



MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING

**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Clopay Building Products Company**  
101 Miller Rd.  
Russia OH 45363

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT SECTION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

Your application for Product Approval of:

**Holmes Models 48W8 & 49W8 Double Car Garage Door.**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This approval shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at anytime from a jobsite or manufacturer's plant for quality control testing.

If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**Acceptance No.: 00-0201.01**

**Expires: 04/21/2003**

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL CONDITIONS**

**BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director

Miami-Dade County  
Building Code Compliance Office

**Approved: 04/21/2000**

1 of 3



Clopay Building Products Company.

ACCEPTANCE No. : 00-0201.01  
APPROVED : APR 21 2000  
EXPIRES : APR 21 2003

**NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS**

**1. SCOPE**

This approves a sectional steel garage door 16'-2" wide x 6'-6" through 8'-0" high, as described in Section 2 of this Notice of Acceptance (NOA), designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County. For the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

**2. PRODUCT DESCRIPTION**

The **Holmes Sectional Garage Door** and its components shall be constructed in strict compliance with the following documents: Drawing No. 102066, titled "Holmes Door Brand" prepared by Clopay Building Products Co., drawn on 12/06/99, checked on 01/25/00, sheet 1 through 2 of 2. They bear the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

**3. LIMITATIONS**

This approval requires the manufacturer to do testing of all coils used to fabricate door panels under this Notice of Acceptance. A minimum of 2 specimens shall be cut from each coil and tensile tested according to ASTM E-8 by a Dade County approved laboratory selected and paid by the manufacturer. Every 3 months, four times a year, the manufacturer shall mail to this office: a copy of the tested reports with confirmation that the specimens were selected from coils at the manufacturer production facilities. And a notarized statement from the manufacturer that only coils with yield strength of 38,000 psi or more shall be used to make door panels for Dade County under this Notice of Acceptance.

**4. INSTALLATION**

- 4.1 The sectional steel garage door and its components shall be installed in strict compliance with the approved drawings.
- 4.2 The installation of this door does **not require** a hurricane protection system.
- 4.3 Units with dimensions equal to or smaller than those shown in the approved drawing shall qualify under this approval.

**5. LABELING**

Each door shall bear a **permanent** label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

**6. BUILDING PERMIT REQUIREMENTS**

- 6.1 Application for building permit shall be accompanied by copies of the following:
  - 6.1.1 This Notice of Acceptance.
  - 6.1.2 Duplicate copies of the approved drawings as identified in Section 2 of this NOA, clearly marked to show the components selected for the proposed installation.
  - 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

  
Candido Font, PE. Sr. Product Control Examiner  
Product Control Division

**Clopay Building Products Company.**

ACCEPTANCE No. : 00-0201.01  
APPROVED : APR 21 2000  
EXPIRES : APR 21 2003

**NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS**

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approval", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
  - b. The product is no longer the same product (identical) as the one originally approved.
  - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
  - d. The engineer, who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a. Unsatisfactory performance of this product or process.
  - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

**END OF THIS ACCEPTANCE**



Candido Font, PE. Sr. Product Control Examiner  
Product Control Division

HOLMES MODELS 48W8 & 49W8


18 GA. GALV. DOUBLE END STILES ATTACHED TO TOP AND BOTTOM RAIL WITH PATENTED TOG-L-LOC SYSTEM.

ONE INTERMEDIATE STILE BETWEEN EACH EMBOSS LOCATION. ATTACHED W/ PATENTED TOG-L-LOC SYSTEM (TOP & BOT) AND URETHANE ADHESIVE (ALONG CENTER)

16 GA. PAINTED END STILES ATTACHED TO DOOR SKIN WITH PATENTED TOG-L-LOC SYSTEM (TOP, BOTTOM & CENTER).

REVISIONS


| REV. NO. | ZONE: | DATE: | ECN NO. | APPVD: | DESCRIPTION |
|----------|-------|-------|---------|--------|-------------|
|          |       |       |         |        |             |

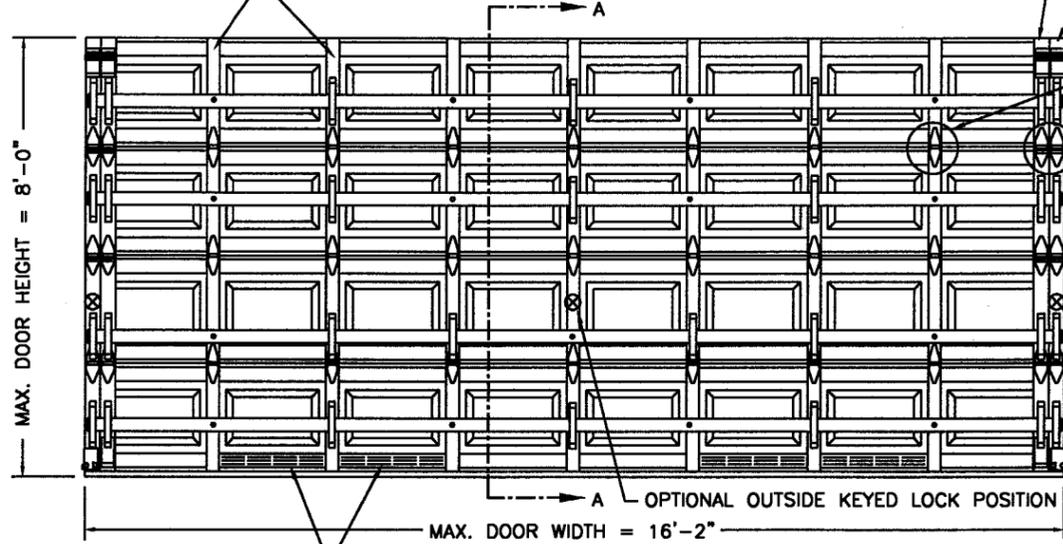

LOCK POSITION (BOTH SIDES) TWO POINT LOCKING CONFORMS TO SFBC 3603.2 REGARDING GARAGE DOORS WITH 5/8" MIN. ENGAGEMENT. DOOR TESTED FOR FORCED ENTRY WITH BOTH OUTSIDE KEYED LOCK AND INSIDE SLIDE BOLT LOCK OPTIONS (SEE LAYOUT OF EACH LOCK ON NEXT PAGE).

24 GA. DQSK STEEL (MIN. YIELD STRENGTH: 38 KSI) EXTERIOR SKIN WITH G-60 GALVANIZING, BAKED-ON PRIMER AND A BAKED-ON POLYESTER PAINTED TOP COAT APPLIED TO BOTH SIDES OF STEEL SKIN. (ASTM No. A653).

12 GA. GALV. STEEL TOP ROLLER BRACKET. EACH BRACKET ATTACHED W/(4) #14x5/8" SHEET METAL SCREWS. ADJUSTABLE SLIDE ATTACHED TO TOP BRACKET WITH (2) 1/4"x1/2" BOLTS AND NUTS PER BRACKET.



VIEW "D"  
6" TALL C-CHANNEL  
16 GA. GALV. STEEL

14 GA. GALV. ROLLER HINGE. EACH HINGE FASTENED TO END STILES W/(4) #14x5/8" SHEET METAL AND (4) 1/4"x3/4" SELF TAPPING SCREWS. (SEE VIEW "B")

ONE 6" TALL C-CHANNEL PER DOOR SECTION. (SEE VIEW "D") C-CHANNEL ATTACHED AT EACH STILE LOCATION WITH (1) 1/4"x3/4" SELF TAPPING SCREW.


1-1/4" WIDE x 16 GA. GALV. STRAP. (7) PER DOOR SECTION, EXCEPT (8) STRAPS ON 2ND SECTION (SEE INSIDE ELEVATION). EACH STRAP ATTACHED WITH (3) 1/4"x3/4" SELF TAPPING SCREWS (TWO SCREWS TO DOOR, ONE SCREW TO C-CHANNEL).

13 GA. GALV. STEEL BOTTOM BRACKET. ATTACHED WITH (2) #14x5/8" SHEET METAL SCREWS.

ALUMINUM EXTRUSION & VINYL WEATHERSTRIP.

SECTION A-A (SIDE VIEW)  
SCALE 1" = 9"

SHIP LAP JOINTS.

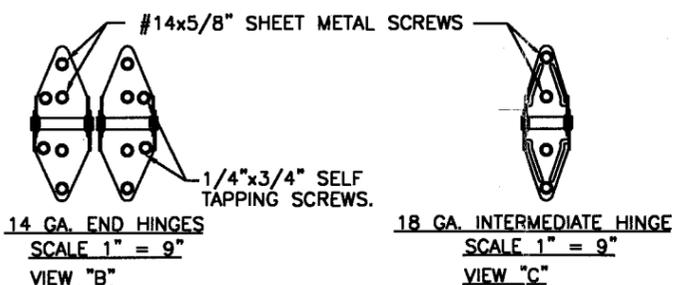

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE April 27, 2000  
BY [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0201.01

DESIGN ENGINEER  
MARK W. WESTERFIELD, P.E.  
FLORIDA REGISTRATION No. 48495

DESIGN LOADS: +46.6 P.S.F. & -52.0 P.S.F.

LOCATION OF OPTIONAL VENTS AREA OF VENTS NOT TO EXCEED 60 SQ. INCHES BETWEEN STILES

| DEALER MODEL | RETAIL MODEL | DESCRIPTION  |
|--------------|--------------|--|
| 49W8         | 48W8         | WOODGRAIN TEXTURE, RAISED PANEL, PAINTED/GALV. INTER. STILES |

NOTE:  
DOORS UP TO 7'-0" HIGH CONSIST OF (4) SECTIONS (SHOWN).  
DOORS OVER 7'-0" HIGH CONSIST OF (5) SECTIONS (NOT SHOWN).

HORIZONTAL TRACK SUPPORT BY DOOR INSTALLER (TO SUIT)

DOOR COUNTERBALANCE SYSTEM

12 GA. GALV. STEEL CONTINUOUS 1-5/8" x 2-3/8" ANGLE.


76" (7'6"H & 8'0"H DOORS ONLY)

TRACK CONFIGURATION SCALE 1" = 36"

| DOOR HEIGHT | "L" |
|-------------|-----|
| 6'-6"       | 70" |
| 7'-0"       | 76" |
| 7'-6"       | 82" |
| 8'-0"       | 88" |

2" GALV. STEEL TRACK, TRACK THICKNESS: .083"

TYP. 2-1/2"x12 GA. GALV. STEEL TRACK CLIPS. DISTANCE FROM BOTTOM OF VERTICAL TRACK TO EACH CLIP IS: 3-1/2", 10", 24", 38", 50", 63", AND 76" (7'6"H & 8'0"H DOORS ONLY) ONE 5/16"x1-5/8" LAG SCREW PER TRACK CLIP.



Unless Stated Otherwise TOLERANCES are  
.0 = ±.03  
.00 = ±.015  
.000 = ±.005  
.0000 = ±.001  
Degrees = ± 1/2"

|   |   |                   |             |
|---|---|-------------------|-------------|
| CLOPAY BUILDING PRODUCTS COMPANY                              | 312 Walnut St. Suite 1600 Cincinnati, OH 45202<br>Tel. No. 1-513-381-4800<br>Fax No. 1-513-762-3519 | HOLMES DOOR BRAND |             |
| DESCRIPTION: HOLMES MODELS 48W8 & 49W8 MAX SIZE: 16'2" x 8'0" |   |                   |             |
| DRAWN BY: NJE   | DATE: 12/6/99   | SCALE:            | DWG. SIZE B |
| CHECKED BY: MWW   | DATE: 01/25/00  | SHEET 1 OF 2      |             |
| DWG. NO.: 102066  |   | REV. NO. 00       |             |

00-0201.01

| REVISIONS |       |       |         |        |             |
|-----------|-------|-------|---------|--------|-------------|
| REV. NO.  | ZONE: | DATE: | ECN NO. | APPVD: | DESCRIPTION |
|           |       |       |         |        |             |

HOLMES MODELS 48W8 & 49W8

**2x6 JAMB TO SUPPORTING STRUCTURE ATTACHMENT**

**NOTES:**




- 1) ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE TRACK AND THEN FROM THE TRACK TO THE 2x6 VERTICAL JAMBS (GRADE 2 OR BETTER YELLOW PINE). NO LOAD FROM THE DOOR IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB.
- 2) EACH VERTICAL JAMB SEES A MAXIMUM DESIGN LOAD OF +2,982.4 LB & -3,328 LB AND A MAXIMUM TEST LOAD OF 4,480 LB & -4,992 LB.
- 3) ALL JAMB FASTENERS MAY BE (BUT NOT REQUIRED) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.

**WOOD FRAME BUILDINGS**

STUD WALLS OF DOOR OPENING SHALL BE FRAMED SOLID BY NOT LESS THAN (3) 2x6 PRESSURE TREATED GRADE #2 OR BETTER WOOD STUD OF A STRESS GRADE NOT LESS THAN 1200 PSI NOMINAL EXTREME FIBER STRESS IN BENDING (F<sub>b</sub>). STUD WALLS TO BE CONTINUOUS FROM FOOTING TO TIE BEAMS AND IN ACCORDANCE WITH SFBC SECTION 2905.1.

**BLOCK WALL OR CONCRETE**

2x6 WOOD JAMB SHALL BE ANCHORED TO GROUT REINFORCED BLOCK WALL OR CONCRETE COLUMN. BLOCK WALL CELLS SHALL BE FILLED WITH CONCRETE AND REINFORCED WITH #5 BAR EXTENDING INTO THE FOOTING AND INTO TIE BEAMS. ALL BARS SHALL BE CONTINUOUS FROM THE TIE BEAMS TO FOOTING PER BLOCK WALL OR CONCRETE COLUMN. BLOCK WALLS AND CONCRETE COLUMNS TO BE DESIGNED BY BUILDING PROFESSIONAL OF RECORD AND IN ACCORDANCE WITH SFBC SECTION 2704.2.

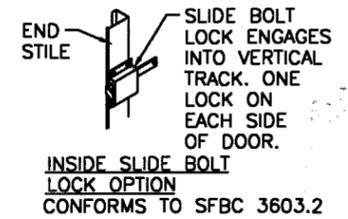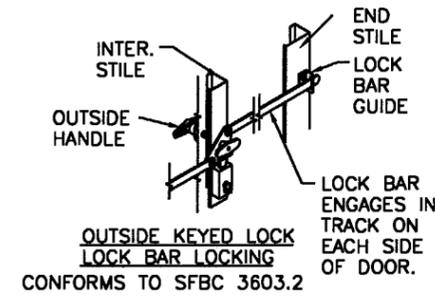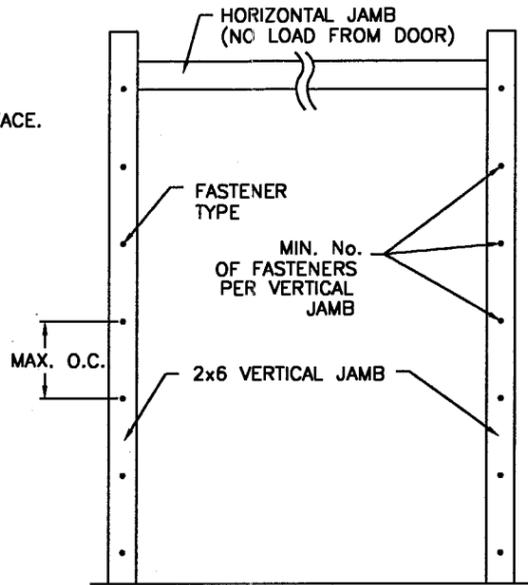


**2x6 JAMB TO SUPPORTING STRUCTURE ATTACHMENT**

(NOT TO BE USED FOR ATTACHMENT OF TRACK ANGLE TO 2x6 VERTICAL JAMBS OR SUPPORTING STRUCTURE)

| BUILDING TYPE          | FASTENER TYPE   | MIN. No. OF FASTENERS PER VERTICAL JAMB | MAXIMUM ON CENTER DISTANCE BETWEEN FASTENERS | STEEL WASHERS REQUIRED? |
|------------------------|---|---|--|-------------------------|
| WOOD FRAME             | 1/2" x 3" EMBED LAG SCREW (ASTM A307, GRADE A)                    | 6                                       | 16"  | YES                     |
| BLOCK WALL OR CONCRETE | 1/4" x 1-3/4" MIN. EMBED TAPCON CONCRETE ANCHOR                   | 9                                       | 10"  | YES                     |
| BLOCK WALL OR CONCRETE | 3/8" x 1-3/4" MIN. EMBED RAWL-STUD EXPANSION ANCHOR (7400 SERIES) | 5                                       | 19"  | NO                      |
| BLOCK WALL OR CONCRETE | 3/8" x 1-3/4" MIN. EMBED RAWL LOK/BOLT ANCHOR BOLT (5000 SERIES)  | 6                                       | 16"  | NO                      |

MINIMUM DISTANCE BETWEEN CENTER OF ANCHOR AND EDGE OF CONCRETE BLOCK: 3", EXCLUDING STUCCO THICKNESS. CLOPAY DOES NOT SUPPLY JAMB ATTACHMENT FASTENERS.

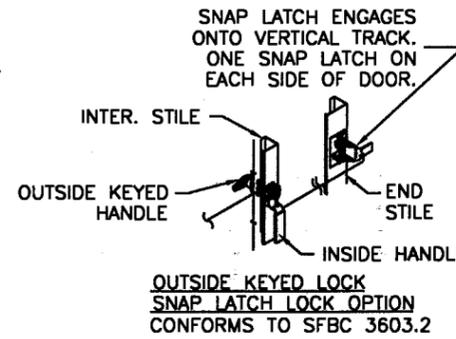


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE April 21, 2000  
 BY [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 00-0201.01

**JAMB PREPARATION NOTE**

EACH CONTINUOUS ANGLE TRACK SHALL BE FASTENED TO PRESSURE TREATED 2x6 YELLOW PINE WOOD JAMBS WITH 5/16"x1-5/8" LAG SCREWS (12 LAG SCREWS PER SIDE UP TO 7'0" HIGH AND (13) LAG SCREWS PER SIDE UP TO 8'0" HIGH). THE METHOD OF ATTACHMENT TO THE SUPPORTING STRUCTURE OF THE PRESSURE TREATED 2x6 WOOD JAMBS SHALL BE APPROVED BY THE PROFESSIONAL OF RECORD FOR THE STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING OR AS SHOWN ON PAGE 4 OF THIS DRAWING. PREPARATION OF JAMBS BY OTHERS.

ALL MOUNTING OF TRACK, ANGLES, HORIZONTAL TRACK SUPPORTS, AND ALL OTHER DOOR HARDWARE TO BE INSTALLED PER CLOPAY INSTALLATION INSTRUCTIONS SUPPLIED WITH DOOR SYSTEM UNLESS OTHERWISE NOTED.

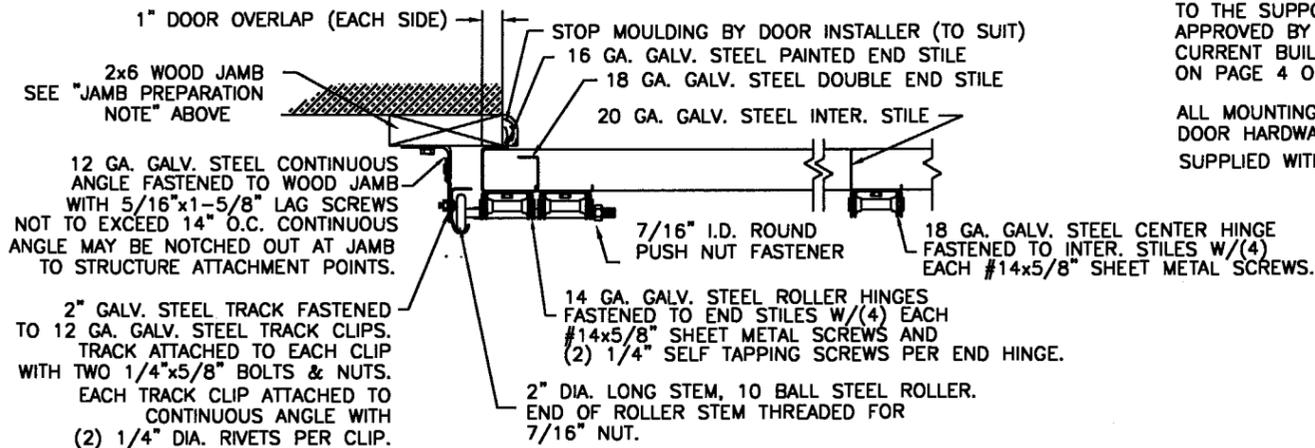

JAMB CONFIGURATION

DESIGN ENGINEER  
 MARK W. WESTERFIELD, P.E.  
 FLORIDA REGISTRATION No. 48495

DESIGN LOADS: +46.6 P.S.F. & -52.0 P.S.F.

|  |  |                   |
|--|--|-------------------|
| Unless Stated Otherwise TOLERANCES are<br>.0 = ±.03<br>.00 = ±.015<br>.000 = ±.005<br>.0000 = ±.001<br>Degrees = ±1/2' | CLOPAY BUILDING PRODUCTS COMPANY<br>312 Walnut St. Suite 1600 Cincinnati, OH 45202<br>Tel. No. 1-513-381-4800 Fax No. 1-513-762-3519 | HOLMES DOOR BRAND |
| DESCRIPTION: HOLMES MODELS 48W8 & 49W8 MAX SIZE: 16'2" x 8'0"  | DWG. NO.: 102066   | REV. NO. 00       |
| DRAWN BY: NJE  | DATE: 12/6/99  | SCALE:            |
| CHECKED BY: MWW  | DATE: 01/25/00   | SHEET 2 OF 2      |
| Third Angle Projection   |  | DWG. SIZE B       |