



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Metal Sales Manufacturing Corporation**  
7800 State Road 60  
Sellersburg IN 47172

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT SECTION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

Your application for Product Approval of:

***Stile TM Metal Roof***

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This approval shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at anytime from a jobsite or manufacturer's plant for quality control testing.

If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**Acceptance No.:** 00-0214.06

**Expires:** 06/29/2003

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL  
CONDITIONS  
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director

Miami-Dade County  
Building Code Compliance Office

**Approved:** 06/29/2000



**ROOFING SYSTEM APPROVAL:**

Category: Roofing  
Sub-Category: Metal, Panels

Approval Date: **June 29, 2000**Expiration Date: **June 29, 2003**System Trade Names:

**Metal Sales**  
**STILE Metal Roof Panel**

**TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:**

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Stile Metal Roof	l = 3' to 20' w = 42.3" h = 1.18" min. 26 gage	PA 110	Corrosion resistant, galvanized, preformed, coated, prefinished, metal panels.
Trim Pieces	l = varies w = varies min. 26 ga.	PA 110	Standard flashing and trim pieces. Manufactured for each panel width.

**TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS:**

<u>Product</u>	<u>Dimensions</u>	<u>Product Description</u>	<u>Manufacturer</u>
#30 Felt	N/A	Saturated organic felt to be used as a nailed underlayment.	generic
#43 Coated Base Sheet	N/A	Saturated and coated organic base sheet for single or double ply underlayment.	generic
Fire Barrier Board ("Dens Deck")	min. 1/4" thick	Fire barrier for Class 'A' fire rating.	Georgia-Pacific with current PCA
Fire Barrier ("Roctex")	min. 450 grams/m <sup>2</sup>	Fire barrier for Class 'A' fire rating.	Partek Insulations, Inc.
Fasteners (Panel)	min. #10 coarse thread wood screw.	Corrosion resistant, pancake head, self-drilling, self-threading with sealing washers screws	generic
Sealant	N/A	Sealant for use at foam closure strip.	generic



Frank Zuloaga, RRC  
Roofing Product Control Examiner

**APPROVED ASSEMBLIES:**

**SYSTEM A:** STILE Metal Roof Panel

**Deck Type:** Wood, Non-insulated

**Deck Description:** New Construction or Re-roof  
19/32" or greater plywood or wood plank.

**Slope Range:** 3":12" or greater

**Maximum Uplift Pressure:** The maximum allowable design pressure for the STILE metal panel shall be **-122.5 psf**

**Deck Attachment:** In accordance with chapter 29 of the SFBC, but in no case shall it be less than #8 x 1-7/8" course thread screws spaced 6" o.c. In reroofing, where the deck is less than 19/32" thick (minimum 15/32"), the above attachment method must be in addition to existing attachment.

**Underlayment:** Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 12 gauge 1 1/4" annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll.

**Valleys:** Valley construction shall be in compliance with Miami-Dade County Roofing Application Standard RAS 133 and with Metal Sales Manufacturing Corporation's current published installation instructions.

**Fire Barrier Board:** For class A or B fire rating, install minimum 1/4" thick Georgia Pacific "Dens Deck" or one layer of "Roctex" or 5/8" water resistant type X gypsum sheathing with treated core and facer, over the deck prior to installing the underlayment in compliance with Miami-Dade County Roofing Application Standard RAS 133.

**Metal Panels and Accessories:** Install the "STILE Panels" and accessories in compliance with Metal Sales Manufacturing Corporation's current, published installation instructions and details. Flashing, penetrations, valley construction and other details shall be constructed in compliance with the minimum requirements provided in Miami-Dade County Roofing Application Standards RAS 133. Panel fasteners shall be #10 x 1-1/2" self drilling, self tapping, hex head screws with sealing washer of sufficient length to penetrate through the sheathing a minimum of 3/16 inch. Fasteners shall be installed at every other tile valley at a maximum of (10" o.c.) and every third vertical step at a maximum of (36" o.c.) and at every step (12" o.c.) at the panel edges. At end laps shall be fastened at every tile valley (5" o.c.). All side laps shall be fastened with stainless steel pop rivets (1/8" x 3/16") fastened at a maximum of 12" o.c.




Frank Zuloaga, RRC  
Roofing Product Control Examiner


**SYSTEM LIMITATIONS:**

1. The minimum roof pitch for Metal Sales Manufacturing Corporation applications shall be a 3" rise in 12" run (3":12").
2. The maximum uplift pressures noted for each System shall meet or exceed the design pressures for the field, perimeter and corner areas determined in compliance with Chapter 23 of the South Florida Building Code. Increased design pressures at perimeter and corner areas may be met through rational analysis by increasing number of attachment points in these areas. All rational analysis computations shall be conducted, signed and sealed by a Professional Engineer.
3. All panels shall be permanently labeled with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved. All clips shall be stamped with manufacturer's name and model.

**PROFILE DRAWINGS:**

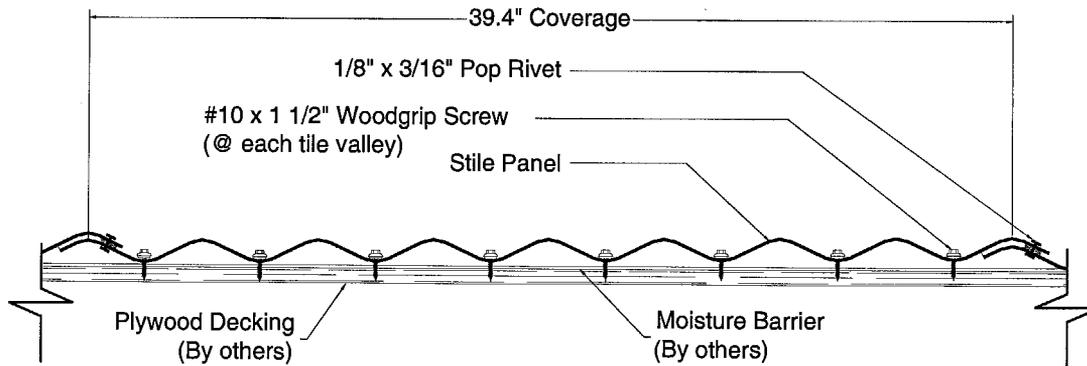

**FASTENING PATTERN AT RIDGE AND ENDLAPS**

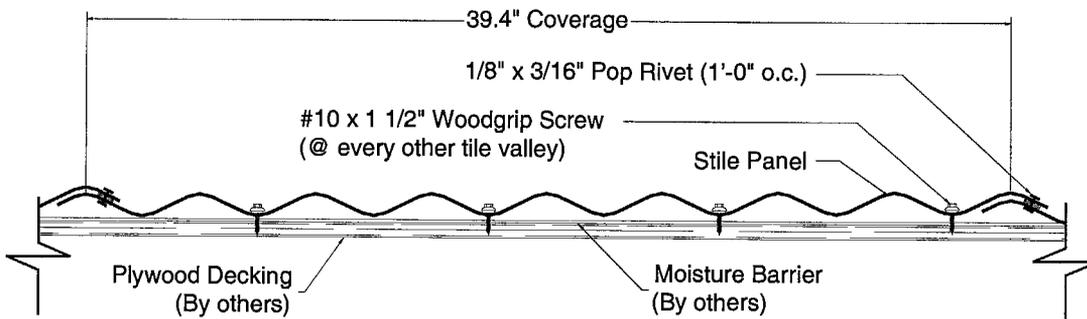

**FASTENING PATTERN AT EAVE AND INTERIOR OF PANEL**

**STILE METAL ROOF PANEL**

Frank Zuloaga, RRC  
Roofing Product Control Examiner

**NOTICE OF ACCEPTANCE STANDARD CONDITIONS**

- 1 Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
- 2 Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
- 3 Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
- 4 Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
- 5 Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process;
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
- 6 The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
- 7 A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all times. The copies need not be resealed by the engineer.
- 8 Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
- 9 This Acceptance contains pages 1 through 5.


**END OF THIS ACCEPTANCE**

Frank Zuloaga, RRC  
Roofing Product Control Examiner

**EVIDENCE SUBMITTED:**

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Akzo Coatings		ASTM G 23 ASTM B 117	
Valspar Corporation		ASTM G 23 ASTM B 117	
Underwriters Laboratory	R9697	UL 790	July 1998
Celotex Corporation Testing Services	MTS 520103-2	PA 100	Dec. 1998
Celotex Corporation Testing Services	MTS 520103	ASTM E 8	Jan. 1999
Hurricane Test Laboratory, Inc.	0103-1213-98	PA 125	Dec. 1998

E-1

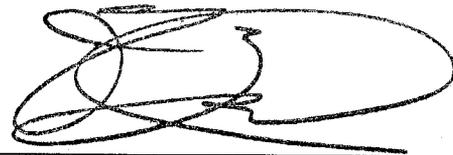

Frank Zuloaga, RRC  
Roofing Product Control Examiner