



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Curries Company
525 9th Street S.E., P.O. Box 1648
Mason City ,IA 50401

Your application for Notice of Acceptance (NOA) of:

Series 707 Flush w\glazed vision Single Outswing Commercial Steel Door-Impact.

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-0307.09
EXPIRES: 08/10/2003

Raul Rodriguez
Chief Product Control Division

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 08/10/2000



Curries Company

ACCEPTANCE No.: 00-0307.09

APPROVED : AUG 1 0 2000

EXPIRES : AUG 1 0 2003

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

1.1 This approves a commercial steel door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

2.1 The **Series 707 Flush w\ glazed vision Single Outswing Commercial Steel Door –Large Missile Impact Resistant** and its components shall be constructed in strict compliance with the following documents: Drawing No **RD0055**, titled “Curries series 707 glazed commercial steel door”, prepared by manufacturer, sheets 1 through 12 of 12 dated 10/29/99 and latest revised on 06-29-00, signed and sealed by Richard Boyette, P.E. , bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

3.1 This approval applies to single unit applications of of door, as shown in approved drawings.
3.2 Unit shall be installed only at locations protected by a canopy or overhang such that the angle between the edge of canopy or overhang to sill is less than 45 degrees. Unless unit is installed in non-habitable areas where the unit and the area are designed to accept water infiltration.

4. INSTALLATION

4.1 The commercial steel door and its components shall be installed in strict compliance with the approved drawings.
4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.

5. LABELING

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:
6.1.1 This Notice of Acceptance
6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

Curries Company

ACCEPTANCE No.: 00-0307.09

APPROVED : AUG 10 2000


EXPIRES : AUG 10 2003

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

END OF THIS ACCEPTANCE

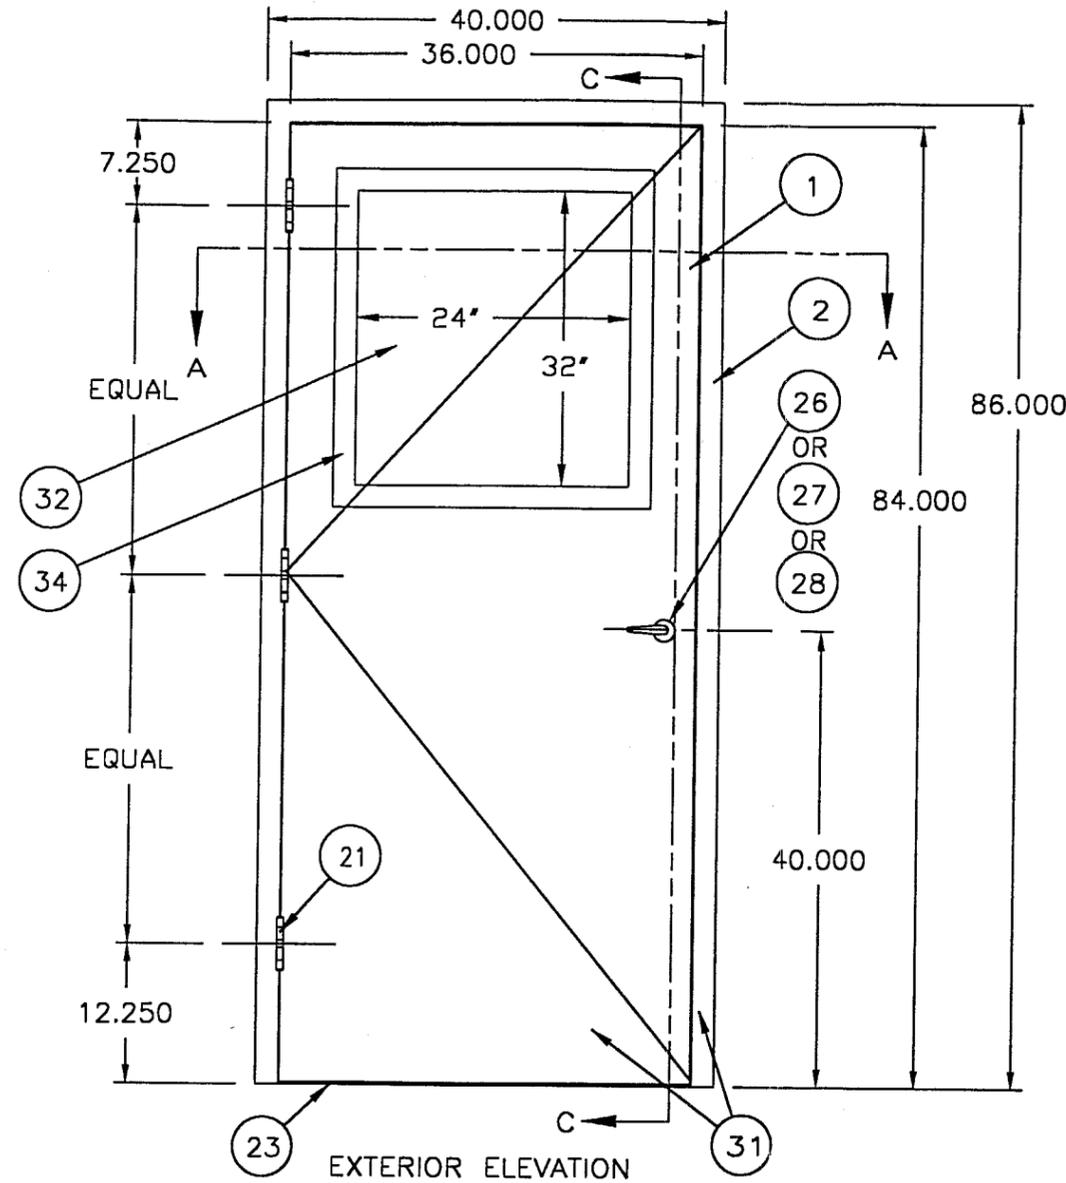

FOR GLAZING:
 MINIMUM WIDTH 12", MAXIMUM WIDTH 24"
 MINIMUM HEIGHT 12", MAXIMUM HEIGHT 32"
 NOT TO EXCEED VISIBLE AREA OF
 768 SQUARE INCHES

DESIGN PRESSURE RATING FOR
 LOCKS AS INDICATED ON SHEET 12 (ITEMS 26, OR 27, OR 28.)


	WHERE WATER INFILTRATION REQUIREMENT IS REQUIRED	WHERE WATER INFILTRATION REQUIREMENT IS NOT REQUIRED
POSITIVE	NOT APPROVED	+72
NEGATIVE	NOT APPROVED	-72

NOTE: FOR ANCHOR LOCATIONS, SEE INTERIOR ELEVATIONS

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE August 10, 2000
 BY Ishag I. Chaudh
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0307.09

REV	DATE	DESCRIPTION	DR	CK	SC
		CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
		TITLE: CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR EXTERIOR ELEVATION			
		DR: L. SHERIFF			
		CK: N. KRASCHEL			
		SCAN: -			
		TOLERANCE: UNLESS OTHERWISE SPECIFIED			
		DEC± .031			
		ANG± .5°			
		FRAC± 1/32			
		SH SZ: B	SH.NO. 1 OF 12	DWG.NO.	
		SCALE: 1:16	DATE: 29-OCT-99	RDO055	

RICHARD BOYETTE
 FL Civil PE #42485
 4031 Coconut Blvd
 Royal Palm Bch FL 33411
 (561) 790-5766 Voice / Fax
Richard Boyette
 12/9/99 99-1213

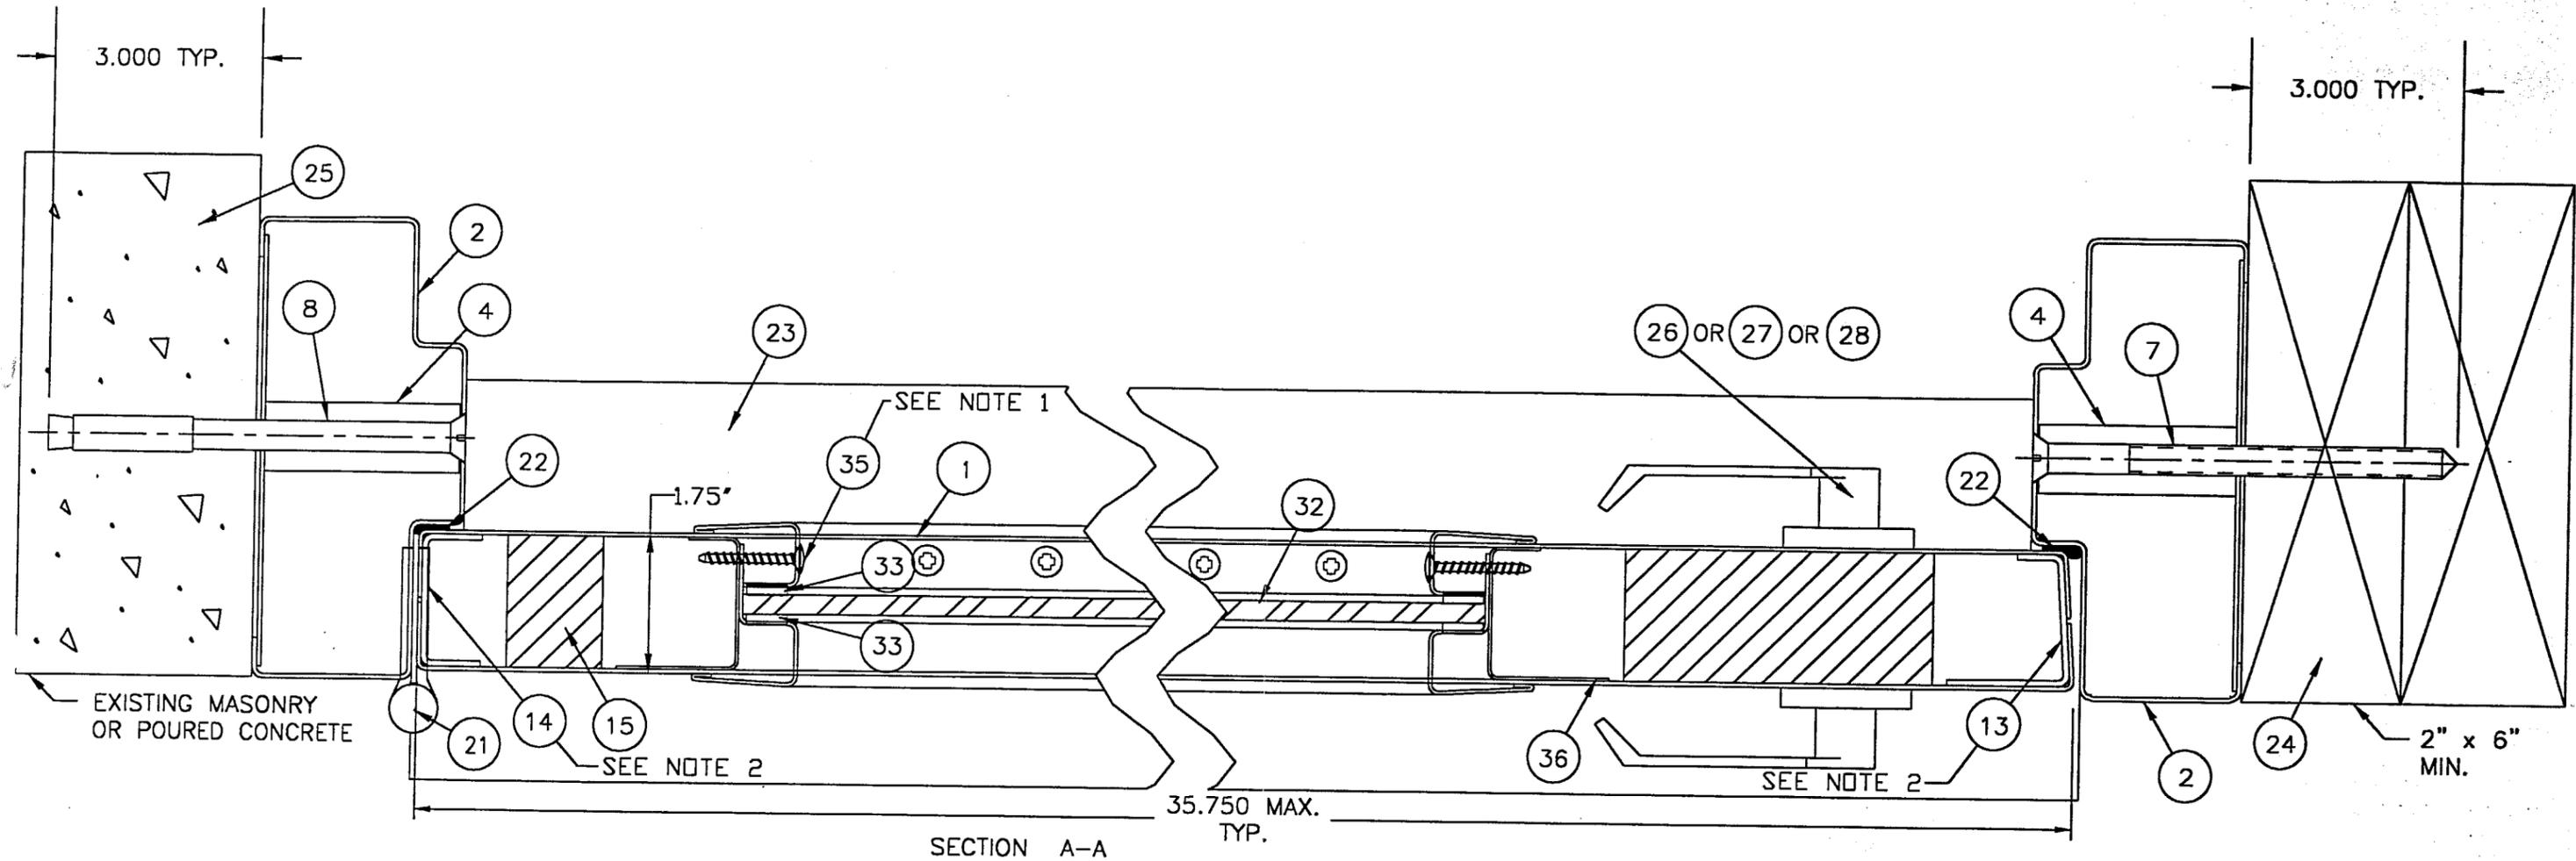


NOTE 1: TEK SCREW LOCATIONS

NOTE 2: DOOR SKINS SPOT WELDED TO PARTS 13 AND 14

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE August 10, 2000
 BY Isaac I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0307-09

REV	DATE	DESCRIPTION	DR	CK	SC
DR:	L. SHERIFF	CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
CK:	N. KRASCHEL				
SCAN:	-	TITLE:			
TOLERANCE: UNLESS OTHERWISE SPECIFIED		CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR HORIZONTAL CROSS SECTION			
DEC±	.031	SH.NO. 3 OF 12	DWG.NO.		
ANG±	.5°				
FRAC±	1/32				
SH SZ:	B	DATE: 29-OCT-99			
SCALE:	1:2				RD0055

RICHARD BOYETTE
 FL Civil PE #42485
 4031 Coconut Blvd
 Royal Palm Bch FL 33411
 (561) 790-5766 Voice / Fax
Richard Boyette
 12/9/99

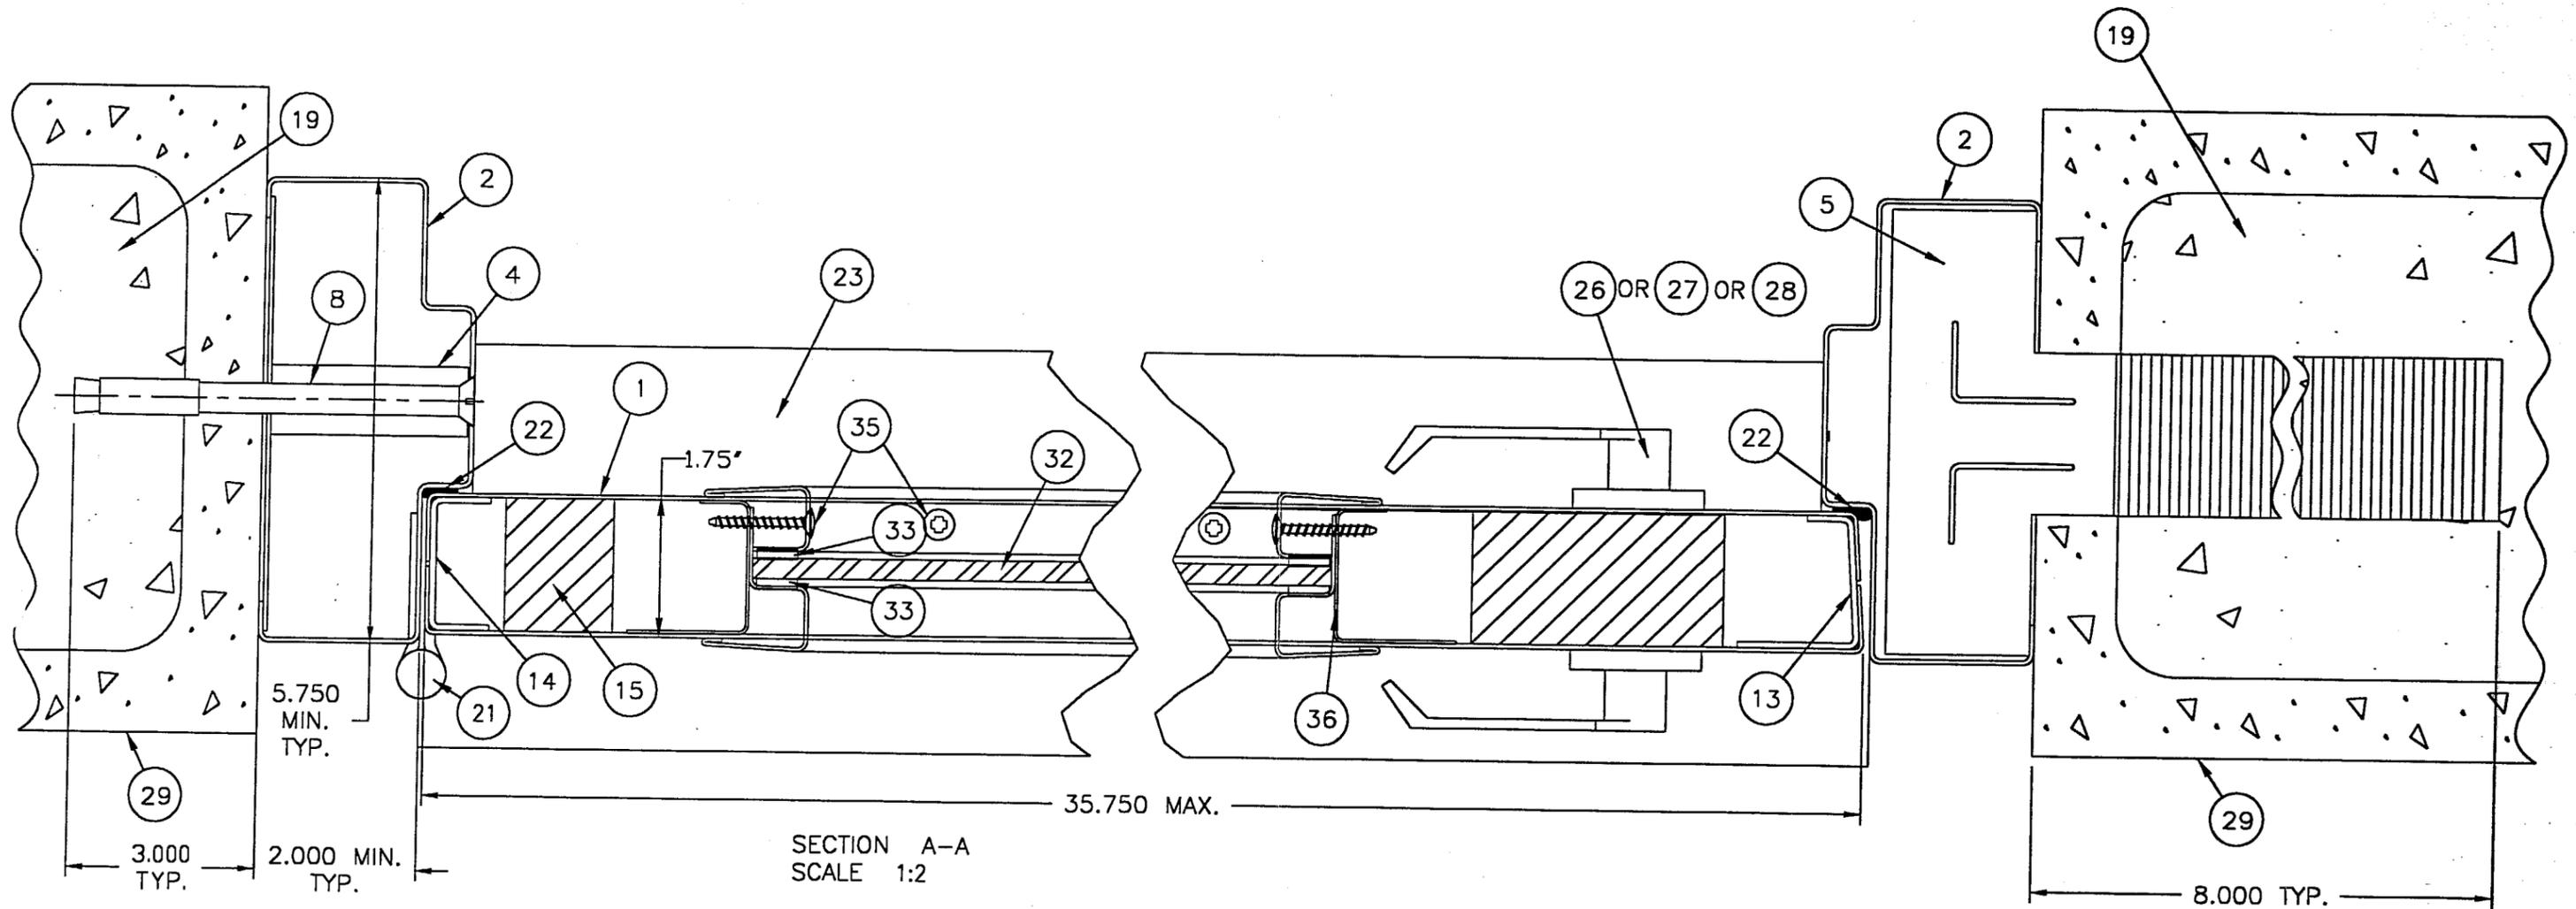


SECTION A-A
SCALE 1:2


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *August 10, 2000*
BY *Isaac I. Chanda*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0307.09*

REV	DATE	DESCRIPTION	DR	CK	SC
		CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
		TITLE: CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR HORIZONTAL CROSS SECTION			
		TOLERANCE: UNLESS OTHERWISE SPECIFIED			
		DEC± .031			
		ANG± .5°			
		FRAC± 1/32			
		SH SZ: B	SH.NO. 4 OF 12	DWG.NO.	
		SCALE: 1:16	DATE: 29-OCT-99	RDO055	

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax
Richard Boyette
12/9/99

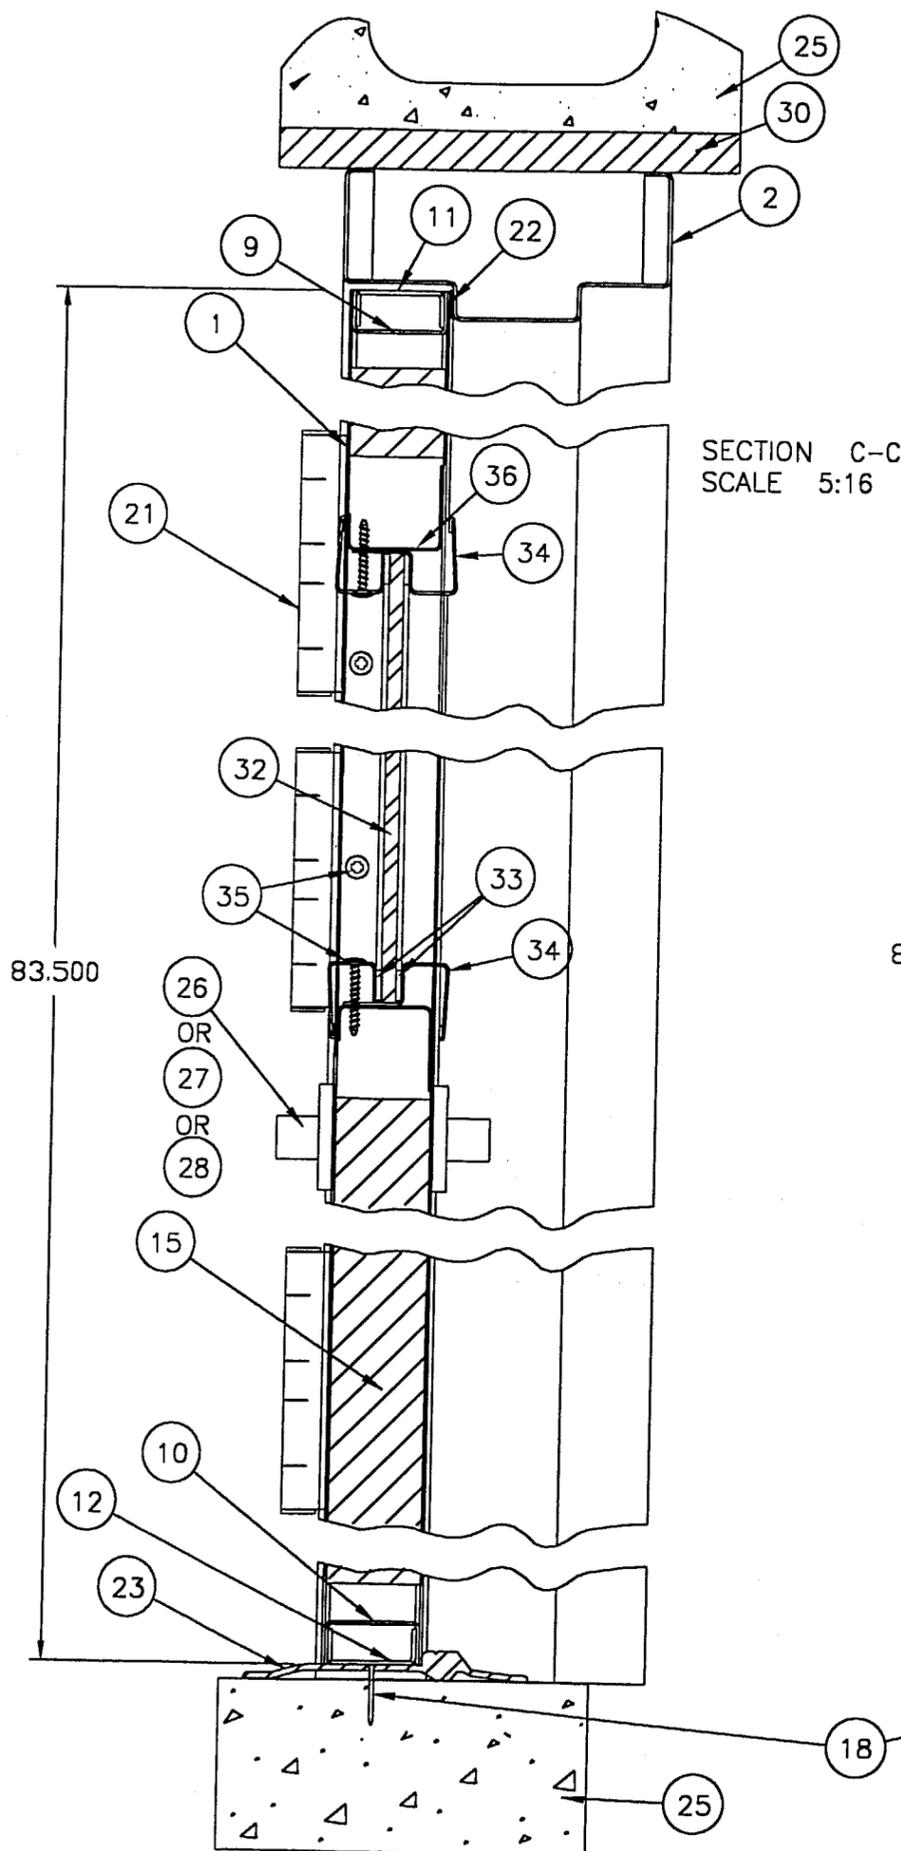

SECTION C-C
SCALE 5:16

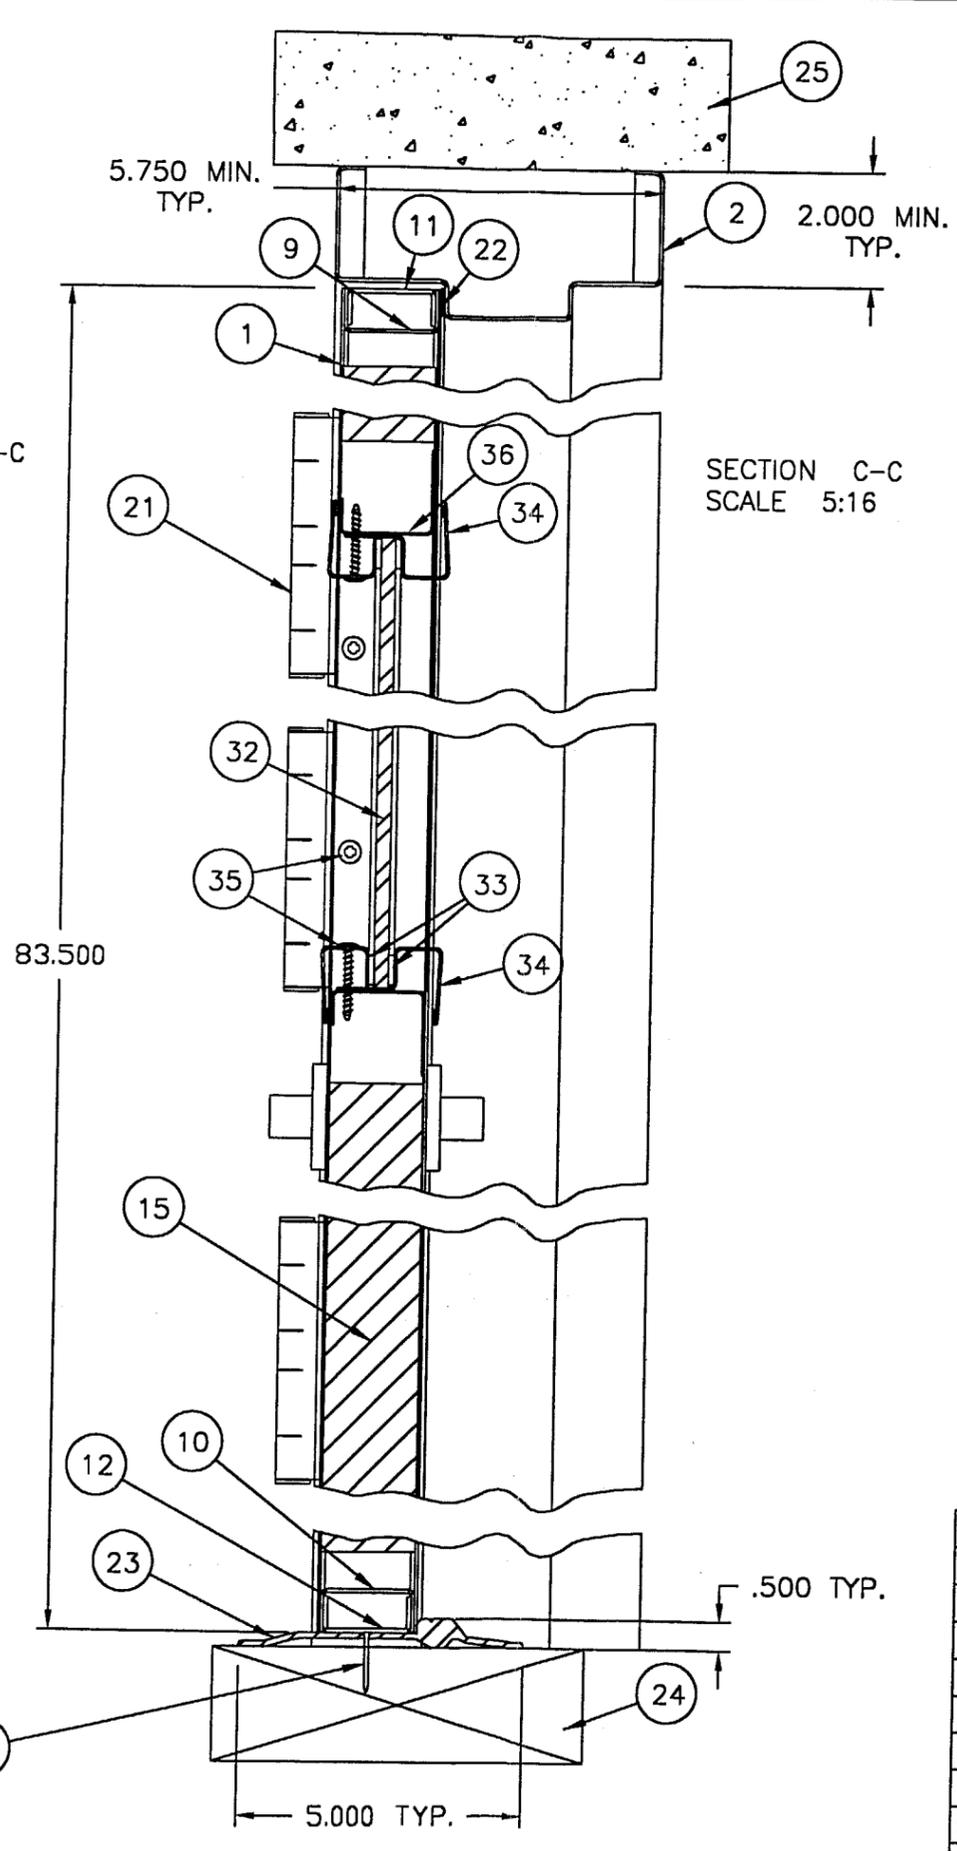


SECTION C-C
SCALE 5:16

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE August 10, 2000
BY Ishaq I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0307.07

REV	DATE	DESCRIPTION	DR	CK	SC
DR:	L. SHERIFF	CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
CK:	N. KRASCHEL				
SCAN:	-				
TOLERANCE:	UNLESS OTHERWISE SPECIFIED	TITLE:	CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR VERTICAL CROSS SECTION		
DEC±	.031	SH SZ:	B	SH.NO. 5 OF 12	DWG.NO.
ANG±	.5°	SCALE:	5:16	DATE: 29-OCT-99	RDO055
FRAC±	1/32				








RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax
Richard Boyette
12/9/99

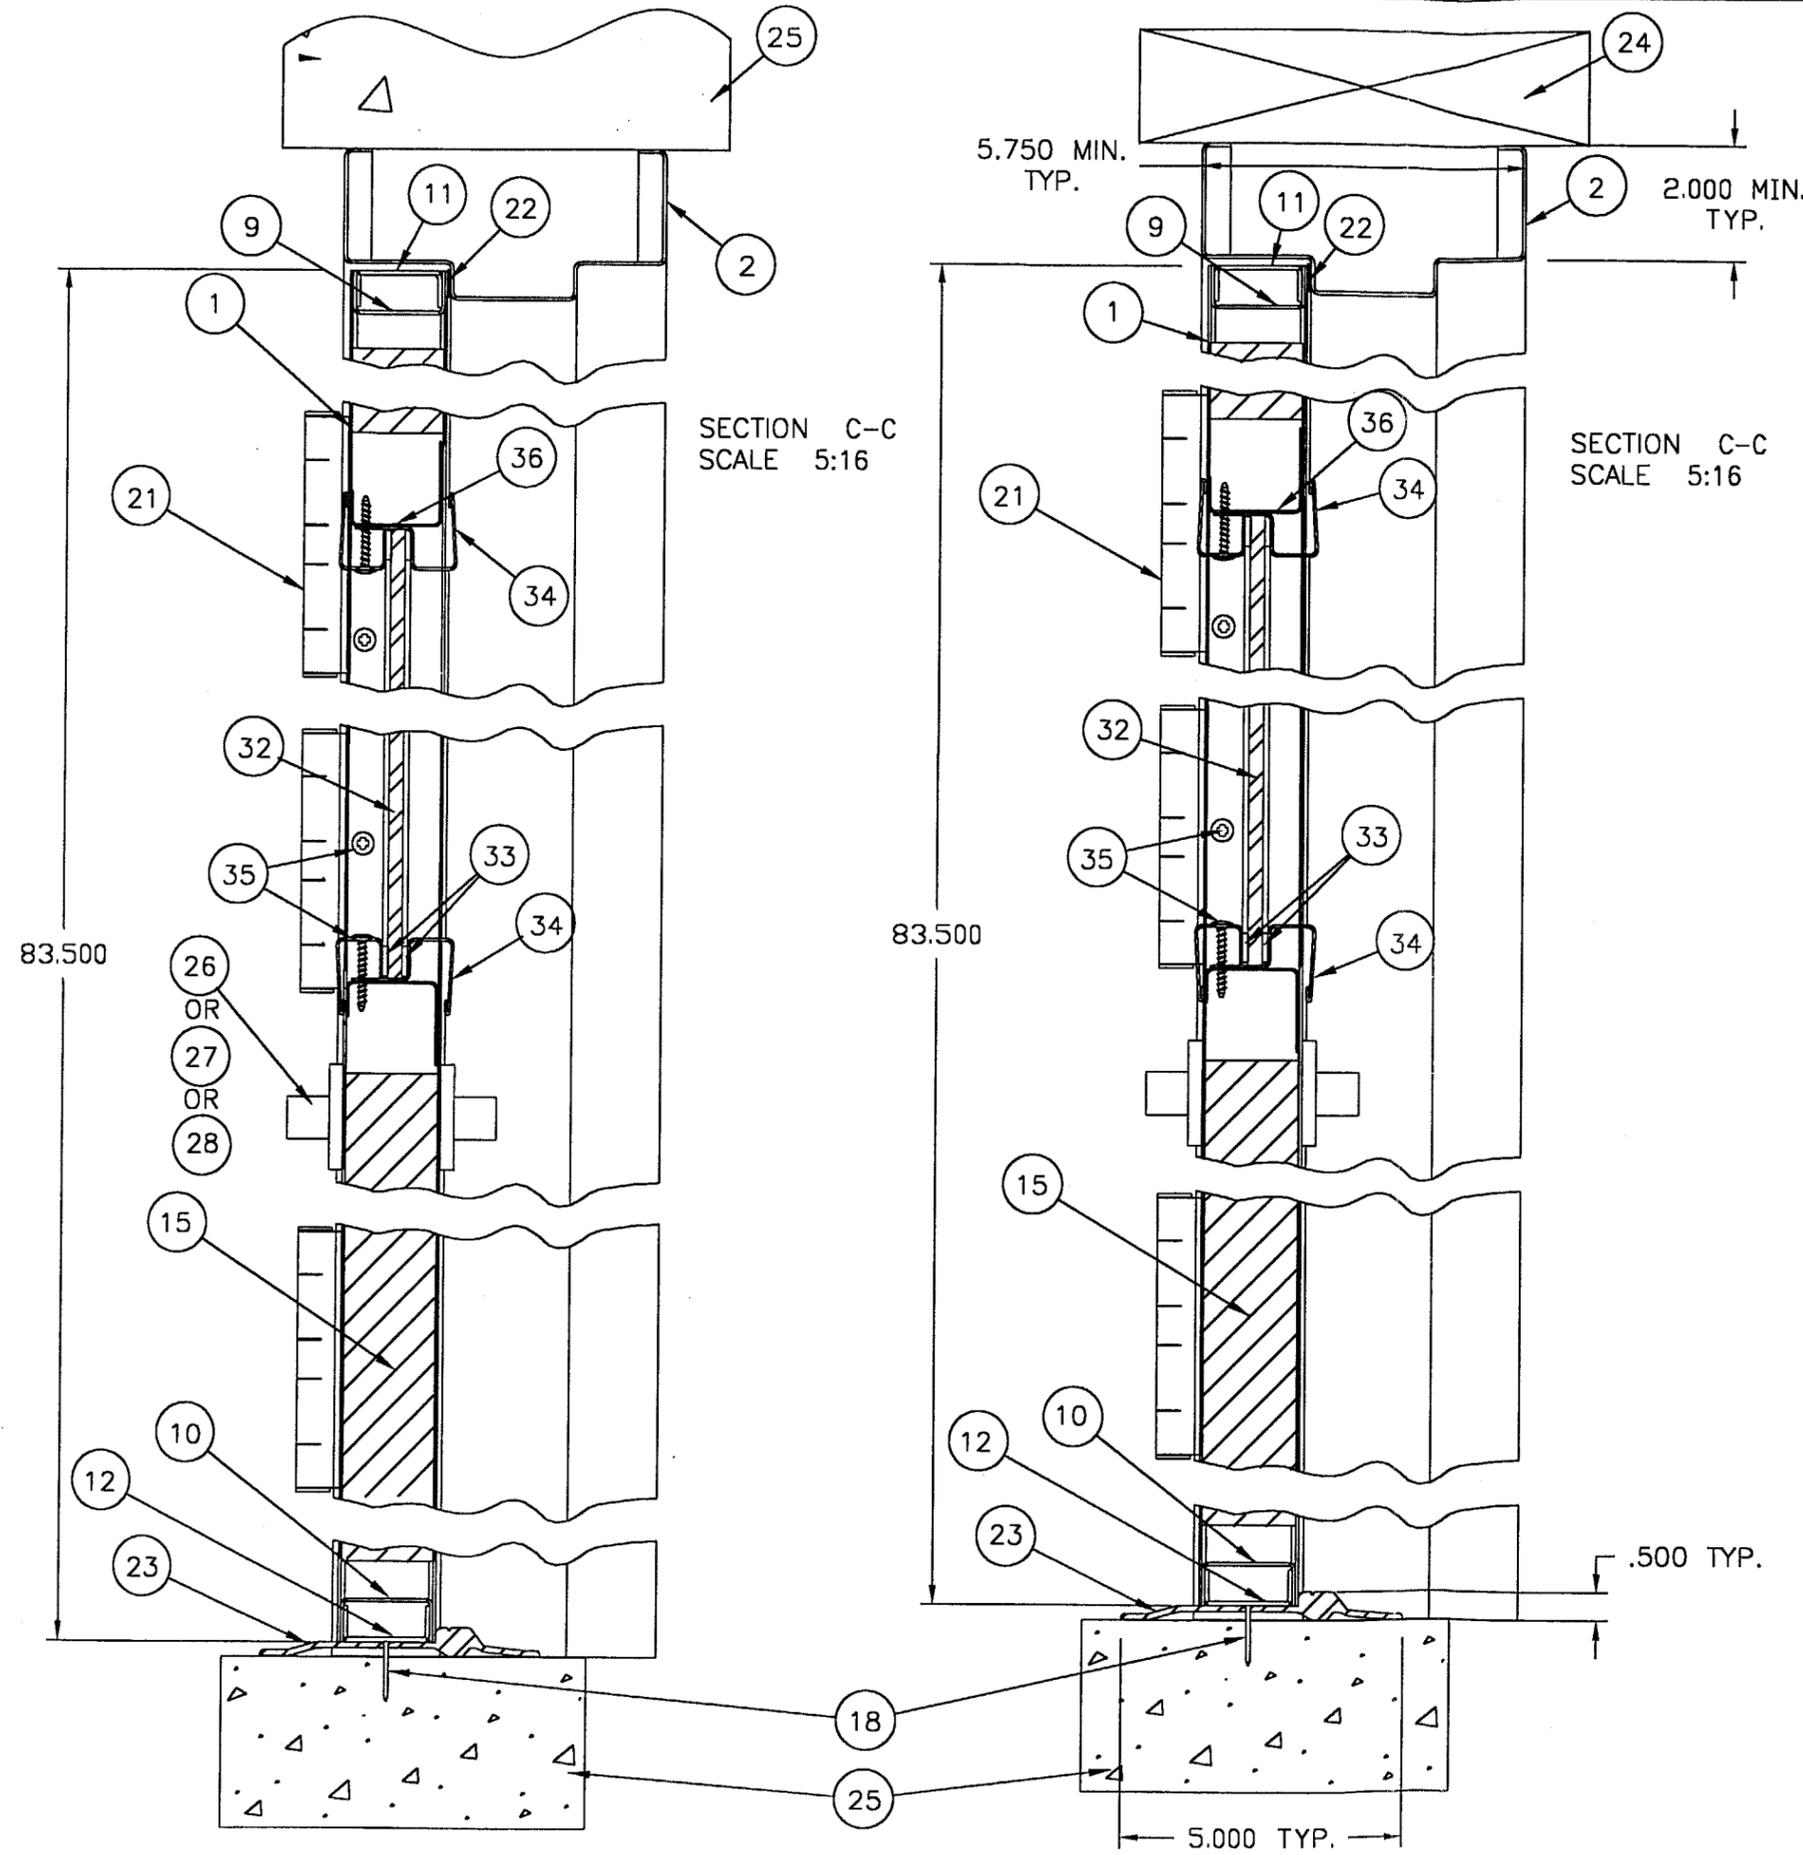

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE August 10, 2000
 BY Ishaq I. Chande
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0307-09

Richard Boyette ^{02/29/00}
RICHARD BOYETTE
 FL PE # 42485
 4031 COCONUT BLVD
 ROYAL PALM BCH FL 33411
 561-790-5766


REV	DATE	DESCRIPTION	DR	CK	SC
DR:	L. SHERIFF	CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
CK:	N. KRASCHEL				
SCAN:	-	TITLE: CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR VERTICAL CROSS SECTION			
TOLERANCE:	UNLESS OTHERWISE SPECIFIED				
DEC±	.031				
ANG±	.5°				
FRAC±	1/32				
SH SZ:	B	SH.NO. 6 OF 12	DWG.NO.		
SCALE:	5:16	DATE: 29-OCT-99	RDO055		

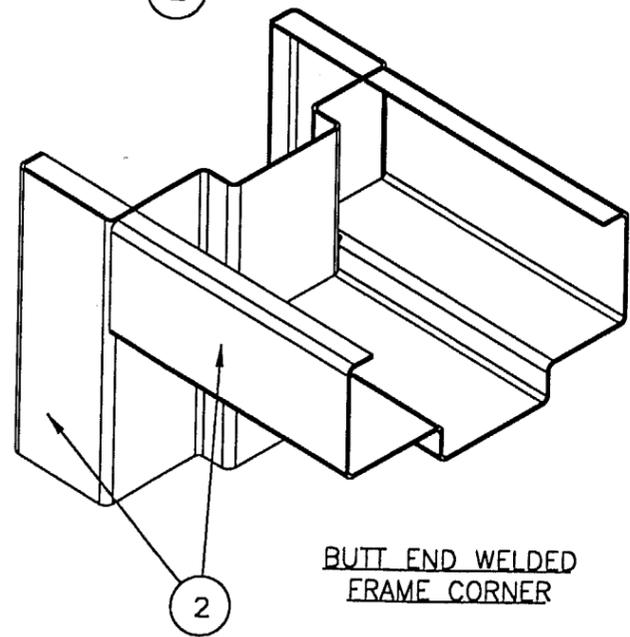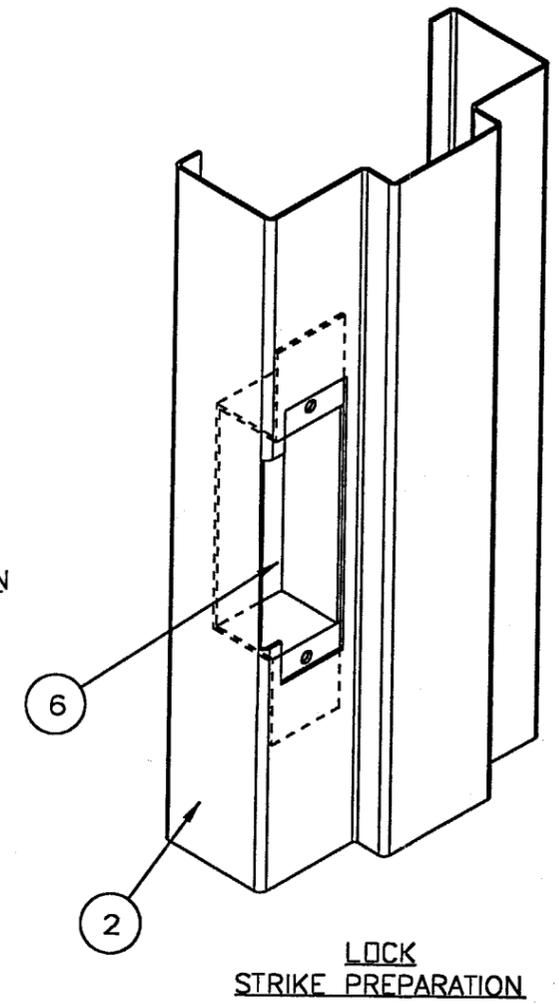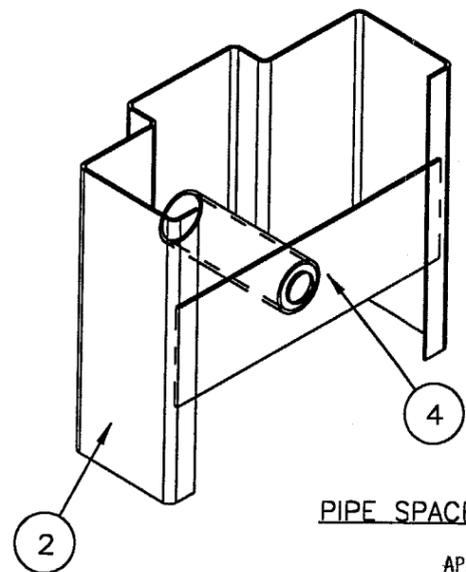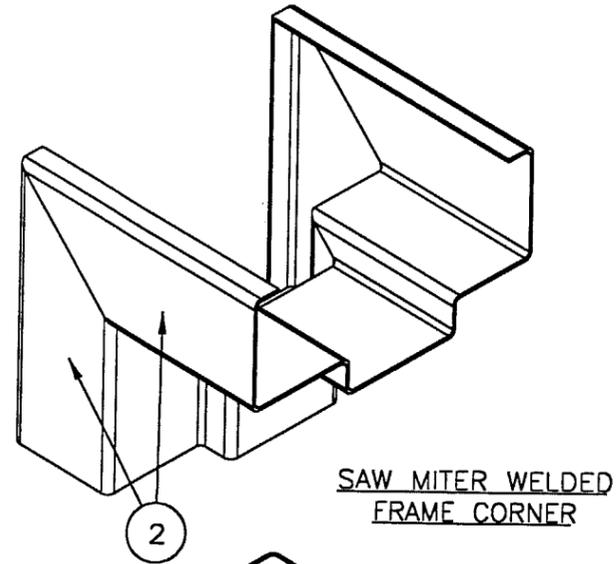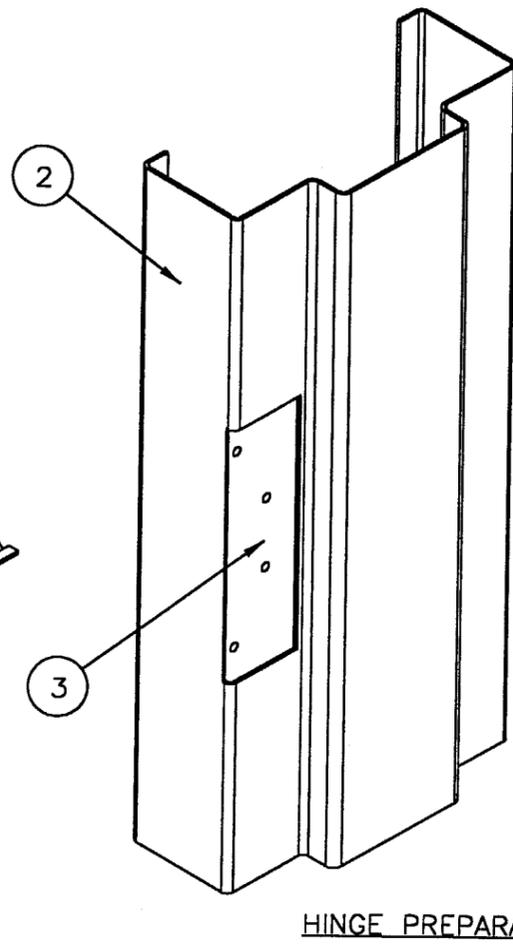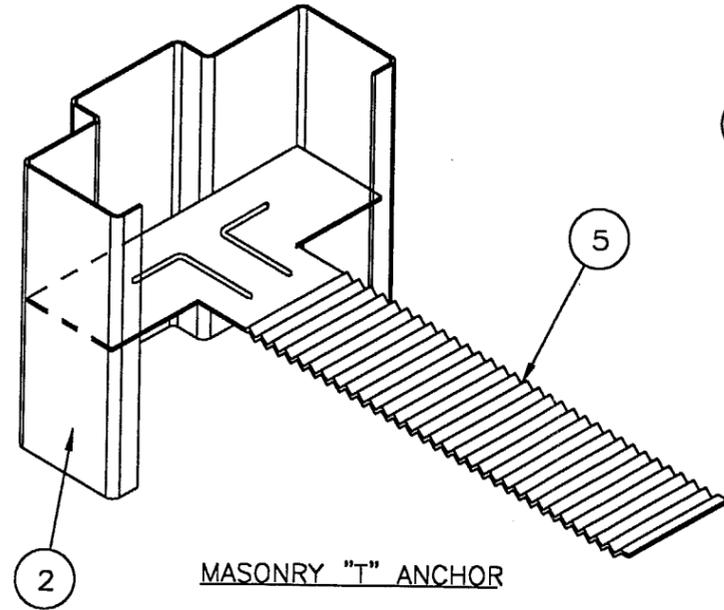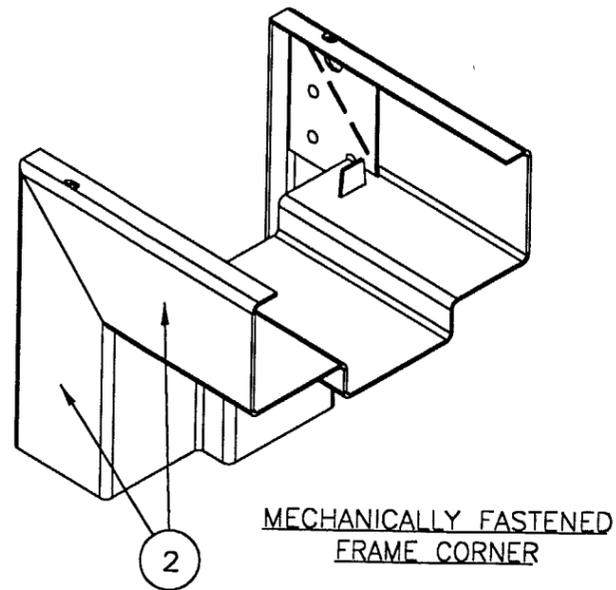


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE August 10, 2000
BY Isaac L. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0307.09

REV	DATE	DESCRIPTION	DR	CK	SC
DR:	L. SHERIFF	CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
CK:	N. KRASCHEL				
SCAN:	-				
TOLERANCE: UNLESS OTHERWISE SPECIFIED		TITLE:			
DEC±	.031	CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR FRAME ASSEMBLY DETAILS			
ANG±	.5°				
FRAC±	1/32				
SH SZ:	B	SH.NO. 7 OF 12	DWG.NO.		
SCALE:	3:8	DATE: 29-OCT-99	RDO055		


RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax
Richard Boyette
12/2/99

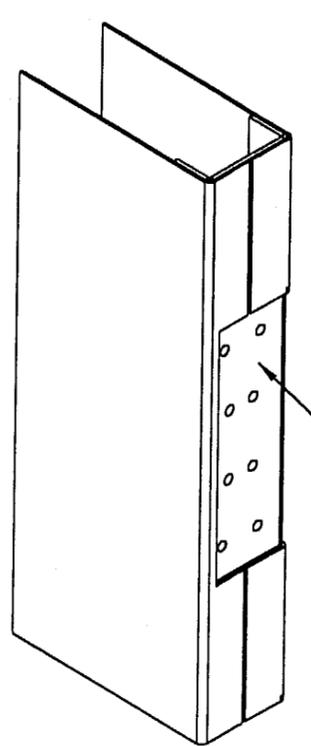

HINGE PREPARATION ASSEMBLY

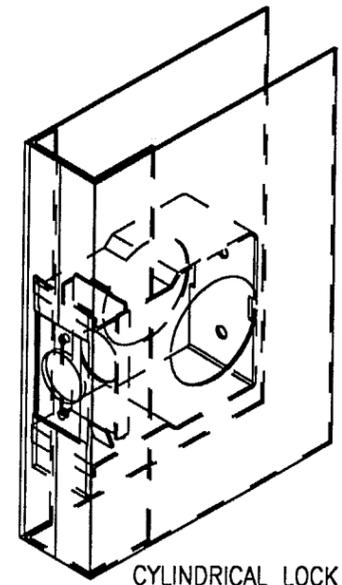


CYLINDRICAL LOCK ASSEMBLY

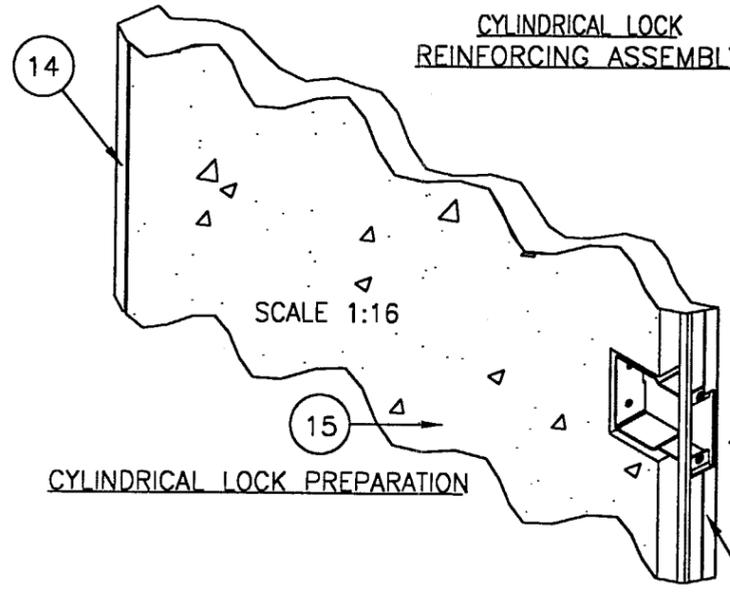


CYLINDRICAL LOCK REINFORCING ASSEMBLY

CYLINDRICAL LOCK PREPARATION

SCALE 1:16

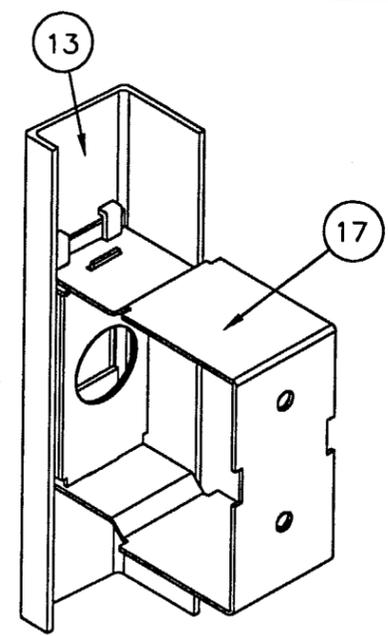

40" FROM ϕ TO FINISHED FLOOR

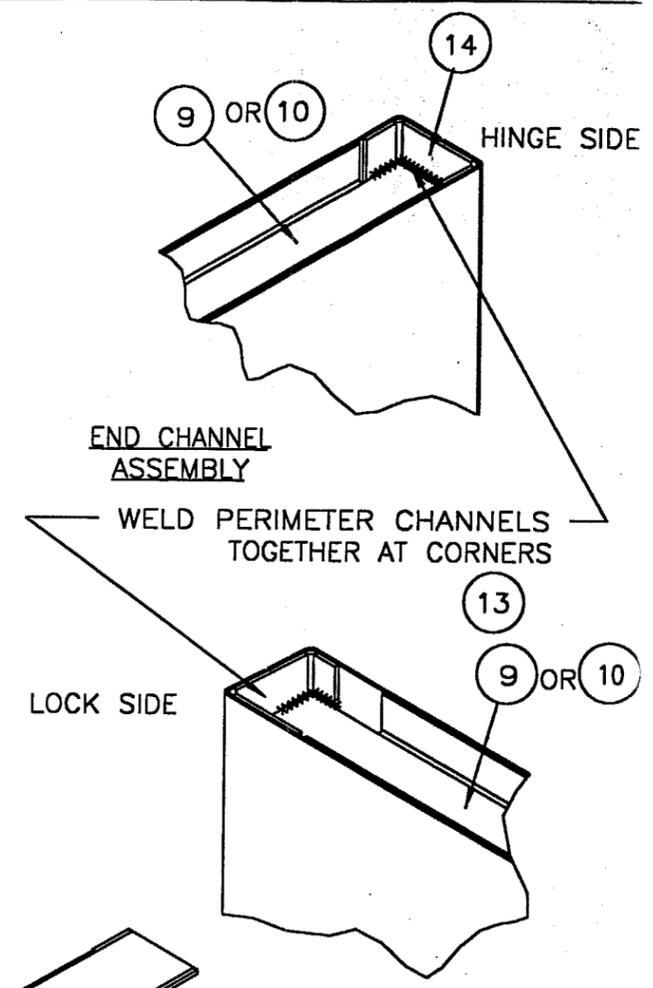


END CHANNEL ASSEMBLY


WELD PERIMETER CHANNELS TOGETHER AT CORNERS

LOCK SIDE

HINGE SIDE

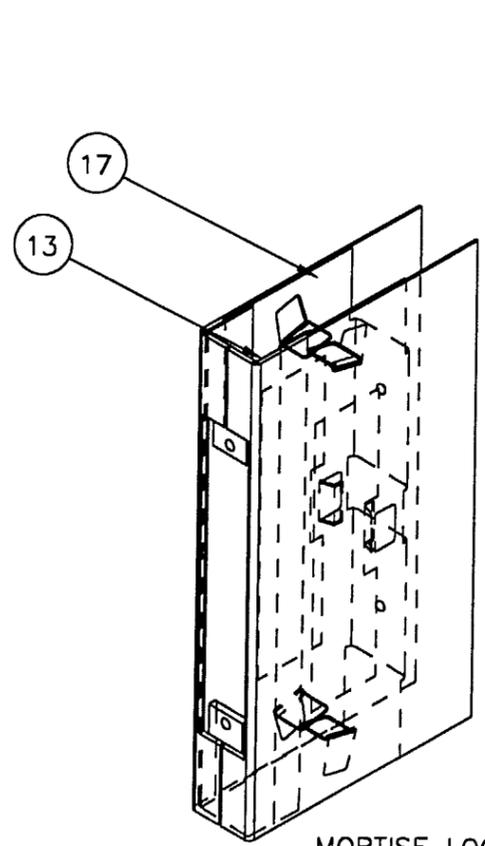


MORTISE LOCK ASSEMBLY

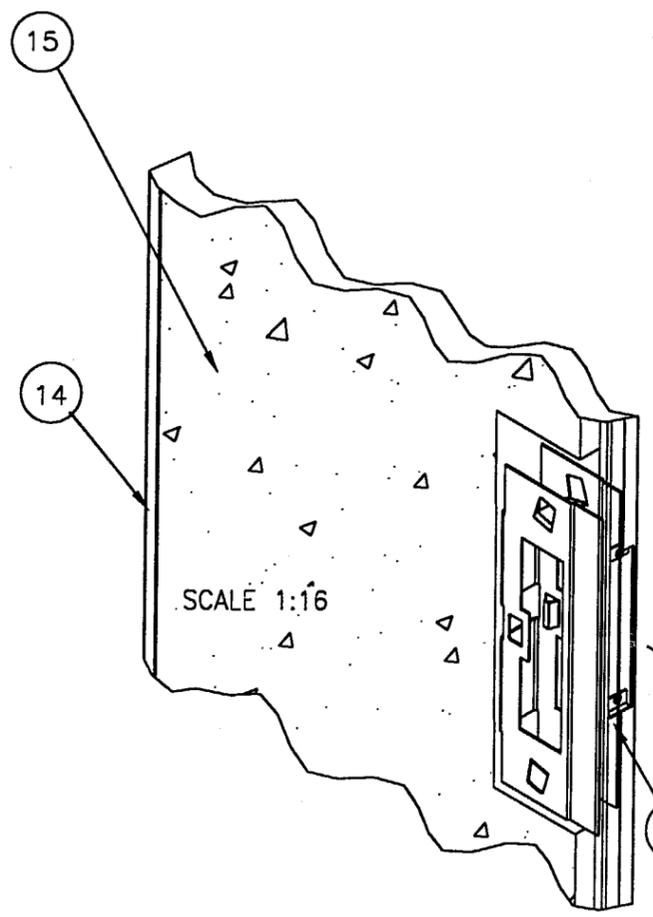

40" FROM ϕ TO FINISHED FLOOR

SCALE 1:16

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE August 10, 2000
 BY Ishaq I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0307-09

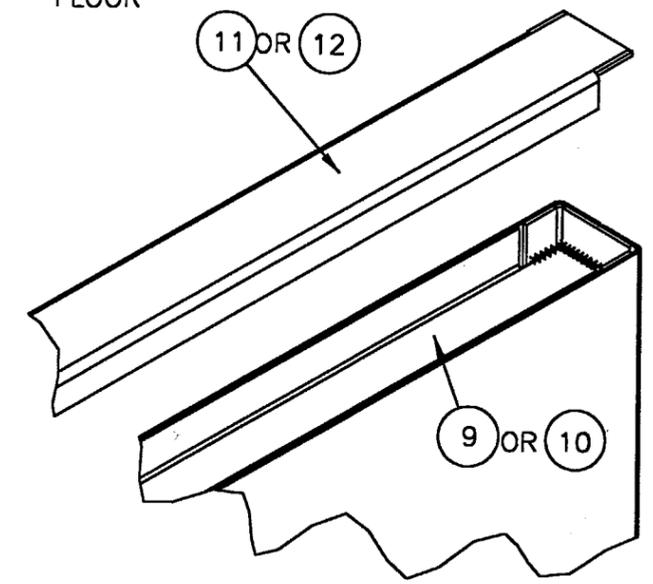


OPTIONAL TOP/BOTTOM CAP ASSEMBLY

REV	DATE	DESCRIPTION	DR	CK	SC
DR:	L. SHERIFF	CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
CK:	N. KRASCHEL				
SCAN:	-	TITLE:			
DEC±	.031	CURRIES SERIES 707			
ANG±	.5°	GLAZED COMMERCIAL			
FRAC±	1/32	STEEL DOOR			
SH SZ:	B	SH.NO. 8 OF 12	DWG.NO.		
SCALE:		DATE: 29-OCT-99	RD0055		

RICHARD BOYETTE
 FL Civil PE #42485
 4031 Coconut Blvd
 Royal Palm Bch FL 33411
 (561) 790-5766 Voice / Fax

Richard Boyette
 12/19/99



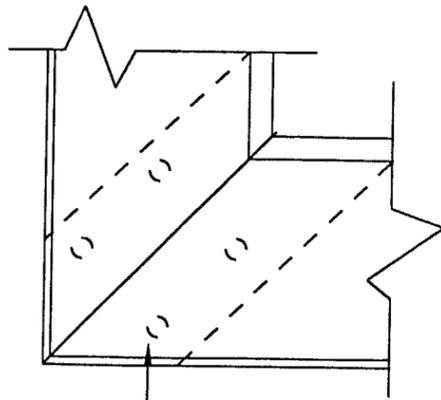


34

VISION LIGHT
CORNER WELD
DETAIL

(4 SPOT WELDS
AT EACH CORNER)

LENGTH OF WINDOW KIT PIECE	MIN. REQ'D NO. OF SCREWS PER SIDE
12"-13"	2
13"-21"	3
21"-29"	4
29"-32"	5

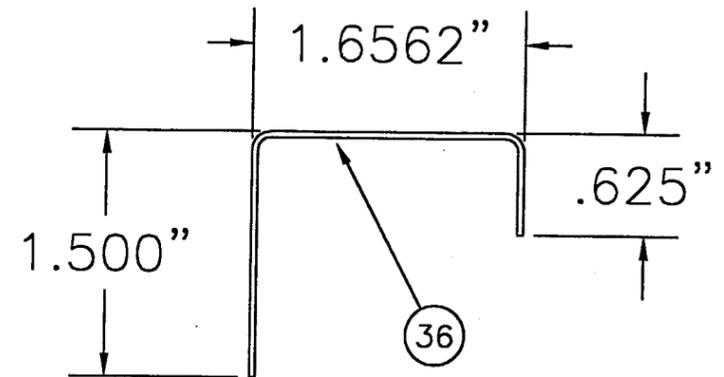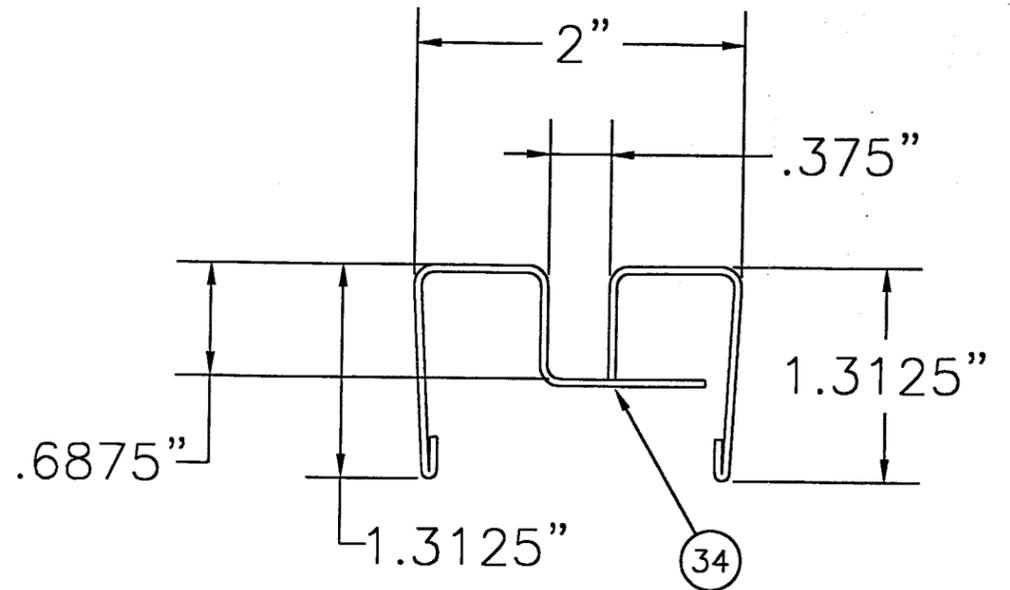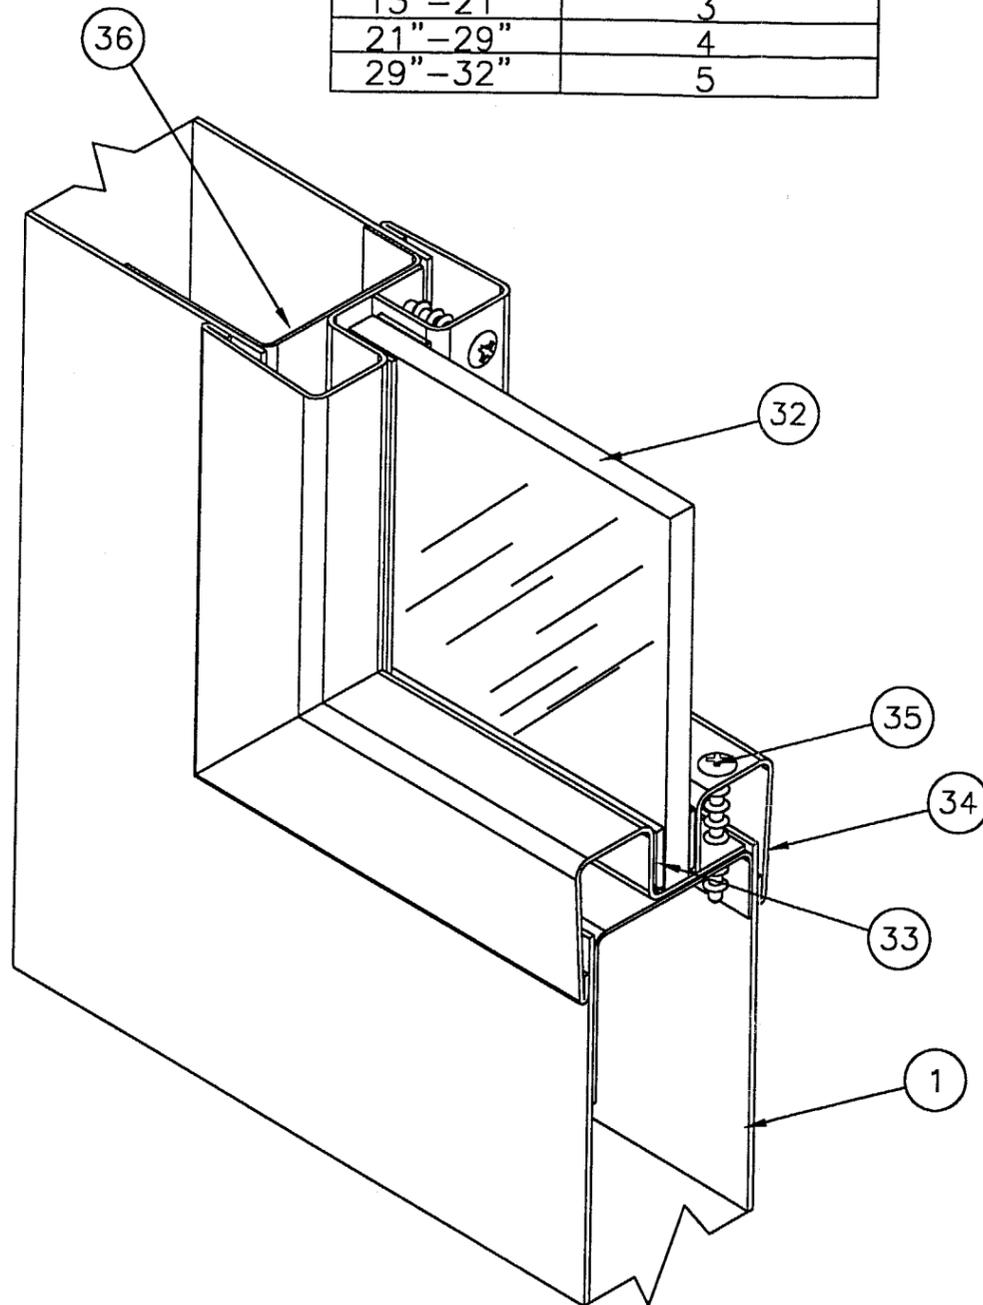


NOTE ON SURROUND CHANNEL LENGTH:
PIECE LENGTH IS EQUAL TO CUT-OUT
IN DOOR FOR VISION LIGHT KIT.

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE August 10, 2000
BY Ishag I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0307.09





REV	DATE	DESCRIPTION	DR	CK	SC
DR: L. SHERIFF		CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
CK: N. KRASCHEL					
SCAN: -		TITLE:			
TOLERANCE: UNLESS OTHERWISE SPECIFIED		CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR VISION LIGHT KIT DETAILS			
DEC± .031		SH.NO. 9 OF 12			DWG.NO.
ANG± .5°		DATE: 29-OCT-99			RD0055
FRAC± 1/32					
SH SZ: B					
SCALE:					

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax
Richard Boyette
12/9/99

SHIM PLATE







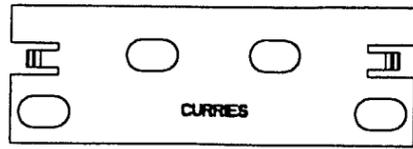


ULTIMA HINGE REINFORCEMENT

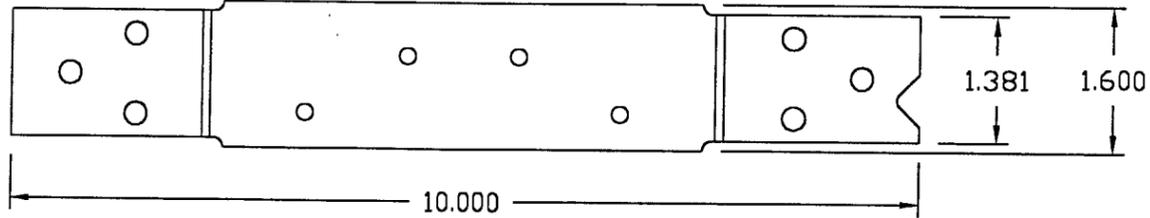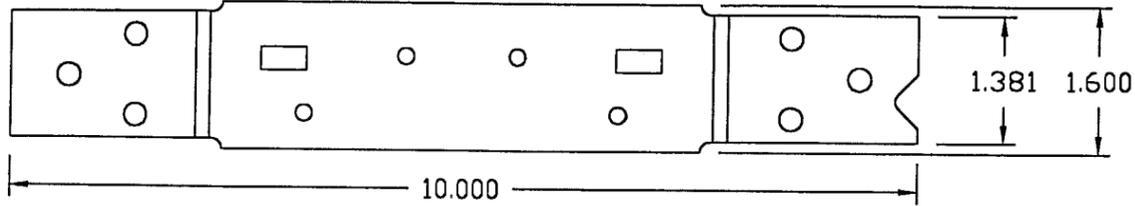


STANDARD HINGE REINFORCEMENT

FRAME STRIKE REINFORCEMENT

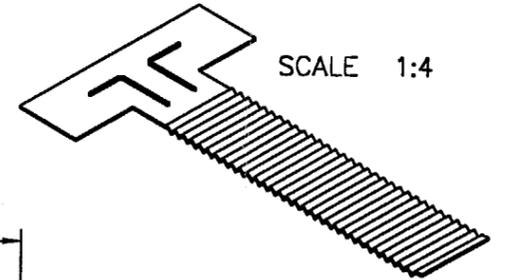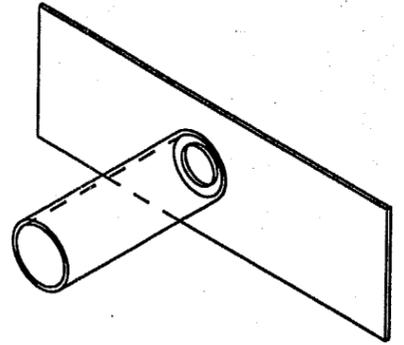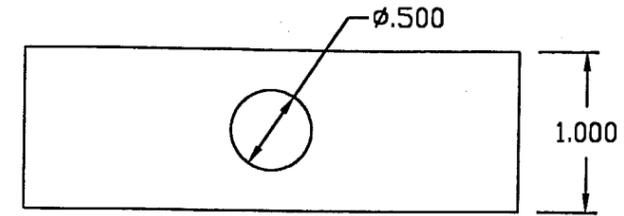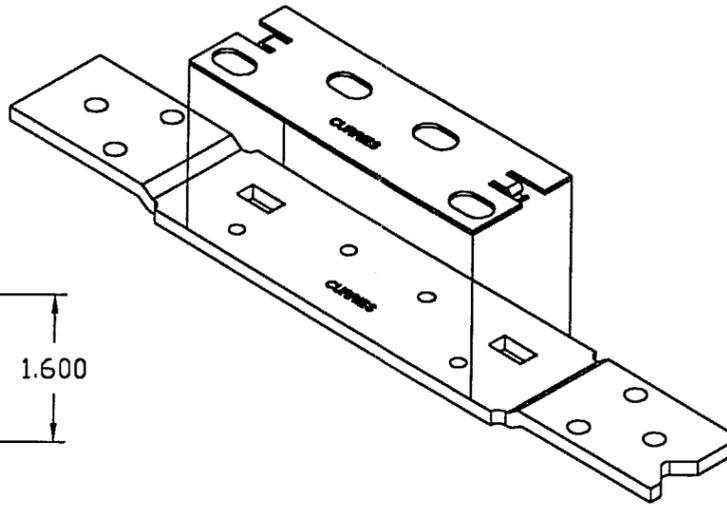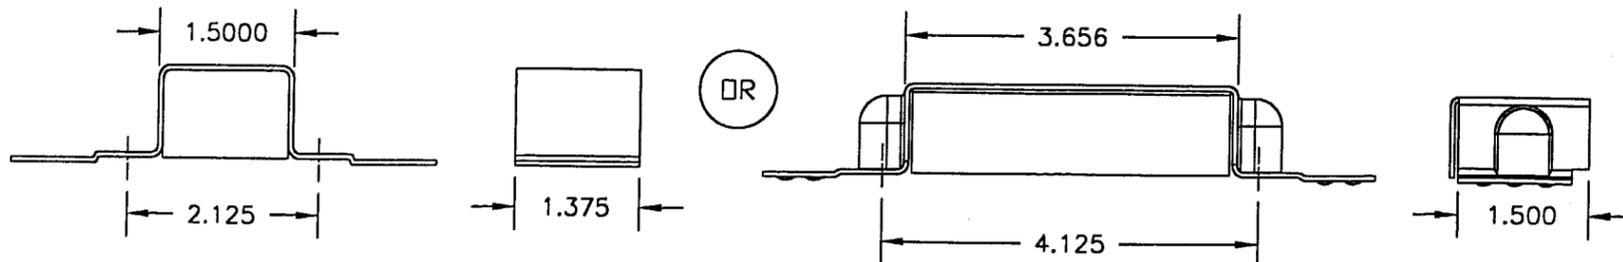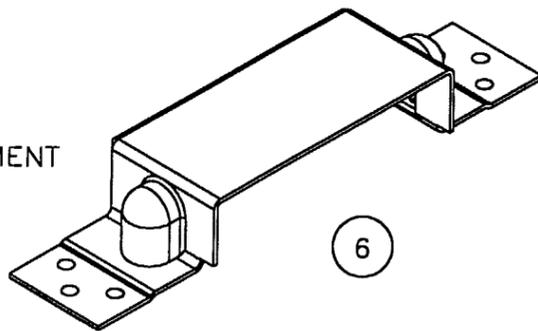

SCALE 1:4


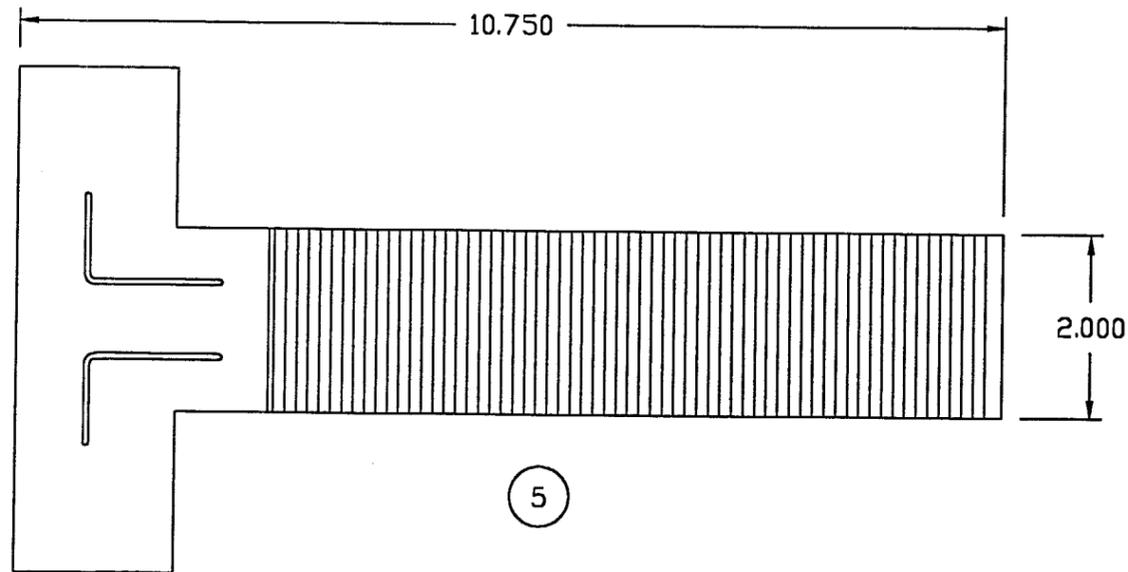


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE August 10, 2000
BY Shaq L. Lhanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0307.09


REV	DATE	DESCRIPTION	DR	CK	SC
DR:	L. SHERIFF	CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
CK:	N. KRASCHEL				
SCAN:	-				
TOLERANCE:	UNLESS OTHERWISE SPECIFIED	TITLE:			
DEC±	.031	CURRIES SERIES 707			
ANG±	.5°	GLAZED COMMERCIAL			
FRAC±	1/32	STEEL DOOR			
		FRAME PARTS DETAILS			
SH SZ:	B	SH.NO. 10 OF 12			DWG.NO.
SCALE:	1:2	DATE: 29-OCT-99			R00055

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax

Richard Boyette
12/6/99

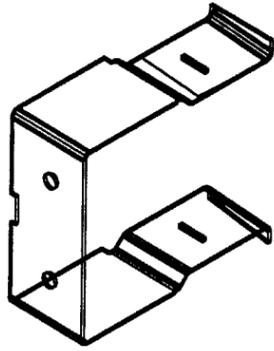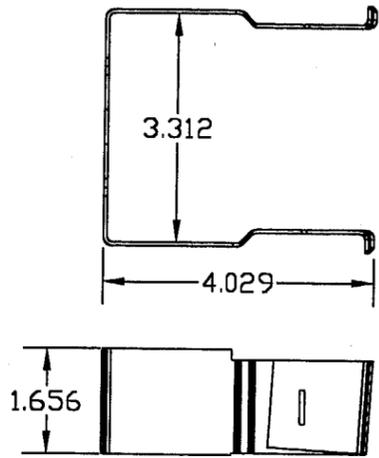


17

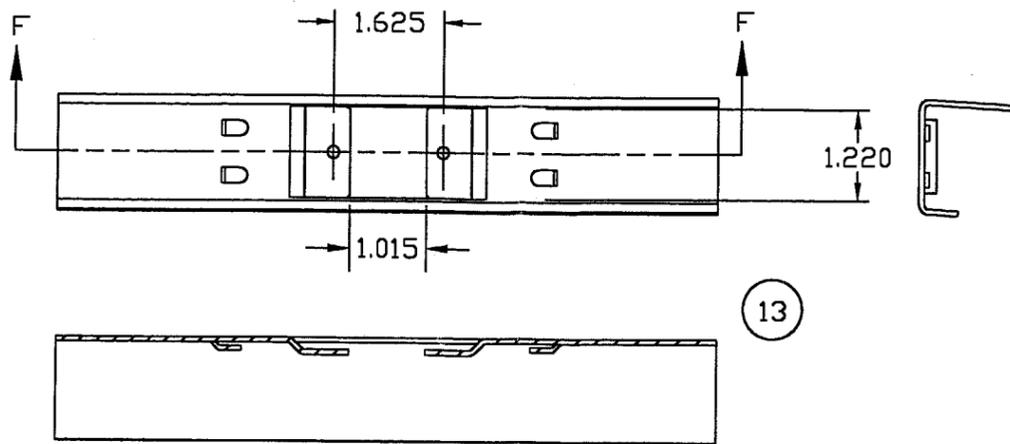


13

SECTION F-F
FOR CYLINDRICAL LOCK

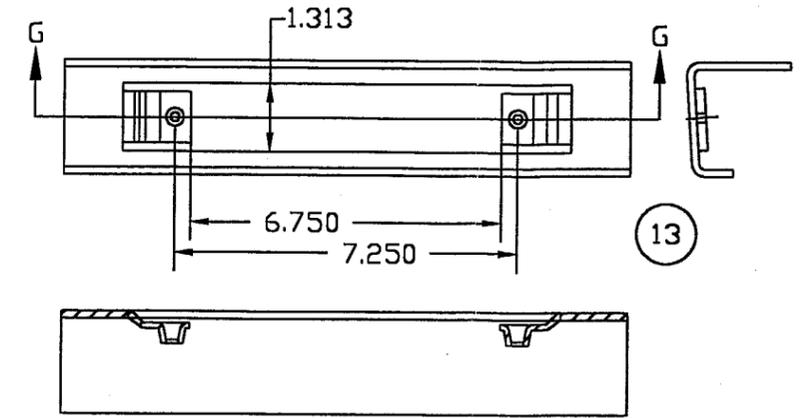


13


SECTION G-G
FOR MORTISE LOCK

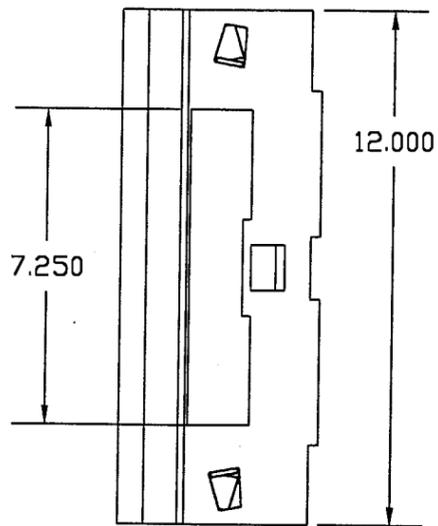


28

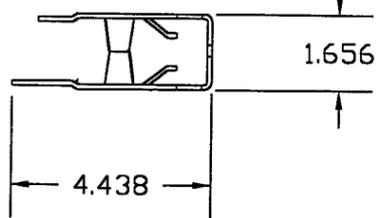

MORTISE LOCK
REINFORCING



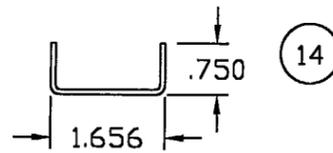


14

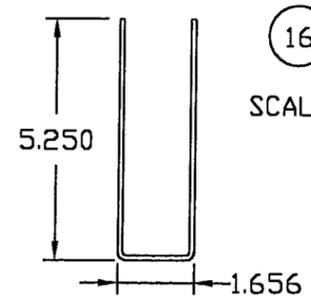




16

SCALE 1:4

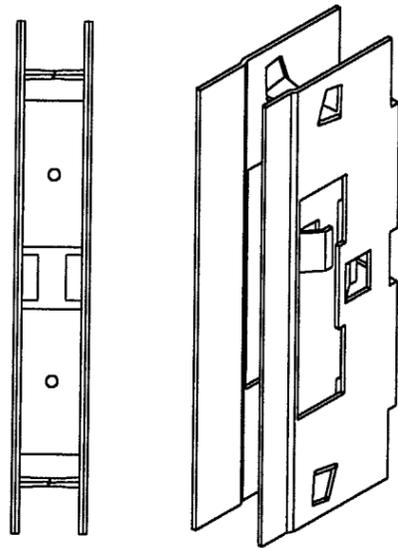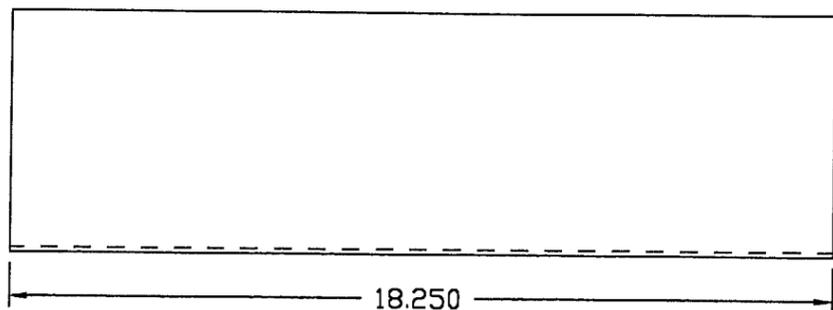


OPTIONAL
NOTCH EACH END
TO CLEAR HINGE
AND LOCK CHANNEL

11 & 12

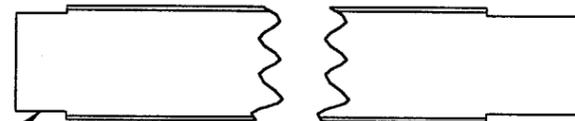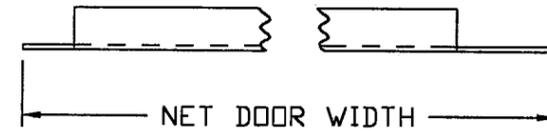

9 & 10



NOTCHED EACH END
TO CLEAR HINGE
AND LOCK CHANNEL

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE August 10, 2000
BY Ishag I. Luanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0307-09

REV	DATE	DESCRIPTION	DR	CK	SC
DRL	SHERIFF	CURRIES 525 9TH ST. S.E. MASON CITY, IOWA			
CK-N	KRASCHER				
SCAN	-	TITLE:			
TOLERANCE: UNLESS OTHERWISE SPECIFIED		CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR DOOR PARTS DETAILS			
DEC±	.031	SH. NO. 11 OF 12			
ANG±	.5°	DWG. NO.			
FRAC±	1/32	DATE: 29-OCT-99			
SH SZ:	B	RD0055			
SCALE:	3:8				

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax

Richard Boyette
12/9/99

BILL OF MATERIALS

ITEM	QUANTITY	DESCRIPTION
1	1	18 GA. (.041") MIN., 14 GA. (.080) MAX. FLUSH DOOR (COLD ROLLED, GALVANIZED, OR STAINLESS STEEL)
2	1	16 GA. (.053") MIN., 12 GA. (.110") MAX. WELDED OR KD FRAME (COLD ROLLED, GALVANIZED, OR STAINLESS STEEL)
3	3	7 GA. (.171") MIN., (.203") MAX. FRAME HINGE REINFORCEMENT - PER HINGE JAMB
4	4	16 GA. (.053") MIN. PIPE SPACER ANCHOR - PER JAMB
5	4	16 GA. (.053") MIN. MASONRY T ANCHOR - PER JAMB
6	1	16 GA. (.171") MIN. STRIKE REINFORCEMENT
7	4	3/8" x 5" FLAT HEAD WOOD SCREW/LAG BOLT - PER JAMB
8	4	3/8" x 5" FLAT HEAD SLEEVE ANCHOR - PER JAMB
9	1	16 GA. (.053") MIN., 12 GA. (.110") MAX., TOP END CHANNEL
10	1	16 GA. (.053") MIN., 12 GA. (.110") MAX., BOTTOM END CHANNEL
11	1	OPTIONAL 16 GA. (.053") MIN., 12 GA. (.110") MAX., TOP CAP
12	1	OPTIONAL 16 GA. (.053") MIN., 12 GA. (.110") MAX., BOTTOM CAP
13	1	14 GA. (.080") MIN., LOCK CHANNEL
14	1	14 GA. (.080") MIN., 12 GA. (.110") MAX. HINGE CHANNEL
15	1	ONE POUND DENSITY POLYSTYRENE CORE - 1.656" NOMINAL THICKNESS - MANUFACTURED BY BASF
16	1	OPTIONAL 12 GA. (.110") MIN. CLOSER REINFORCING
17	1	16 GA. (.053") MIN. CYLINDRICAL MORTISE LOCK REINFORCEMENT
18	3	#10 WOOD OR MACHINE SCREW x 1" LONG MIN OR 1/4-20 x 1-1/4" LONG TAP CON.
19	1	2000 PSI MIN. MORTAR OR CONCRETE
20		NOT USED
21	3	4-1/2" x 4-1/2" x .134" STEEL HINGES - MCKINNEY T-2714
22	1	ONE ROW OF PEMKO S88 WEATHERSTRIP PER FRAME MEMBER
23	1	PEMKO ALUMINUM SILL 2005AS - 1/2" TALL x 5" x NOMINAL DOOR WIDTH
24	1	2" x 12" WOOD BUCK
25	1	EXISTING MASONRY OR POURED CONCRETE - 2000 PSI. MIN.
26	-	SARGENT 10 LINE CYLINDRICAL LOCK
27	-	SCHLAGE D SERIES CYLINDRICAL LOCK
28	-	SARGENT 8200 SERIES MORTISE LOCK
29	1	8" CMU BLOCK
	1	STEEL LINTEL
31	1	FINISH PAINT BY OTHERS - FACES OF DOOR AND FRAME
32	1	1/4" THICK MIN. DSM (HYZOD BRAND) OR DADE APPROVED 1/4" THICK MIN. - - TRANSPARENT OR TRANSLUCENT PLASTIC. (WIDTH AND HEIGHT 1" GREATER THAN VISIBLE DIMENSIONS)

ITEM	QUANTITY	DESCRIPTION
33	2	1/8" x 1/2" x PERIMETER OF VISION LIGHT KIT CLOSED CELL FOAM TAPE.
34	1	CURRIES VISION LIGHT KIT. (18 GA. MIN.)
35	-	#6 x 1-1/4" OVAL HEAD TEK SCREW - SEE TABLE ON SHEET 9 FOR QUANTITY PER LENGTH
36	4	20 GA. MIN. x 1-1/2" x 1.656 SURROUND CHANNEL

NOTES:

- NOTES: 1. MINIMUM TENSILE STRENGTH 53,000 PSI
2. MINIMUM YIELD STRENGTH 36,000 PSI

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE August 10, 2000
BY Ishaq I. Chaudhry
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0307-09

REV	DATE	DESCRIPTION	DR	CK	SC
		CURRIES			
		525 9TH ST. S.E. MASON CITY, IOWA			
		TITLE: CURRIES SERIES 707 GLAZED COMMERCIAL STEEL DOOR BILL OF MATERIALS			
		SH SZ: B	SH. NO. 12 OF 12	DWG. NO.	
		SCALE: -	DATE: 29-OCT-99	RDO055	

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax

Richard Boyette
12/9/99

00-0307-09