



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Gulfstream Aluminum and Shutter Corporation
3001 SE Gran Park Way
Stuart, FL 34997

Your application for Notice of Acceptance (NOA) of:

"Impact" Aluminum Colonial Shutter

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-0411.10
EXPIRES: 02/08/2004

Raul Rodriguez
Chief Product Control Division

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 02/08/2001

Gulfstream Aluminum and Shutter Corp.

ACCEPTANCE No. : 00-0411.10

APPROVED : 02/08/2001

EXPIRES : 02/08/2004

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

This approves an Extruded Aluminum Hinged Bi-Fold Colonial Shutter, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

This Extruded Aluminum Hinged Bi-Fold Colonial Shutter and its components shall be constructed in strict compliance with the following documents: Drawing No. 1000, titled " Impact Colonial Shutter ", prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E., dated January 10, 2001, sheets 1 through 7 of 7, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

All permanent set components, included but not limited to embedded anchor bolts, threaded cones, metal shields, must be protected against corrosion, contamination and damage at all times.

4. INSTALLATION

This Extruded Aluminum Hinged Bi-Fold Colonial Shutter and its components shall be installed in strict compliance with the approved drawings.

5. LABELING

Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.



Helmy A. Makar, P.E.- Product Control Examiner
Product Control Division

Gulfstream Aluminum and Shutter Corp.

ACCEPTANCE No. : 00-0411.10


APPROVED : 02/08/2001

EXPIRES : 02/08/2004


NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer, who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE






Helmy A. Makar, P.E.- Product Control Examiner
Product Control Division

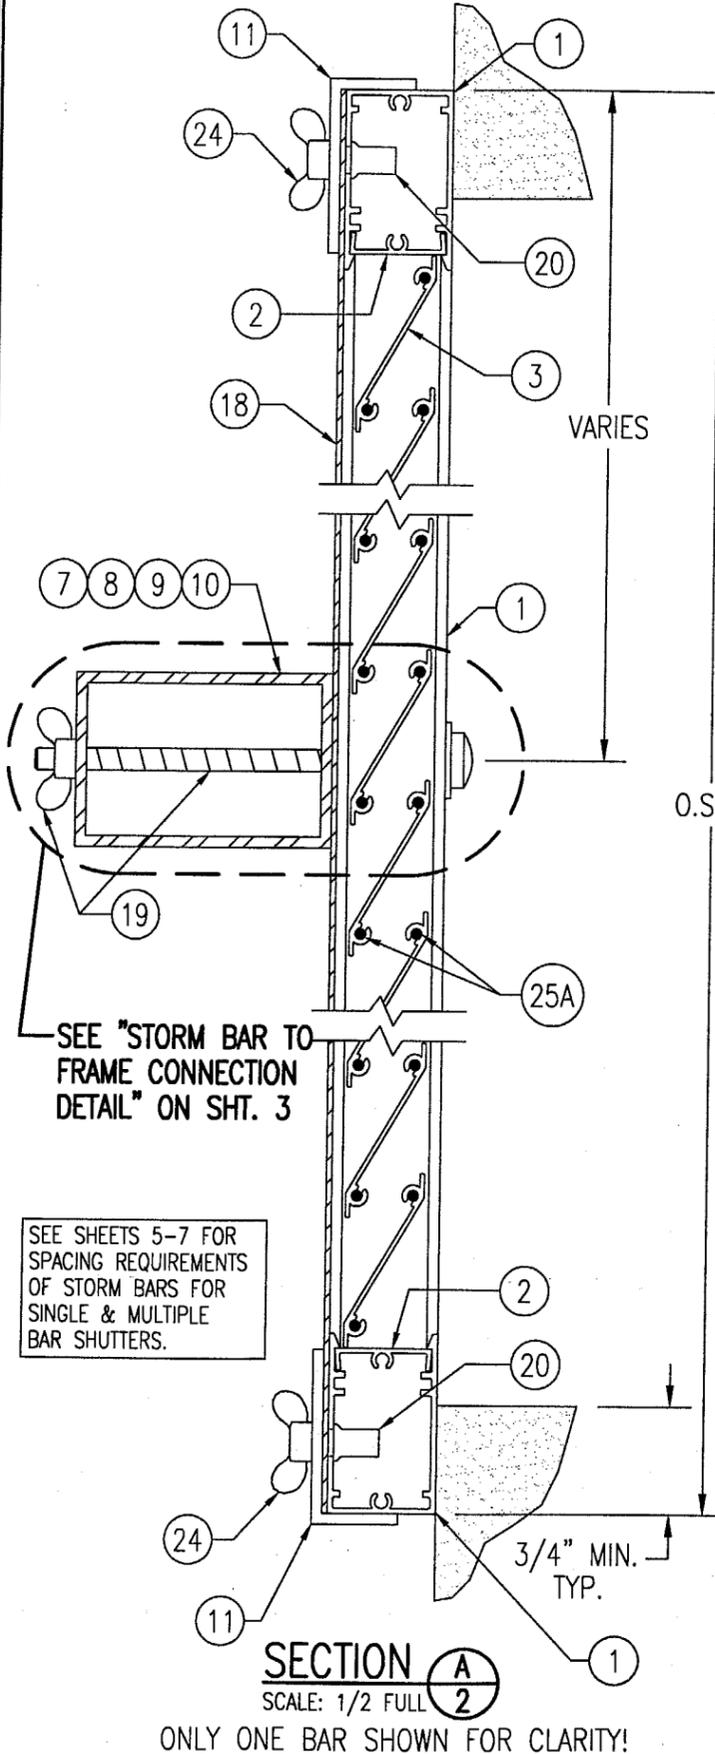


SEE "STORM BAR TO FRAME CONNECTION DETAIL" ON SHT. 3

SEE SHEETS 5-7 FOR SPACING REQUIREMENTS OF STORM BARS FOR SINGLE & MULTIPLE BAR SHUTTERS.

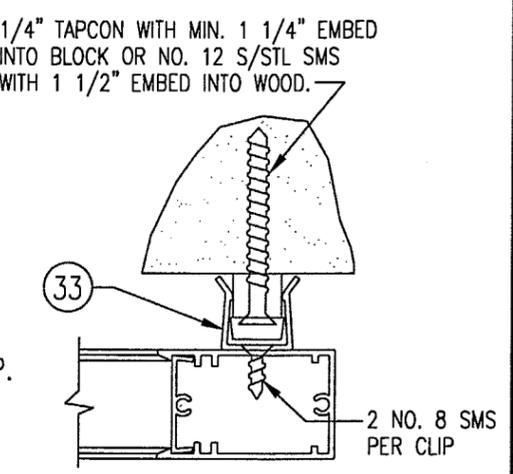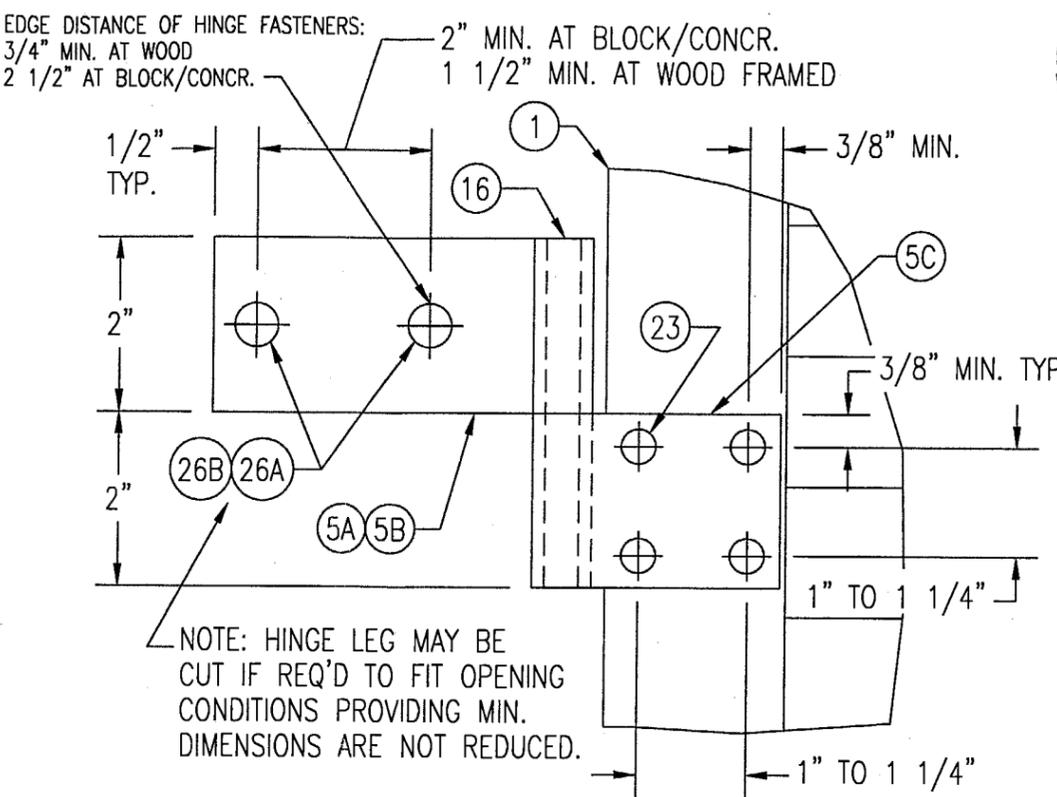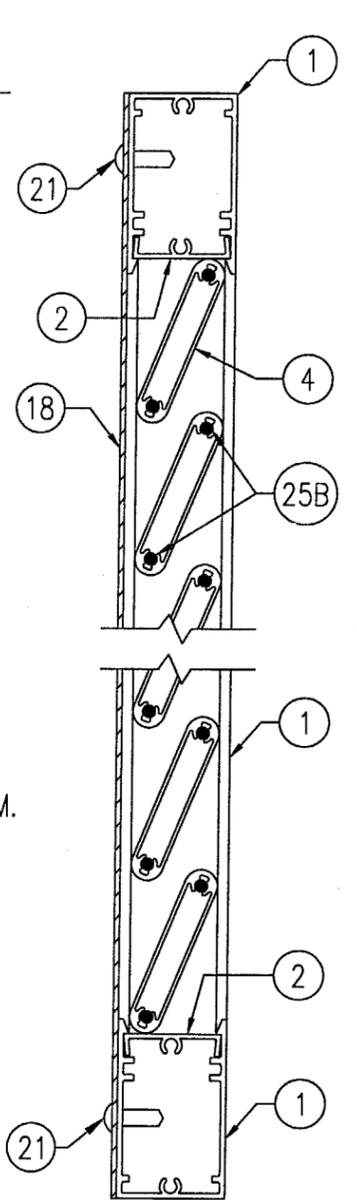


TYPICAL REQUIRED IN THE OPEN POSITION (SEE GENERAL NOTE #8)
WALL CLIP DETAIL
POSITIONED BETWEEN EACH HINGE (MAX. 31" O.C.)

L2X2X1/8 OR L2X3X1/8
3" LONG FOR BLOCK APPLICATIONS
1 1/2" LONG FOR WOOD APPLICATIONS

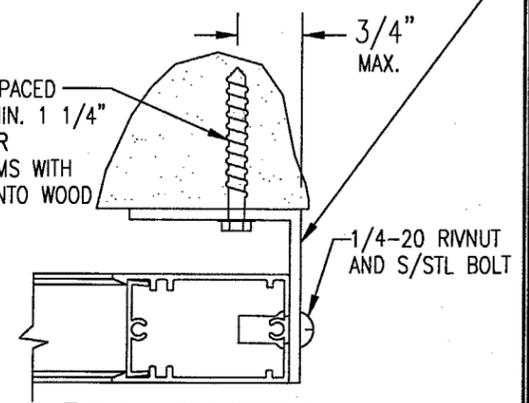


TYPICAL REQUIRED IN THE OPEN POSITION (SEE GENERAL NOTE #8)
OPTIONAL WALL CLIP DETAIL
POSITIONED BETWEEN EACH HINGE (MAX. 31" O.C.)
(THE MAX. PRESSURE FOR THIS CONNECTION IS 80 PSF)

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE 02/08/2001
BY *Warren W. Schaefer*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0411.10

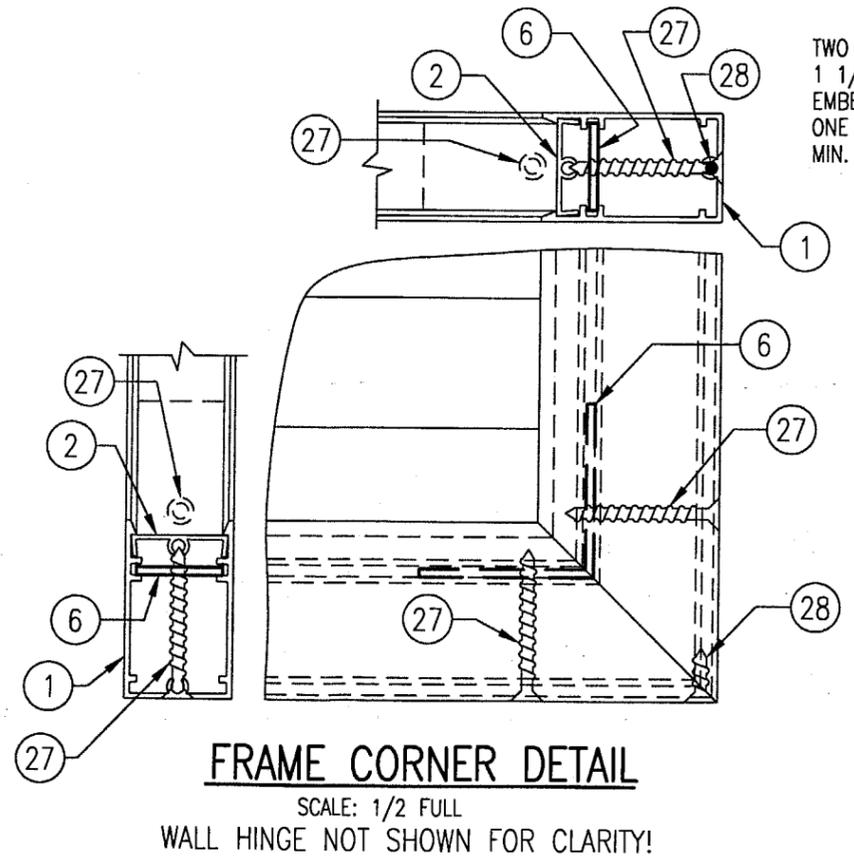


DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1-2	DATE: 01/10/01
DATE	
BY	
REVISION DESCRIPTION	
NO.	
(DADE)	
IMPACT COLONIAL SHUTTERS	
CONSULTANTS	MANUFACTURER
W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.	
600 SANDTREE DRIVE, SUITE 203B PALM BEACH GARDENS, FL 33403 PHONE: 561-775-4902 FAX: 561-775-4903	
IMPACT COLONIAL SHUTTERS ALUMINUM & SHUTTER CORP. 197 S.E. MONTEREY RD. STUART, FLORIDA 34994 (561)287-6476	
CERTIFICATION JAN 10 2001	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1000	REV.
SHEET NO. 2	OF 7

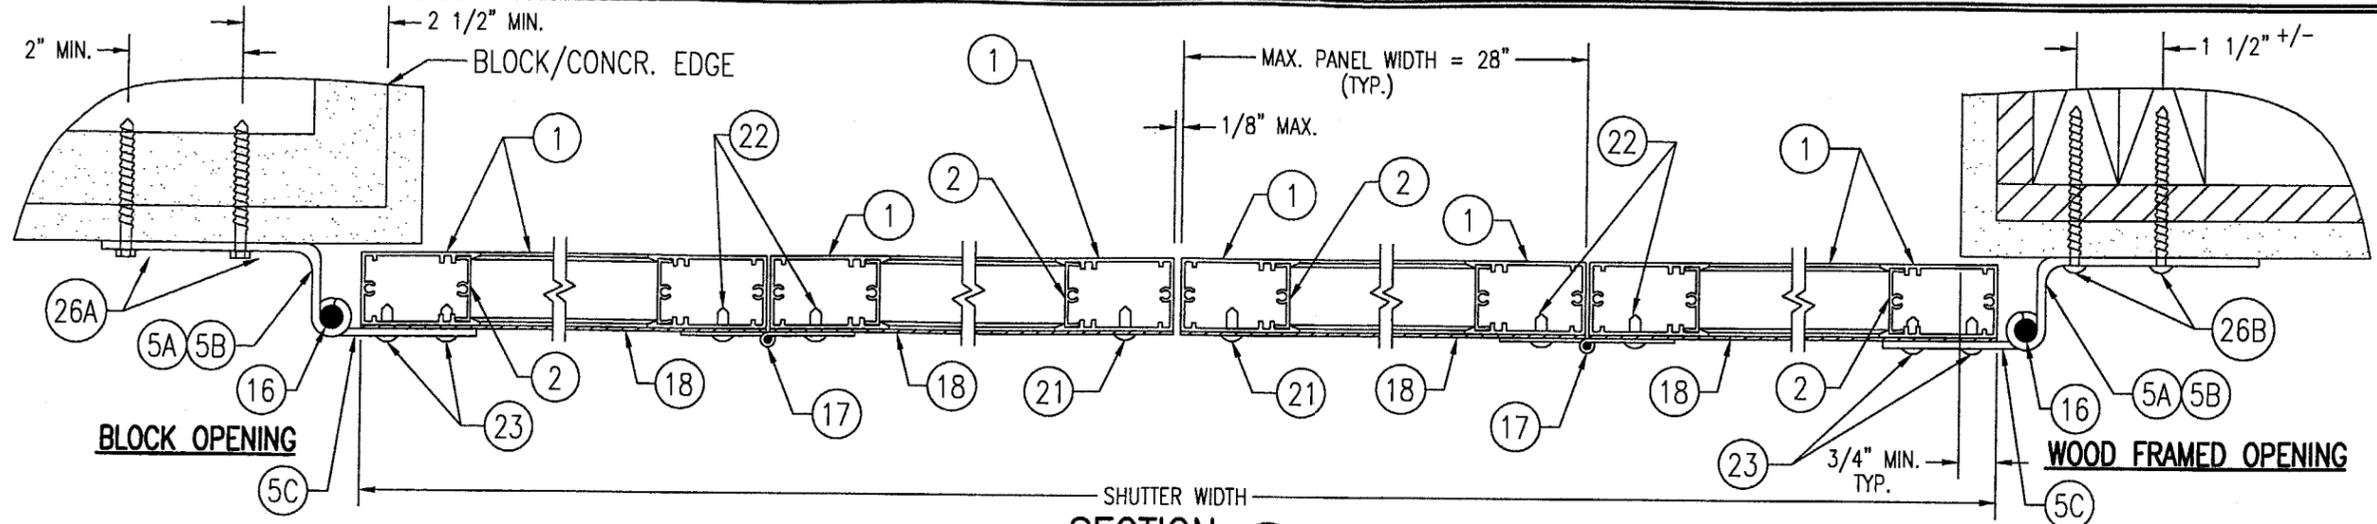


SECTION B
SCALE: 1/3 FULL


STORM BAR NOT SHOWN FOR CLARITY!

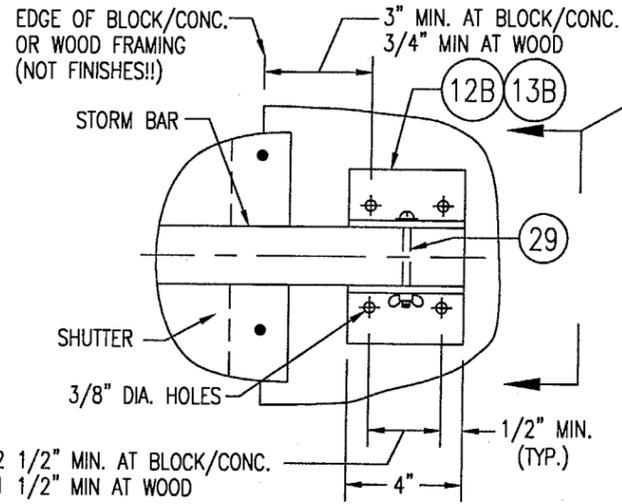

STORM BAR END CONNECTION "A"
SCALE: 2"=1'-0"

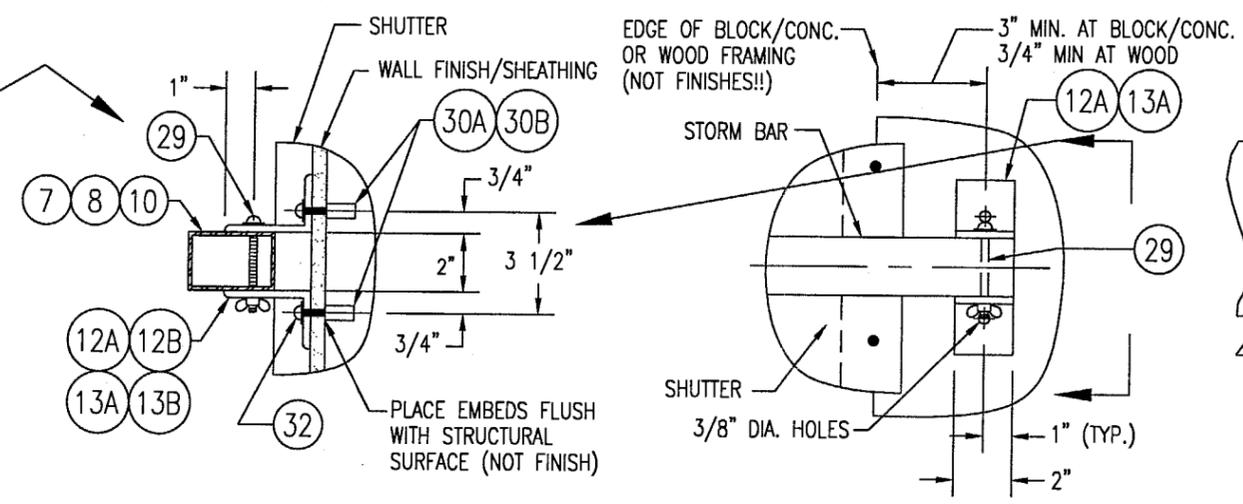


STORM BAR END CONNECTION "B"
SCALE: 2"=1'-0"

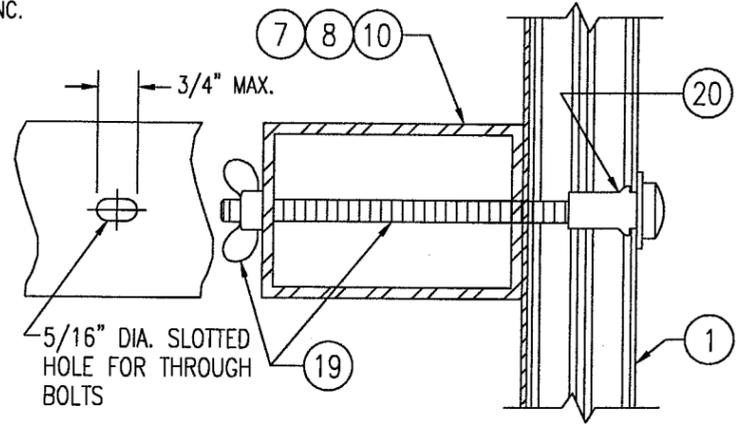

STORM BAR TO FRAME CONNECTION DETAIL
SCALE: 1/2 FULL


NOTE: CONNECTION OF STORM BAR TO SHUTTER FRAMES IS NOT REQUIRED AT SINGLE BAR SHUTTERS.

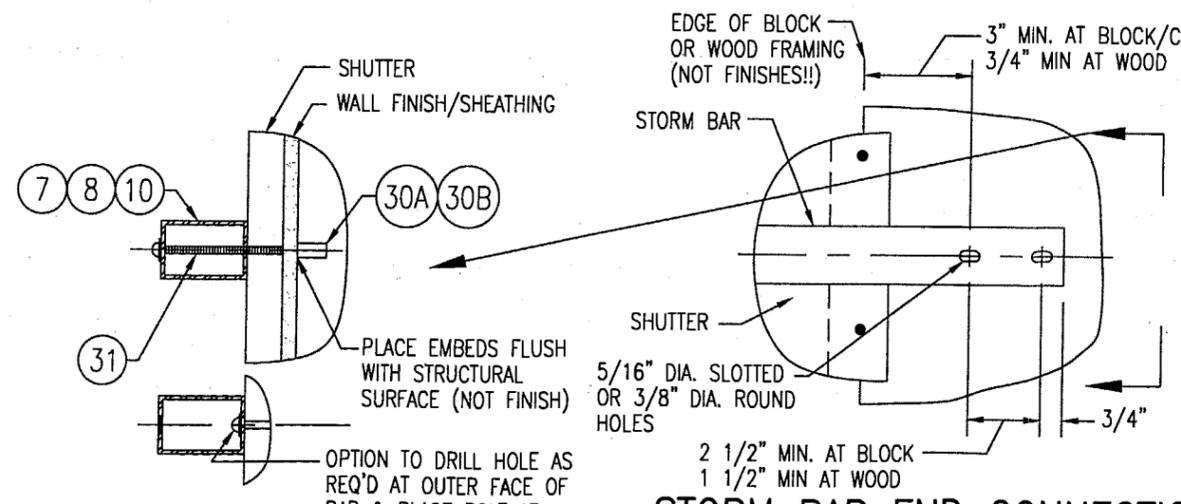


STORM BAR END CONNECTION "C"
SCALE: 2"=1'-0"

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE 02/08/2001
BY *Warren W. Schaefer*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0411-10


DRAWN BY: W.W.S.		CHECKED BY: W.W.S.	
PLOT: 1=3		DATE: 01/10/01	
NO.	REVISION DESCRIPTION	BY	DATE
DRAWING TITLE: IMPACT COLONIAL SHUTTERS			
MANUFACTURER: GULFSTREAM ALUMINUM & SHUTTER CORP.			
CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.			
600 SANDTREE DRIVE, SUITE 203B PALM BEACH GARDENS, FL 33403 PHONE: 561-775-4902 FAX: 561-775-4903			
197 S.E. MONTEREY RD. STUART, FLORIDA 34994 (561)287-6476			
CERTIFICATION		P.E.	
JAN 10 2001		<i>Warren W. Schaefer</i>	
DRAWING NO. 1000		REV.	
SHEET NO. 3		OF 7	

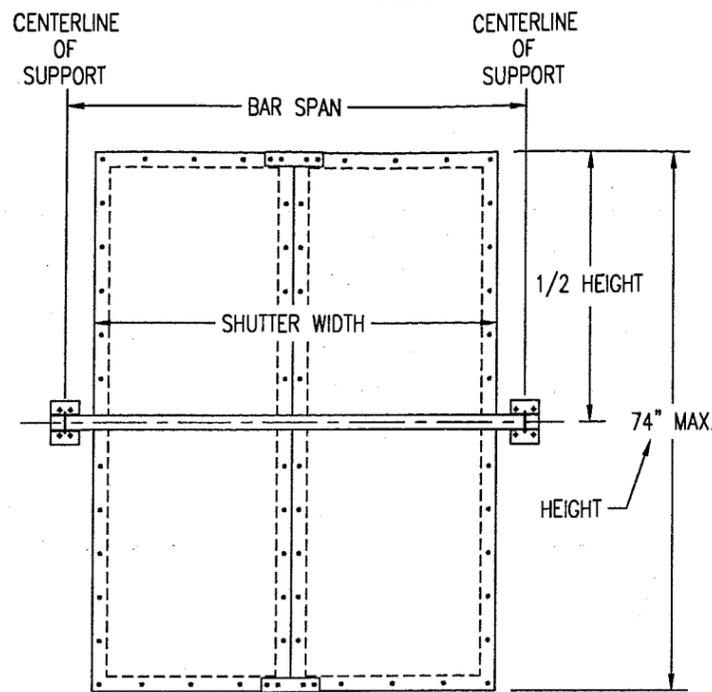


SINGLE BAR

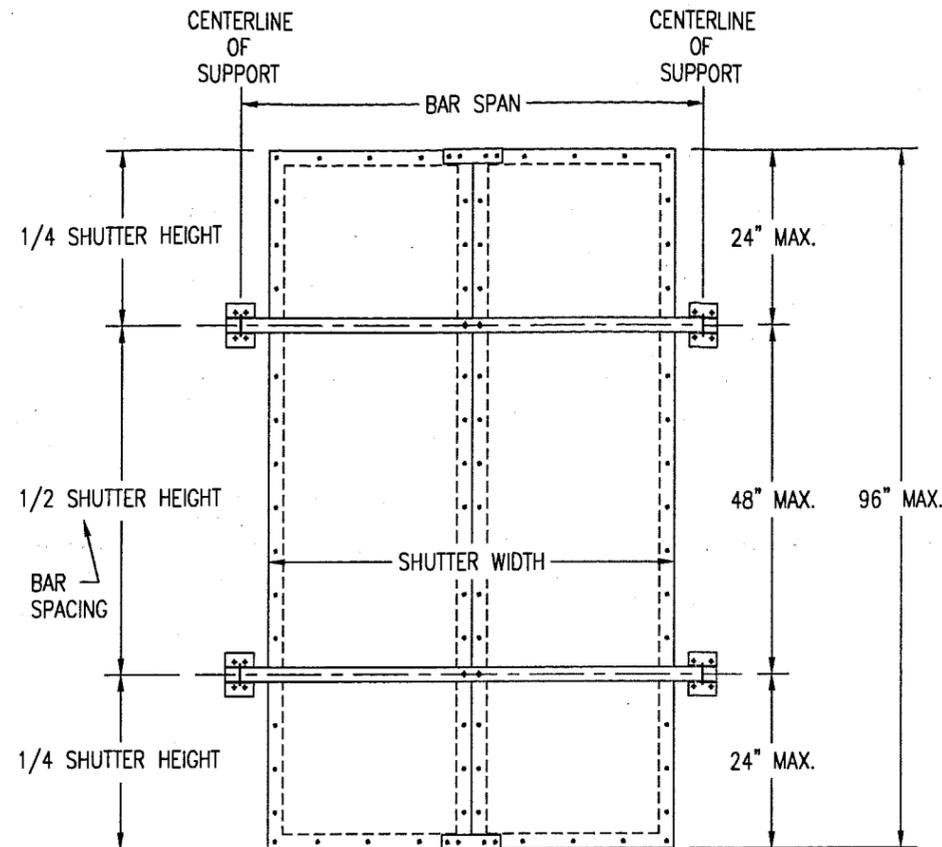

TWO BARS

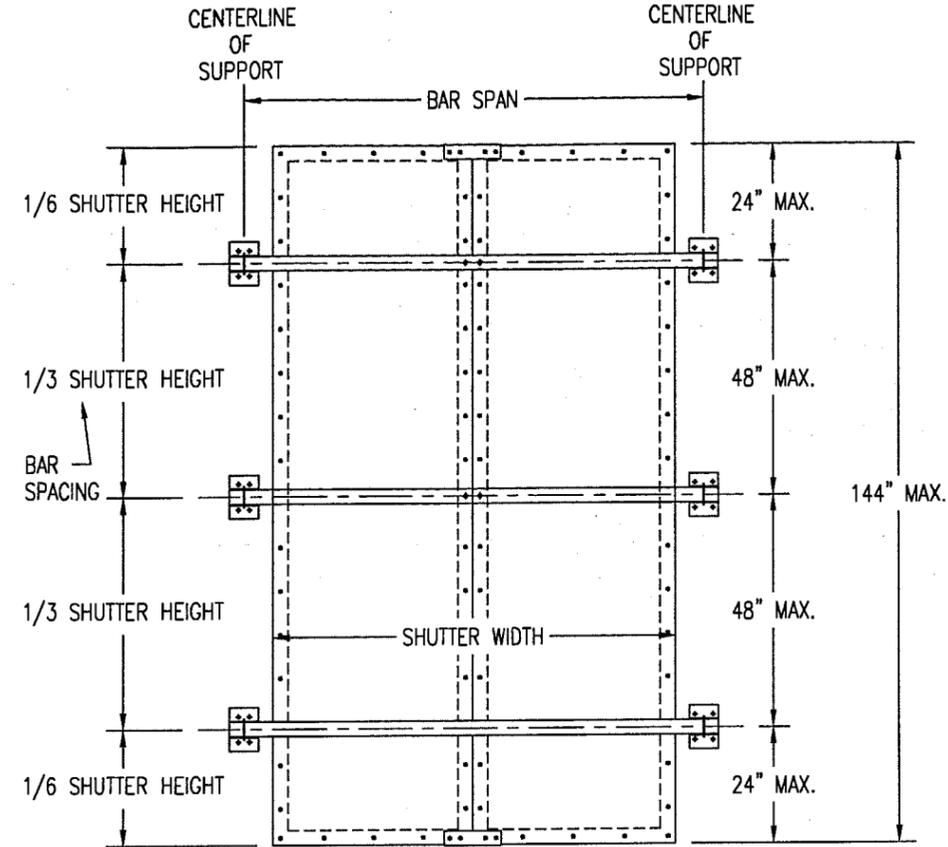

THREE BARS

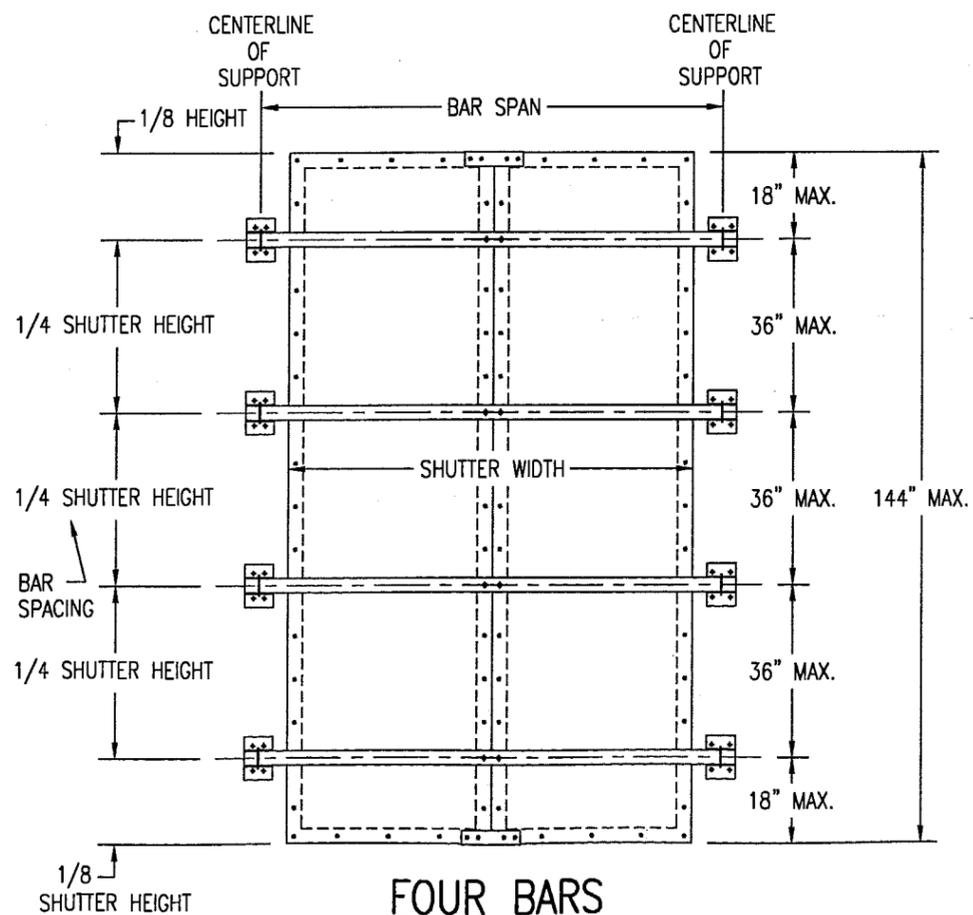

FOUR BARS

ALLOWABLE PRESSURE TABLE FOR SINGLE BAR SHUTTERS

SHUTTER HEIGHT	PRESSURE (PSF)	
	POSITIVE	NEGATIVE
54" & LESS	80.0	80.0
56"	77.0	77.0
58"	74.0	74.0
60"	71.0	71.0
62"	68.0	68.0
64"	65.0	65.0
66"	60.0	60.0
68"	55.0	55.0
70"	49.7	50.0
72"	44.4	45.0
74"	39.8	40.0

PRESSURE TABLE NOTES:

1. THE SHUTTER MUST BE PLACED A MIN. DISTANCE OF 2.125" AWAY FROM THE GLASS.
2. SEE INSTRUCTIONS ON SHEET 7 FOR USE OF ALL LOAD TABLES.

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE 02/08/2001
 BY *Warren W. Schaeffer*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0411-10

DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1-24	DATE: 01/10/01
DATE	BY
REVISION DESCRIPTION	NO.
(DADE)	
IMPACT COLONIAL SHUTTERS	
MANUFACTURER GULFSTREAM ALUMINUM & SHUTTER CORP.	
CONSULTANTS W. W. SCHAEFFER ENGINEERING & CONSULTING, P.A. 600 SANDTREE DRIVE, SUITE 203B PALM BEACH GARDENS, FL 33403 PHONE: 561-775-4902 FAX: 561-775-4903	
197 S.E. MONTEREY RD. STUART, FLORIDA 34994 (561)287-6476	
CERTIFICATION JAN 10 2001	WARREN W. SCHAEFFER, P.E. P.E. NO. 44135
DRAWING NO. 1000	REV.
SHEET NO. 5	OF 7

PRESSURE LOAD TABLE FOR STORM BARS & BAR END CONNECTIONS							
SHUTTER WIDTH (IN)	HEIGHT OR BAR SPACING (IN) *	ALLOWABLE PRESSURES (PSF) FOR BARS			ALLOWABLE PRESSURE (PSF) AS CONTROLLED BY CONNECTIONS		
		TS2X2X1/8	TS3X2X1/8	TS5X2X1/8	CONN "A"		CONN "B" & "C"
					WOOD/BLOCK/CONC.	WOOD	
36	48	80	80	80	80	80	80
	54	80	80	80	80	80	78
	60	80	80	80	80	80	70
	66	80	80	80	80	80	64
	72	80	80	80	80	78	58
	74	80	80	80	80	76	57
42	42	80	80	80	80	80	80
	48	80	80	80	80	80	71
	54	80	80	80	80	80	67
	60	80	80	80	80	80	60
	66	79	80	80	80	73	55
	72	72	80	80	80	67	50
48	36	80	80	80	80	80	80
	42	80	80	80	80	80	71
	48	80	80	80	80	80	62
	54	77	80	80	80	78	58
	60	70	80	80	80	70	53
	66	63	80	80	80	64	48
54	30	80	80	80	80	80	80
	36	80	80	80	80	80	73
	42	77	80	80	80	80	63
	48	67	80	80	80	73	55
	54	60	80	80	80	69	52
	60	54	80	80	80	62	47
60	24	80	80	80	80	80	80
	30	70	80	80	80	80	66
	36	62	80	80	80	80	66
	42	53	80	80	80	75	57
	48	47	80	80	80	66	50
	54	42	80	80	80	62	47
66	24	67	80	80	80	80	80
	30	54	80	80	80	80	72
	36	45	80	80	80	80	60
	42	39	80	80	80	80	51
	48	34	80	80	80	60	45
	54	30	80	80	80	56	43
72	24	50	80	80	80	80	80
	30	40	80	80	80	80	66
	36	33	80	80	80	80	55
	42	-	77	80	80	80	47
	48	-	67	80	80	80	41
	54	-	60	80	80	80	39
78	24	-	80	80	80	80	76
	30	-	80	80	80	80	61
	36	-	68	80	80	80	51
	42	-	58	80	80	80	44
	48	-	51	80	80	79	38
	54	-	45	80	80	74	36
84	24	-	80	80	80	80	71
	30	-	62	80	80	80	57
	36	-	52	80	80	80	47
	42	-	44	80	80	80	40
	48	-	39	80	80	73	35
	54	-	35	80	80	69	33
90	24	-	80	80	80	80	66
	30	-	49	80	80	80	53
	36	-	41	80	80	80	44
	42	-	35	80	80	78	38
	48	-	30	80	80	68	33
	54	-	-	80	80	64	31

PRESSURE LOAD TABLE FOR STORM BARS & BAR END CONNECTIONS							
SHUTTER WIDTH (IN)	HEIGHT OR BAR SPACING (IN)	ALLOWABLE PRESSURES (PSF) FOR BARS			ALLOWABLE PRESSURE (PSF) AS CONTROLLED BY CONNECTIONS		
		TS2X2X1/8	TS3X2X1/8	TS5X2X1/8	CONN "A"		CONN "B" & "C"
					WOOD/BLOCK/CONC.	WOOD	
72	24	50	80	80	80	80	80
	30	40	80	80	80	80	66
	36	33	80	80	80	80	55
	42	-	77	80	80	80	47
	48	-	67	80	80	80	41
	54	-	60	80	80	80	39
78	24	-	80	80	80	80	76
	30	-	80	80	80	80	61
	36	-	68	80	80	80	51
	42	-	58	80	80	80	44
	48	-	51	80	80	79	38
	54	-	45	80	80	74	36
84	24	-	80	80	80	80	71
	30	-	62	80	80	80	57
	36	-	52	80	80	80	47
	42	-	44	80	80	80	40
	48	-	39	80	80	73	35
	54	-	35	80	80	69	33
90	24	-	80	80	80	80	66
	30	-	49	80	80	80	53
	36	-	41	80	80	80	44
	42	-	35	80	80	78	38
	48	-	30	80	80	68	33
	54	-	-	80	80	64	31

LOAD TABLE CONTINUED ON SHEET 7

NOTE: SEE INSTRUCTIONS ON SHEET 7 FOR USE OF ALL LOAD TABLES!

1. ALL PRESSURES ARE FOR BOTH POSITIVE & NEGATIVE AND ARE PSF.
 2. PRESSURES ARE LIMITED TO MAX. 80 PSF AS CONTROLLED BY TESTING.
 3. REF. SHEET 3 FOR CONNECTION TYPES.
 4. THE SHUTTERS MUST BE POSITIONED MINIMUM 2.125" FROM THE GLASS THEY PROTECT.
- * MAXIMUM SHUTTER HEIGHT A SINGLE STORM BAR SHUTTER IS 74".
MAXIMUM BAR SPACING FOR A MULTI STORM BAR SHUTTER IS 48".

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE 02/08/2001
BY Warren W. Schaefer
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0411-10

DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1-1	DATE: 01/10/01
DATE	
BY	
REVISION DESCRIPTION	
NO.	
(DADE)	
IMPACT COLONIAL SHUTTERS	
MANUFACTURER	
W. W. SCHAEFER ENGINEERING GULFSTREAM ALUMINUM & SHUTTER CORP.	
197 S.E. MONTEREY RD. STUART, FLORIDA 34994 (561)287-6476	
CONSULTANTS	
W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.	
600 SANDTREE DRIVE, SUITE 203B PALM BEACH GARDENS, FL 33403 PHONE: 561-775-4902 FAX: 561-775-4903	
DRAWING TITLE	
CERTIFICATION	
JAN 10 2001	
WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1000	REV.
SHEET NO. 6	OF 7

PRESSURE LOAD TABLE FOR STORM BARS & BAR END CONNECTIONS

SHUTTER WIDTH (IN)	HEIGHT OR BAR SPACING (IN)	ALLOWABLE PRESSURES (PSF) FOR BARS			ALLOWABLE PRESSURE (PSF) AS CONTROLLED BY CONNECTIONS		
		TS2X2X1/8	TS3X2X1/8	TS5X2X1/8	CONN "A"		CONN "B" & "C"
					WOOD/BLOCK/CONC.	WOOD	BLOCK/CONC.
96	24	-	48	80	80	80	62
	30	-	39	80	80	66	50
	36	-	32	80	80	55	41
	42	-	-	80	73	47	35
	48	-	-	80	64	41	31
	54	-	-	78	60	39	29
	60	-	-	70	54	35	-
	66	-	-	64	49	32	-
	72	-	-	58	45	29	-
74	-	-	57	44	-	-	
102	24	-	39	80	80	77	58
	30	-	31	80	80	62	47
	36	-	-	80	80	52	39
	42	-	-	80	69	44	33
	48	-	-	70	60	39	29
	54	-	-	62	57	37	-
	60	-	-	56	51	33	-
	66	-	-	51	47	30	-
	72	-	-	47	43	27	-
74	-	-	45	42	-	-	
108	24	-	31	80	80	73	55
	30	-	-	80	80	58	44
	36	-	-	76	76	49	37
	42	-	-	65	65	42	31
	48	-	-	57	57	37	28
	54	-	-	51	54	35	-
	60	-	-	46	48	31	-
	66	-	-	41	44	28	-
	72	-	-	38	40	-	-
74	-	-	37	39	-	-	
112	24	-	-	80	80	70	53
	30	-	-	80	80	56	42
	36	-	-	66	73	47	35
	42	-	-	57	63	40	30
	48	-	-	50	55	35	-
	54	-	-	44	52	33	-
	60	-	-	40	47	30	-
	66	-	-	36	42	27	-
	72	-	-	33	39	-	-
74	-	-	32	38	-	-	

LOAD TABLE INSTRUCTIONS:

1. DETERMINE THE SIZE OF THE SHUTTER.
2. DETERMINE WHAT THE REQUIRED DESIGN POSITIVE & NEGATIVE WIND LOADS ARE FOR THE SHUTTER.
3. IF THE SHUTTER HEIGHT IS 74" OR LESS, GO TO THE PRESSURE TABLE ON SHEET 5. IF THE REQUIRED LOADS ARE LESS THAN OR EQUAL TO THOSE IN THE TABLE, ONLY ONE BAR IS REQUIRED (USE THE PRESSURE TABLE ON SHEET 5). IF NOT, MORE THAN ONE BAR IS REQUIRED.
4. IF THE SHUTTER HEIGHT IS GREATER THAN 74", DO NOT USE THE TABLE ON SHEET 5 & GO TO THE STORM BAR LOAD TABLES ON SHEETS 6 & 7.
5. IF ONLY ONE BAR IS REQUIRED, GO TO THE STORM BAR LOAD TABLES ON SHEETS 6 & 7. FIND THE APPLICABLE SHUTTER WIDTH IN THE 1ST COLUMN & SHUTTER HEIGHT IN THE 2ND COLUMN. GO ACROSS THE STORM BAR COLUMNS UNTIL YOU HAVE A BAR WHICH MEETS THE REQUIRED PRESSURE. THEN GO ACROSS THE CONNECTION COLUMNS UNTIL YOU HAVE A CONNECTION THAT MEETS THE REQUIRED PRESSURE. USE THAT BAR & THAT CONNECTION. NOTE THAT IF YOU DECIDE THAT THE BAR &/OR CONNECTION IS TOO LARGE FOR YOUR LIKING, ADD A BAR & GO TO INSTRUCTION NUMBER 6 BELOW.
6. IF MORE THAN ONE BAR IS REQUIRED, GO TO THE STORM BAR LOAD TABLES ON SHEETS 6 & 7. FIND THE APPLICABLE SHUTTER WIDTH IN THE 1ST COLUMN & STORM BAR SPACING IN THE 2ND COLUMN. GO ACROSS THE STORM BAR COLUMNS UNTIL YOU HAVE A BAR WHICH MEETS THE REQUIRED PRESSURE. THEN GO ACROSS THE CONNECTION COLUMNS UNTIL YOU HAVE A CONNECTION THAT MEETS THE REQUIRED PRESSURE. USE THAT BAR & THAT CONNECTION. NOTE THAT IF YOU DECIDE THAT THE BAR &/OR CONNECTION IS TOO LARGE FOR YOUR LIKING, ADD ANOTHER BAR & START AGAIN WITH INSTRUCTION NUMBER 6.

NOTE THAT WHEN MORE THAN ONE BAR IS USED WITH ONE SHUTTER, THE MAXIMUM BAR SPACING MAY NOT EXCEED 48".

DRAWN BY: W.W.S.		CHECKED BY: W.W.S.	
PLOT: 1=1		DATE: 01/10/01	
DATE	BY	REVISION DESCRIPTION	NO.
DRAWING TITLE IMPACT COLONIAL SHUTTERS		MANUFACTURER GULFSTREAM ALUMINUM & SHUTTER CORP.	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A.		197 S.E. MONTEREY RD. STUART, FLORIDA 34994 (561)287-6476	
600 SANDTREE DRIVE, SUITE 203B PALM BEACH GARDENS, FL 33403 PHONE: 561-775-4902 FAX: 561-775-4903			
CERTIFICATION JAN 10 2001		WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE <u>02/08/2001</u> BY <u>Heung H. Ho</u> PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. <u>00-0411.10</u>		DRAWING NO. 1000 REV. 	
SHEET NO. 7 OF 7			