



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Wheeling Corrugating Company  
1134 Market Street  
Wheeling, WV 26003**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by the BCCO and accepted by the Building Code and Product Review Committee to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The BCCO (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BCCO reserves the right to revoke this acceptance, if it is determined by BCCO that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County or Florida Building Code.

**DESCRIPTION: "R" Panel Steel Roofing**

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 7.

The submitted documentation was reviewed by Frank Zuloaga, RRC



**NOA No.: 00-0501.14  
Expiration Date: 02/21/07  
Approval Date: 02/21/02  
Page 1 of 7**

**ROOFING SYSTEM APPROVAL:**

**Category:** Roofing  
**Sub-Category:** Metal, Panels  
**Material:** Steel  
**Deck Type:** Wood  
**Maximum Design Pressure:** -87.5 psf.

**TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:**

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Wheeling Corrugating Company "R" Roof Panel	Length: varies Width: 37" Height: 1-1/4" Thickness: .0217"	PA 110	G-90 Galvanized, AZ55, Wheeling Paint System, Fluoropan, Kylar or Hylar over G60 Galvanized Steel.

**TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS:**

<u>Product</u>	<u>Dimensions</u>	<u>Product Description</u>	<u>Manufacturer</u>
#30 Felt	N/A	Saturated organic felt to be used as a nailed underlayment.	Generic (With current NOA)
#43 Coated Base Sheet	N/A	Saturated and coated organic base sheet for single or double ply underlayment.	Generic (With current NOA)
Fire Barrier Board ("Dens Deck")	Min. 1/4" thick	Fire barrier for Class 'A' fire rating.	Georgia-Pacific (With current NOA)
Fire Barrier ("Roctex")	Min. 450 grams/m <sup>2</sup>	Fire barrier for Class 'A' fire rating.	Partek Insulations, Inc. (With current NOA)
Fasteners (Panel)	Min. 0.178 inch diameter by 1-1/2 long	Corrosion resistant, sharp point hex-head screws with neoprene sealing washer.	Generic (With current NOA)



## APPROVED SYSTEMS:

- SYSTEM:** Wheeling Corrugating Company "R" Roof Panel
- Deck Type:** Wood, Non-insulated
- Deck Description:** New Construction or Re-roof  
 $1\frac{5}{32}$ " or greater plywood or wood plank.
- Slope Range:** 2": 12" or greater
- Maximum Uplift Pressure:** The maximum allowable design pressure -52.5 psf
- Deck Attachment:** **In accordance with applicable building code, but in no case shall it be less than  $1\frac{5}{32}$ " plywood fastened with #8 x 2 inch wood screws spaced 6" o.c. to wood structural supports spaced at a maximum of 24 inches o.c.**
- Underlayment:** Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 15" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 12 gauge 1  $\frac{1}{4}$ " annular ring-shank nails, spaced 6" o.c. at all laps and one staggered rows 12" o.c. in the field of the 17" exposure.
- Valleys:** Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Wheeling Corrugating Company "R" Roof Panel' current published installation instructions.
- Fire Barrier Board:** For class A or B fire rating, install minimum  $\frac{1}{4}$ " thick Georgia Pacific "Dens Deck" or one layer of "Roctex" or  $\frac{5}{8}$ " water resistant type X gypsum sheathing with treated core and facer, in compliance with Roofing Application Standard RAS 133.
- Metal Panels and Accessories:** Install the "Wheeling Corrugating Company "R" Roof Panel" and accessories in compliance with Wheeling Corrugating Company' current published installation instructions and details. Flashing, penetrations, valley construction and other details shall be constructed in compliance with the minimum requirements provided in Roofing Application Standards RAS 133.
- "R" Roofing Panels shall be fastened with a minimum of #9-15 sharp point screws with a hex-washer head and neoprene sealing washer of sufficient length to penetrate through the deck spaced at  $\frac{3}{16}$ " at a maximum spacing of 12 inches o.c. in all directions as follows:
1. Side laps shall be fastened with a minimum of two screws spaced at a maximum of 12 inches along the entire length of the roof (parallel to the roof slope) see details herein.
  2. Panel width shall be fastened with fasteners at a maximum spacing of 12 inches o.c. perpendicular to the slope of the roof in accordance with the detail herein. Fastener rows shall continue up the entire length of the roof (parallel to the roof slope) at a maximum spacing of 12 inches o.c.



- SYSTEM:** Wheeling Corrugating Company "R" Roof Panel
- Deck Type:** Wood, Non-insulated
- Deck Description:** New Construction or Re-roof  
<sup>15</sup>/<sub>32</sub>" or greater plywood or wood plank.
- Slope Range:** 2": 12" or greater
- Maximum Uplift Pressure:** The maximum allowable design pressure -87.5 psf
- Deck Attachment:** In accordance with applicable building code, but in no case shall it be less than <sup>15</sup>/<sub>32</sub>" plywood fastened with #8 x 1-7/8 inch wood screws spaced 6" o.c. to wood structural supports spaced at a maximum of 12 inches o.c.
- Underlayment:** Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 15" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 12 gauge 1 1/4" annular ring-shank nails, spaced 6" o.c. at all laps and one staggered rows 12" o.c. in the field of the 17" exposure.
- Valleys:** Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Wheeling Corrugating Company "R" Roof Panel' current published installation instructions.
- Fire Barrier Board:** For class A or B fire rating, install minimum 1/4" thick Georgia Pacific "Dens Deck" or one layer of "Roctex" or 5/8" water resistant type X gypsum sheathing with treated core and facer, in compliance with Roofing Application Standard RAS 133.
- Metal Panels and Accessories:** Install the "Wheeling Corrugating Company "R" Roof Panel" and accessories in compliance with Wheeling Corrugating Company' current published installation instructions and details. Flashing, penetrations, valley construction and other details shall be constructed in compliance with the minimum requirements provided in Roofing Application Standards RAS 133.
- "R" Roofing Panels shall be fastened with a minimum of # 0.178" diameter sharp point screw with a hex-washer head and neoprene sealing washer of sufficient length to penetrate through the deck spaced at <sup>3</sup>/<sub>16</sub>" at a maximum spacing of 12 inches o.c. in all directions as follows:
1. Side laps shall be fastened with a minimum of two screws spaced at a maximum of 12 inches along the entire length of the roof (parallel to the roof slope) see details herein.
  2. Panel width shall be fastened with fasteners at a maximum spacing of 12 inches o.c. perpendicular to the slope of the roof in accordance with the detail herein. Fastener rows shall continue up the entire length of the roof (parallel to the roof slope) at a maximum spacing of 12 inches o.c.



## SYSTEM LIMITATIONS:


1. Increased design pressures at perimeter and corner areas, in compliance with applicable building code may be met through rational analysis by increasing the number of attachment points in these areas. The maximum fastener spacing noted in the "Systems Description" section of this approval shall not be exceeded. All rational analysis computation shall be prepared, signed and sealed by a Florida registered Professional Engineer, Registered Architect, or Registered Roof Consultant.
2. Panels shall be rolls formed in continuous lengths from eave to ridge. Maximum lengths shall be as described in Roofing Application Standard RAS 133.
3. All panels shall be permanently labeled with the manufacturer's name or logo, and the following statement: "Miami-Dade County Product Control Approved."

## EVIDENCE SUBMITTED:



<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Architectural Testing Inc.	01-35689.01	PA 125 PA 100	11/17/99
Architectural Testing Inc.	01-35687.03	ASTM B-117 ASTM G-23 ASTM D-714 ASTM D-772	12/22/99
Architectural Testing Inc.	01-35688.02	ASTM B-117 ASTM G-23 ASTM D-714 ASTM D-772	12/22/99
Architectural Testing Inc.	01-35689.02	ASTM B-117 ASTM G-23 ASTM D-714 ASTM D-772	12/22/99
Architectural Testing Inc.	01-35690.02	ASTM B-117 ASTM G-23 ASTM D-714 ASTM D-772	12/22/99
Underwriters Laboratory	00NB/R20684	UL 580	09/14/01




# WHEELING CORRUGATING COMPANY "R" ROOF PANEL

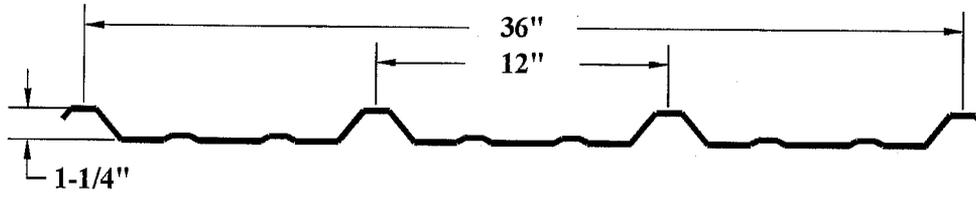

## FASTENER LOCATION

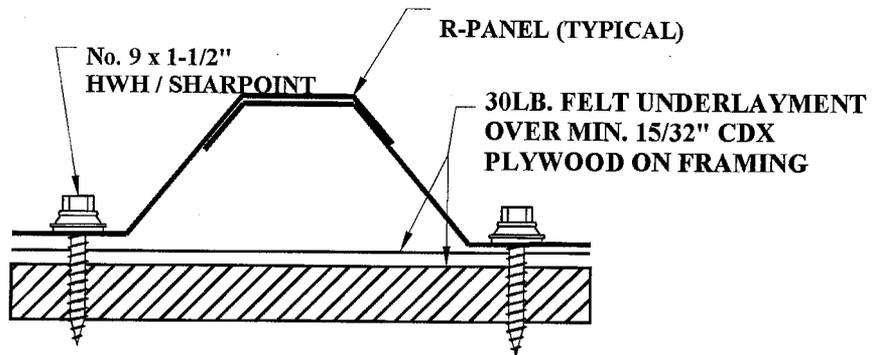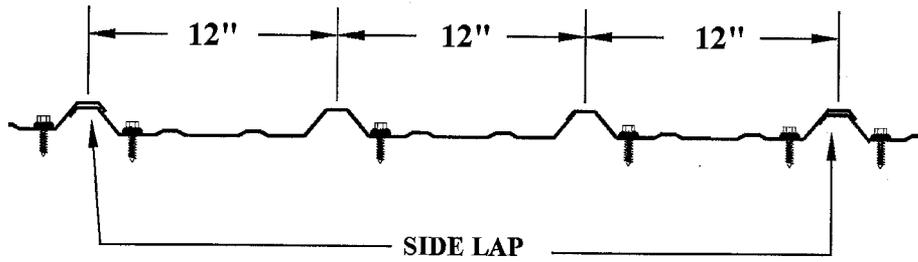

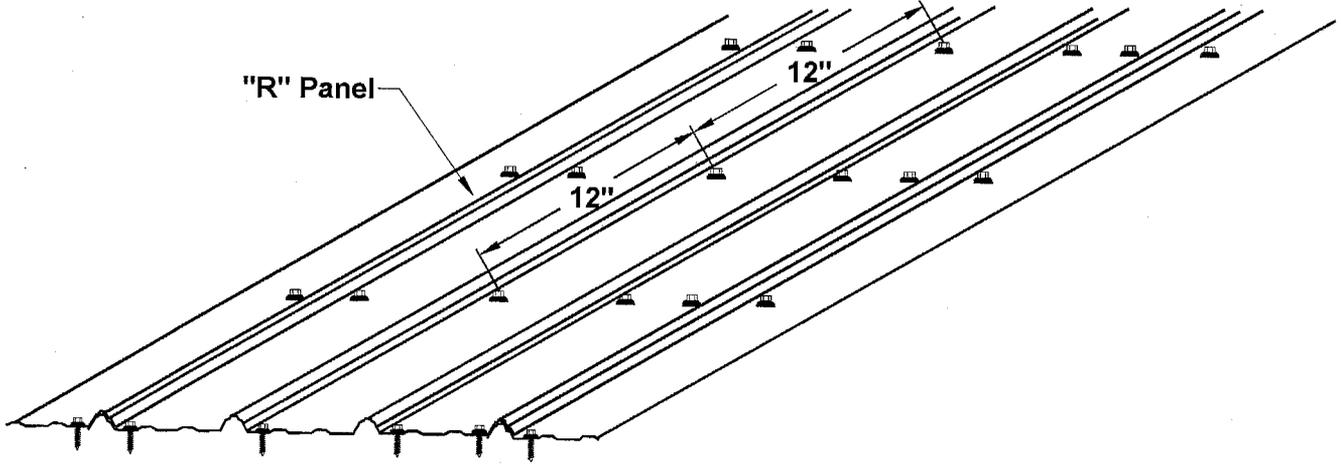

**END OF THIS ACCEPTANCE**



**NOA No.: 00-0501.14**  
**Expiration Date: 02/21/07**  
**Approval Date: 02/21/02**  
**Page 7 of 7**