



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Hope's Windows, Inc.
84 Hopkins Ave.
Jamestown ,NY 14701

Your application for Notice of Acceptance (NOA) of:

"Jamestown" Series Steel Fixed Windows

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-0519.12
EXPIRES: 08/23/2004

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 08/23/2001

Hope's Windows Inc.

ACCEPTANCE No.: 00-0519.12

APPROVED : August 23, 2001

EXPIRES : August 23, 2004

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1 This approves a steel fixed window, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1 The Series "Jamestown" Steel Fixed Window – Large Missile Impact Resistant and its components shall be constructed in strict compliance with the following documents: Drawing No S-2095, titled " Hope's Jamestown Series Fixed Windows" Sheets 1 through 6 of 6, dated 02/02/01 and last revised on 05-26-01, prepared by R W Building Consultant Inc., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1 This approval applies to single unit applications only, as shown in approved drawings.

4. INSTALLATION

- 4.1 The steel fixed window and its components shall be installed in strict compliance with the approved drawings (See details for anchor type, spacing & glazing types).
- 4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.

5. LABELING

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

Hope's Windows Inc.

ACCEPTANCE No.: 00-0519.12

APPROVED : August 23, 2001

EXPIRES : August 23, 2004

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

END OF THIS ACCEPTANCE

Hope's Windows Inc.

ACCEPTANCE No.: 00-0519.12

APPROVED : August 23, 2001

EXPIRES : August 23, 2004

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED
(For File ONLY. Not part of NOA.)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **S-2095**, titled "Hope's Jamestown Series Fixed Windows" Sheets 1 through 6 of 6, dated 02/02/01 and last revised on 05-26-01, prepared by R W Building Consultant Inc.

B. TESTS

1. Test reports on 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
4) Large Missile Impact Test per SFBC, PA 201-94
5) Cyclic Wind Pressure Loading per SFBC, PA 203-94
6) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
along with marked-up drawings and installation diagram of a steel fixed window, dated 04/04/99, prepared by Architectural Testing Inc., for Test Report No. **ATI-01-34554.01**, this report has been revised by addendum letter dated 01-24-01, signed and sealed by Allen N. Reeves, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis dated 02/02/01, prepared, signed and sealed by Wendell Haney, P.E.

D. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **98-0608.03**, issued to E.I. DuPont DeNemours for "Sentry Glass Plus" dated 01-14-1999, expiring on 01-14-2002.
2. Photocopies of Tensile test report No. ETC-01-589-10638.0, dated 3-28-01, issued by ETC Laboratories, per ASTM-E-8, for steel frame material., signed by Arthur Murray, manager (original is pending from manufacturer).
3. Revised Tensile test report No. ETC-01-589-10638.01, dated 3-28-01, issued by ETC Laboratories, per ASTM-E-8, for steel frame material., signed and sealed by Joseph L. Doland, P.E.

E. STATEMENTS

1. Statement letter of conformance and "statement of no financial interest", dated February 02, 2001, signed and sealed by Wendell Haney, P.E.
2. Laboratory compliance letter, issued by Architectural Testing Inc., Test Report No. **ATI-01-34554.01**, dated 04/28/99, signed and sealed by Allen N. Reeves, P.E.
3. Addendum letter dated 24 January, 2001, issued by Architectural Testing Inc., Test Report No. **ATI-01-34554.01**, signed and sealed by Allen N. Reeves, P.E.
4. Letter from Dupont dated December 04, 2000, reference to investigation outcome of Dupont's Sentry Glass Plus interlayer.
5. Letter from Hopes Window dated January 30, 2001, designating Rick Wright of WR Building Consultant Inc., as the contact person for this file.

F. OTHER

1. Glazing: This file submitted in 2000, has been reviewed for glazing per table 35E of SFBC. Glazing must comply per ASTM-1300-98 at the time of **next revision or renewal**

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

HOPE'S Windows, Inc.

THE JAMESTOWN SERIES STEEL FIXED WINDOWS
WITH EQUAL AND LONG LEG FRAMES

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS ARE NOT REQUIRED.
6. THIS SYSTEM MEETS THE WATER REQUIREMENTS IN MIAMI-DADE COUNTY.
7. ALL WINDOW FRAMES AND WINDOW COMPONENTS ARE STEEL ELECTRO-DEPOSITED ZINC COATING PER ASTM B-633 TYPE 1, CLASS 3. ALL WINDOW COMPONENTS ARE THEN FINISH PAINTED WITH ULTRATHANE ACRYLIC POLYURETHANE ENAMEL.

JAMESTOWN SERIES STEEL WINDOW CONSTRUCTION

(Common to all conditions)

Steel Frame Material: The steel frame is made from Hot-Rolled steel carbon .10 to .15, with an average yield strength $F_y = 54,950$ psi.



Steel Frame Construction: The frame is constructed from solid steel members. The corners are mitered, butt joined and continuously welded and smoothed.

Glazing Method: Each unit is glazed with overall 0.330" thick nominal glass fabricated by Insulgard Corp. See glazing details sheets 4 & 5 for laminated and tempered glass details. The glass is interior glazed with a silicone back-bedding and a silicone head bead of Dow #995. A snap-in or screw-on aluminum glazing bead is attached to the interior of the window and a silicone cap bead of Dow #995 is applied to both the interior and exterior side.



TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	EQUAL LEG FRAME VERTICAL & HORIZONTAL CROSS SECTIONS
3	LONG LEG FRAME VERTICAL & HORIZONTAL CROSS SECTIONS
4	ANCHORING LOCATIONS TYPE #1 & GLAZING DETAILS 1 & 2
5	ANCHORING LOCATIONS TYPE #2 & GLAZING DETAIL 1
6	BILL OF MATERIALS & UNIT COMPONENTS

DESIGN PRESSURE RATING W/ ANCHOR SPACING TYPE 1 & GLAZING TYPE 1 OR 2		
ALL WINDOW MODELS	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	
PRESSURE	+80.0 psf	-80.0 psf

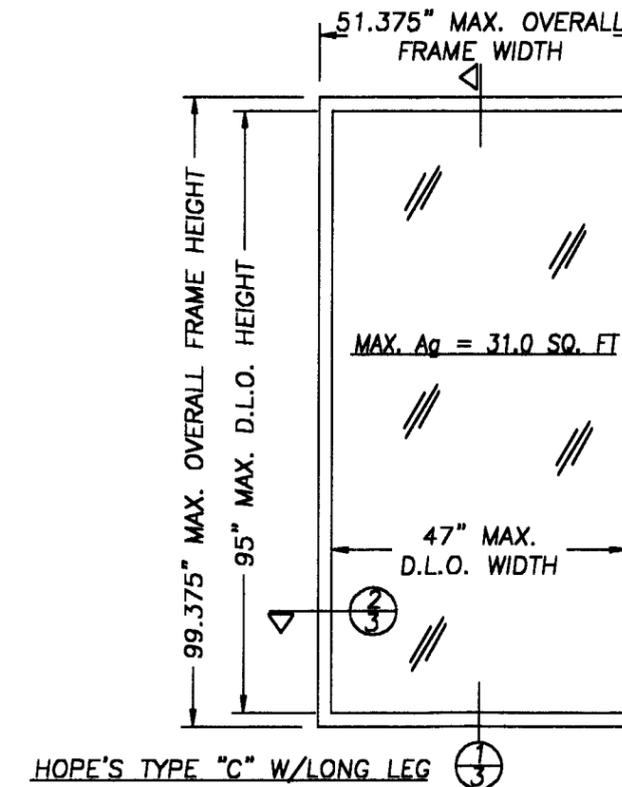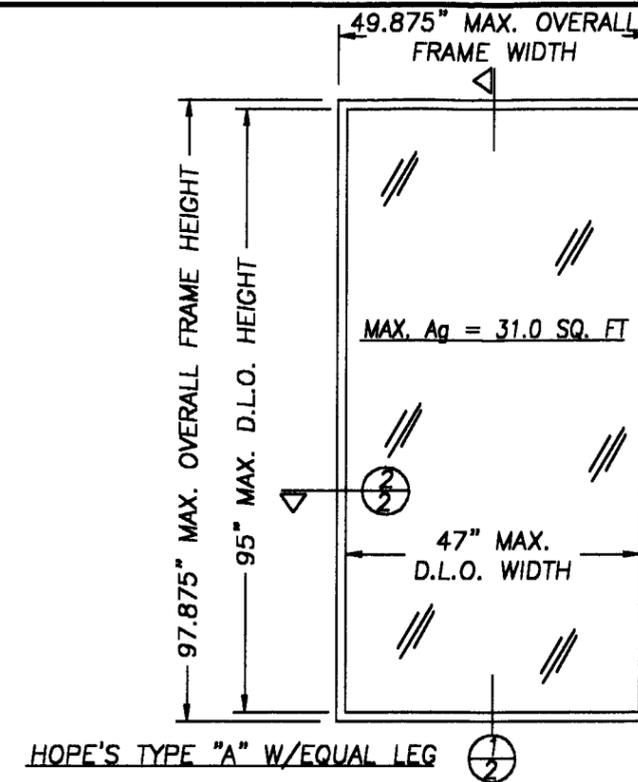

DESIGN PRESSURE RATING W/ ANCHOR SPACING TYPE 2 & GLAZING TYPE 1		
ALL WINDOW MODELS	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	
PRESSURE	+60.0 psf	-60.0 psf

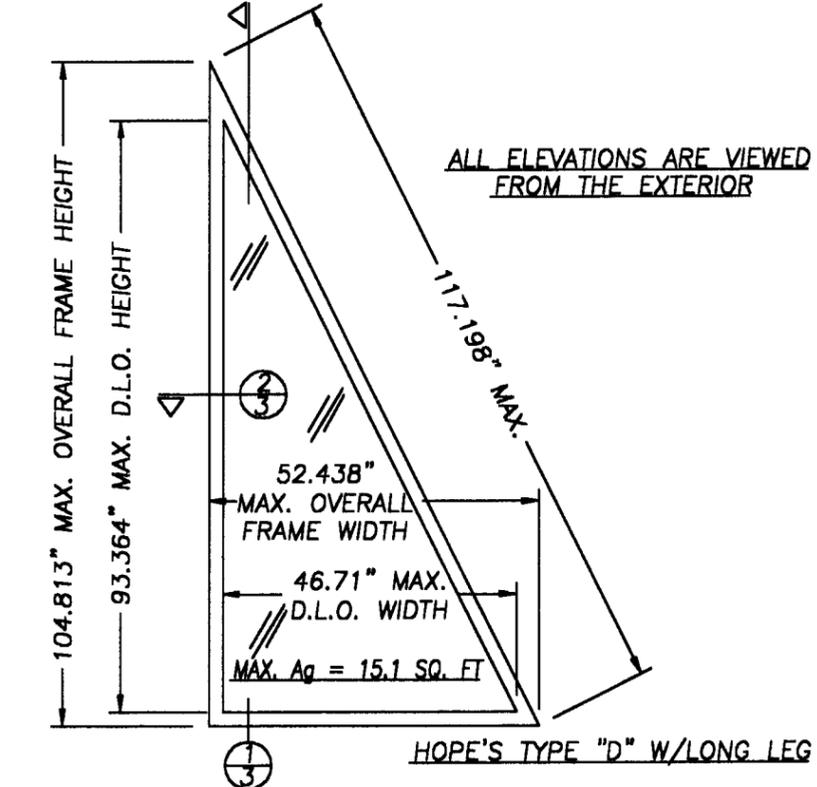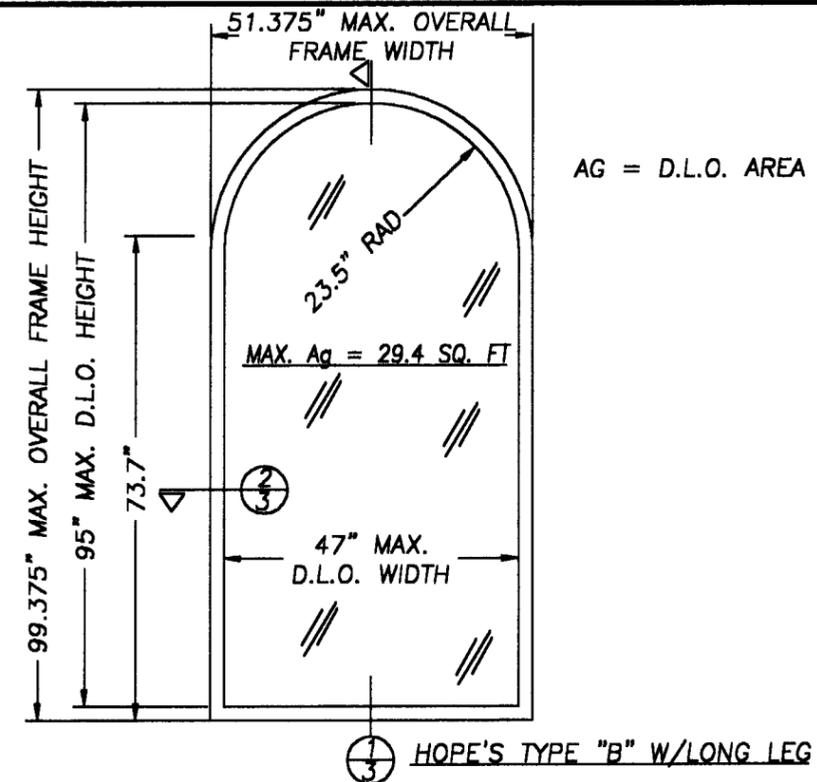

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE AUGUST 23, 2001
BY Shaq I. Zhande
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0519-12

DATE: 02/02/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2095
SHEET 1 OF 6


HOPE'S

64 HOPKINS AVE., P.O. BOX 580
JAMESTOWN, NEW YORK
PHONE (716) 665-5124 FAX (716) 665-6903


PRODUCT: HOPE'S JAMESTOWN SERIES STEEL FIXED WINDOWS W/ EQUAL & LONG LEG FRAMES
PART OR ASSEMBLY:
GENERAL NOTES & TYPICAL ELEVATIONS

NO.	DATE	REVISIONS
3	05/26/01	GENERAL REVISION TJH
2	04/04/01	GENERAL REVISION TJH
1	03/02/01	GENERAL REVISION TJH


RW BUILDING CONSULTANTS, INC.
813.684.3831

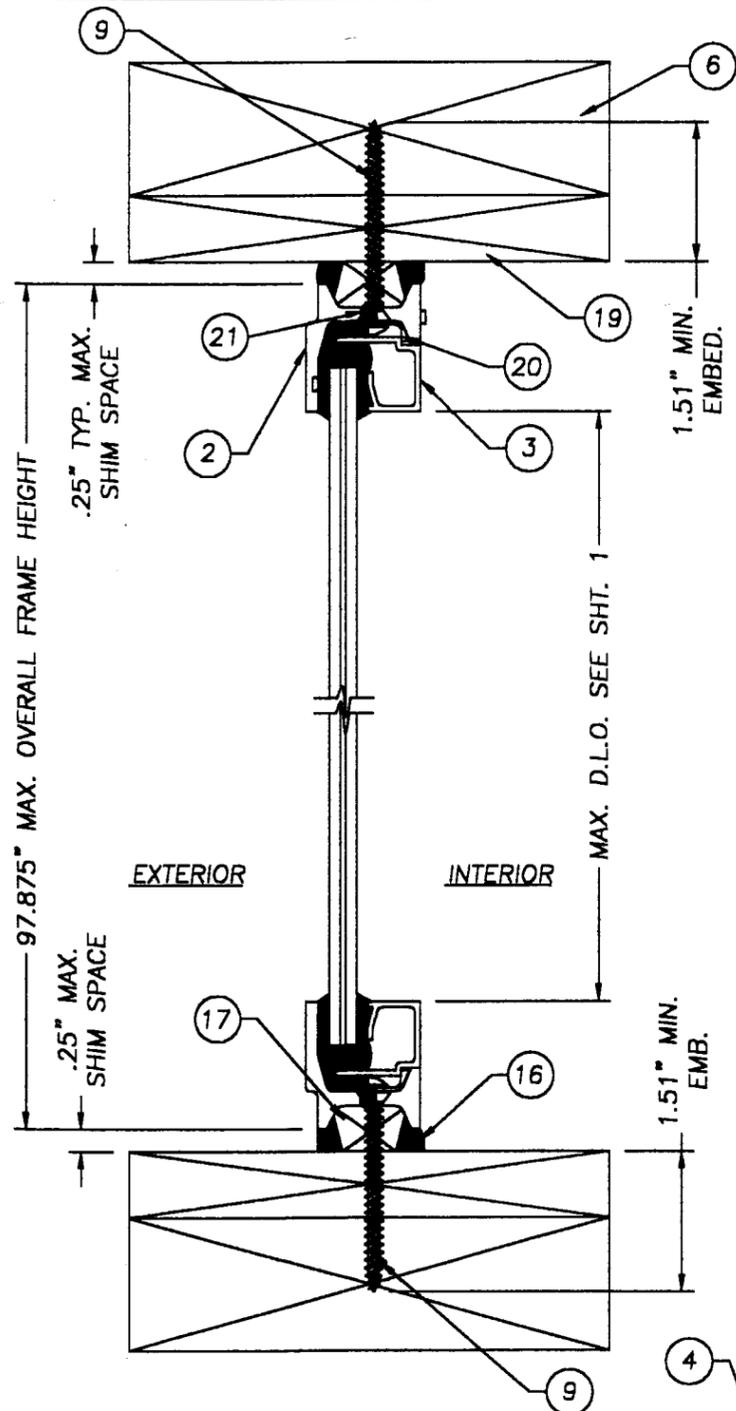


1 VERTICAL CROSS SECTION TO WOOD
2 EQUAL LEG FRAME

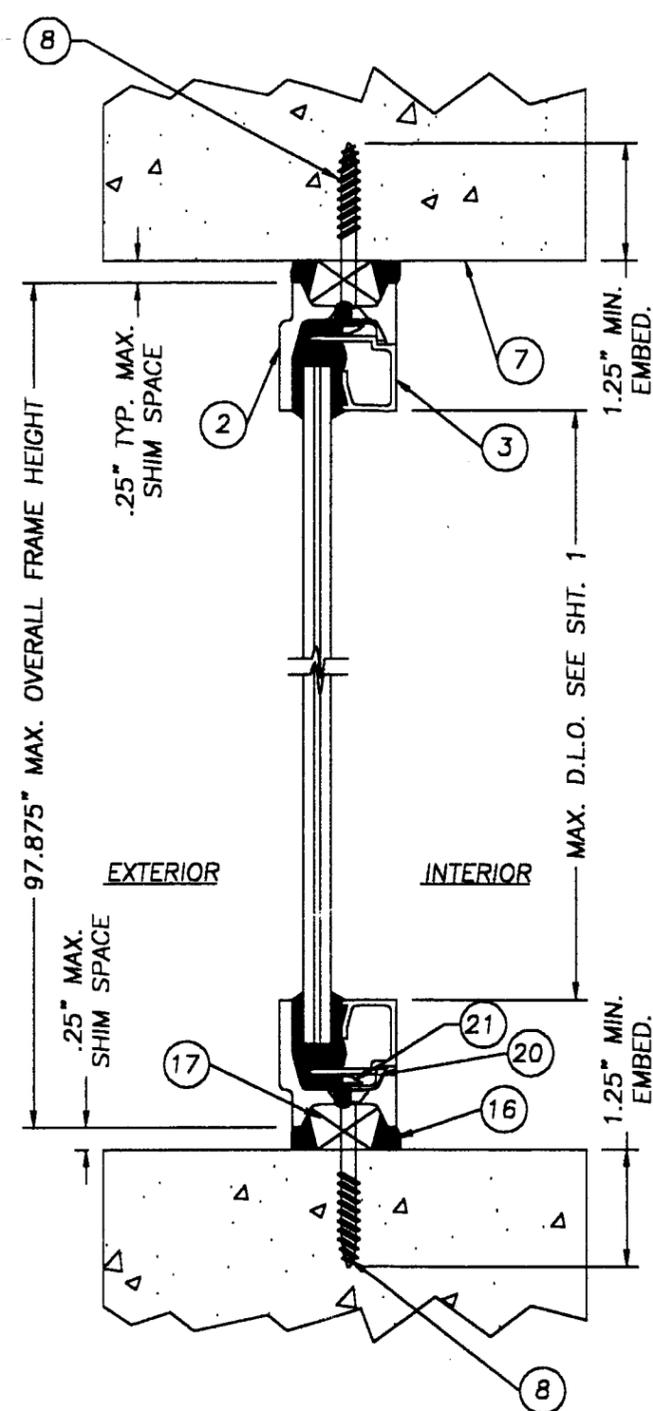


1 VERTICAL CROSS SECTION TO MASONRY
2 EQUAL LEG FRAME

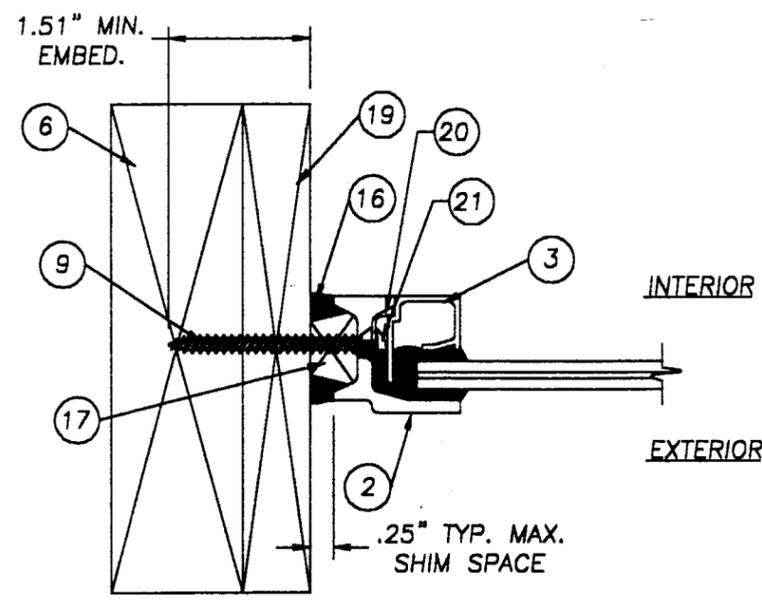

2 HORIZONTAL CROSS SECTION TO WOOD
2 EQUAL LEG FRAME

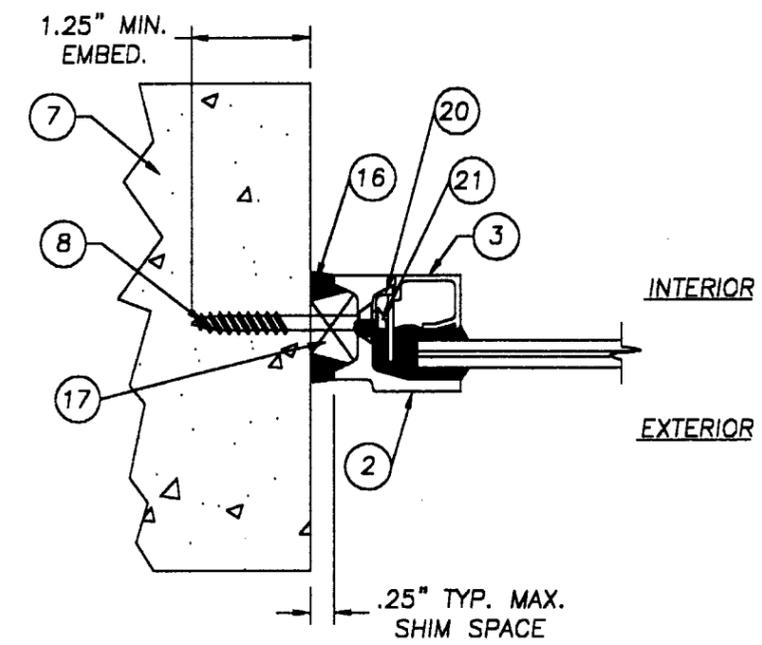

2 HORIZONTAL CROSS SECTION TO MASONRY
2 EQUAL LEG FRAME

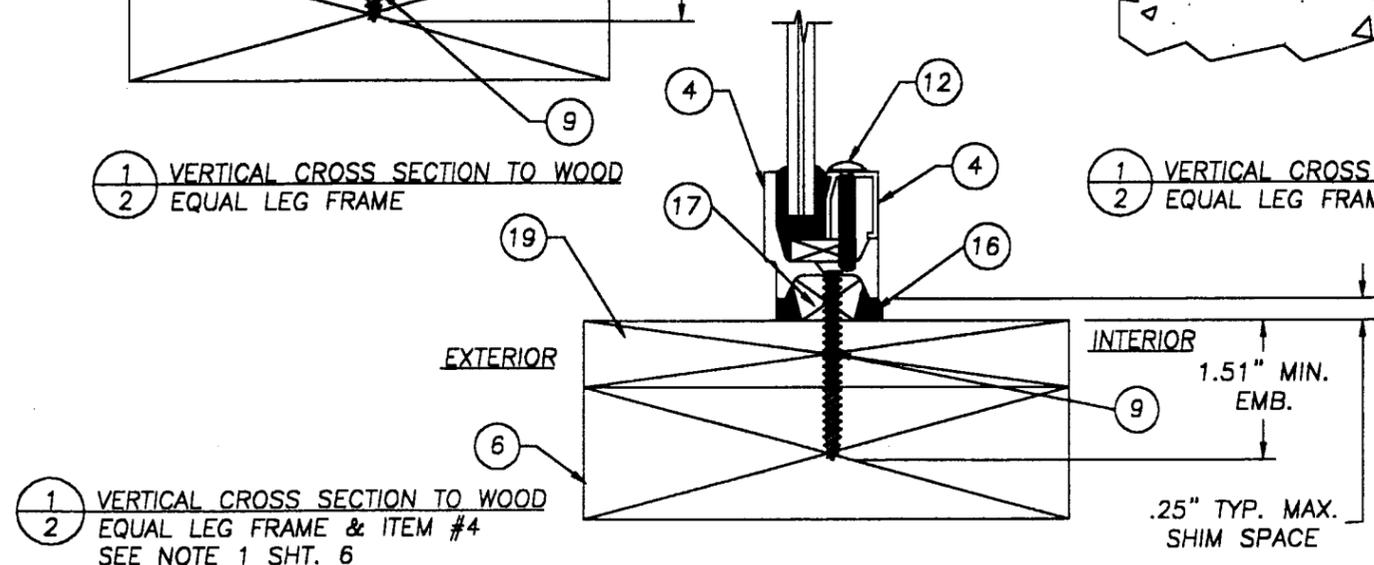

1 VERTICAL CROSS SECTION TO WOOD
2 EQUAL LEG FRAME & ITEM #4
SEE NOTE 1 SHT. 6

HOPE'S
 84 HOPKINS AVE., P.O. BOX 580
 JAMESTOWN, NEW YORK
 PHONE (716) 665-5124 FAX (716) 665-6903


PRODUCT: HOPE'S JAMESTOWN SERIES
 STEEL FIXED WINDOWS W/
 EQUAL & LONG LEG FRAMES
 PART OR ASSEMBLY:
 EQUAL LEG FRAME VERTICAL
 & HORIZONTAL X-SECTIONS

NO.	DATE	REVISIONS	BY
3	05/26/01	GENERAL REVISION	TJH
2	04/04/01	GENERAL REVISION	TJH
1	03/02/01	GENERAL REVISION	TJH

RW BUILDING
 CONSULTANTS, INC.
 813.684.3831


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE August 23, 2001
 BY Ishag J. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0519.12

DATE: 02/02/01
 SCALE: 1/2" = 1"
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: S-2095
 SHEET 2 OF 6

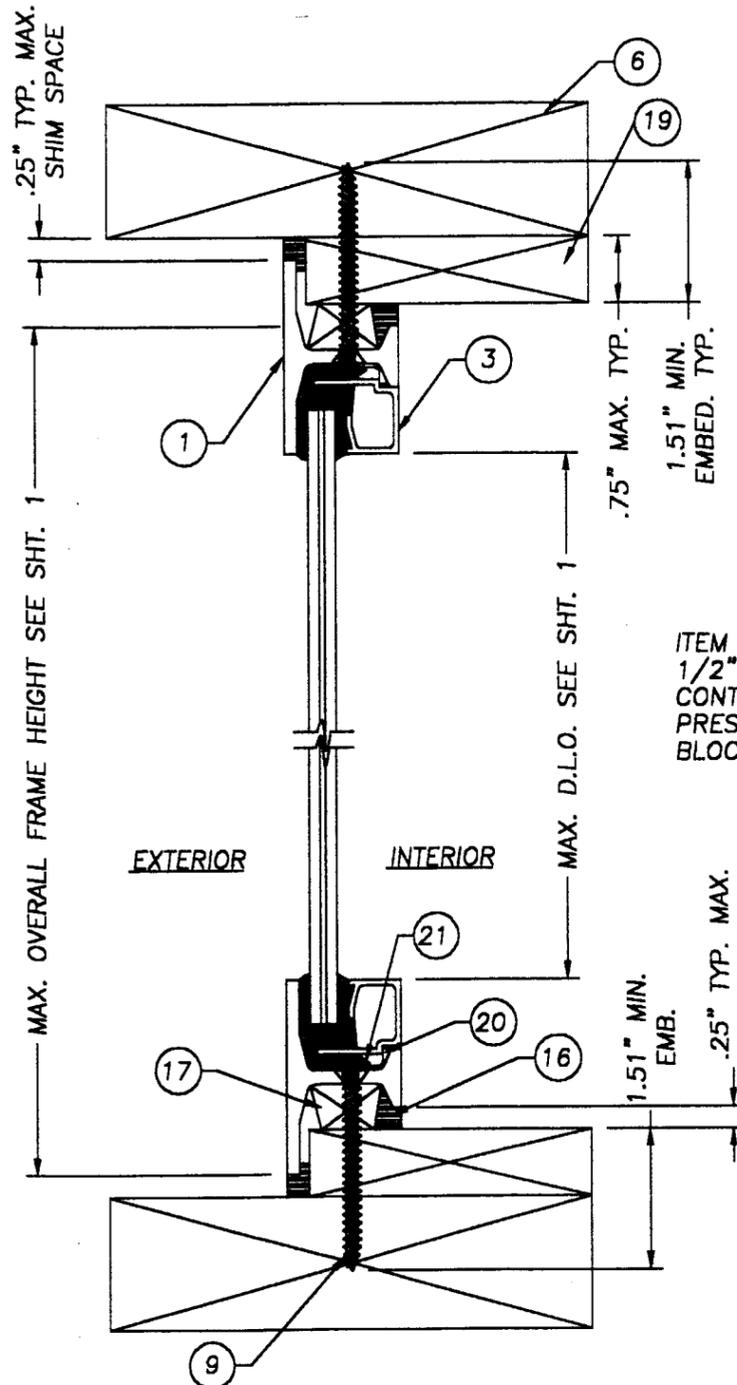


1 VERTICAL CROSS SECTION TO WOOD
3 LONG LEG FRAME


ITEM #17 (NOTE)
1/2" PROFILE
CONTINUOUS STABILIZED
PRESSURE TREATED
BLOCK

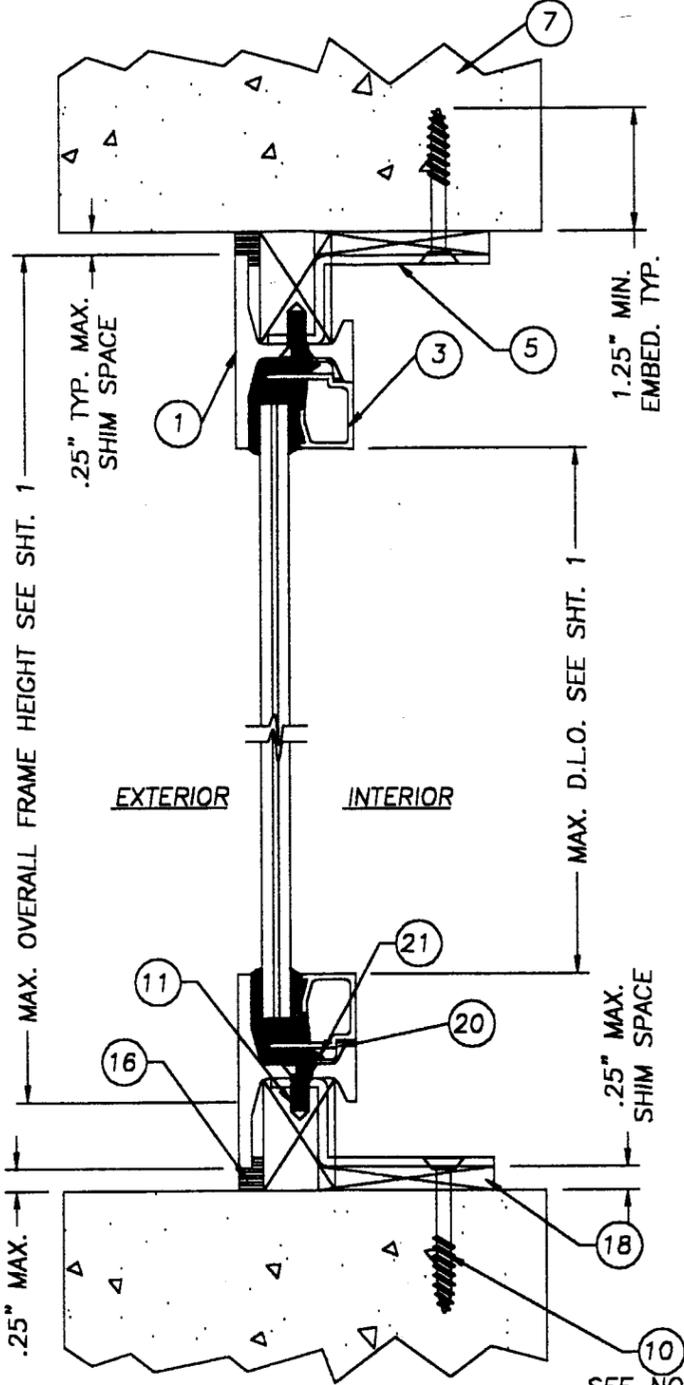

1 VERTICAL CROSS SECTION TO MASONRY
3 LONG LEG FRAME

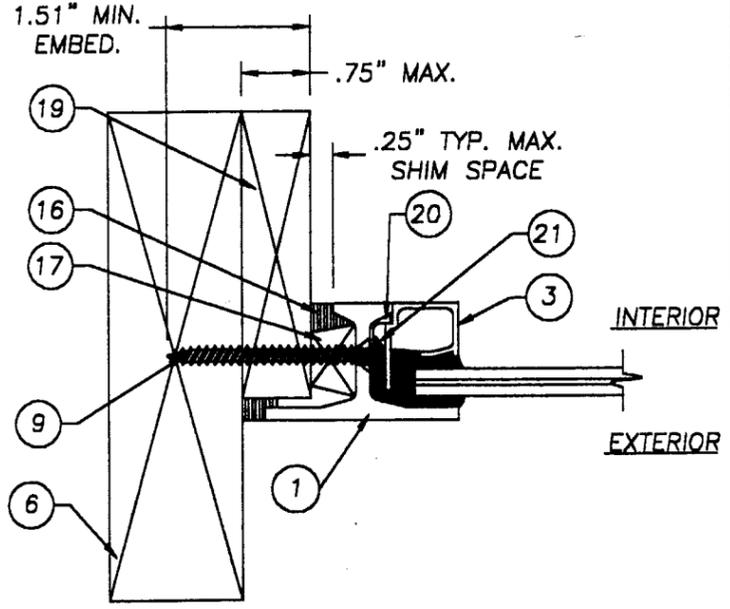


2 HORIZONTAL CROSS SECTION TO WOOD
3 LONG LEG FRAME

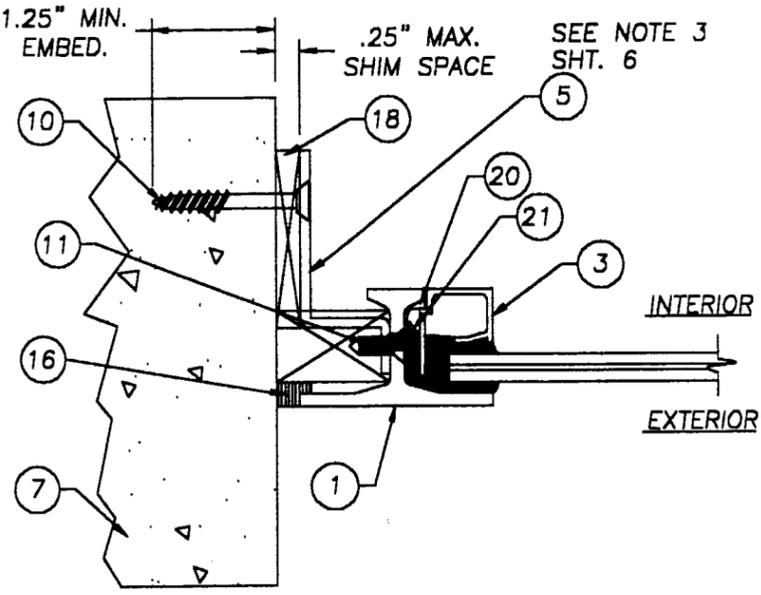

2 HORIZONTAL CROSS SECTION TO MASONRY
3 LONG LEG FRAME

1 VERTICAL CROSS SECTION TO WOOD
3 LONG LEG FRAME & ITEM #4
SEE NOTE 1 SHT. 6

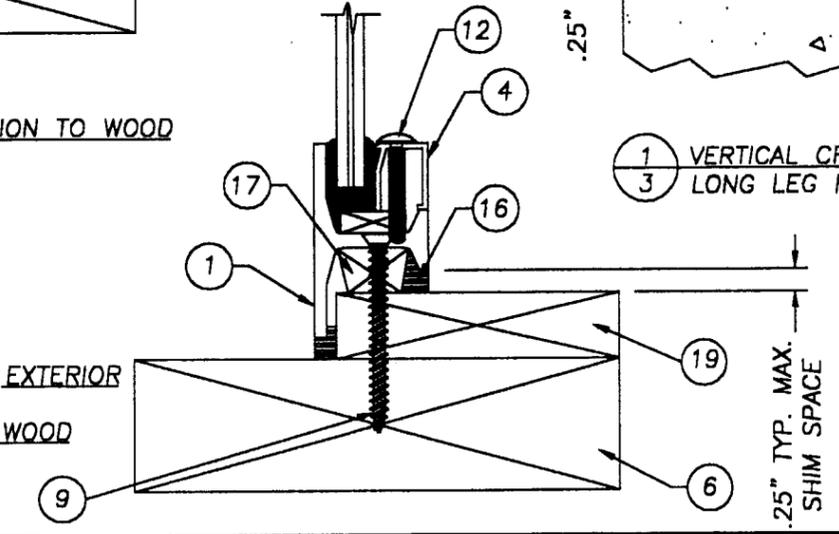

HOPE'S

84 HOPKINS AVE., P.O. BOX 580
JAMESTOWN, NEW YORK
PHONE (716) 665-6124 FAX (716) 665-6903



PRODUCT: HOPE'S JAMESTOWN SERIES
STEEL FIXED WINDOWS W/
EQUAL & LONG LEG FRAMES
PART OR ASSEMBLY:
LONG LEG FRAME VERTICAL
& HORIZONTAL X-SECTIONS

NO.	DATE	REVISIONS	BY
3	05/26/01	GENERAL REVISION	TJH
2	04/04/01	GENERAL REVISION	TJH
1	03/02/01	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE August 23, 2001
BY Shaq I. Chaudhry
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0519-12



DATE: 02/02/01
SCALE: 1/2" = 1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2095
SHEET 3 OF 6

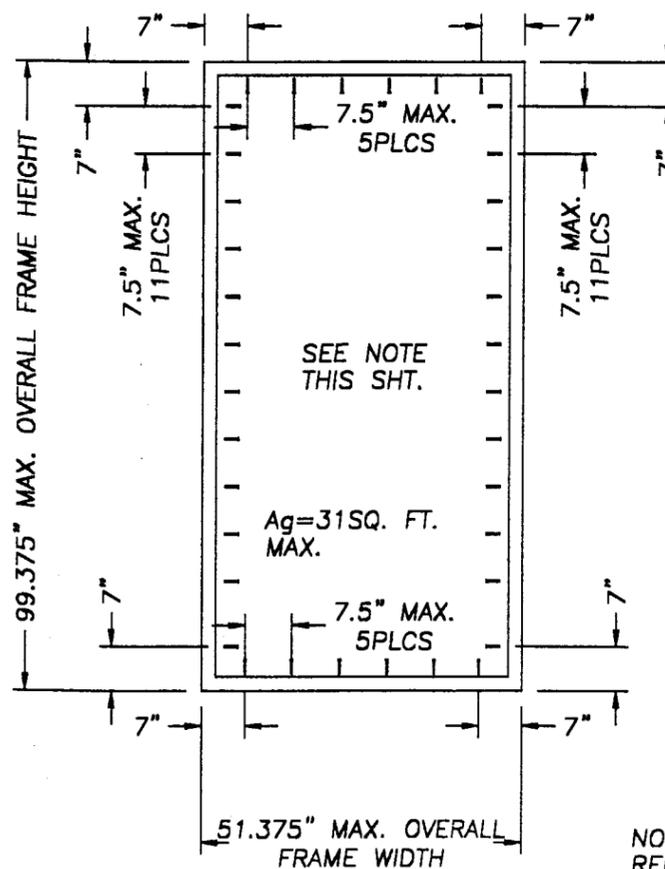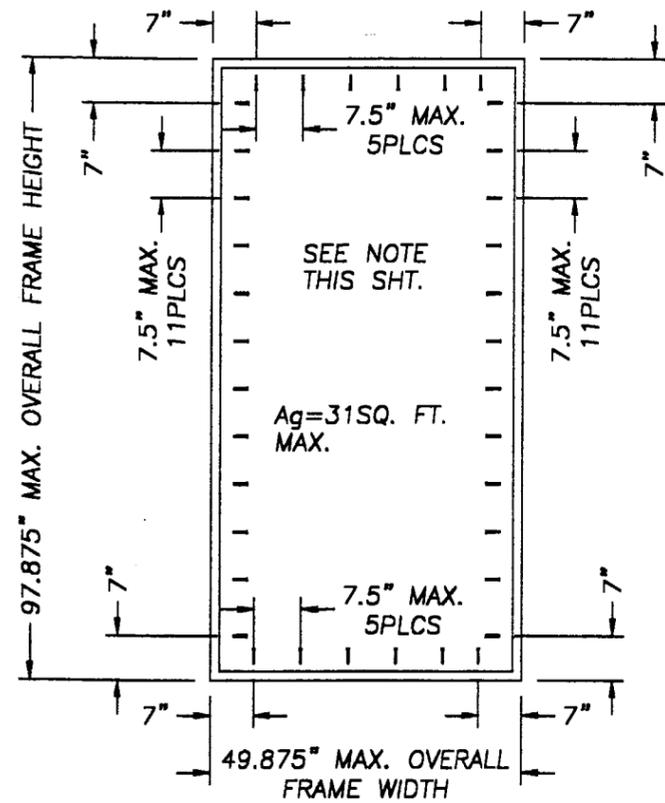



AG = D.L.O. AREA

DESIGN PRESSURE RATING W/ ANCHOR SPACING TYPE 1 & GLAZING TYPE 1 OR 2	
ALL WINDOW MODELS	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED
PRESSURE	+80.0 psf -80.0 psf

- ANCHOR SPACING TYPE #1
7" FROM ALL CORNERS AND A MAX. OF 7.5" O.C.
- A. GLAZING TYPE #1
USE GLAZING TYPE #1 WHEN D.L.O. AREA IS LESS THAN 23.0 SQ. FT.
- B. GLAZING TYPE #2
USE GLAZING TYPE #2 WHEN D.L.O. AREA IS GREATER THAN 23.0 SQ. FT UP TO 31.0 SQ. FT. MAX.

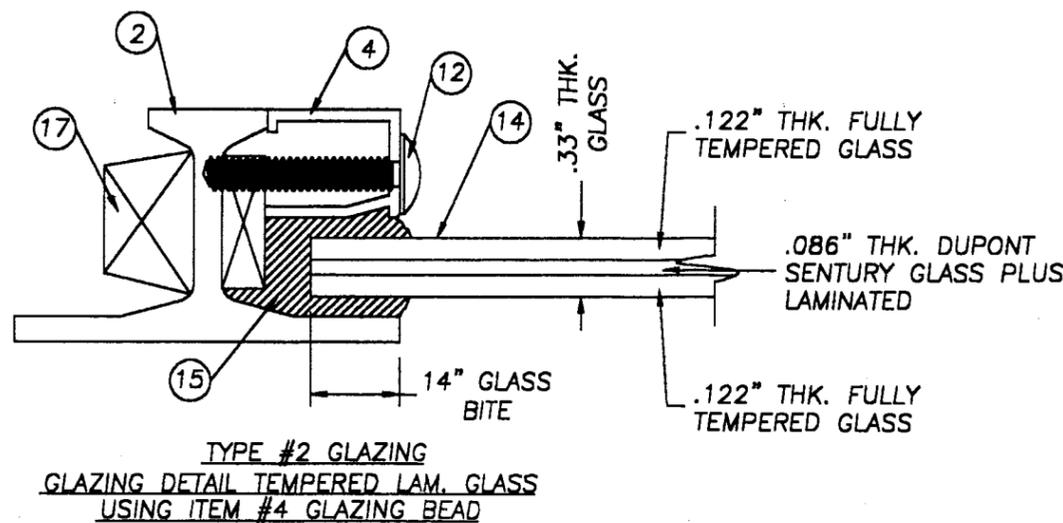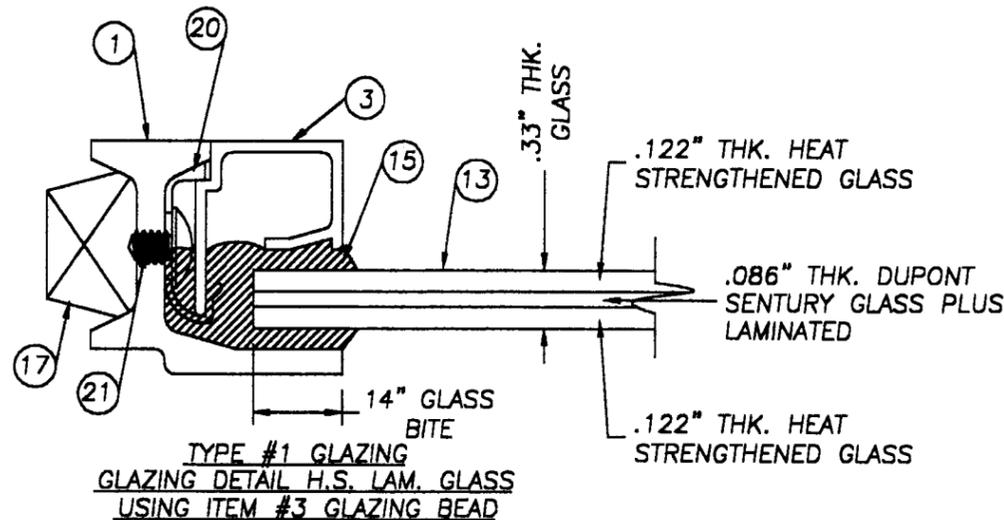

NOTE:
REFER TO CROSS SECTIONS ON SHTS. 2 & 3 TO DETERMINE THE ANCHOR TO BE USED FOR EACH INSTALLATION TYPE, I.E. MASONRY, WOOD OR INSTALLATION CLIP.

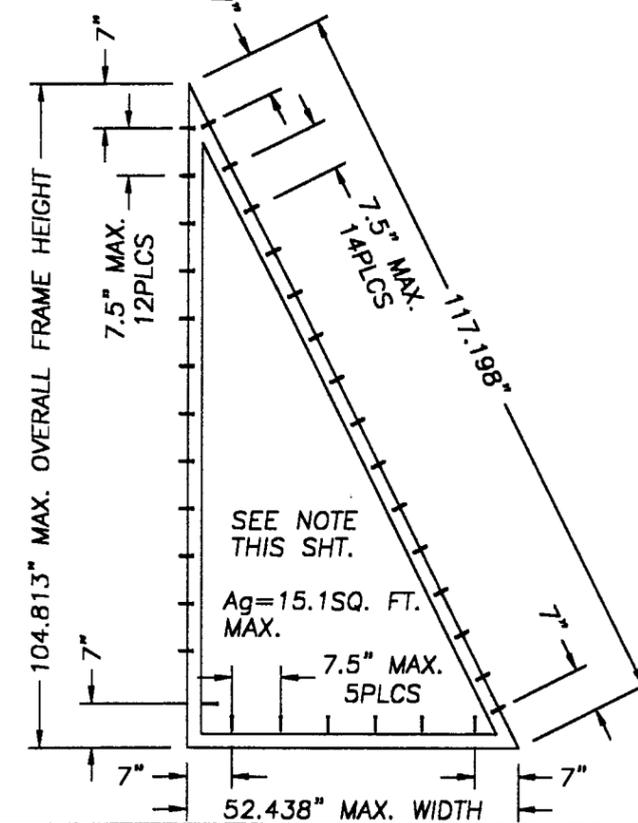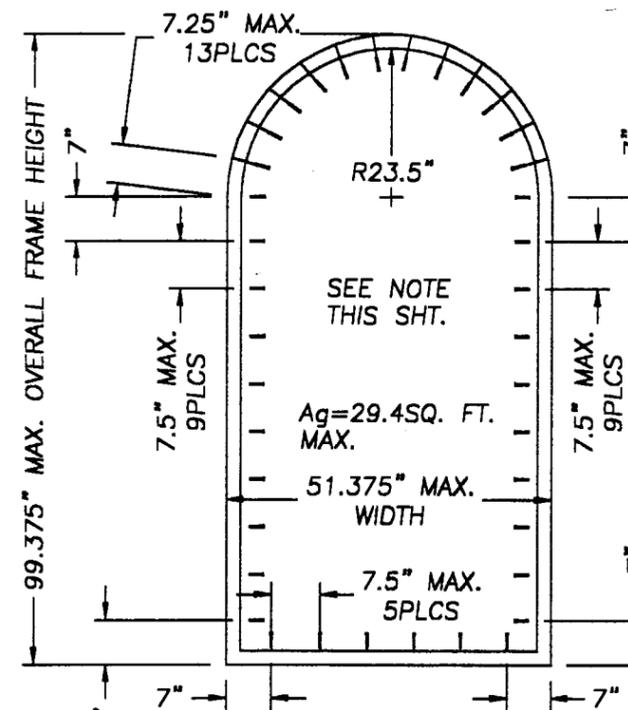

HOPE'S

84 HOPKINS AVE., P.O. BOX 580
JAMESTOWN, NEW YORK
PHONE (716) 665-5124 FAX (716) 665-6903


PRODUCT:
HOPE'S JAMESTOWN SERIES
STEEL FIXED WINDOWS W/
EQUAL & LONG LEG FRAMES
PART OR ASSEMBLY:
ANCHORING LOCATIONS TYPE
#1 & GLAZING DET. 1 & 2

NO.	DATE	TJH	BY	REVISIONS
3	05/26/01	TJH		GENERAL REVISION
2	04/04/01	TJH		GENERAL REVISION
1	03/02/01	TJH		GENERAL REVISION

RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE AUGUST 23, 2001
BY Isaac I. Chugh
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0519.12



DATE: 02/02/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2095
SHEET 4 OF 6

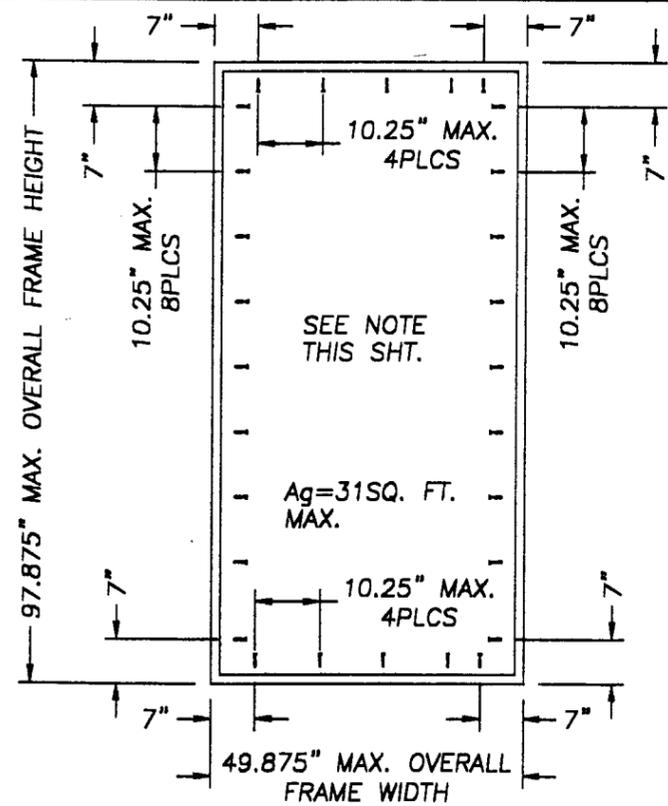



DESIGN PRESSURE RATING W/ ANCHOR SPACING TYPE 2 & GLAZING TYPE 1	
ALL WINDOW MODELS	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED
PRESSURE	+60.0 psf -60.0 psf

ANCHOR SPACING TYPE #2
7" FROM ALL CORNERS AND A MAX. OF 10.25" O.C.

GLAZING TYPE #1
USE GLAZING TYPE #1 UP TO A MAX. OF 31.0 SQ. FT OF D.L.O. AREA.

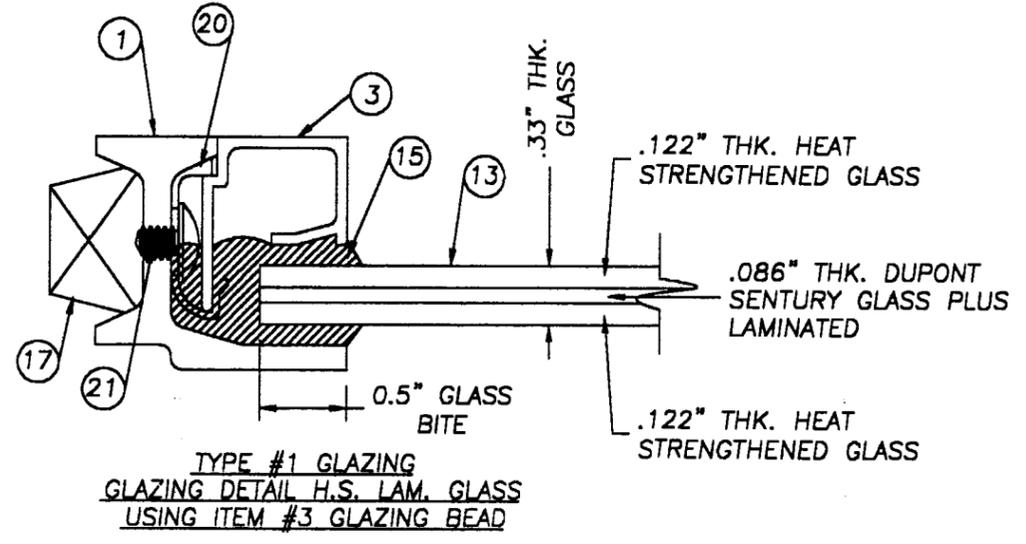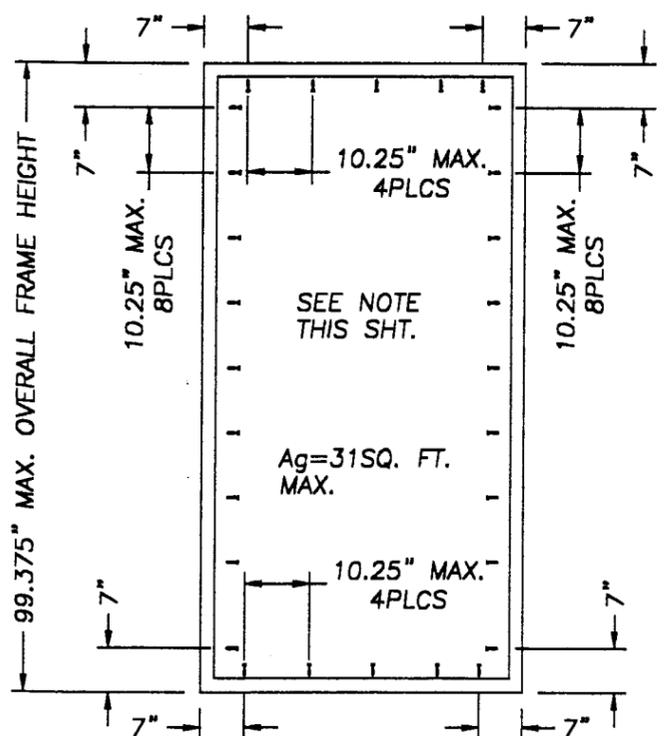

NOTE:
REFER TO CROSS SECTIONS ON SHTS. 2 & 3 TO DETERMINE THE ANCHOR TO BE USED FOR EACH INSTALLATION TYPE, I.E. MASONRY, WOOD OR INSTALLATION CLIP.

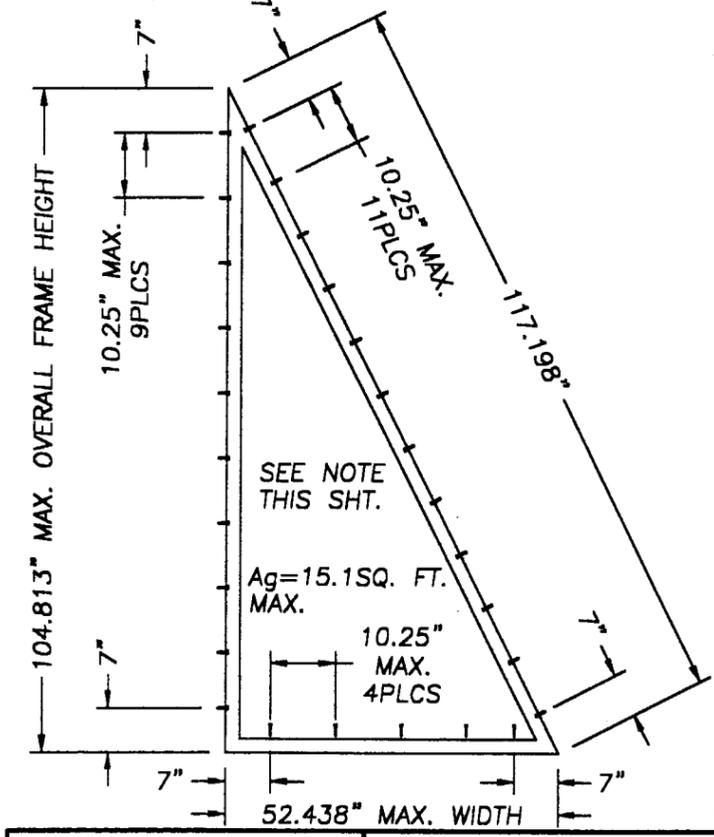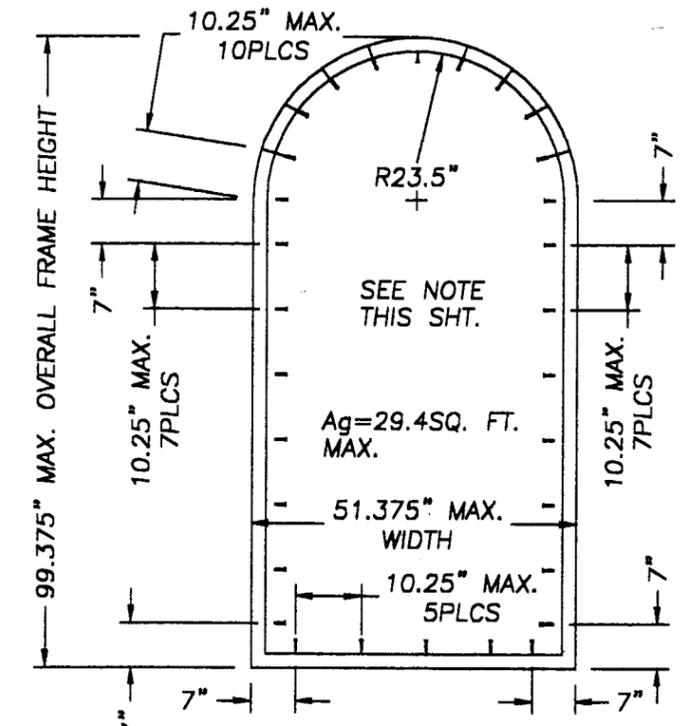

HOPE'S

84 HOPKINS AVE., P.O. BOX 580
JAMESTOWN, NEW YORK
PHONE (716) 665-5124 FAX (716) 665-6903


PRODUCT:
HOPE'S JAMESTOWN SERIES
STEEL FIXED WINDOWS W/
EQUAL & LONG LEG FRAMES
PART OR ASSEMBLY:
ANCHORING LOCATIONS TYPE
#2 & GLAZING DETAIL 1

NO.	DATE	BY	REVISIONS
3	05/26/01	TJH	GENERAL REVISION
2	04/04/01	TJH	GENERAL REVISION
1	03/02/01	TJH	GENERAL REVISION


RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE August 23, 2001
BY Isles I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0519.12


DATE: 02/02/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2095
SHEET 5 OF 6

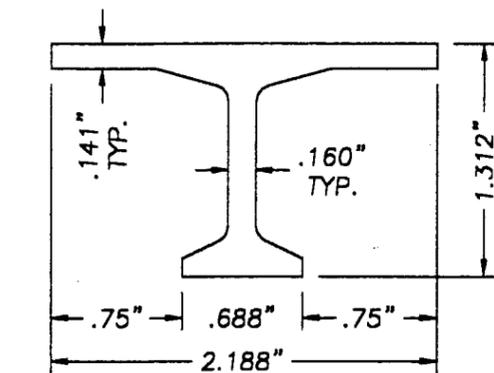


① FRAME MEMBER #1000M4
HOT-ROLLED STEEL

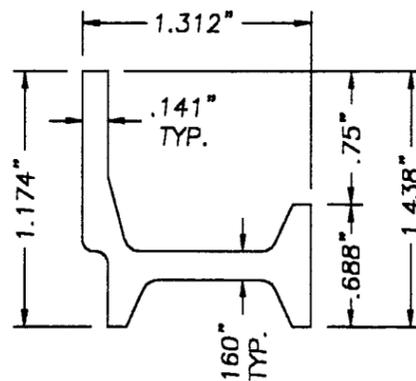


② FRAME MEMBER #1000A4
HOT-ROLLED STEEL




③ SNAP-IN GLAZING BEAD #30
6063-T5 EXTRUDED ALUMINUM
.062\"/>



④ GLAZING BEAD #294
6063-T5 EXTRUDED ALUMINUM
.062\"/>

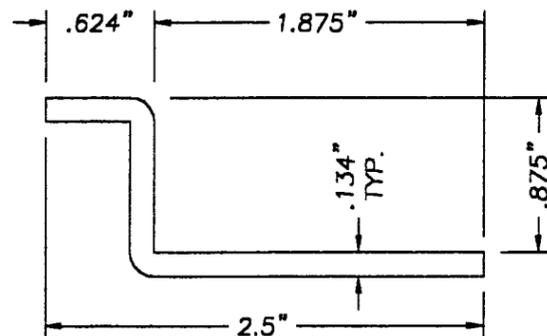

⑤ ANCHOR CLIP 3\"/>



⑥ SNAP-IN GLAZING BEAD RETAINER #37
6063-T5 EXTRUDED ALUMINUM
.040\"/>

ITEM	DESCRIPTION	MATERIAL
1	FRAME MEMBER, 1000M4 (HOT-ROLLED STEEL)	STEEL
2	FRAME MEMBER, 1000A4 (HOT-ROLLED STEEL)	STEEL
3	SNAP-IN GLAZING BEAD #30 (EXTRUDED ALUM. 6063-5)	ALUM.
4	GLAZING BEAD #294 (EXTRUDED ALUM. 6063-5)	STEEL
5	ANCHOR CLIP (10GA. GALVANIZED STEEL 3\"/>	

NOTES:

- CROSS SECTIONS USING ITEM #4 ARE SHOWN ON WOOD, ITEM #4 CAN BE USED ON EITHER MASONRY OR WOOD AND IS A SUBSTITUTE FOR ITEM #3.
- GLAZING DETAILS ARE SHOWN WITH EQUAL LEG FRAMES. ALL GLAZING COMPOUND AND GLASS INFORMATION IS THE SAME FOR LONG LEG FRAMES.
- THE ANCHOR CLIPS USE (1) SCREW PER CLIP AT EACH ANCHORING LOCATION.

HOPE'S

84 HOPKINS AVE., P.O. BOX 580
JAMESTOWN, NEW YORK
PHONE (716) 665-5124 FAX (716) 665-6903

PRODUCT:
HOPE'S JAMESTOWN SERIES
STEEL FIXED WINDOWS W/
EQUAL & LONG LEG FRAMES
PART OR ASSEMBLY:
BILL OF MATERIALS &
UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
3	05/26/01	GENERAL REVISION	TJH
2	04/04/01	GENERAL REVISION	TJH
1	03/02/01	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE August 23, 2001
BY Ishaq I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0519-12

DATE: 02/02/01
SCALE: FULL
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2095
SHEET 6 OF 6