



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Clopay Building Products Co.
4800 Interstate Drive
Cincinnati, OH 45246

Your application for Notice of Acceptance (NOA) of:

9' Wide Sectional Door

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-0609.01
EXPIRES: 09/25/2003

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 08/24/2000

Clopay Building Products Co.

ACCEPTANCE No. : 00-0609.01
APPROVED : AUG 24 2000
EXPIRES : 09/25/2003

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approval", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer, who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.





END OF THIS ACCEPTANCE



Candido Font, PE. Sr. Product Control Examiner
Product Control Division





MODELS 83, 84A, 93, 94

REV	DATE	DESCRIPTION
1	11/13/96	MODIFIED JAMB CONFIG. AND HINGES
2	18/18/97	ADD VENT. SIZE; ADD G-60

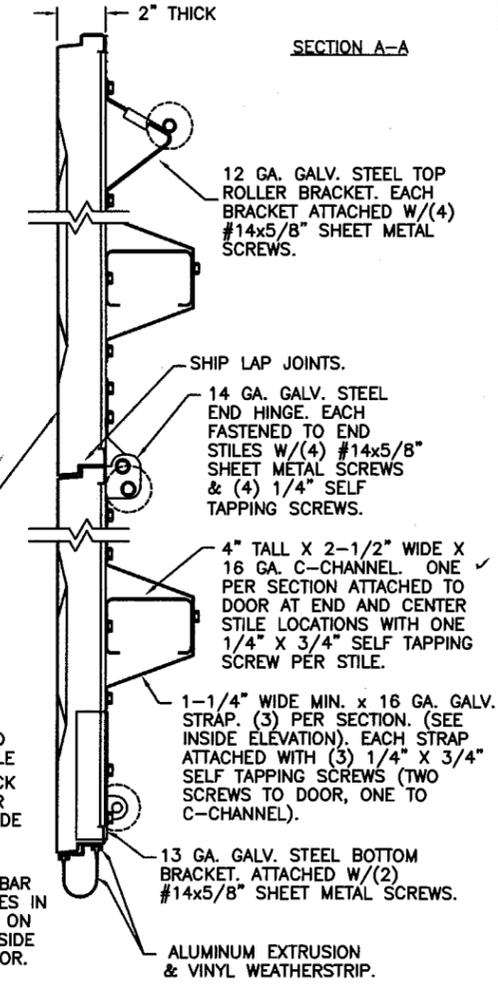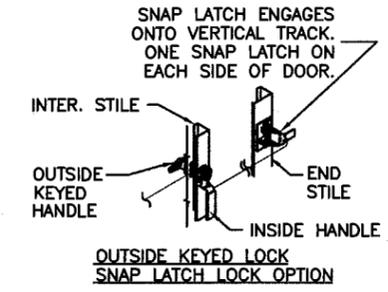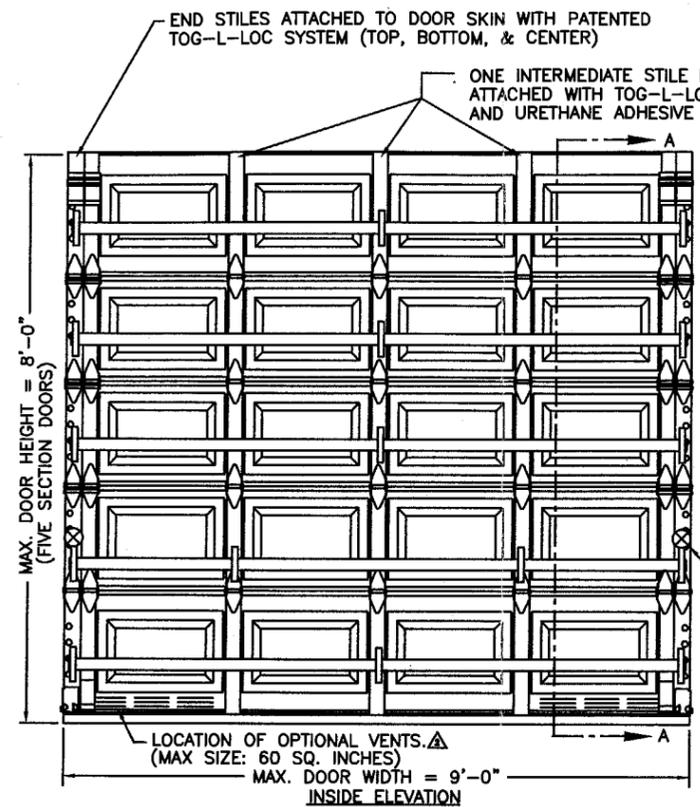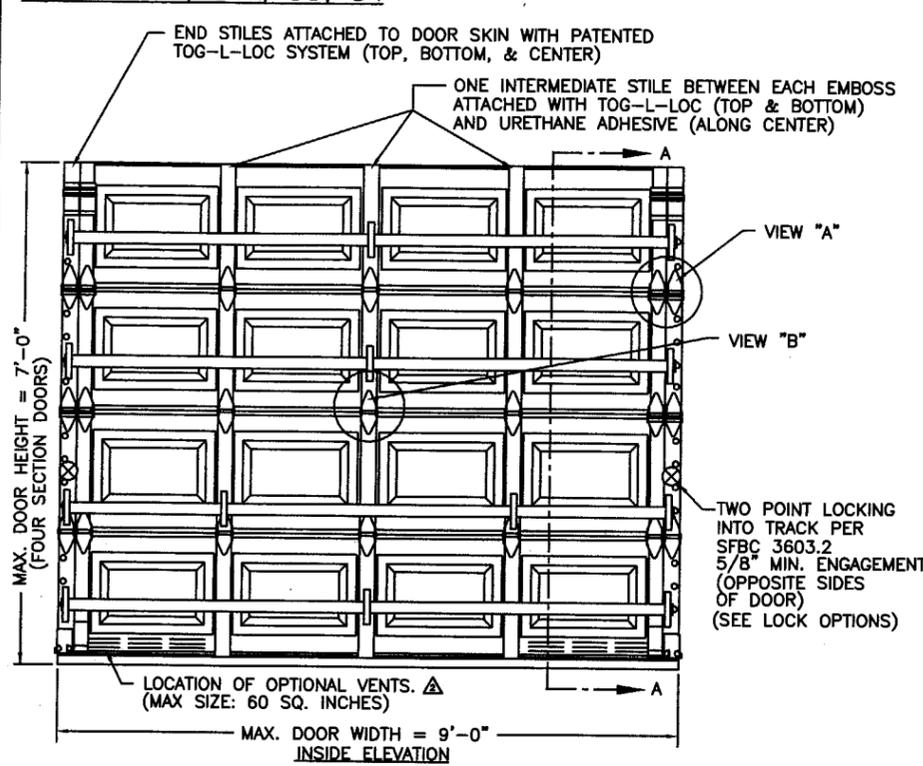


NOTE 1:
 DOORS 6'6" HIGH CONSIST OF (4) SECTIONS; (2) OF 21" & (2) OF 18".
 DOORS 7'0" HIGH CONSIST OF (4) SECTIONS; (4) OF 21".
 DOORS 7'8" HIGH CONSIST OF (5) SECTIONS; (5) OF 18".
 DOORS 8'0" HIGH CONSIST OF (5) SECTIONS; (2) OF 21" & (3) OF 18".

NOTE 2: SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS SHOWN ON THIS DRAWING.

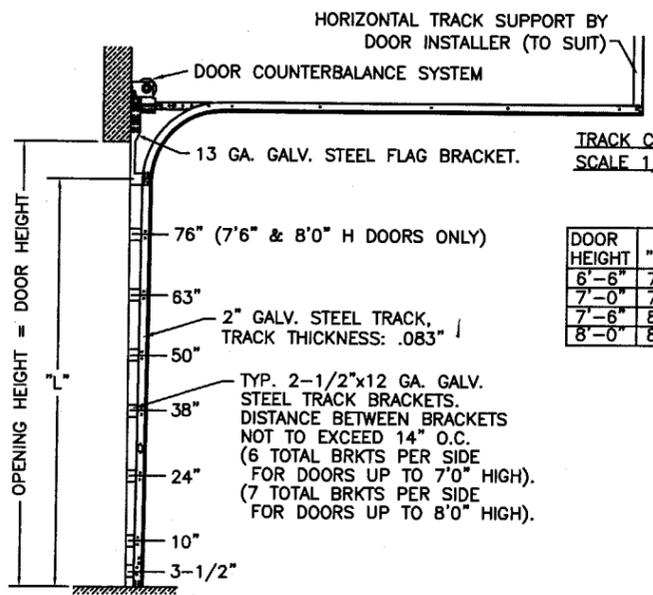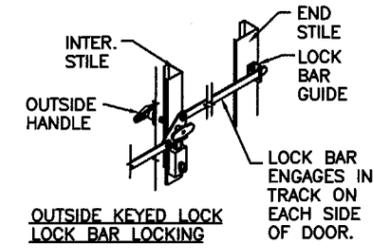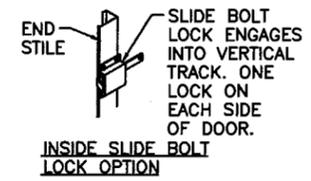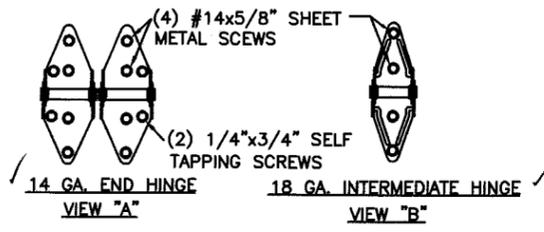

TRACK CONFIGURATION
SCALE 1/2" = 1'

DOOR HEIGHT	"L"
6'-6"	70"
7'-0"	76"
7'-6"	82"
8'-0"	88"

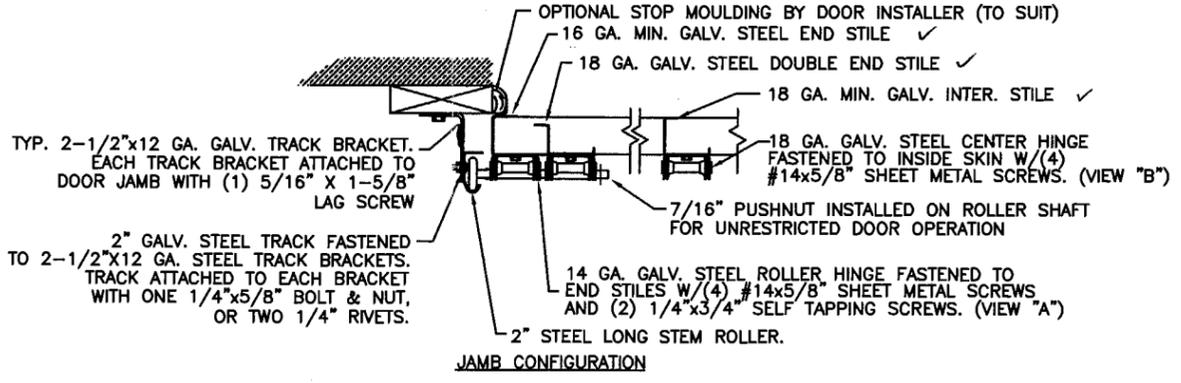

THE 2x6 VERTICAL WOOD JAMBS ARE TO BE GRADE 2 OR BETTER YELLOW PINE. NO LOAD IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB. ALL JAMB FASTENERS MAY BE (BUT NOT REQUIRED) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.

2x6 WOOD JAMB CAN BE ANCHORED TO GROUT REINFORCED BLOCK WALL OR CONCRETE COLUMN. BLOCK CELLS SHALL BE FILLED WITH CONCRETE AND REINFORCED WITH CONTINUOUS #5 BAR EXTENDING INTO THE FOOTING AND INTO TIE BEAMS. ANCHORS CAN BE 1/4"x1-3/4" EMBED TAPCON CONCRETE ANCHORS STARTING AT NO MORE THAN 8" FROM BOTTOM AND 16" O.C., OR WITH 3/8"x4" (1-3/4" EMBED) RAWL LOK/BOLT ANCHOR STARTING AT NO MORE THAN 8" FROM BOTTOM AND 24" O.C.

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE August 24, 2000
 BY [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0609.01

Mark Westfield 5/31/00

DESIGN LOADS: +57.0 PSF & -67.0 PSF.

DESIGN ENGINEER:
 MARK W. WESTERFIELD
 FLORIDA REGISTRATION No. 48495
 MECHANICAL ENGINEERING



CLOPAY BUILDING PRODUCTS COMPANY
 312 WALNUT STREET
 SUITE 1600
 CINCINNATI, OHIO 45202
 (513) 381 - 4800

SCALE: PLOT 1=42	CLASSIFICATION	MAXIMUM JAMB SIZE: 9'0"W x 8'0"H
DATE: 11/18/96	DESCRIPTION: DOOR MODELS: 83, 84A, 93, 94	
DRAWN BY: MWW	DRAWING NUMBER: B 101706	REV: 2
CHECKED BY:		

00-0609.01