



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**YKK AP America Inc.**  
**5630 Gwaltney Dr.**  
**Atlanta GA 30336**

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT SECTION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

Your application for Product Approval of:

*Model "20 D Narrow Stile" Aluminum Outswing Storefront Door w/ Panic Exit Devices.*

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This approval shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at anytime from a jobsite or manufacturer's plant for quality control testing.

If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**Acceptance No.: 00-0705.01**

**Expires: 08/07/2003**

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL CONDITIONS**

**BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director

Miami-Dade County  
Building Code Compliance Office

**Approved: 08/03/2000**



YKK AP AMERICA INC.

ACCEPTANCE No. : 00-0705.01

APPROVED : AUG 03 2000

EXPIRES : August 07, 2003

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

**1. SCOPE**

1.1 This renews the Notice of Acceptance No. 98-0421.08, which was issued on October 01, 1998. It approves an aluminum outswing storefront door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

**2. PRODUCT DESCRIPTION**

2.1 The Model "20D Narrow Stile" Outswing Aluminum Storefront Doors w/ Panic Exit Devices-Non-Impact Resistant, and its components shall be constructed in strict compliance with the following documents: Drawing No: 20 D, Sheet 1 through 8 of 8, titled "20D door", prepared by manufacturer, dated September 18, 1996 and revised on August 24, 1998, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

**3. LIMITATIONS**

3.1 This approval applies to single unit applications of pair of doors and single door only, as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.

3.2 Unit shall be installed only at locations protected by a canopy or overhang such that the angle between the edge of canopy or overhang to sill is less than 45 degrees. Unless unit is installed in non-habitable areas where the unit and the area are designed to accept water infiltration

**4. INSTALLATION**

4.1 The aluminum outswing storefront doors and its components shall be installed in strict compliance with the approved drawings.

4.2 The installation of this product will require a hurricane protection system.

**5. LABELING**

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".


**6. BUILDING PERMIT REQUIREMENTS**

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

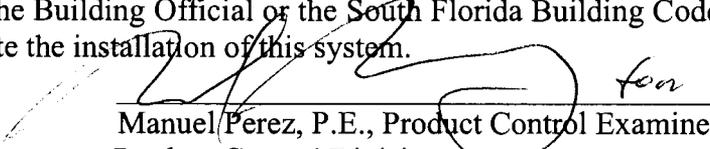  
Manuel Perez, P.E., Product Control Examiner  
Product Control Division

**YKK AP AMERICA INC.**

**ACCEPTANCE No. :** 00-0705.01


**APPROVED :** AUG 03 2000

**EXPIRES :** August 07, 2003


**NOTICE OF ACCEPTANCE: STANDARD CONDITIONS**

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approval", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
  - b. The product is no longer the same product (identical) as the one originally approved.
  - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
  - d. The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a. Unsatisfactory performance of this product or process.
  - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

**END OF THIS ACCEPTANCE**

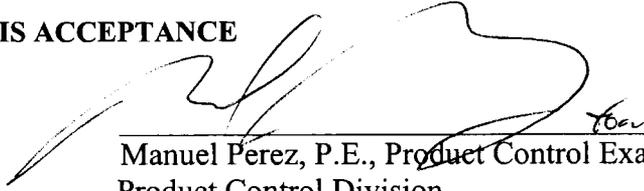  
\_\_\_\_\_  
Manuel Perez, P.E., Product Control Examiner  
Product Control Division

REV.	DESCRIPTION	BY	DATE
A	METRO-DADE REQUIREMENT	MLT	8/9/97
B	REVISED APPLICATION	A.OI	02/18/98
C	METRO-DADE REQUIREMENT	OHM	8/24/98

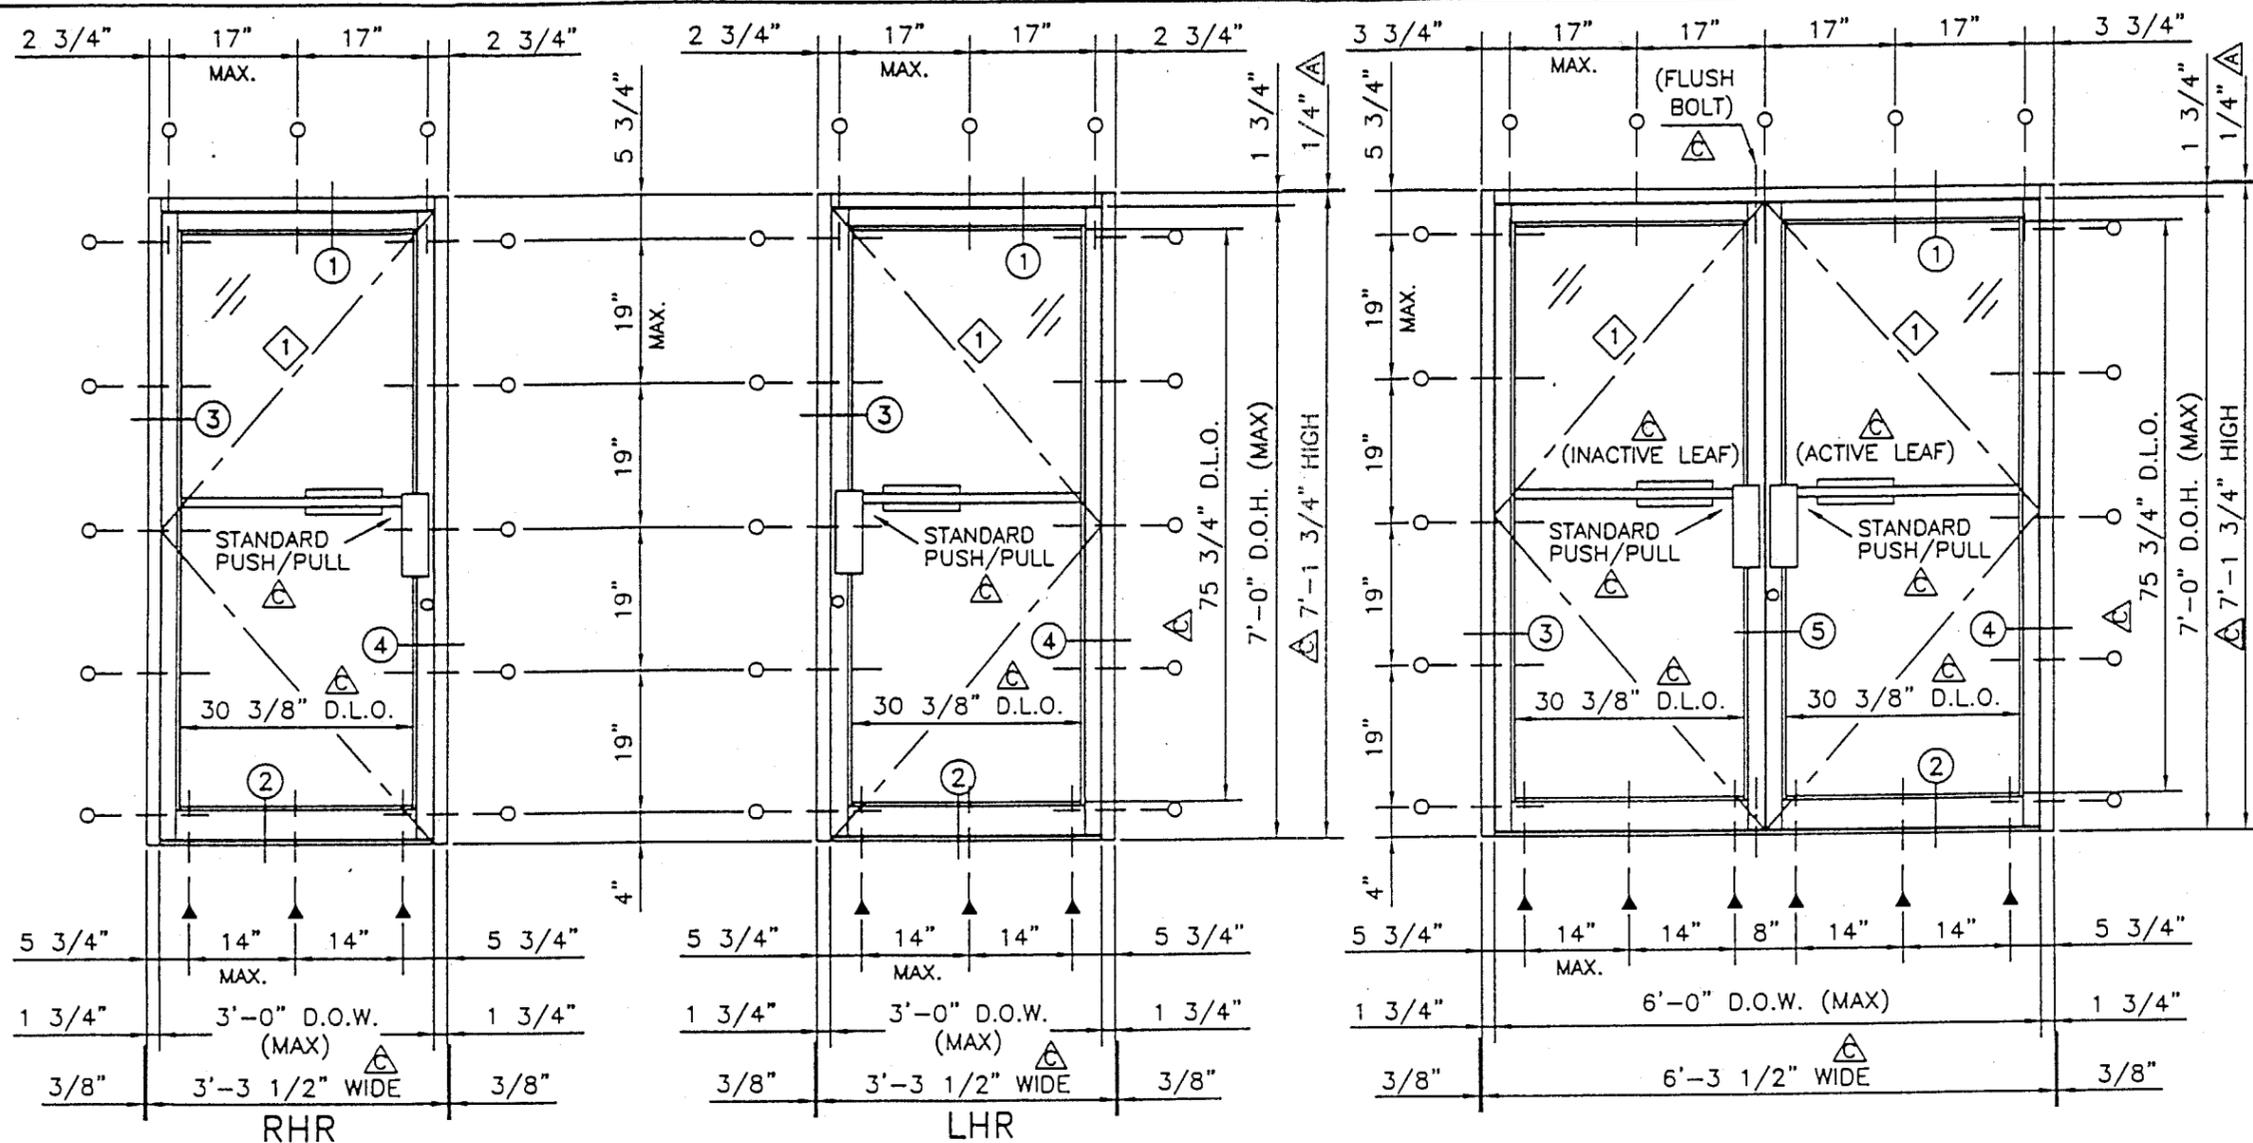

**INDEX OF DRAWINGS**

DESCRIPTION	SHEET #
INDEX & ELEVATION	1
ELEVATION	2
DOOR DETAIL	3
FLUSH BOLT DETAIL	4
MATERIAL/PART LIST FOR SINGLE DOOR	5,6
MATERIAL/PART LIST FOR PAIR DOOR	7,8

**TYPICAL ELEVATIONS - SINGLE DOORS**  
SCALE: 1/2" = 1'-0"

**TYPICAL ELEVATION - PAIR OF DOORS**  
SCALE: 1/2" = 1'-0"

- ALL SIZES NOTED ARE MAXIMUM SIZES: SIZES SMALLER IN WIDTH & HEIGHT ARE PERMITTED.
- CAULK JOINTS AND SHIM SPACE: MAX. 1/4" (FOR TOP) MAX. 3/8" (FOR VERT.)

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE August 03, 2000  
BY [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0705-01

**YKK**  
YKK AP AMERICA INC.  
5630 GWALTNEY DRIVE  
ATLANTA, GEORGIA, 30336

SYSTEM: 20D DOOR  
SCALE: 1/24  
GLEZING: SINGLE

DESCRIPTION: INDEX OF DRAWING & DOOR ELEVATION  
FINISH: ANODIZED OR PAINTED

DRAWING NUMBER: 20 D  
REVISION: C

APPROVED BY: A.OI  
DRAWN BY: PST  
DATE: 09/18/96  
SHEET NO.: 1 OF 8

**GLASS LEGEND**

① = 3/16" FULLY TEMPER GLASS

**ANCHOR FASTENERS**

① THRESHOLD ANCHOR  
#14 x 1 3/4" FHSMS (AB)  
OR 1/4" x 2 1/4" FH TAPCON

② HEAD, JAMB MULLION ANCHOR  
#14 x 3 1/2" FHSMS (AB)  
OR 1/4" x 3 3/4" FH TAPCON

**DOOR PARTS LIST PER LEAF**

QTY	PART#	DESCRIPTION	STANDARD	PANIC
1	E1-0051	PULL PLATE	○	⊙1
1	E1-0055	PUSH BAR	○	○
1	P-4304	PANIC PULL	○	⊙1
1	E1-0302	BOTTOM PIVOT	○	○
1	E1-0304	TOP PIVOT	○	○
2	E1-0331	FLUSH BOLTS (INACTIVE)	○	○
1	P-2100	HOOK LOCK (ACTIVE)	○	○
2	P-2600	KEY CYLINDER (ACTIVE)	○	○
2	P-2601	CYLINDER TRIM RING (ACTIVE)	○	○
1	P-2323	EXIT DEVICE	○	⊙2
1	P-2362	EXIT DEVICE	○	⊙2
1	E9-0332	MEETING STILE COVER (ACTIVE)	○	○

**DESIGN PRESSURE REQUIREMENT**

DESIGN PRESSURE	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
POSITIVE	NOT APPROVED	+65 PSF
NEGATIVE	NOT APPROVED	-65 PSF


**FRAME PARTS LIST PER LEAF**

QTY	PART#	DESCRIPTION	STANDARD	PANIC
1	E1-0300	BOTTOM PIVOT(R)	○	○
1	E1-0301	BOTTOM PIVOT(L)	○	○
1	E1-0303	TOP PIVOT	○	○
1	E1-0319	FLUSH BOLT STRIKE (FOR PAIR)	○	○


NOTES: ⊙ SELECTION PART (SELECT AMONG NUMBER GROUP)

REV.	DESCRIPTION	BY	DATE
C	METRO-DADE REG.(NEW SHT.)	DHM	8/24/98


GLASS LEGEND	
①	= 3/16" FULLY TEMPER GLASS

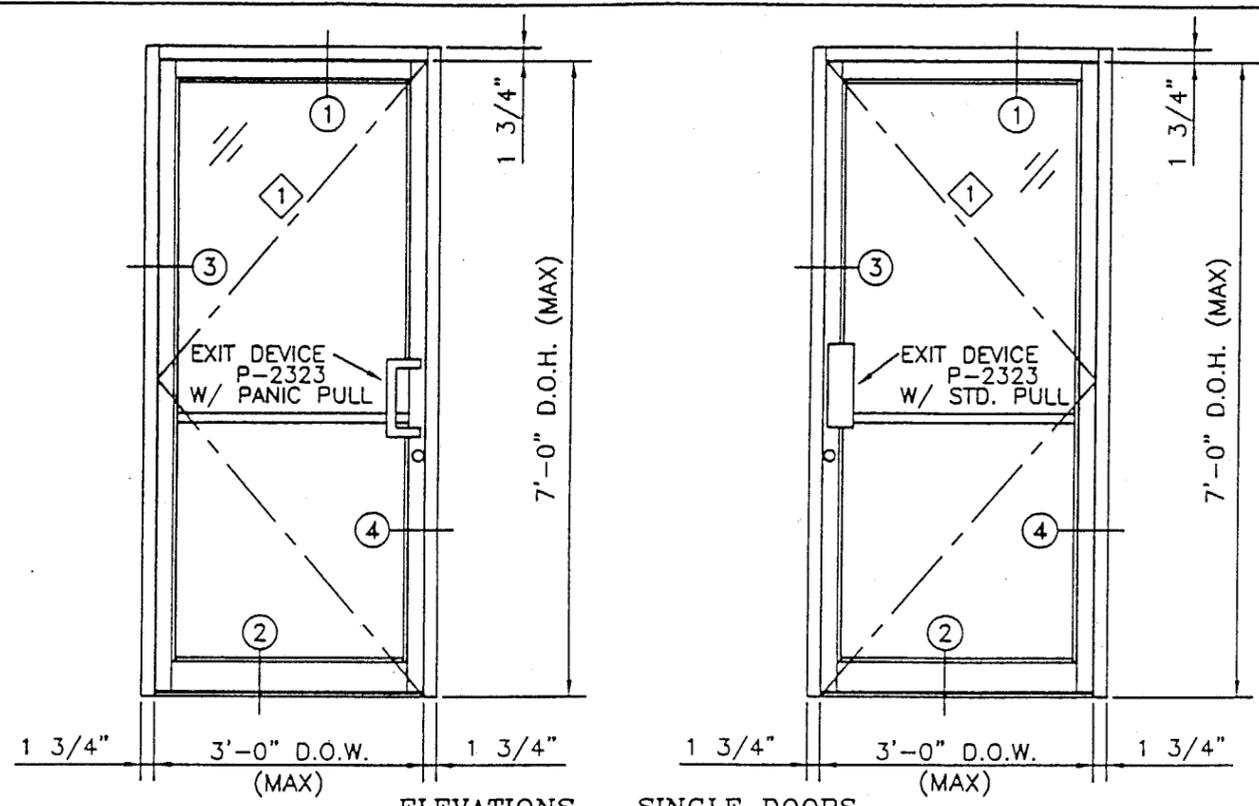


**ELEVATIONS - SINGLE DOORS**  
SCALE: 1/2" = 1'-0"

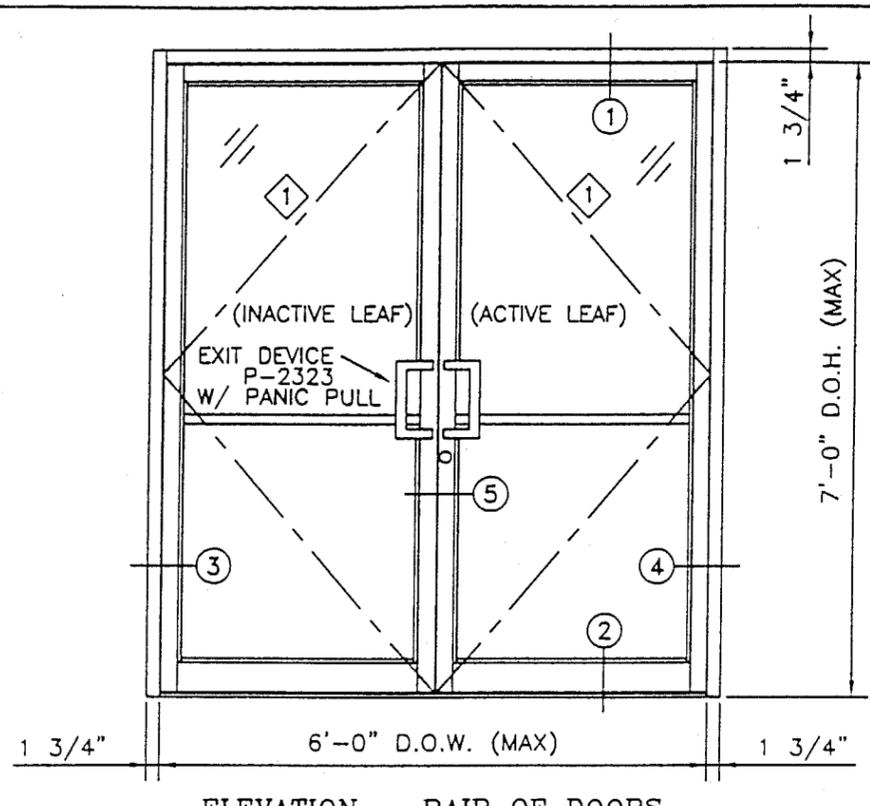

**ELEVATION - PAIR OF DOORS**  
SCALE: 1/2" = 1'-0"

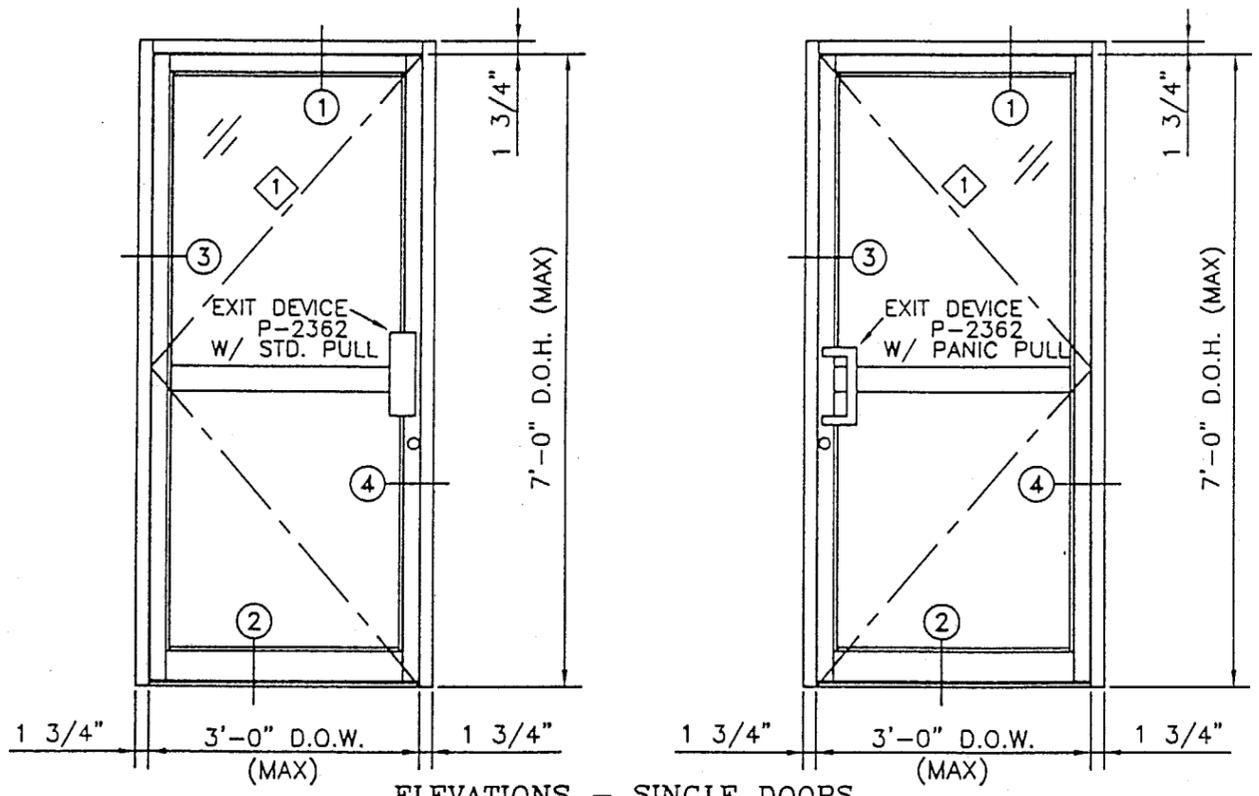

**ELEVATIONS - SINGLE DOORS**  
SCALE: 1/2" = 1'-0"

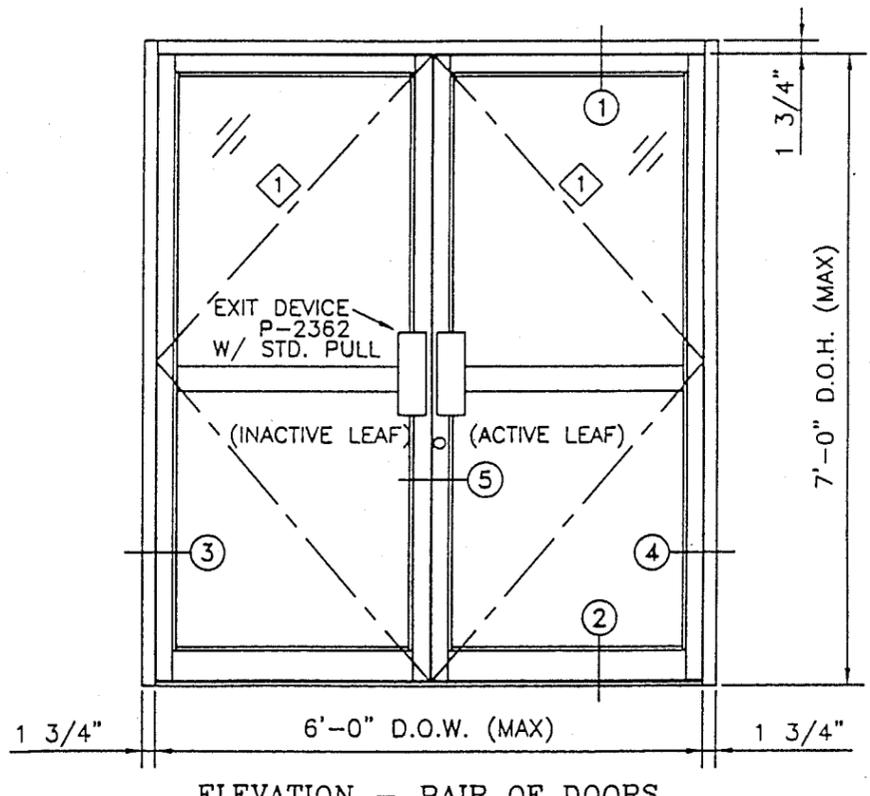


**ELEVATION - PAIR OF DOORS**  
SCALE: 1/2" = 1'-0"

NOTE: ANCHOR SPACING, DESIGN PRESSURE, CAULK JOINT AND SHIM SPACE, OVERALL SIZE, AND DAYLIGHT OPENING (PANEL): SAME AS SHEET 1.

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE August 03, 2000  
BY [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0705.01

<b>YKK</b>	
YKK AP AMERICA INC. 5630 GWALTNEY DRIVE ATLANTA, GEORGIA, 30336	
SYSTEM	SCALE
200 DOOR	1/24
DESCRIPTION	GLAZING
DOOR ELEVATION	SINGLE
FINISH	
ANODIZED OR PAINTED	
DRAWING NUMBER	REVISION
20 D	C
APPROVED BY	DRAWN BY
A.OI	DHM
DATE	SHEET NO.
8/13/98	2 OF 8

REV.	DESCRIPTION	BY	DATE
A	METRO-DADE REQUIREMENT	M.T.	8/13/97
B	REVISED APPLICATION	A.OI	02/18/98
C	METRO-DADE REQUIREMENT	A.OI	8/11/98

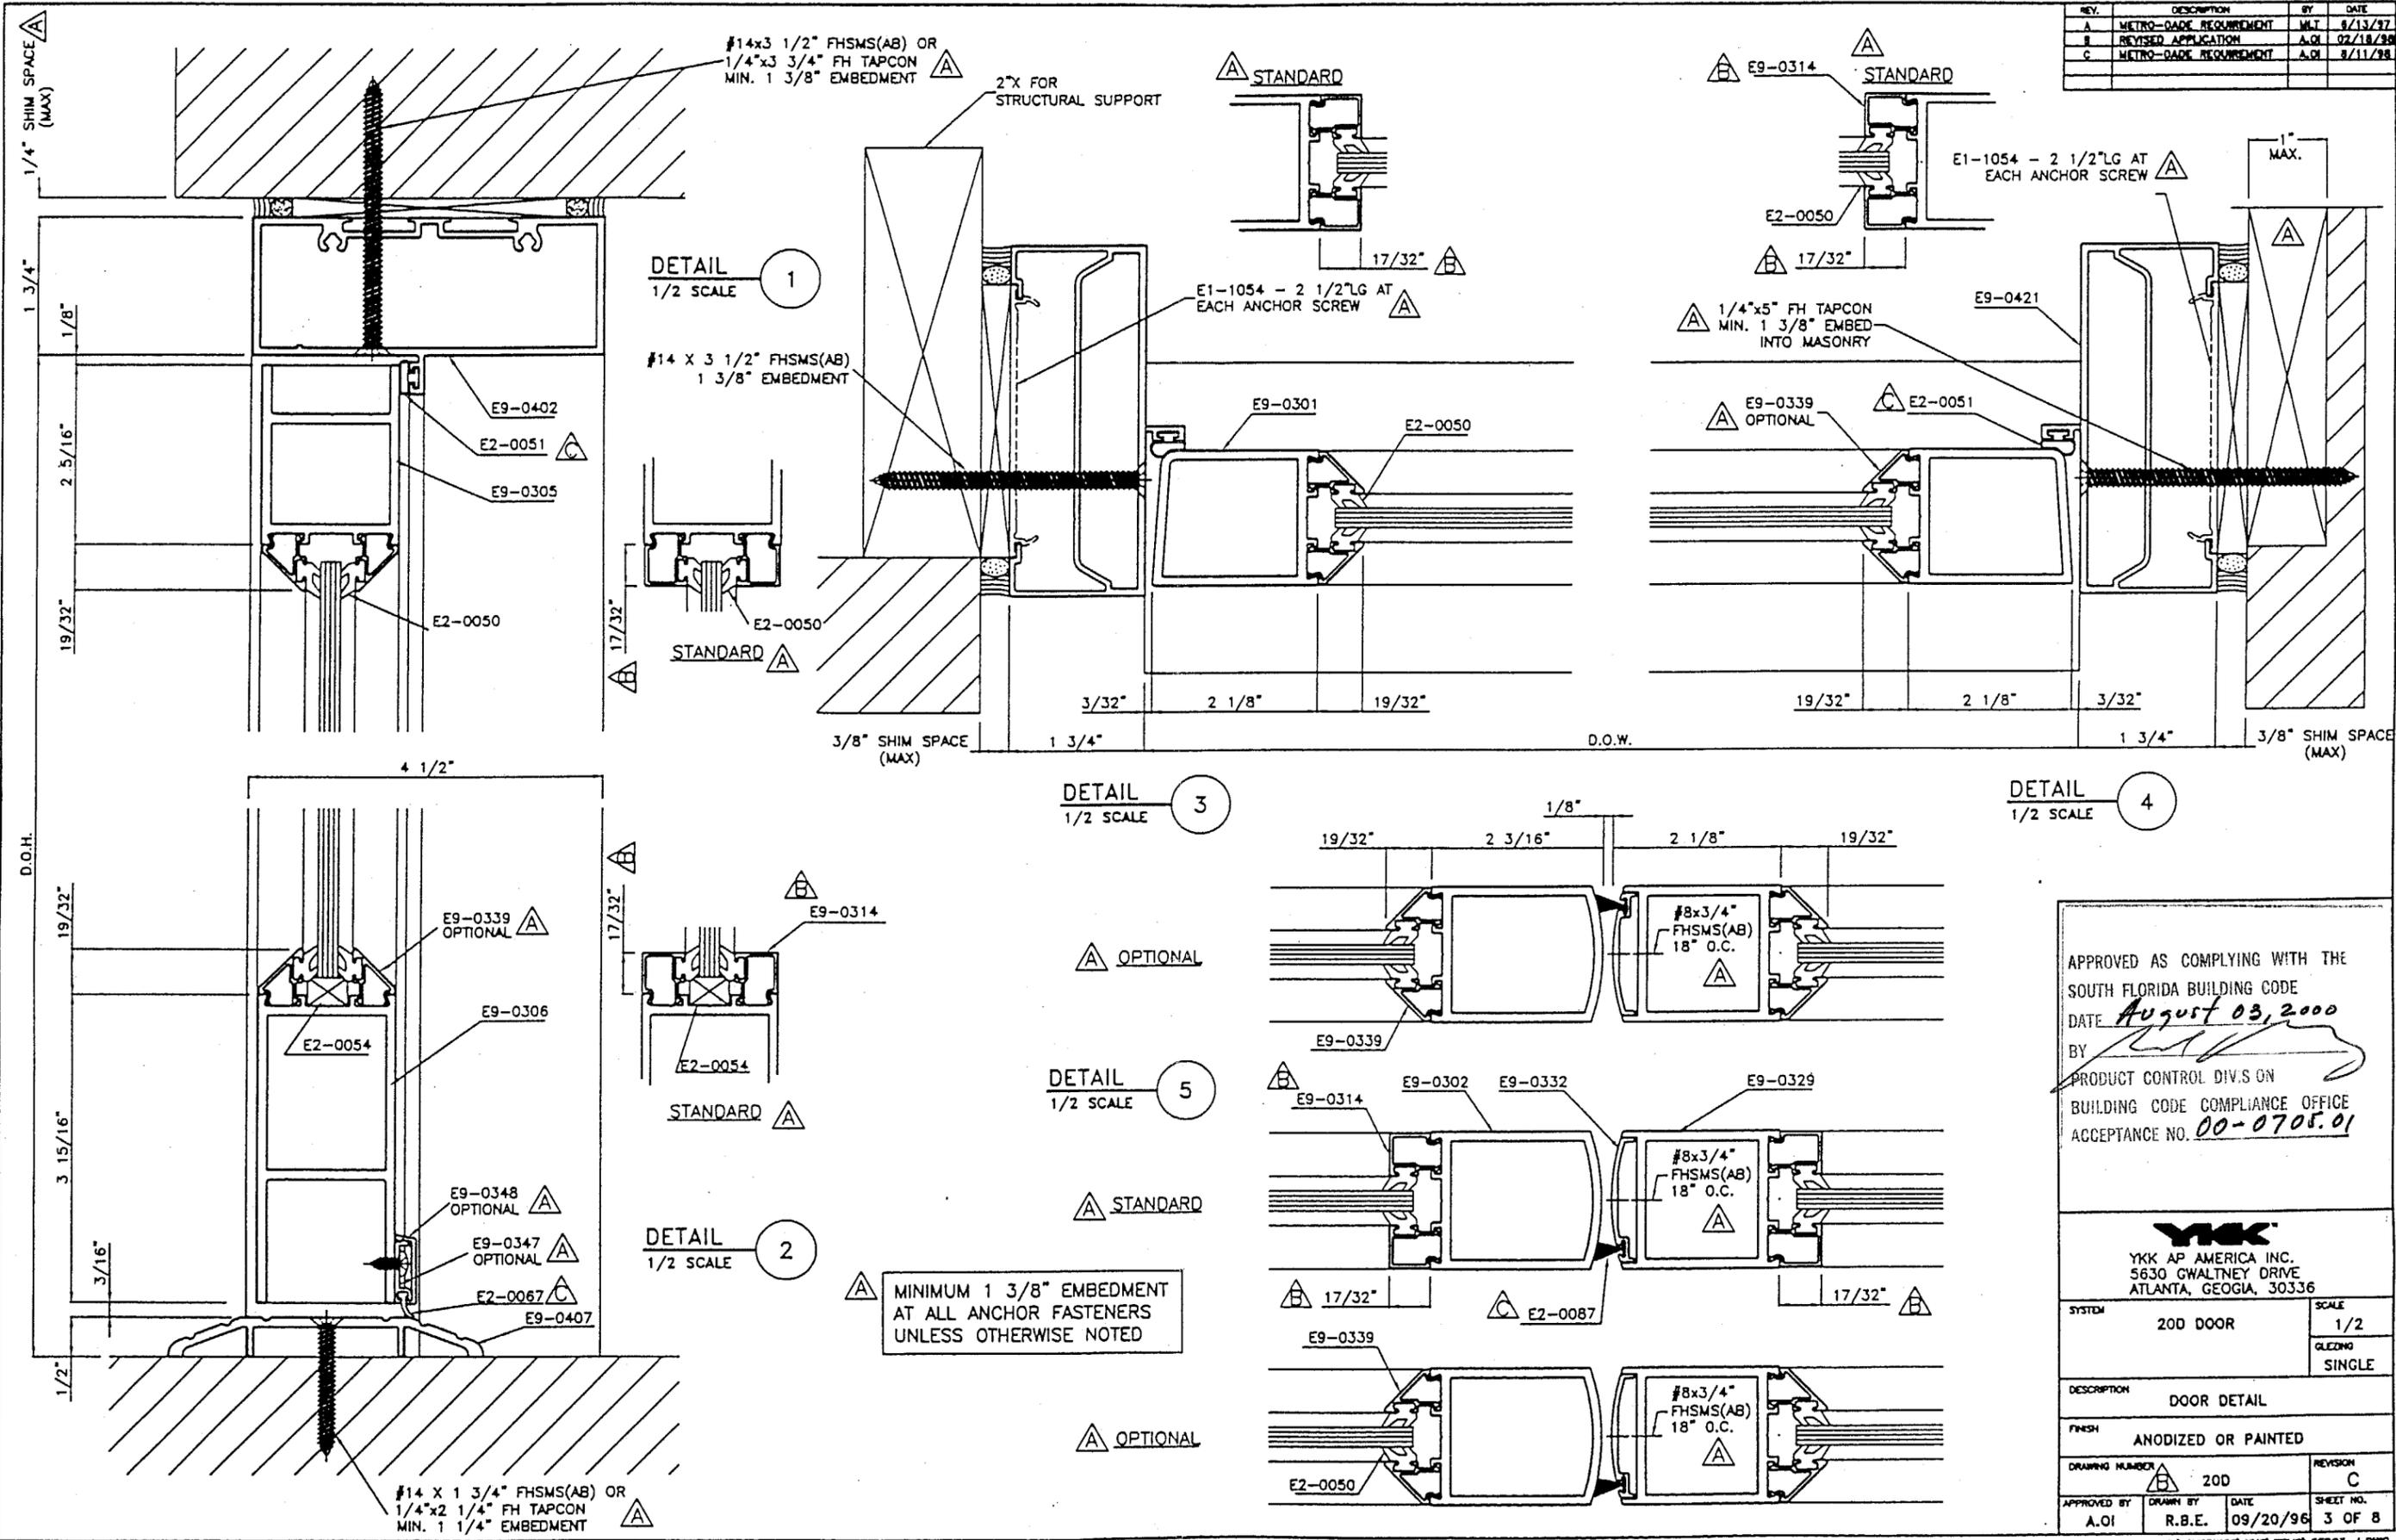


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE August 03, 2000  
 BY [Signature]  
 PRODUCT CONTROL DIV. S ON  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 00-0705.01

<b>YKK</b>	
YKK AP AMERICA INC. 5630 GWALTNEY DRIVE ATLANTA, GEORGIA, 30336	
SYSTEM	200 DOOR
SCALE	1/2
DESCRIPTION	DOOR DETAIL
FINISH	ANODIZED OR PAINTED
DRAWING NUMBER	200
REVISION	C
APPROVED BY	A.OI
DRAWN BY	R.B.E.
DATE	09/20/96
SHEET NO.	3 OF 8


MINIMUM 1 3/8" EMBEDMENT AT ALL ANCHOR FASTENERS UNLESS OTHERWISE NOTED

D.O.W.


REV.	DESCRIPTION	BY	DATE
C	M-DATE REQ. (NEW SHEET)	A.OI	8/11/98

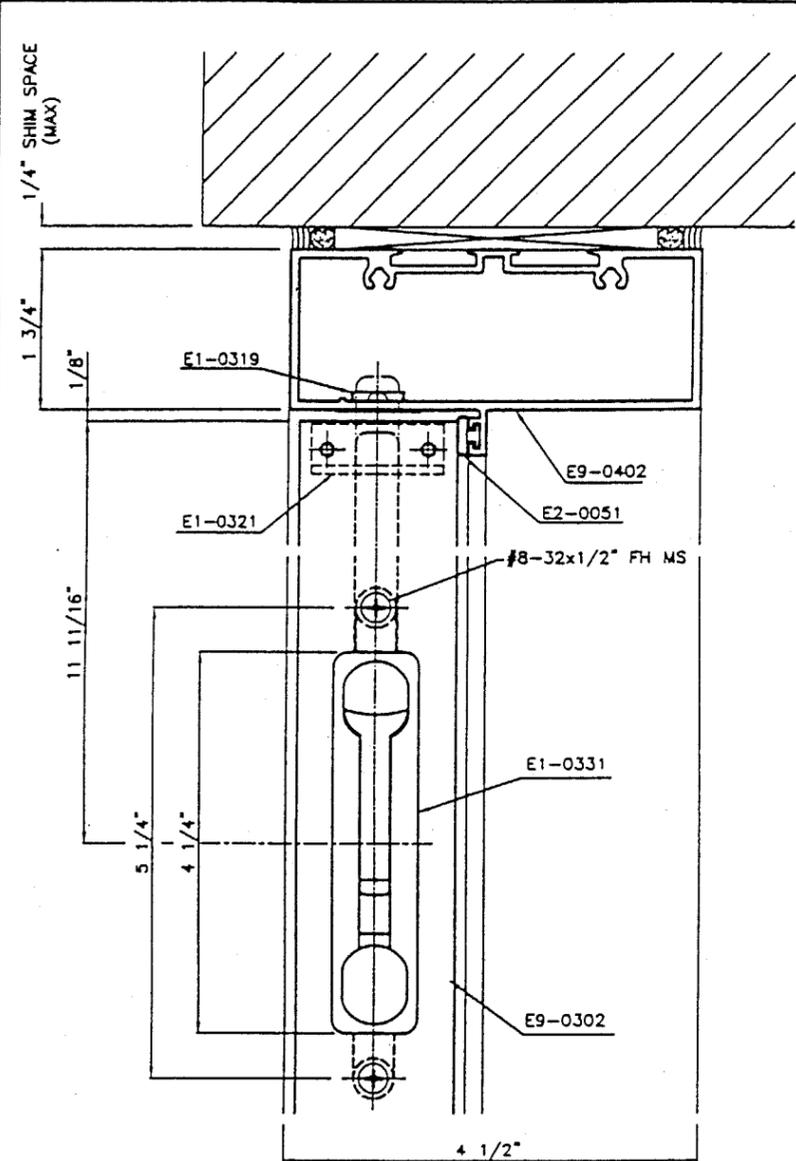

FLUSH BOLT @ HEAD  
DETAIL 6  
1/2 SCALE

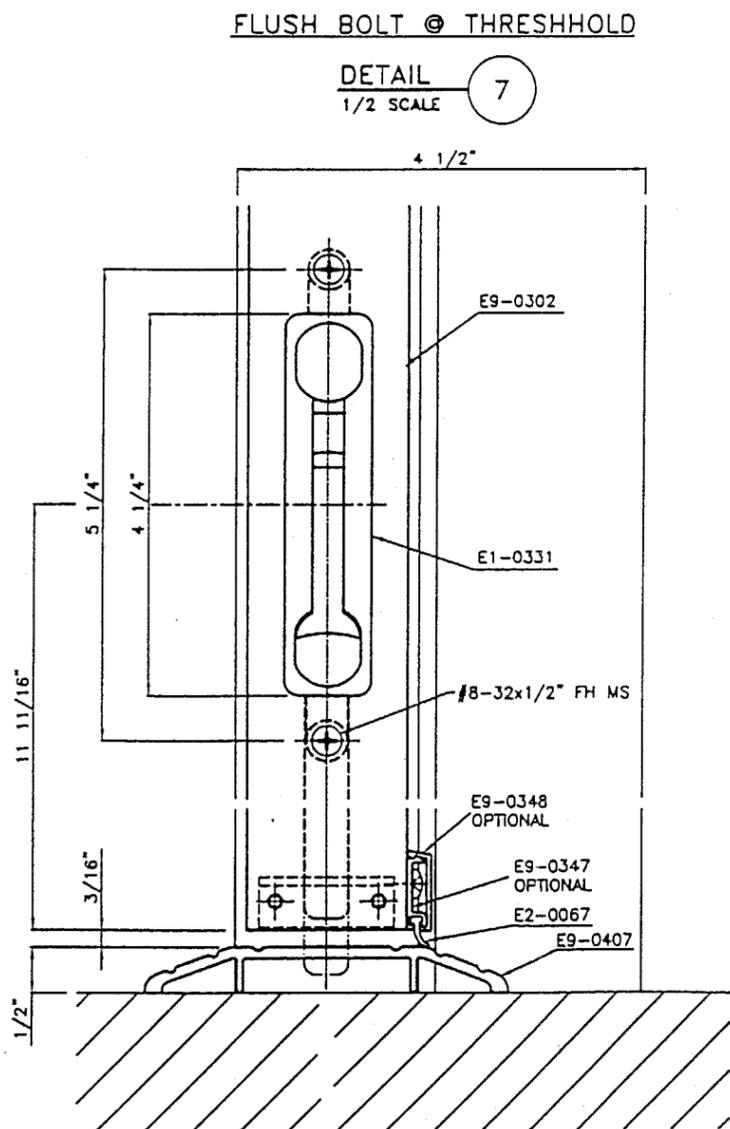

FLUSH BOLT @ THRESHOLD  
DETAIL 7  
1/2 SCALE

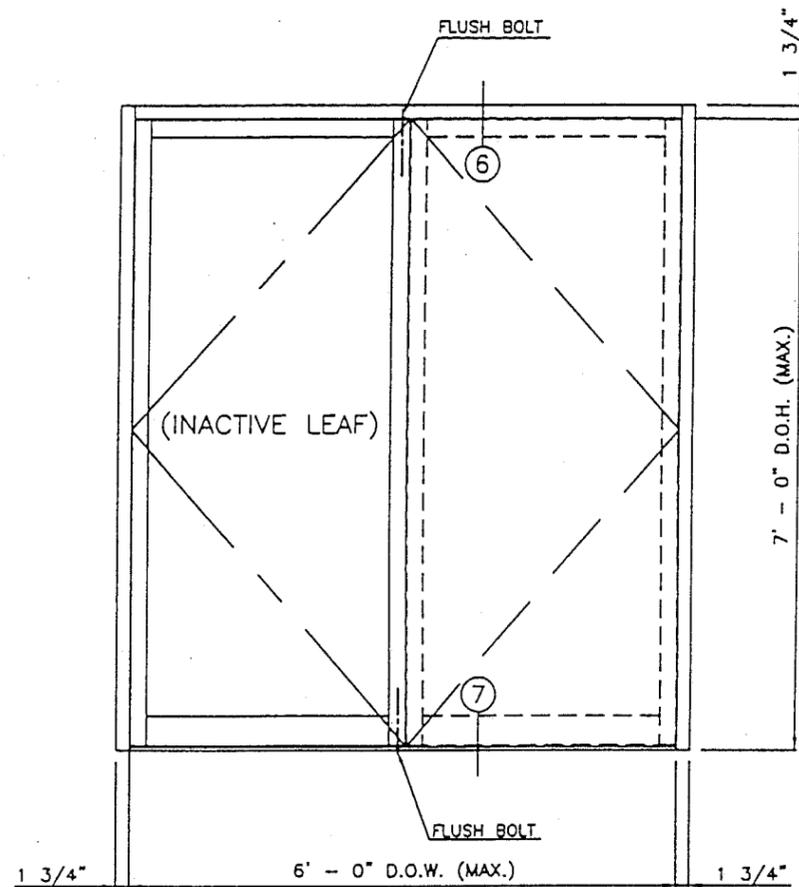


TYPICAL ELEVATION - PAIR OF DOORS  
SCALE: 1/2" = 1' - 0"

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE August 03, 2000  
BY [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-0705-01

SYSTEM 200 DOOR		SCALE 1/2
		GLazing SINGLE
DESCRIPTION FLUSH BOLT DETAIL		
FINISH ANODIZED OR PAINTED		
DRAWING NUMBER 200		REVISION C
APPROVED BY J.A.I.	DRAWN BY A.OI	DATE 08/11/98
SHEET NO. 4 OF 8		

**MATERIAL LIST**

DESCRIPTION	SHAPE #	CUT LENGTH	QTY	CUT FORM	REV
TOP RAIL	E9-0305	D.O.W. - 4 7/16"	1		
BOTTOM RAIL	E9-0306	D.O.W. - 4 7/16"	1		
LEFT STILE	E9-0301	D.O.H. - 13/16"	1		
RIGHT STILE	E9-0301	D.O.H. - 13/16"	1		
GLASS STOP (HORIZ.)	E9-0314	D.O.W. - 5 1/2"	4		
GLASS STOP (VERT.)	E9-0314	D.O.H. - 7 1/16"	4		
OP GLASS STOP (HORIZ.)	E9-0339	D.O.W. - 4 11/16"	4	45°MITER CUT	
OP GLASS STOP (VERT.)	E9-0339	D.O.H. - 7 1/16"	4		
HEAD	E9-0402	D.O.W.	1		
THRESHOLD	E9-0407	D.O.W.	1		
RIGHT JAMB	E9-0421	D.O.H. + 1 3/4"	1		
LEFT JAMB	E9-0421	D.O.H. + 1 3/4"	1		
OP DOOR SWEEP BASE	E9-0347	D.O.W. - 9/16"	1		
OP DOOR SWEEP COVER	E9-0348	D.O.W. - 9/16"	1		

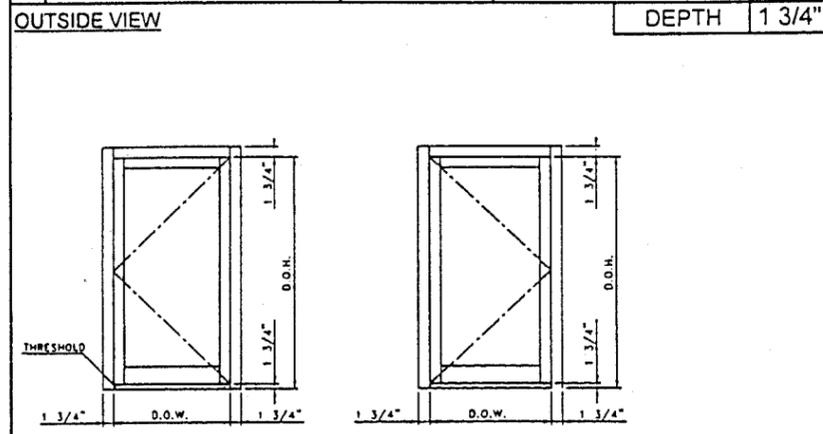

DEPTH	1 3/4"
SYSTEM	20D HURRICANE DOOR W/ SHUTTER
DESCRIPTION	SINGLE DOOR (1/2)
FINISH	ANODIZED & PAINTED
SIZE	MAX.: D.O.W. = 3' - 0" D.O.H. = 7' - 0"
GLAZING	SINGLE

**PART LIST**

DESCRIPTION	PART #	QTY	MATERIAL	LENGTH	COLOR	REMARK	REV
< FOR ALL DOOR >							
JOINT CLIP	E1-0308	2	6063-T5			FOR TOP RAIL	
JOINT CLIP	E1-0309	2	6063-T5			FOR BOTTOM RAIL	
BACKER PLATE	E1-0311	4	SPCC or SPHC			FOR E1-0308 & E1-0309	
RIV NUT	P-5002	1	ALUMINUM	1/4" - 20		FOR ADJUSTMENT	
RIV NUT	P-5003	2	STEEL	1/4" - 20		FOR PANIC PULL	
GLAZING GASKET	E2-0050		EPDM	2 D.O.W. + 4 D.O.H. - 46 1/4"			C
SETTING BLOCK	E2-0054	1	EPDM				C
GLASS SPACER	E3-0004	2	POLYAMIDE				C
ADJUSTABLE CAP	E3-0005	1	POLYAMIDE				C
SH BOLT	SM 3810	6	STEEL	3/8" - 16 x 5/8"		FOR JOINT CLIP	
PH MS	PM 2528	1	STEEL	1/4" - 20 x 1 3/4"		FOR ADJUSTMENT	
FH SMS (AB)	FC 1016	8	STEEL	#10 x 1"		FOR DOOR ASSMEBLY	
LABEL	E4-0002	2	ALUMINUM			FOR HURRICANE DOOR	
S RH PIVOT HINGE (BTM)	E1-0300	1	A380, ETC.		Y	FOR DOOR FRAME	
S LH PIVOT HINGE (BTM)	E1-0301	1	A380, ETC.		Y	FOR DOOR FRAME	
BOTTOM PIVOT HINGE	E1-0302	1	ALUMINUM ETC.		Y	FOR DOOR	
PIVOT HINGE (TOP)	E1-0303	1	A380, ETC.		Y	FOR DOOR FRAME	
TOP PIVOT HINGE	E1-0304	1	ALUMINUM ETC.		Y	FOR DOOR	
THRESHOLD CLIP	E1-0307	1	6063-T5				
HH-BOLT	HM5610-W3	4	STEEL	5/16" - 18 x 5/8"		FOR PIVOT HINGE	
FH MS	FM 1210	5	STEEL	#12 - 24 x 5/8"	Y	FOR PIVOT HINGE	
FH MS	FM 1208	2	STEEL	#12 - 24 x 1/2"		FOR THRESHOLD	
FH MS	FM 1210	2	STEEL	#12 - 24 x 5/8"	Y	FOR THRESHOLD CLIP	
FH MS	FM 1208	2	STEEL	#12 - 24 x 1/2"		FOR THRESHOLD CLIP	
AT. GASKET	E2-0051		PVC	2 D.O.H. + D.O.W.			C
PH SMS(AB)	PC 1216	4	STEEL	#12 x 1"		FOR FRAME ASSMEBLY	
OP DOOR SWEEP GASKET	E2-0067	2	EPDM	D.O.W. - 9/16"			C
OP PH MS	PM 1008	8	STEEL	#10 x 1/2"		FOR DOOR SWEEP BASE	

NOTE:

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE August 03, 2000  
 BY [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 00-0705.01

REV	DESCRIPTION	BY	DATE
A	M.-DADE REQUIREMENT	MLT	06/09/97
B	REVISED APPLICATION	A.OI	02/27/98
C	M.-DADE REQUIREMENT	DHM	08/13/98

NO. 20D


CKD BY	BY	DATE	SHEET NO.
	PST	09/18/96	5 OF 8



**MATERIAL LIST**

DESCRIPTION	SHAPE #	CUT LENGTH	QTY	CUT FORM	REV
TOP RAIL	E9-0305	D.O.W./2 - 4 7/16"	2		
BOTTOM RAIL	E9-0306	D.O.W./2 - 4 7/16"	2		
LEFT STILE (HINGE SIDE)	E9-0301	D.O.H. - 13/16"	1		
RIGHT STILE (HINGE SIDE)	E9-0301	D.O.H. - 13/16"	1		
MEETING STILE (ACTIVE SIDE)	E9-0329	D.O.H. - 13/16"	1		
MEETING STILE (INACTIVE SIDE)	E9-0303	D.O.H. - 13/16"	1		
MEETING STILE COVER	E9-0332	D.O.H. - 13/16"	1		
GLASS STOP (HORIZ.)	E9-0314	D.O.W./2 - 5 1/2"	8		
GLASS STOP (VERT.)	E9-0314	D.O.H. - 7 1/16"	8		
OP GLASS STOP (HORIZ.)	E9-0339	D.O.W./2 - 4 11/16"	8	45° MITER CUT	
OP GLASS STOP (VERT.)	E9-0339	D.O.H. - 7 1/16"	8		
HEAD	E9-0402	D.O.W.	1		
THRESHOLD	E9-0407	D.O.W.	1		
RIGHT JAMB	E9-0421	D.O.H. + 1 3/4"	1		
LEFT JAMB	E9-0421	D.O.H. + 1 3/4"	1		
op DOOR SWEEP BASE	E9-0347	D.O.W./2 - 9/16"	2		
op DOOR SWEEP COVER	E9-0348	D.O.W./2 - 9/16"	2		

OUTSIDE VIEW

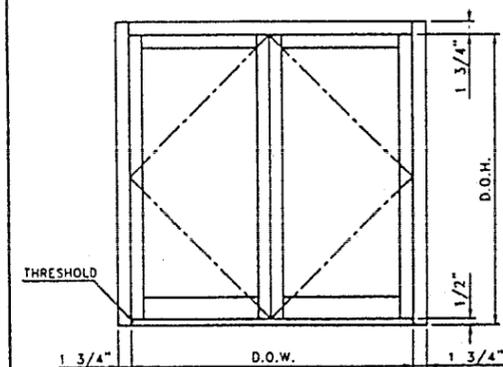

DEPTH	1 3/4"	SYSTEM	20D HURRICANE DOOR W/ SHUTTER
DESCRIPTION	PAIR DOOR (1/2)		
FINISH	ANODIZED & PAINTED		
SIZE	MAX.: D.O.W. = 6' - 0" D.O.H. = 7' - 0"		
GLAZING	SINGLE		

**PART LIST**

DESCRIPTION	PART #	QTY	MATERIAL	LENGTH	COLOR	REMARK	REV
< FOR ALL DOOR >							
JOINT CLIP	E1-0308	4	6063-T5			FOR TOP RAIL	
JOINT CLIP	E1-0309	4	6063-T5			FOR BOTTOM RAIL	
BACKER PLATE	E1-0311	8	SPCC or SPHC			FOR E1-0308 & E1-0309	
RIV NUT	P-5002	2	ALUMINUM	1/4" - 20		FOR ADJUSTMENT	
RIV NUT	P-5003	4	STEEL	1/4" - 20		FOR PANIC PULL	
GLAZING GASKET	E2-0050		EPDM	4 D.O.W. + 8 D.O.H. - 92 1/2"			C
SETTING BLOCK	E2-0054	2	EPDM				C
WEATHER STRIP	E2-0087		POLYPROPYLENE	D.O.H. - 13/16"			C
ASTRAGAL	E2-0066	7	NEOPRENE				C
GLASS SPACER	E3-0004	4	POLYAMIDE				C
ADJUSTABLE CAP	E3-0005	2	POLYAMIDE				C
SH BOLT	SM 3810	12	STEEL	3/8" - 16 x 5/8"		FOR JOINT CLIP	
PH MS	PM 2528	2	STEEL	1/4" - 20 x 1 3/4"		FOR ADJUSTMENT	
FH SMS (AB)	FC 1016	16	STEEL	#10 x 1"		FOR DOOR ASSMEBLY	
FH SMS (AB)	FC 0812	7	STEEL	#8 x 3/4"	Y	FOR MEETING STILE COVER	
LABEL	E4-0002	2	ALUMINUM			FOR HURRICANE DOOR	
RH PIVOT HINGE (BTM)	E1-0300	1	A380, ETC.		Y	FOR DOOR FRAME	
LH PIVOT HINGE (BTM)	E1-0301	1	A380, ETC.		Y	FOR DOOR FRAME	
BOTTOM PIVOT HINGE	E1-0302	2	ALUMINUM ETC.		Y	FOR DOOR	
PIVOT HINGE (TOP)	E1-0303	2	A380, ETC.		Y	FOR DOOR FRAME	
TOP PIVOT HINGE	E1-0304	2	ALUMINUM ETC.		Y	FOR DOOR	
HH-BOLT	HM5610-W3	8	STEEL	5/16" - 18 x 5/8"		FOR PIVOT HINGE	
FH MS	FM 1210	10	STEEL	#12 - 24 x 5/8"	Y	FOR PIVOT HINGE	
FH MS	FM 1208	4	STEEL	#12 - 24 x 1/2"		FOR THRESHOLD	
AT. GASKET	E2-0051		PVC	2 D.O.H. + D.O.W.			C
PH SMS(AB)	PC 1216	4	STEEL	#12 x 1"		FOR FRAME ASSMEBLY	
OP DOOR SWEEP GASKET	E2-0067	2	EPDM	D.O.W. - 9/16"			C
OP PH MS	PM 1008	8	STEEL	#10 x 1/2"		FOR DOOR SWEEP BASE	

NOTE:

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE August 03, 2000  
 BY [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 00-0705-01

REV	DESCRIPTION	BY	DATE
A	M.-DADE REQUIREMENT	MLT	06/09/97
B	REVISED APPLICATION	A.OI	02/27/98
C	M.-DADE REQUIREMENT	DHM	08/13/98

NO. 20D

CKD BY	BY	DATE	SHEET NO.
	PST	09/18/96	7 OF 8

[S] SELECTION PART [LP] LOOSE PART  
 [OP] OPTION PART Y: COLOR INDICATED

