



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Kawneer Company, Inc.
555 Guthridge Court
Norcross, GA 30092

Your application for Notice of Acceptance (NOA) of:

Series 350 Medium Stile Outswing Aluminum Storefront Doors - Impact Resistant

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-0705.10
EXPIRES: 02/01/2004

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 02/01/2001

Kawneer Company, Inc.

ACCEPTANCE No. : 00-0705.10

APPROVED : FEB 0 1 2001

EXPIRES : FEB 0 1 2004

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

1.1 This approves an outswing aluminum storefront door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

2.1 The **Series 350 Medium Stile Outswing Aluminum Storefront Door- Impact with IR 500 Framing System** and its components shall be constructed in strict compliance with the following documents: Drawing No. **T200-800**, titled "Product Approval Drawings, Kawneer 350 Doors – Impact, Multiple Infills, Protocols PA 201/202/203" dated 12/4/00, Sheets 1 thru 8 of 8, with revision #1 dated 1/11/01, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

3.1 This approval applies to single unit applications of pair of doors and single door with sidelite and transom, as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.

3.2 Unit shall be installed only at locations protected by a canopy or overhang such that the angle between the edge of canopy or overhang to sill is less than 45 degrees. Unless unit is installed in non-habitable areas where the unit and the area are designed to accept water infiltration.

4. INSTALLATION

4.1 The outswing aluminum storefront door, and its components shall be installed in strict compliance with the approved drawings.

4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.

5. LABELING

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".


6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

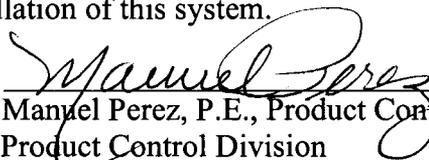
Manuel Perez, P.E., Product Control Examiner
Product Control Division

Kawneer Company, Inc.

ACCEPTANCE No. : 00-0705.10


APPROVED : FEB 0 1 2001

EXPIRES : FEB 0 1 2004


NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approval", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE

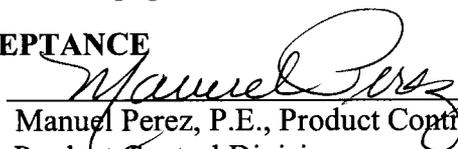

Manuel Perez, P.E., Product Control Examiner
Product Control Division

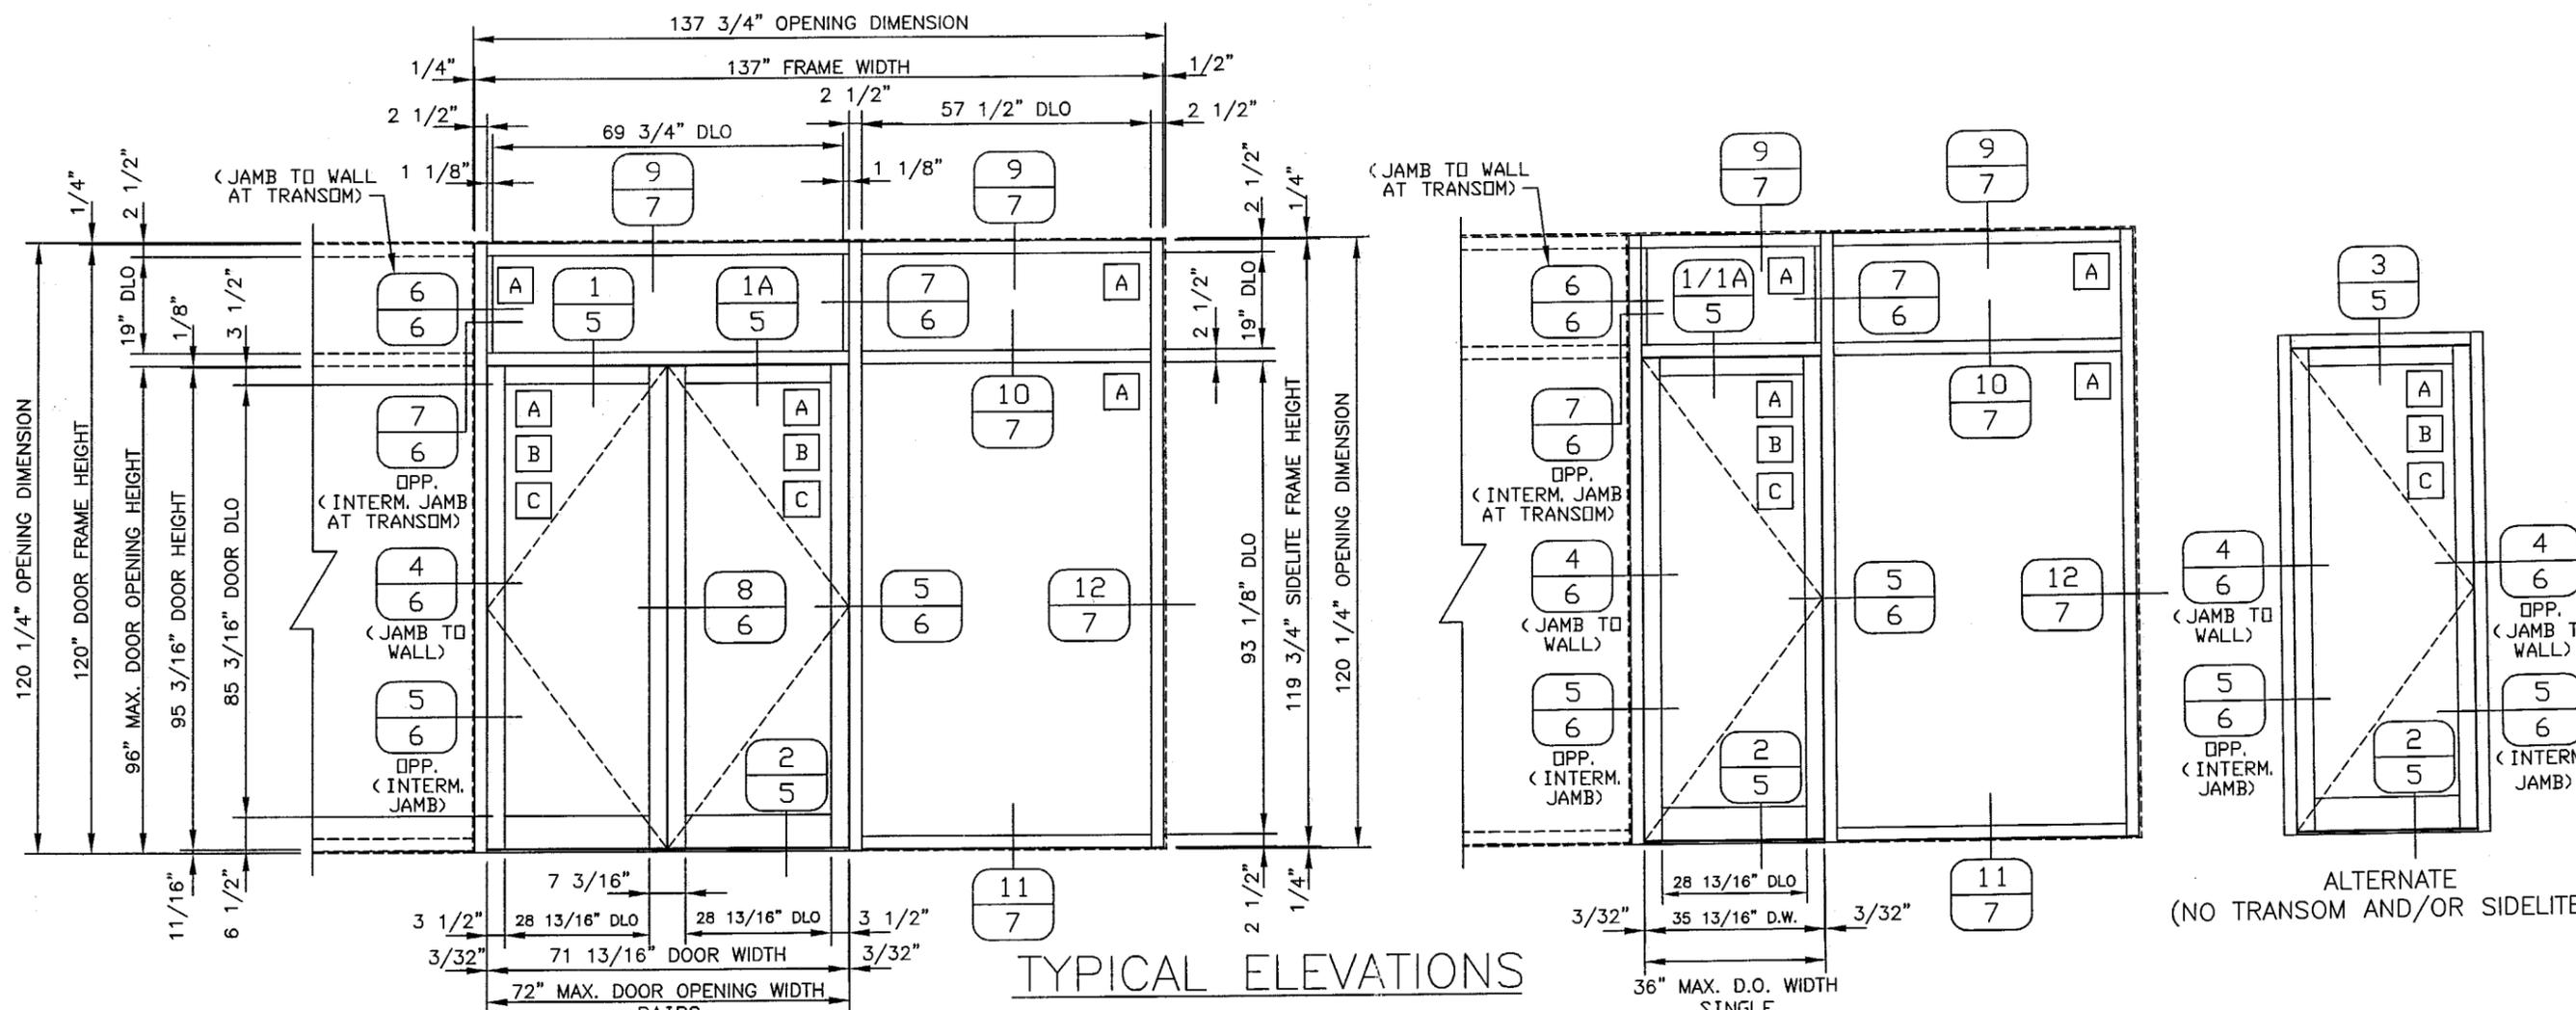

TYPICAL ELEVATIONS

DESIGN PRESSURE = +/- 85 PSF

GLAZING SCHEDULE	
GLASS TYPE	MAX. DLO SIZE
[A] = 1/4" TEMPERED SentryGlas® [B] = 9/16" HRG-2 LAMINATED GLASS BY VIRACON 3/16" HEAT STRENGTHENED OUTBOARD LITE/.050 URETHANE/.080 POLYCARBONATE/ .050 URETHANE/3/16" HEAT STRENGTHENED INBOARD LITE [C] = 7/16" SAF-GLAS LAMINATED GLASS BY SECURITY IMPACT GLASS 3/16" HEAT STRENGTHENED OUTBOARD LITE/.070 POLYCARBONATE/ 3/16" HEAT STRENGTHENED INBOARD LITE	28.813" x 85.188" = 17.1 SQ. FT.
TYPICAL DOOR GLASS SIZE = DLO - 1/2"	TYPICAL FRAME GLASS SIZE = DLO + 1-1/4"

- NOTES:
- SEE SHEET 2 OF 8 FOR PERIMETER FASTENER SCHEDULE AND LOCATIONS.
 - SEE IR 500 PRODUCT APPROVALS FOR OTHER FRAME AND FRAME GLAZING OPTIONS.
 - THESE DRAWINGS SHOULD BE USED IN CONJUNCTION WITH THE STANDARD PRODUCT INSTALLATION INSTRUCTIONS.

DADE COUNTY NOA NO. 00-0705.10

Kawneer
 An Alcoa Company
 Product Engineering & Development

555 GUTHRIDGE COURT
 NORCROSS, GEORGIA 30092
 PHONE (770) 449-5555
 FAX (770) 734-1560

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE Feb. 01, 2001
 BY *Mamuel Terry*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0705.10


THIS DRAWING IS FOR
 DADE COUNTY
 PRODUCT APPROVAL
 ONLY

DESCRIPTION
 PRODUCT APPROVAL DRAWINGS
 KAWNEER 350 DOORS - IMPACT
 MULTIPLE INFILLS
 PROTOCOLS PA 201/202/203

DRAWN BY JME DATE 12-4-00
 DRWG. NO. T200-800
 SHEET 1 of 8 T200-800-1.DWG

REV.	DATE	DESCRIPTION
1	1-11-01	REVISED PER DADE COUNTY INITIAL SUBMITTAL
	12-4-00	

PERIMETER FASTENER LOCATIONS

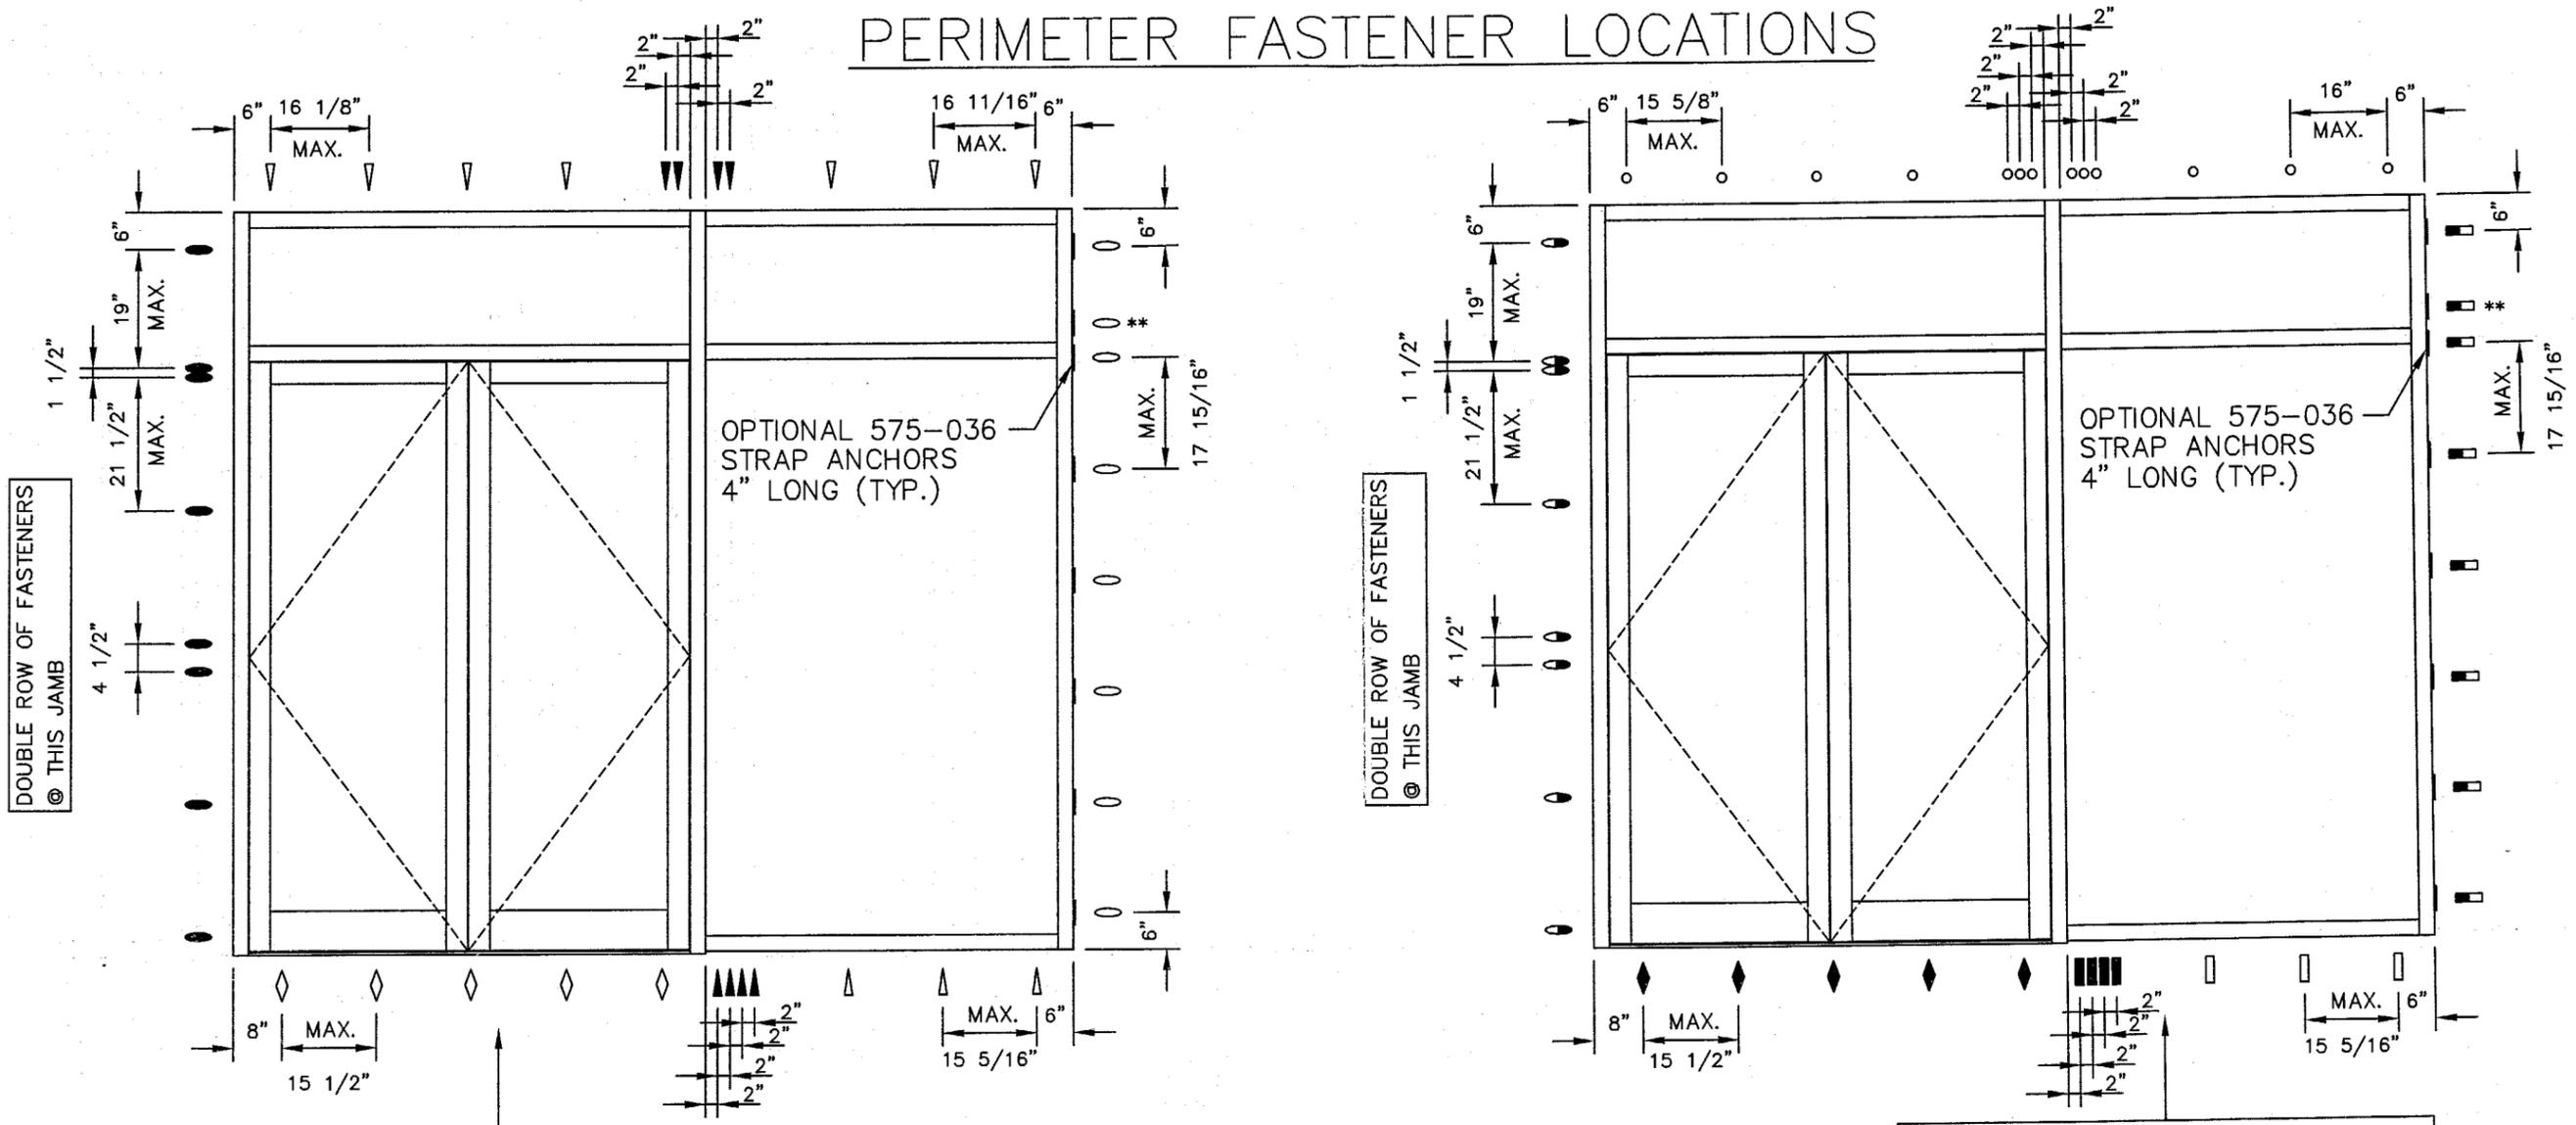

OPTIONAL 575-036 STRAP ANCHORS 4" LONG (TYP.)

OPTIONAL 575-036 STRAP ANCHORS 4" LONG (TYP.)

SUBSTRATE:
WOOD - GRADE 2 SOUTHERN PINE

FASTENER SCHEDULE

SUBSTRATES:
CONCRETE - MIN. 3000 PSI
POURED CONCRETE BLOCK
STEEL - MIN. 1/4" GRADE 50

NUMBER	MATERIAL	DESCRIPTION	SUBSTRATE	LOCATION	MIN. EMBED.	MAX. SPACING
-	STAINLESS STEEL	#14 x 3" PAN HEAD WOOD SCREW (ALT: EQUIV. SHEET METAL SCREW)	WOOD	575-003 HEAD / SILL 575-001 JAMB W/O 575-036 STRAP ANCHOR	1-1/2"	SEE ABOVE
-	STAINLESS STEEL	3/8" x 3" PAN HEAD WOOD SCREW (ALT: EQUIV. SHEET METAL SCREW)	WOOD	575-003 HEAD / SILL @ INT. DOOR JAMB	1-1/2"	SEE ABOVE
-	STAINLESS STEEL	1/4" x 2-1/2" PAN HEAD WOOD SCREW (ALT: EQUIV. SHEET METAL SCREW)	WOOD	575-001 JAMB W/ 575-036 STRAP ANCHOR	1-1/2"	SEE ABOVE
-	STAINLESS STEEL	#14 x 4-1/2" FLAT HEAD WOOD SCREW (ALT: EQUIV. SHEET METAL SCREW)	WOOD	575-050 DOOR JAMB	1-1/2"	SEE ABOVE
-	-	1/4" x 3-1/4" HEX WASHER HEAD CONCRETE SCREW	CONCRETE/CBS	575-003 HEAD / SILL 575-001 JAMB W/O 575-036 STRAP ANCHOR	1-1/2"	SEE ABOVE
-	-	5/16" x 4" HEX WASHER HEAD CONCRETE SCREW	CONCRETE/CBS	575-003 HEAD / SILL @ INT. DOOR JAMB	1-1/2"	SEE ABOVE
-	-	1/4" x 2-1/4" HEX WASHER HEAD CONCRETE SCREW	CONCRETE/CBS	575-001 JAMB W/ 575-036 STRAP ANCHOR	1-1/2"	SEE ABOVE
-	-	5/16-18 x 2" HEX HEAD CAP SCREW	STEEL	575-003 HEAD / SILL & @ INT. DOOR JAMB	1/8"	SEE ABOVE
-	-	1/4" x 4-1/2" FLAT HEAD CONCRETE SCREW	CONCRETE/CBS	575-050 DOOR JAMB	1-1/2"	SEE ABOVE
-	STAINLESS STEEL	#12 x 2" FLAT HEAD WOOD SCREW (ALT: EQUIV. SHEET METAL SCREW)	WOOD	THRESHOLD	1-1/2"	SEE ABOVE
-	-	1/4" x 2-1/4" FLAT HEAD CONCRETE SCREW	CONCRETE	THRESHOLD	1-1/2"	SEE ABOVE

** ADDITIONAL ANCHOR @ HORIZONTAL

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE Feb. 01, 2001
BY Manuel Serrano
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0705.10

DADE COUNTY NOA NO. 00-0705.10

Kawneer
An Alcoa Company
Product Engineering & Development

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560

THIS DRAWING IS FOR
DADE COUNTY
PRODUCT APPROVAL
ONLY

DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

DRAWN BY JME DATE 12-4-00

DRWG. NO. T200-800

SHEET 2 of 8 T200-800-2.DWG

REV.	DATE	DESCRIPTION OF REVISION
1	1-11-01	REVISED PER DADE COUNTY INITIAL SUBMITTAL
2	12-4-00	INITIAL SUBMITTAL

#	PT. NO.	DESCRIPTION	DIMENSIONS	MATERIAL	MANUFACTURER	NOTES
36	963-239	INTERIOR DOOR GLASS STOP	1.354 x 1.359 x .100	6063-T5 ALUMINUM	KAWNEER	
37	963-240	EXTERIOR DOOR GLASS STOP	1.273 x .500 x .070	6063-T5 ALUMINUM	KAWNEER	
38	28-260	DOOR STOP ATTACHMENT SCREW	#8 x 3/8" PHTFS	CARBON STEEL - ZINC PLATED	VARIES	
39	128-267	SPLINE SCREW	#12 x 1" PHTFS	300 SERIES STAINLESS STEEL	VARIES	
40	128-271	STEEL ATTACHMENT SCREW	#12 x 5/8" PHTFS	300 SERIES STAINLESS STEEL	VARIES	
41	128-910	DOOR GLASS STOP ATTACHMENT SCREW	#10 x 1/2" FHTFS	300 SERIES STAINLESS STEEL	VARIES	
42	28-315	DOOR BOTTOM RAIL WEATHER SWEEP ATTACHMENT SCREW	#6 x 3/8" FHTFS	400 SERIES STAINLESS STEEL	VARIES	
43	128-439	DOOR ADJUST. ASTRAGAL WEATHERING ATTACHMENT SCREW	#6 x 11/16" FH	ZINC PLATED CARBON STEEL	VARIES	

MATERIALS LIST

REVISIONS	DOOR NO.: DADE COUNTY APPROVED PRODUCT				ELEV.:					
	DOOR TYPE: 350, S/A PAIR, D. P. or B. H.		SIZE: 6'-0" X 8'-0"	FIN.:	QTY.:	ARCH. HDWR. SET: -				
	HARDWARE DESCRIPTION	PART NUMBER	FINISH	QUANTITY	BY KAWNEER	OTHERS	PHYSICAL HDWR BY OTHERS REQ'D AT KAWNEER	PREPARATION KAWNEER	FIELD	SHIP LOOSE
	CLOSER OPTIONAL	-	-	-						
	TOP OFFSET PIVOT	50-322		2	X			X		
	INTERMEDIATE OFFSET PIVOT	50-331		2	X			X		
	BOTTOM OFFSET PIVOT	50-326/327		2	X			X		
	A/R CYL. OPERATER FLUSHBOLT	1871W-30-628		4	X			X		
	A/R FLUSHBOLT GUIDE PACKAGE	41-0828		4	X			X		
	A/R 1850A MS LOCK	50-112		2	X			X		
	CYLINDERS	37-177		5	X			X		
	THRESHOLD	69-139	10	1	X			X		
	BOTTOM DOOR WEATHERING	200-795		2	X			X		X
	THUMBTURNS (INTERIOR)	37-176		5	X			X		
	ALTERNATE HINGING									
	BUTT HINGES	37-232		6	X			X		


REVISIONS	DOOR NO.: DADE COUNTY APPROVED PRODUCT				ELEV.:					
	DOOR TYPE: 350, S/A SINGLE, D. P. or B. H.		SIZE: 3'-0" X 8'-0"	FIN.:	QTY.:	ARCH. HDWR. SET: -				
	HARDWARE DESCRIPTION	PART NUMBER	FINISH	QUANTITY	BY KAWNEER	OTHERS	PHYSICAL HDWR BY OTHERS REQ'D AT KAWNEER	PREPARATION KAWNEER	FIELD	SHIP LOOSE
	CLOSER OPTIONAL	-	-	-						
	TOP OFFSET PIVOT	50-322		1	X			X		
	INTERMEDIATE OFFSET PIVOT	50-331		1	X			X		
	BOTTOM OFFSET PIVOT	50-326/327		1	X			X		
	A/R CYL. OPERATER FLUSHBOLT	1871W-30-628		2	X			X		
	A/R FLUSHBOLT GUIDE PACKAGE	41-0828		2	X			X		
	A/R 1850A MS LOCK	50-112		1	X			X		
	CYLINDERS	37-177		3	X			X		
	THRESHOLD	69-139	10	1	X			X		
	BOTTOM DOOR WEATHERING	200-795		1	X			X		X
	THUMBTURNS (INTERIOR)	37-176		3	X			X		
	ALTERNATE HINGING									
	BUTT HINGES	37-232		3	X			X		

200-795 BOTTOM DOOR WEATHERING: 27-406 SWEEP GASKET EXTRUSION
27-407 SWEEP GASKET FILLER
27-309 SWEEP GASKET
A/R = ADAMS RITE


HARDWARE SCHEDULES

200-795 BOTTOM DOOR WEATHERING: 27-406 SWEEP GASKET EXTRUSION
27-407 SWEEP GASKET FILLER
27-309 SWEEP GASKET
A/R = ADAMS RITE

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE Feb. 01, 2001
BY Manuel Perez
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-D705.10

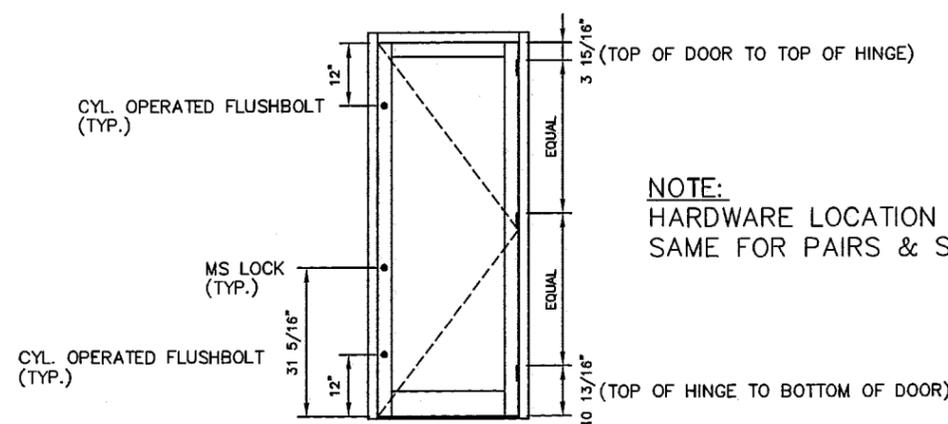

TYPICAL HARDWARE LOCATION (BUTT HINGES)

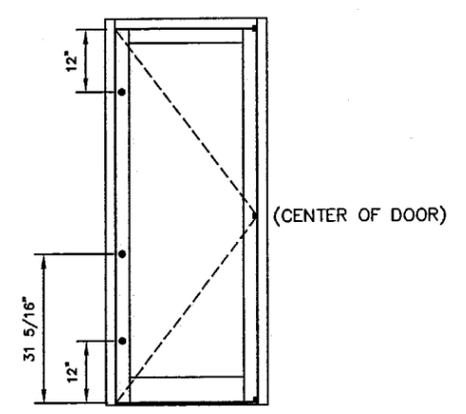

TYPICAL HARDWARE LOCATION (OFFSET PIVOTS)

DOOR CORNER CONSTRUCTION
VERTICAL STILES RUN THROUGH AND ARE ATTACHED TO THE TOP AND BOTTOM RAILS WITH 1/4" THICK EXTRUDED ALUMINUM CHANNELS, 1/4-20 x 3/4" PAN HEAD MACHINE SCREWS, AND 3/16" THICK STEEL NUT PLATES. THE INTERSECTION OF EACH CORNER JOINT IS WELDED WITH A 1/2" DIAMETER PLUG WELD AND A 1-1/8" LONG FILLET WELD AT BOTH WEBS OF EACH RAIL.

DADE COUNTY NDA NO. 00-0705.10

Kawneer
An Alcoa Company
Product Engineering & Development
555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560

DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

THIS DRAWING IS FOR
DADE COUNTY
PRODUCT APPROVAL
ONLY

DRAWN BY: JME
DATE: 12-4-00

DRWG. NO.: T200-800

SHEET: 4 of 8
T200-800-4.DWG

DATE	REV.	E. C. NO.	DESCRIPTION
1-11-01	1		REVISED PER DADE COUNTY INITIAL SUBMITTAL
12-4-00			

OPENING DIMENSION

FRAME HEIGHT

DOOR OPENING (TYP.)

DOOR HEIGHT (TYP.)

2 1/2'

1/8"

3 1/2'

DLO

6 1/2'

11/16"

2'

PERIMETER FASTENER (SEE SHEET 2)

SEE SHEET 8 FOR IDENTIFICATION OF GLAZING MATERIALS AND GLASS BITE

38 @ 17" O.C. MAX. (TYP.)

1 TRANSOM BAR

1/4" SentryGlas® SHOWN

SEE SHEET 8 FOR GLAZING OPTIONS, PARTS IDENTIFICATION, AND GLASS BITE

SEE SHEET 8 FOR GLAZING OPTIONS, PARTS IDENTIFICATION, AND GLASS BITE

2 THRESHOLD

1/4" SentryGlas® SHOWN

42 @ 10" O.C. MAX. (TYP.)

OPENING DIMENSION

1/4"

2 1/2'

1/8"

3 1/2'

DLO

SCALE: HALF

PERIMETER FASTENER (SEE SHEET 2)

3 HEADER

1/4" SentryGlas® SHOWN

SEE SHEET 8 FOR GLAZING OPTIONS, PARTS IDENTIFICATION, AND GLASS BITE

DADE COUNTY NDA NO. 00-0705.10

Kawneer
An Alcoa Company
Product Engineering & Development

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560

DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE Feb. 01, 2001
BY Manuel Serrano
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0705.10

THIS DRAWING IS FOR
DADE COUNTY
PRODUCT APPROVAL
ONLY

DRAWN BY JME DATE 12-4-00

DRWG. NO. T200-800


SHEET 5 of 8 T200-800-5.DWG

DATE	REV.	E. C. NO.	DESCRIPTION
1-11-01	1		REVISED PER DADE COUNTY
12-4-00	-		INITIAL SUBMITTAL

JME


JME

BY

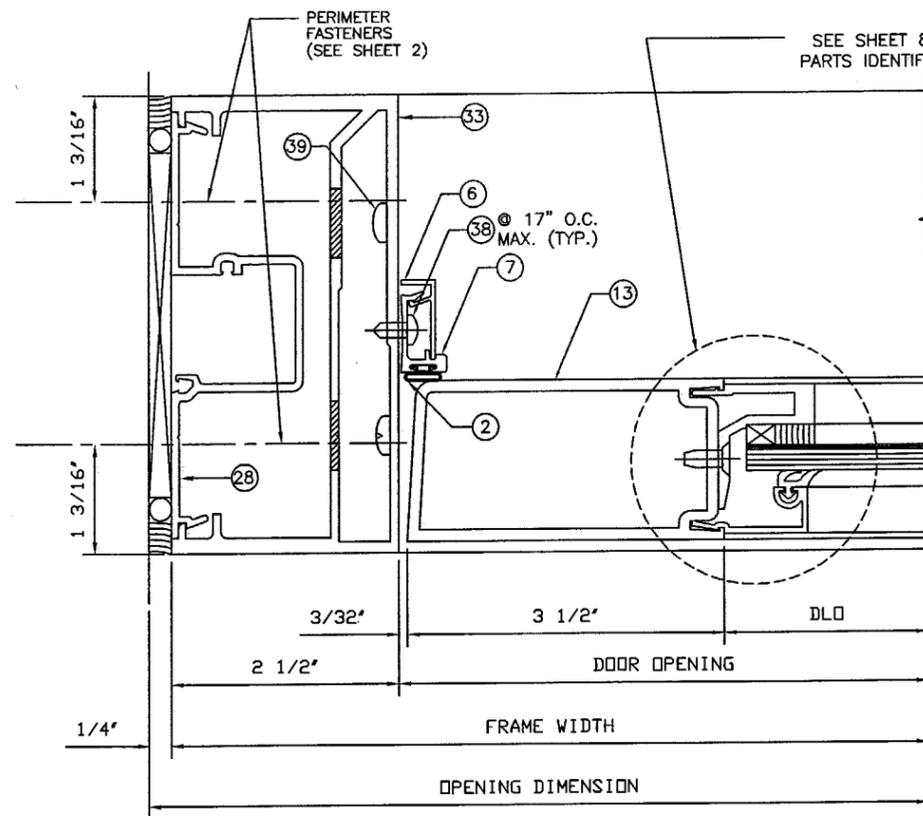


4
JAMB TO WALL

1/4" SentryGlas® SHOWN

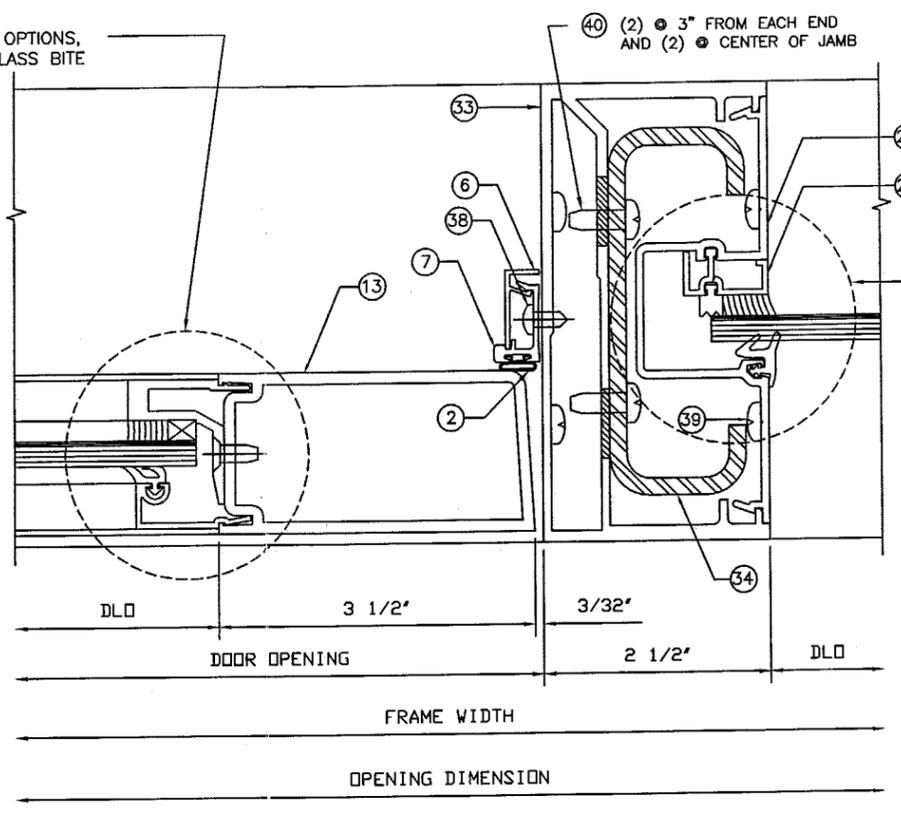


5
INTERM. JAMB

1/4" SentryGlas® SHOWN

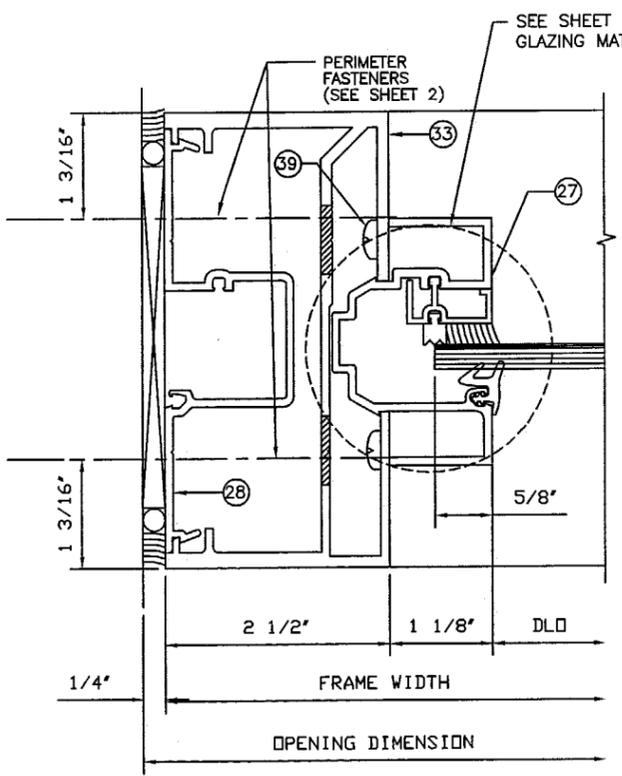


6
JAMB TO WALL

1/4" SentryGlas® SHOWN

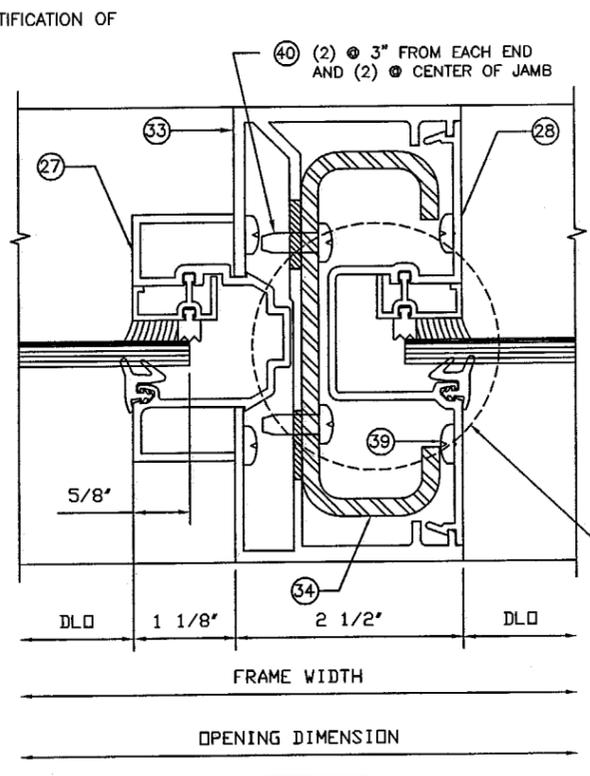

7
INTERM. JAMB

1/4" SentryGlas® SHOWN

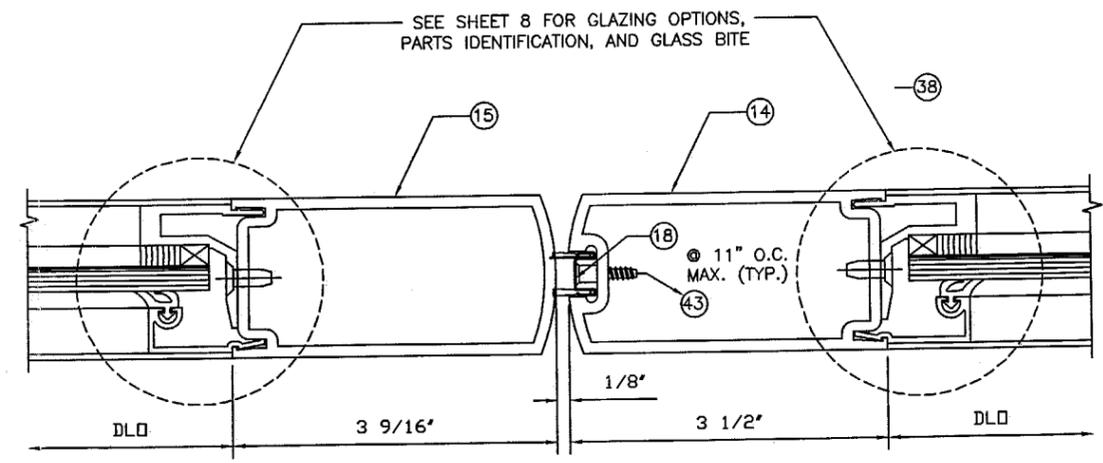

8
MEETING STILES

1/4" SentryGlas® SHOWN

SEE SHEET 8 FOR IDENTIFICATION OF GLAZING MATERIALS

SCALE: HALF

REV.	DATE	DESCRIPTION
1	1-11-01	REVISED PER DADE COUNTY INITIAL SUBMITTAL
	12-4-00	

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE Feb. 01, 2001 BY *Manuel Sosa* PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. 00-0705.10

DADE COUNTY NOA NO. 00-0705.10


Kawneer
An Alcoa Company
Product Engineering & Development

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560


DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

THIS DRAWING IS FOR DADE COUNTY PRODUCT APPROVAL ONLY


DRAWN BY JME	DATE 12-4-00
DRWG. NO. T200-800	
SHEET 6 of 8	T200-800-6.DWG

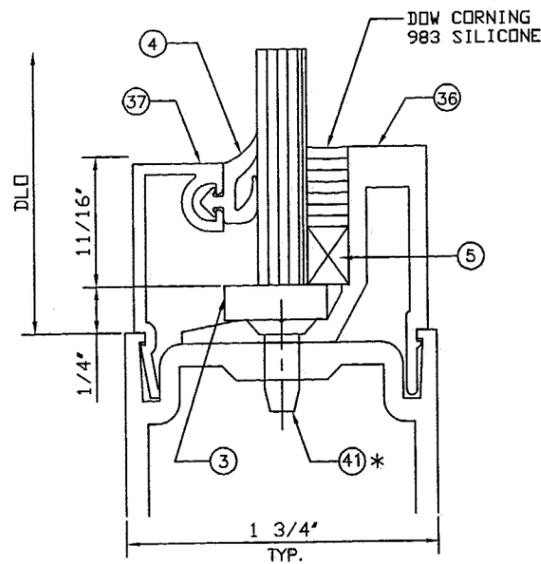


TYPICAL DOOR GLAZING DETAIL
1/4" SentryGlas®
ACTUAL SIZE

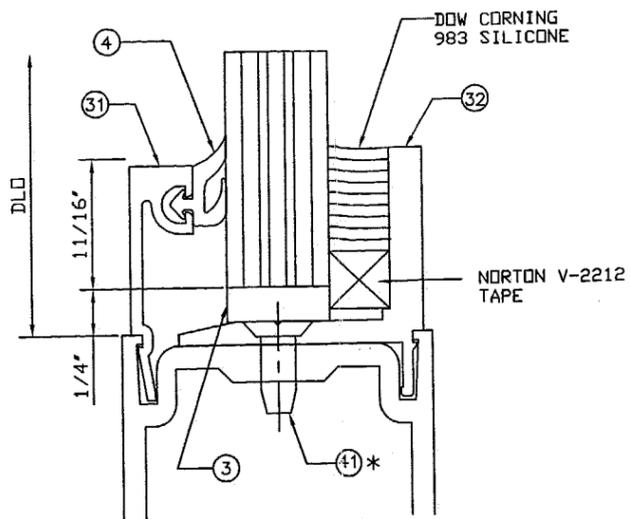

TYPICAL DOOR GLAZING DETAIL
9/16" HRG-2
ACTUAL SIZE

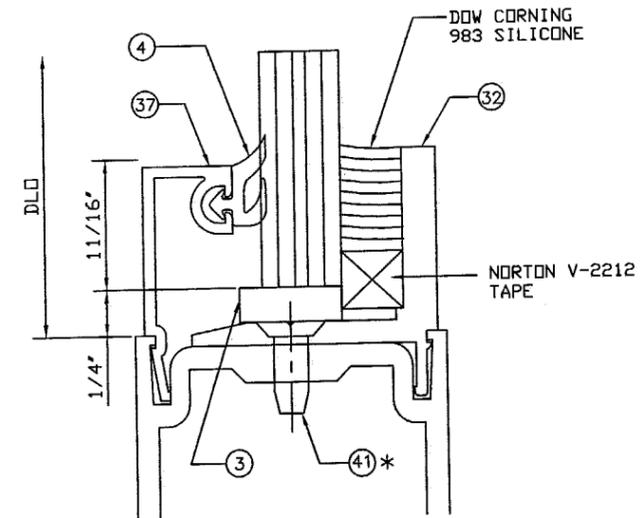

TYPICAL DOOR GLAZING DETAIL
7/16" SAF-GLAS
ACTUAL SIZE

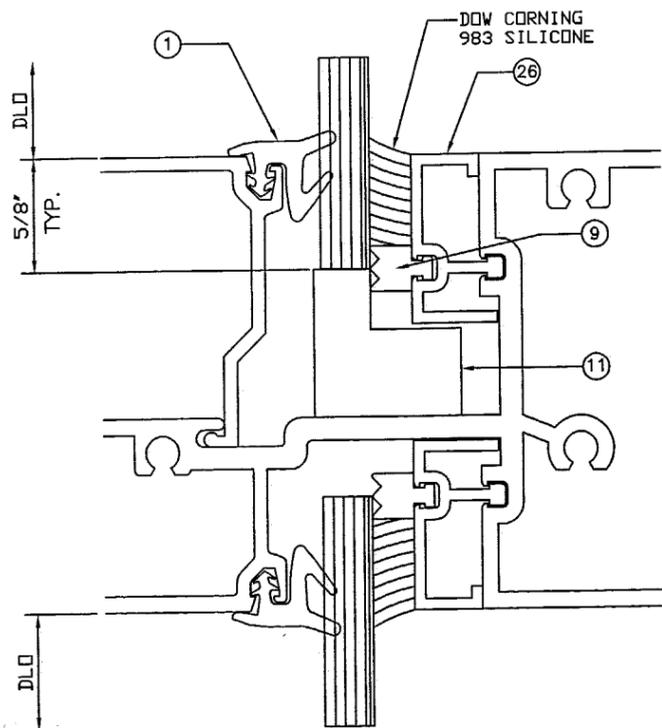

TYPICAL FRAME GLAZING DETAIL
1/4" SentryGlas® SHOWN
ACTUAL SIZE

* 3" FROM EACH END AND MAX. 7-1/2" O.C. @ TOP AND BOTTOM RAIL
3" FROM EACH END AND MAX. 11-1/8" O.C. @ VERTICAL STILES

SEE IR 500 PRODUCT APPROVALS FOR OTHER FRAME GLAZING OPTIONS

SCALE: FULL

REV.	DATE	DESCRIPTION
1	1-11-01	REVISED PER DADE COUNTY INITIAL SUBMITTAL
-	12-4-00	
E. C. NO.	REV.	DATE

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE Feb. 01, 2001
BY Manuel Perez
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0705.10

DADE COUNTY NOA NO. 00-0705.10

Kawneer
An Alcoa Company
Product Engineering & Development
555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560

THIS DRAWING IS FOR
DADE COUNTY
PRODUCT APPROVAL
ONLY

DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

DRAWN BY JME	DATE 12-4-00
DRWG. NO. T200-800	
SHEET 8 of 8	T200-800-8.DWG