



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Stanley Door Systems
7300 Reames Rd.
Charlotte ,NC 28216

Your application for Notice of Acceptance (NOA) of:

Series "Sta-Tru" Outswing Glazed Residential Insulated Steel Door w/Sidelites

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez
Chief Product Control Division

ACCEPTANCE NO.: 00-0809.02
EXPIRES: 01/04/2002

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 01/04/2001

Stanley Door Systems

ACCEPTANCE No.: 00-0809.02

APPROVED : JAN 0 4 2001

EXPIRES : JAN 0 4 2002

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

1.1 This approves a residential insulated steel door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

2.1 The Series "Sta-Tru" Outswing Glazed Residential Insulated Steel Door w/Sidelites and its components shall be constructed in strict compliance with the following documents: Drawing No. **39638** titled "Stanley Outswing Glazed 11-4 x 8-0 Door-W/ & W/O Sidelites" Sheets 1 through 7 of 7, dated 6/2/00, with revision 1 dated 12/11/00, prepared by R.W Building Consultants, Inc., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

3.1 This approval applies to single unit applications of pair of doors and single door with or without sidelites, as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.

4. INSTALLATION


4.1 The residential insulated steel door and its components shall be installed in strict compliance with the approved drawings.
4.2 Hurricane protection system (shutters): the installation of this unit **will require** a hurricane protection system.

5. LABELING

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:
6.1.1 This Notice of Acceptance
6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

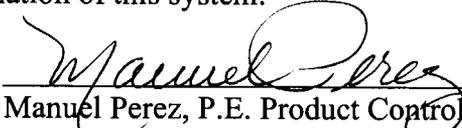
Manuel Perez, P.E. Product Control Examiner
Product Control Division

Stanley Door Systems


ACCEPTANCE No.: 00-0809.02

APPROVED : JAN 0 4 2001

EXPIRES : JAN 0 4 2002

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

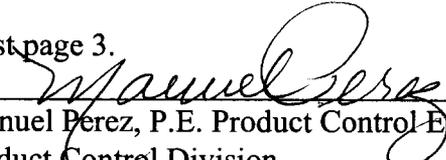
Manuel Perez, P.E. Product Control Examiner
Product Control Division

END OF THIS ACCEPTANCE

STANLEY DOOR SYSTEMS

STA-TRU OUTSWING 8-0 GLAZED STEEL DOOR
W/AND W/O SIDELITES IN A WOOD FRAME

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED.
5. DESIGN PRESSURE RATING SEE TABLES PAGE 1.
6. SIDELITES ARE AN OPTION AND CAN BE IN A SINGLE OR DOUBLE DOOR CONFIGURATION.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

Door Panel & Sidelite Construction:

Face sheets: 24 GA.(0.021") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength $F_y(\text{min.})=41,949$ psi

Core design: Polyurethane foam core, with 1.7 psf lbs. density by BASF.

Door Panel Construction: Glazed type. The vertical edges of the skin are flush and glued to the top and bottom finger jointed pine stiles. The horizontal edges of the panel skin are roll formed over the finger jointed hinge stile and LVL latch stile to form a mechanical lock. The panels are sandwich glazed using a two piece polypropylene lite frame with mitered & welded corners.

Sidelite Panel Construction: The vertical edges of the skin are flush and glued to the top and bottom finger jointed pine stiles. The horizontal edges of the panel skin are roll formed over the finger jointed side stiles to form a mechanical lock. Panels are sandwich glazed using a two piece polypropylene lite frame with mitered & welded corners.


TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS & DOOR MODELS
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & GLAZING DETAILS
7	COMPONENTS

DESIGN PRESSURE RATING	
UNIT TYPE	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED
SINGLE	+50.0 -50.0 PSF
SINGLE W/SIDELITES	+50.0 -50.0 PSF

DESIGN PRESSURE RATING			
UNIT TYPE	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED		
	W/IMPERIAL AST.	W/WINDJAMBER // AST.	
DOUBLE	+50.0 -44.0 PSF	+50.0 -50.0 PSF	
DOUBLE WITH SIDELITES	+50.0 -44.0 PSF	+50.0 -50.0 PSF	

ALL DOOR MODELS ARE VIEWED FROM THE INTERIOR SIDE (OUTSWING DOORS)

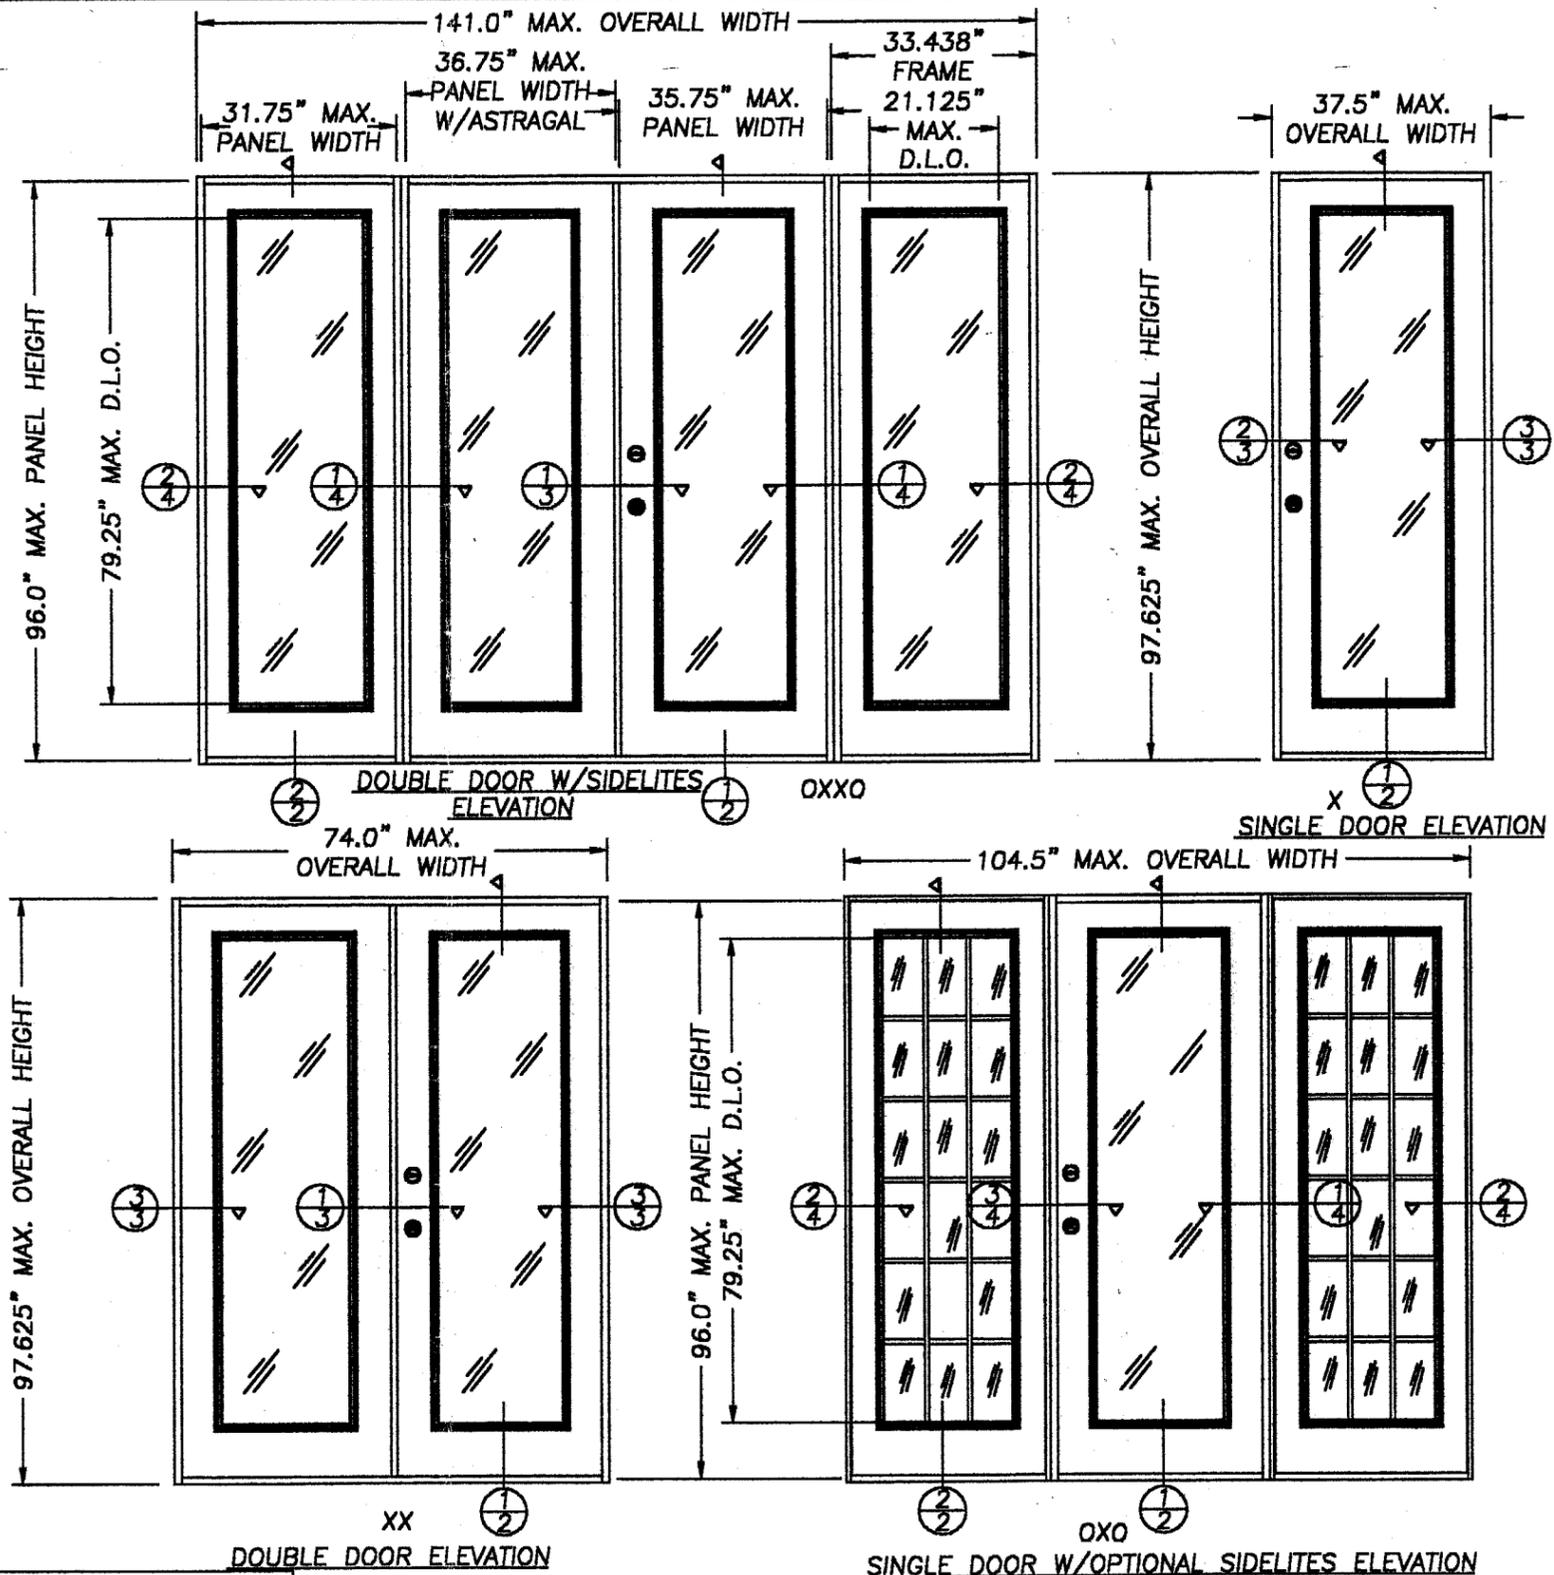

STANLEY

STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT: STANLEY OUTSWING GLAZED
11-4 x 8-0 WOODEDGE
DOOR W/ & W/O SIDELITES


PART OR ASSEMBLY:
ELEVATIONS AND
GENERAL NOTES

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/11/00			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE: *January 09, 2001*
BY: *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0809.02*

DATE: 6/2/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39638
SHEET 1 OF 7

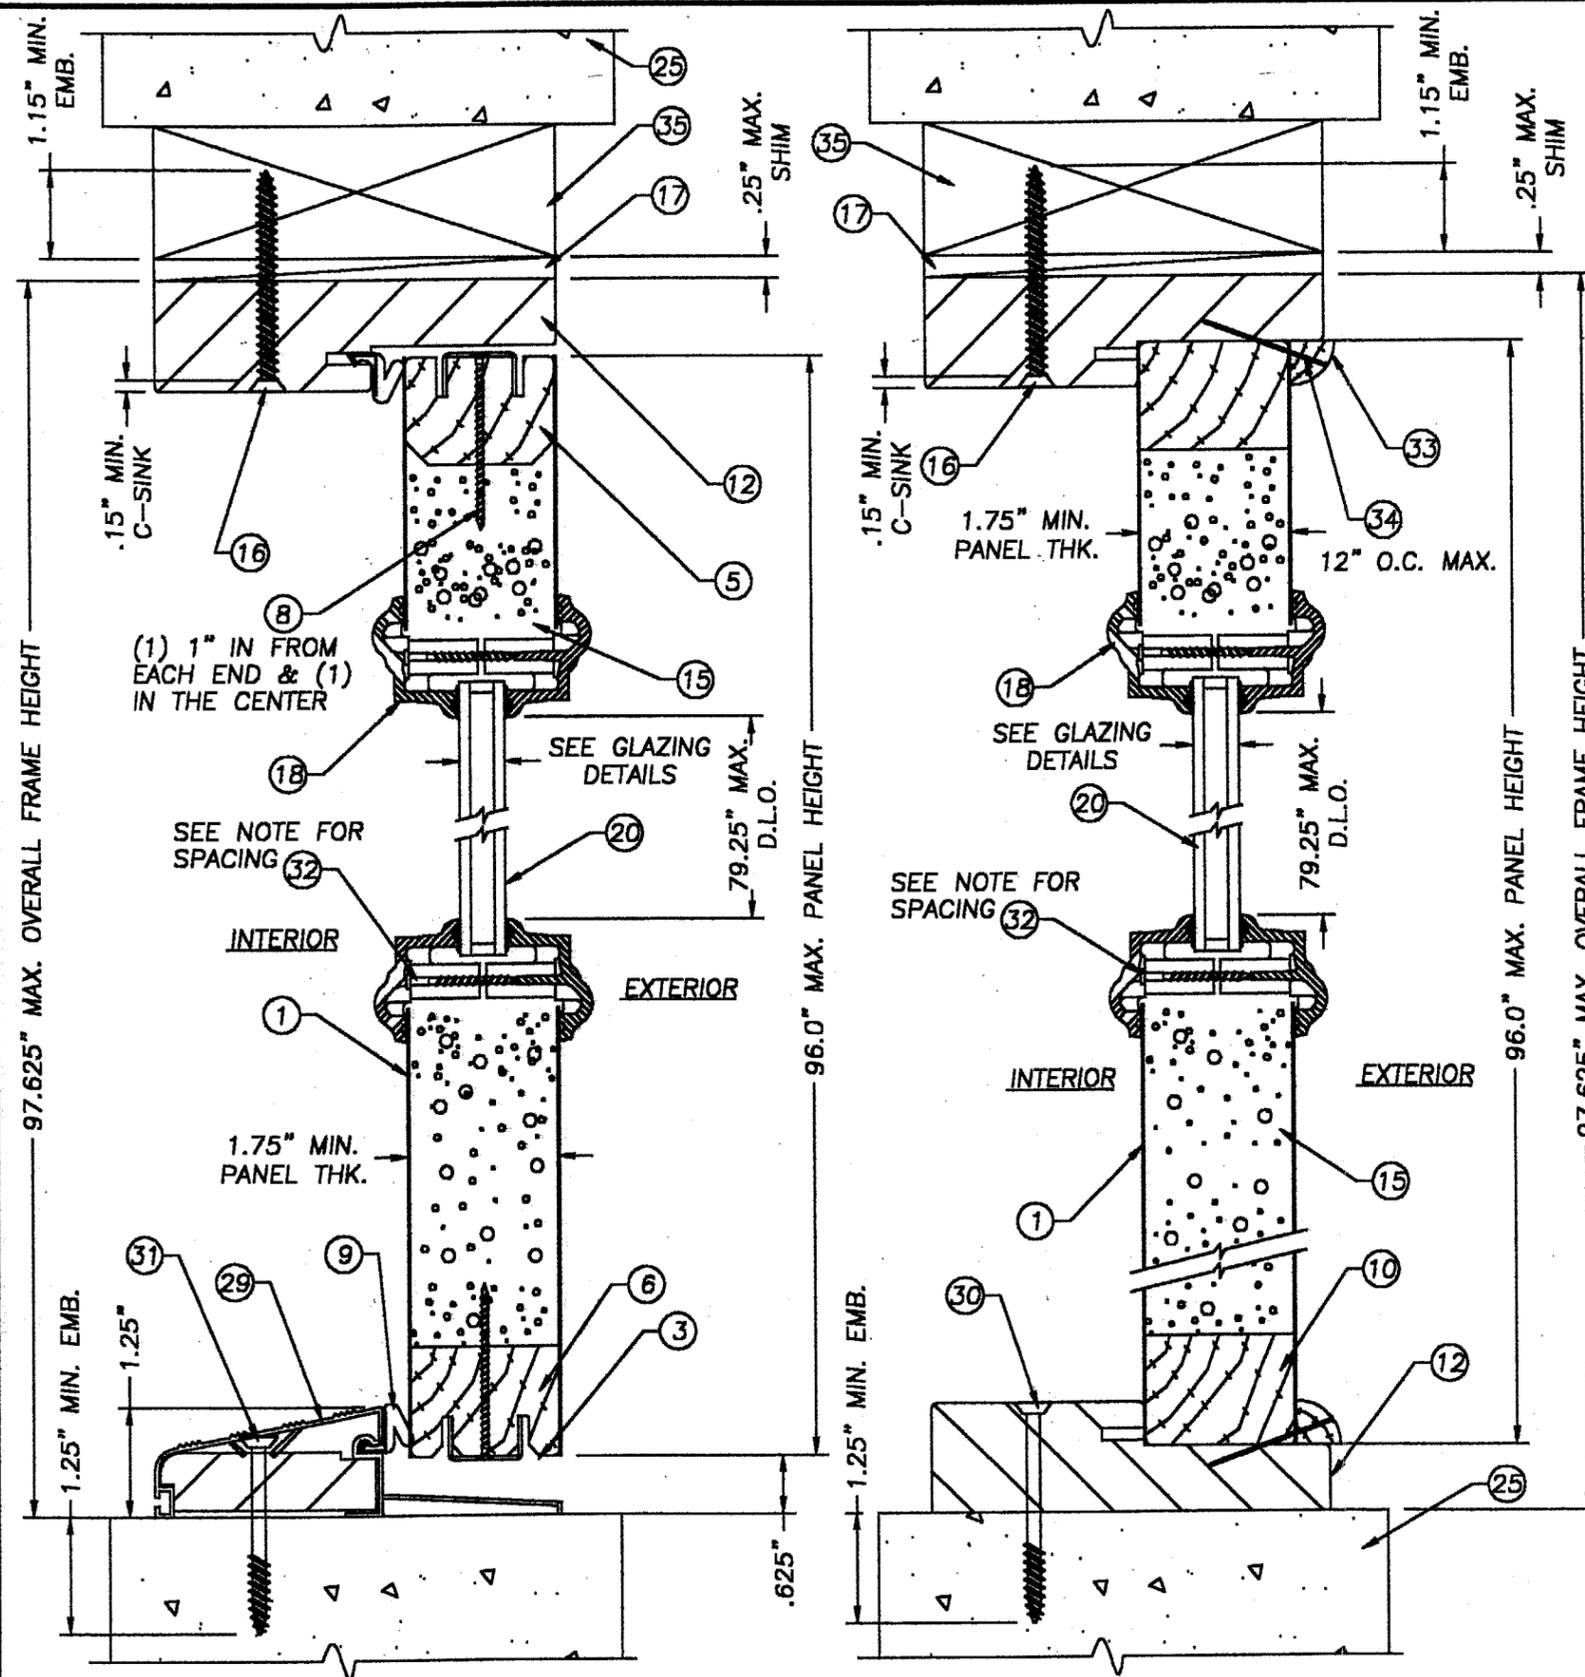

1 VERTICAL CROSS SECTION
2 DOOR PANEL

2 VERTICAL CROSS SECTION
SIDELITE

NOTE: SPACING FOR ITEM #32; TOP & BOTTOM (1) 3 1/2" IN FROM CORNERS & (1) IN THE CENTER. SIDES; (6) SCREWS @ 3 1/4", 13 3/4", 26 1/2", 39 3/8", 52" & 62 5/8".

ITEM	DESCRIPTION	MATERIAL
1	DOORSKIN (.021" MIN. STEEL)	STEEL
2	1.68" x 4.0" LATCH STILE	LVL
3	DOOR PANEL TOP & BOTTOM REIN. (.040" THK.)	STEEL
4	1.68"x1.22" HINGE STILE (PONDEROSA PINE)	PINE
5	1.68"x1.22" TOP RAIL (PONDEROSA PINE)	PINE
6	1.68"x1.00" BOTTOM RAIL (PONDEROSA PINE)	PINE
7	HINGES 4" X 4" X .088 WT. (STANLEY)	STEEL
8	#6 x 2" PHILLIPS FLAT HEAD SCREW	STEEL
9	COMPRESSION WEATHERSTRIP (SCHLEGAL QDS-650) MAGNETIC WEATHERSTRIP (HOLMES)	FOAM
10	SIDELITE TOP & BOTTOM RAIL (PONDEROSA PINE)	PINE
11	SIDELITE BLANK JAMB (PONDEROSA PINE)	PINE
12	HEAD JAMB (PONDEROSA PINE)	PINE
13	HNGE JAMB (PONDEROSA PINE)	PINE
14	LATCH JAMB (PONDEROSA PINE)	PINE
15	POLYURETHANE FOAM CORE (BASF) TYPE A. INFINITY: RESIN (P14120R) ISOCYANATE (P1001), CYCLOPENTANE. TYPE B. RETRO: RESIN (P12430R), ISOCYANATE (P1036).	
16	#8 x 2 1/2" PFH WS	STEEL
17	1/4" SHIM MATERIAL	-
18	1/2" GLASS LITE FRAME (POLYPROPYLENE BY ODL) 1" GLASS LITE FRAME (POLYPROPYLENE BY ODL)	POLYPROP. POLYPROP.
19	GLAZING COMPOUND SILICONE CAULK (GE WINDOW & DOOR) GLAZING COMPOUND LIQUID NAIL LATEX SEALANT GLAZING COMPOUND SILICONE CAULK (NOVAGARD)	SILICONE LATEX SILICONE
20	GLASS (1/2" BY ODL SEE GLAZING DETAIL) GLASS (1" BY ODL SEE GLAZING DETAIL)	
21	KWIKSET 660 DEADBOLT	-
22	KWIKSET SERIES 200 DL PASSAGE	
23	#8 x 2" PFH WOOD SCREW	STEEL
25	MASONRY	CONCRETE
26	GLAZING TAPE (VENTURE TAPE .30" W. x .037" THK.) GLAZING COMPOUND LIQUID NAIL LATEX SEALANT GLAZING COMPOUND SILICONE CAULK (NOVAGARD)	FOAM LATEX SILICONE
27	#9 x 1.00 F.H. WD SCREWS	STEEL
28	#8 x 2" P.H. WD SCREWS	STEEL
29	BUMP THRESHOLD	ALUMINUM
30	3/16" TAPCON (ITW) OR 3/16" (ELCO) 2 1/2" LG.	STEEL
31	3/16" TAPCON (ITW) OR 3/16" (ELCO) 2 1/4" LG.	STEEL
32	#8-1 1/4" TEK SCREW (LITE FRAME SCREW)	STEEL
33	GLAZING STOP QUARTER ROUND (1/2" x 1/2")	PINE
34	BRAD TRIM NAIL 2" LG. (12" MAX. O.C. SPACING)	STEEL
35	2X BUCK	WOOD
36	OPTIONAL EXTRUDED ALUMINUM ASTRAGAL (IMPERIAL)	ALUM.
37	1.68"x1.22" BLANK STILE (PONDEROSA PINE)	PINE
38	ASTRAGAL EXTRUDED ALUM. (WR80S WINDJAMBER II)	ALUM.

STANLEY
 STANLEY DOOR SYSTEMS
 7300 REAMES ROAD
 CHARLOTTE, NC 28216
 PH. (704) 921-3470

PRODUCT: STANLEY OUTSWING GLAZED
 11-4 x 8-0 WOODEDGE
 DOOR W/ & W/O SIDELITES
 PART OR ASSEMBLY:
 VERTICAL CROSS SECTIONS
 & BILL OF MATERIALS


NO.	DATE	GENERAL REVISION	TJH	BY
1	12/11/00			

REVISIONS


RW BUILDING CONSULTANTS, INC.
 813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE *January 04, 2001*
 BY *Manuel Ruiz*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. *00-0809-02*


DATE: 6/2/00
 SCALE: 1/2" = 1"
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: 39638
 SHEET 2 OF 7

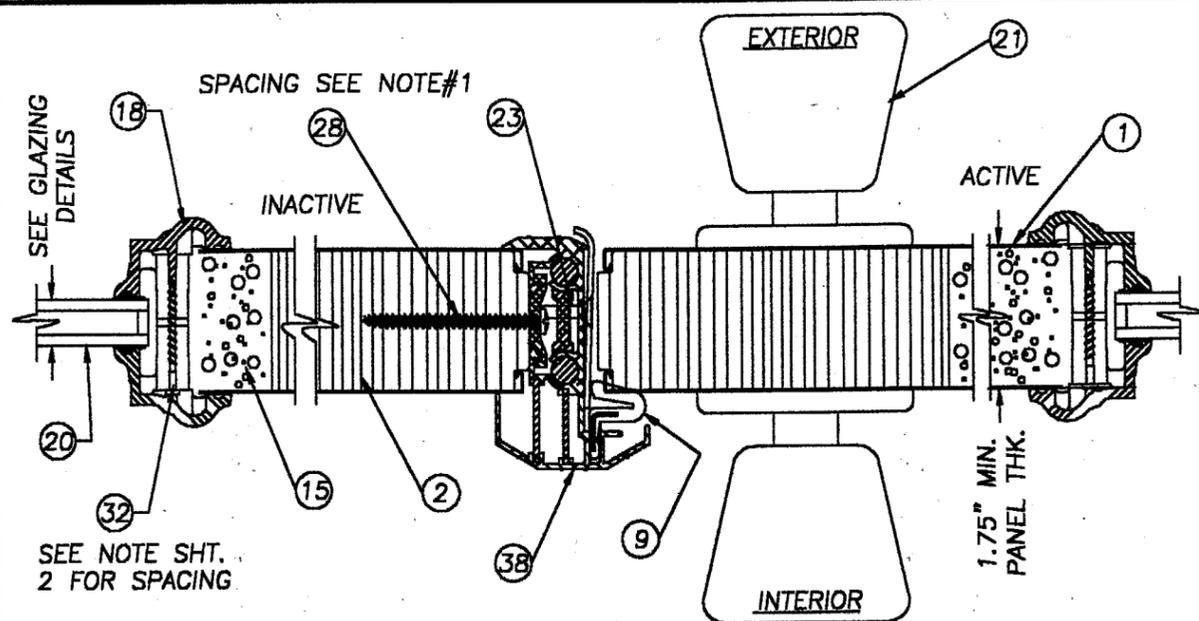

1 HORIZONTAL CROSS SECTION
3 AT ASTRAGAL TYP. (W/ITEM #38 WR80S)

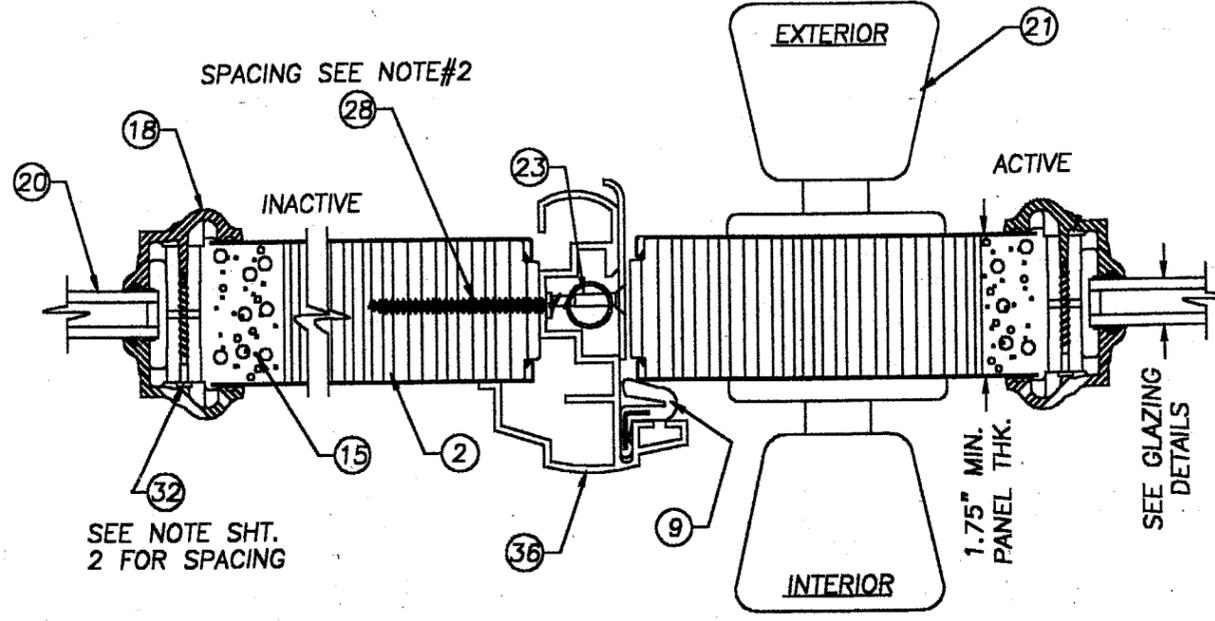


1 OPTIONAL HORIZONTAL CROSS SECTION
3 AT ASTRAGAL TYP. (W/ITEM #36 IMPERIAL)

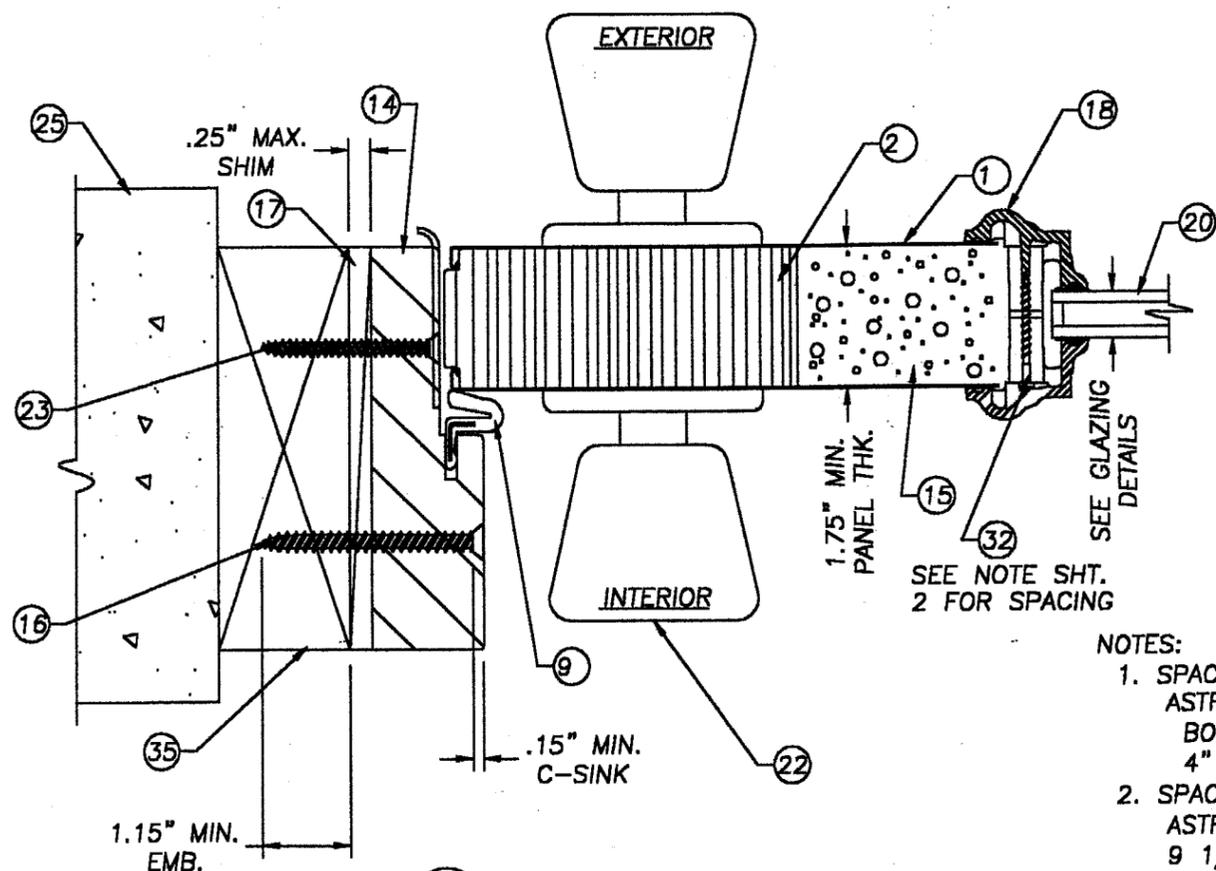

2 HORIZONTAL CROSS SECTION
3 AT LATCH JAMB TO BUCK TYP.

NOTES:

1. SPACING FOR ITEM #28 ON THE WR80S ASTRAGAL IS AS FOLLOWS: TOP DOWN & BOTTOM UP; 1", 3", 5", 26", & (1) 4" UP FROM THE STRIKE.
2. SPACING FOR ITEM #28 ON THE IMPERIAL ASTRAGAL IS AS FOLLOWS: TOP DOWN; 1", 9 1/4", 18 1/8", 26 7/8", 35 3/4", 44 3/8" & 48 1/8". FROM THE BOTTOM UP; 1", 7 1/2", 14 1/2", 21 1/2", 28 1/2", 33 1/2" & 37 1/4".

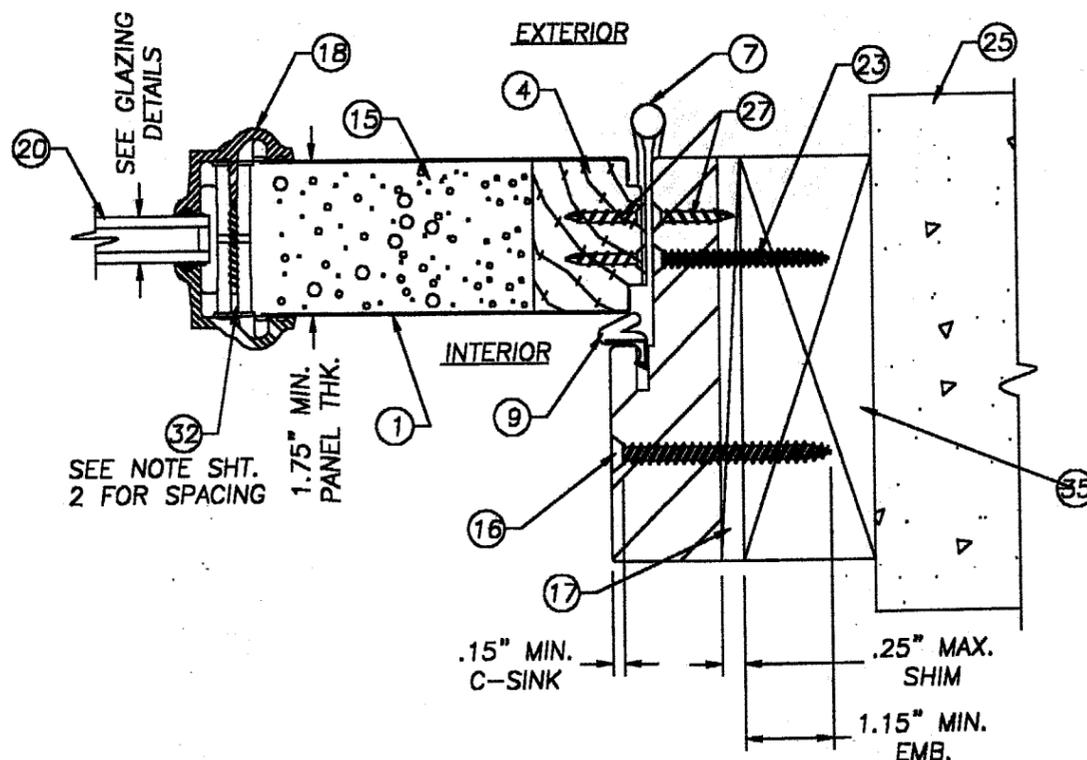

3 HORIZONTAL CROSS SECTION
3 AT HINGE JAMB TO BUCK TYP.

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470



PRODUCT:
STANLEY OUTSWING GLAZED
11-4 x 8-0 WOODEDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
HORIZONTAL
CROSS SECTIONS

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/11/00			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *January 04, 2001*
BY *Maurek*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0809-02*


DATE: 6/2/00
SCALE: 1/2"=1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39638
SHEET 3 OF 7

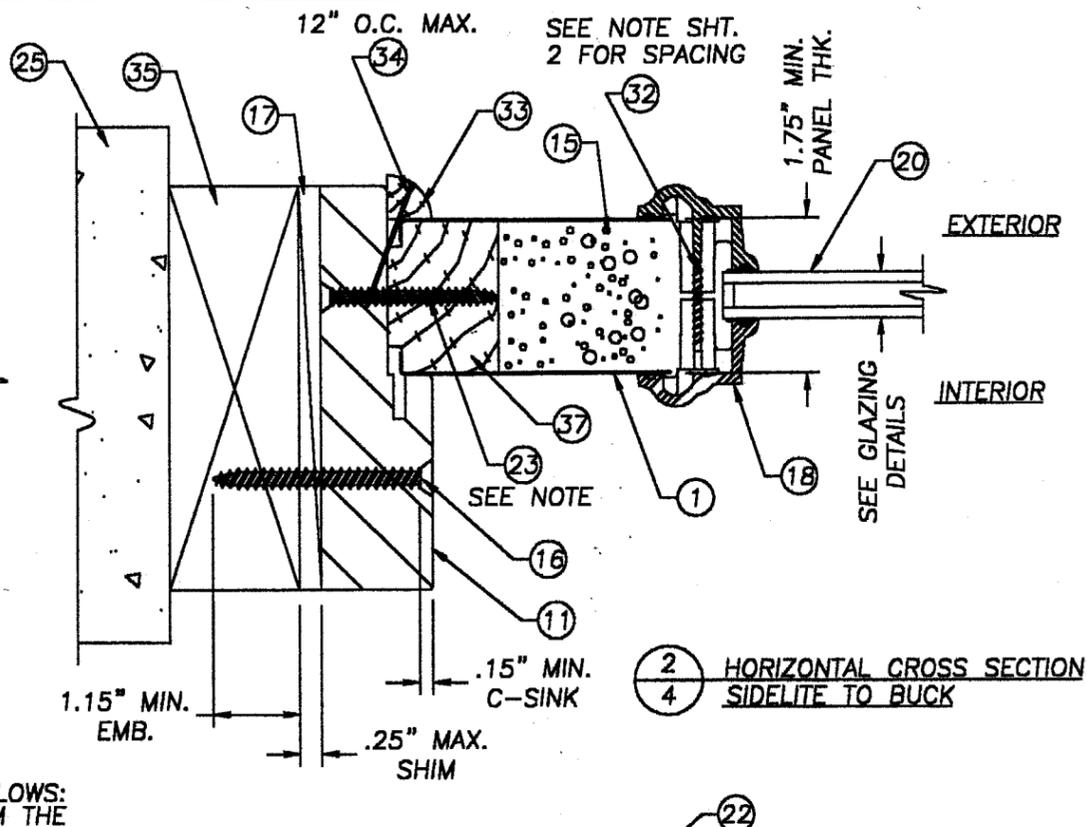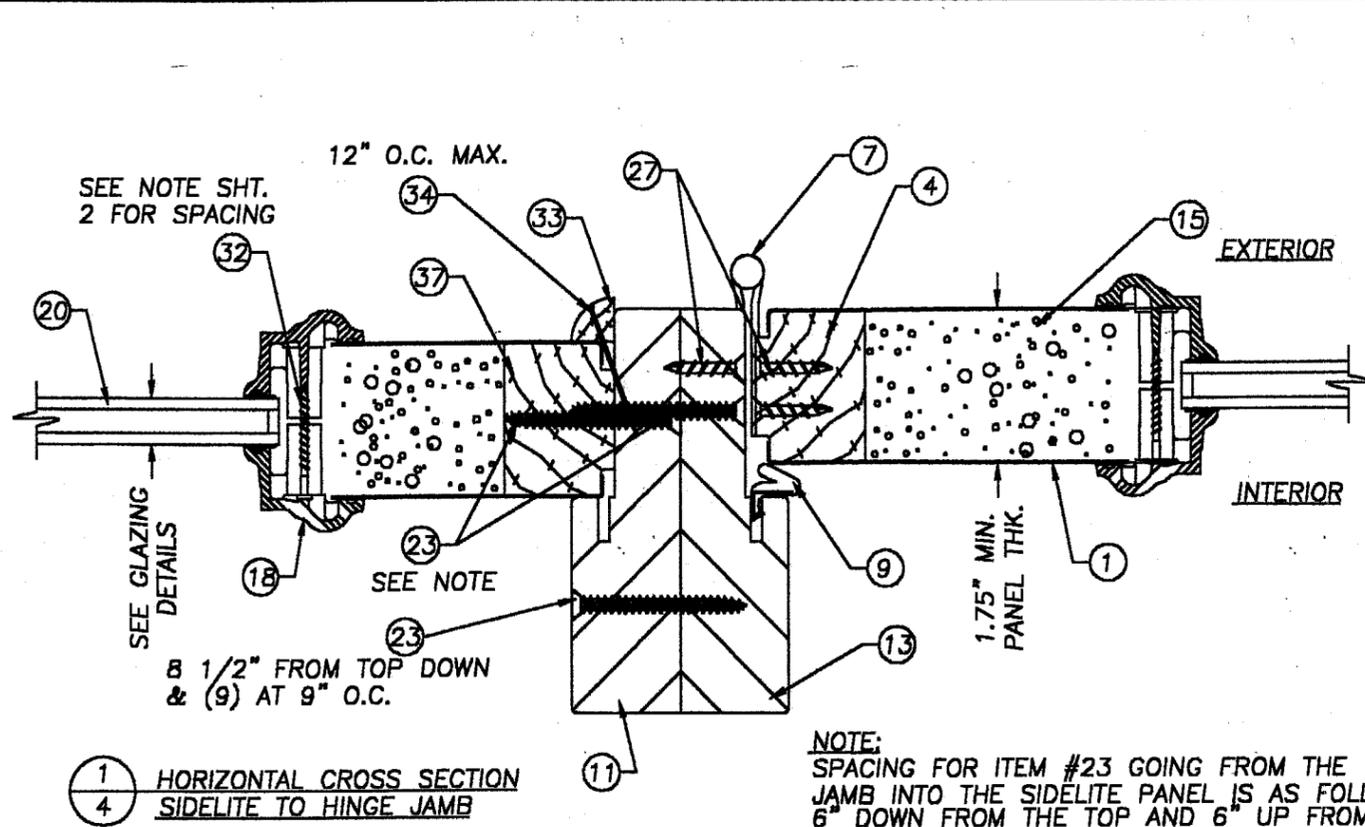


NOTE:
SPACING FOR ITEM #23 GOING FROM THE JAMB INTO THE SIDELITE PANEL IS AS FOLLOWS: 6" DOWN FROM THE TOP AND 6" UP FROM THE BOTTOM WITH (2) MORE EVENLY SPACED. A TOTAL OF (4) SCREWS PER EACH JAMB.

1 HORIZONTAL CROSS SECTION
4 SIDELITE TO HINGE JAMB

2 HORIZONTAL CROSS SECTION
4 SIDELITE TO BUCK

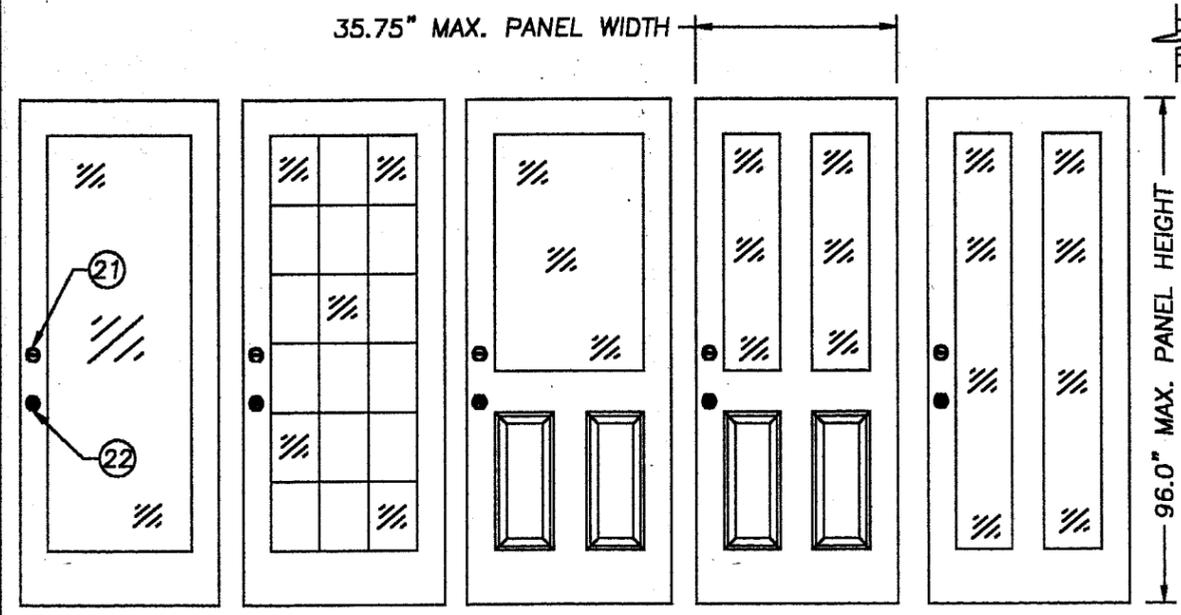

GLAZED DOOR MODELS

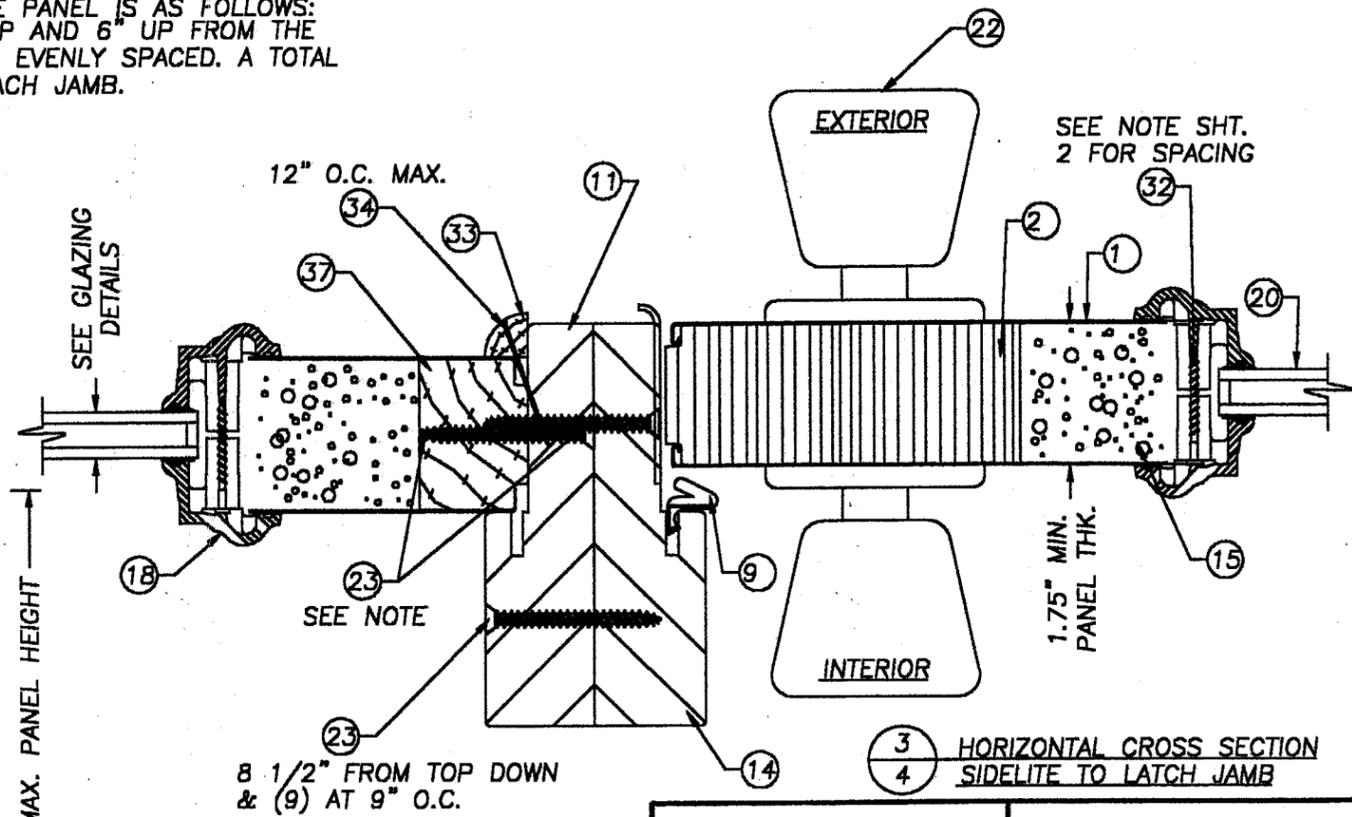

3 HORIZONTAL CROSS SECTION
4 SIDELITE TO LATCH JAMB

8 1/2" FROM TOP DOWN
& (9) AT 9" O.C.

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470







PRODUCT:
STANLEY OUTSWING GLAZED
11-4 x 8-0 WOODEDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
HORIZONTAL CROSS
SECTIONS & DOOR MODELS

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/11/00			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *January 04, 2001*
BY *Manuel Sere*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0809.02*

DATE: 6/2/00
SCALE: 1/2"=1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39638
SHEET 4 OF 7

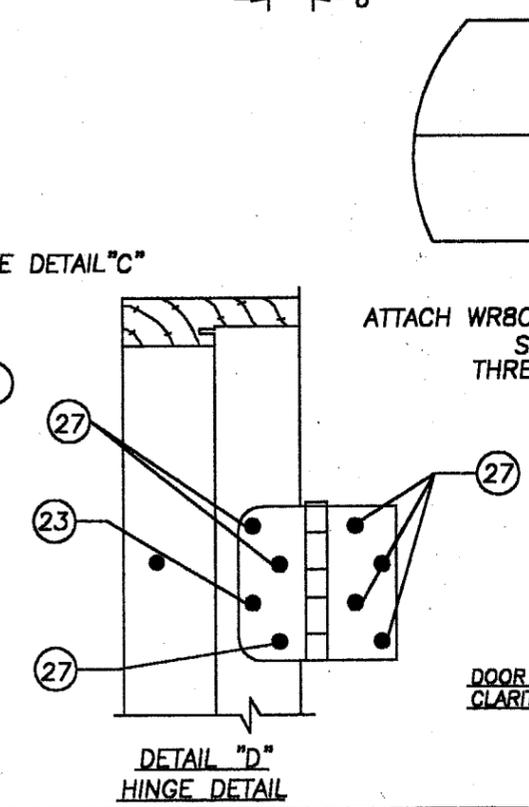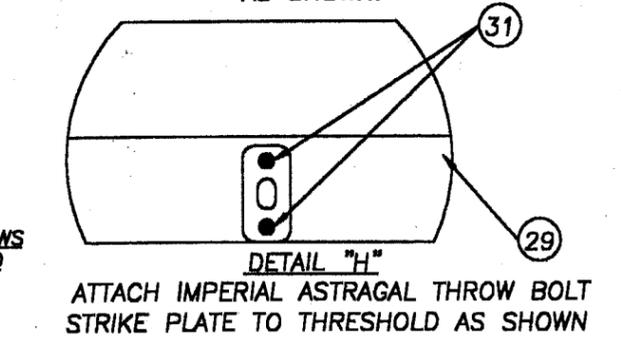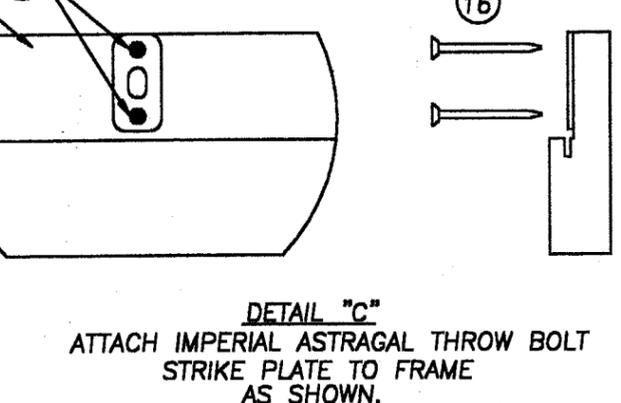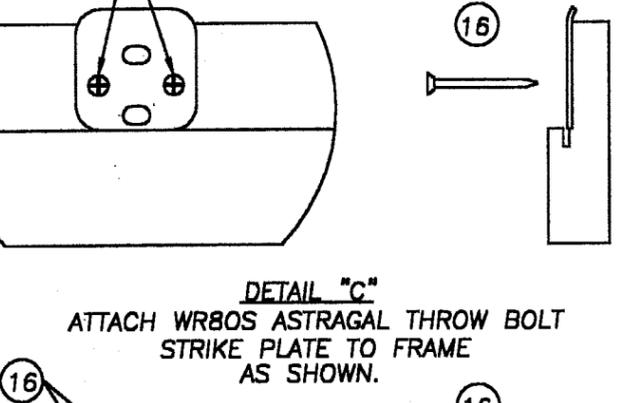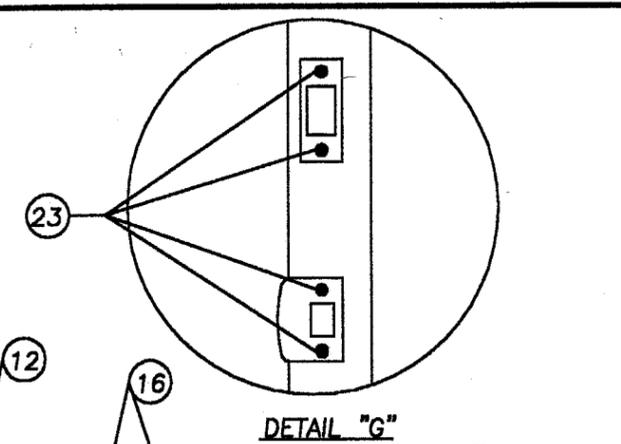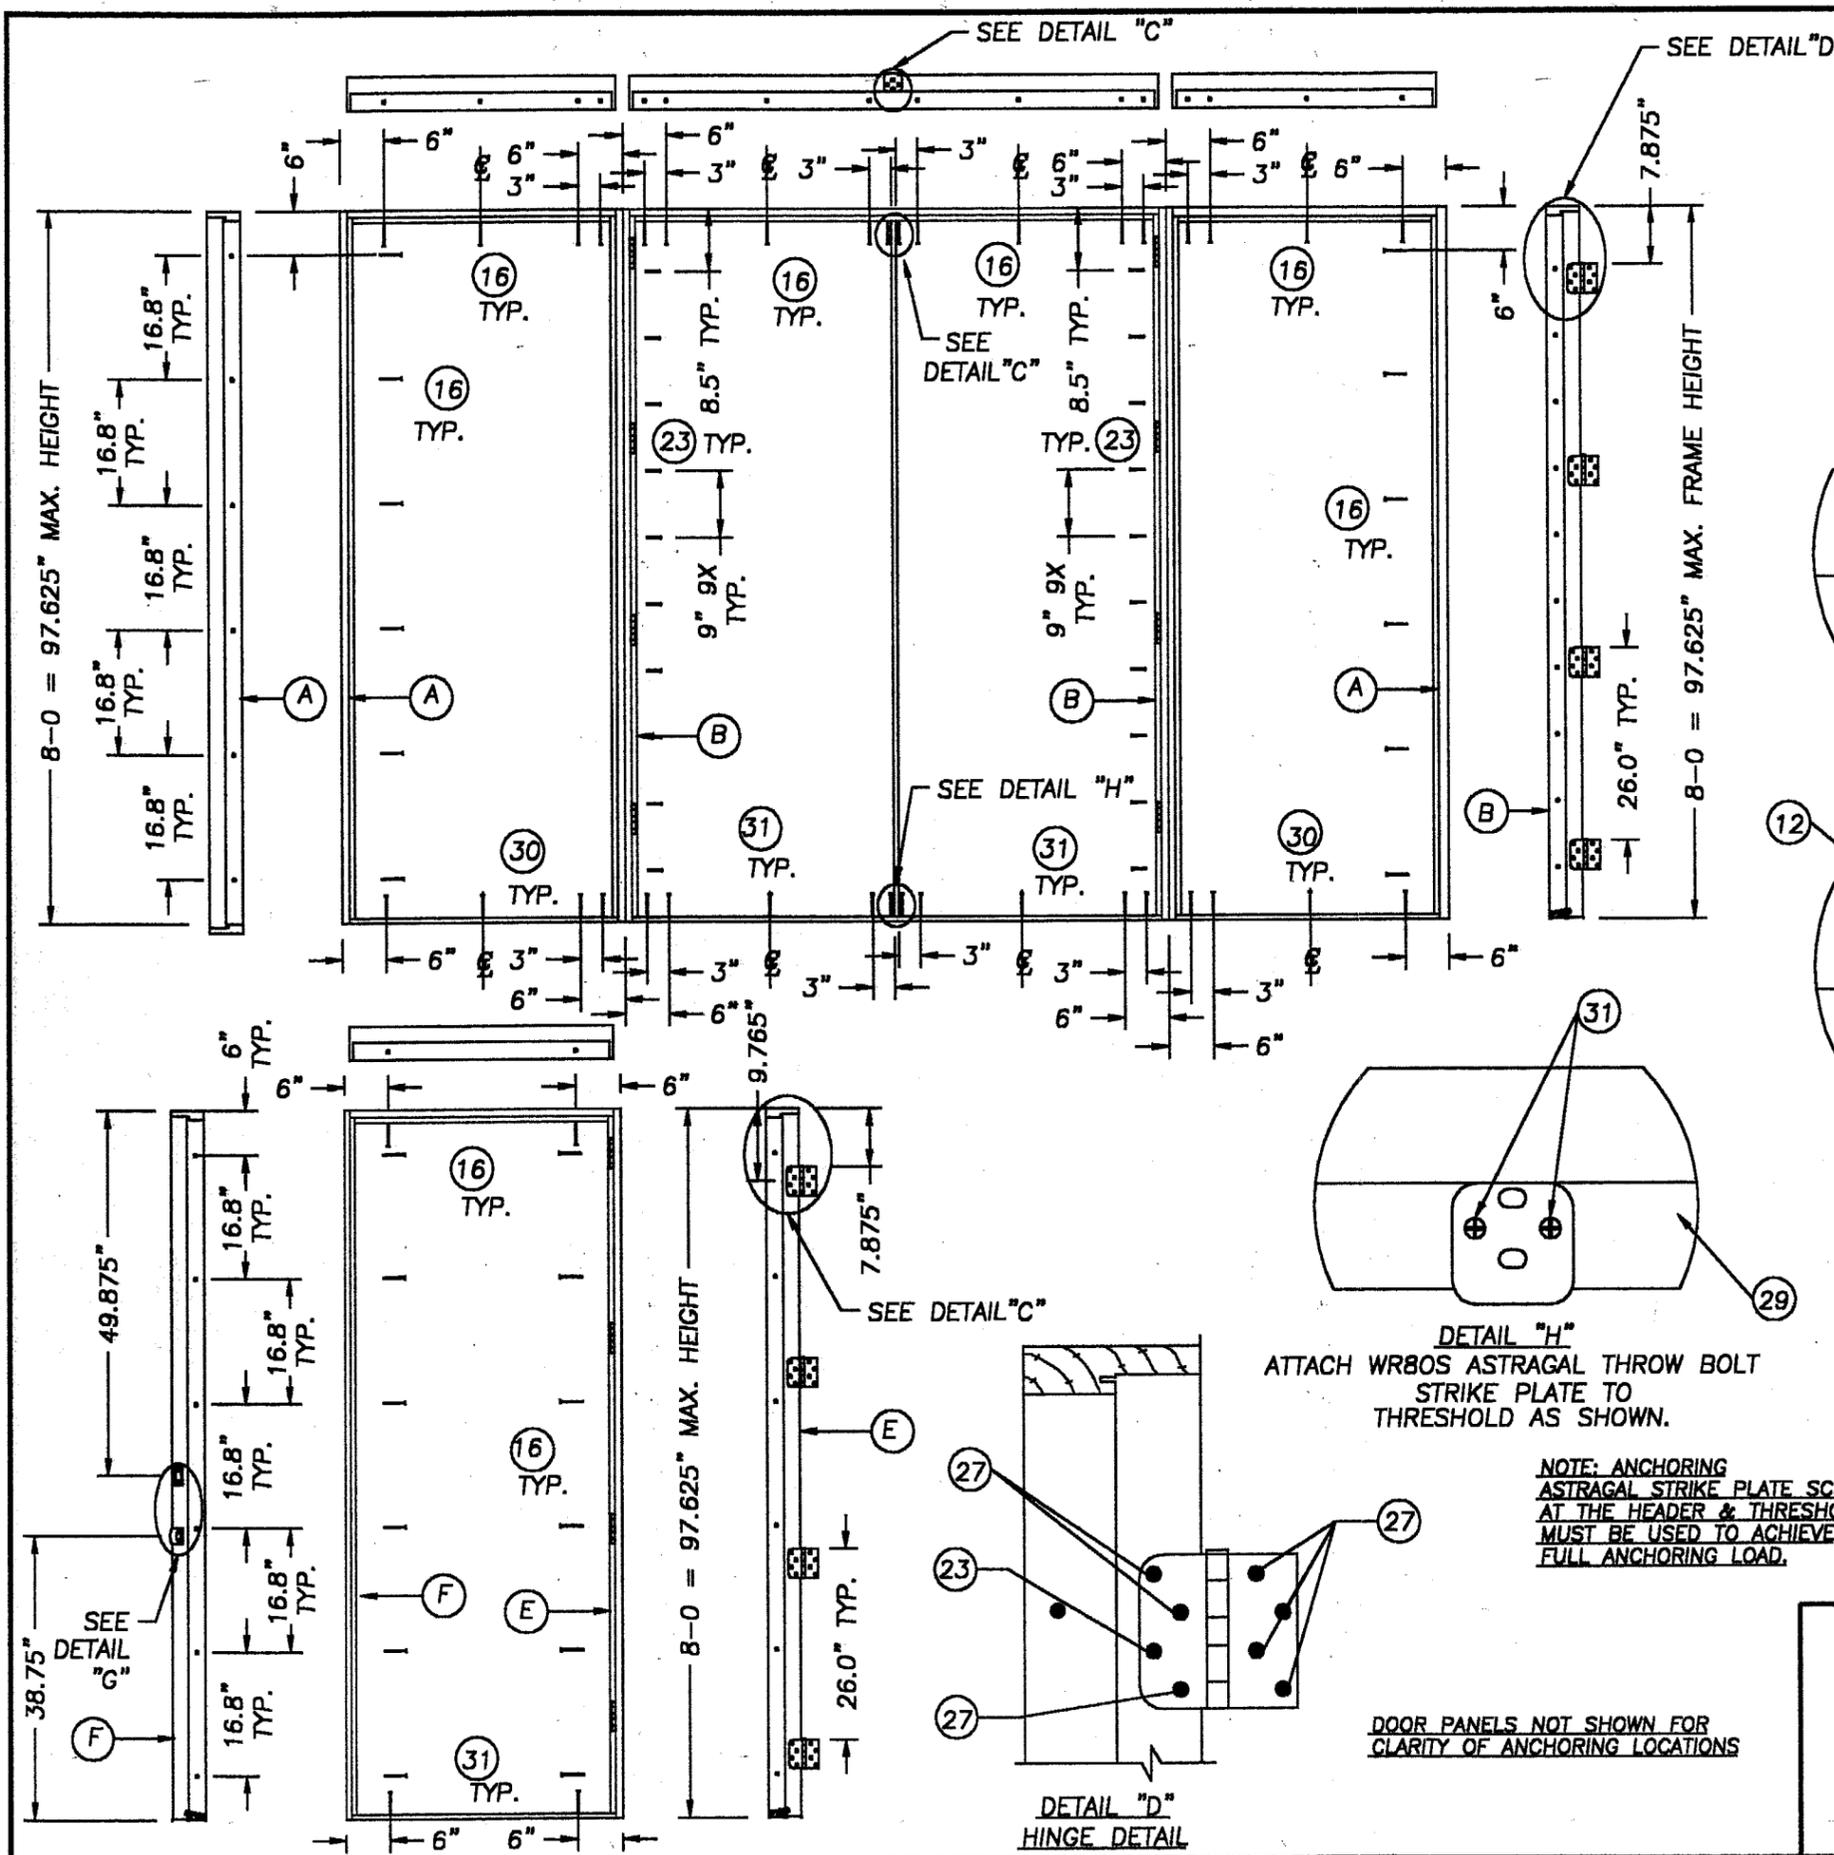

DETAIL "G"
ATTACH WRBOS ASTRAGAL THROW BOLT STRIKE PLATE TO FRAME AS SHOWN.

DETAIL "C"
ATTACH IMPERIAL ASTRAGAL THROW BOLT STRIKE PLATE TO FRAME AS SHOWN.

DETAIL "H"
ATTACH IMPERIAL ASTRAGAL THROW BOLT STRIKE PLATE TO THRESHOLD AS SHOWN

DETAIL "H"
ATTACH WRBOS ASTRAGAL THROW BOLT STRIKE PLATE TO THRESHOLD AS SHOWN.

NOTE: ANCHORING ASTRAGAL STRIKE PLATE SCREWS AT THE HEADER & THRESHOLD MUST BE USED TO ACHIEVE FULL ANCHORING LOAD.

DOOR PANELS NOT SHOWN FOR CLARITY OF ANCHORING LOCATIONS

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470




PRODUCT:
STANLEY OUTSWING GLAZED
11-4 x 8-0 WOODEDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
ANCHORING LAYOUTS
& DETAILS

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/11/00			



RW BUILDING CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE *January 04, 2001*
BY *Maurice Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0809.02*

DATE: 6/2/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39638
SHEET 5 OF 7

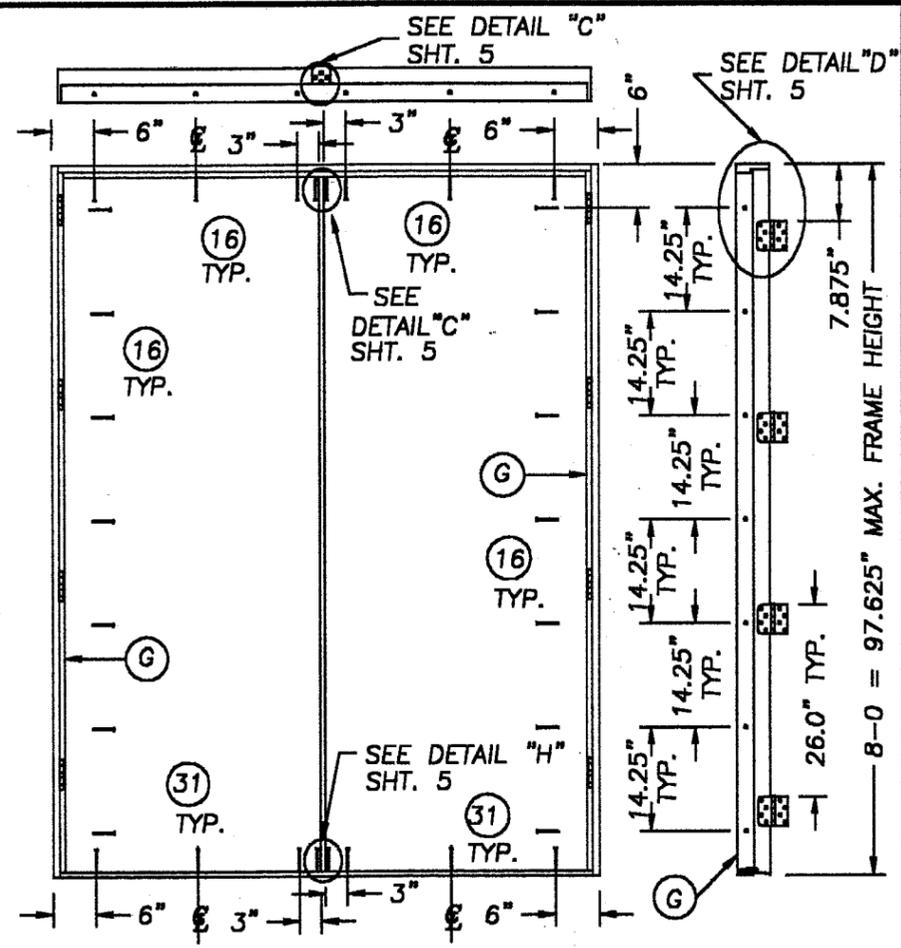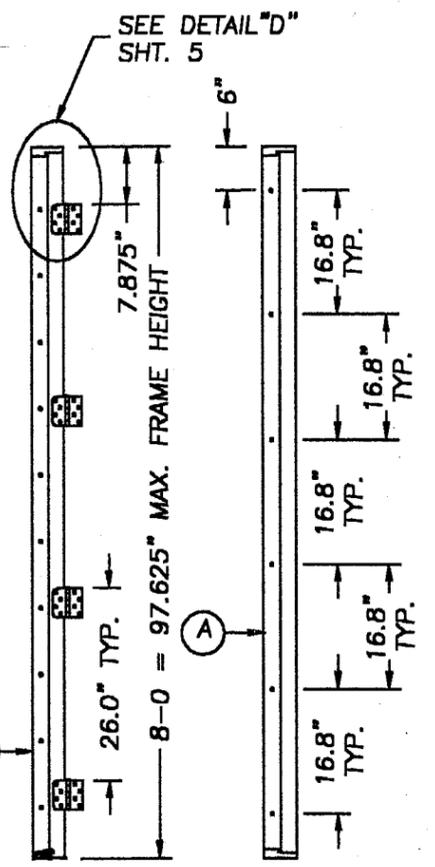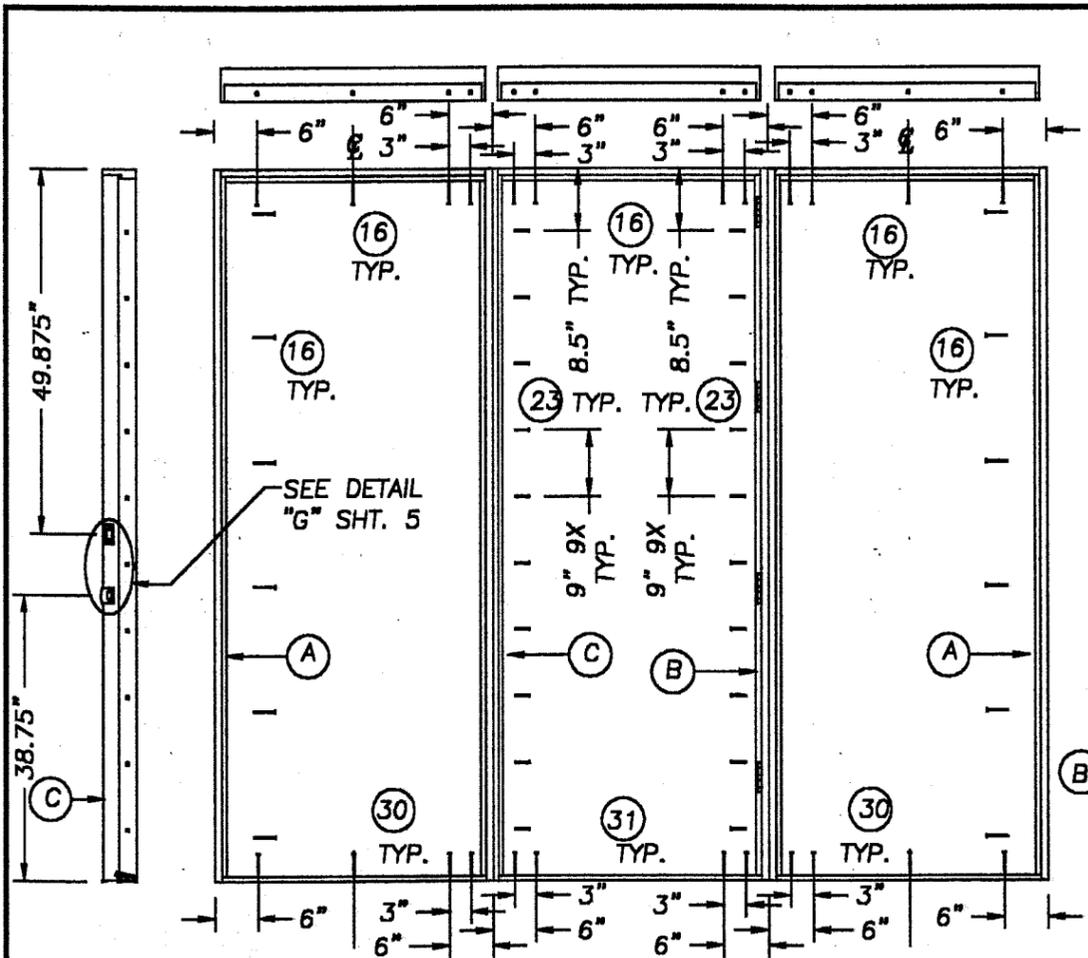

DOOR PANELS NOT SHOWN FOR CLARITY OF ANCHORING LOCATIONS

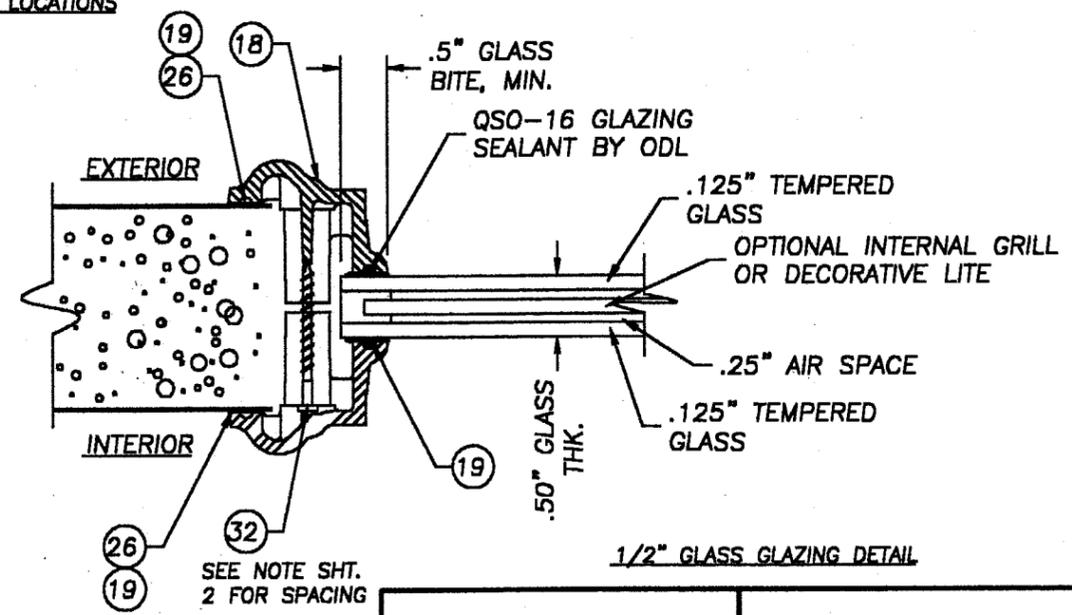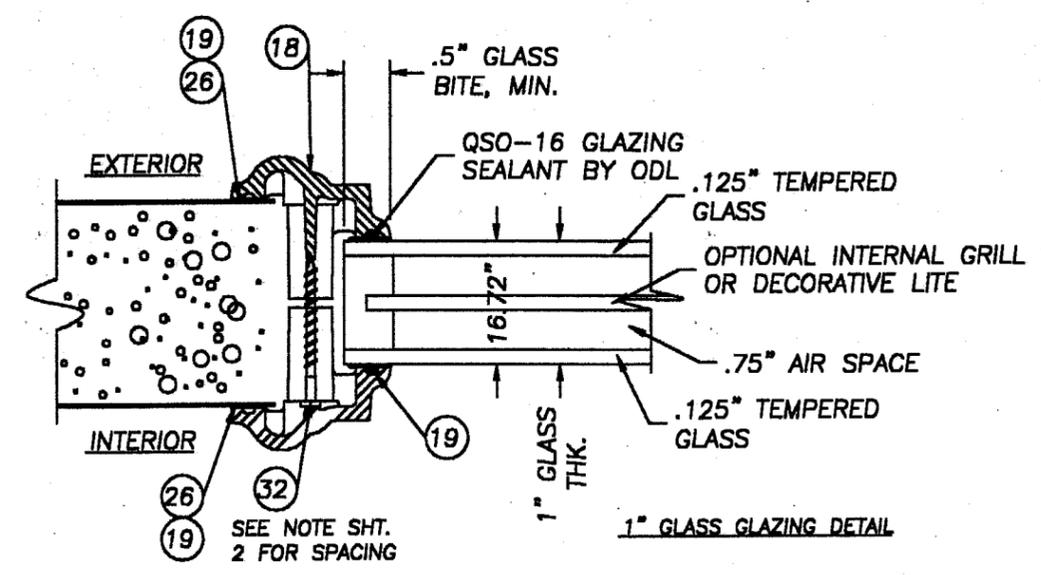

STANLEY
 STANLEY DOOR SYSTEMS
 7300 REAMES ROAD
 CHARLOTTE, NC 28216
 PH. (704) 921-3470


PRODUCT: STANLEY OUTSWING GLAZED 11-4 x 8-0 WOODEDGE DOOR W/ & W/O SIDELITES
 PART OR ASSEMBLY: ANCHORING LAYOUTS & GLAZING DETAILS

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/11/00			


RW BUILDING CONSULTANTS, INC.
 813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE *January 04, 2005*
 BY *Manuel...*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. *00-0809-02*


DATE: 6/2/00
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: 39638
 SHEET 6 OF 7

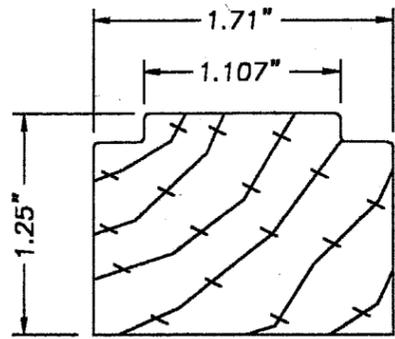


WOOD HINGE & BLANK SIDE STYLE

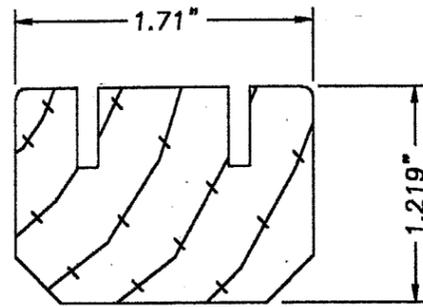


WOOD TOP STYLE

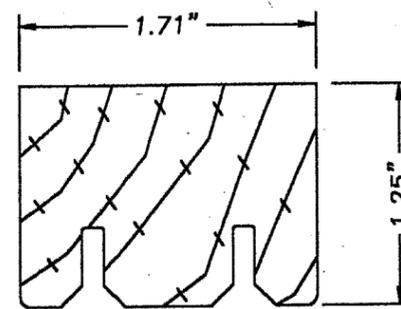


WOOD BOTTOM STYLE

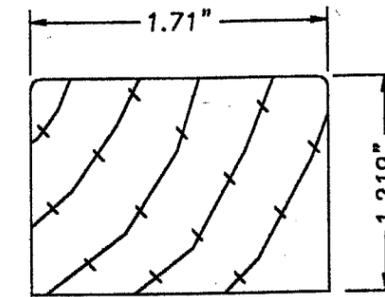


SIDELITE TOP & BOTTOM WOOD STYLE

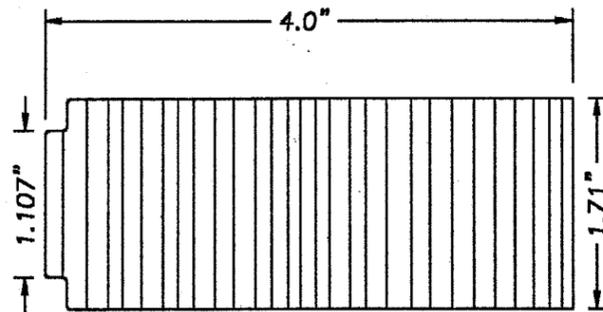


LVL LATCH STYLE

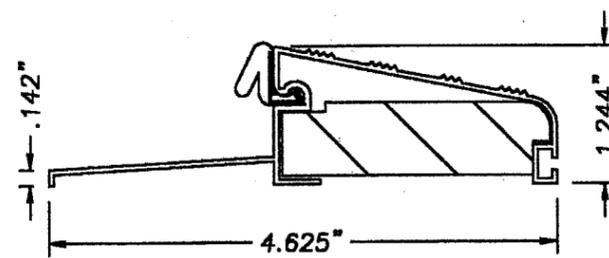


OUTSWING BUMP FACE
ALUMINUM THRESHOLD
.045" WALL THK.

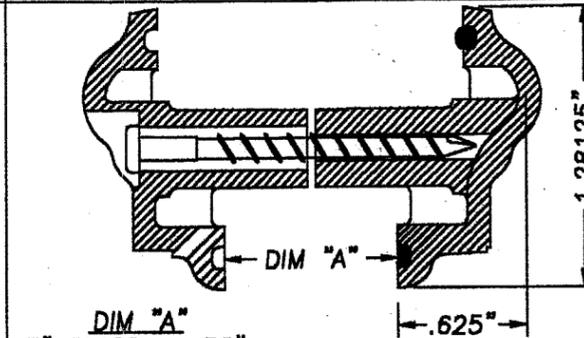

DIM "A"
.5" GLASS = .58"
1" GLASS = 1.08"
POLYPROPYLENE LIP LITE FRAME (ODL)

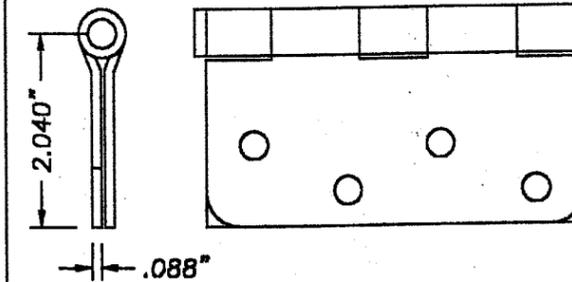


4 x 4 DOOR HINGE

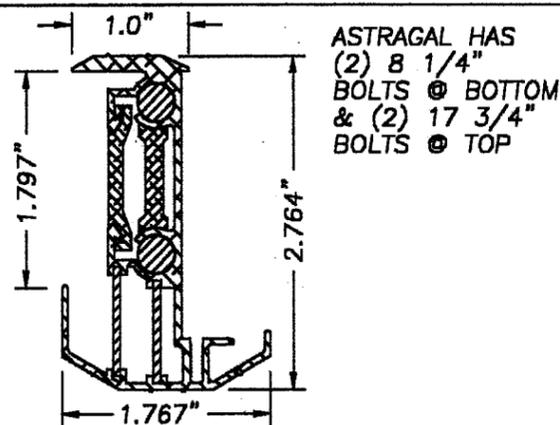


ASTRAGAL WINDJAMBER II
(WR80S) T-6063 EXTRUDED ALUMINUM


ASTRAGAL HAS
(2) 8 1/4" BOLTS @ BOTTOM
& (2) 17 3/4" BOLTS @ TOP

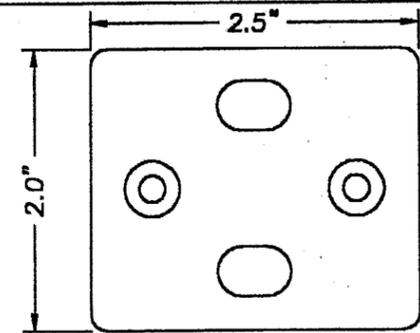


ASTRAGAL THRESHOLD STRIKE PLATE
WR80S .50" ALUM.

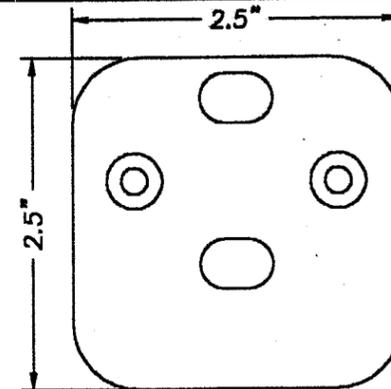


ASTRAGAL HEADER STRIKE PLATE
WR80S .066" STEEL

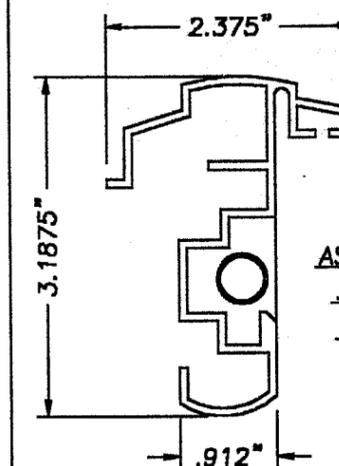

OPTIONAL
ASTRAGAL (IMPERIAL)
.075" WALL ALUM.
W/(2) 12" BOLTS

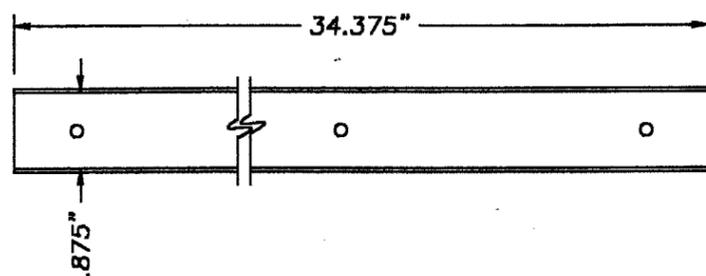

DOOR PANEL TOP & BOTTOM REIN.
.040" STEEL

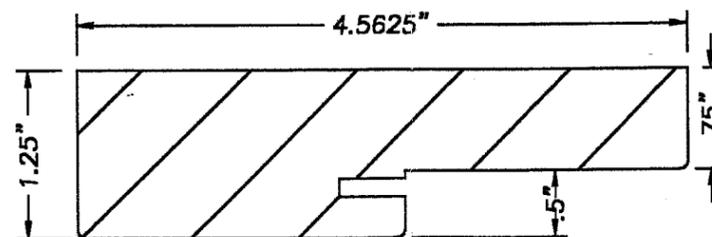

WOOD FRAME

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *January 04, 2001*
BY *Manuel*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0809.02*

DATE: 6/2/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 39638
SHEET 7 OF 7

RW BUILDING CONSULTANTS, INC.
813.684.3831

PRODUCT:		STANLEY OUTSWING GLAZED 11-4 x 8-0 WOODEDGE DOOR W/ & W/O SIDELITES	
PART OR ASSEMBLY:		COMPONENTS	
NO.	DATE	GENERAL REVISION	TJH BY
1	12/11/00		
REVISIONS			

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470