



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Naturalite Skylight Systems
803 Airport Road
Terrell, TX 75088

Your application for Notice of Acceptance (NOA) of:

Hurricane Resistant Skylights

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-0915.03
EXPIRES: 03/22/2004

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 03/22/2001

Naturalite Skylight Systems.

ACCEPTANCE NO: 00-0915.03

APPROVED: MAR 22 2001

EXPIRES: MAR 22 2004

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. **SCOPE**

1.1 This approves a Curb Mount Skylight and a Self Flashing Skylight as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County. For the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. **PRODUCT DESCRIPTION**

2.1 The **Naturalite Curb Mount Skylight and the Self Flashing Skylight** and its components shall be constructed in strict compliance with the following documents: Drawing No. HRDADE, sheets 1 through 8 of 8, titled "Hurricane Resistant Skylight", prepared by Naturalite Skylight Systems, dated 07/06/00, with last revision on 02/12/01. It bears the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. **LIMITATIONS**

3.1 All permanent set components and fasteners must be protected against corrosion, contamination and damage at all times.

4. **INSTALLATION**

4.1 This Curb Mount Aluminum Skylight must be installed in strict compliance with the approved drawings.

4.2 The installation of this product **will not** require a hurricane protection system.

5. **LABELING**

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved". The plastic shall be marked according to the requirements of Notice of Acceptance # 00-0508.14

BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as indicated in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.




Candido F. Font P.E. – Senior Product Control Examiner
Product Control Division

NOTICE OF ACCEPTANCE : STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer, who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process;
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Acceptance consists of pages 1, 2, and this last page 3.

END OF THIS ACCEPTANCE

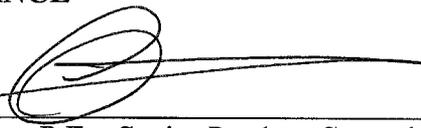

Candido F. Font, P.E.— Senior Product Control Examiner
Product Control Division

Naturalite Skylight Systems.

ACCEPTANCE NO: 00-0915.03

APPROVED: MAR 22 2001

EXPIRES: MAR 22 2004

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED
(For file ONLY. Not part of NOA)

A. DRAWINGS

1. Drawing No. HRDADE, sheets 1 through 8 of 8, titled "Hurricane Resistant Skylight", prepared by Naturalite Skylight Systems, dated 07/06/00, with latest revision on 02/12/01, signed and sealed by D. S. Barron, P.E.

B. TESTS

1. Test report on Large Missile Impact Test and Cyclic Load Test on "Naturalite HRA (Specimen 2), HRLDD (Specimen 5), HRL (Specimen 4) & HRADD (Specimen 1) Skylight", prepared by Hurricane Test Laboratory, Inc., report No. 0142-0617-00 issued on 06/26&2700, signed and sealed by V. J. Abraham, P.E.
2. Test report on Uniform Static Air Pressure Test on "Naturalite HRL (Specimens 6) & HRADD (Specimen 3) skylight", prepared by Hurricane Test Laboratory, Inc., report No. 0142-0617-00, issued on 06/27/00, signed and sealed by V. J. Abraham, PE.

B. CALCULATIONS

1. Anchor Calculation, sheets 1 through 15, prepared by D. S. Barron, signed and sealed by D. S. Barron, PE.

D. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. 98-1110.01, issued to Rmax, Inc, on 07/08/99, expiring on 07/08/2002.
2. Notice of Acceptance No. 00-0508.14, issue to Plaskolite, Inc., on 07/13/00, expiring on 06/26/2003.

E. STATEMENTS

1. Test compliance letter issue by Hurricane Test Laboratory, Inc, on 08/10/00, signed and sealed by V. J. Abraham, PE.
2. Letter of No-Financial interest issue by Barron Consulting Engineering, on 08/17/00, signed by D. S. Barron, PE and notarized by J. A. Soles on 08/17/00.
3. Letter of Code Compliance issue by Barron Consulting Engineering, on 02/15/01, signed and sealed by D. S. Barron, PE.


Candido F. Font, P.E.— Senior Product Control Examiner
Product Control Division


HURRICANE RESISTANT SKYLIGHTS FOR DADE COUNTY, FLORIDA

HRL - CURB MOUNT - SINGLE DOME

HRLDD - CURB MOUNT - DOUBLE DOME

HRA - SELF FLASHING - SINGLE DOME

HRADD - SELF FLASHING - DOUBLE DOME

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **MAR 22 2001**
BY 
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. **00-0915.03**

David S. Baum
2-15-01

DATE: 7-6-00		
DRAWN BY: REH		
DRAWING NO.: HRDADE	REVISIONS	DATE

HR HURRICANE RESISTANT SKYLIGHT



NATURALITE
SKYLIGHT SYSTEMS
750 AIRPORT ROAD • TERRELL, TX 75160 • 972-551-6400

SHEET: 1
OF: 8

STOCK NUMBER	OUTSIDE CURB DIMENSIONS	STOCK NUMBER	OUTSIDE CURB DIMENSIONS
SQUARE		RECTANGULAR	
HRL 2424	22" X 22"	HRL 2052	17 1/4" X 49 1/4"
HRL 2828	25 1/4" X 25 1/4"	HRL 2852	25 1/4" X 49 1/4"
HRL 3636	33 1/4" X 33 1/4"	HRL 3296	28 1/2" X 92 1/2"
HRL 4242	40" X 40"	HRL 3652	33 1/4" X 49 1/4"
HRL 5252	49 1/4" X 49 1/4"	HRL 3676	33 1/4" X 72 1/2"
HRL 4848	51" X 51"	HRL 4280	40" X 78"
DESIGN PRESSURES +40 -60 LARGE MISSILE IMPACT		HRL 4365	41" X 62"
		HRL 5276	49 1/4" X 72 1/2"
		HRL 5296	49 1/4" X 92 1/2"
		HRL 4896	51" X 99" ← TESTED SIZE

Ⓐ GENERAL NOTES

- 1) ALL ROOFING DETAILS SHALL COMPLY WITH CHAPTER 34 OF THE SOUTH FLORIDA BUILDING CODE.
- 2) 4" MINIMUM DISTANCE IS REQUIRED FROM ANGLE OR CURB ENDS TO ROOF SURFACE FOR SINGLE OR BUR WITHOUT INSULATION. FOR INSULATION AND ROOF TILE ADD TILE HEIGHT AND INSULATION THICKNESS TO THE 4" MINIMUM DISTANCE.

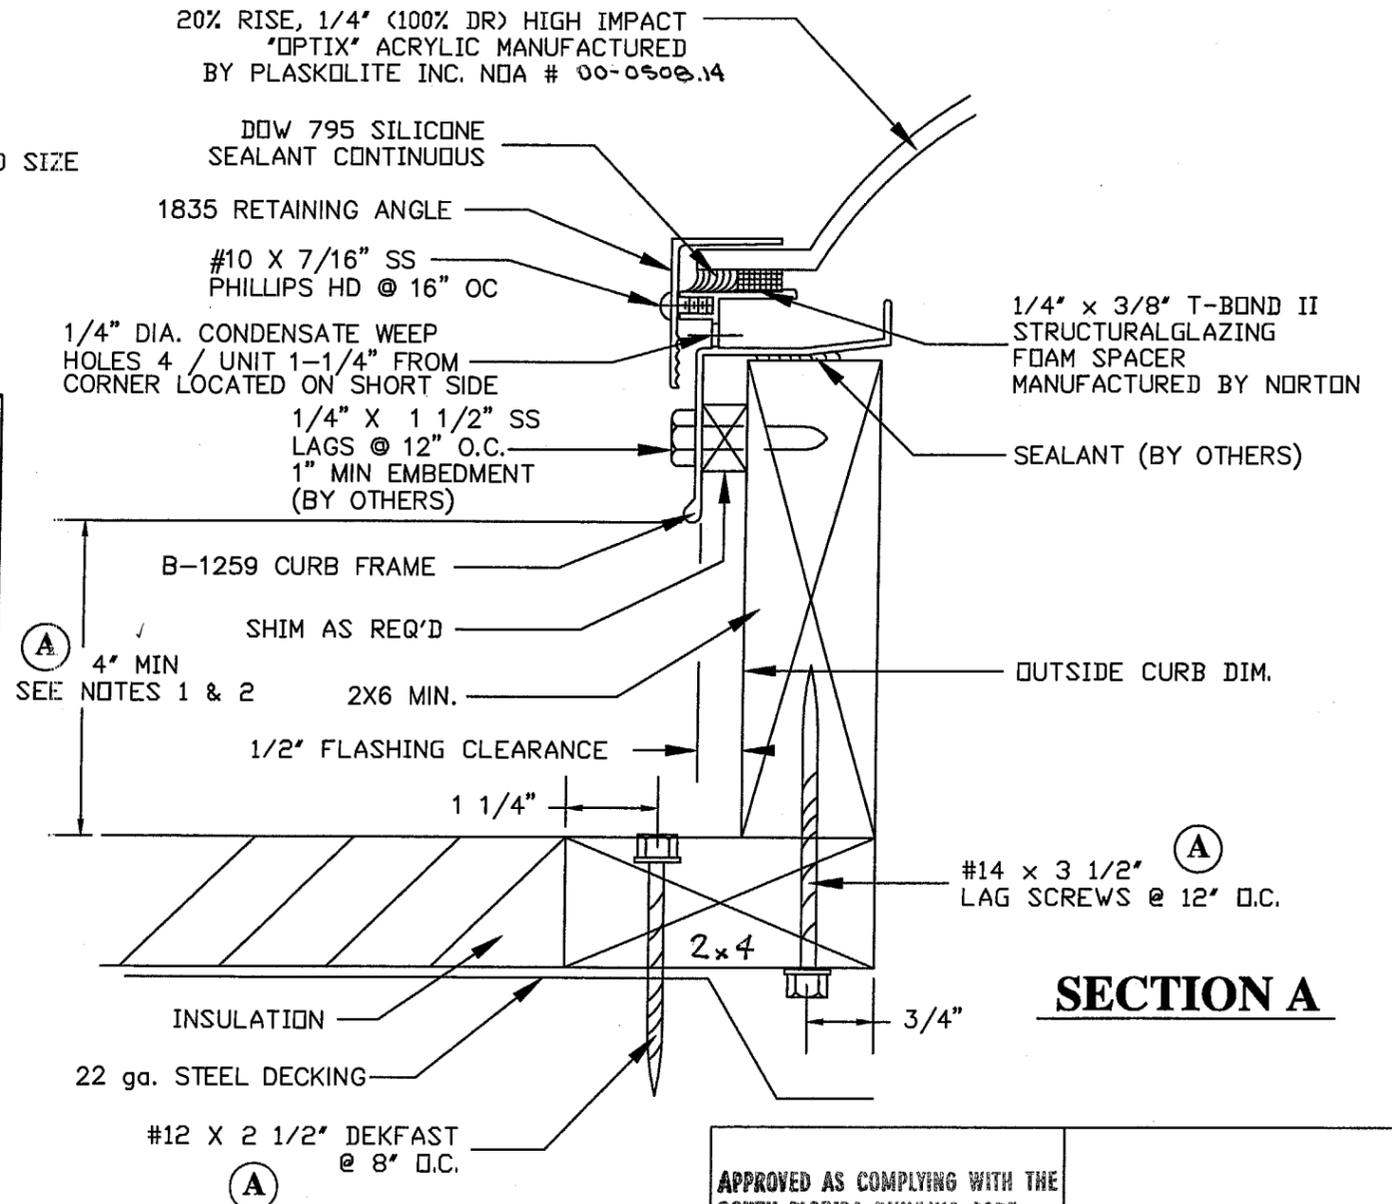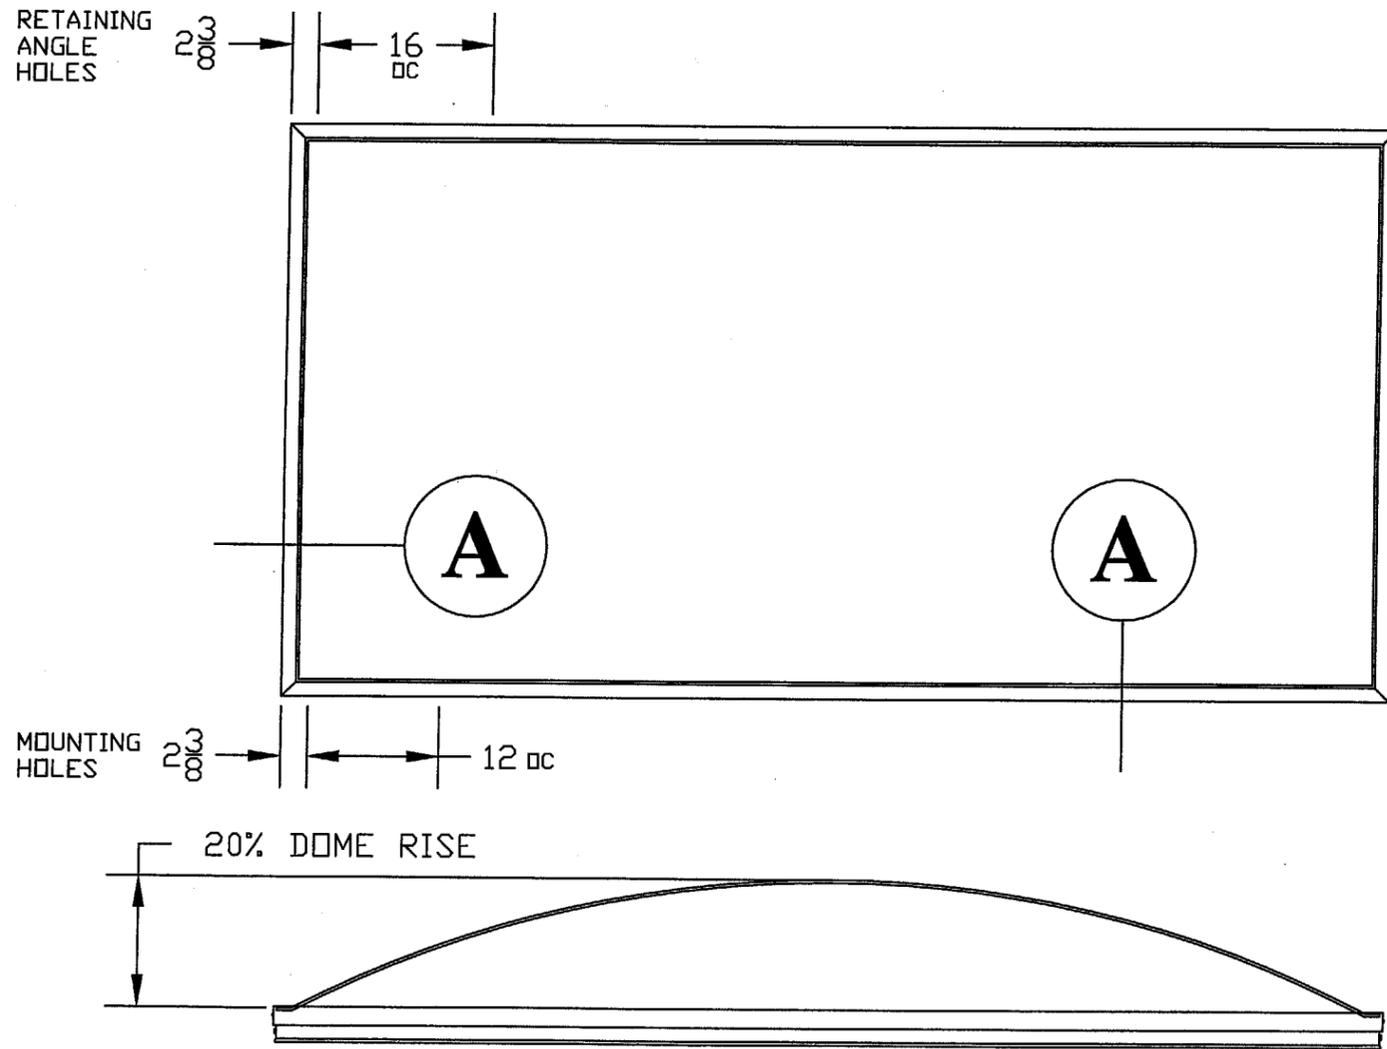

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE **MAR 22 2001**
BY *[Signature]*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0915.03

James B. Brown
215-01

DATE: 7-6-00		
DRAWN BY: REH	A	ADDED NOTES & DECK ATTACHMENT 2-12-01
DRAWING NO.: HRDADE	REVISIONS	DATE

HR HURRICANE RESISTANT SKYLIGHT

NATURALITE
SKYLIGHT SYSTEMS
750 AIRPORT ROAD • TERRELL, TX 75160 • 972-551-6400

SHEET: 2
OF: 8



STOCK NUMBER	OUTSIDE CURB DIMENSIONS	STOCK NUMBER	OUTSIDE CURB DIMENSIONS
SQUARE		RECTANGULAR	
HRLDD2424	22" X 22"	HRLDD2052	17 1/4" X 49 1/4"
HRLDD2828	25 1/4" X 25 1/4"	HRLDD2852	25 1/4" X 49 1/4"
HRLDD3636	33 1/4" X 33 1/4"	HRLDD3296	28 1/2" X 92 1/2"
HRLDD4242	40" X 40"	HRLDD3652	33 1/4" X 49 1/4"
HRLDD5252	49 1/4" X 49 1/4"	HRLDD3676	33 1/4" X 72 1/2"
HRLDD4848	51" X 51"	HRLDD4280	40" X 78"
DESIGN PRESSURES +40 -60 LARGE MISSILE IMPACT		HRLDD4365	41" X 62"
		HRLDD5276	49 1/4" X 72 1/2"
		HRLDD5296	49 1/4" X 92 1/2"
		HRLDD4896	51" X 99"

20% RISE 1/4" (100% DR) HIGH IMPACT "OPTIX" ACRYLIC MANUFACTURED BY PLASKOLITE INC. NDA # 00-0508.14


1/8" (100% DR) HIGH IMPACT "OPTIX" ACRYLIC MANUFACTURED BY PLASKOLITE INC. NDA # 00-0508.14

GENERAL NOTES

- 1) ALL ROOFING DETAILS SHALL COMPLY WITH CHAPTER 34 OF THE SOUTH FLORIDA BUILDING CODE.
- 2) 4" MINIMUM DISTANCE IS REQUIRED FROM ANGLE OR CURB ENDS TO ROOF SURFACE FOR SINGLE OR BUR WITHOUT INSULATION. FOR INSULATION AND ROOF TILE ADD TILE HEIGHT AND INSULATION THICKNESS TO THE 4" MINIMUM DISTANCE.

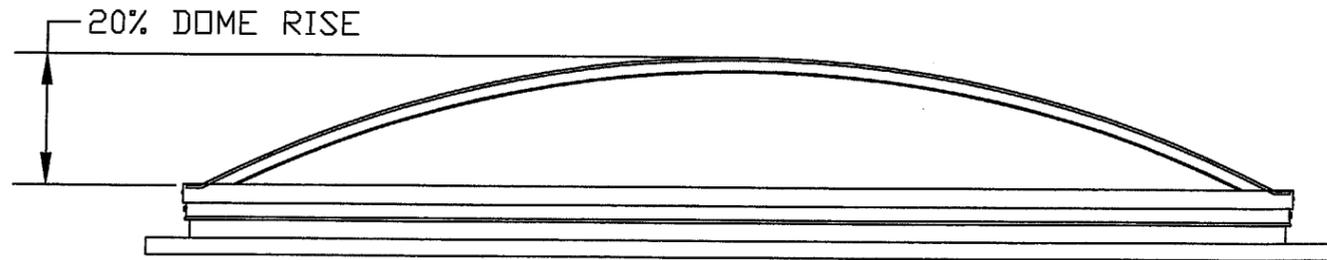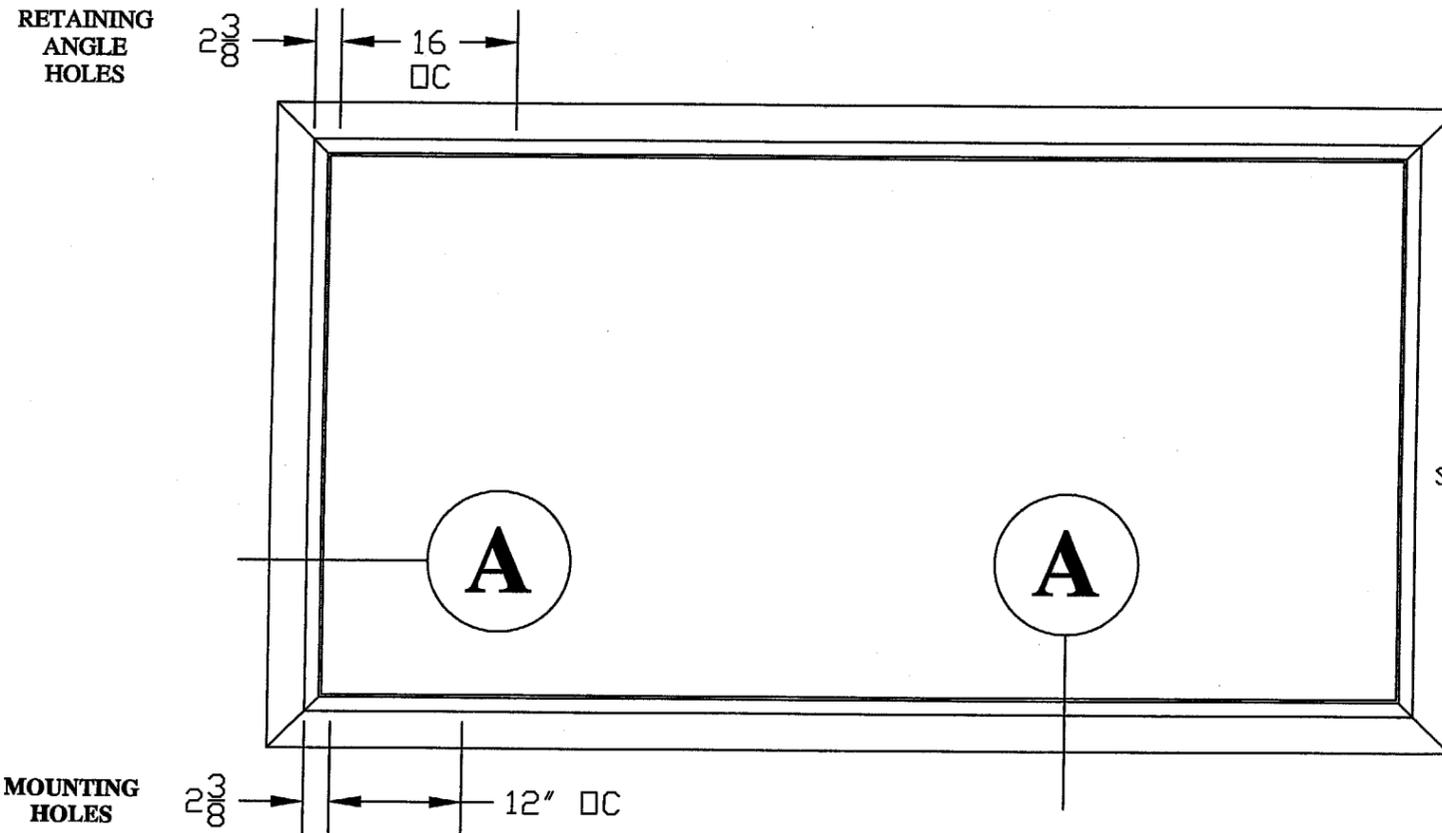

HRLDD

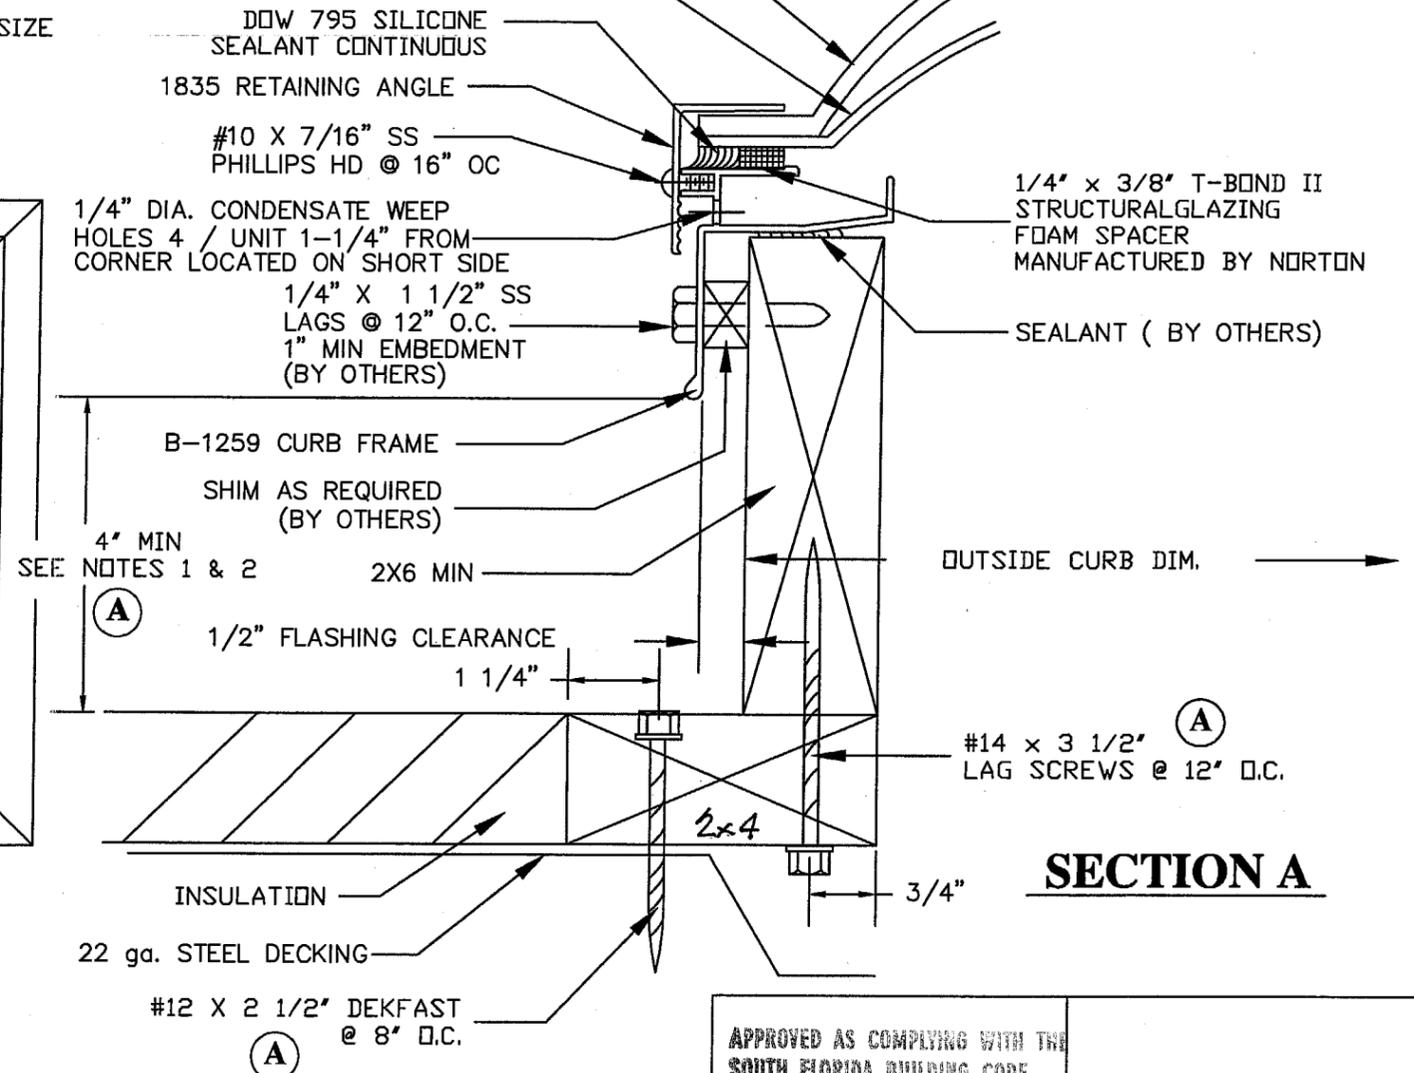

SECTION A

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE **MAR 22 2001**
BY *[Signature]*
PRODUCT CONTROL OFFICE
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0915.03

David S. Baum
2-15-01

DATE: 7-6-00			
DRAWN BY: REH	A	ADDED NOTES & DECK ATTACHMENT	2-12-01
DRAWING NO.: HRDAE		REVISIONS	DATE

HR HURRICANE RESISTANT SKYLIGHT

NATURALITE
SKYLIGHT SYSTEMS
750 AIRPORT ROAD • TERRELL, TX 75160 • 972-551-6400



SHEET: 3
OF: 8

STOCK NUMBER	INSIDE CURB DIMENSIONS	STOCK NUMBER	INSIDE CURB DIMENSIONS
SQUARE		RECTANGULAR	
HRA 2424	19" X 19"	HRA 2052	14 1/4" X 46 1/4"
HRA 2828	22 1/4" X 22 1/4"	HRA 2852	22 1/4" X 46 1/4"
HRA 3636	30 1/4" X 30 1/4"	HRA 3296	25 1/2" X 89 1/2"
HRA 4242	37" X 37"	HRA 3652	30 1/4" X 46 1/4"
HRA 5252	46 1/4" X 46 1/4"	HRA 3676	30 1/4" X 69 1/2"
HRA 4848	48" X 48"	HRA 4280	37" X 75"
DESIGN PRESSURE		HRA 4365	38" X 59"
+40		HRA 5276	46 1/4" X 69 1/2"
-60		HRA 5296	46 1/4" X 89 1/2"
LARGE MISSILE IMPACT		HRA 4896	48 X 96 ← TESTED SIZE


(A) GENERAL NOTES

- 1) ALL ROOFING DETAILS SHALL COMPLY WITH CHAPTER 34 OF THE SOUTH FLORIDA BUILDING CODE.
- 2) 4" MINIMUM DISTANCE IS REQUIRED FROM ANGLE OR CURB ENDS TO ROOF SURFACE FOR SINGLE OR BUR WITHOUT INSULATION. FOR INSULATION AND ROOF TILE ADD TILE HEIGHT AND INSULATION THICKNESS TO THE 4" MINIMUM DISTANCE.

20% RISE 1/4" (100% DR) HIGH IMPACT "OPTIX" ACRYLIC MANUFACTURED BY PLASKOLITE INC. NOA # 00-0508.14

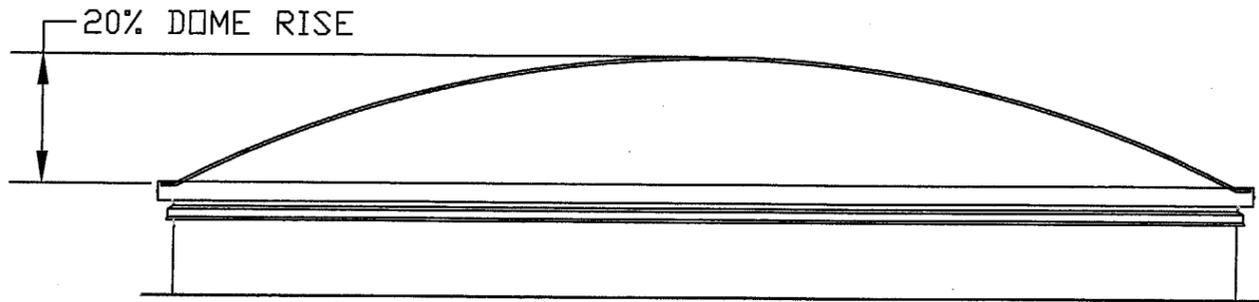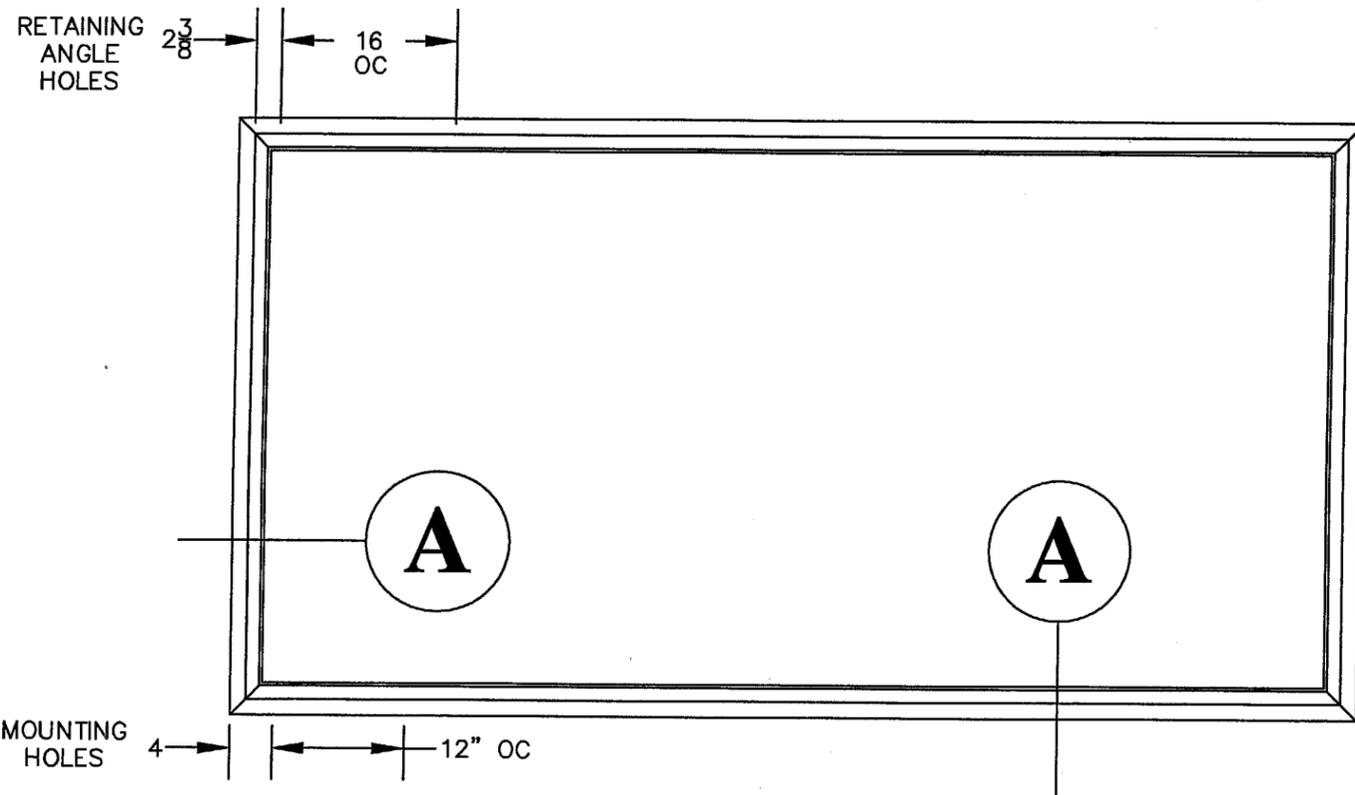

HRA

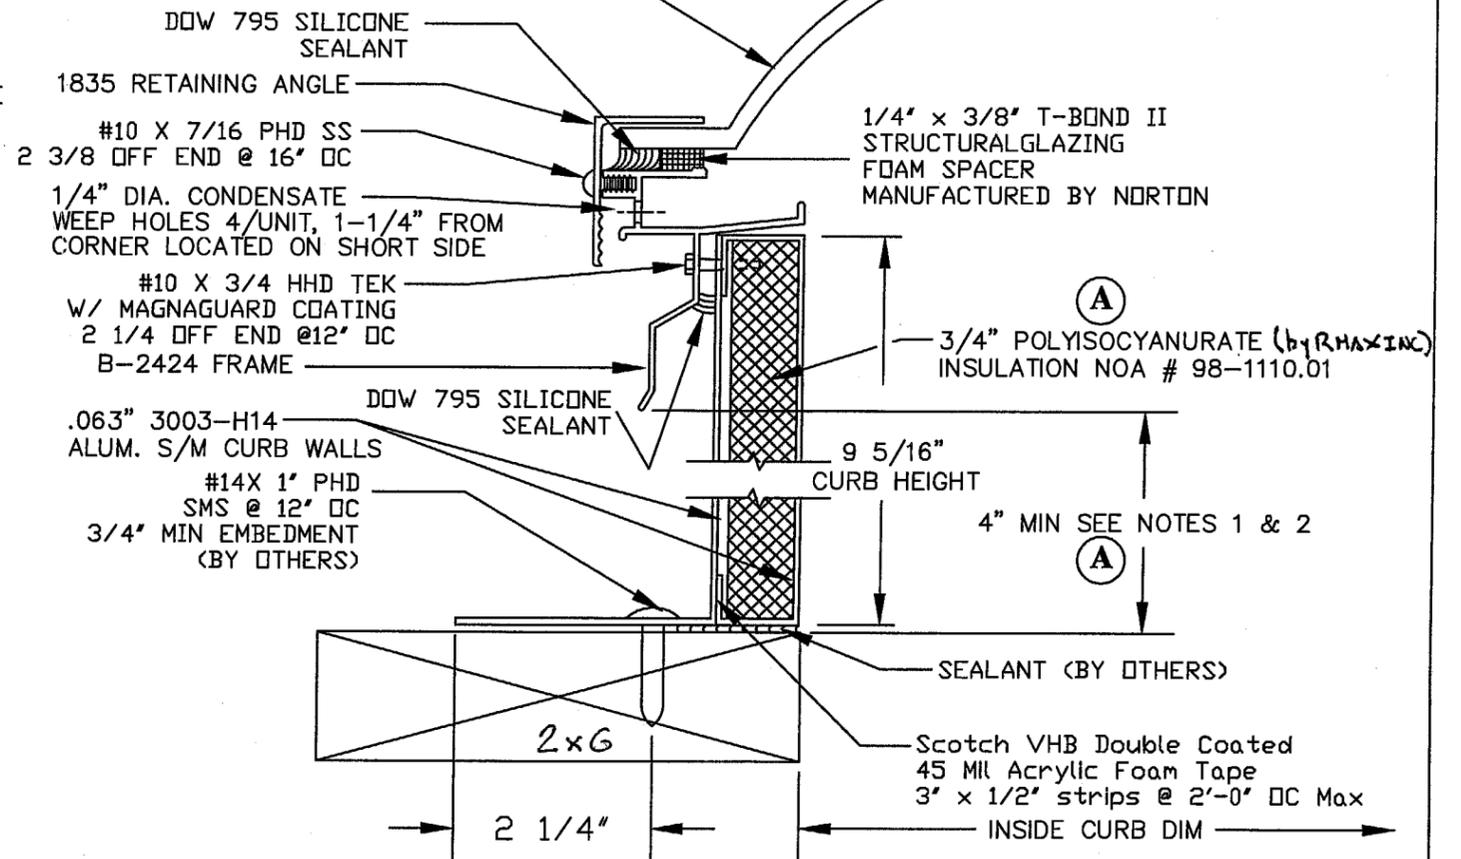

SECTION A

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE **MAR 22 2001**
 BY *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0915.03

David S. Bann
2-15-01



DATE: 7-6-00		
DRAWN BY: REH	A ADDED NOTES	2-12-01
DRAWING NO.: HRDADE	REVISIONS	DATE

HR HURRICANE RESISTANT SKYLIGHT

NATURALITE
SKYLIGHT SYSTEMS
750 AIRPORT ROAD • TERRELL, TX 75160 • 972-551-6400

SHEET: 4
OF: 8

STOCK NUMBER	INSIDE CURB DIMENSIONS		STOCK NUMBER	INSIDE CURB DIMENSIONS	
	SQUARE			RECTANGULAR	
HRADD 2424	19"	X 19"	HRADD 2052	14 1/4"	X 46 1/4"
HRADD 2828	22 1/4"	X 22 1/4"	HRADD 2852	22 1/4"	X 46 1/4"
HRADD 3636	30 1/4"	X 30 1/4"	HRADD 3296	25 1/2"	X 89 1/2"
HRADD 4242	37"	X 37"	HRADD 3652	30 1/4"	X 46 1/4"
HRADD 5252	46 1/4"	X 46 1/4"	HRADD 3676	30 1/4"	X 69 1/2"
HRADD 4848	48"	X 48"	HRADD 4280	37"	X 75"
	DESIGN PRESSURE		HRADD 4365	38"	X 59"
	+40		HRADD 5276	46 1/4"	X 69 1/2"
	-60		HRADD 5296	46 1/4"	X 89 1/2"
	LARGE MISSILE IMPACT		HRADD 4896	48"	X 96"

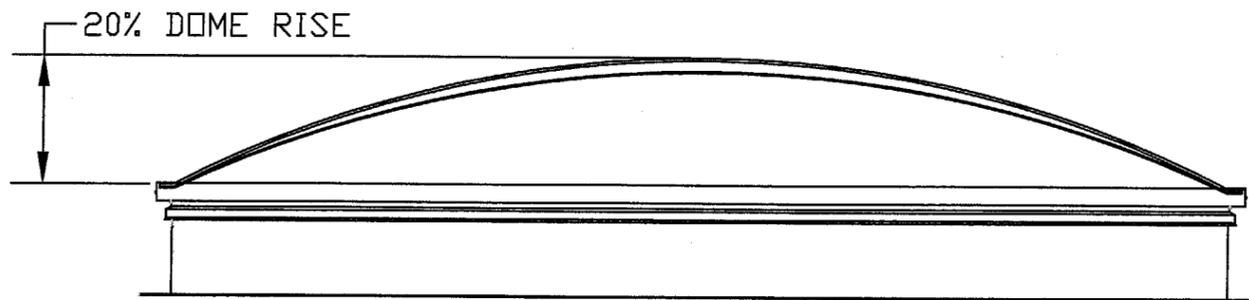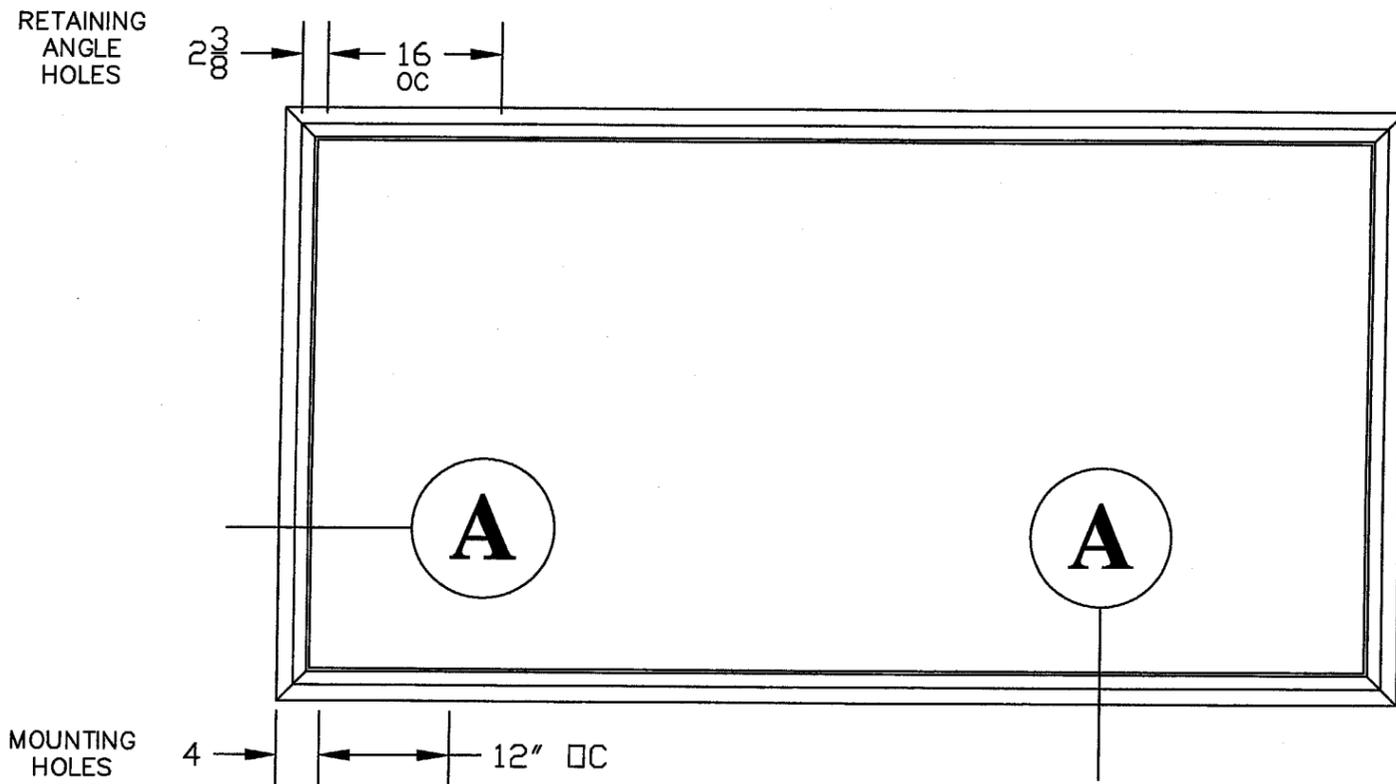

HRADD

GENERAL NOTES

- 1) ALL ROOFING DETAILS SHALL COMPLY WITH CHAPTER 34 OF THE SOUTH FLORIDA BUILDING CODE.
- 2) 4' MINIMUM DISTANCE IS REQUIRED FROM ANGLE OR CURB ENDS TO ROOF SURFACE FOR SINGLE OR BUR WITHOUT INSULATION. FOR INSULATION AND ROOF TILE ADD TILE HEIGHT AND INSULATION THICKNESS TO THE 4' MINIMUM DISTANCE.

20% RISE 1/4" (100% DR) HIGH IMPACT "OPTIX" ACRYLIC MANUFACTURED BY PLASKOLITE INC. NOA # 00-0508.14

1/8" (100% DR) HIGH IMPACT "OPTIX" ACRYLIC MANUFACTURED BY PLASKOLITE INC. NOA # 00-0508.14

DDW 795 SILICONE SEALANT

TESTED SIZE 1835 RETAINING ANGLE

#10 X 7/16 PHD SS 2 3/8 OFF END @ 16' OC

1/4" DIA. CONDENSATE WEEP HOLES 4/UNIT, 1-1/4" FROM CORNER LOCATED ON SHORT SIDE

#10 X 3/4 HHD TEK W/ MAGNAGUARD COATING 2 1/4 OFF END @ 12' OC

B-2424 FRAME

.063" 3003-H14 ALUM. S/M CURB WALLS

#14X 1" PHD SMS @ 12' OC 3/4" MIN EMBEDMENT (BY OTHERS)

1/4" x 3/8" T-BOND II STRUCTURAL GLAZING FOAM SPACER MANUFACTURED BY NORTON


3/4" POLYISOCYANURATE (by RMAX INC) INSULATION NOA # 98-1110.01

9 5/16" CURB HEIGHT

4' MIN SEE NOTES 1 & 2

SEALANT (BY OTHERS)

Scotch VHB Double Coated 45 MIL Acrylic Foam Tape 3" x 1/2" strips @ 2'-0" OC Max

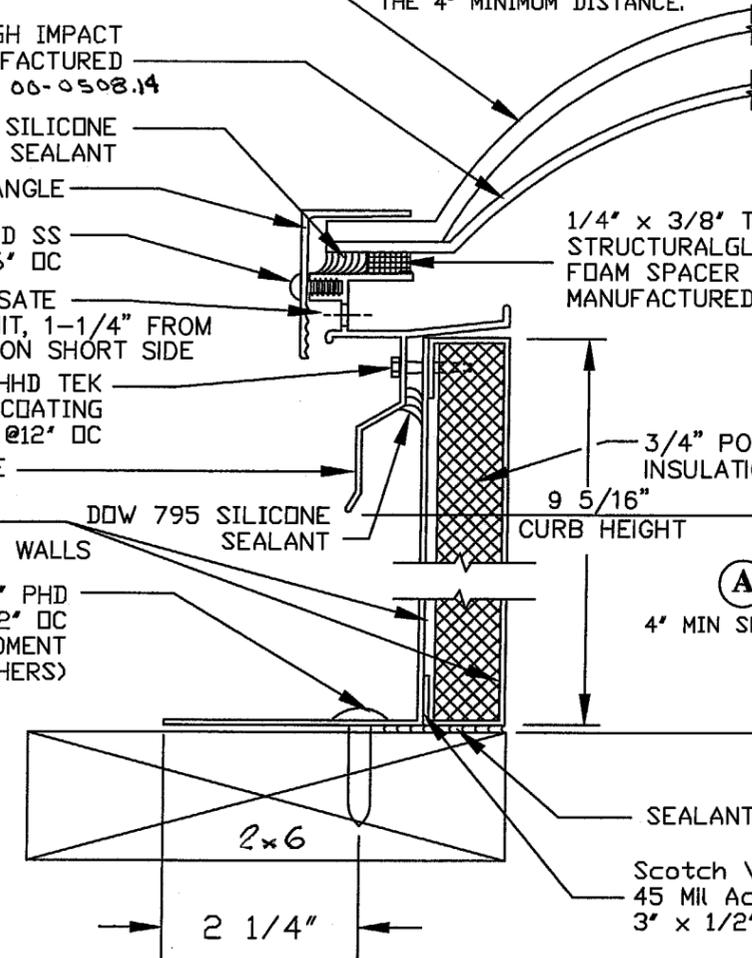

SECTION A

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE **MAR 22 2001**
 BY *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0915.03


David S. Baum
2-15-01

DATE: 7-6-00			
DRAWN BY: REH	A	ADDED NOTES	2-12-01
DRAWING NO.: HRDAE		REVISIONS	DATE


HR HURRICANE RESISTANT SKYLIGHT

NATURALITE
SKYLIGHT SYSTEMS
750 AIRPORT ROAD • TERRELL, TX 75160 • 972-551-6400


SHEET: 5
OF: 8






HRL / HRLDD CORNER WELD DETAIL




HRA / HRADD CORNER WELD DETAIL

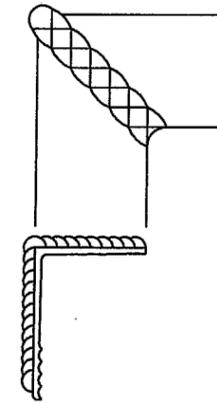


RET ANGLE CORNER WELD DETAIL

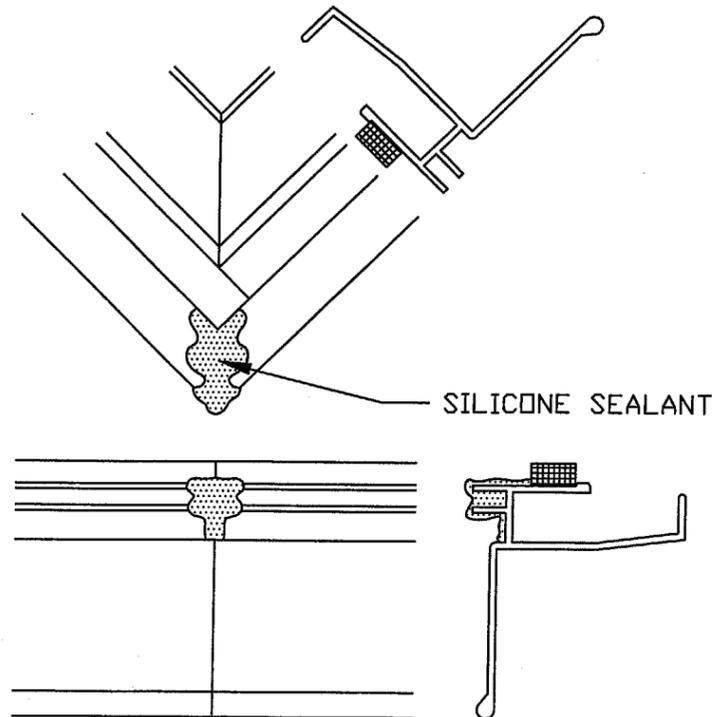

HRL / HRLDD CORNER SEALANT DETAIL

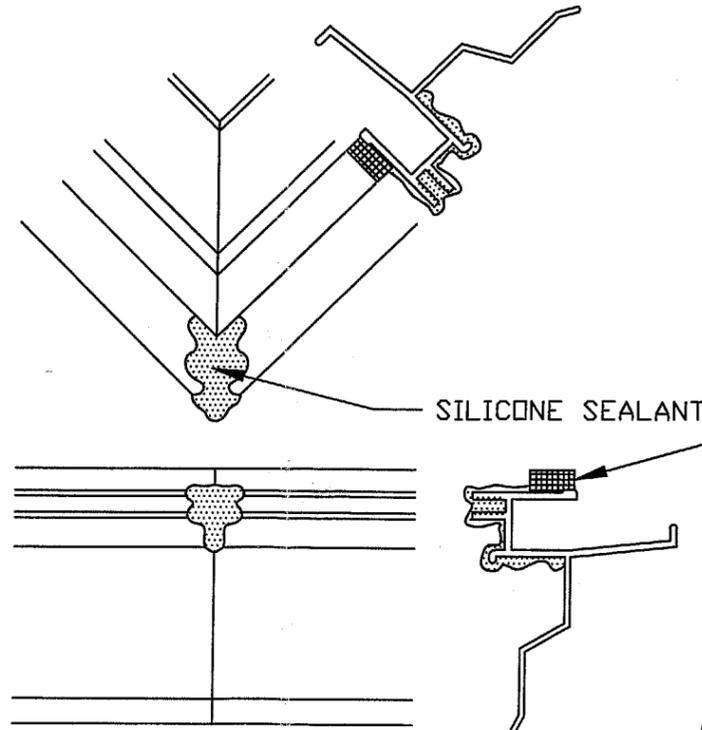

HRA / HRADD CORNER SEALANT DETAIL

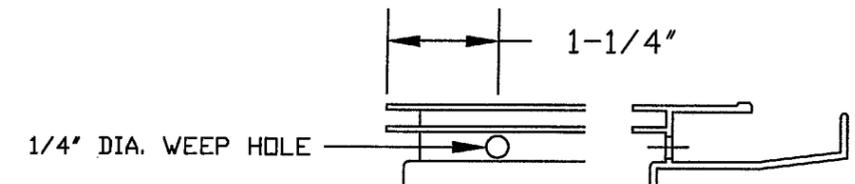

WEEP HOLE DETAIL

1/4" DIA. WEEP HOLE
 1/4" x 3/8" T-BOND II
 STRUCTURAL GLAZING
 FOAM SPACER
 MANUFACTURED BY NORTON

David Stamm
 2-15-01

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE **MAR 22 2001**
 BY *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0915.03


DATE: 7-6-00		
DRAWN BY: REH		
DRAWING NO.: HRDADE	REVISIONS	DATE

HR HURRICANE RESISTANT SKYLIGHT


NATURALITE
 SKYLIGHT SYSTEMS
 750 AIRPORT ROAD • TERRELL, TX 75160 • 972-551-6400

SHEET: 6
 OF: 8


CORNER PAD

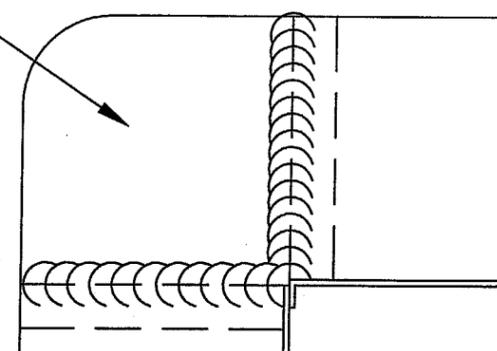


#10 X 3/4 HHD TEK
3/CORNER

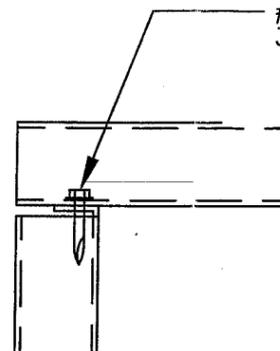

.063" 3003-H14
ALUM. S/M OUTER CURB WALLS

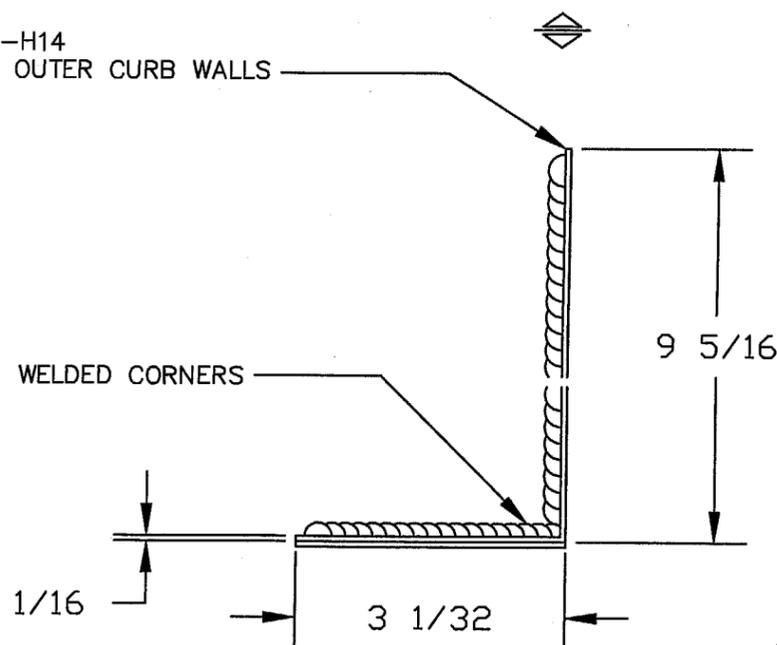

.063" 3003-H14
ALUM. S/M INNER CURB WALLS

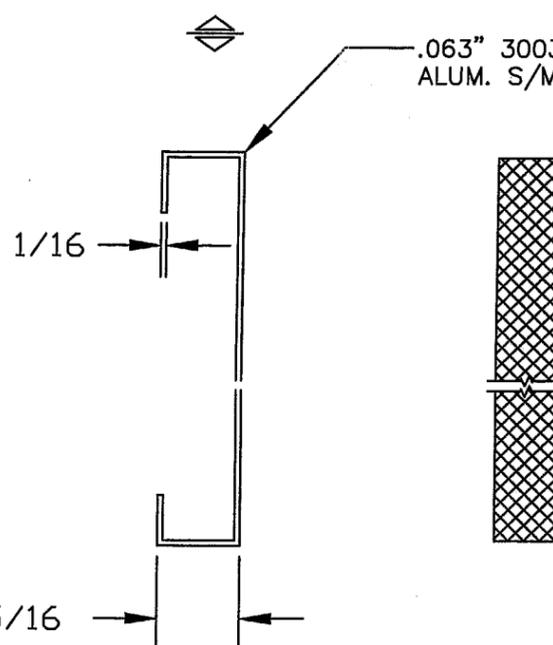


3/4" POLYISOCYANURATE
INSULATION by RMAX INC
NOA # 98-1110.01



Scotch VHB Double Coated
45 Mil Acrylic Foam Tape
3' x 1/2" strips @ 2'-0" OC Max

CURB ASSEMBLY

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **MAR 22 2001**
BY 
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. **00-0915.03**

David S. Baum
2-15-01

DATE: 7-6-00		
DRAWN BY: REH		
DRAWING NO.: HRDADE	REVISIONS	DATE


HR HURRICANE RESISTANT SKYLIGHT

NATURALITE
SKYLIGHT SYSTEMS
750 AIRPORT ROAD • TERRELL, TX 75160 • 972-551-6400


SHEET: 7
OF: 8

(A) GENERAL NOTES

- 1) ALL ROOFING DETAILS SHALL COMPLY WITH CHAPTER 34 OF THE SOUTH FLORIDA BUILDING CODE.
- 2) 4' MINIMUM DISTANCE IS REQUIRED FROM ANGLE OR CURB ENDS TO ROOF SURFACE FOR SINGLE OR BUR WITHOUT INSULATION. FOR INSULATION AND ROOF TILE ADD TILE HEIGHT AND INSULATION THICKNESS TO THE 4' MINIMUM DISTANCE.

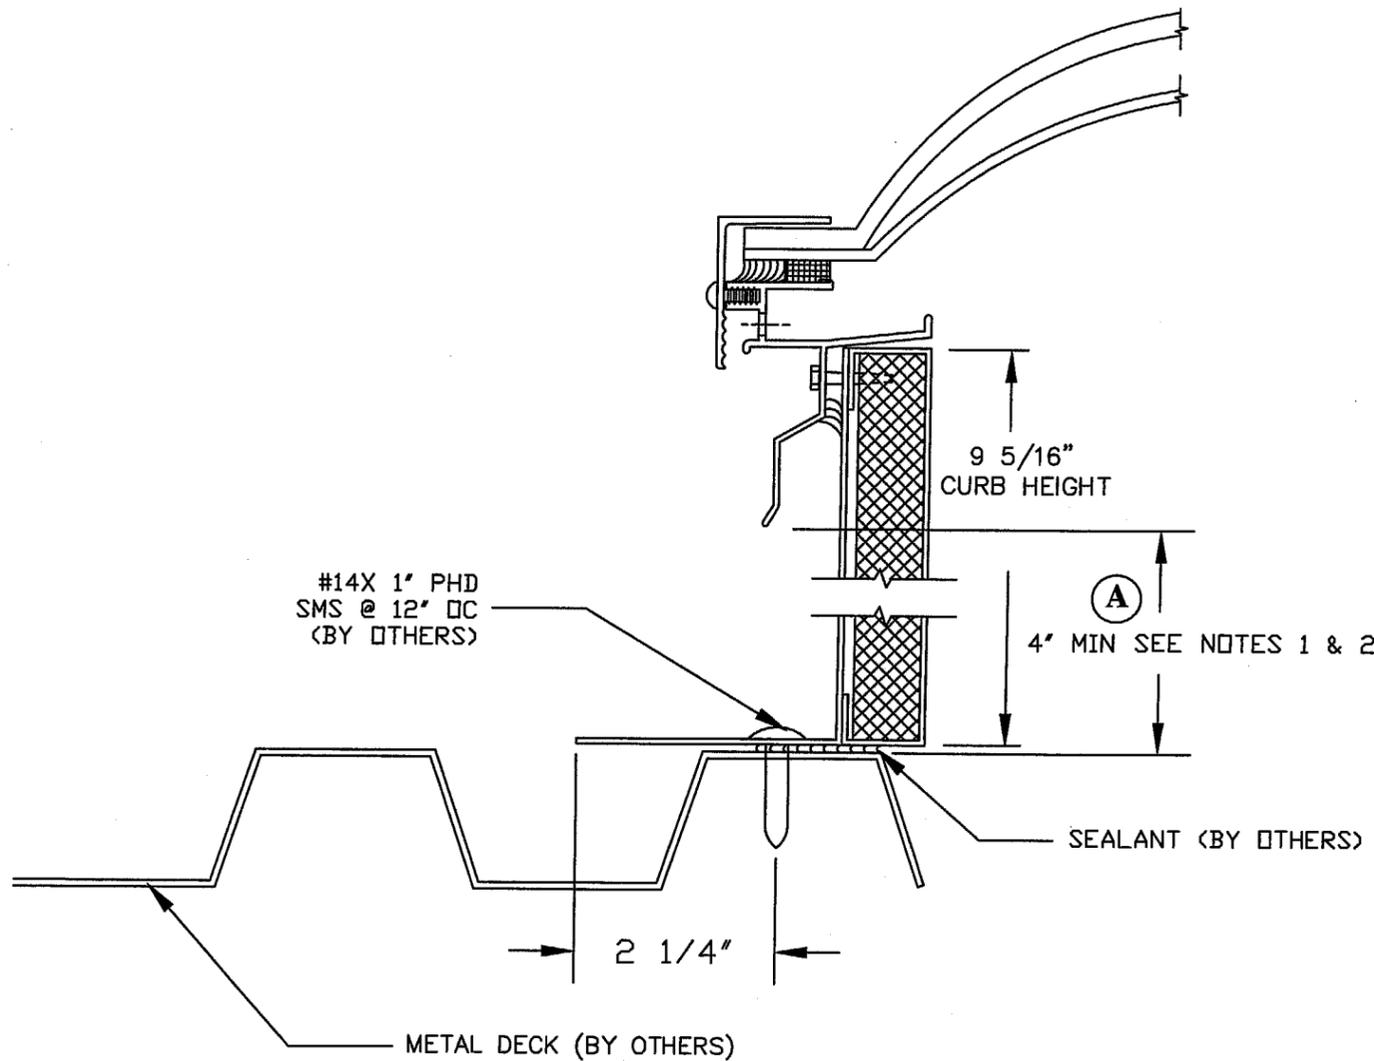

ALTERNATE ATTACHMENT
HRA / HRADD

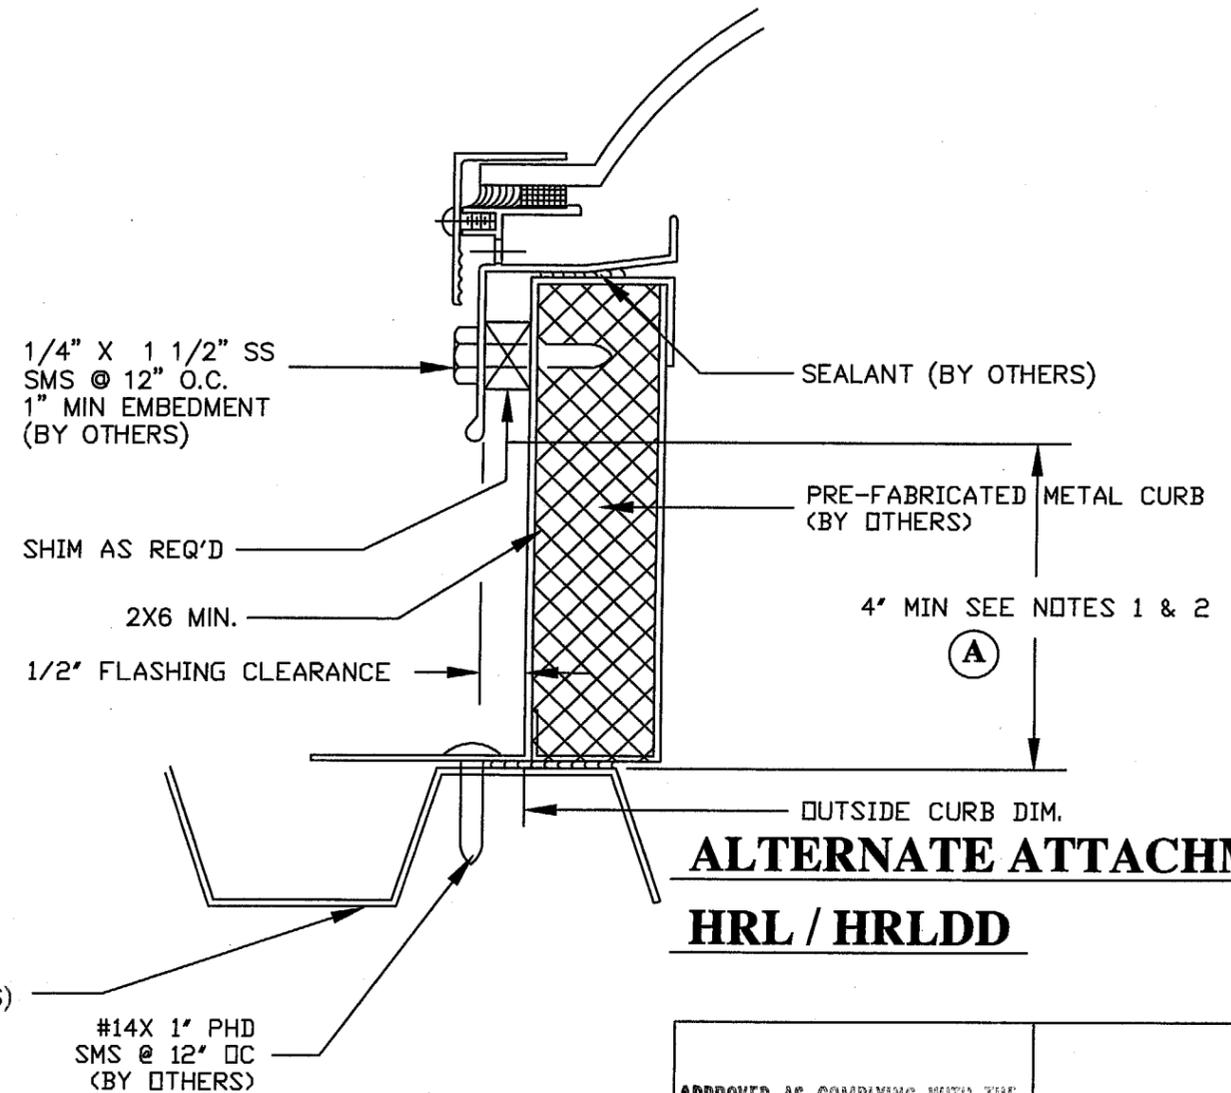

ALTERNATE ATTACHMENT
HRL / HRLDD

David Baum
2-15-01

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE **MAR 22 2001**
BY *[Signature]*
PRODUCT CONTROL OFFICE
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0915.03

DATE: 7-6-00		
DRAWN BY: REH	A	ADDED NOTES
DRAWING NO.: HRDADE		REVISIONS
		DATE
		2-12-01

HR HURRICANE RESISTANT SKYLIGHT

NATURALITE
SKYLIGHT SYSTEMS
750 AIRPORT ROAD • TERRELL, TX 75160 • 972-551-6400

SHEET: 8
OF: 8