



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Temo Incorporated
20400 Hall Road
Clinton Twp. ,MI 48038

Your application for Notice of Acceptance (NOA) of:

Screen Room with Aluminum Sandwich Roof Panel

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-0920.05
EXPIRES: 01/04/2004

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 01/04/2001

TEMO Inc.

ACCEPTANCE No. : 00-0920.05

APPROVED : 01/04/2001

EXPIRES : 01/04/2004

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

This revises and renews the Notice of Acceptance No. 96-0418.06, which was issued on April 24, 1997. It approves an aluminum screen room, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

This aluminum screen room and its components shall be constructed in strict compliance with the following documents: Drawing No. 99-179 titled "Screen Room", prepared by Knezevich & Associates, Inc., dated September 18, 2000, last revision #2 dated November 29, 2000, sheets 1 through 6 of 6, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

All permanent set components, included but not limited to embedded anchor bolts, must be protected against corrosion, contamination and damage at all times.

4. INSTALLATION

This aluminum screen room and its components shall be installed in strict compliance with the approved drawings.

5. LABELING

A permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved," shall be attached to the side of each sill and at each roof panel.


6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.



Helmy A. Makar, P.E. - Product Control Examiner
Product Control Division

TEMO Inc.

ACCEPTANCE No. : 00-0920.05


APPROVED : 01/04/2001

EXPIRES : 01/04/2004

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer, who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE



Helmy A. Makar, P.E.- Product Control Examiner
Product Control Division



SCREEN ROOM NOTES:

- THIS EXPANDED POLYSTYRENE (E.P.S.) ROOF PANEL AND SCREEN ROOM IS DESIGNED IN ACCORDANCE WITH THE SOUTH FLORIDA BUILDING CODE (S.F.B.C.), 1994 EDITION. WIND FORCES ARE IN ACCORDANCE WITH ASCE 7-88 WITH A BASIC WIND VELOCITY OF 110 M.P.H. AND 1.05 IMPORTANCE FACTOR.
- DESIGN LOADS:
ROOFS: DEAD LOAD = 1.4 P.S.F. DOWN
LIVE LOAD = 30.0 P.S.F. DOWN
ROOF WIND LOADS ARE CALCULATED IN ACCORDANCE WITH ASCE 7-88 USING THE CRITERIA FOR "BUILDINGS" IN TABLE 4 & INTERNAL PRESSURE COEFFICIENT OF ±0.25 FROM TABLE 9.

SCREEN WALLS: WIND LOAD = 21.6 P.S.F.
SCREEN WALL WIND LOADS ARE CALCULATED IN ACCORDANCE WITH TABLE 14 OF THE ASCE 7-88 WITH $C_f = 1.5$ AND $e = 0.4$.
- DEFLECTION CRITERIA FOR COLUMNS, BEAMS, AND ROOF PANELS:
L/80 FOR ROOF PROJECTIONS FROM EXISTING STRUCTURE LESS THAN OR EQUAL TO 12 FEET WHEN USED FOR RESIDENTIAL OCCUPANCY.
- DESIGN IS BASED ON CONSTRUCTION RESEARCH LAB (C.R.L.) TEST REPORT No. 6349.
- SCREEN FABRIC OPENINGS SHALL BE 60% OF THE GROSS AREA OR GREATER.
- ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY, UNLESS OTHERWISE NOTED. SHAPES OF ALUMINUM STRUCTURAL MEMBERS SHALL BE AS SHOWN ON THIS DRAWING WITH WALL THICKNESS AS SPECIFIED. EXTRUSIONS THICKNESSES MAY HAVE A TOLERANCE OF +0.0066", UNLESS SPECIFIED AS A MINIMUM.
- ALL BOLTS AND SCREWS SHALL BE 2024-T4 ALUMINUM ALLOY, ELECTRO-GALVANIZED STEEL, HOT DIPPED GALVANIZED STEEL OR STAINLESS STEEL.
- ALL CONCRETE ANCHORS SHALL BE AS SPECIFIED ON DRAWINGS. EMBEDMENT LENGTHS NOTED ON DRAWING SHALL NOT INCLUDE STUCCO OR FINISH MATERIAL.
- CONCRETE TO DEVELOP A MINIMUM COMPRESSIVE STRENGTH OF 3000 P.S.I. AFTER 28 DAYS. CONCRETE MIXTURE & PLACEMENT TO COMPLY WITH THE PROVISIONS OF THE A.C.I.
- REINFORCING STEEL SHALL BE ASTM A-615 GRADE 60, WELDED WIRE FABRIC SHALL COMPLY WITH ASTM A-185.
- ADEQUACY OF EXISTING STRUCTURE SHALL BE VERIFIED BY A REGISTERED PROFESSIONAL ENGINEER PRIOR TO ATTACHMENT OF NEW SCREEN ROOM STRUCTURE.
- MINIMUM SOIL BEARING PRESSURE SHALL BE 2000 P.S.F.
- ALUMINUM MEMBERS IN CONTACT WITH CONCRETE AND WOOD SHALL BE PROTECTED BY "KOPPERS BITUMINOUS PAINT" OR EQUIVALENT ACCORDING TO S.F.B.C., SECTION 3004.4 (d) AND (e). WHEN IN CONTACT WITH PRESSURE TREATED WOOD TO BE IN ACCORDANCE WITH S.F.B.C., SECTION 3004.4 (f).
- THIS SCREEN ROOM CAN NOT BE BUILT AS AN ADDITION TO A MOBILE HOME.
- SCREEN ROOM UNIT SHALL BE LESS THAN 15 FT. HIGH ABOVE GROUND LEVEL.

E.P.S. ROOF PANEL SPECIFICATIONS:

- PANELS SHALL BE COMPOSITE SANDWICH PANELS COMPRISED OF ALUMINUM FACINGS WITH EXPANDED POLYSTYRENE FOAM PLASTIC CORES.
- PANEL FACINGS SHALL BE 0.032" THICK ALUMINUM ALLOY 3105-H24.
- PANEL CORE SHALL BE EXPANDED POLYSTYRENE WITH THE NOMINAL DENSITY OF 2.0 P.C.F.
- ADHESIVE SHALL BE ASHLAND CHEMICAL 30300, APPLIED THE BOTH SIDES OF THE CORE MATERIAL.

SCREEN ROOM WITH GLASS WIND BREAKERS:

- THIS SCREEN ROOM IS DESIGNED IN ACCORDANCE WITH THE SOUTH FLORIDA BUILDING CODE (S.F.B.C.), 1994 EDITION. WIND FORCES ARE IN ACCORDANCE WITH ASCE 7-88 WITH A BASIC WIND VELOCITY OF 75 M.P.H. AND AN IMPORTANCE FACTOR OF 1.05. STRUCTURE WITHOUT WIND BREAKERS IS DESIGNED IN ACCORDANCE WITH NOTE No. 1 OF THE "SCREEN ROOM NOTES".
- WIND BREAK PANELS ARE DESIGNED TO BE REMOVED DURING PERIODS OF HIGH WIND VELOCITY. WIND BREAK PANELS SHALL BE REMOVED DURING SUCH PERIODS OF TIME AS ARE DESIGNATED BY THE UNITED STATES WEATHER BUREAU AS BEING A HURRICANE WARNING OR ALERT.
- WIND BREAK PANELS SHALL BE GLAZED WITH 1/8" TEMPERED GLASS.
- DESIGN OF WIND BREAK PANELS IS BASED ON CONSTRUCTION TESTING CORPORATION (C.T.C.) TEST REPORT No. 00-021.

KNEZEVICH & ASSOCIATES, INC.
CONSULTING ENGINEERS • PRODUCT TESTING
1260 N. UNIVERSITY DRIVE, SUITE 180 • FORT LAUDERDALE, FL 33322
TEL: (954) 382-2800 • FAX: (954) 382-2888 • FLORIDA CCA #3205
WEBSITE: WWW.KNEZEVICH.COM • E-MAIL: KA@KNEZEVICH.COM
COPYRIGHT © 2000 KNEZEVICH & ASSOCIATES, INC.

SCREEN ROOM
TEMO Inc.
20400 Hall Road
Clinton Twp., Michigan 48038
Tel: (800) 344-TEMO
Fax: (610) 286-5409

REVISIONS	
no	date
1	09/18/00 ZS
2	11/29/00 ZS

V.J. KNEZEVICH
PROFESSIONAL ENGINEER
FL License No: PE 0010983

NOV 29 2000

date 09/13/00


scale AS NOTED drawn by MC

design by ZS checked by VJK


drawing no. 99-179

sheet 1 of 6


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE 01/04/2001
BY *Helmut A. Mader*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0920-05

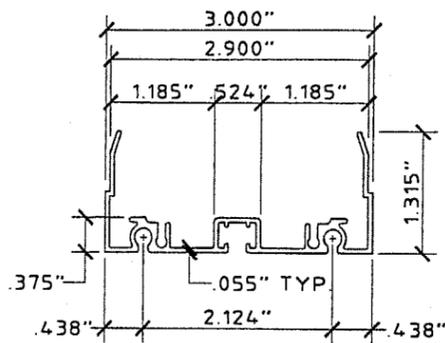


1 3" MALE GROOVE
SCALE: HALF SIZE

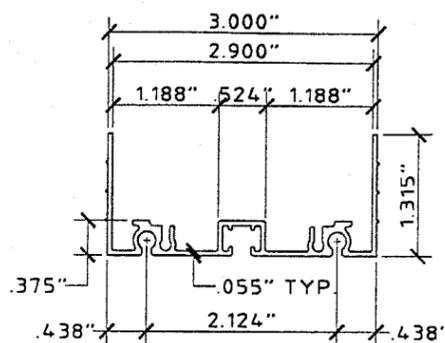


2 3" STANDARD FEMALE
SCALE: HALF SIZE

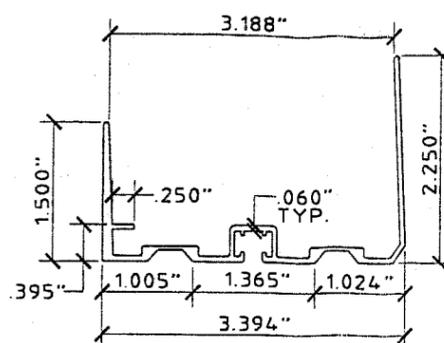


3 3" HANGING RAIL
SCALE: HALF SIZE

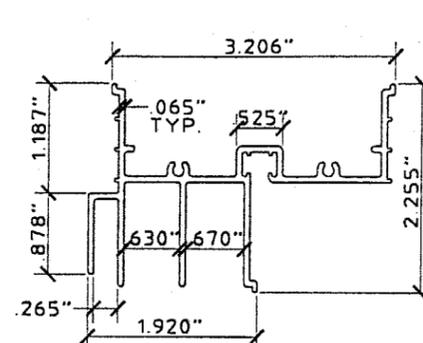


4 3" HEADER
SCALE: HALF SIZE

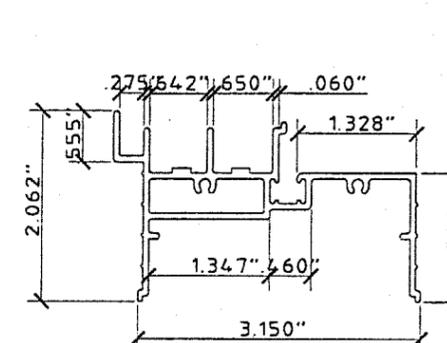


5 3" SILL
SCALE: HALF SIZE

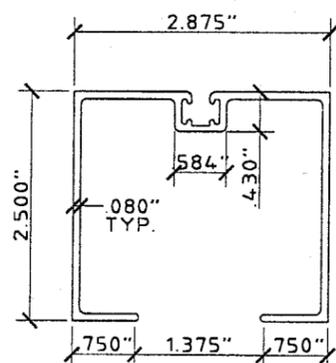


6 WB COLUMN
SCALE: HALF SIZE

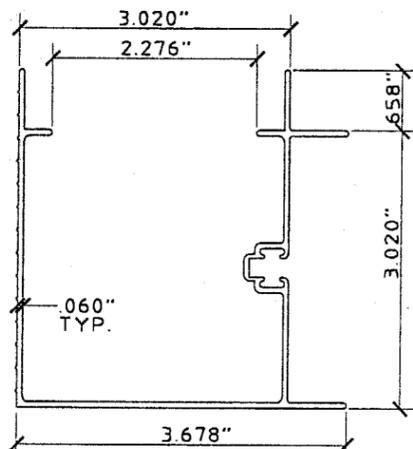


7 3" CORNER MULLION
SCALE: HALF SIZE

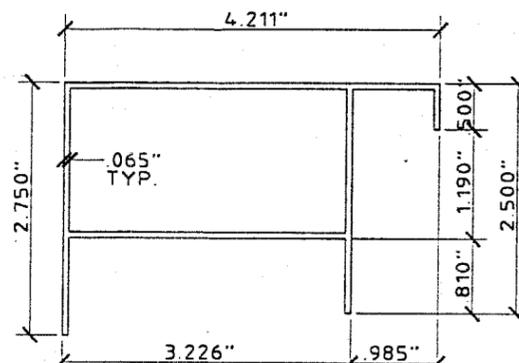


8 TOP TRACK / EXPANDER
SCALE: HALF SIZE

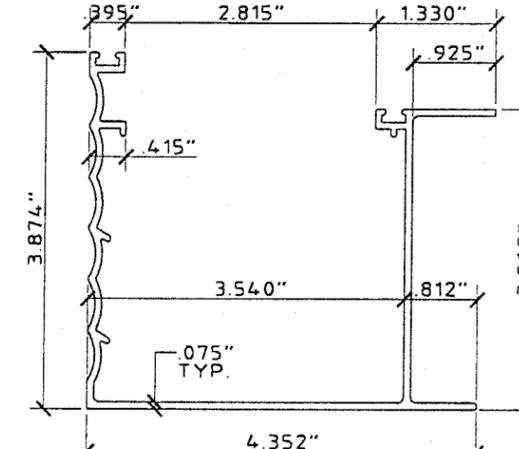


9 3" GUTTER
SCALE: HALF SIZE

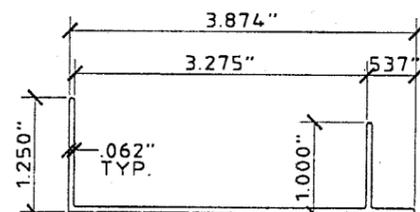


10 3" C - FASCIA
SCALE: HALF SIZE

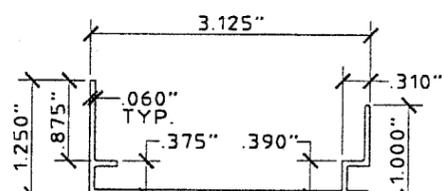


11 BASE CAP
SCALE: HALF SIZE




12 ADAPTER
SCALE: HALF SIZE




13 LS JAMB
SCALE: HALF SIZE

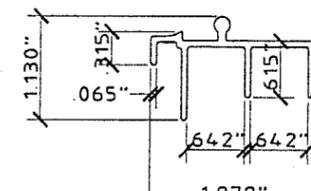


14 RS JAMB
SCALE: HALF SIZE

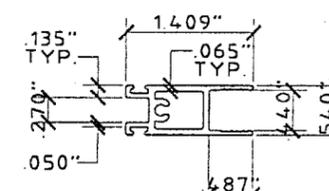


15 SC SASH
SCALE: HALF SIZE

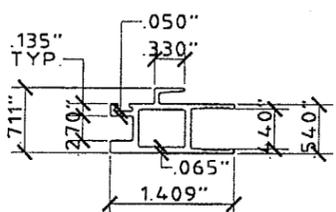

16 SC INTERLOCK
SCALE: HALF SIZE

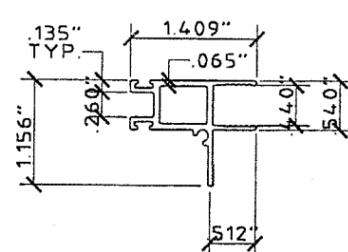


17 SC HANDLE
SCALE: HALF SIZE

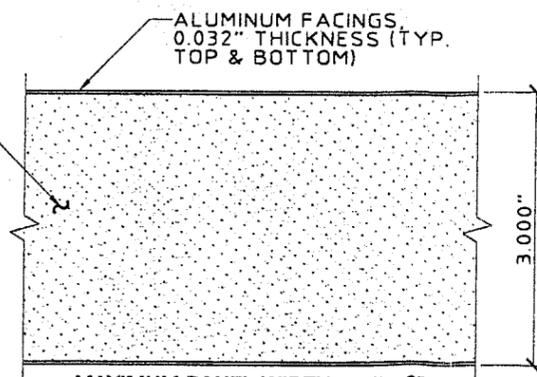

18 3" E.P.S. ROOF PANEL
SCALE: HALF SIZE

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE 01/04/2001
BY *Heather A. Mark*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0920.05








KNEZEVICH & ASSOCIATES, INC.
CONSULTING ENGINEERS • PRODUCT TESTING
1260 N. UNIVERSITY DRIVE, SUITE 180 • FORT LAUDERDALE, FL 33322
TEL: (954) 382-2800 • FAX: (954) 382-2888 • FLORIDA COA #3205
WEBSITE: WWW.KNEZEVICH.COM • E-MAIL: KA@KNEZEVICH.COM
COPYRIGHT © 2000 KNEZEVICH & ASSOCIATES, INC.

SCREEN ROOM
TEMO inc.
20400 Hall Road
Clinton Twp., Michigan 48038
Tel: (800) 344-TEMO
Fax: (810) 286-5409





no.	date	by	description
1	09/18/00	ZS	PREV. DRAWING NO. 99-179
2	11/29/00	ZS	BCCO COMMENTS

V.J. KNEZEVICH
PROFESSIONAL ENGINEER
FL License No.
PE 0010983
[Signature]
NOV 29 2000
date 09/18/00
scale AS NOTED drawn by MC
design by ZS checked by VJK
drawing no. 99-179
sheet 2 of 6


**SCREEN ROOM WITH NO WIND BRAKERS
SCREEN WALLS WITH 3' - 0" PANELS @ BASE**

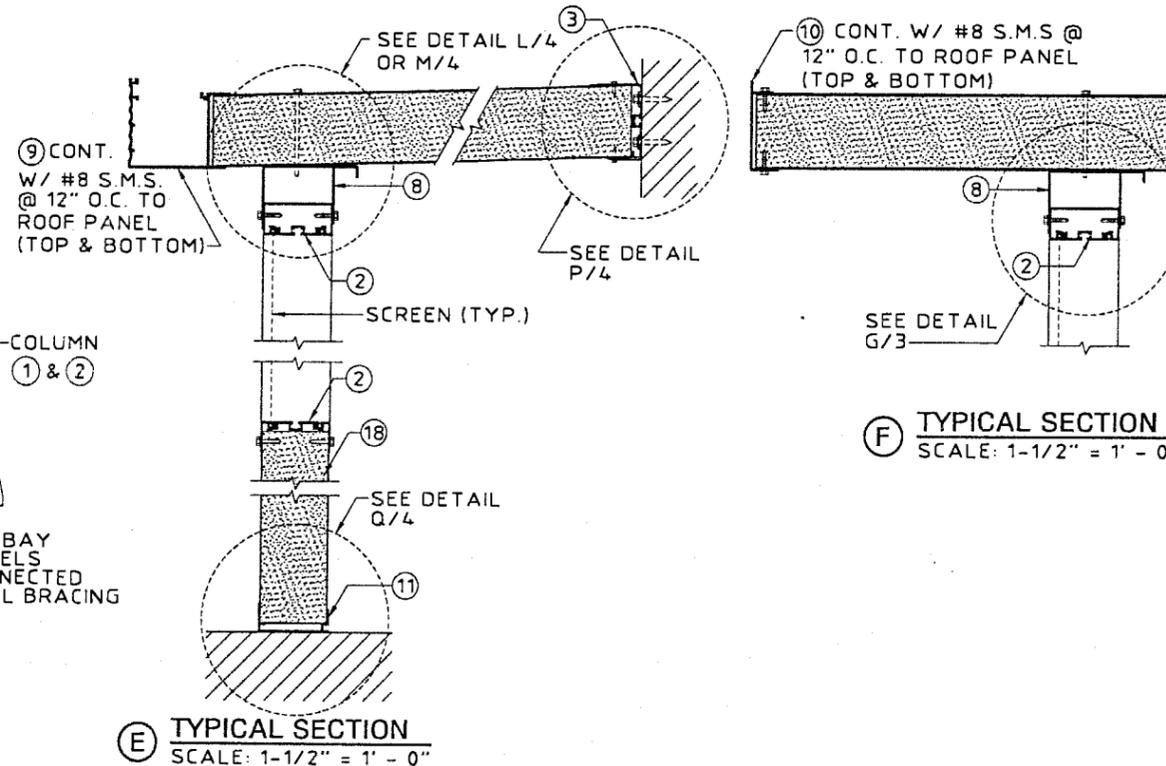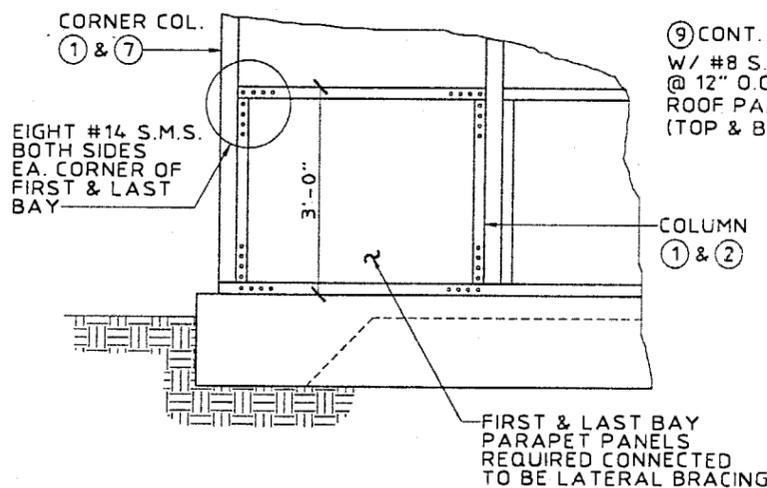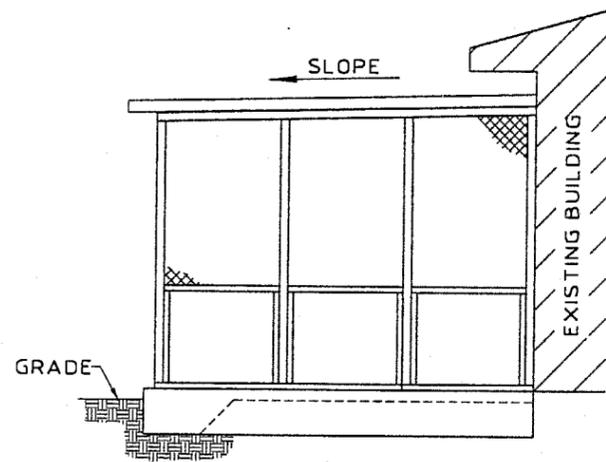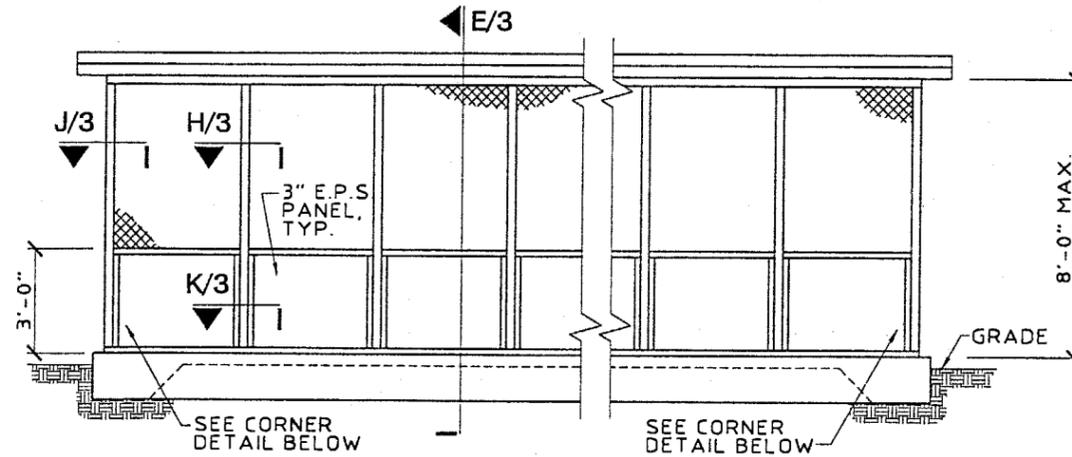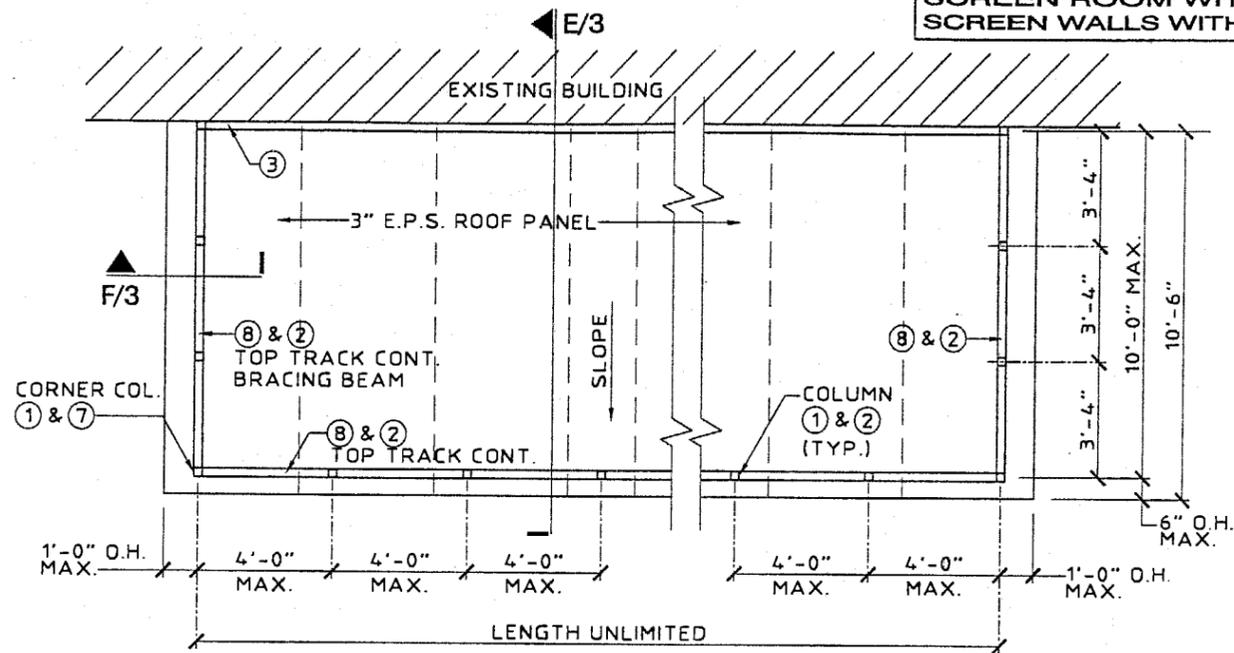

(F) TYPICAL SECTION
SCALE: 1-1/2" = 1' - 0"

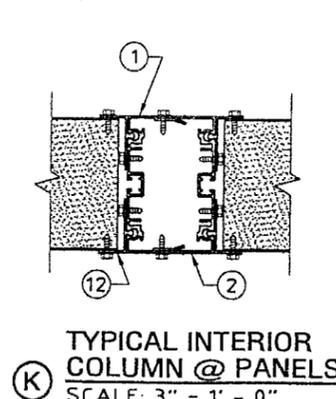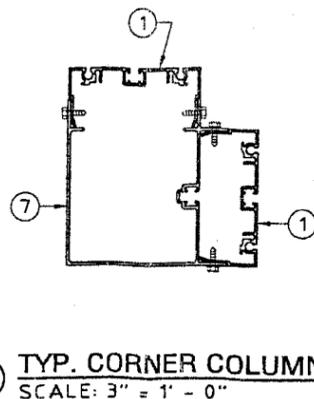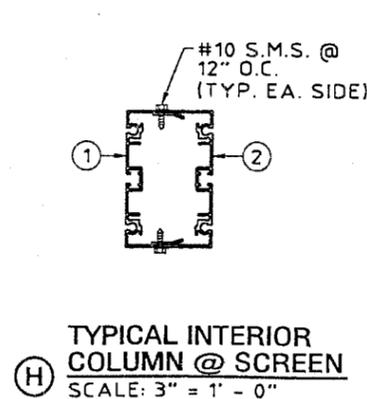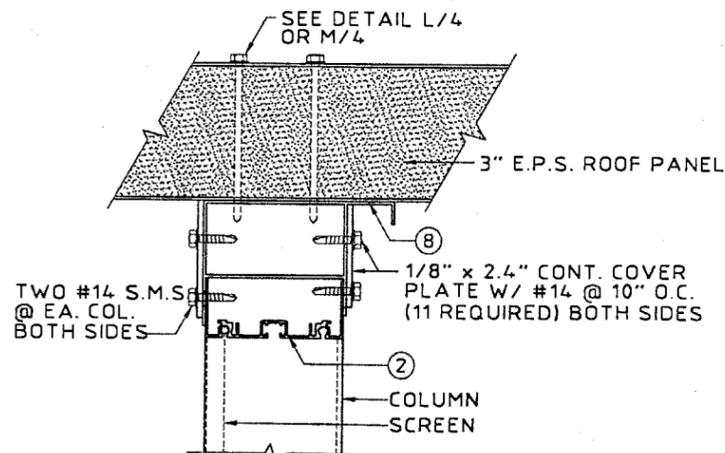

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE 01/04/2001
BY Helmut A. Mark
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0920.05




KNEZEVICH & ASSOCIATES, INC.
CONSULTING ENGINEERS • PRODUCT TESTING
1280 N. UNIVERSITY DRIVE, SUITE 180 • FORT LAUDERDALE, FL 33322
TEL: (954) 382-2800 • FAX: (954) 382-2989 • FLORIDA COA #3205
WEBSITE: WWW.KNEZEVICH.COM • E-MAIL: KA@KNEZEVICH.COM
COPYRIGHT © 2000 KNEZEVICH & ASSOCIATES, INC.

SCREEN ROOM
TEMO Inc.
20400 Hall Road
Clinton Twp., Michigan 48038
Tel: (601) 344-TEMO
Fax: (610) 286-5409


no.	date	by	description
1	09/18/00	ZS	PREV. DRAWING NO. 96-270
2	11/29/00	ZS	BCCO COMMENTS

V.J. KNEZEVICH
PROFESSIONAL ENGINEER
FL License No.:
PE 0010983
NOV 29 2000
date 09/18/00
AS NOTED drawn by MC
design by ZS checked by VJK
drawing no.
99-179
sheet 3 of 6


**SCREEN ROOM WITH NO WIND BRAKERS
SCREEN WALLS WITH 3' - 0" PANELS @ BASE**

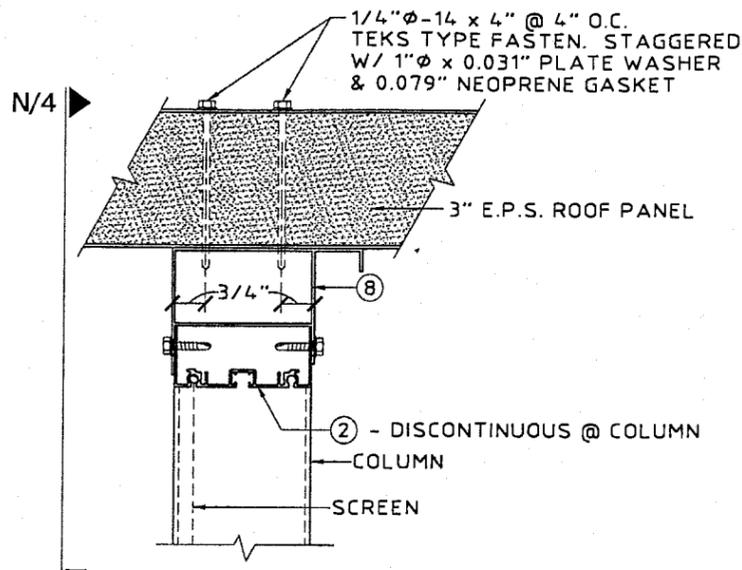


L ROOF PANEL TO HEADER WITH SCREWS
SCALE: 3" = 1' - 0"

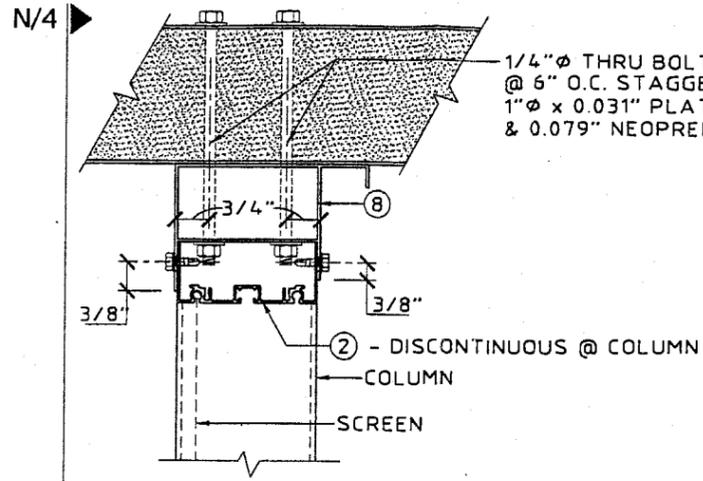


M ROOF PANEL TO HEADER WITH BOLTS
SCALE: 3" = 1' - 0"

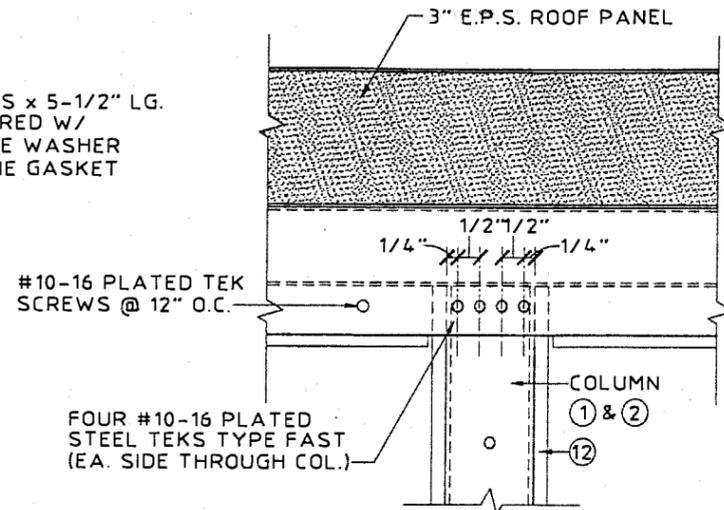


N ROOF PANEL TO HEADER ELEVATION
SCALE: 3" = 1' - 0"

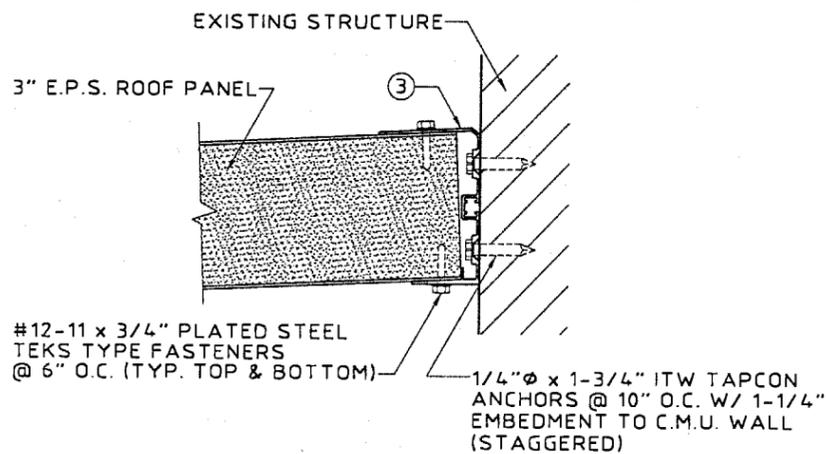


P ROOF PANEL TO WALL
SCALE: 3" = 1' - 0"

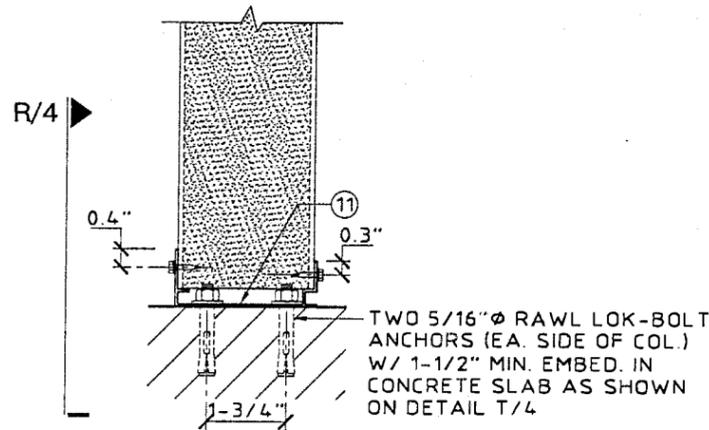


Q WALL TO SLAB
SCALE: 3" = 1' - 0"

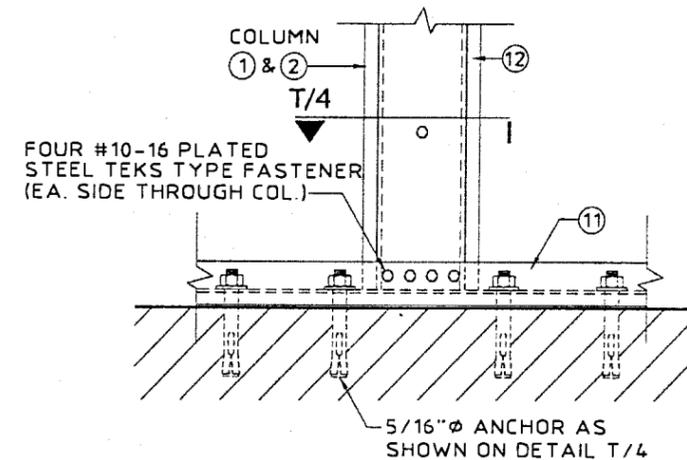

R COLUMN TO SLAB
SCALE: 3" = 1' - 0"

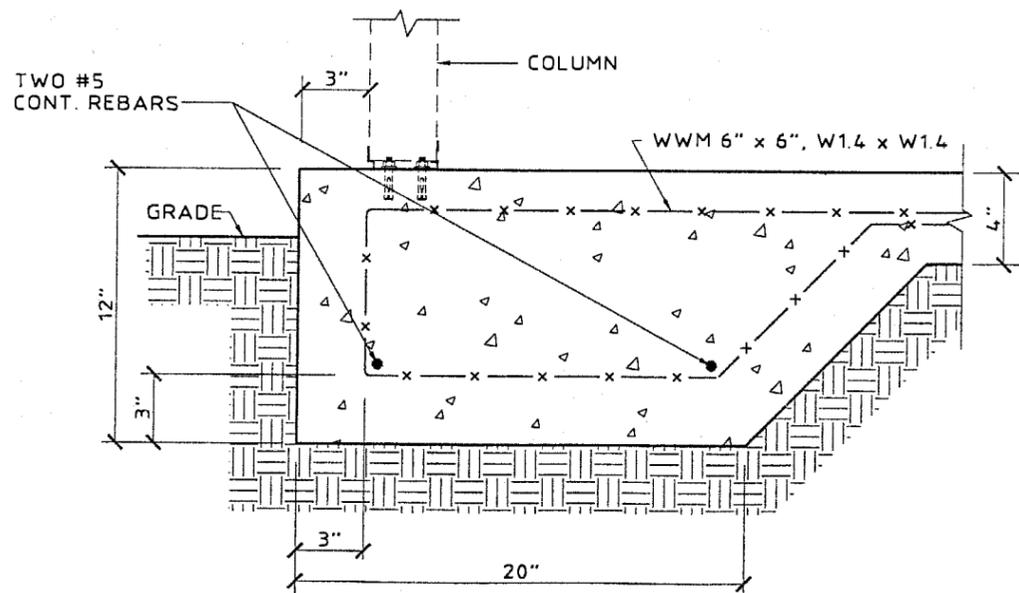


S TYPICAL FOUNDATION DETAIL
SCALE: 1-1/2" = 1' - 0"

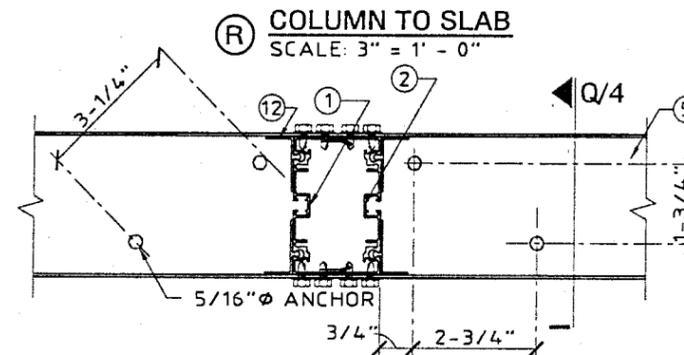

T COLUMN TO SLAB
SCALE: 3" = 1' - 0"

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE 01/04/2001
BY *Helmut A. Mark*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0920-05



KNEZEVICH & ASSOCIATES, INC.
CONSULTING ENGINEERS • PRODUCT TESTING
1280 N. UNIVERSITY DRIVE, SUITE 180 • FORT LAUDERDALE, FL 33322
TEL: (954) 382-2800 • FAX: (954) 382-2989 • FLORIDA COA #9305
WEBSITE: WWW.KNEZEVICH.COM • E-MAIL: KA@KNEZEVICH.COM
COPYRIGHT © 2000 KNEZEVICH & ASSOCIATES, INC.

SCREEN ROOM


TEMO Inc.
20400 Hall Road
Clinton Twp., Michigan 48038
Tel: (800) 344-TEMO
Fax: (810) 286-5409

no.	date	by	description
1	09/18/00	ZS	PREV. DRAWING NO. 99-270
2	11/29/00	ZS	BCCO COMMENTS


V.J. KNEZEVICH
PROFESSIONAL ENGINEER
Fl. License No:
PE 0070983

NOV 29 2000
date 09/18/00
scale AS NOTED
design by ZS
checked by VJK
drawing no. 99-179
sheet 4 of 6


SCREEN ROOM WITH GLASS WIND BRAKERS
REMOVABLE WIND BREAKERS WITH 1'-6" PANELS @ HEAD & SILL

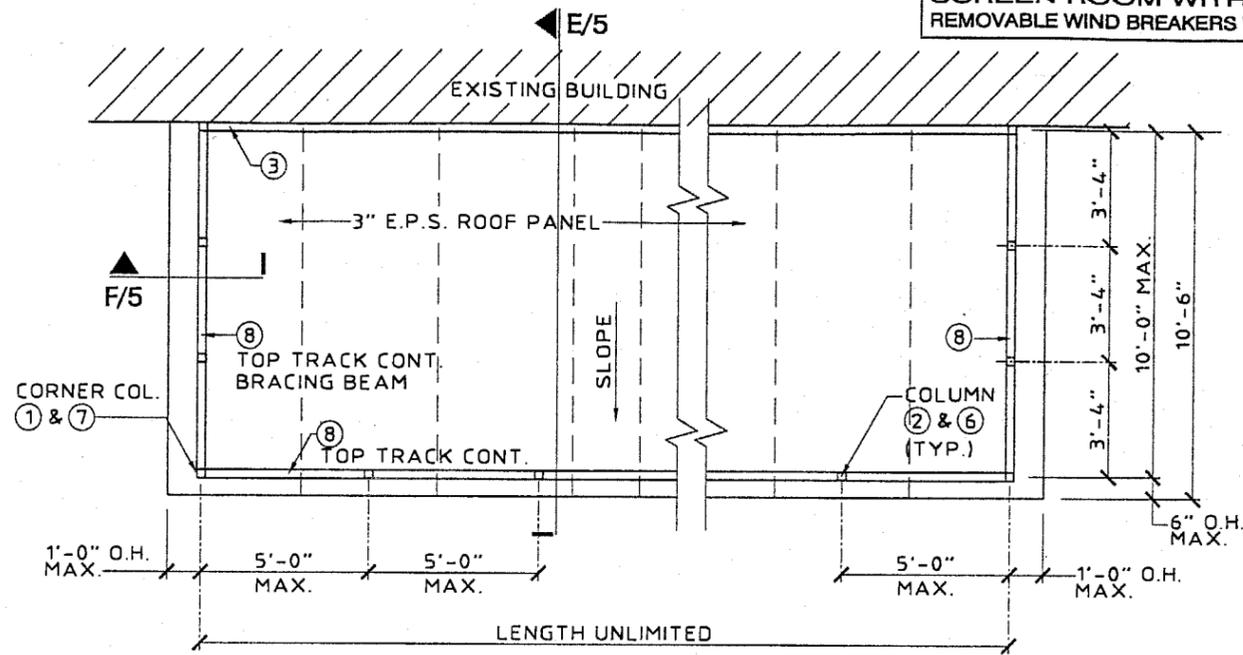


(A) ROOF PLAN
 SCALE: 3/16" = 1' - 0"

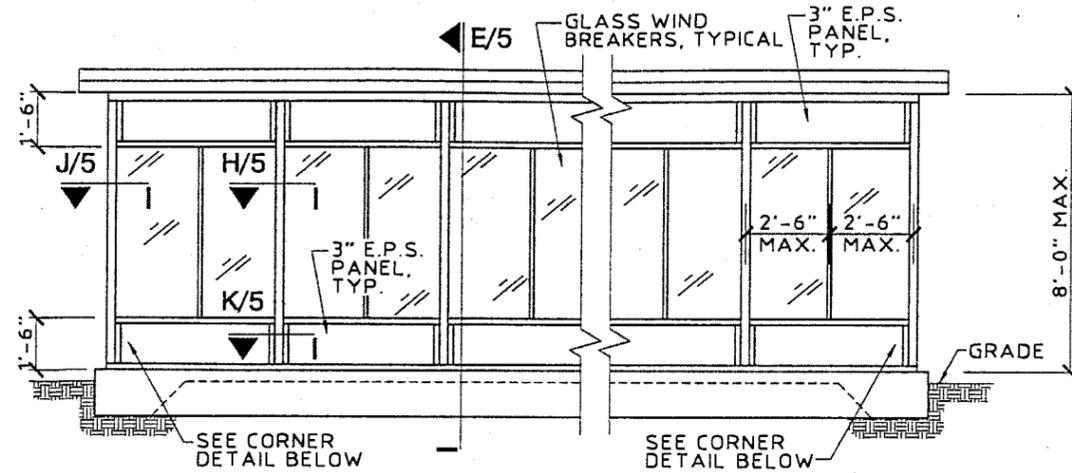


(B) FRONT ELEVATION
 SCALE: 3/16" = 1' - 0"

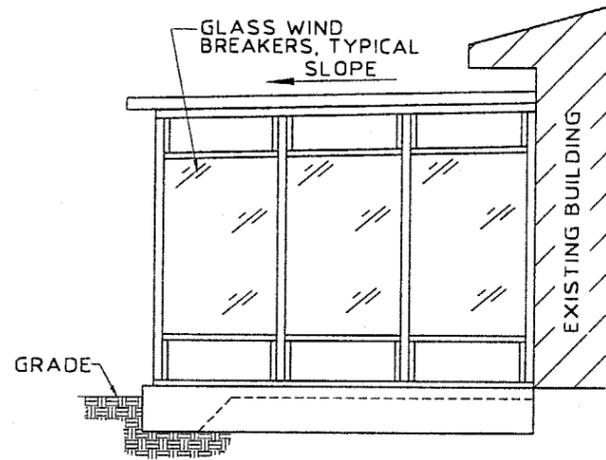


(C) SIDE ELEVATION
 SCALE: 3/16" = 1' - 0"

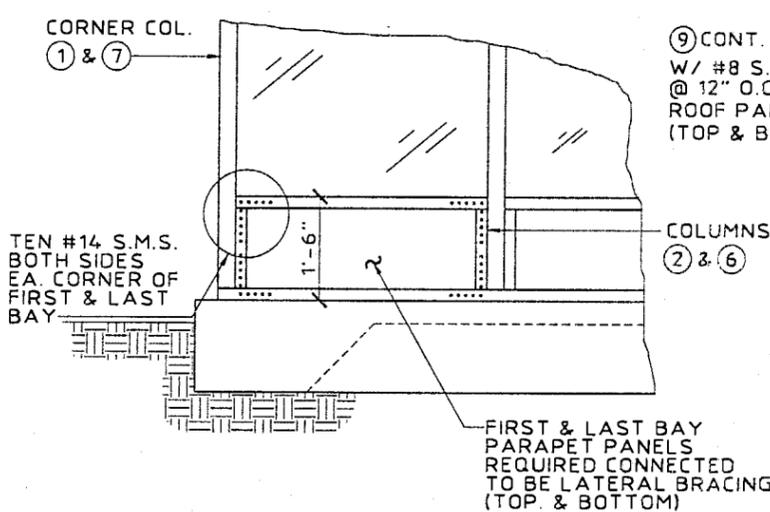


(D) CORNER DETAIL
 SCALE: 3/8" = 1' - 0"

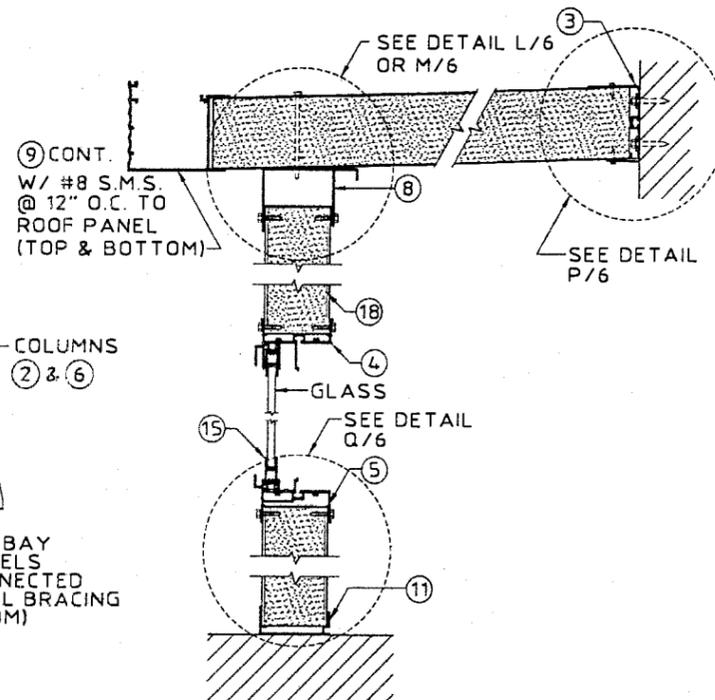


(E) TYPICAL SECTION
 SCALE: 1-1/2" = 1' - 0"

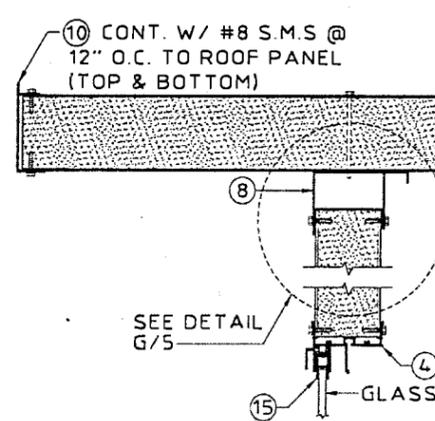


(F) TYPICAL SECTION
 SCALE: 1-1/2" = 1' - 0"

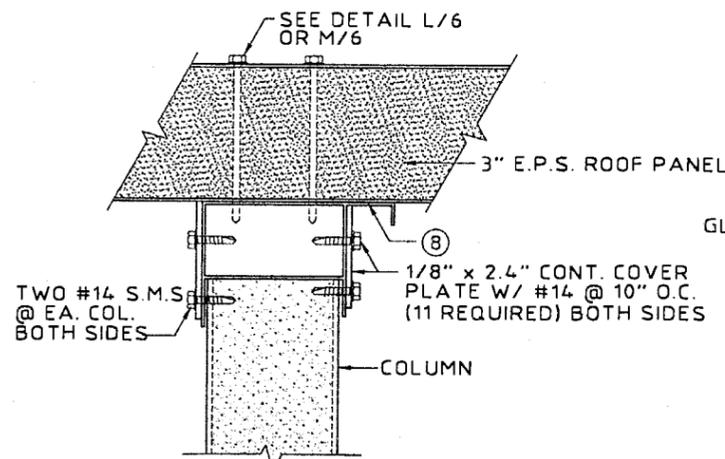


(G) BRACING BEAM
 SCALE: 3" = 1' - 0"

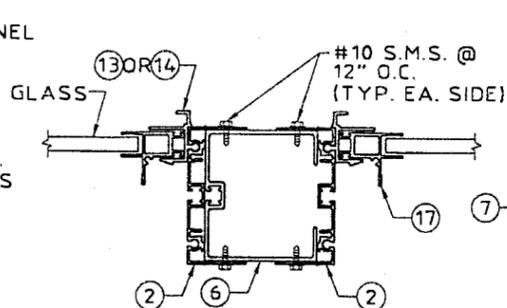

(H) TYPICAL INTERIOR COLUMN @ GLASS
 SCALE: 3" = 1' - 0"




(J) TYP. CORNER COLUMN
 SCALE: 3" = 1' - 0"

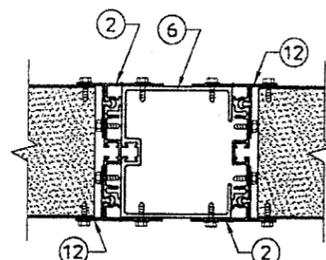

(K) TYPICAL INTERIOR COLUMN @ PANELS
 SCALE: 3" = 1' - 0"

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE 01/04/2001
 BY *Helmut A. Meier*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-0920-05



KNEZEVICH & ASSOCIATES, INC.
 CONSULTING ENGINEERS • PRODUCT TESTING
 1280 N. UNIVERSITY DRIVE, SUITE 180 • FORT LAUDERDALE, FL 33322
 TEL: (954) 382-2800 • FAX: (954) 382-2888 • FLORIDA COA #3205
 WEBSITE: WWW.KNEZEVICH.COM • E-MAIL: KA@KNEZEVICH.COM
 COPYRIGHT © 2000 KNEZEVICH & ASSOCIATES, INC.

SCREEN ROOM
TEMO Inc.
 20400 Hall Road
 Clinton Twp., Michigan 48038
 Tel: (800) 344-TEMO
 Fax: (810) 286-5409

no.	date	by	description
1	09/18/00	ZS	PREV. DRAWING NO. 96-270
2	11/29/00	ZS	BCCO COMMENTS

V.J. KNEZEVICH
 PROFESSIONAL ENGINEER
 FL License No: PE 0010983
 NOV 29 2000
 date: 09/18/00
 scale: AS NOTED
 drawn by: MC
 design by: ZS
 checked by: V.K.
 drawing no. 99-179
 sheet 5 of 6

**SCREEN ROOM WITH GLASS WIND BRAKERS
REMOVABLE WIND BRAKERS WITH 1'-6" PANELS @ HEAD & SILL**




KNEZEVICH & ASSOCIATES, INC.
CONSULTING ENGINEERS • PRODUCT TESTING
1280 N. UNIVERSITY DRIVE, SUITE 180 • FORT LAUDERDALE, FL 33322
TEL: (954) 382-2800 • FAX: (954) 382-2888 • FLORIDA COA #3205
WEBSITE: WWW.KNEZEVICH.COM • E-MAIL: K@KNEZEVICH.COM
COPYRIGHT © 2000 KNEZEVICH & ASSOCIATES, INC.


SCREEN ROOM
TEMO Inc.
20400 Hall Road
Clinton Twp., Michigan 48038
Tel: (800) 344-TEMO
Fax: (810) 286-5409

no.	date	description
1	09/18/00	25 PREV. DRAWING NO. 96-270
2	11/29/00	25 BECD COMMENTS


V.J. KNEZEVICH
PROFESSIONAL ENGINEER
FL License No:
PE 0010983
NOV 29 2000
date 09/18/00
scale AS NOTED drawn by MC
design by ZS checked by VJK
drawing no.
99-179
sheet 6 of 6

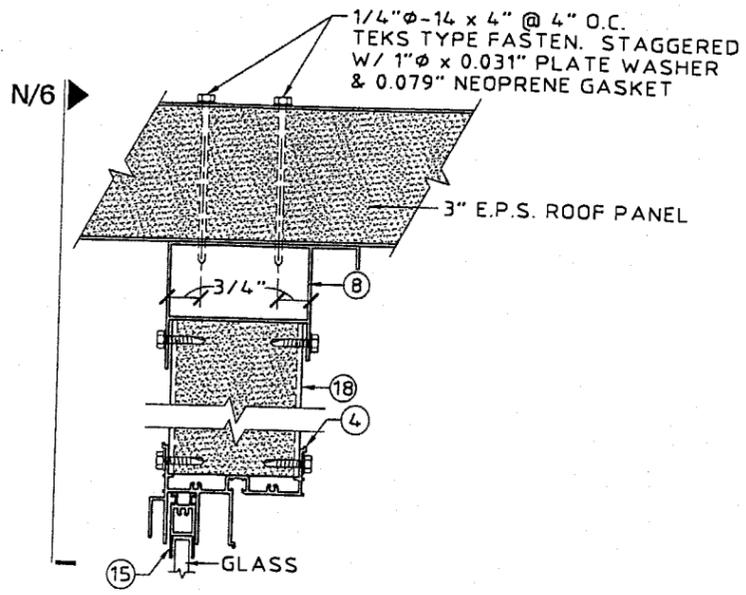


L ROOF PANEL TO HEADER WITH SCREWS
SCALE: 3" = 1' - 0"

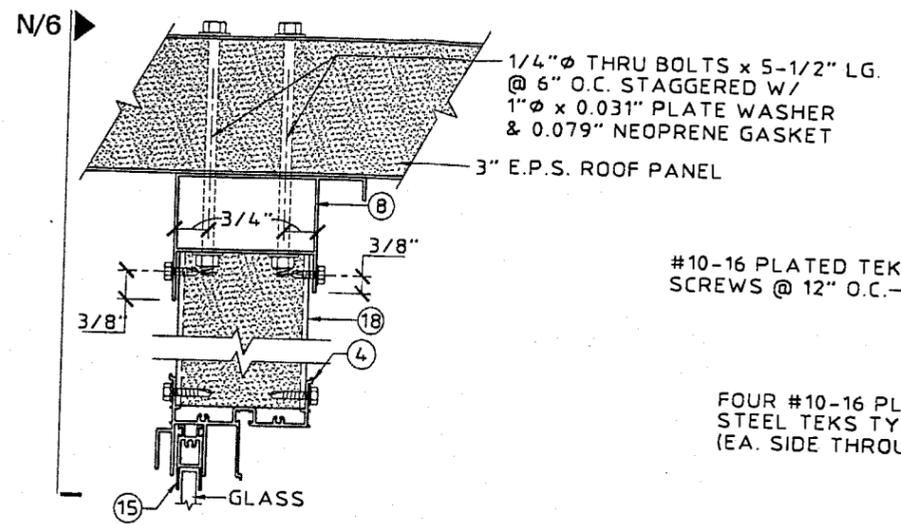


M ROOF PANEL TO HEADER WITH BOLTS
SCALE: 3" = 1' - 0"

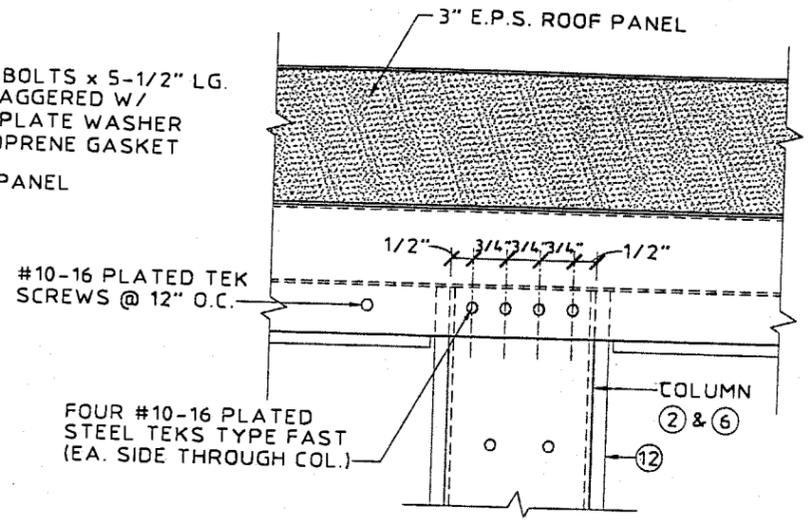


N ROOF PANEL TO HEADER ELEVATION
SCALE: 3" = 1' - 0"

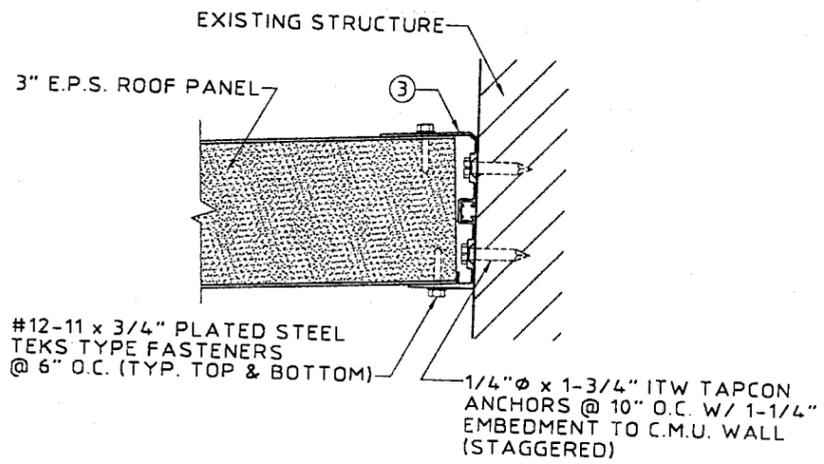


P ROOF PANEL TO WALL
SCALE: 3" = 1' - 0"

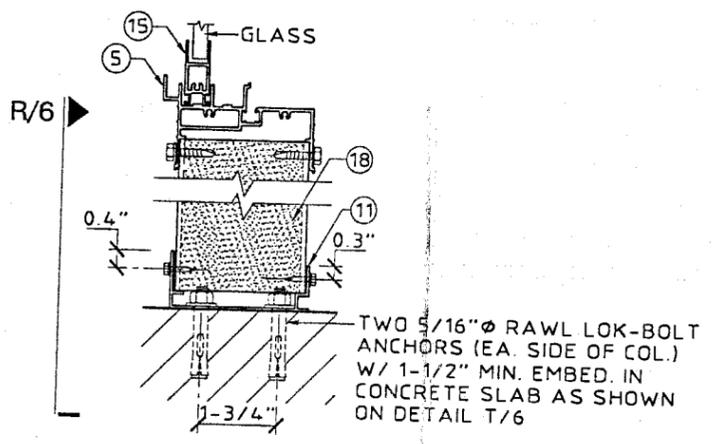


Q WALL TO SLAB
SCALE: 3" = 1' - 0"

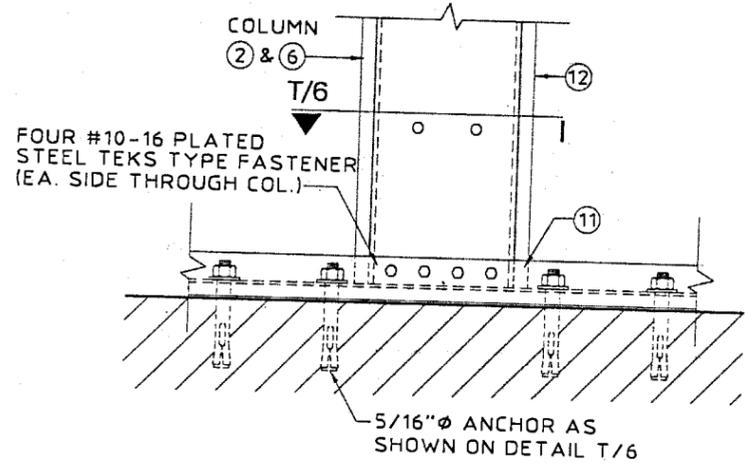

R COLUMN TO SLAB
SCALE: 3" = 1' - 0"

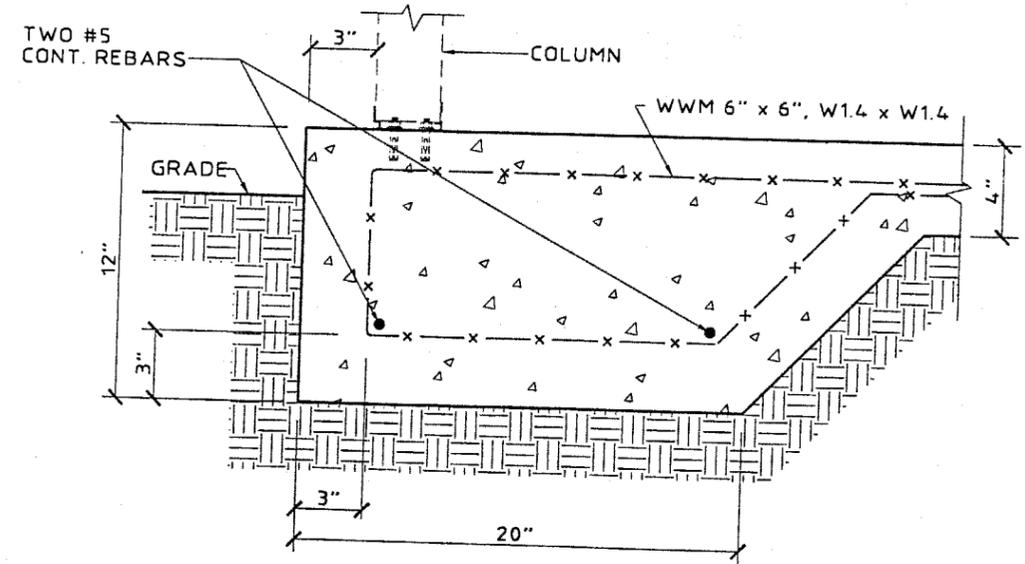

S TYPICAL FOUNDATION DETAIL
SCALE: 1-1/2" = 1' - 0"

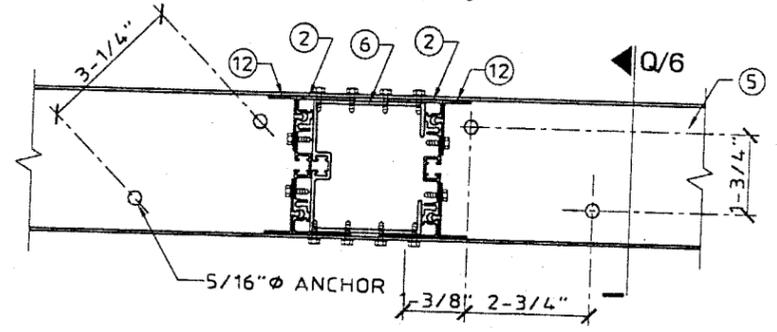

T COLUMN TO SLAB
SCALE: 3" = 1' - 0"

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE 01/04/2001
BY *Heather H. Miller*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0920.05