



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

TRACO Security Windows & Doors, Inc.
5100 NW 72 Avenue
Miami, FL 33166

Your application for Notice of Acceptance (NOA) of:

Series 8000 Aluminum Sliding Glass Door - Non-Impact and Small Missile Impact

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-0929.15
EXPIRES: 11/09/2003

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 11/09/2000

TRACO Security Windows & Doors, Inc.

ACCEPTANCE No.: 00-0929.15

APPROVED : NOV 09 2000

EXPIRES : NOV 09 2003

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

1.1 This approves an aluminum sliding glass door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

2.1 The **Series 8000 Aluminum Sliding Glass Door - Non-Impact and Small Missile Impact Resistant** and its components shall be constructed in strict compliance with the following documents: Drawing No **W00-42**, titled "Series 8000 Alum. Sliding Glass Door", Sheets 1 through 7 of 7 dated 08/25/00, prepared By Al-Farooq Corporation, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

3.1 This approval applies to single unit applications only, as shown in approved drawings.

4. INSTALLATION

4.1 The aluminum sliding glass door and its components shall be installed in strict compliance with the approved drawings.

4.2 Hurricane protection system (shutters):

4.2.1 For 7/16" laminated glass: The installation of this unit up to 30 feet above grade, **will require** a hurricane protection system, but for installations above 30 feet above grade **will not require** a hurricane protection system.

4.2.2 For 1/4" tempered glass: The installation of this unit **will require** a hurricane protection system.

5. LABELING

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".


6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

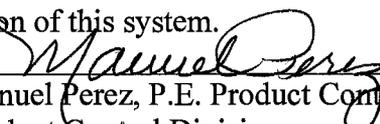
Manuel Perez, P.E. Product Control Examiner
Product Control Division

TRACO Security Windows & Doors, Inc.

ACCEPTANCE No.: 00-0929.15


APPROVED : NOV 09 2000


EXPIRES : NOV 09 2003

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE

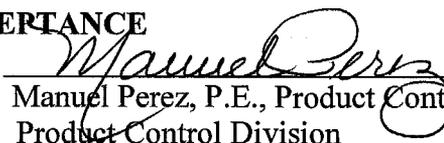
Manuel Perez, P.E., Product Control Examiner
Product Control Division

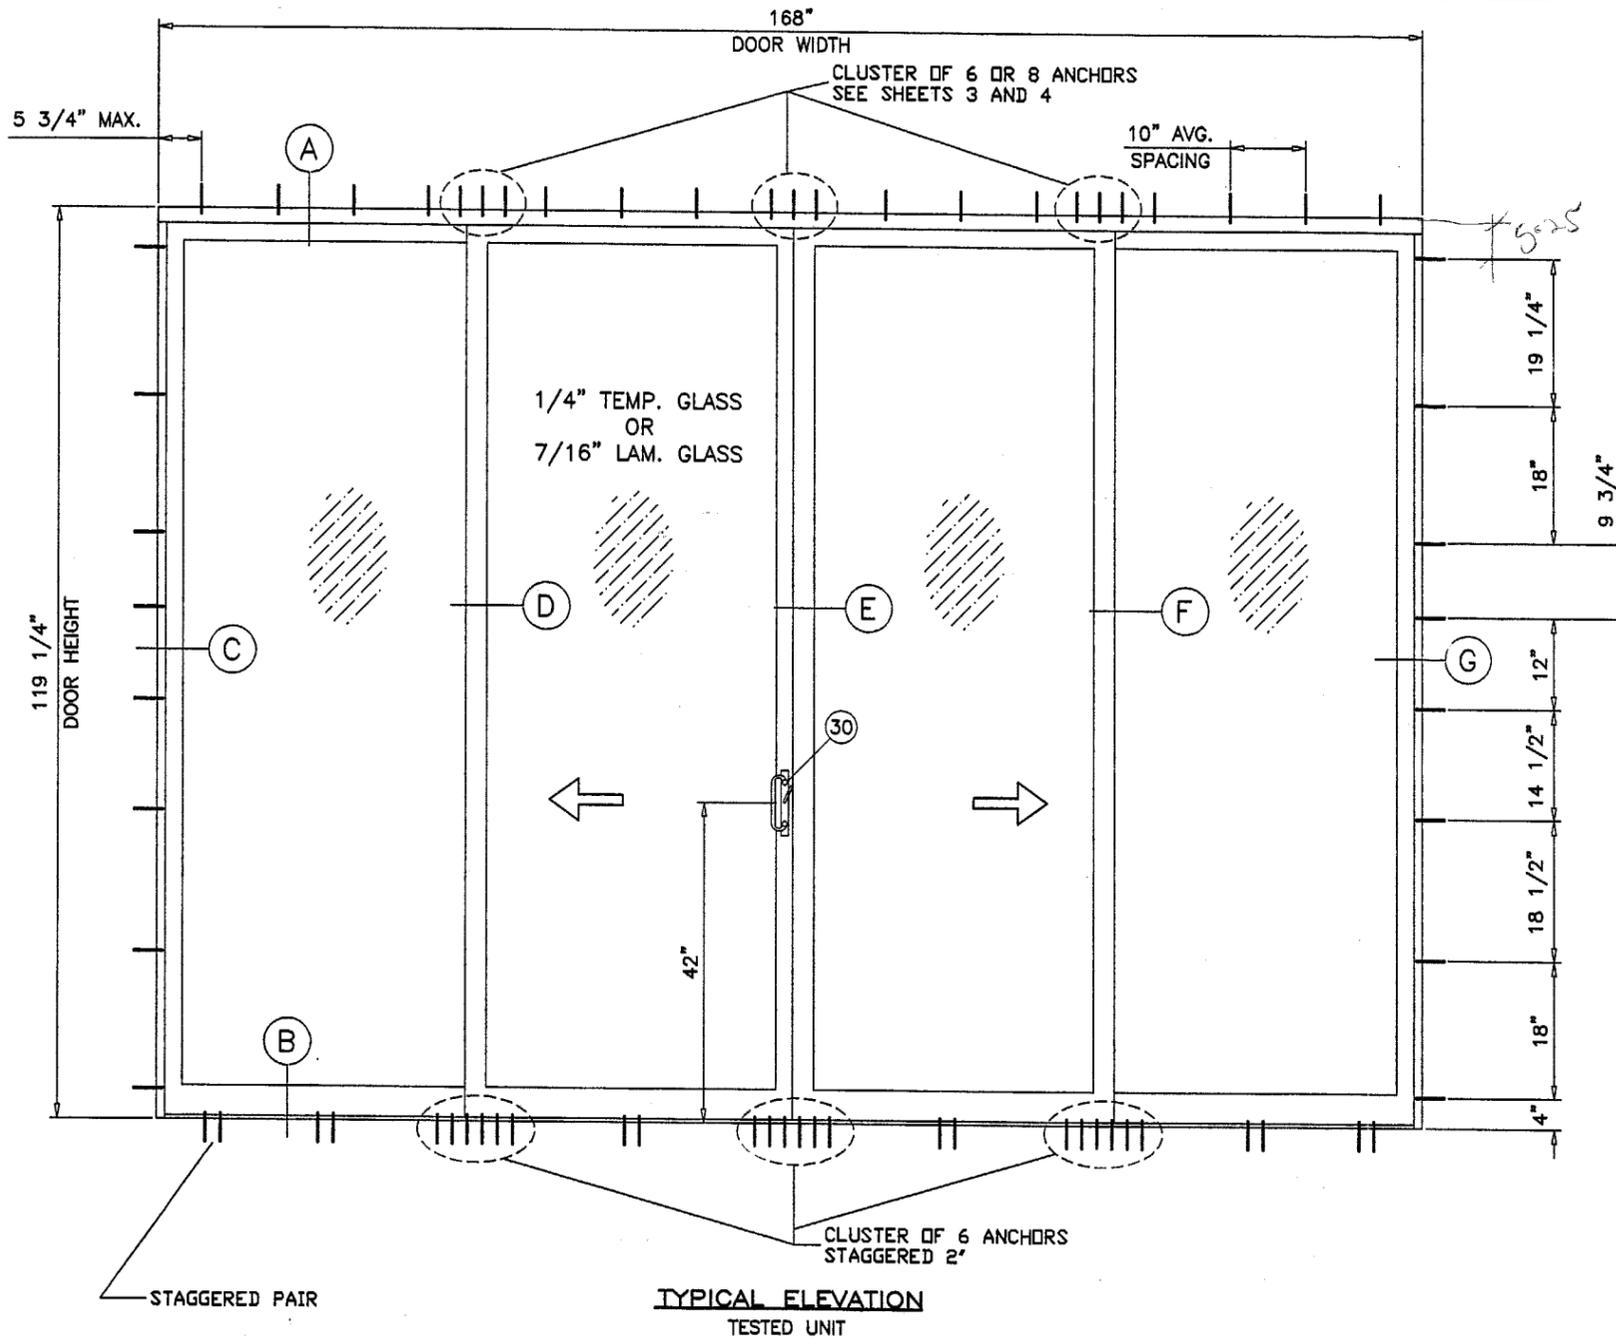


SERIES 8000 ALUMINUM SLIDING GLASS DOOR:
 DOORS MAY BE INSTALLED WITH OR WITHOUT HEAD RECEPTORS, SEE SHEET 3 FOR DETAILS.

DOORS MAY BE GLAZED WITH 1/4" TEMPERED GLASS FOR INSTALLATIONS WITH IMPACT RESISTANT SHUTTERS. OR 7/16" LAMINATED GLASS FOR INSTALLATIONS ABOVE 30 FT. OF GRADE WITHOUT SHUTTERS, SEE SHEET 2 FOR CAPACITY.

DOORS MAY HAVE ANY NUMBER OF PANELS USING STILE CONFIGURATIONS AS SHOWN ON SHEET 4. I.E. OX, XO, OXO, OXXO.

NOTES

1. THIS STRUCTURE IS DESIGNED AS PER THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR DADE COUNTY. ALSO FOR WIND LOADS AS PER ASCE 7-88 USING CORRESPONDING LOADS.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. ALL STEEL IN CONTACT WITH ALUMINUM TO BE PAINTED OR PLATED.

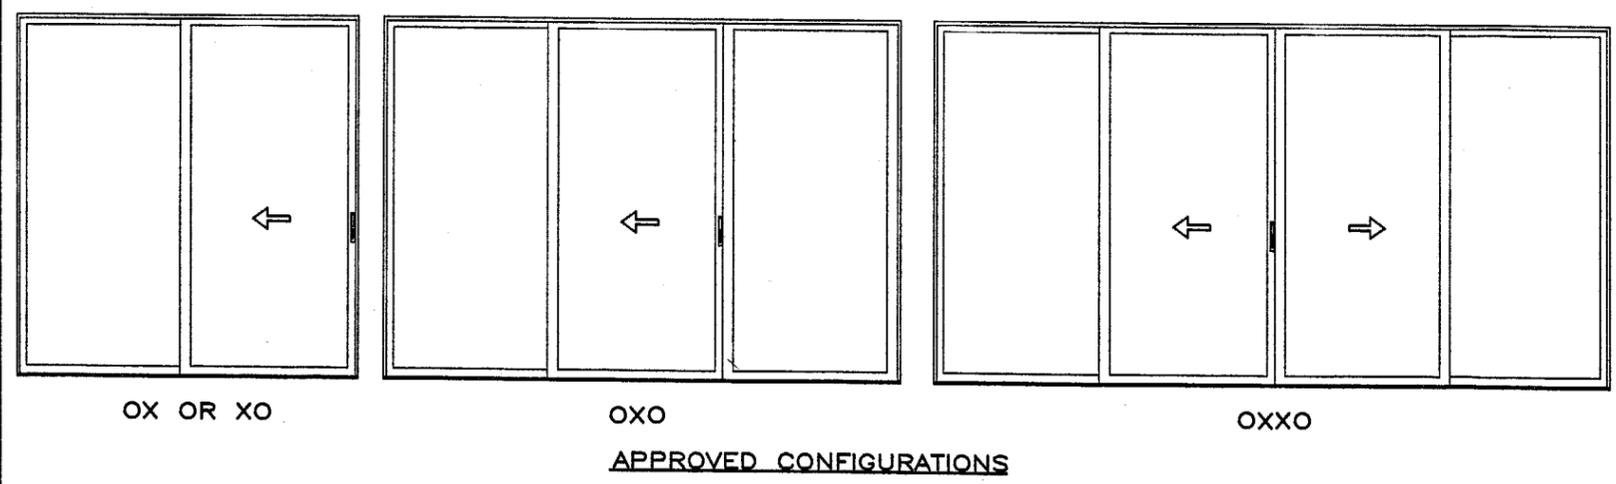

Engr. DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 SEP 26 2000

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE *November 09, 2000*
 BY *Muhammad J...*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. *00-0929.15*

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W00-42TS


SERIES 8000 ALUM. SLIDING GLASS DOOR
TRACO SECURITY WINDOWS & DOORS INC.
 5100 N.W. 72 AVE.
 MIAMI, FL. 33166
 TEL. (305) 591-8990

revisions:	no	date	by	description

date: 08-25-00
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:
 drawing no. **W00-42**
 sheet 1 of 7

00-0929-05

PANEL WIDTH NOMINAL FT./IN.	DOOR HEIGHT FT./IN.	PANELS WITH 1/4" TEMPERED GLASS MIAMI DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS REQUIRED						PANELS WITH 7/16" OVERALL LAMINATED GLASS SHUTTERS NOT REQUIRED FOR INSTALLATIONS ABOVE 30 FT. OF GRADE					
		DESIGN LOAD CAPACITY - PSF						DESIGN LOAD CAPACITY - PSF					
		CHART 'A-1'		CHART 'A-2'		CHART 'B'		CHART 'A-1'		CHART 'A-2'		CHART 'B'	
		EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
2/0	6/8	120.0	250.0	120.0	250.0	120.0	250.0	120.0	160.0	120.0	160.0	120.0	160.0
2/6		120.0	222.4	120.0	250.0	120.0	250.0	120.0	160.0	120.0	160.0	120.0	160.0
3/0		120.0	194.3	120.0	239.2	120.0	250.0	120.0	160.0	120.0	160.0	120.0	160.0
3/6		120.0	175.0	120.0	215.5	120.0	217.4	120.0	160.0	120.0	160.0	120.0	160.0
4/0		120.0	161.4	120.0	188.5	120.0	188.5	120.0	160.0	120.0	160.0	120.0	160.0
4/6		120.0	151.5	120.0	166.4	120.0	166.4	120.0	151.5	120.0	160.0	120.0	160.0
5/0		120.0	144.6	120.0	148.9	120.0	148.9	120.0	144.6	120.0	148.9	120.0	148.9
2/0	8/0	120.0	215.1	120.0	250.0	120.0	250.0	120.0	160.0	120.0	160.0	120.0	160.0
2/6		120.0	178.5	120.0	219.7	120.0	237.7	120.0	160.0	120.0	160.0	120.0	160.0
3/0		120.0	154.5	120.0	190.2	120.0	205.7	120.0	154.5	120.0	160.0	120.0	160.0
3/6		120.0	137.7	120.0	169.5	120.0	178.1	120.0	137.7	120.0	160.0	120.0	160.0
4/0		120.0	125.5	120.0	154.5	120.0	154.5	120.0	125.5	120.0	154.5	120.0	154.5
2/0	9/0	120.0	188.3	120.0	231.8	120.0	250.0	120.0	160.0	120.0	160.0	120.0	160.0
2/6		120.0	155.5	120.0	191.4	120.0	207.1	120.0	155.5	120.0	160.0	120.0	160.0
3/0		120.0	133.9	120.0	164.8	120.0	178.3	120.0	133.9	120.0	160.0	120.0	160.0
3/6		118.7	118.7	120.0	146.1	120.0	156.9	118.7	118.7	120.0	146.1	120.0	156.9
2/0	10/0	120.0	168.5	120.0	207.4	120.0	224.4	120.0	160.0	120.0	160.0	120.0	160.0
2/6		120.0	138.7	120.0	170.7	120.0	184.7	120.0	138.7	120.0	160.0	120.0	160.0
3/0		119.0	119.0	120.0	146.5	120.0	158.5	119.0	119.0	120.0	146.5	120.0	158.5
3/6		105.1	105.1	120.0	129.4	120.0	140.0	105.1	105.1	120.0	129.4	120.0	140.0

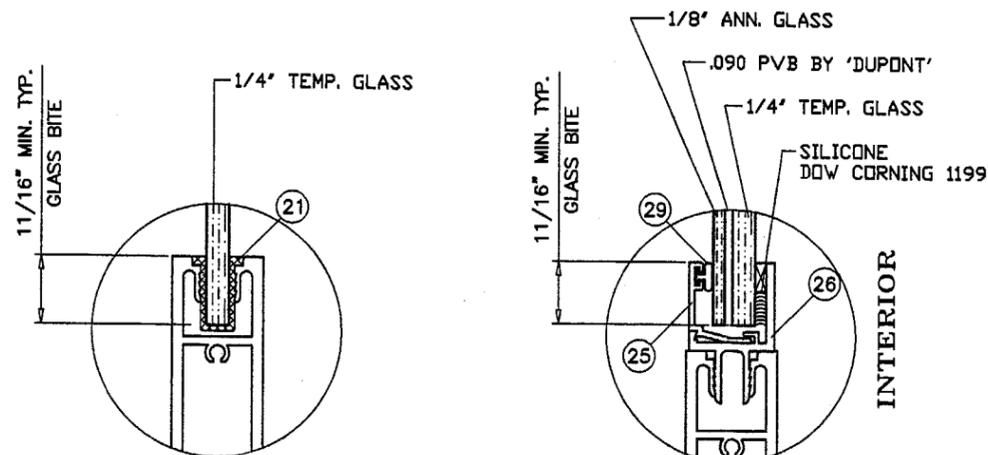

NON IMPACT RESISTANT

SMALL MISSILE IMPACT RESISTANT
LAMINATED BY 'CARDINAL'

GLAZING OPTIONS

SEALANTS:

INSTALLATION SCREWS, FRAME AND PANEL CORNER SEAMS SEALED WITH ALUM/CLEAR COLORED SEALANT.
FIX. PANEL BOTTOM RAIL, FIX. PANEL JAMBS AND THRESHOLD INSERTS SEALED TO THE FRAME WITH SILICONE.

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

SEP 26 2000

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *November 09, 2000*
BY *Manuel Jerez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0929-15*

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W00-42TS

SERIES 8000 ALUM. SLIDING GLASS DOOR
TRACO SECURITY WINDOWS & DOORS INC.
5100 N.W. 72 AVE.
MIAMI, FL. 33166
TEL. (305) 591-8990

revisions:	no	date	by	description

date: 08-25-00
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W00-42

sheet 2 of 7

CLUSTER ● STILE ENDS	
ANCHORS	CHART TO USE
6	A-1
8	B

1/4" X 3-1/4" TAPCONS IN PAIRS
SEE ELEV. FOR SPACING


1BY, 2BY WOOD BUCKS
OR WOOD STRUCTURE

CLUSTER ● STILE ENDS	
ANCHORS	CHART TO USE
6	B


1/4" X 2-1/4" TAPCONS IN PAIRS
SEE ELEV. FOR SPACING

1/4" X 3-1/4" TAPCONS IN PAIRS
SEE ELEV. FOR SPACING


CLUSTER ● STILE ENDS	
ANCHORS	CHART TO USE
6	A-1
8	B

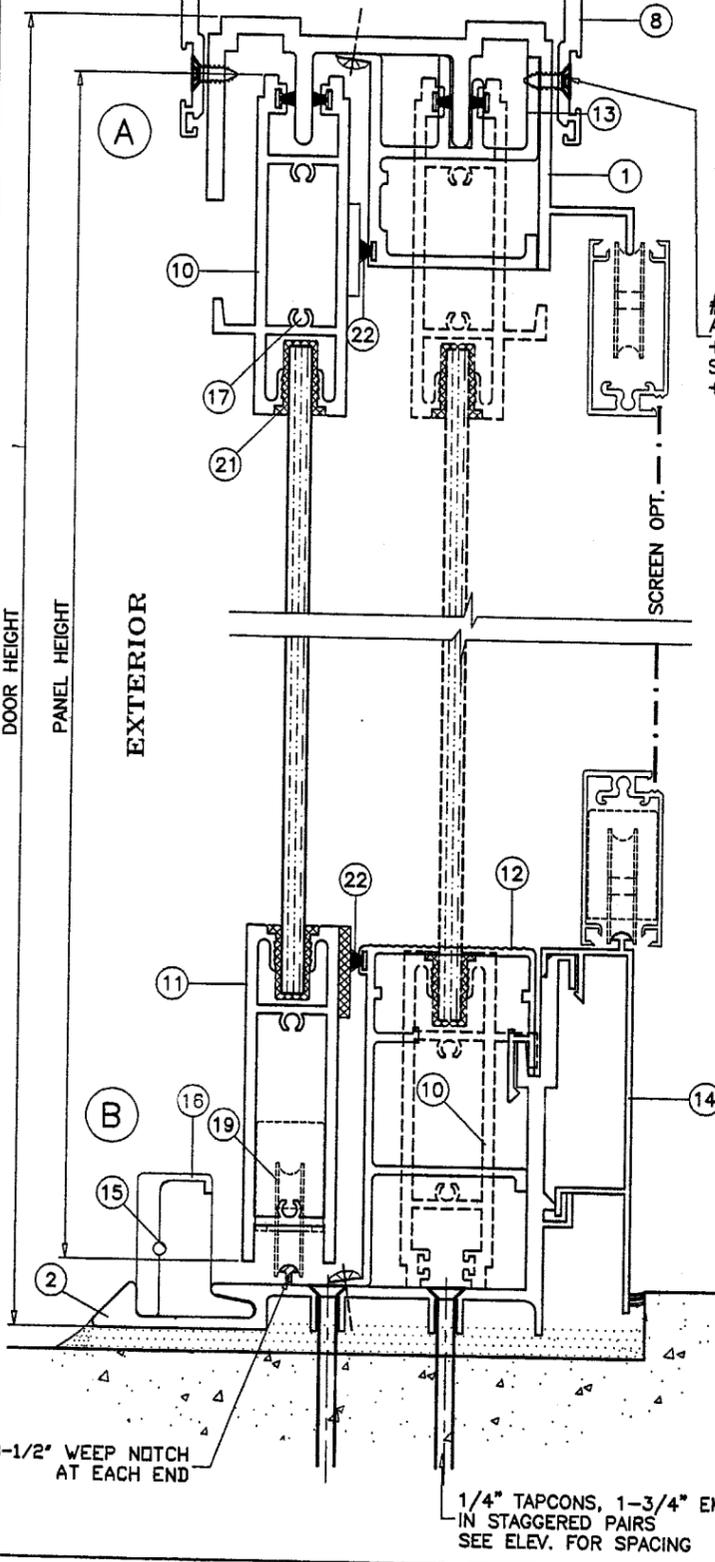

#10 X 1" SMS
AT EACH END
+CLUSTER OF 3 AT MTG.
STILES
+ONE BETWEEN STILES

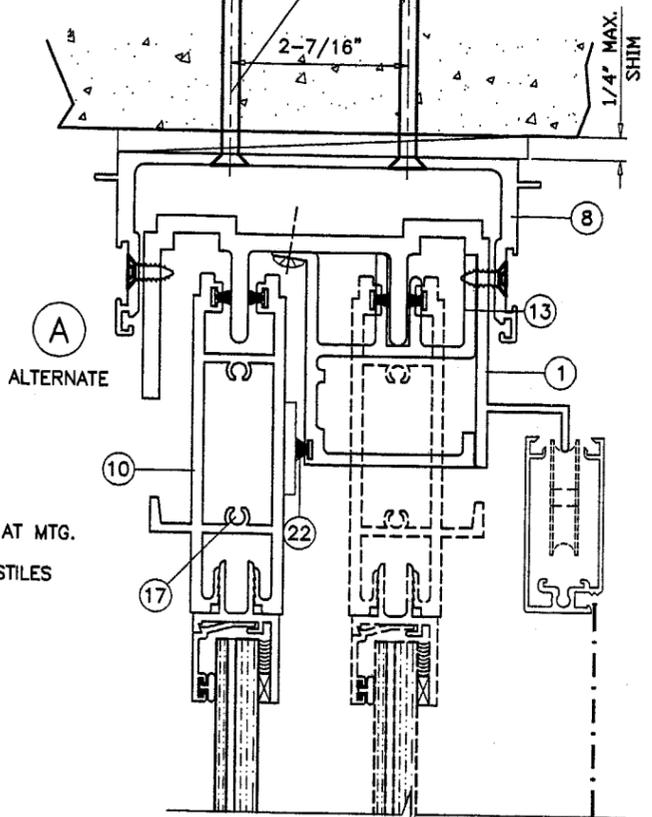


WOOD BUCKS NOT BY TRACO SECURITY, MUST SUSTAIN
LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER
THEM TO THE BUILDING STRUCTURE.

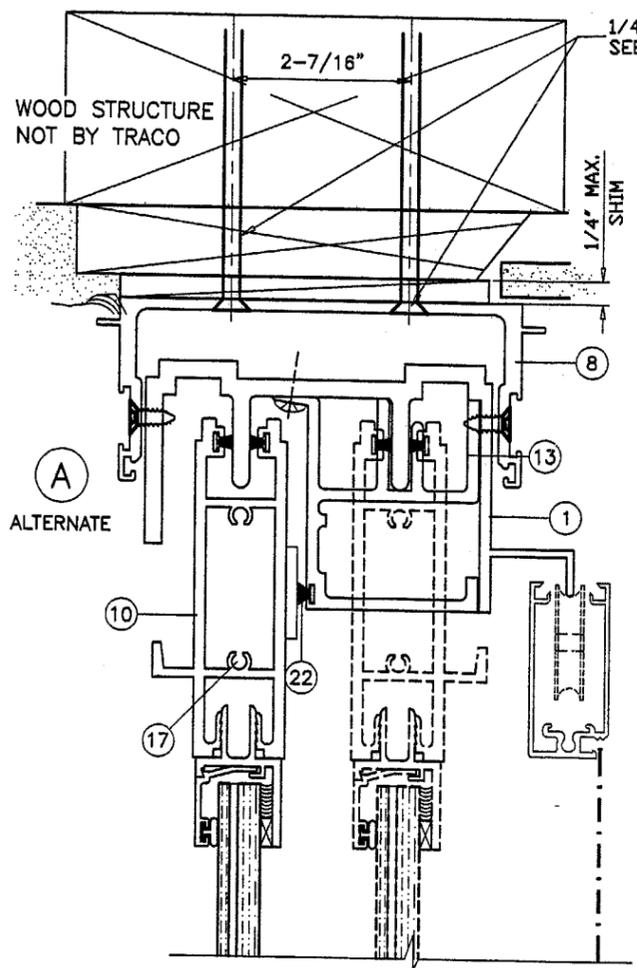

FRAME INSTALLATION DETAILS:

PANELS FOR ANY FRAMING CONDITION SHOWN
HEREIN MAY BE SUPPLIED WITH
1/4" MONOLITHIC GLASS OR
7/16" LAMINATED GLASS
SEE GLAZING OPTION DETAILS ON SHEET 2

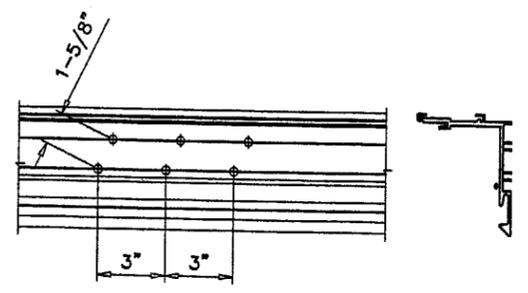

CLUSTER OF ANCHORS AT SILL

ANCHORS: SEE ELEV. FOR SPACING

1/4" TAPCONS BY ELCO, OR
AN EQUAL SELF TAPPING CONC. ANCHOR HOLDING A CURRENT NOA.
1-1/2" MIN. EMBED THRU WOOD BUCKS INTO MASONRY OR DIRECTLY INTO MASONRY
1-3/4" MIN. PENETRATION INTO WOOD STRUCTURE

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 18557

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *November 09, 2000*
BY *Manuel Jery*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0929.13*

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *November 09, 2000*
BY *Manuel Jery*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0929.13*

afsc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W00-42TS

SERIES 8000 ALUM. SLIDING GLASS DOOR
TRACO SECURITY WINDOWS & DOORS INC.
5100 N.W. 72 AVE.
MIAMI, FL. 33166
TEL. (305) 591-8990

revisions:	no	date	description




date: 08-25-00	scale: 1/2" = 1"
dr. by: HAMID	chk. by:

drawing no. **W00-42**
sheet 3 of 7

CLUSTER ● STILE ENDS	
ANCHORS CHART TO USE	
6	A-2
8	B

CLUSTER ● STILE ENDS	
ANCHORS CHART TO USE	
6	B

CLUSTER ● STILE ENDS	
ANCHORS CHART TO USE	
6	A-2
8	B

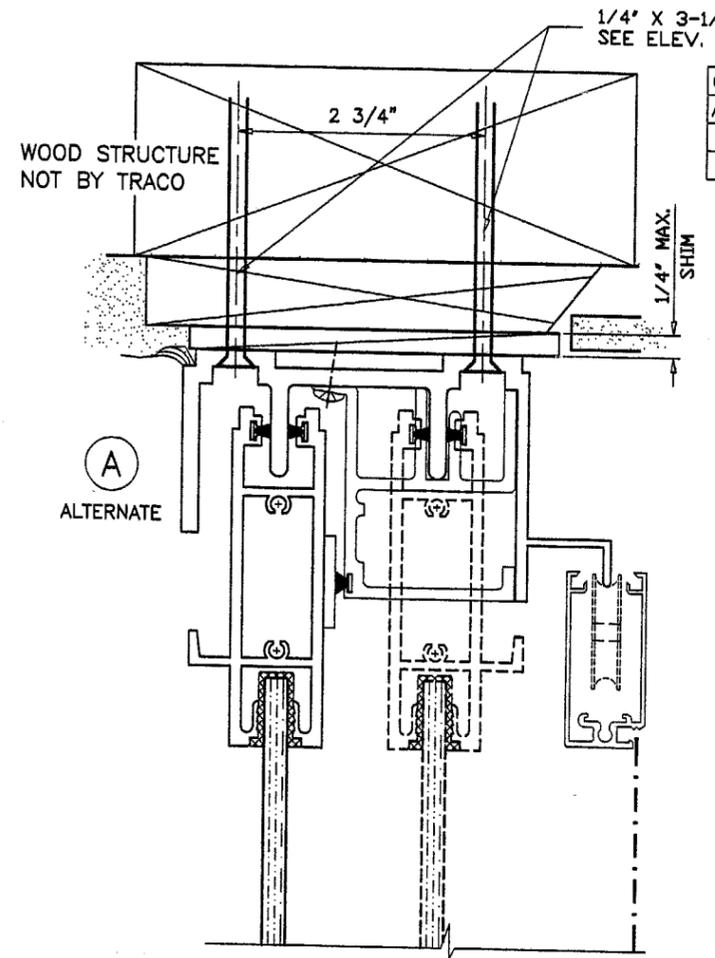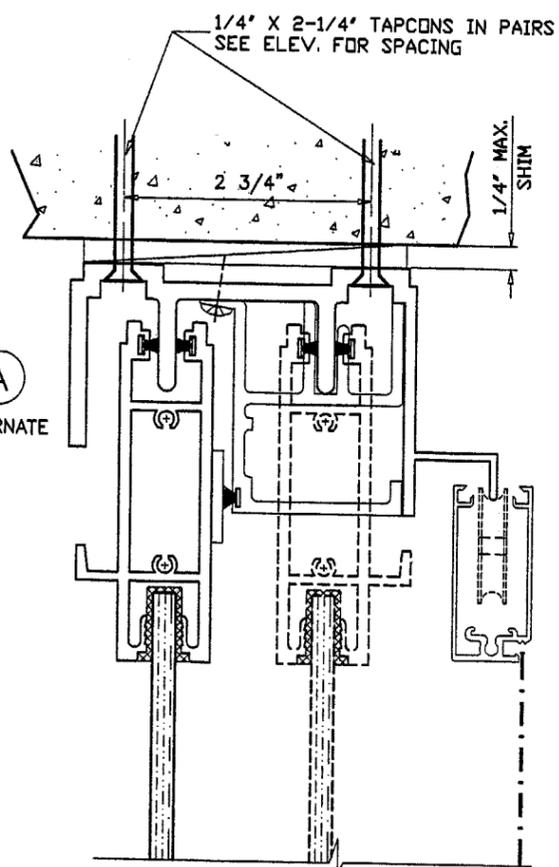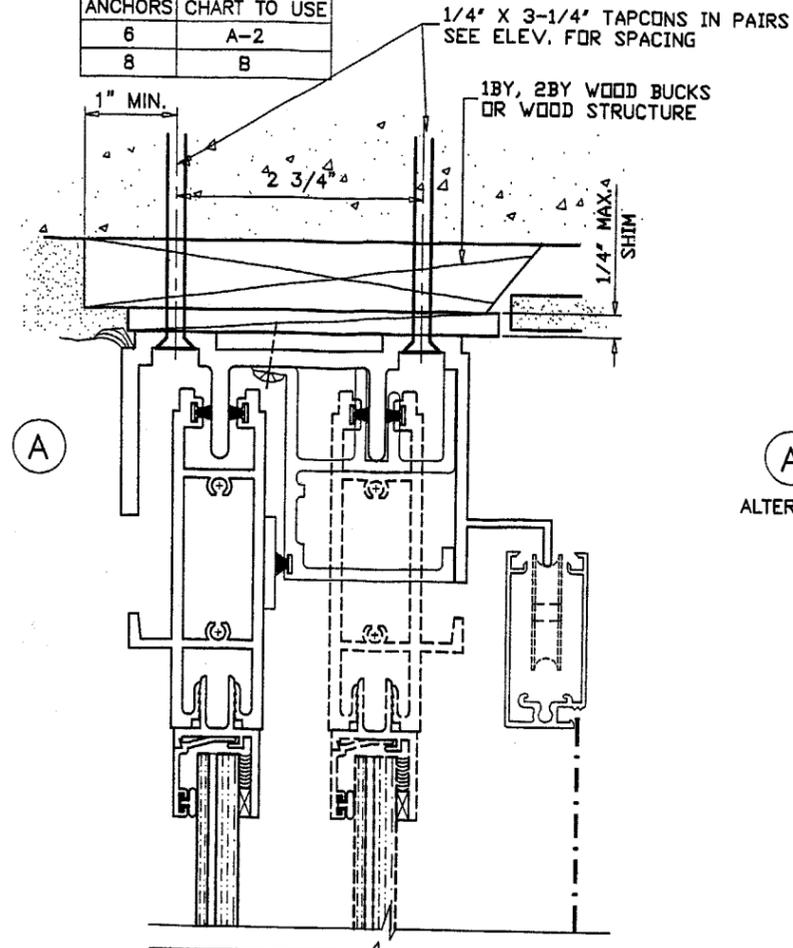

WOOD BUCKS NOT BY TRACO SECURITY, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

FRAME INSTALLATION DETAILS:
 PANELS FOR ANY FRAMING CONDITION SHOWN HEREIN MAY BE SUPPLIED WITH
 1/4" MONOLITHIC GLASS OR
 7/16" LAMINATED GLASS
 SEE GLAZING OPTION DETAILS ON SHEET 2

ANCHORS: SEE ELEV. FOR SPACING
 1/4" TAPCONS BY ELCO, OR
 AN EQUAL SELF TAPPING CONC. ANCHOR HOLDING A CURRENT NOA.
 1-1/2" MIN. EMBED THRU WOOD BUCKS INTO MASONRY OR DIRECTLY INTO MASONRY
 1-3/4" MIN. PENETRATION INTO WOOD STRUCTURE

3-1/2" WEEP NOTCH AT EACH END

1/4" TAPCONS, 1-3/4" EMBED IN STAGGERED PAIRS SEE ELEV. FOR SPACING

Engr: DR. HUMAYOON FAROOQ
 STRUCTURES
 FLA. PE # 16557

SEP 26 2000

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE *November 29, 2000*
 BY *Manuel Perez*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. *80-029.15*

a f c


AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL WOO-42/S

SERIES 8000 ALUM. SLIDING GLASS DOOR
TRACO SECURITY WINDOWS & DOORS INC.
 5100 N.W. 72 AVE.
 MIAMI, FL. 33166
 TEL (305) 591-8990

no	date	by	description

date: 08-25-00
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no. **WOO-42**
 sheet 4 of 7

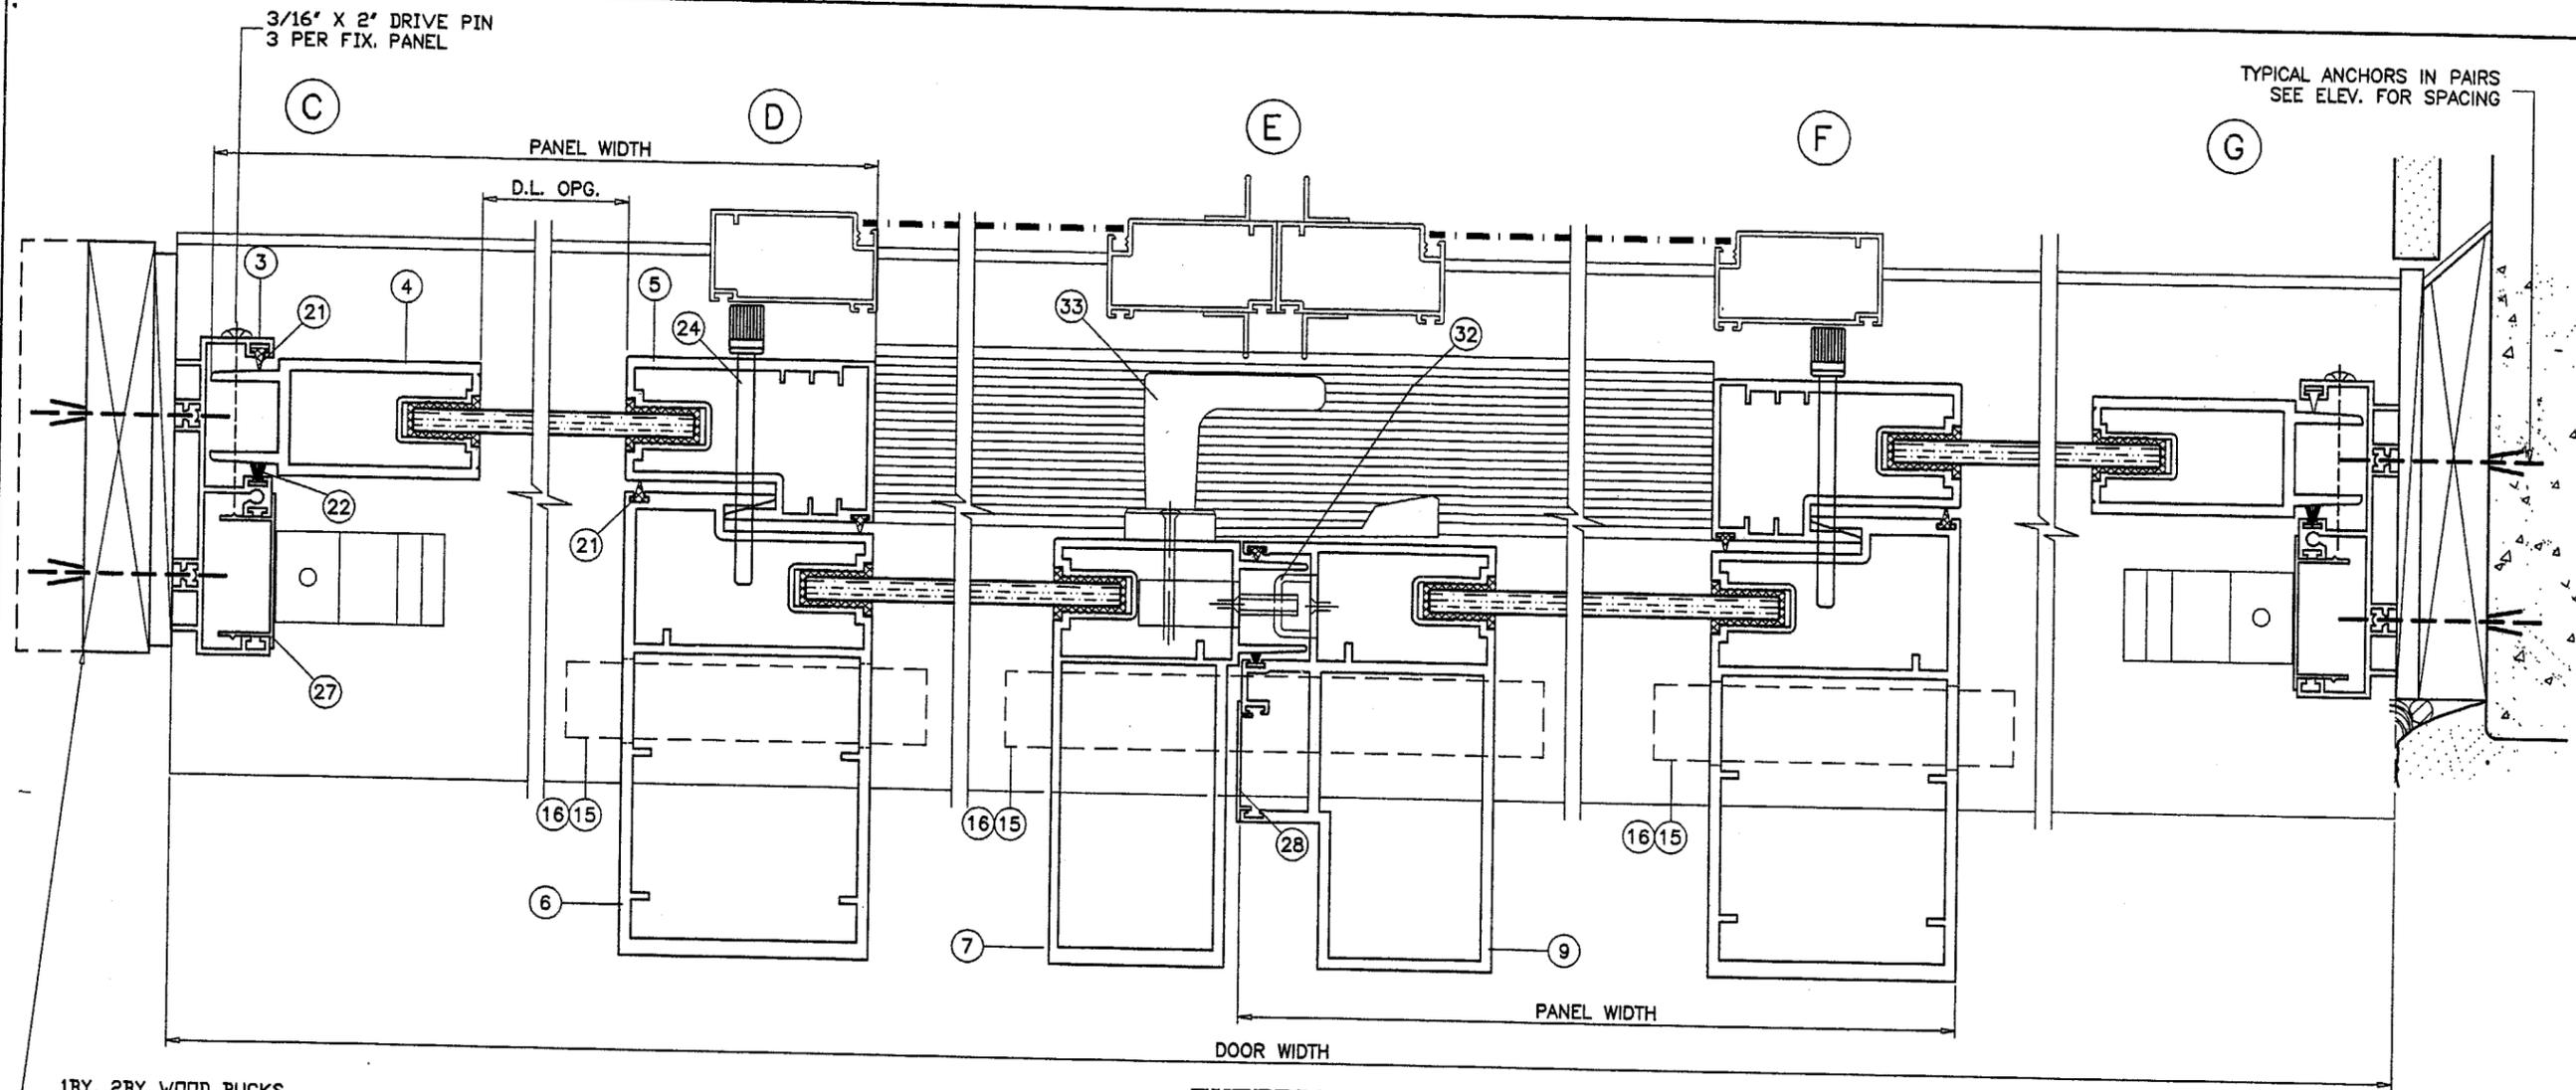

1BY, 2BY WOOD BUCKS
OR WOOD STRUCTURE

EXTERIOR

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

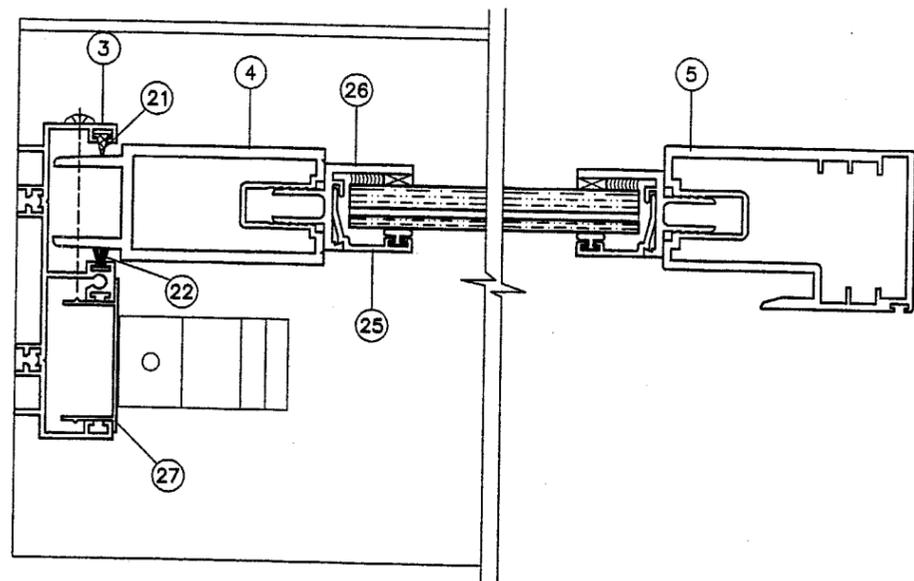

ANCHORS: SEE ELEV. FOR SPACING

1/4" TAPCONS BY ELCO, OR
AN EQUAL SELF TAPPING CONC. ANCHOR HOLDING A CURRENT NOA.
1-1/2" MIN. EMBED THRU WOOD BUCKS INTO MASONRY OR DIRECTLY INTO MASONRY
1-1/2" MIN. PENETRATION INTO WOOD STRUCTURE

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

DATE November 29, 2000
BY Manuel

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE November 29, 2000
BY Manuel
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-0929-16

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W00-42IS

SERIES 8000 ALUM. SLIDING GLASS DOOR
TRACO SECURITY WINDOWS & DOORS INC.
5100 N.W. 72 AVE.
MIAMI, FL. 33166
TEL. (305) 591-8990

revisions:	no	date	by	description

date: 08-25-00	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no. **W00-42**
sheet 5 of 7

FRAME TOP CORNER

FRAME BOTTOM CORNER

PANEL BOTTOM CORNER

PANEL TOP CORNER

MATERIALS LIST					
ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	050-633	1	FRAME HEAD	6063-T6	-
2	050-630	1	FRAME SILL	6063-T6	-
3	050-608	2	FRAME JAMB	6063-T6	-
4	051-643	AS REQD.	JAMB STILE	6063-T6	-
5	052-647	AS REQD.	INT. INTERLOCK	6063-T6	-
6	052-646	AS REQD.	EXT. INTERLOCK	6063-T6	-
7	052-644	AS REQD.	MALE STILE	6063-T6	-
8	050-609	AS REQD.	HEAD RECEPTOR	6063-T6	-
9	052-654	AS REQD.	FEMALE ASTRAGAL STILE	6063-T6	-
10	051-632	1/ PANEL	TOP RAIL	6005-T5	-
11	051-631	1/ PANEL	BOTTOM RAIL	6005-T5	-
12	050-635	1	THRESHOLD	6005-T5	-
13	050-636	1	HEAD COVER	6005-T5	-
14	050-611	1	SCREEN TRACK ADAPTER	6063-T6	-
15	050-648	AS REQD.	PRESSURE CLIP	6063-T6	7-7/8" LONG
16	050-649	AS REQD.	PRESSURE CLIP COVER	6063-T6	7-7/8" LONG
17	012-02-130	1/CORNER	PANEL ASSEMBLY SCREW	CRS	#10 X 1" PHPH SMS
18	012-02-131	-	FRAME ASSEMBLY SCREWS	CRS	#10 X 1" FH SMS
19	037-02-003	2/ MOV. PANEL	TANDEM STEEL WHEEL ASSEMBLY	-	TRUTH OR EQUIV.
20	046-00-031	AS REQD.	1/4" GLAZING VINYL	SOFT VINYL	WIBORG WV-5826
21	-	AS REQD.	FLAP WEATHERSTRIPPING	SOFT VINYL	-
22	-	AS REQD.	PILE W'STRIPPING WITH PLASTIC FIN	-	BY AMESBURY OR EQUIV.
23	-	1	FLUSH MOUNT HOOK LOCK WITH KEEPER	-	AT 42" FROM BOTTOM
24	-	-	3/16" DIA. SECURITY PIN	ST. STEEL	AT 48" FROM BOTTOM
25	050-749	AS REQD.	GLAZING BEAD (7/16" GLASS)	6063-T5	-
26	050-752	AS REQD.	ADAPTER (7/16" GLASS)	6063-T5	-
27	050-529	AS REQD.	JAMB COVER	6063-T5	-
28	050-660	AS REQD.	SNAP COVER	6063-T6	-
29	046-00-010	AS REQD.	BULB VINYL	-	WIBORG WV-3134
30	-	007-084	DEAD LOCK & LATCH	-	ADAMS RITE
31	013-00-033	-	3/16" X 2" DRIVE PIN	-	RAWL
32	007-00-115	-	KEEPER	-	TRUTH
33	007-10-114	-	HANDLE	-	TRUTH

afc
AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W00-42TS


SERIES 8000 ALUM. SLIDING GLASS DOOR
TRACO SECURITY WINDOWS & DOORS INC.
 5100 N.W. 72 AVE.
 MIAMI, FL. 33166
 TEL. (305) 591-8990

revisions:	no	date	by	description


Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557
 SEP 20 2000
17

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE *November 09, 2000*
 BY *Maunel*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. *00-0929-157*


date: 08-25-00
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W00-42
 sheet 6 of 7

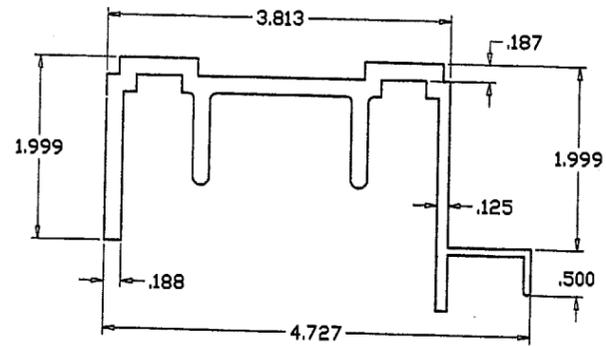


FRAME HEAD

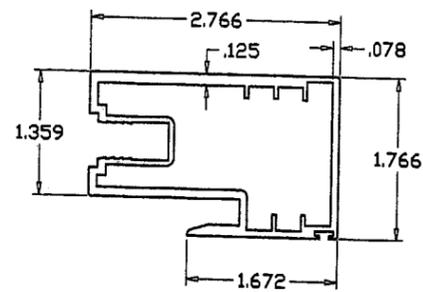


INTERLOCK

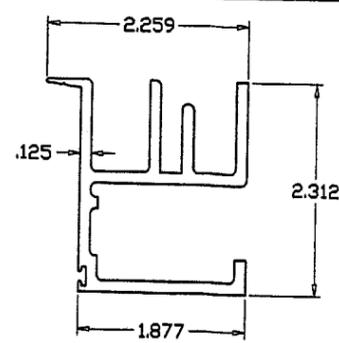

HEAD FILLER

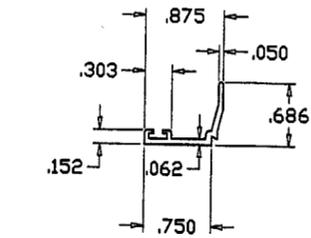


GLAZING BEAD 7/16" GLASS

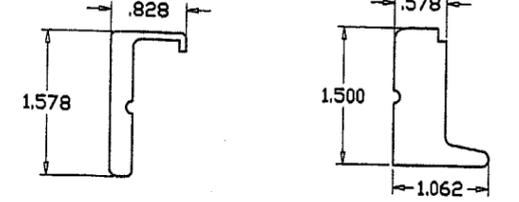


PRESSURE CLIP COVER


PRESSURE CLIP

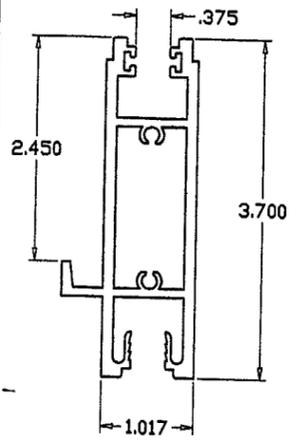


TOP RAIL

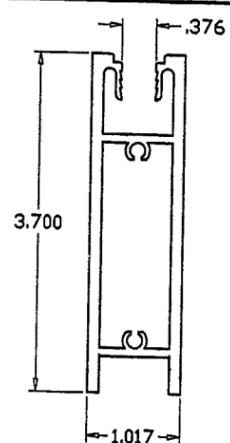


BOTTOM RAIL

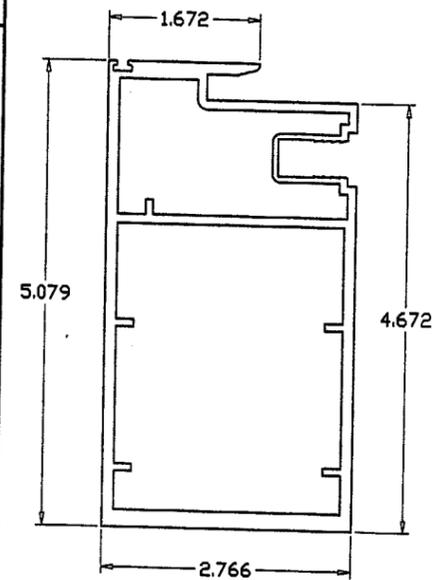


INTERLOCK

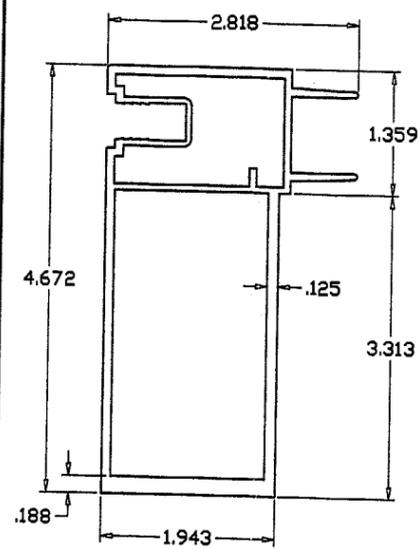


LOCK STILE

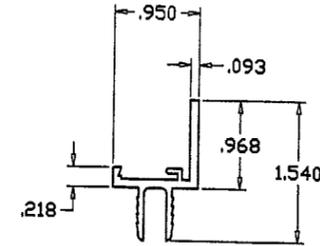


ADAPTER 7/16" GLASS

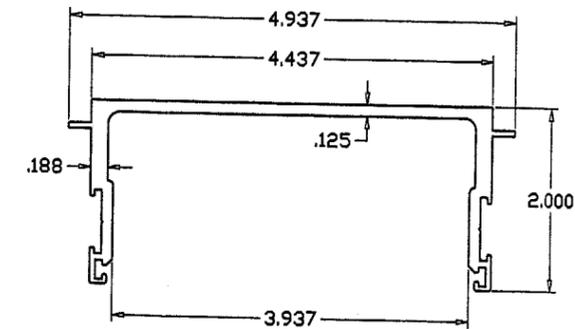


HEAD RECEPTOR

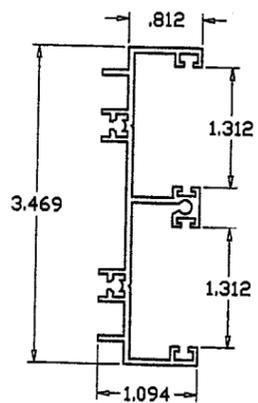


FRAME JAMB

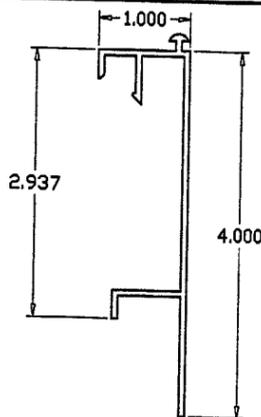


SCREEN TRACK

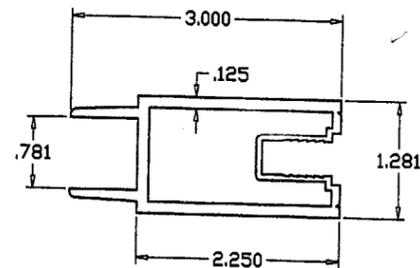


JAMB STILE

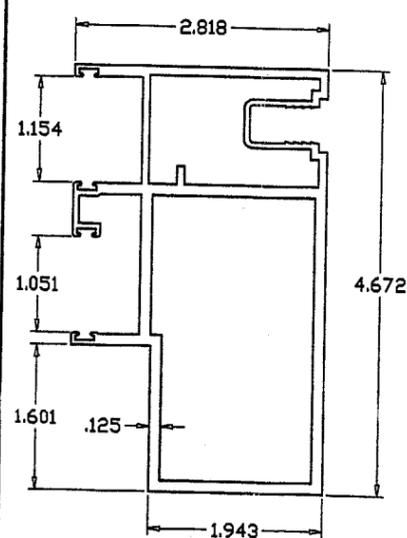


MEETING STILE




JAMB COVER

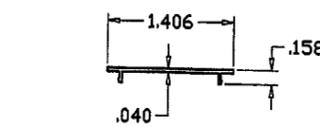

SNAP COVER

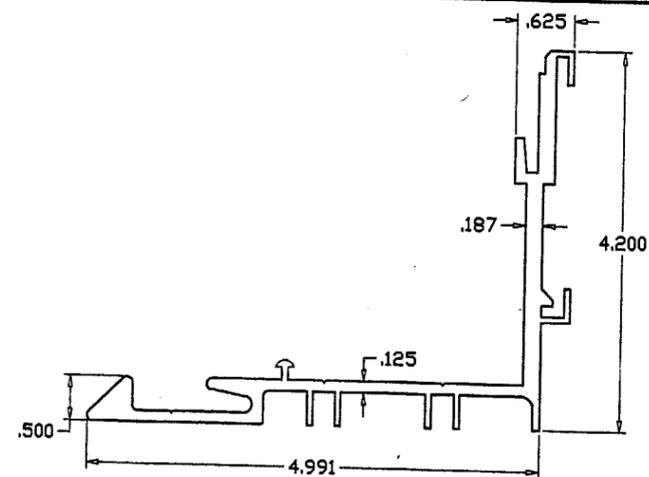

FRAME SILL

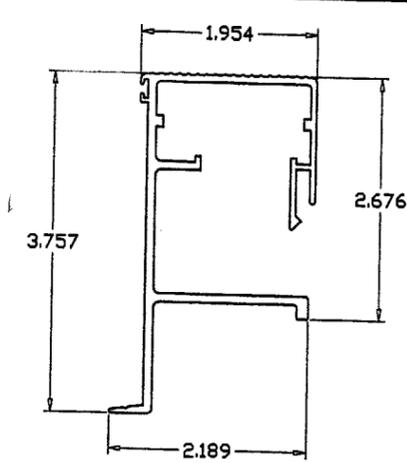

THRESHOLD

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557

DATE: *November 29, 2000*
BY: *Manuel Suez*
SFP 2.6 2000

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE: *November 29, 2000*
BY: *Manuel Suez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-0929.15*

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL WOO-42TS

SERIES 8000 ALUM. SLIDING GLASS DOOR
TRACO SECURITY WINDOWS & DOORS INC.
5100 N.W. 72 AVE.
MIAMI, FL. 33166
TEL. (305) 591-8990

no	date	by	description

date: 08-25-00
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no. **WOO-42**
sheet 7 of 7