



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Pozzi Window Company
62845 Boyd Acres Rd. (P.O. Box 5249)
Bend ,OR 97701

Your application for Notice of Acceptance (NOA) of:

Series "Direct Set" Aluminum Clad Wood Fixed Windows - Impact Resistant

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez
Chief Product Control Division

ACCEPTANCE NO.: 00-1003.02
EXPIRES: 02/26/2006

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 02/15/2001

Pozzi Window Company

ACCEPTANCE No. : 00-1003.02

APPROVED : FEB 15 2001

EXPIRES : February 26, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. SCOPE

- 1.1 This revises and renews the Notice of Acceptance No. 97-0421.01, which was issued on February 26, 1998. It approves an aluminum clad wood fixed window, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1 The Series "Direct Set" Aluminum Clad Wood Fixed Window – Impact Resistant and its components shall be constructed in strict compliance with the following documents: Drawing No. DS-1, titled "Pozzi Aluminum Clad Direct Set Fixed Windows," prepared by R.W. Building Consultants, Inc., dated 9/9/97, with revision #1 dated 8/16/00, Sheets 1 thru 4 of 4, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1 This approval applies to single unit applications only, as shown in approved drawings.

4. INSTALLATION


- 4.1 The aluminum clad wood fixed window and its components shall be installed in strict compliance with the approved drawings.
- 4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.

5. LABELING

- 5.1 Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance.
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

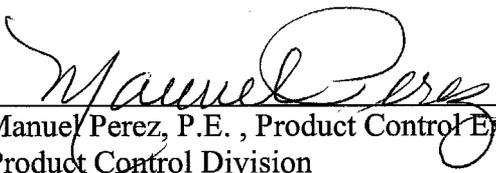
Manuel Perez, P.E., Product Control Examiner
Product Control Division

Pozzi Window Company

ACCEPTANCE No. : 00-1003.02


APPROVED : FEB 15 2001

EXPIRES : February 26, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approval", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE

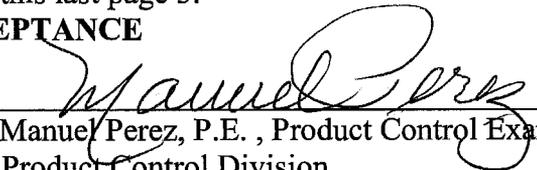
Manuel Perez, P.E., Product Control Examiner
Product Control Division

Pozzi Window Company

ACCEPTANCE No. : 00-1003.02

APPROVED : FEB 15 2001

EXPIRES : February 26, 2006

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA.)

A. DRAWINGS


1. Manufacturer's die drawings and sections.
2. Drawing No. **DS-1**, titled "Pozzi Aluminum Clad Direct Set Fixed Windows," prepared by R.W. Building Consultants, Inc., dated 9/9/97, with revision #1 dated 8/16/00, Sheets 1 thru 4 of 4

B. TESTS

1. Test report on: 1) Large Missile Impact Test, SFBC PA 201-94
2) Cyclic Loading Test, per SFBC PA 203-94
along with installation diagram of an aluminum clad wood fixed window, overall size 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0412-00**, dated 04/19/00, signed and sealed by Vinu J. Abraham, P.E.
2. Test report on: 1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
4) Large Missile Impact Test, SFBC PA 201-94
5) Cyclic Loading Test, per SFBC PA 203-94
along with installation diagram of aluminum clad wood fixed windows, overall sizes: 42" wide x 84" high & 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0803-99**, dated 8/16/99, signed and sealed by Vinu J. Abraham, P.E.
3. Test report on: 1) Large Missile Impact Test, SFBC PA 201-94
2) Cyclic Loading Test, per SFBC PA 203-94
along with installation diagram of an aluminum clad wood fixed window, overall size 60" wide x 120" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-0724-98**, dated 07/30/98, signed and sealed by Vinu J. Abraham, P.E.

Submitted under original file No. 97-0421.01

4. Test report on:
1) Air Infiltration Test, per PA 202-94
2) Uniform Static Air Pressure Test, Loading per PA 202-94
3) Water Resistance Test, per PA 202-94
4) Large Missile Impact Test, SFBC PA 201-94
5) Cyclic Loading Test, per SFBC PA 203-94
along with installation diagram of an aluminum clad wood fixed window, overall size 48" wide by 96" high, prepared by Hurricane Test Laboratory, Inc., report No. **HTL-0112-1007-96**, dated October 08, 1996 signed and sealed by Timothy S. Marshall, P.E.

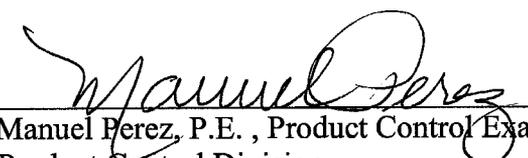
Manuel Perez, P.E., Product Control Examiner
Product Control Division

Pozzi Window Company

ACCEPTANCE No. : 00-1003.02

APPROVED : FEB 15 2001

EXPIRES : February 26, 2006

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA.)

C. CALCULATIONS

1. Anchor calculations dated 9/25/00, prepared, signed and sealed by Mark Fetherman, P.E.
Submitted under file No. 97-0421.01
2. Anchor calculations prepared by Tilteco Inc. dated 9/19/97, signed and sealed by Walter A. Tillit Jr., P.E.

D. MATERIAL CERTIFICATIONS

Submitted under file No. 97-0421.01

1. Notice of Acceptance No. **97-0527.04** issued to Nebula Glass International Inc. for "Glasslam Safety-Plus Laminated Glass" dated 09/09/97, expiring on 09/09/00.

E. STATEMENTS


1. Statement letter of no financial interest, dated August 08, 2000, signed and sealed by Dan Stokes, Technical Services Manager of Pozzi Window Company.
2. Statement letter of conformance, dated September 25, 2000, signed and sealed by Mark C. Fetherman, P.E.
3. Laboratory compliance letter for Test Reports No. HTL-0112-0724-98, 0112-0803-99 and 0112-0412-00, issued by Hurricane Test Laboratory, Inc., dated June 19, 2000, signed and sealed by Vinu J. Abraham, P.E.

Submitted under file No. 97-0421.01

4. Statement letter of conformance, dated November 11, 1997, signed and sealed by Walter A. Tillit Jr., P.E.
5. Statement letter of no financial interest, dated October 27, 1997, signed and sealed by Kelvin A. Campbell, P.E.

F. OTHER

1. This NOA renews NOA No. 97-0421.01, which was approved on 02/26/98, and expires on 02/26/01.

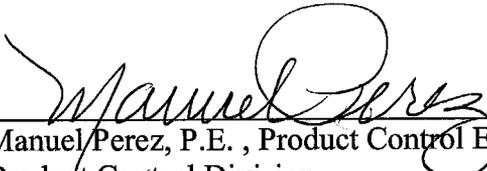
Manuel Perez, P.E., Product Control Examiner
Product Control Division

POZZI WINDOW COMPANY

ALUMINUM CLAD WOOD WINDOWS
FIXED FRAME DIRECT SET SERIES

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS ARE NOT REQUIRED.
5. FOR DESIGN PRESSURE RATING SEE CHART THIS PAGE:

DIRECT SET FIXED WINDOW CONSTRUCTION (Common to all conditions)

Wood Frame Construction: The wood frame is 1.21875" x 3.28125" Ponderosa Pine. The corners are coped, butted and sealed. Each corner is fastened with (2) 1.5" L x .375" W. staples and (1) corner key. A wood frame extension of Ponderosa Pine .6875" x 1.375" is attached to the head, sill and jambs on the interior with 15ga. x 2" L. finish nails.

Aluminum Cladding: Custom extrusions of 6063-T5 aluminum 1.916" x 2.023" x .055" thk. wall





Window Construction: The aluminum cladding is tongue and groove fit to the wood frame with mitered corners and secured with (2) #6 x 2" screws per corner. It is secured to the wood frame with .375" W. x 1" L. wire staples spaced at 24" O.C. An aluminum drip cap/nailling flange is snap fitted to the head of the window and a PVC nailling flange is snap fitted to the jambs and sill.

Glazing Method: The interior and exterior are both glazed with .125" x .5" glazing tape and Dow Corning 1199. The interior side has a wood glass stop attached to the frame with 15ga. x 1.25" finish nails at 2" in from the coeners and 12" O.C.

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATION
2	VERTICAL CROSS SECTION, B.O.M. & COMPONENTS
3	HORIZONTAL CROSS SECTIONS & GLAZING DETAIL
4	ANCHORING LOCATIONS & DETAILS

DESIGN PRESSURE RATING ALL MODELS SHOWN

DAYLIGHT OPNG.	DESIGN PRESSURE RATING (PSF)	GLASS TYPE AND THICKNESS
35.01 TO 45.7 SQ. FT.	+ 46.3 PSF - 46.3 PSF	1/2" LAM. ANNEALED GLASS
0.0 TO 35.0 SQ. FT.	+ 60.0 PSF - 60.0 PSF	1/2" LAM. ANNEALED GLASS
0.0 TO 22.5 SQ. FT.	+ 60.0 PSF - 60.0 PSF	3/8" LAM. ANNEALED GLASS

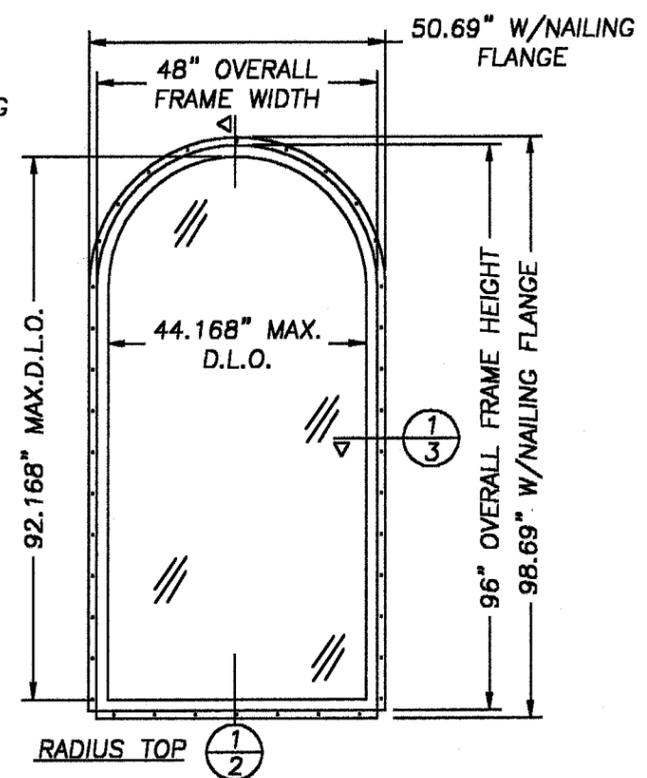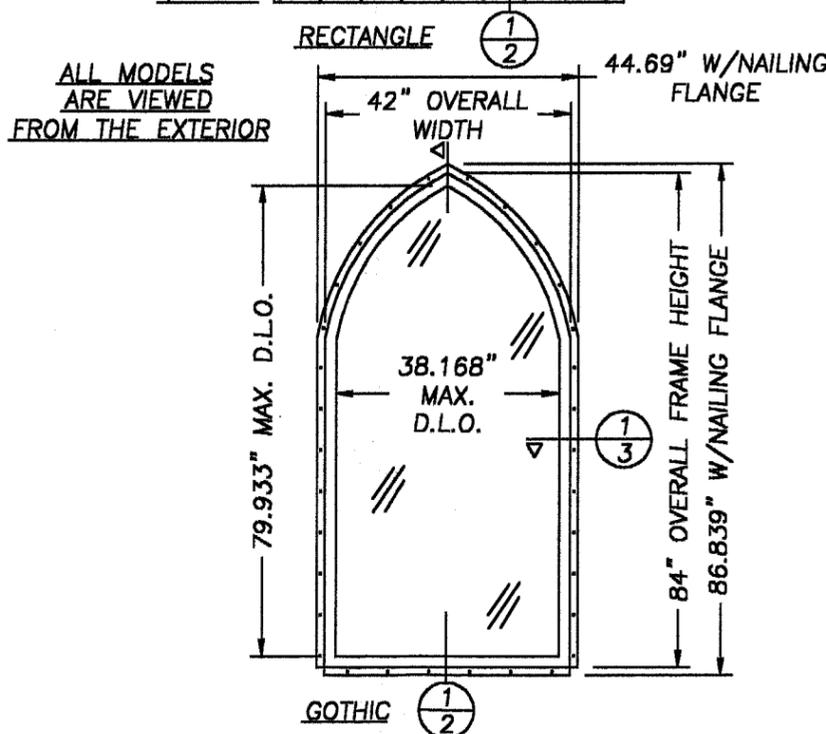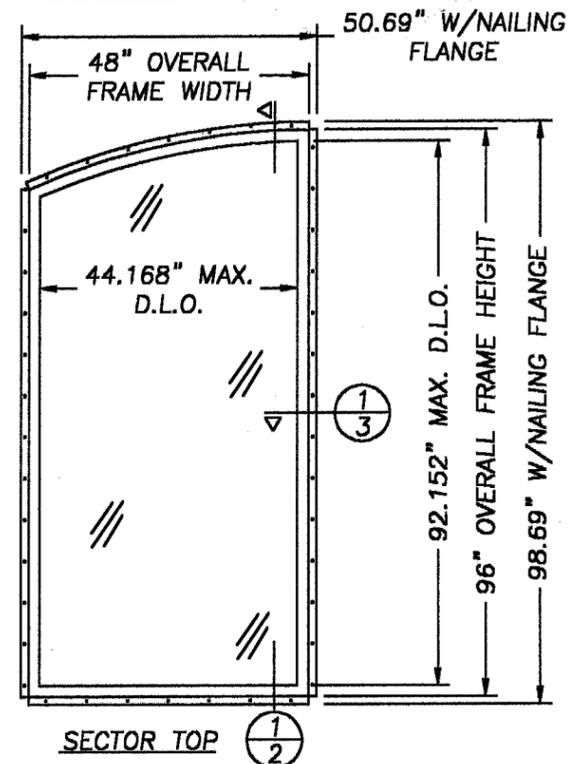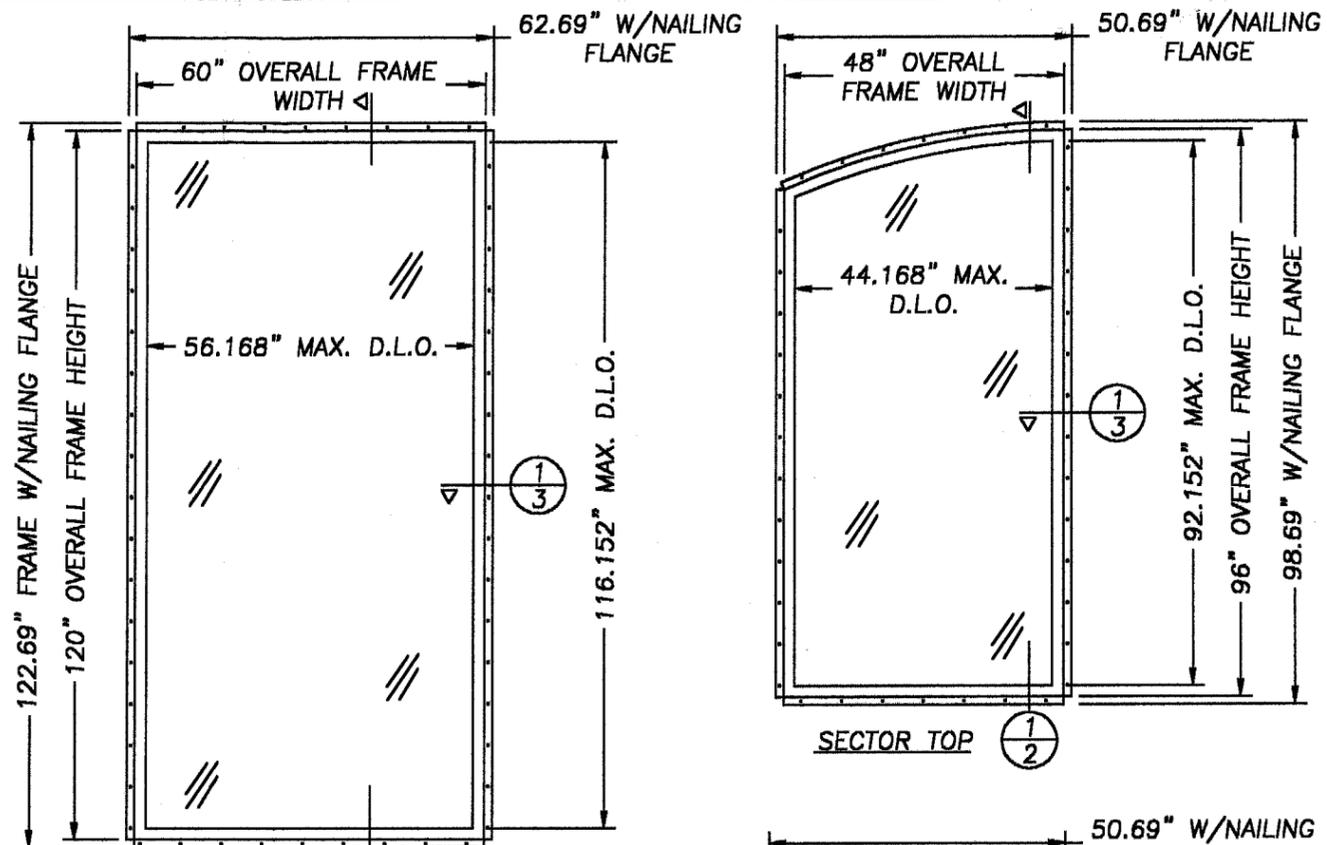

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411





PRODUCT: POZZI ALUMINUM CLAD DIRECT SET FIXED WINDOWS WINDOWS UP TO 60" x 120"
PART OR ASSEMBLY:
GENERAL NOTES & TYPICAL ELEVATION

NO.	DATE	GENERAL REVISION	TJH	BY
1	8/16/00			





RW BUILDING CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE: February 2001
BY: Manuel Perez
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-1003.02

DATE: 9/9/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.: DS-1
SHEET 1 OF 4

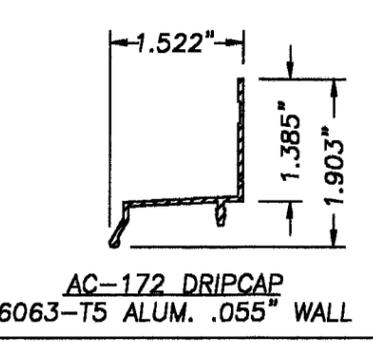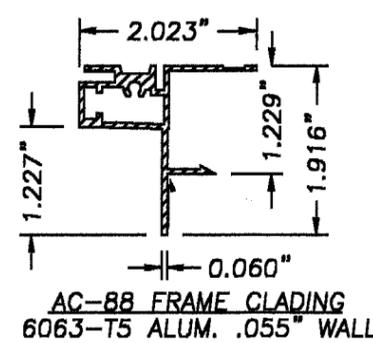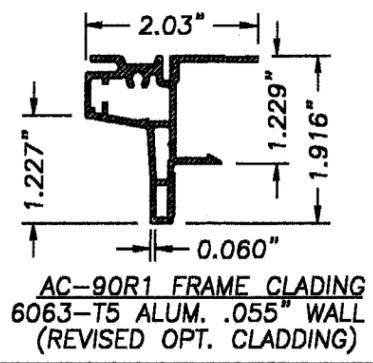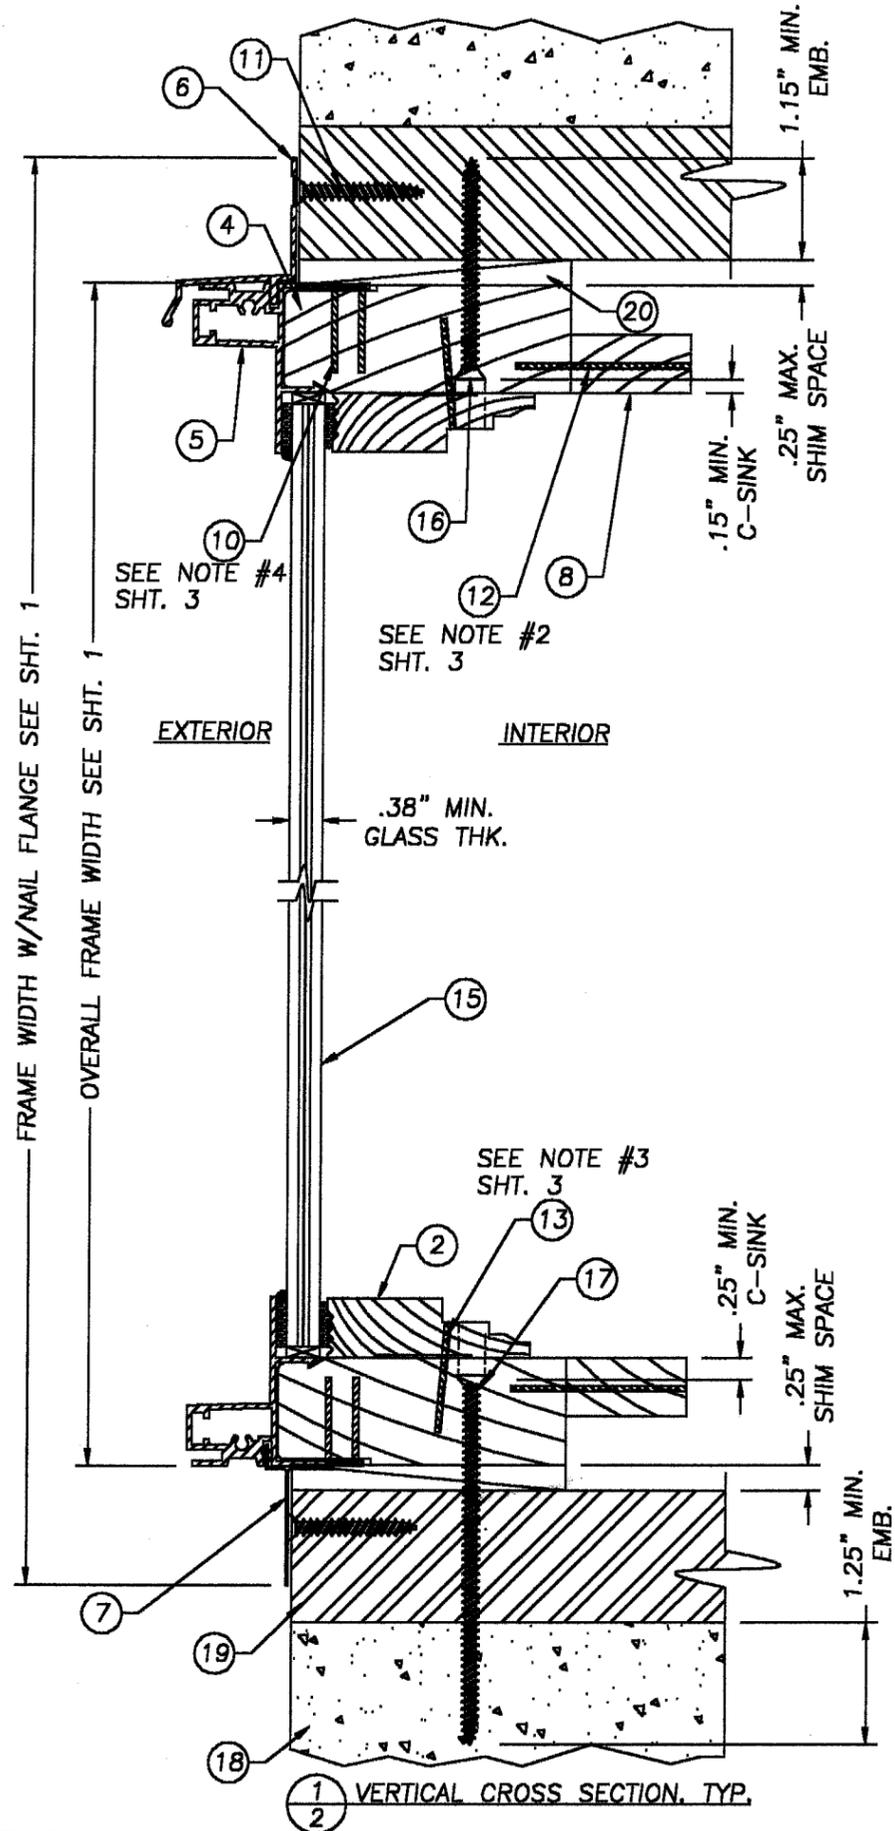

Item	Description	Material
1	1/8"x1/2" LIN. GLAZING TAPE (BY VENTURE)	
2	GLASS STOP LINEAL (#AC-173 BEND MILLWORKS)	CLEAR PINE
3	FRAME CORNER KEY (#AC-74 MITCHELL METAL)	6061-T6511 ALUM.
4	WOOD FRAME F/J LINEAL (#AC-151 BEND MILLWORKS)	PONDEROSA PINE
5	FRAME CLADING LINEAL EXTRUSION (#AC-88 ANODIZING INC.)	6063-T5 ALUM.
	FRAME CLADING LINEAL EXTRUSION (#AC-90R1 ANODIZING INC.) OPTIONAL REVISED CLADDING	6063-T5 ALUM.
6	ALUMINUM DRIP CAP LINEAL (#AC-172 ANODIZING INC.)	6063-T5 ALUM.
7	VINYL NAIL FLANGE LINEAL (#AC-36 PLASTIC PROFILES INC.)	PVC
8	WOOD JAMB EXTENSION (#AC-11 BEND MILLWORKS)	CLEAR PINE
9	3/8" x 1-1/2" WIRE STAPLES (STANLEY/BOSTICH)	STEEL
10	3/8" x 1" WIRE STAPLES (STANLEY/BOSTICH)	STEEL
11	#8 x 1 1/2" PH.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
12	15GA. x 2" FINISH NAIL (STANLEY/BOSTICH)	STEEL
13	15GA. x 1 1/4" FINISH NAIL (STANLEY/BOSTICH)	STEEL
14	GLAZING COMPOUND (DOW CORNING SILICONE #1199)	SILICONE
15	3/8" LAMINATED GLASS (SAFTY PLUS BY GLASSLAM GLAZING)	
	1/2" LAMINATED GLASS (SAFTY PLUS BY GLASSLAM GLAZING)	
	SEE DESIGN PRESSURE RATING TABLE SHEET 1	
16	#8 x 2 1/2" PH.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL
17	TAPCON ANCHOR 1/4" x 4"	STEEL
18	MASONRY WALL	CONC.
19	2x WOOD BUCK	WOOD
20	1/4" SHIM	
21	#6 x 2" PH.F.H. WOOD SCREW (CROWN FASTENERS)	STEEL

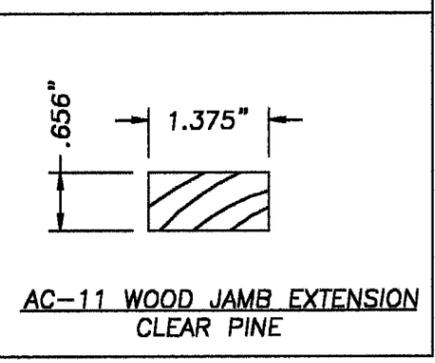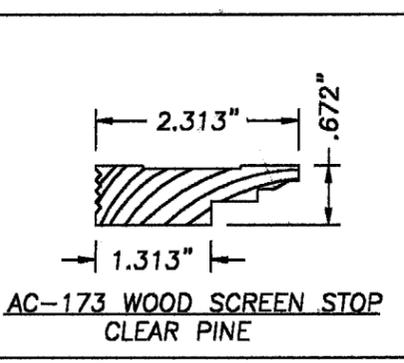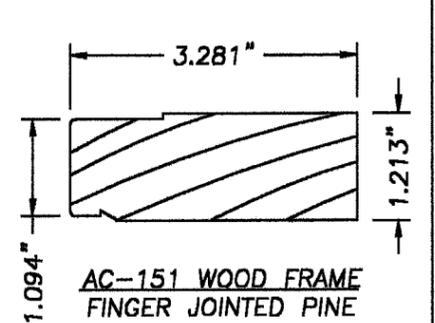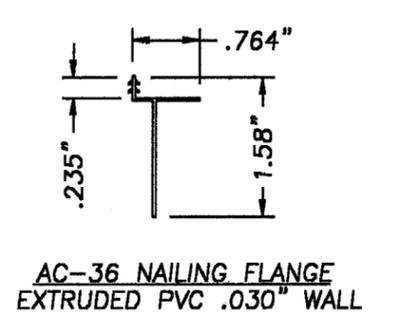

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD DIRECT SET WINDOWS UP TO 60" x 120"
PART OR ASSEMBLY: VERTICAL CROSS SECTION B.O.M. & COMPONENTS

NO.	DATE	GENERAL REVISION	TJH	BY
1	8/16/00			


RW BUILDING CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE February 15, 2001
BY *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-1003.02


DATE: 9/9/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.: DS-1
SHEET 2 OF 4

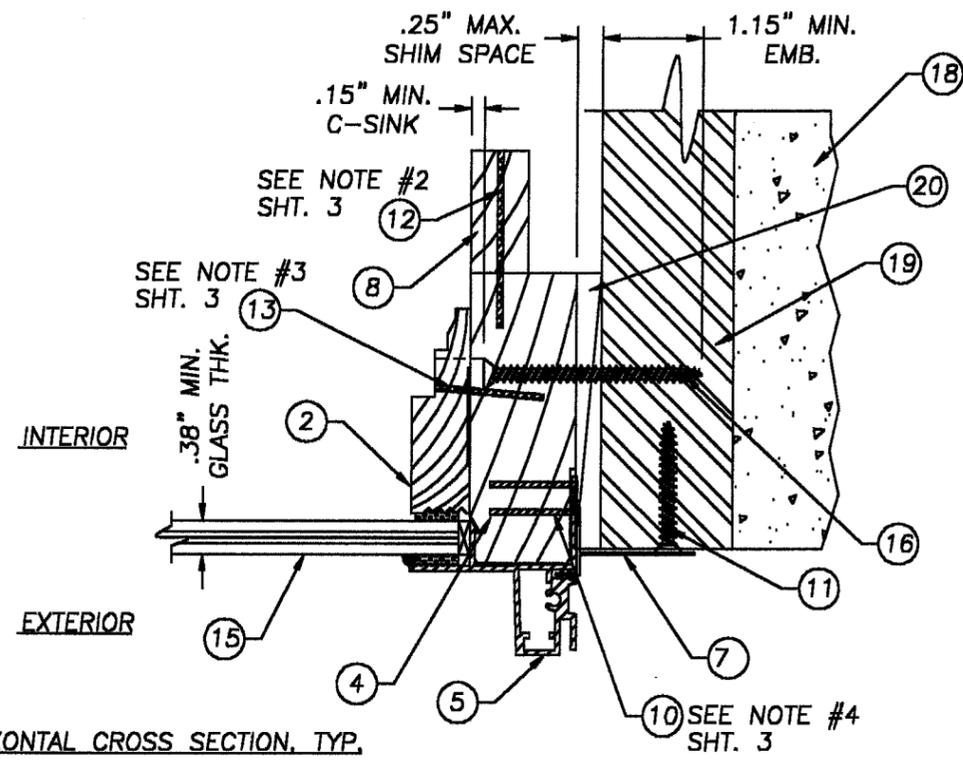


1 HORIZONTAL CROSS SECTION, TYP.
3

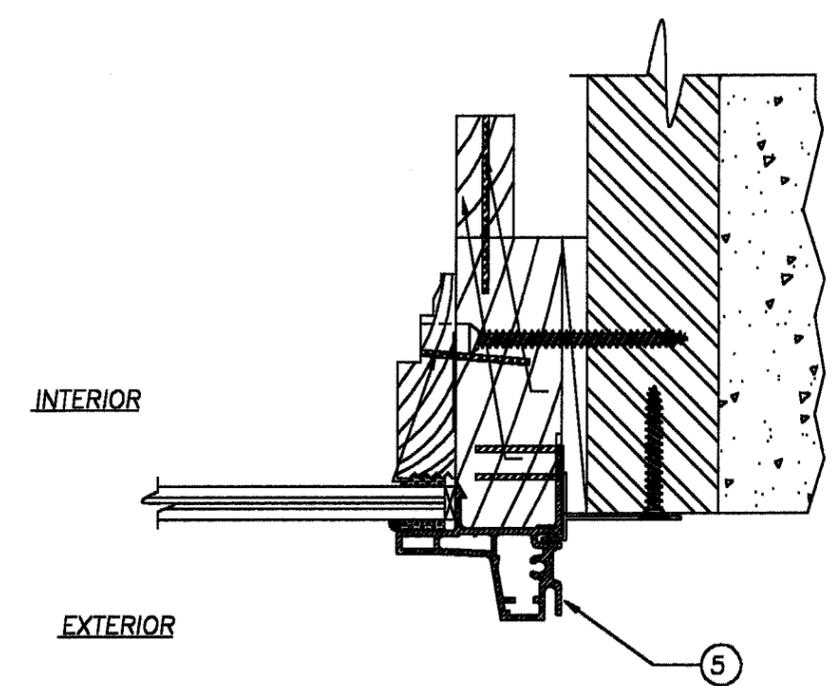

1 HORIZONTAL CROSS SECTION, TYP.
3 OPTIONAL REVISED FRAME CLADDING

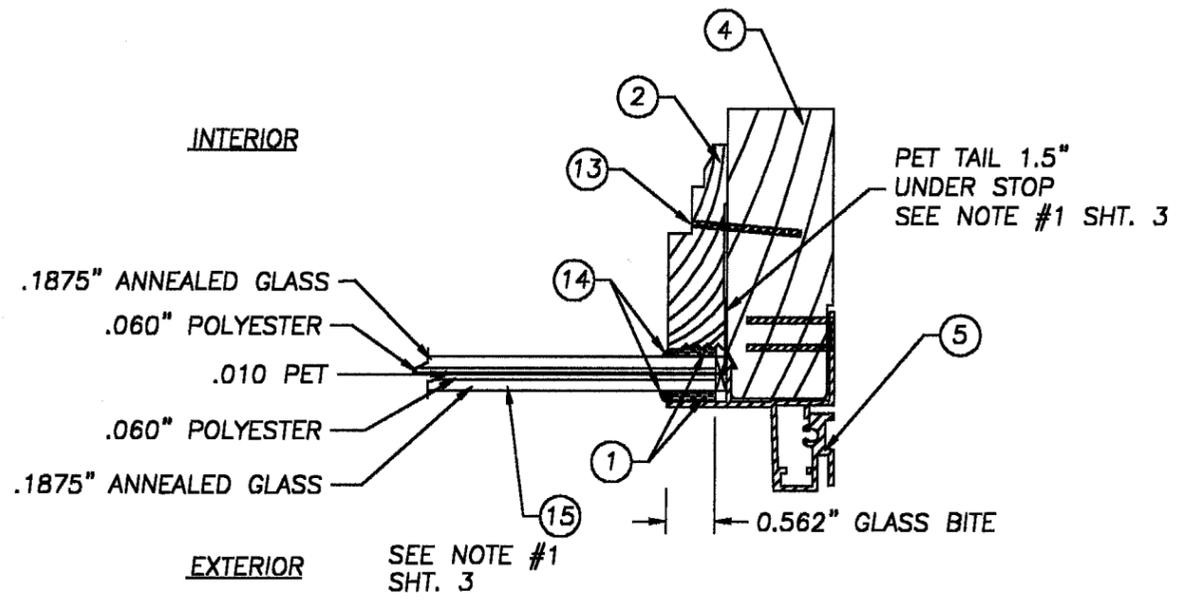

GLAZING DETAIL
1/2" LAMINATED ANNEALED GLASS
SAFTY PLUS BY GLASLAM GLAZING

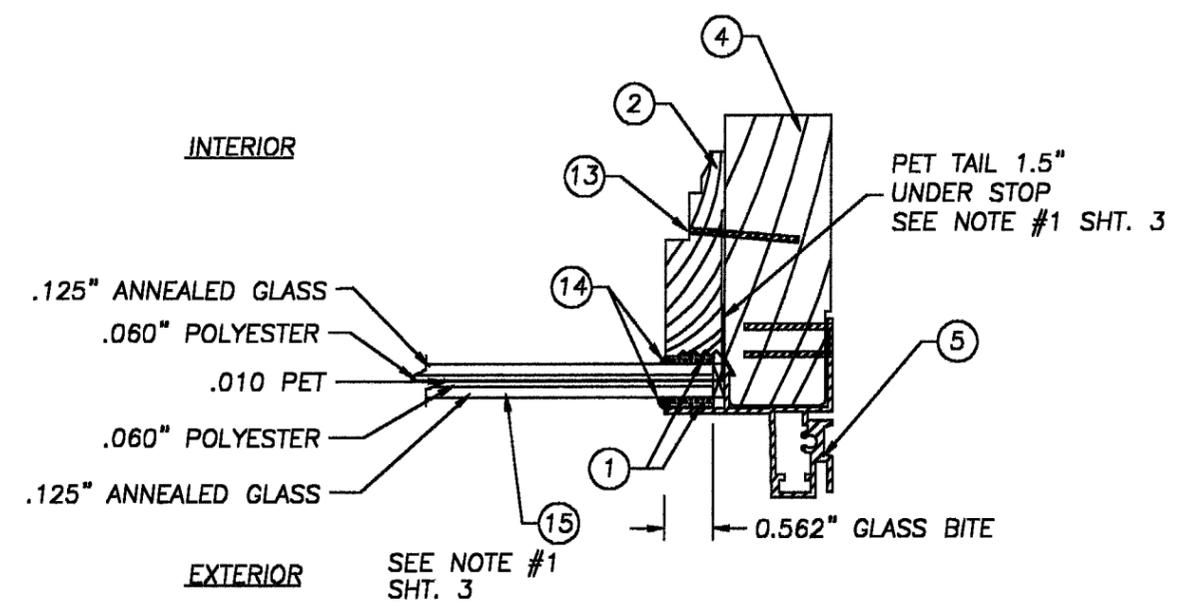

GLAZING DETAIL
3/8" LAMINATED ANNEALED GLASS
SAFTY PLUS BY GLASLAM GLAZING

- NOTES:
1. THE PET FILM EXTENDS 1.5" BEYOND THE EDGE OF THE GLASS PLATE TO ALLOW THE FILM TO BE MECHANICALLY FASTENED AND SILICONED TO THE WINDOW FRAME.
 2. SPACING FOR ITEM #12 IS AS FOLLOWS: 2" IN FROM THE CORNERS AND 12" O.C.
 3. SPACING FOR ITEM #13 IS AS FOLLOWS: 2" IN FROM THE CORNERS AND 12" O.C.
 4. SPACING FOR ITEM #10 IS AS FOLLOWS: 1" IN FROM THE CORNERS AND 24" O.C.

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD DIRECT SET WINDOWS UP TO 60" x 120"
PART OR ASSEMBLY: HORIZONTAL CROSS SECTION & GLAZING DETAIL

NO.	DATE	GENERAL REVISION	TJH	BY
1	8/16/00			


RW BUILDING CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE February 15, 2001
BY Manuel
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-1003-02

DATE: 9/9/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.: DS-1
SHEET 3 OF 4

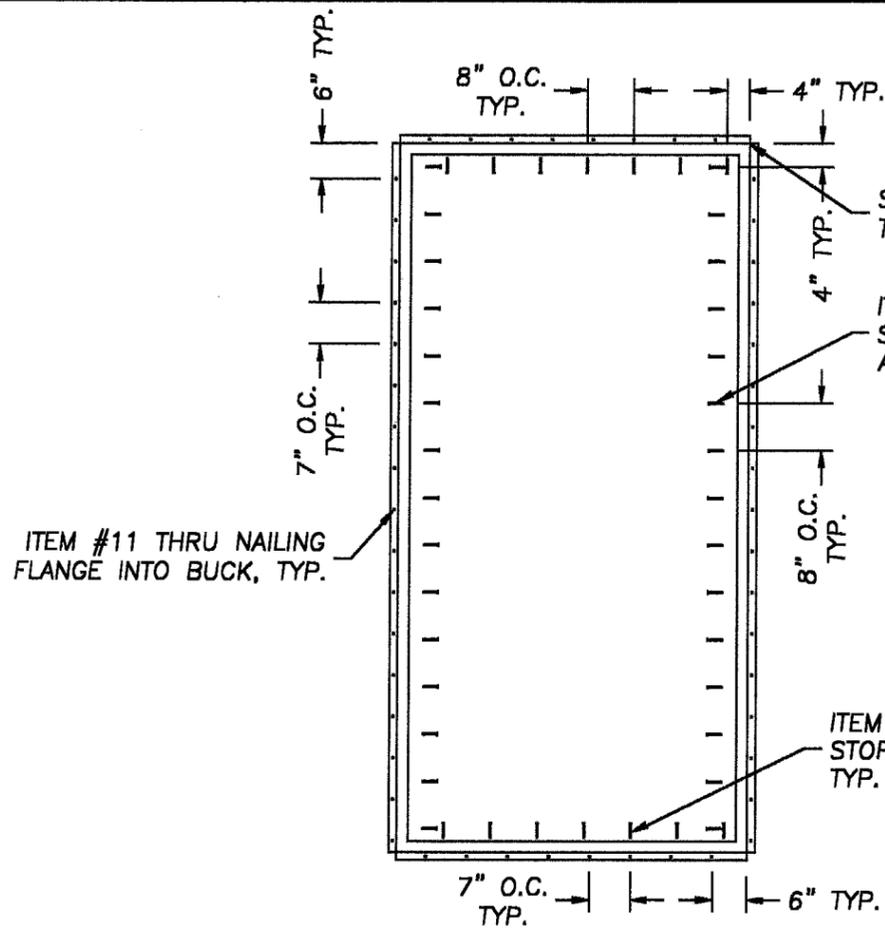


RECTANGLE

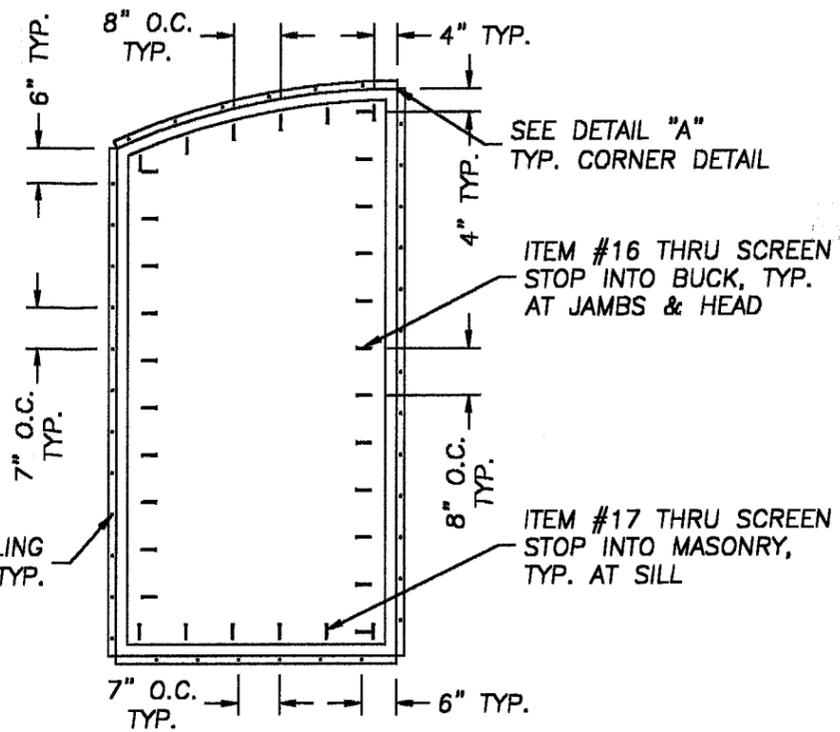


SECTOR TOP


NOTE:
THE SCREW SPACING AT THE TOP AND BOTTOM ARE THE SAME FOR ALL MODELS.

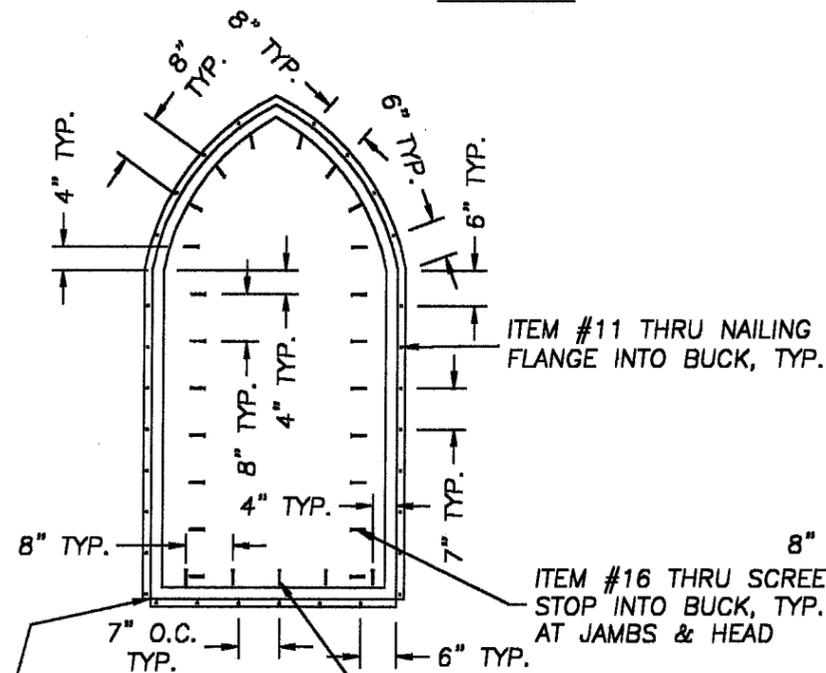

GOthic

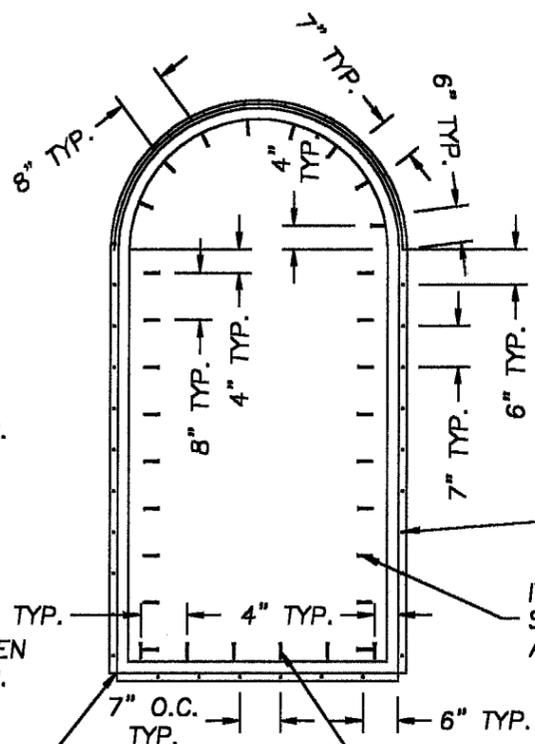

RADIUS TOP

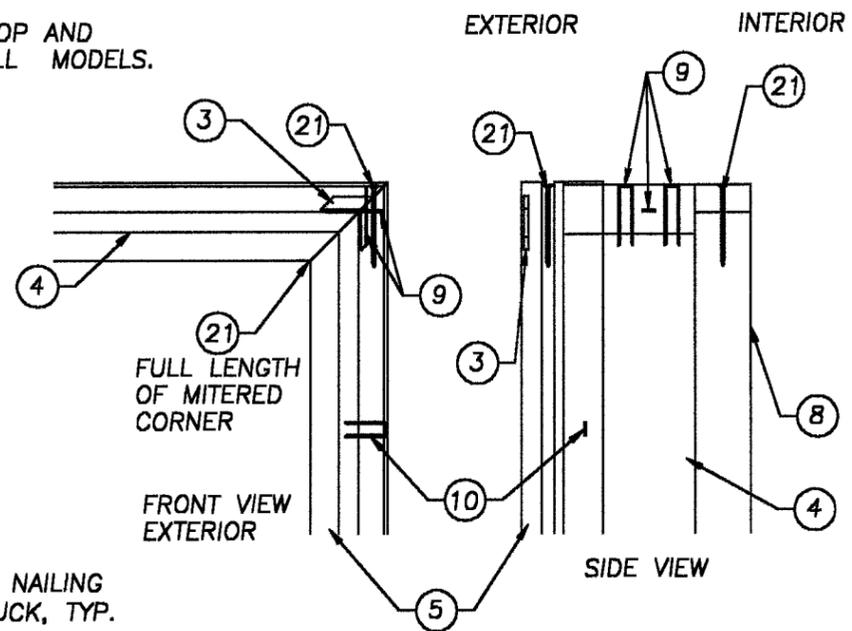

DETAIL "A"
TYP. CORNER DETAIL
N.T.S.

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD DIRECT SET FIXED WINDOWS WINDOWS UP TO 60" x 120"
PART OR ASSEMBLY: ANCHORING LOCATIONS AND DETAILS

NO.	DATE	GENERAL REVISION	TJH	BY
1	8/16/00			

RW BUILDING CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE February 11, 2001
BY *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-1003.02

DATE: 9/9/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.: DS-1
SHEET 4 OF 4