



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Jeld-Wen, Inc**  
**3250 Lakeport Drive**  
**Klamath Falls ,OR 97601**

Your application for Notice of Acceptance (NOA) of:

**Jeld-Wen Series "Nord/Morgan " Outswing Glazed Double Wood Door w/ Surface bolts**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**ACCEPTANCE NO.: 00-1006.06**  
**EXPIRES: 04/26/2004**

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL**  
**CONDITIONS**  
**BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 04/26/2001**

**Jeld-Wen, Inc.**

**ACCEPTANCE No.:** 00-1006.06

**APPROVED** : April 26, 2001

**EXPIRES** : April 26, 2004

**NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS**

**1. SCOPE**

- 1.1 This approves a wood door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

**2. PRODUCT DESCRIPTION**

- 2.1 The Jeld-Wen Series "Nord/Morgan"- Outswing Glazed Double Wood Door w/ Surface bolts - and its components shall be constructed in strict compliance with the following documents: Drawing No S-2036, titled "Glazed 6-8 /8-0 Outswing Double Door" Sheets 1 through 7 of 7 dated 7-21-00 and last revised on 04-04-01 prepared by R. W. Building Consultant Inc., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

**3. LIMITATIONS**

- 3.1 This approval applies to single unit applications of glazed single door or double door (w/ surface bolts as applicable per design pressure rating tables), as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.

**4. INSTALLATION**

- 4.1 The glazed wood door and its components shall be installed in strict compliance with the approved drawings.
- 4.2 Hurricane protection system (shutters): the installation of these units **will require** a hurricane protection system

**5. LABELING**

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

**6. BUILDING PERMIT REQUIREMENTS**

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

Ishaq I. Chanda

Ishaq I. Chanda, P.E. Product Control Examiner  
Product Control Division

**Jeld-Wen, Inc.**

**ACCEPTANCE No.:** 00-1006.06

**APPROVED** : April 26, 2001

**EXPIRES** : April 26, 2004

**NOTICE OF ACCEPTANCE: STANDARD CONDITIONS**

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process.
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

Ishaq I. Chanda  
Ishaq I. Chanda, P.E. Product Control Examiner  
Product Control Division

**END OF THIS ACCEPTANCE**

**Jeld-Wen, Inc.**

**ACCEPTANCE No.:** 00-1006.06

**APPROVED** : April 26, 2001

**EXPIRES** : April 26, 2004

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

*(For File ONLY. Not part of NOA.)*

**A. DRAWINGS**

1. Manufacturer's Parts and section drawings.
2. Drawing No **S-2036**, titled "Glazed 6-8 /8-0 Outswing Double Door" Sheets 1 through 7 of 7 dated 7-21-00 and last revised on 04-04-01 prepared by R. W. Building Consultant Inc. (Reviewer's note: The drawing No. S-2036 , sheets 1, 2 & 5 were corrected for missing information, upon receipt from approval committee-IC)

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per PA 202-94  
2) Uniform Static Air Pressure Test, Loading per PA 202-94  
3) Water Resistance Test, per PA 202-94  
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94  
along with marked-up drawings and installation diagram of double glazed outswing wood doors, prepared by Certified Testing Laboratories, Test Report No. **CTLA572WA**, and **CTLA 572WC** both dated July 17 & 18, 2000 and revised by addendum letter dated March 15, 2001, signed and sealed by Ramesh Patel, P.E.

**C. CALCULATIONS**

1. Anchor verification calculations dated 8-24-00, prepared, signed and sealed by Mark Fetherman, P.E.

**D. MATERIAL CERTIFICATIONS**

1. None

**E. STATEMENTS**

1. Statement letter of conformance and no financial interest, dated 07-26-2000, signed and sealed by Mark C. Fetherman, P.E.
2. Statement letter dated 07-20-00 designating Rick Wright of R. W. Consulting Inc as the contact person for Jeld-Wen product approval , issued by Jeld-Wen, signed by Steve Frey
3. Statement letter of no financial interest, dated October 18, 1999, signed by Steve Frey, Products Testing Manager, Jeld-Wen, Inc.
4. Statement letter of compliance as part of test reports CTLA570W, issued by CTL and signed and sealed by Ramesh Patel, P.E.
5. Addendum letter dated March 15, 2001 issued by Certified Testing Laboratories, signed and sealed by Ramesh Patel, P.E.
6. Photocopy of letter dated 04-04-2001 issued by Jeld-Wen for additional test report for muntin bars, signed by Steve Frey (original pending from manufacturer).

**F. OTHER**

1. Manufacturing plant address of Jeld-Wen series "Nord / Morgan".

Ishaq I. Chanda  
Ishaq I. Chanda, P.E. Product Control Examiner  
Product Control Division

# Nord/Morgan/Nicolai Wood Door

6-8 AND 8-0 GLAZED OUTSWING  
DOUBLE DOOR


## GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. IMPACT RESISTANT SHUTTERS ARE REQUIRED
5. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.

## RESIDENTIAL STILE & RAIL WOOD DOOR (Common to all frame conditions)

**Frame Construction:** The head and side jambs are finger jointed ponderosa pine measuring 4.5625" x 1.25". The head and side jambs are mortised, butted and joined using (3) 16GA. 2" X 1/2" crown staples at the top corners. The bump threshold is attached to the floor.

**Door Panel Construction:** The panel is a stile and rail construction. The stiles and rails are constructed from solid wood of either Douglas Fir or Western Hemlock. They are laminated with a .0625" thk. wood veneer of the following species: Douglas Fir, Western Hemlock, Ponderosa Pine & Northern Red Oak. The veneer face sheet is glued to the stiles and rails. The top rail is connected to the perimeter stiles w/(2) .5" dia. min. x 4" long wooden dowels and the bottom rail is connected to the perimeter stile w/(3) .5" dia. min. x 4" long wooden dowels. The glazing is captured between the wood cap on the exterior and the wood glass stop on the interior. The panels are wet glazed using PRC 365 silicone.

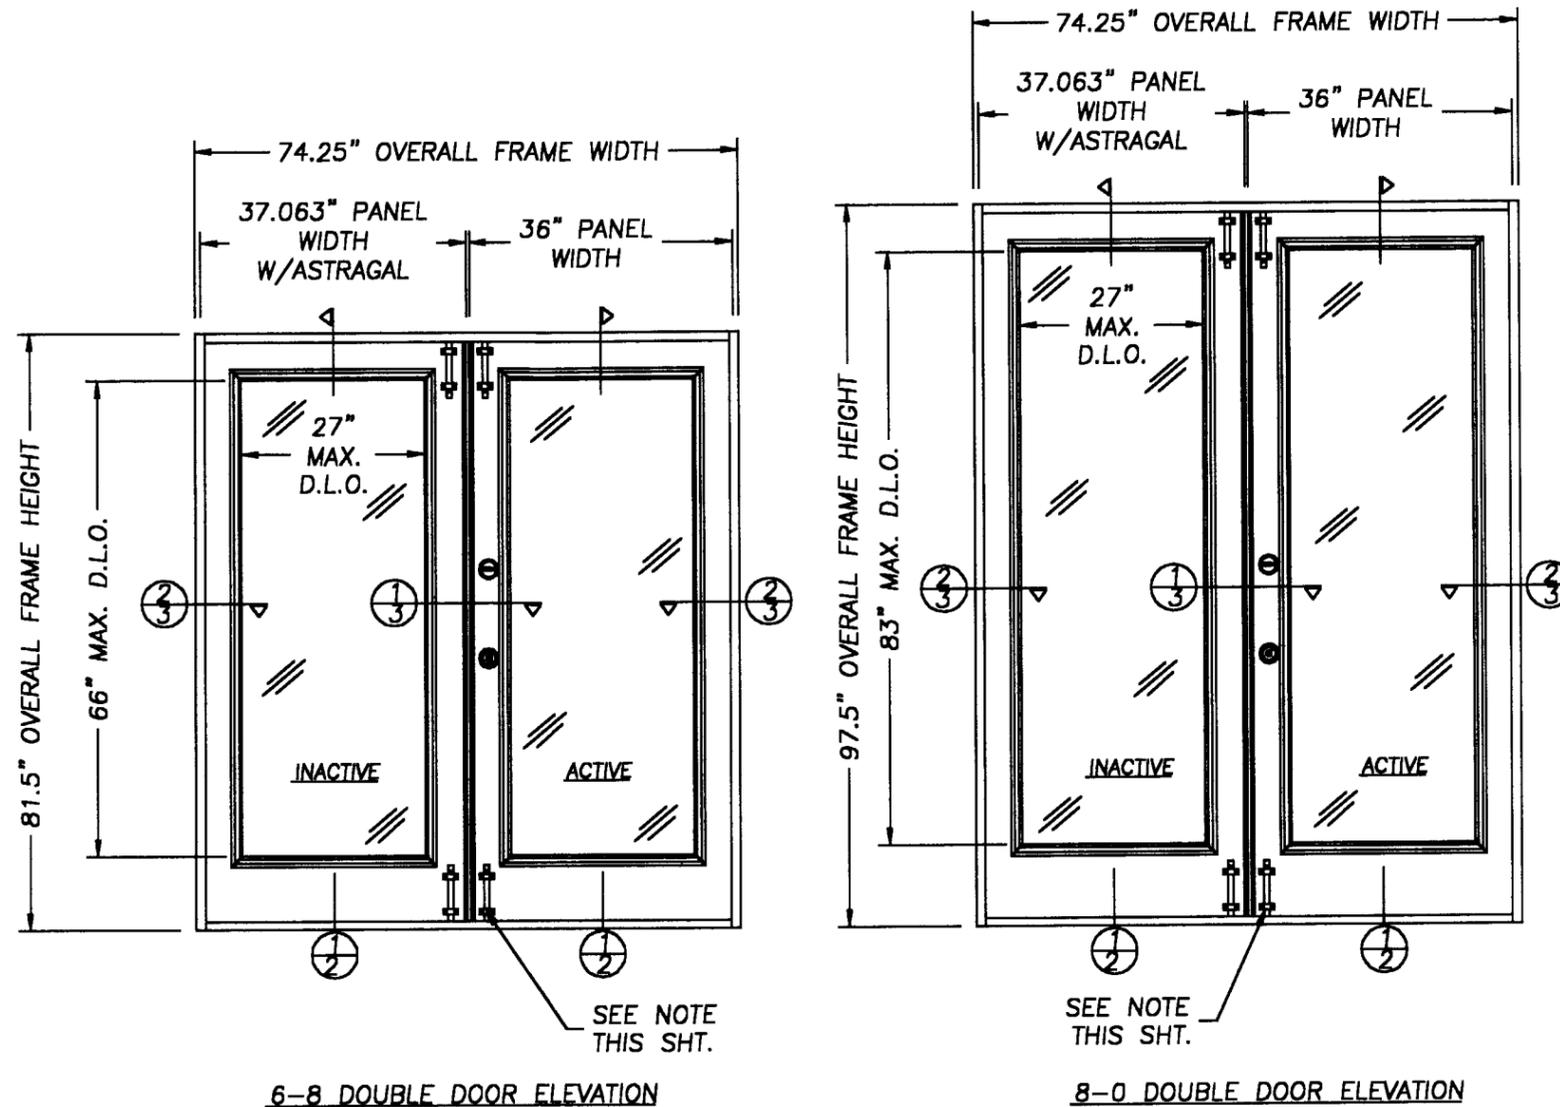

6-8 DOUBLE DOOR ELEVATION

8-0 DOUBLE DOOR ELEVATION

ALL MODELS ARE VIEWED FROM INTERIOR

NOTE  
THE SURFACE BOLTS ARE AN OPTION ON THE ACTIVE DOOR AND ARE USED TO ACHIEVE A HIGHER PRESSURE SEE SHT. 3 SECTIONS 1/3 & NOTE 2 SHT. 3 FOR SURFACE BOLT OPTIONS (SEE DESIGN PRESSURE TABLE)

## DESIGN PRESSURE RATING (OUTSWING DOORS) WHERE WATER INFILTRATION REQUIREMENT IS NEEDED

DOOR SIZE	W/SURFACE BOLTS ON INACTIVE PANEL	W/SURFACE BOLTS ON BOTH PANEL
6-8	+47.0psf -47.0psf	+65.0psf -70.0psf*
8-0	+32.0psf -32.0psf	+60.0psf -60.0psf

\*NOTE: 6-8 TRUE DIVIDED MUNTIN LITE DOOR PANELS CANNOT EXCEED +65.0psf -65.0psf

## TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES, TYPICAL ELEVATION)
2	VERTICAL CROSS SECTION & B.O.M.
3	HORIZONTAL CROSS SECTIONS 1/3, 2/3 & 3/3
4	ANCHORING LOCATIONS & DETAILS
5	RAIL DETAILS
6	UNIT COMPONENTS
7	DOOR MODELS

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: WOOD STILE & RAIL DOOR  
GLAZED 6-8/8-0  
OUTSWING DOUBLE DOOR  
PART OR ASSEMBLY:  
ELEVATIONS  
AND GENERAL NOTES


NO.	DATE	BY	REVISIONS
2	04/04/01	TJH	GENERAL REVISION
1	02/23/01	TJH	GENERAL REVISION

RW BUILDING  
CONSULTANTS, INC.  
813.684.3831


APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE April 26, 2001  
BY Ishag I. Chauda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-1006-06

DATE: 7/21/00  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2036  
SHEET 1 OF 7



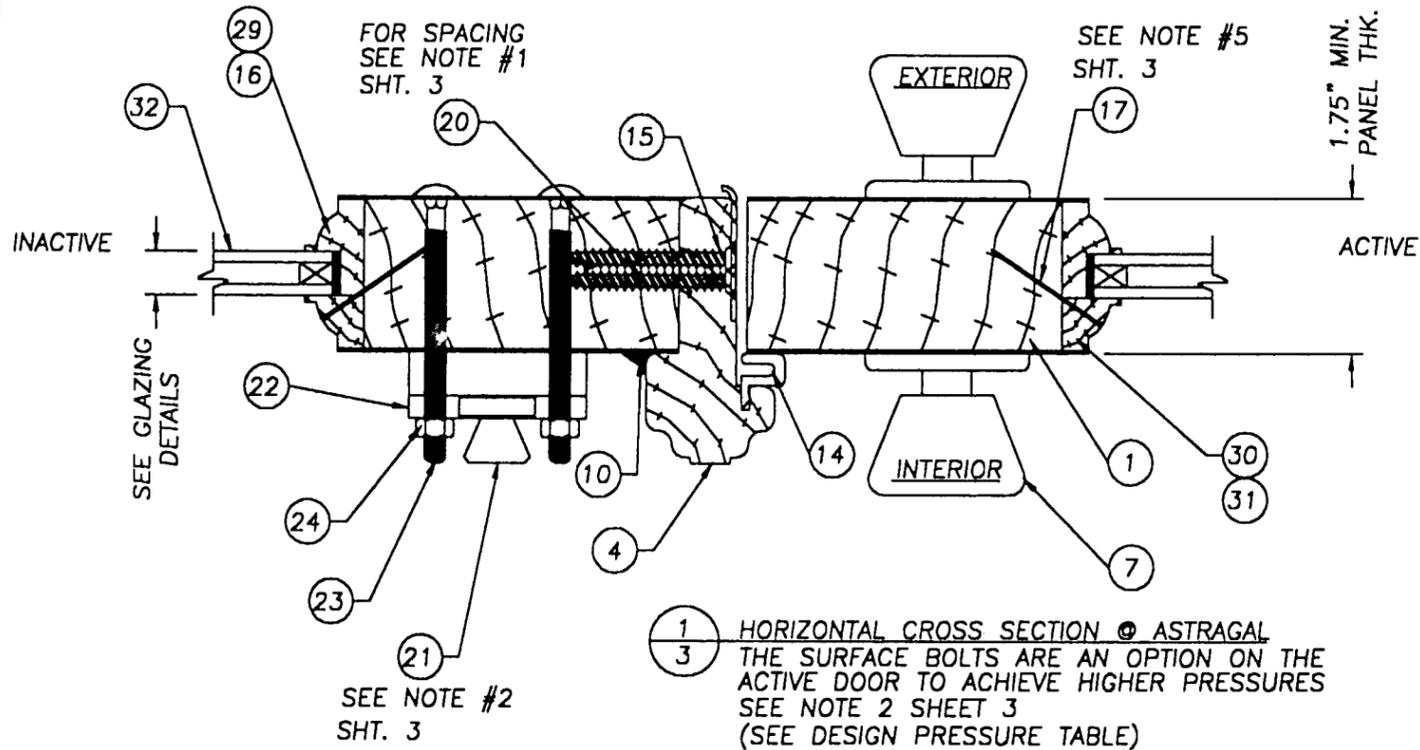

1  
3 HORIZONTAL CROSS SECTION @ ASTRAGAL  
THE SURFACE BOLTS ARE AN OPTION ON THE ACTIVE DOOR TO ACHIEVE HIGHER PRESSURES SEE NOTE 2 SHEET 3 (SEE DESIGN PRESSURE TABLE)

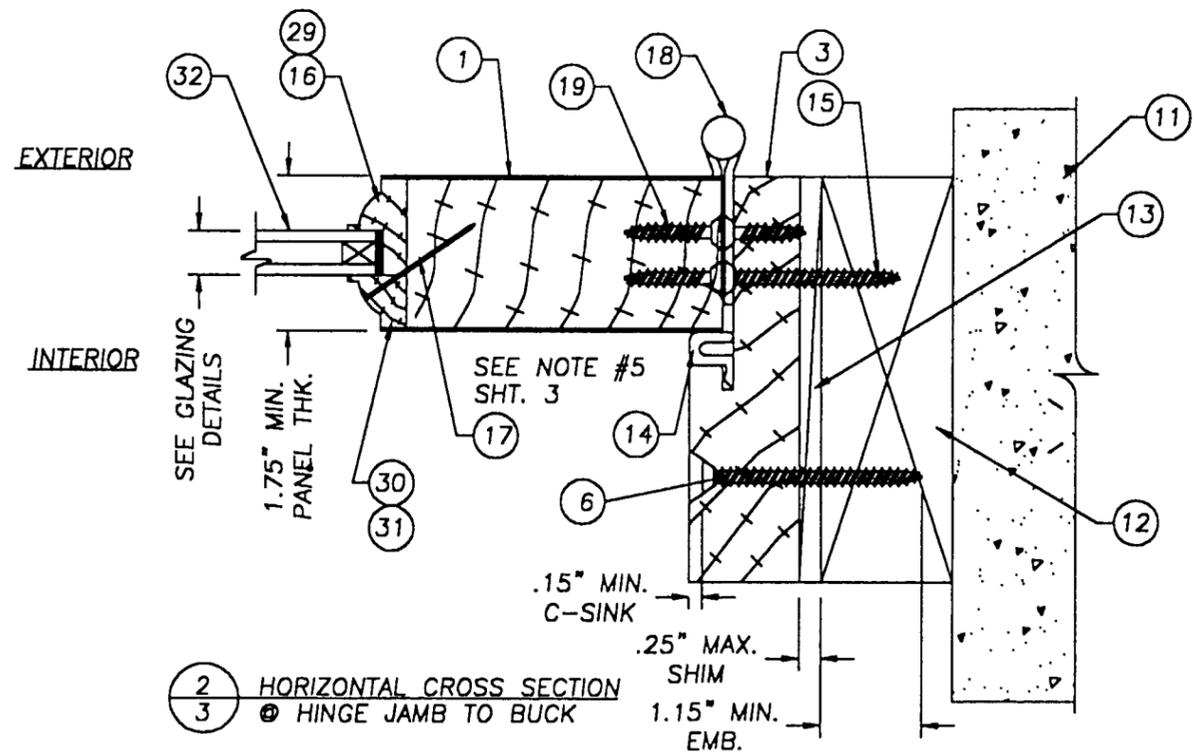

2  
3 HORIZONTAL CROSS SECTION @ HINGE JAMB TO BUCK

- NOTES: (TYP. TO ALL FRAME CONFIGURATIONS)
1. SPACING FOR ITEM #20 (#8 x 2" SCREW) TO ATTACH THE WOOD ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FOR THE 6-8 UNIT TOP DOWN; 3", 12" & 21", FOR THE 8-0 UNIT TOP DOWN; 3", 14", 25" & 36". THE SPACING FROM THE BOTTOM UP IS THE SAME FOR BOTH UNITS; 3", 13 3/8" & 24 1/8".
  2. THE SURFACE BOLTS ARE INSTALLED ON BOTH THE ACTIVE AND INACTIVE DOOR, AT THE TOP AND BOTTOM. THEY ARE NOT SHOWN ON THE ACTIVE DOOR IN SECTION 1/3 FOR CLARITY. SURFACE BOLTS ON THE ACTIVE DOOR ARE AN OPTION TO ACHIEVE HIGHER DESIGN PRESSURES SEE DESIGN PRESSURE TABLE.
  3. THE THRESHOLD IS NOT ATTACHED TO THE FRAME, IT IS NOTCHED AND ATTACHED TO THE FLOOR WITH ITEMS #26 1/4" x 2 3/4" TAPCON AND #10 (OR LAWRENCE 33S SILICONE CAULK). APPLY A CONTINUOUS BEAD .125" THK. x .375" W. AROUND ALL (4) OUTER EDGES WITH A MINIMUM OF (2) ROWS IN A ZIG ZAG PATTERN IN THE MIDDLE THE ENTIRE LENGTH OF THE THRESHOLD, .125" THK. x .375" W.
  4. THE TOP CORNERS OF THE DOOR FRAME, ARE STAPLED TOGETHER USING (3) 16GA. x 2" LG. x 1/2" CROWN STAPLES.
  5. SPACING FOR ITEM #17 IS A MAX. OF 12" O.C.

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: WOOD STILE & RAIL DOOR  
GLAZED 6-8/8-0  
OUTSWING DOUBLE DOOR  
PART OR ASSEMBLY:  
HORIZONTAL CROSS  
SECTIONS 1/3, 2/3 & 3/3

NO.	DATE	BY	REVISIONS
2	04/04/01	TJH	GENERAL REVISION
1	02/23/01	TJH	GENERAL REVISION


RW BUILDING CONSULTANTS, INC.  
813.684.3831

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE APRIL 26, 2001  
BY ISHAG I. CHANDA  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-1006-06


DATE: 7/21/00  
SCALE: 1/2" = 1"  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2036  
SHEET 3 OF 7

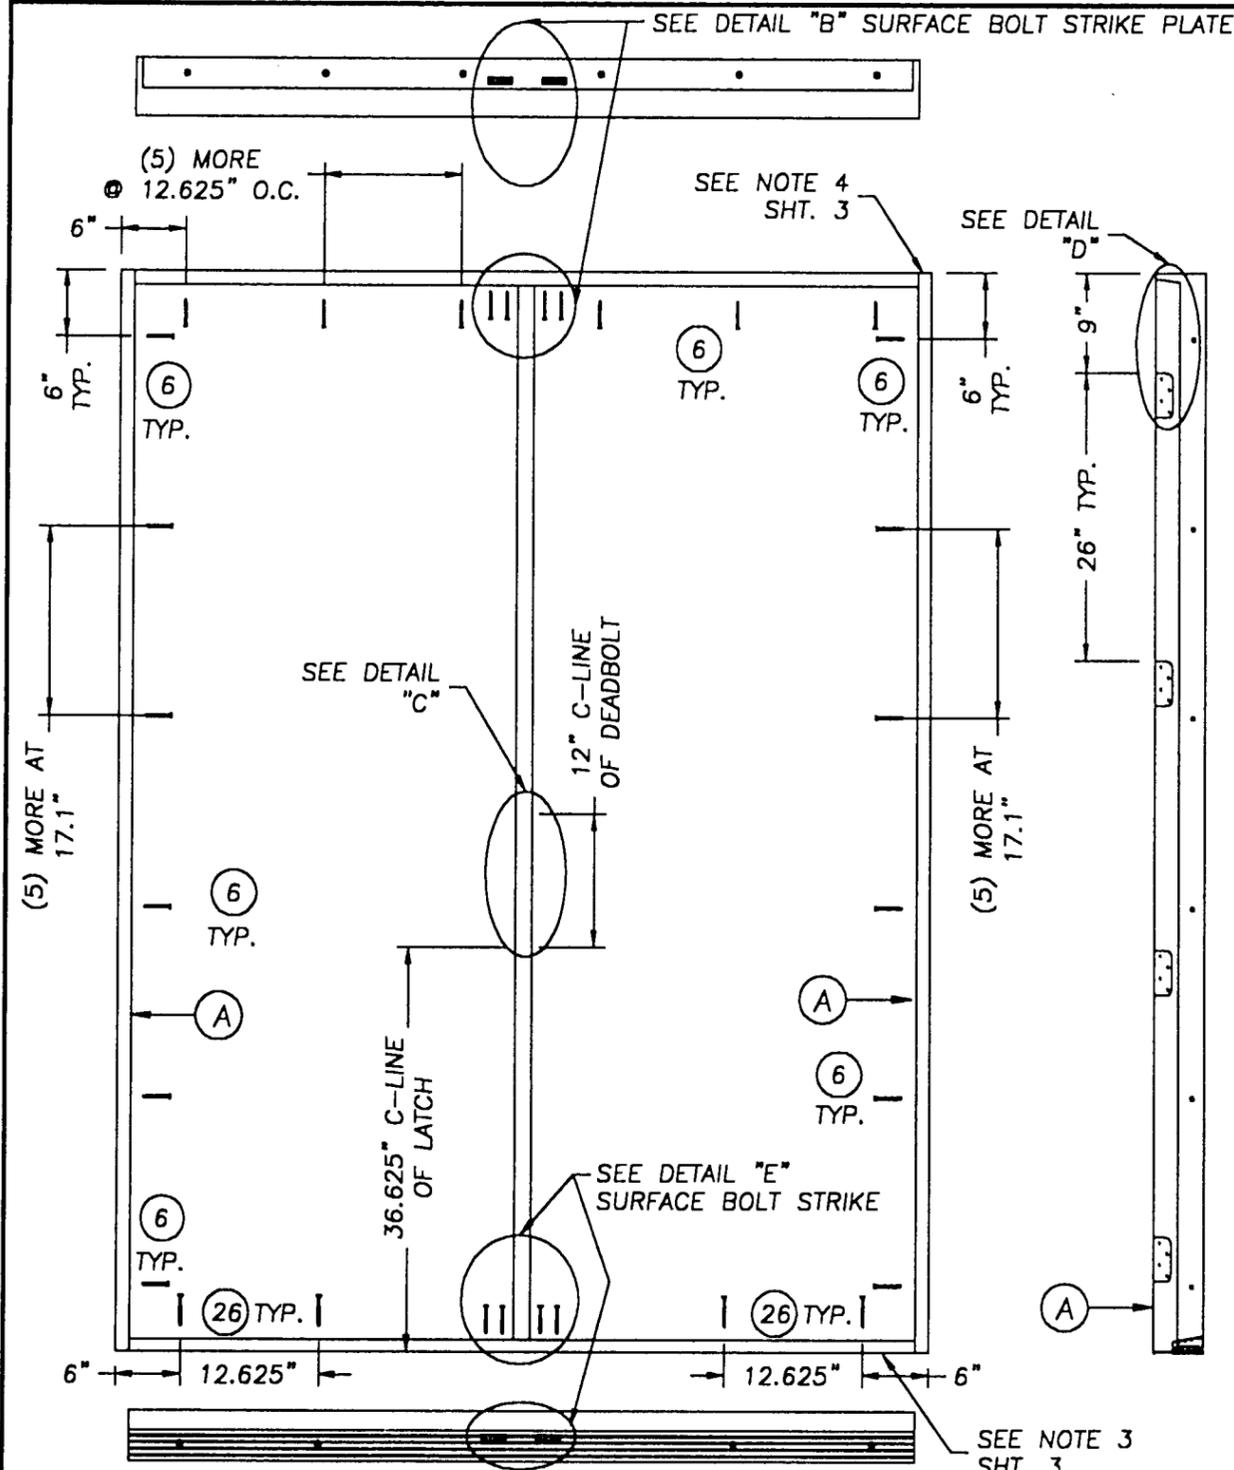


8-0 ANCHORING LOCATIONS

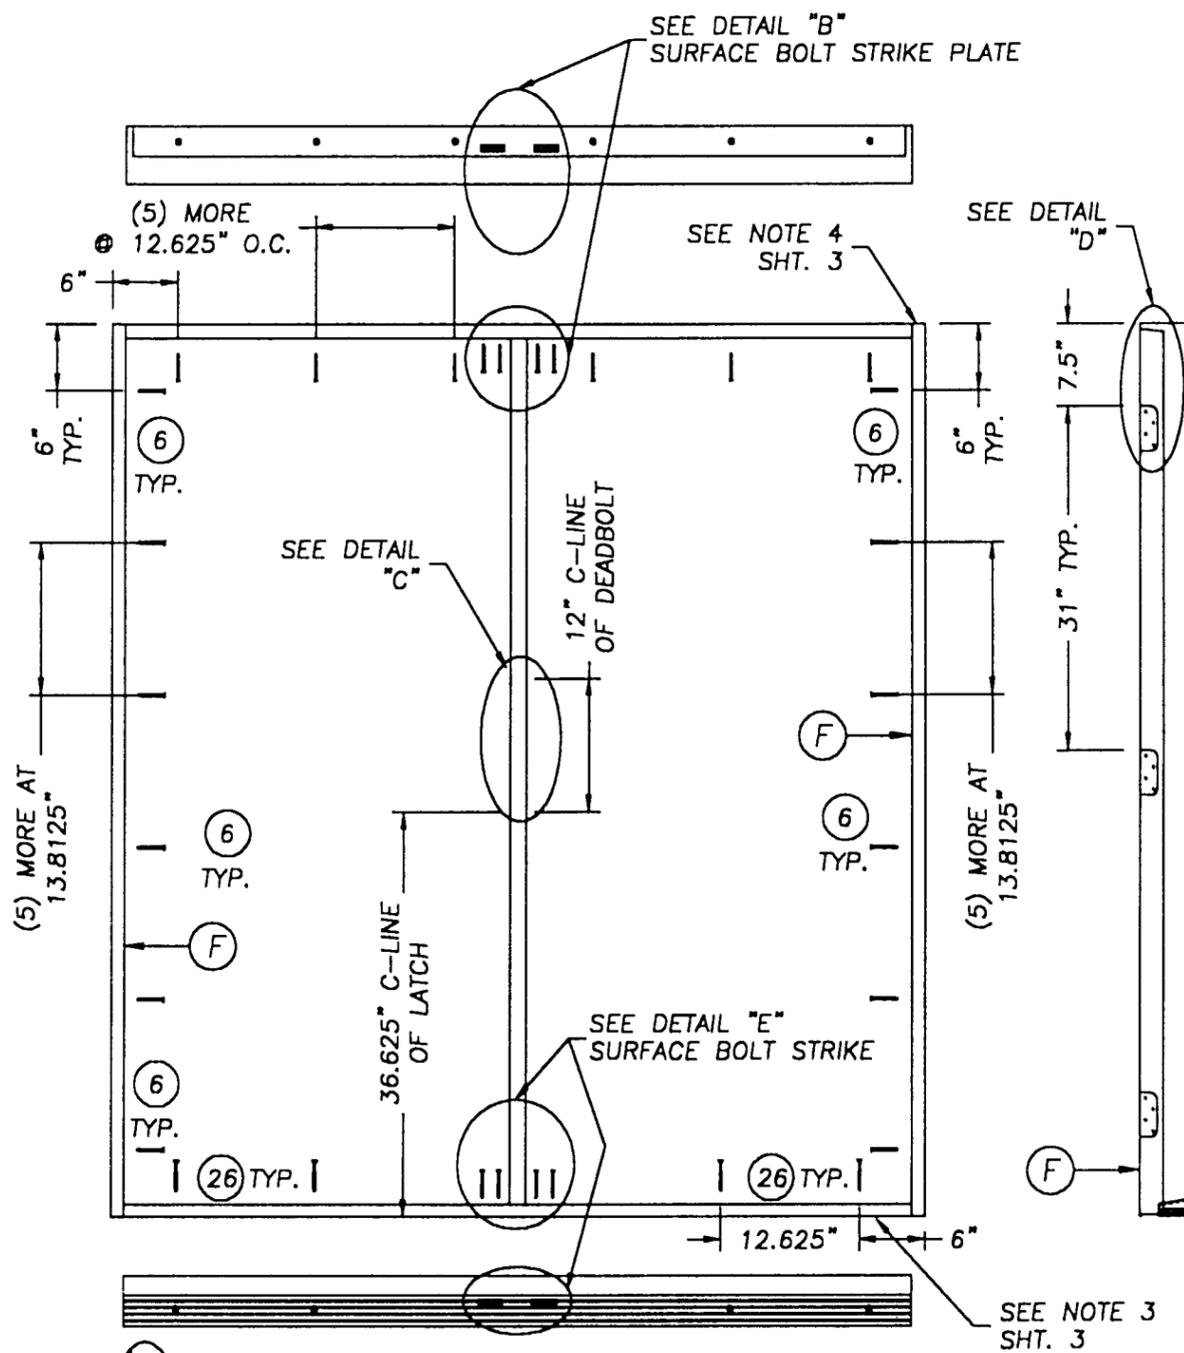


6-8 ANCHORING LOCATIONS

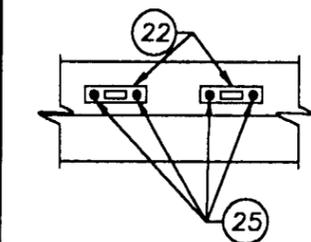


DETAIL "B"  
SURFACE BOLT STRIKE PLATE

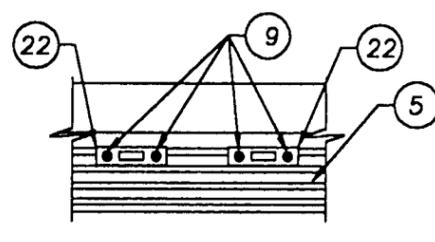

DETAIL "E"  
SURFACE BOLT STRIKE PLATE

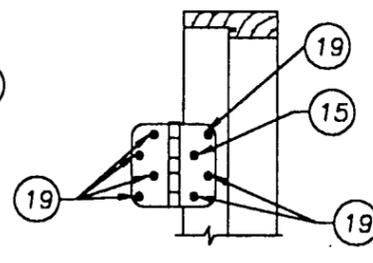

DETAIL "D"

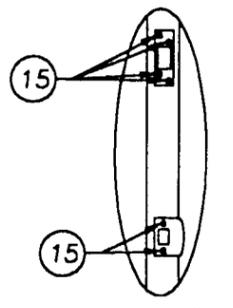

DETAIL "C"  
FOR ITEM #4

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT:  
WOOD STILE & RAIL DOOR  
GLAZED 6-8/8-0  
OUTSWING DOUBLE DOOR  
PART OR ASSEMBLY:  
ANCHORING LOCATIONS  
& DETAILS

NO.	DATE	REVISIONS
2	04/04/01	GENERAL REVISION TJH
1	02/23/01	GENERAL REVISION TJH


**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE APRIL 26, 2001  
BY Ishaq I. Chauda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 00-1006-06

DATE: 7/21/00  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2036  
SHEET 4 OF 7

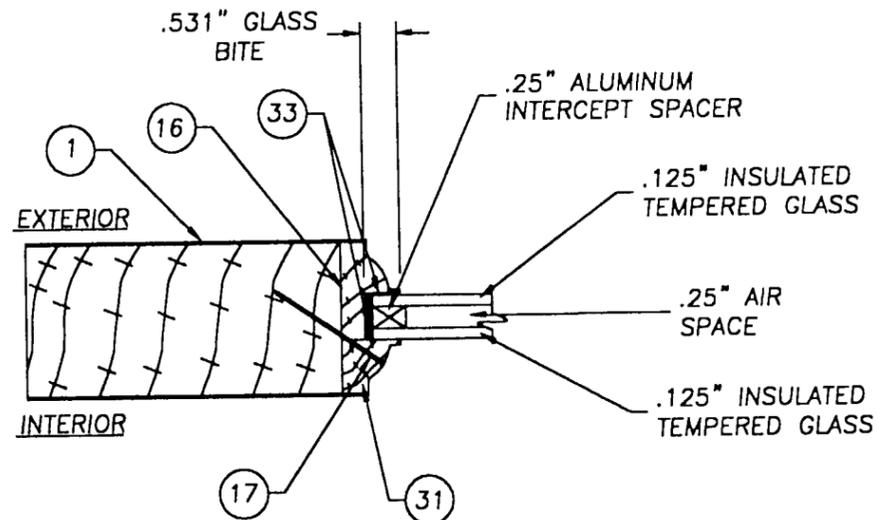


**.50" INSULATED TEMPERED GLASS  
GLAZING DETAIL**  
SCALE: 1/2" = 1"

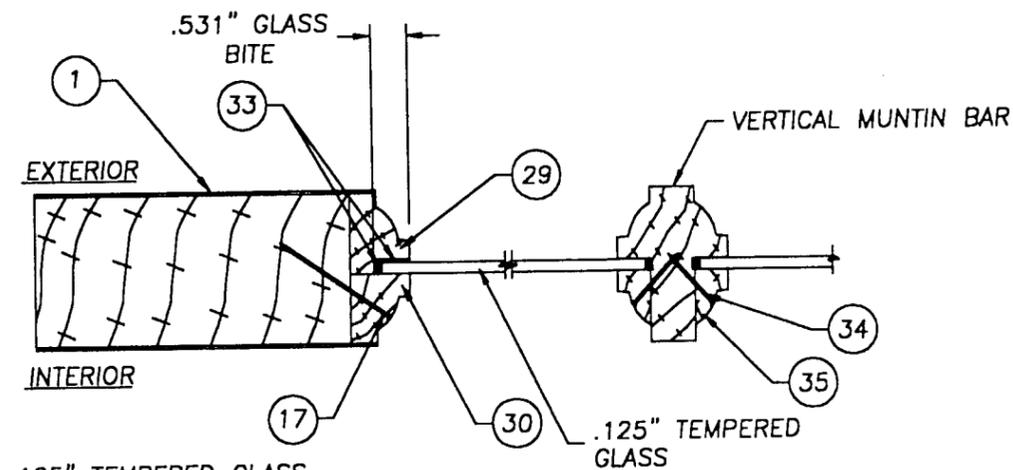


**.125" TEMPERED GLASS  
GLAZING DETAIL**  
SCALE: 1/2" = 1"


NOTE:  
THE MULTI-LITE DOOR PANEL  
IS MADE UP OF TRUE  
DIVIDED GLASS PANELS.

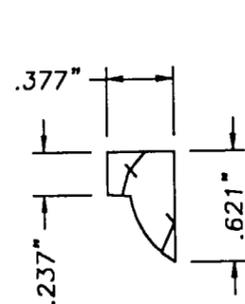


**TRUE DIVIDED GLASS GLAZING STOP**  
SCALE: FULL

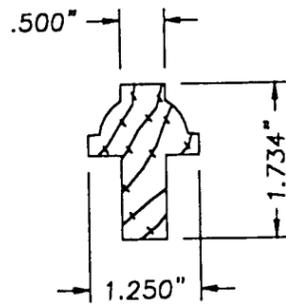

**VERTICAL MUNTIN BAR DETAIL**  
SCALE: 1/2" = 1"

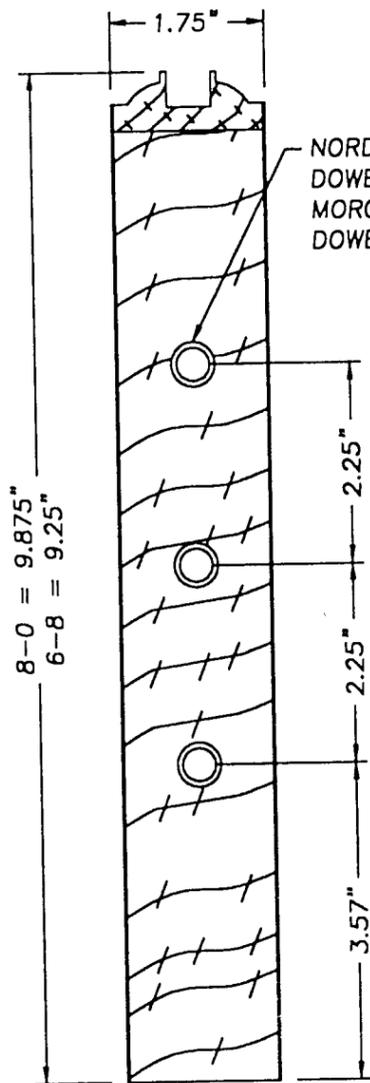

**BOTTOM RAIL**  
SCALE: 1/2" = 1"

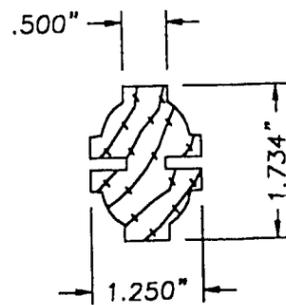


**CENTER BAR DETAIL**  
SCALE: 1/2" = 1"

NOTE:  
DOWELS ARE GLUED AND PRESSED 2.0" INTO  
THE RAILS AND STILES AT PANEL ASSEMBLY.


NORD DOOR .50" WOOD  
DOWEL x 4.0" LG., 3PLCS  
MORGAN/NICOLAI DOOR .625" WOOD  
DOWEL x 4.0" LG., 3PLCS

NORD DOOR .50" WOOD  
DOWEL x 4.0" LG., 2PLCS  
MORGAN/NICOLAI DOOR .625" WOOD  
DOWEL x 4.0" LG., 2PLCS

NORD DOOR HOLE FOR .50" WOOD  
DOWEL x 4.0" LG., 2PLCS  
MORGAN/NICOLAI DOOR HOLES FOR  
.625" WOOD DOWEL x 4.0" LG., 2PLCS

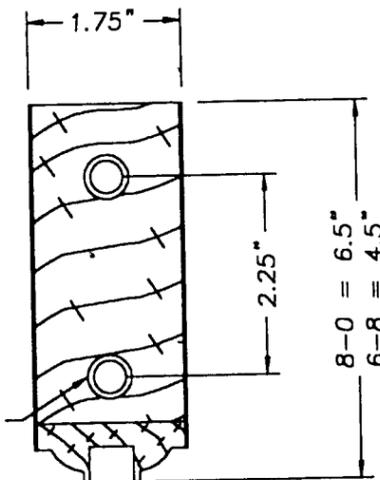

**TOP RAIL**  
SCALE: 1/2" = 1"

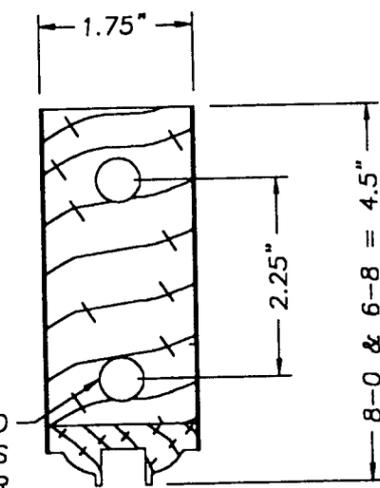

**SIDE STILE**  
SCALE: 1/2" = 1"

**JELD-WEN, INC.**  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT:  
WOOD STILE & RAIL DOOR  
GLAZED 6-8/8-0  
OUTSWING DOUBLE DOOR  
PART OR ASSEMBLY:  
GLAZING DETAILS  
& RAIL DETAILS

NO.	DATE	REVISIONS	TJH	TJH	BY
2	04/04/01	GENERAL REVISION	TJH		
1	02/23/01	GENERAL REVISION	TJH		


**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE April 26, 2001  
BY Ishtag J. Chauda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO 00-1004-06


DATE: 7/21/00  
SCALE: AS NOTED  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2036  
SHEET 5 OF 7

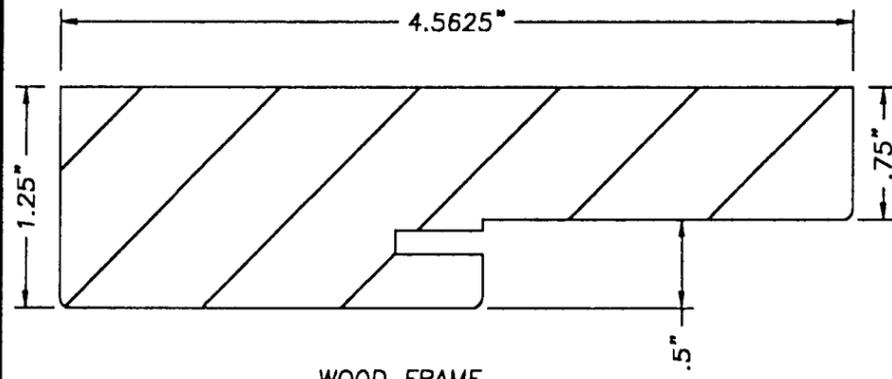


WOOD FRAME

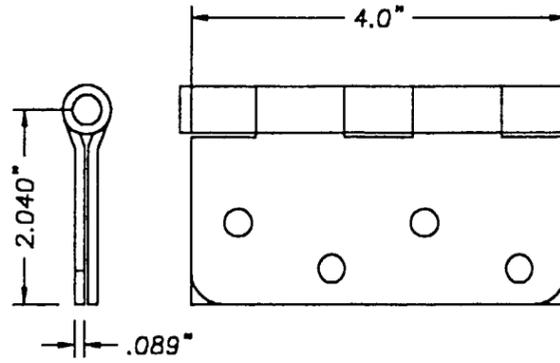


4 x 4 DOOR HINGE

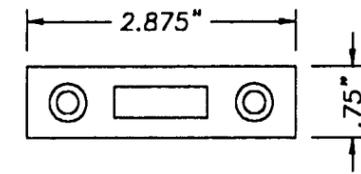


SURFACE BOLT STRIKE (IVES .125" STEEL)

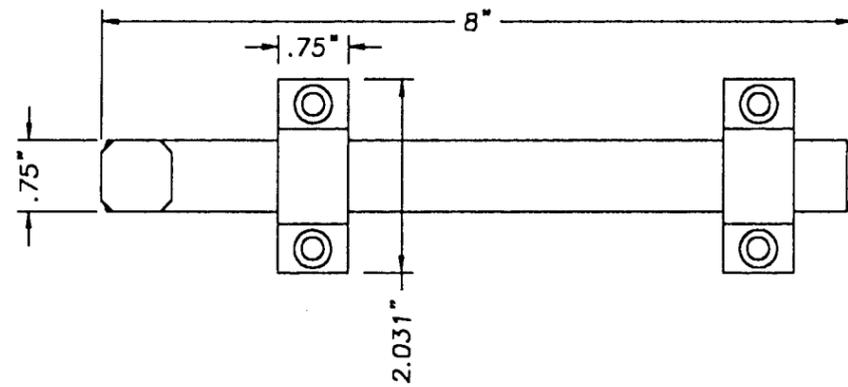

SURFACE BOLT (IVES .25" STEEL)

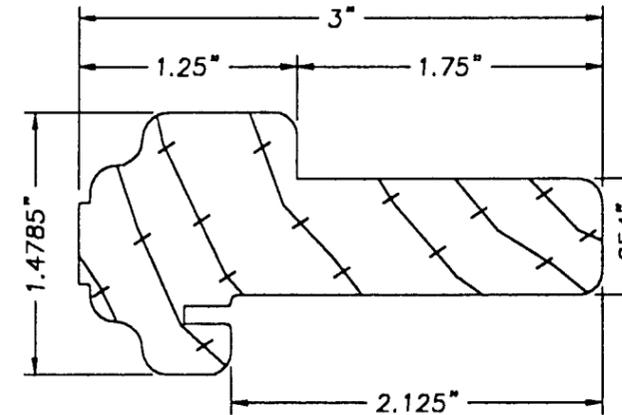

(1) PIECE WOOD ASTRAGAL

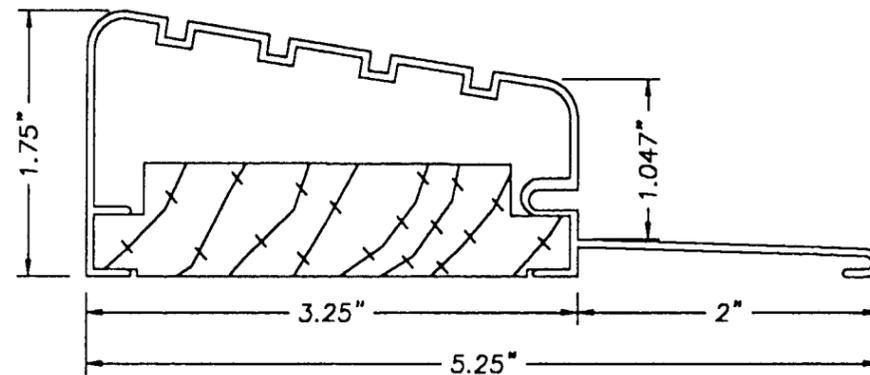

OUTSWING BUMP FACE ALUMINUM THRESHOLD  
.051" WALL THK.

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT:  
WOOD STILE & RAIL DOOR  
GLAZED 6-8/8-0  
OUTSWING DOUBLE DOOR  
PART OR ASSEMBLY:  
UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
2	04/04/01	GENERAL REVISION	TJH
1	02/23/01	GENERAL REVISION	TJH


**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE APRIL 26, 2001  
BY Ishqg I. Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. DO-1006-06

DATE: 7/21/00  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2036  
SHEET 6 OF 7

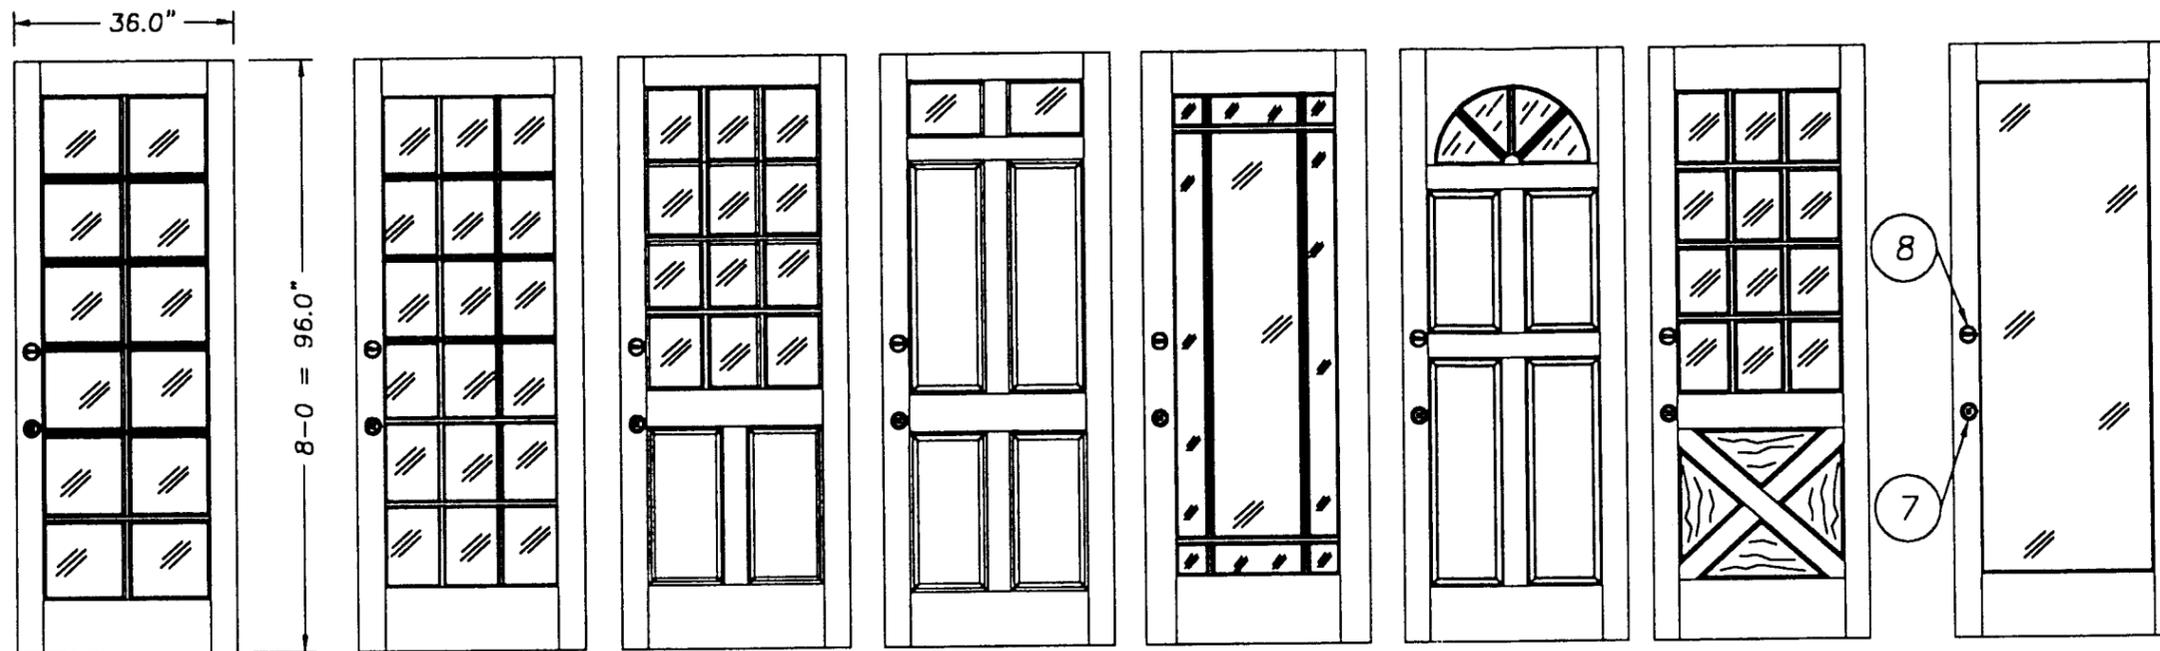

8-0 DOOR MODELS  
SEE NOTE THIS SHEET

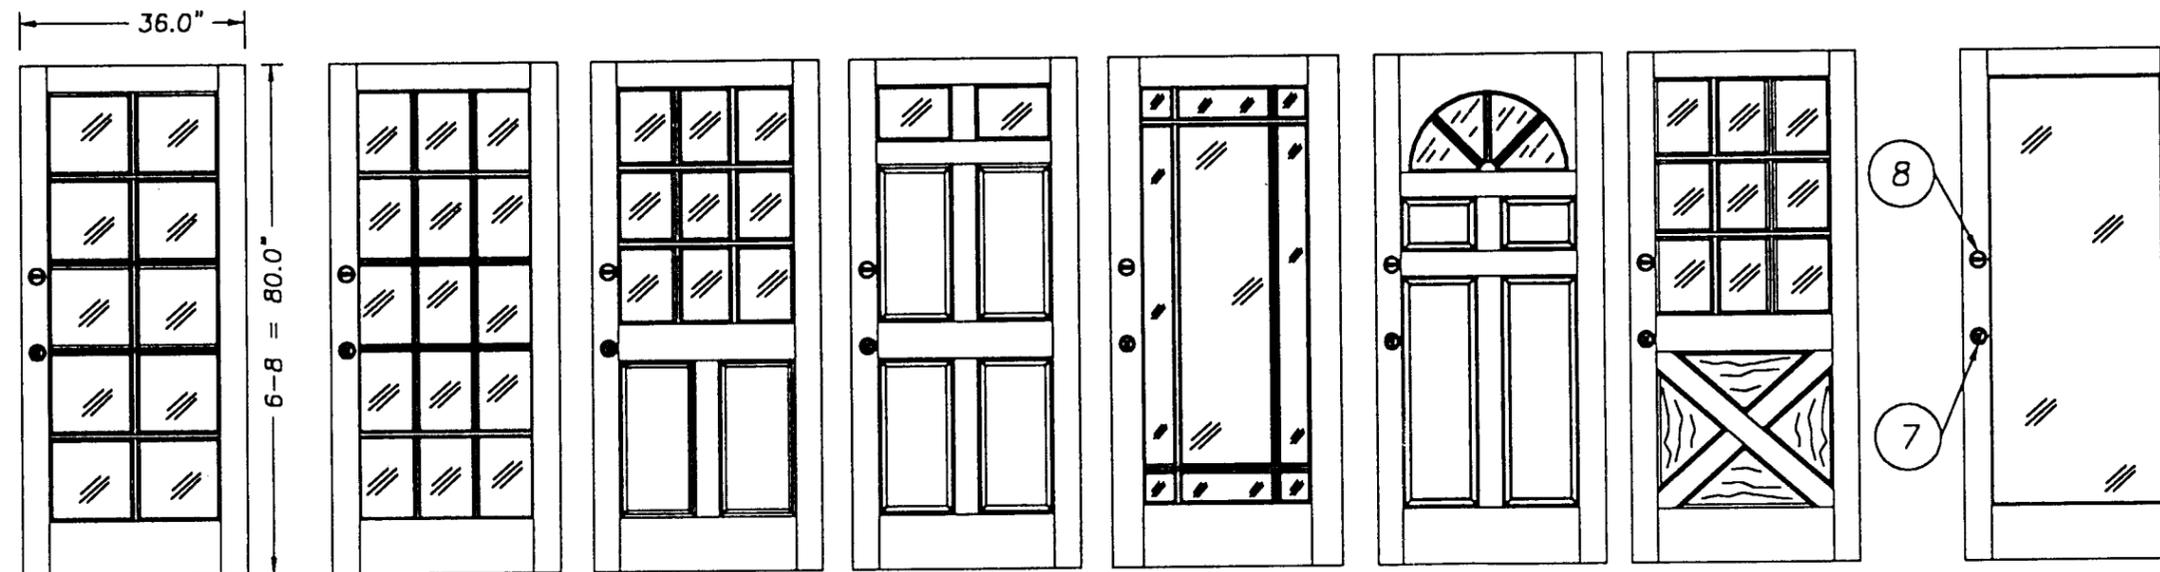

6-8 DOOR MODELS N.T.S.  
SEE NOTE THIS SHEET

NOTE:  
THE MULTI-LITE DOOR PANEL  
IS MADE UP OF TRUE DIVIDED  
GLASS PANELS. THE MAX. DESIGN  
PRESSURE FOR THE 6-8 DOORS W/TRUE  
DIVIDED GLASS IS +65 psf -65 psf  
SEE DESIGN PRESSURE TABLE SHT. 1

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT:  
WOOD STILE & RAIL DOOR  
GLAZED 6-8/8-0  
OUTSWING DOUBLE DOORS  
PART OR ASSEMBLY:  
DOOR MODELS

NO.	DATE	GENERAL REVISION	TJH	BY
2	04/04/01	GENERAL REVISION	TJH	
1	02/23/01	GENERAL REVISION	TJH	

**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE <u>April 26, 2001</u> BY <u>Ishaq I. Chanda</u> PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. <u>00-1006.06</u>	DATE: 7/21/00 SCALE: N.T.S. DWG. BY: TJH CHK. BY: RW DRAWING NO.: S-2036 SHEET 7 OF 7
---	--