



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

General Screen Service Co.
14221 S. W. 140th Street Bay C
Miami, FL 33186

Your application for Notice of Acceptance (NOA) of:

Aluminum Framed Screen Enclosure

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez
Chief Product Control Division

ACCEPTANCE NO.: 00-1116.03
EXPIRES: 12/16/2005

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 02/01/2001

General Screen Service Company

ACCEPTANCE No. : 00-1116.03

APPROVED : 02/01/2001

EXPIRES : 12/16/2005

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

This renews the Notice of Acceptance No. 97-0804.02, which was issued on December 16, 1997. It approves an Aluminum Framed Screen Enclosure, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

This Aluminum Framed Screen Enclosure and its components shall be constructed in strict compliance with the following documents: Drawing No. 3005, prepared by Ramms Engineering, Inc., dated August 30, 1994, last revised on June 12, 1995, sheets 1 and 2 of 3 and dated June 6, 1995, sheet 3 of 3, all bearing the Miami-Dade County Product Control Approval and Renewal stamps with the Notice of Acceptance numbers and approval dates by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

All permanent set components, included but not limited to embedded anchor bolts, must be protected against corrosion, contamination and damage at all times.

4. INSTALLATION

This Aluminum Framed Screen Enclosure and its components shall be installed in strict compliance with the approved drawings.

5. LABELING

A permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved," shall be attached to the bottom of each chair rail.


6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.



Helmy A. Makar, P.E.- Product Control Examiner
Product Control Division

General Screen Service Company

ACCEPTANCE No. : 00-1116.03


APPROVED : 02/01/2001

EXPIRES : 12/16/2005

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer, who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE



Helmy A. Makar, P.E.- Product Control Examiner
Product Control Division

NON-COASTAL ZONE (ASCE 7-88)

PRODUCT RENEWED

ACCEPTANCE No. 00-1116.03

EXPIRATION DATE 12/16/2005

By Helmut A. Mohr
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

BEAM AND COLUMN SCHEDULE

| MARK | SIZE | T1 | T2 | TYPE | MAX. BEAM SPANS AT GIVEN SPACINGS | | | | | | | | | |
|---------|--------|------|------|--------|-----------------------------------|--------|--------|---------|---------|---------|---------|-------|--|--|
| | | | | | 5'-0" | 5'-6" | 6'-0" | 6'-6" | 7'-0" | 7'-6" | 8'-0" | 8'-6" | | |
| Box Bm. | 2 x 2 | .055 | .055 | HOLLOW | 6'-11" | 6'-9" | 6'-7" | 6'-4" | 6'-3" | 6'-1" | 5'-11" | | | |
| Box Bm. | 2 x 3 | .055 | .055 | SNAP | 9'-7" | 9'-3" | 9'-0" | 8'-9" | 8'-7" | 8'-4" | 8'-2" | | | |
| Box Bm. | 2 x 4 | .062 | .062 | SNAP | 12'-6" | 12'-2" | 11'-9" | 11'-5" | 11'-2" | 10'-11" | 10'-8" | | | |
| Box Bm. | 2 x 4 | .120 | .055 | LAP | 14'-3" | 13'-9" | 13'-4" | 13'-0" | 12'-8" | 12'-5" | 12'-2" | | | |
| Box Bm. | 2 x 5 | .062 | .062 | SNAP | 15'-1" | 14'-7" | 14'-2" | 13'-9" | 13'-5" | 13'-2" | 12'-10" | | | |
| Box Bm. | 2 x 6 | .130 | .055 | LAP | 19'-10" | 19'-3" | 18'-8" | 18'-2" | 17'-9" | 17'-4" | 16'-9" | | | |
| Box Bm. | 2 x 6 | .120 | .062 | SNAP | 19'-11" | 19'-4" | 18'-9" | 18'-3" | 17'-10" | 17'-5" | 17'-1" | | | |
| Box Bm. | 2 x 7 | .130 | .068 | SNAP | 22'-11" | 22'-3" | 21'-7" | 21'-0" | 20'-6" | 20'-1" | 19'-7" | | | |
| Box Bm. | 2 x 7 | .280 | .070 | LAP | 21'-7" | 20'-7" | 19'-9" | 18'-11" | 18'-3" | 17'-8" | 17'-1" | | | |
| Box Bm. | 2 x 8 | .224 | .072 | LAP | 27'-1" | 26'-3" | 25'-5" | 24'-9" | 24'-2" | 23'-7" | 23'-2" | | | |
| Box Bm. | 2 x 8 | .224 | .082 | LAP | 29'-0" | 28'-2" | 27'-3" | 26'-7" | 25'-11" | 25'-4" | 24'-10" | | | |
| Box Bm. | 2 x 9 | .224 | .072 | LAP | 31'-5" | 30'-5" | 29'-3" | 28'-1" | 27'-1" | 26'-2" | 25'-4" | | | |
| Box Bm. | 2 x 9 | .320 | .082 | LAP | 34'-3" | 33'-3" | 32'-3" | 31'-5" | 30'-8" | 30'-0" | 29'-4" | | | |
| Box Bm. | 2 x 10 | .360 | .092 | LAP | 38'-7" | 37'-4" | 36'-4" | 35'-4" | 34'-6" | 33'-8" | 33'-0" | | | |

PURLIN TABLE HEAVY LINE INDICATES MAXIMUM SPAN FOR 4" GUTTER "Z" BRACKET. NO LIMIT TO 5" GUTTER BRACKET.

| MARK | SIZE | T1 | T2 | TYPE | MAXIMUM SPAN |
|-------|------|------|--------|--|--------------|
| 2 x 2 | .055 | .055 | HOLLOW | MAXIMUM SPAN = 7'-0" AS PURLIN AND CHAIRRAIL | |
| 2 x 3 | .055 | .055 | HOLLOW | MAXIMUM SPAN = 8'-0" AS PURLIN AND CHAIRRAIL | |

NOTE: MAXIMUM SPACING OF PURLINS = 84". MAXIMUM AREA IN ANY PANEL = 56 SQ. FT.
 MAXIMUM SPACING OF 2X2 CHAIRRAILS = 60" AVG.
 MAXIMUM SPACING OF 3X2 CHAIRRAILS = 72" AVG.
 SPANS SHOWN ABOVE ARE CLEAR SPANS. 4" MAY BE ADDED TO EACH SPAN SHOWN.

| MARK | SIZE | T1 | T2 | TYPE | MAX. COLUMN HEIGHTS AT GIVEN SPACINGS | | | | | | | | | |
|----------|-------|------|------|------|---------------------------------------|--------|--------|---------|---------|---------|--------|-------|--|--|
| | | | | | 5'-0" | 5'-6" | 6'-0" | 6'-6" | 7'-0" | 7'-6" | 8'-0" | 8'-6" | | |
| Box Col. | 2 x 3 | .055 | .055 | SNAP | 6'-8" | 6'-6" | 6'-2" | 5'-11" | 5'-9" | 5'-7" | 5'-4" | | | |
| Box Col. | 2 x 4 | .062 | .062 | SNAP | 9'-2" | 8'-8" | 8'-4" | 8'-0" | 7'-9" | 7'-5" | 7'-3" | | | |
| Box Col. | 2 x 4 | .120 | .055 | LAP | 11'-1" | 10'-7" | 10'-1" | 9'-8" | 9'-4" | 9'-0" | 8'-9" | | | |
| Box Col. | 2 x 5 | .062 | .062 | LAP | 13'-4" | 12'-9" | 12'-2" | 11'-9" | 11'-4" | 10'-11" | 10'-7" | | | |
| Box Col. | 2 x 6 | .130 | .055 | LAP | 15'-10" | 15'-1" | 14'-5" | 13'-10" | 13'-4" | 12'-11" | 12'-6" | | | |
| Box Col. | 2 x 7 | .130 | .055 | SNAP | 16'-6" | 15'-9" | 15'-1" | 14'-5" | 13'-11" | 13'-6" | 13'-0" | | | |
| Box Col. | 2 x 7 | .280 | .070 | LAP | 22'-0" | 21'-4" | 20'-9" | 20'-1" | 19'-4" | 18'-8" | 18'-1" | | | |
| Box Col. | 2 x 8 | .224 | .082 | LAP | 23'-10" | 23'-1" | 22'-1" | 21'-3" | 20'-5" | 19'-9" | 19'-2" | | | |

NOTE: MAX SPACING OF CHAIRRAILS IS 78" SPANS SHOWN ABOVE ARE CLEAR SPANS. 4" MAY BE ADDED TO EACH SPAN SHOWN.
 2X3 AND 2X4 NON-LOAD BEARING BOX COLUMNS MAY BE INCREASED AN ADDITIONAL 10% TO THE HEIGHTS SHOWN ABOVE.
 ALL OTHER COLUMNS TO REMAIN THE SAME.






DESIGN CRITERIA: SOUTH FLORIDA BUILDING CODE ASCE 7-88

- NOTES:
- 1) ROOF AND SIDES SHALL BE COVERED WITH SCREEN CLOTH BEING 60% OPEN OR GREATER ONLY.
 - 2) THE EXISTING STRUCTURE MUST BE CAPABLE OF SUPPORTING THE LOADED SCREEN ENCLOSURE.
 - 3) METAL STRUCTURES WITHIN 5 FT. OF SWIMMING POOLS SHALL BE GROUNDED PR N.E.C. 680-22
 - 4) ANCHORS TO CONCRETE & MASONRY SHALL BE 3/8 X 3" ANCHORS OR APPROVED EQUAL UNLESS OTHERWISE SPECIFIED.
- WALLS DESIGN WIND LOAD IN & OUT ----- 19.6 PSF
 TEST LOAD WIND IN & OUT ----- 29.4 PSF
 ROOF LIVE LOAD UP & DOWN ----- 10.6 PSF
 TEST LOAD UP & DOWN ----- 15.9 PSF
 DEFLECTION LIMITATION: ----- L/80
 ALUMINUM ALLOY 6063-T6 UNLESS OTHERWISE SPECIFIED.

CARRY BEAM TABLE

| CLEAR SPAN OF 2 X 6 CARRY BEAM | MAX SPAN OF SCREEN ENCLOSURE | CLEAR SPAN OF 2 X 7 CARRY BEAM | MAX. SPAN OF SCREEN ENCLOSURE |
|--------------------------------|------------------------------|--------------------------------|-------------------------------|
| 10'-0" | MAXIMUM | 14'-0" | MAXIMUM |
| 12'-0" | MAXIMUM | 16'-0" | 27'-7" |
| 14'-0" | MAXIMUM | 18'-0" | 20'-1" |
| 16'-0" | 23'-4" | 20'-0" | 14'-9" |
| 18'-0" | 14'-0" | 22'-0" | 10'-1" |

MAXIMUM SPAN SHOWN IN BEAM TABLE ABOVE.

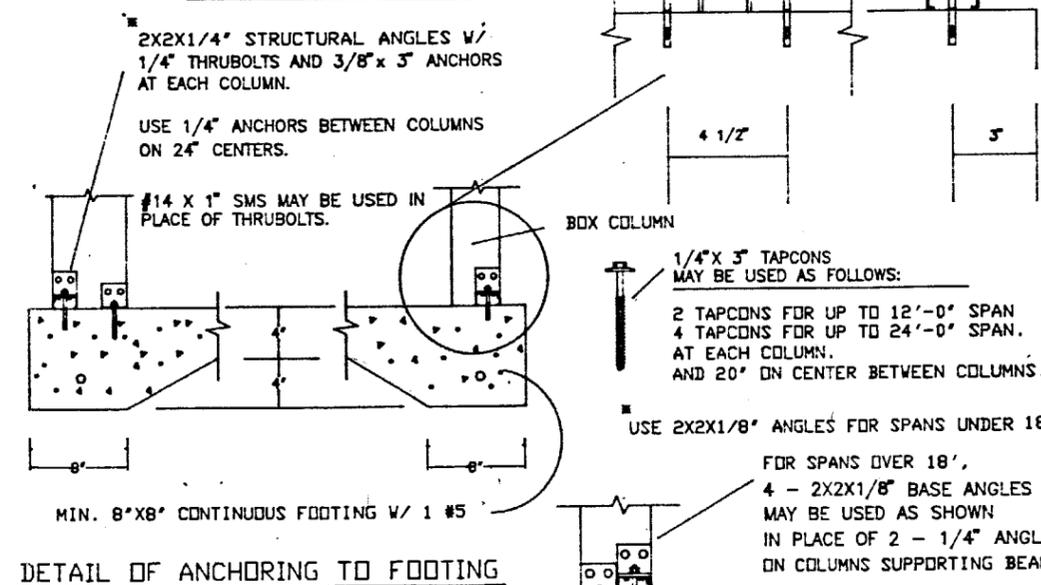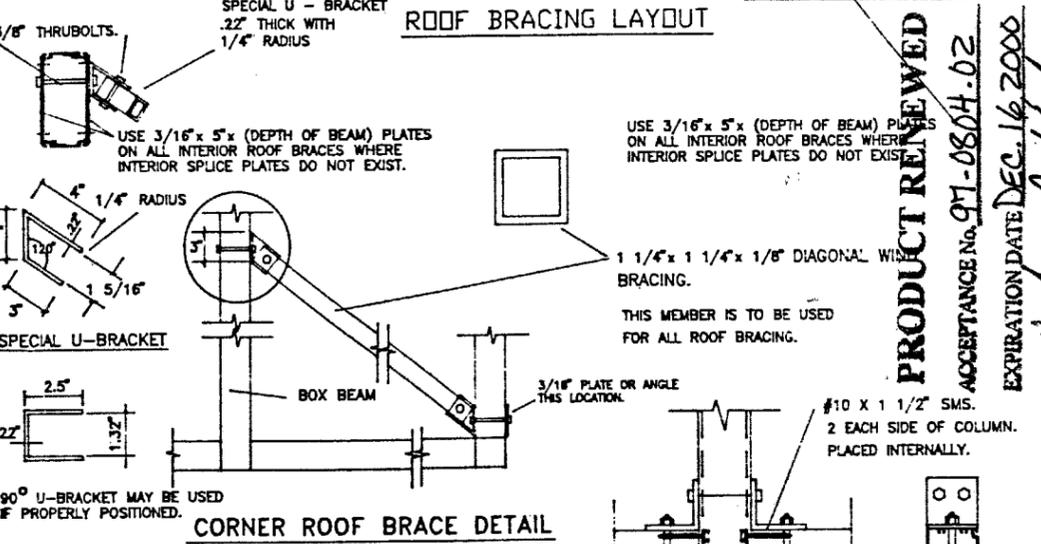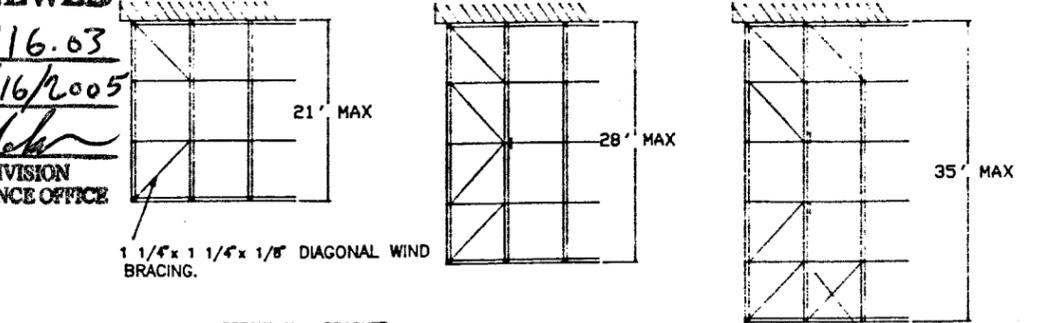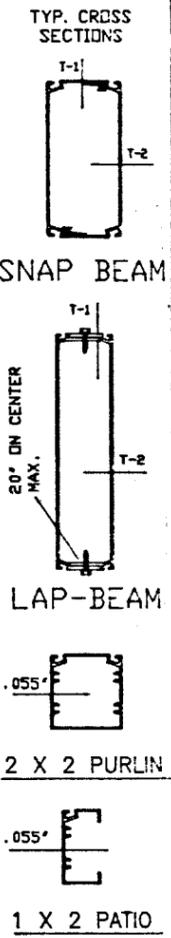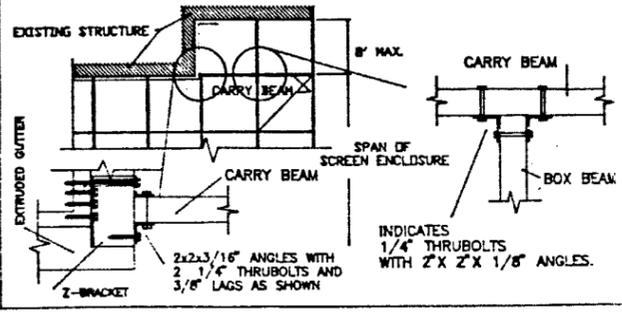

ANCHOR BOLTS TO EXTEND 1 1/4" BEYOND CHATT. OR BRICK PAVEMENT SURFACES

NOTE: COLUMNS ALONG END WALLS REQUIRE ONE PAIR OF 2X2X1/8" ANGLES UNLESS COLUMNS ARE 2X5 OR GREATER. THEN TWO PAIR OF ANGLES ARE REQUIRED.

REPRODUCTION AND APPROVAL OF THIS PLAN OR ANY PART THEREOF FOR CONSTRUCTION OR ANY OTHER USE SHALL ONLY BE DONE BY RAMMS ENGINEERING, INC.

THIS PLAN IS INVALID UNLESS SIGNED AND SEALED BY ROBERT S. MONSOUR FOR EACH SUBMITTAL.

WHEN USING 4 ANGLES, 1/4" X 3" ANCHORS MAY BE USED.

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE JULY 27 1995
 BY [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 95-0615.04

9/2/94
 9/23/94
 10/2/94
 10/2/94

RAMMS ENGINEERING, INC.
Structural Design
 2100 W. 76th STREET, SUITE 311
 MIAMI, FLORIDA 33016

GENERAL/KENDALL SCREEN SERVICE
 7342 S.W. 45th STREET
 MIAMI, FLORIDA 33185

MONSOUR
 R.S.
 8/30/94
 30225
 1
 -3-

PRODUCT RENEWED

ACCEPTANCE NO. 00-1116-03

EXPIRATION DATE 12/16/2005

By *Herb A. M...*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

(2X3, 2X4, 2X5 AND 2X6 BOX BEAMS)

USE 1/8" X 2" X 8" STRAPS WITH 6 #14 SMS TOTAL (3 EACH SIDE OF SPLICE)

(2X7, 2X8, 2X9 AND 2X10 BOX BEAMS)

USE 1/8" X 2" X 12" STRAPS WITH 14 #14 SMS TOTAL

3/16" X 1 1/4" STRAPS MAY BE USED IN PLACE OF 2" STRAPS.

72"

ALL PLATES

3/16" PLATES WITH #14 SMS AS SHOWN CUT PLATES TO FIT INSIDE OF BOX BEAMS AS SHOWN ON DETAIL

4" BOX BEAM
3" BOX BEAM

STRUCTURAL GUTTER DETAIL

CORNER DETAIL

FASCIA CONNECTION FOR DOMES

6" BOX BEAM

7" BOX BEAM

8" BOX BEAM

9" BOX BEAM

10" BOX BEAM

MANSARD BOX BEAM SPLICE DETAIL

TYPICAL ELEVATION

K - BRACE DETAILS

1X2X3/16" ANGLE 10" LONG AT EACH SCREEN ROOF BEAM

60" MAX.

VARIES

1 1/2"

VARIES

7"

VARIES

1 7/8"

VARIES

7"

VARIES

3"

VARIES

9"

VARIES

9"

VARIES

9 3/4"

VARIES

9"

VARIES

9 3/4"

VARIES

3" RISER X 12" WIDE ALUM. ROOF PANEL

2"X3"X1/8" ANGLE ON EACH SIDE

2"X2"X1/8" ANGLE WITH 2 #10 S.M.S. IN EACH LEG

BASE ANGLES MIN 2" X 2" X 1/8"

END WALL POST DETAIL

SPECIAL Z BRACKET 7" LONG AT EACH ALUMINUM RAFTER FASTENED TO FASCIA WITH 1/3 5/16" X 3" LAGS

BEAM TO COLUMN CONNECTION

CONTINUOUS DIVERTER (optional)

INDICATES 3/8" X 8" LAGS AT EACH BEAM

INDICATES 3/8" X 8" LAGS AT EACH BEAM LOCATION CAULK EA. LAG

MAX. 4" WIDE GUTTER MAY BE USED AS SHOWN ON BEAM TABLE SHEET #1 (MAX. LOAD = 1100#)

GUTTER BRACE DETAIL

2 - #10 X 1 1/2" SMS EACH PURLIN

2X2 PURLINS

1/16" U CLIPS WITH #10 X 1" SMS AS SHOWN

2X2X3/16" ANGLE W/ 1/4" X 3" ANCHORS AND #14 SMS.

USE 3/8" ANCHORS FOR 2X7 AND GREATER BEAMS.

BOX BEAM DETAILS

#10 SMS 24" D.C. TOP AND BOTTOM

















APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE

DATE JULY 27 1995

BY *Herb A. M...*

PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE

ACCEPTANCE NO. 95-0615.04

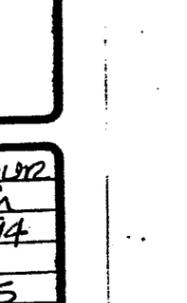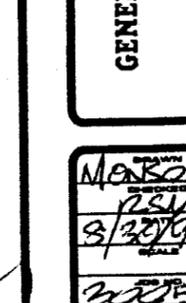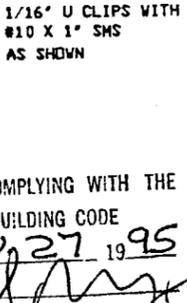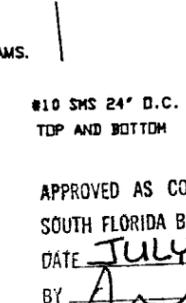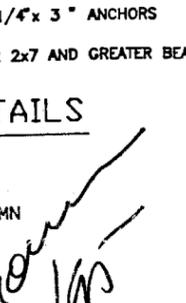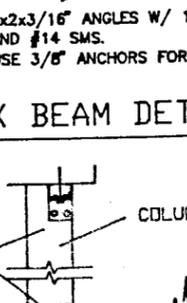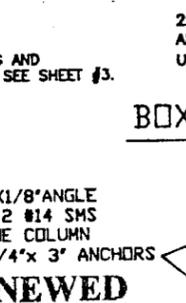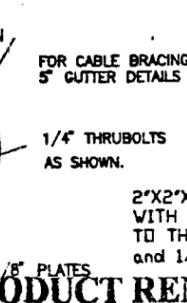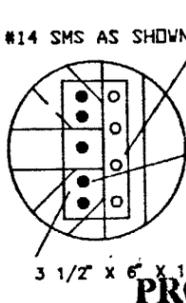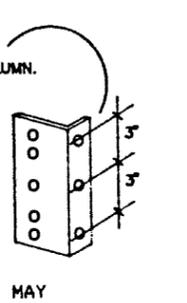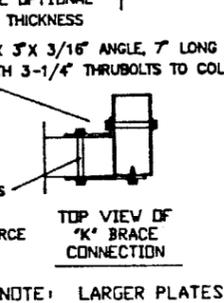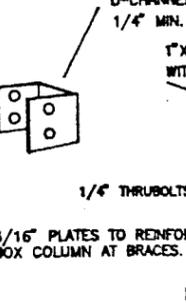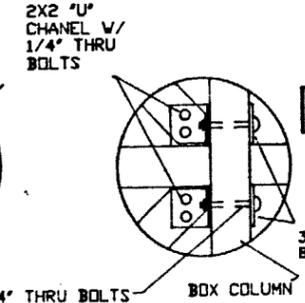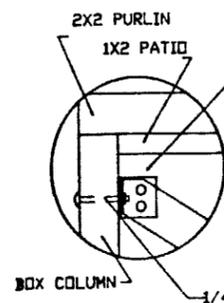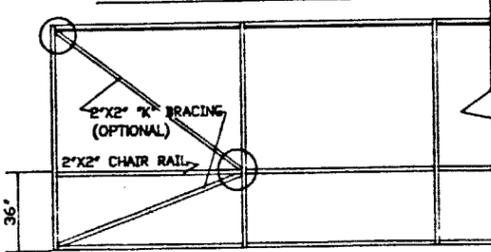

Handwritten notes and dates in a table format.

RAMMS ENGINEERING, INC. Structural Design 2100 W. 76th STREET, SUITE 311 MALEAH, FLORIDA 33016

GENERAL/KENDALL SCREEN SERVICE 7342 S.W. 45th STREET MIAMI, FLORIDA 33185

Handwritten notes and dates in a table format.

REPRODUCTION AND APPROVAL OF THIS PLAN OR ANY PART THEREOF FOR CONSTRUCTION OR ANY OTHER USE SHALL ONLY BE DONE BY RAMMS ENGINEERING, INC.

THIS PLAN IS INVALID UNLESS SIGNED AND SEALED BY ROBERT S. MONSOUR FOR EACH SUBMITTAL.


PRODUCT RENEWED ACCEPTANCE NO. 97-0804.02

EXPIRATION DATE DEC. 16 2000


By *Herb A. M...*

PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE

SPECIAL Z BRACKET 7" LONG.
4" WIDE GUTTERS ONLY.

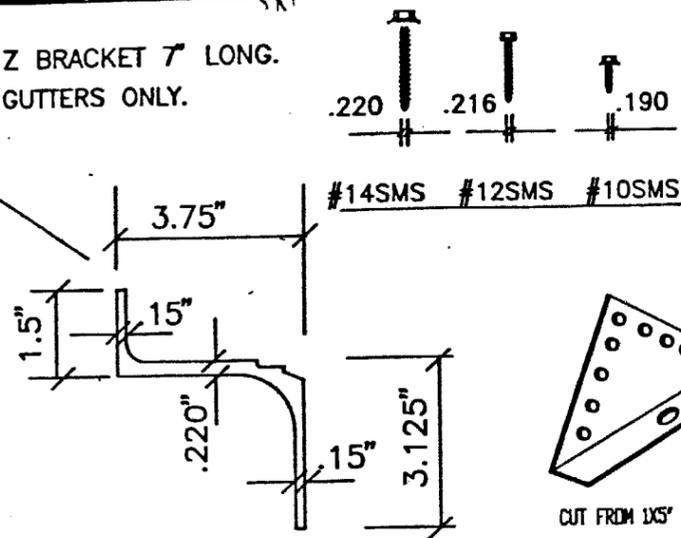

4" Z-BRACKET

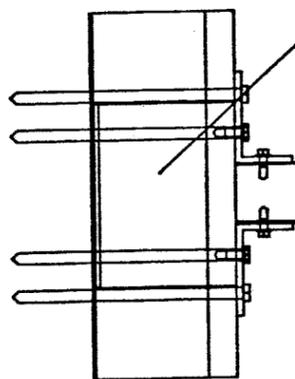

6" SUPER BRACKET WITH (4) 3/8"
X 2 1/2" LAG BOLTS TO FASCIA


PRODUCT RENEWED

ACCEPTANCE No. 00-1116.03

EXPIRATION DATE 12/16/2005


By Helmut A. Mark
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

ALTERNATE

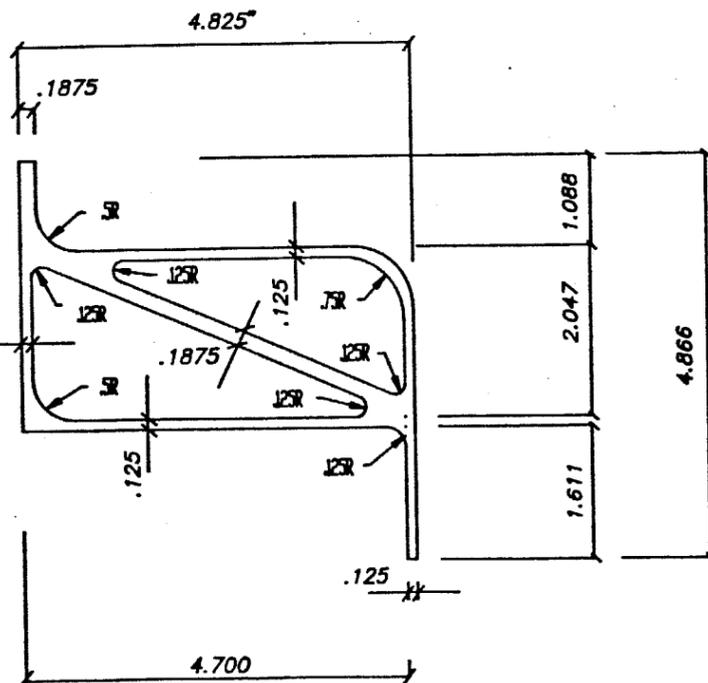





ALTERNATE GUTTER SIZE

1/8" ANGLE BRACKET WITH (9) #14 X 3/4" SMS TO WALL MEMBERS

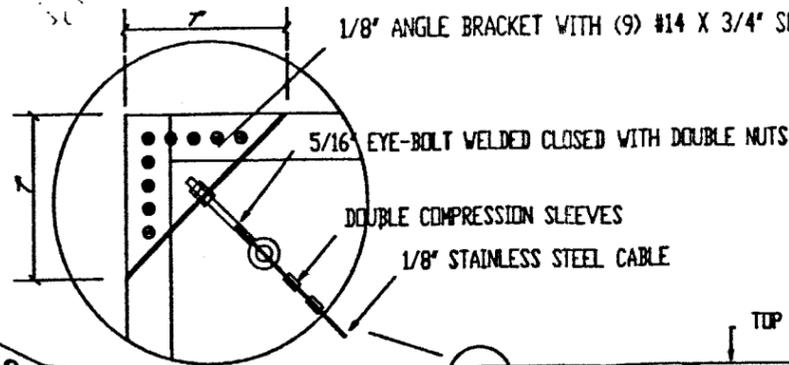

| END NON LOAD BEARING WALL SQUARE FOOTAGE | | | | |
|---|-----------|-----------|-----------|-----------|
| 1-145 | 146-273 | 274-363 | 364-416 | 417-443 |
| TOTAL NUMBER OF CABLES ON THE FRONT LOAD BEARING WALL | | | | |
| 2 | 4 | 6 | 8 | 10 |
| 1 EA. END | 2 EA. END | 3 EA. END | 4 EA. END | 5 EA. END |

QUANTITIES ABOVE ARE FOR 3 SIDED ENCLOSURES.
REFER TO ENGINEER'S SITE SPECIFIC PLAN FOR OTHER CONDITIONS.
USE ONE SET OF CABLES ON RETURN WALLS
FOR SPANS OVER 16 FEET.

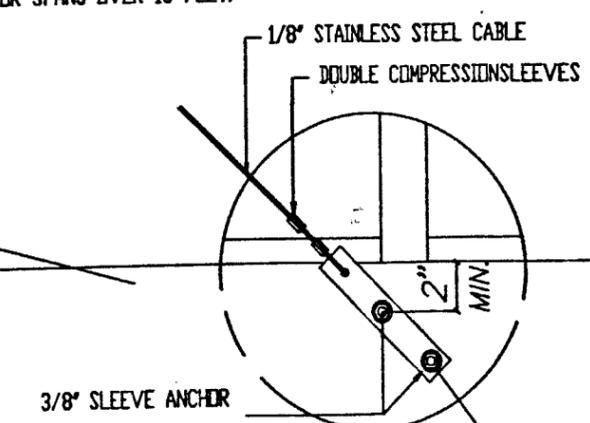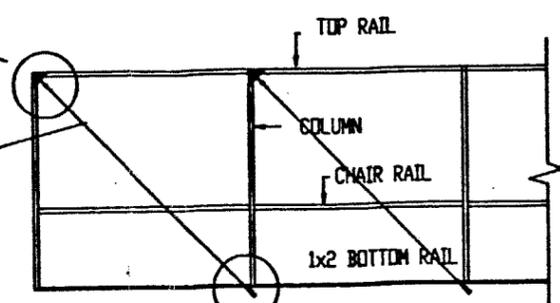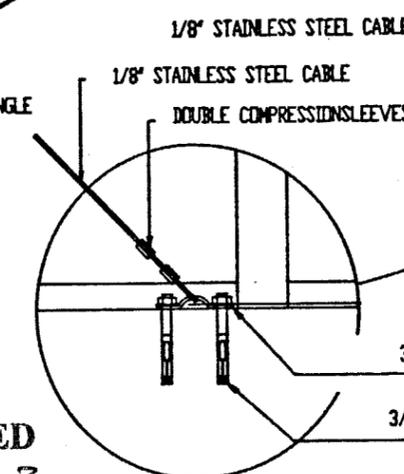

THIS CLIP MAY ALSO BE USED ON SIDE OF
CONCRETE SLAB. MAINTAIN 2" MIN. EDGE DISTANCE.


CABLE BRACING DETAIL

6" SUPER BRACKET WITH (4) 3/8"
X 2 1/2" LAG BOLTS TO FASCIA

FASTEN SUPER GUTTER TO
THE HOST STRUCTURE WITH
1/4" X 2 1/2" LAGS 20" O.C.

2" X 3" X 1/4" ANGLE @ EACH SIDE OF ROOF BEAM
WITH (4) #14 X 3/4" SMS TO ROOF BEAM AND (2) 3/8"
X 8" LAG BOLTS & (3) #14 X 1" SMS TO GUTTER

NOTE: WHEN 1x2 PERIMETER MEMBER IS USED, USE 2 SETS OF 1/4" ANGLES.

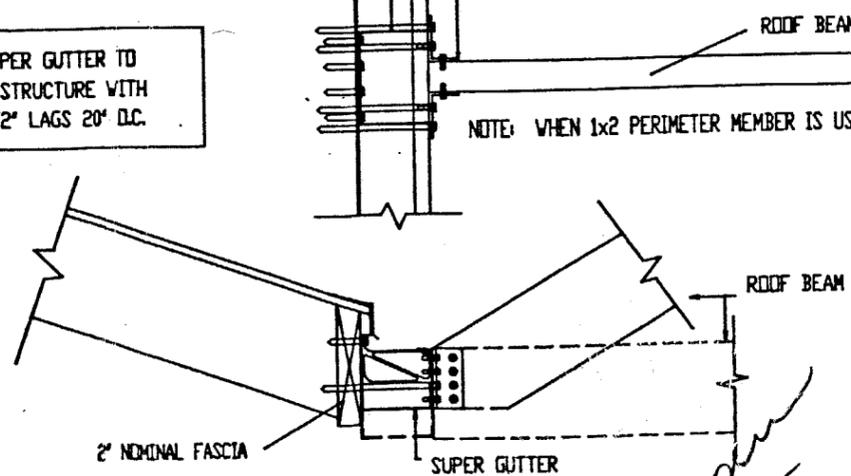

5" GUTTER BRACKET DETAILS

1 1/4" X 5 5/8" X 1/8" PLAT BAR

PRODUCT RENEWED

ACCEPTANCE No. 97-0804.02

EXPIRATION DATE DEC. 16, 2000

By Helmut A. Mark

PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JULY 27, 1995
BY [Signature]
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE No. 95-0615.04

| REVISIONS | BY |
|-----------|----|
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |
| | |

RAMMS ENGINEERING, INC.
Structural Design
2100 W. 78th STREET, SUITE 311
HALEAH, FLORIDA 33016
EB 0006024

GENERAL/KENDALL SCREEN SERVICE
7342 S.W. 45th STREET
MIAMI, FLORIDA 33185

| |
|--------------|
| MONSOUR |
| RSM |
| JUNE 6, 1995 |
| SHOWN |
| 3005 |
| 3 |
| 3 |