



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Sto Corporation
6175 Riverside Drive, S.W.
Atlanta, GA 30331

Your application for Notice of Acceptance (NOA) of:

Sto HI-CM Exterior Insulation and Finish System

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 00-1206.02
EXPIRES: 01/08/2006

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 02/08/2001

Sto Corporation.

ACCEPTANCE NO: 00-1206.02

APPROVED: FEB 08 2001

EXPIRES: 01/08/2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1 This renews & revises the Notice of Acceptance No. 99-1220.05 that was issued on 05/26/00. It approves Sto Exterior Insulation and Finish System as described in Section 2 of this Notice of Acceptance (N.O.A.) designed to comply with the South Florida Building Code 1994 Edition for Miami-Dade County (SFBC). For the location where the pressure requirements, as determined by the SFBC Chapter 23 do not exceed the design pressure rating values indicated in the approved drawing.

2. PRODUCT DESCRIPTION

- 2.1 The Sto EIF System installed over an Impact Resistance Substrate of concrete masonry units and its components shall be constructed in strict compliance with the following documents: Drawing No. Sto Hi-CM-3, sheets 1 through 3 of 3. Titled "Sto Hi-CM EIFS over CMU for Large Missile Impact Resistance" prepared by Sto Corporation, Inc., dated 11/03/2000, with no revisions. They bear the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the Approved Drawing.

3. LIMITATIONS

- 3.1 This system is not to be used on horizontal surfaces exposed to weather except as a soffit, it is intended to be used on wall systems only.

4. INSTALLATION

- 4.1 The Sto EIFS and its components shall be installed in strict compliance with the approved drawing.
4.2 The installation of this product does not require Hurricane Protection System.

5. LABELING

- 5.1 Each component shall bear a permanent label with the manufacturer's logo, city, state and the following statement "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for Building Permit shall be accompanied by copies of the following:
6.1.1 This Notice of Acceptance.
6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this N.O.A.
6.1.3 Any other document required by the Building Official or the SFBC in order to properly evaluate the installation of this system.



Candido Font PE, Senior Product Control Examiner
Product Control Division

Sto Corporation.

ACCEPTANCE NO.: 00-1206.02

APPROVED: FEB 0 8 2001

EXPIRES: 01/08/2006


NOTICE OF ACCEPTANCE STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.



Candido Font PE, Senior Product Control Examiner
Product Control Division

END OF THIS ACCEPTANCE

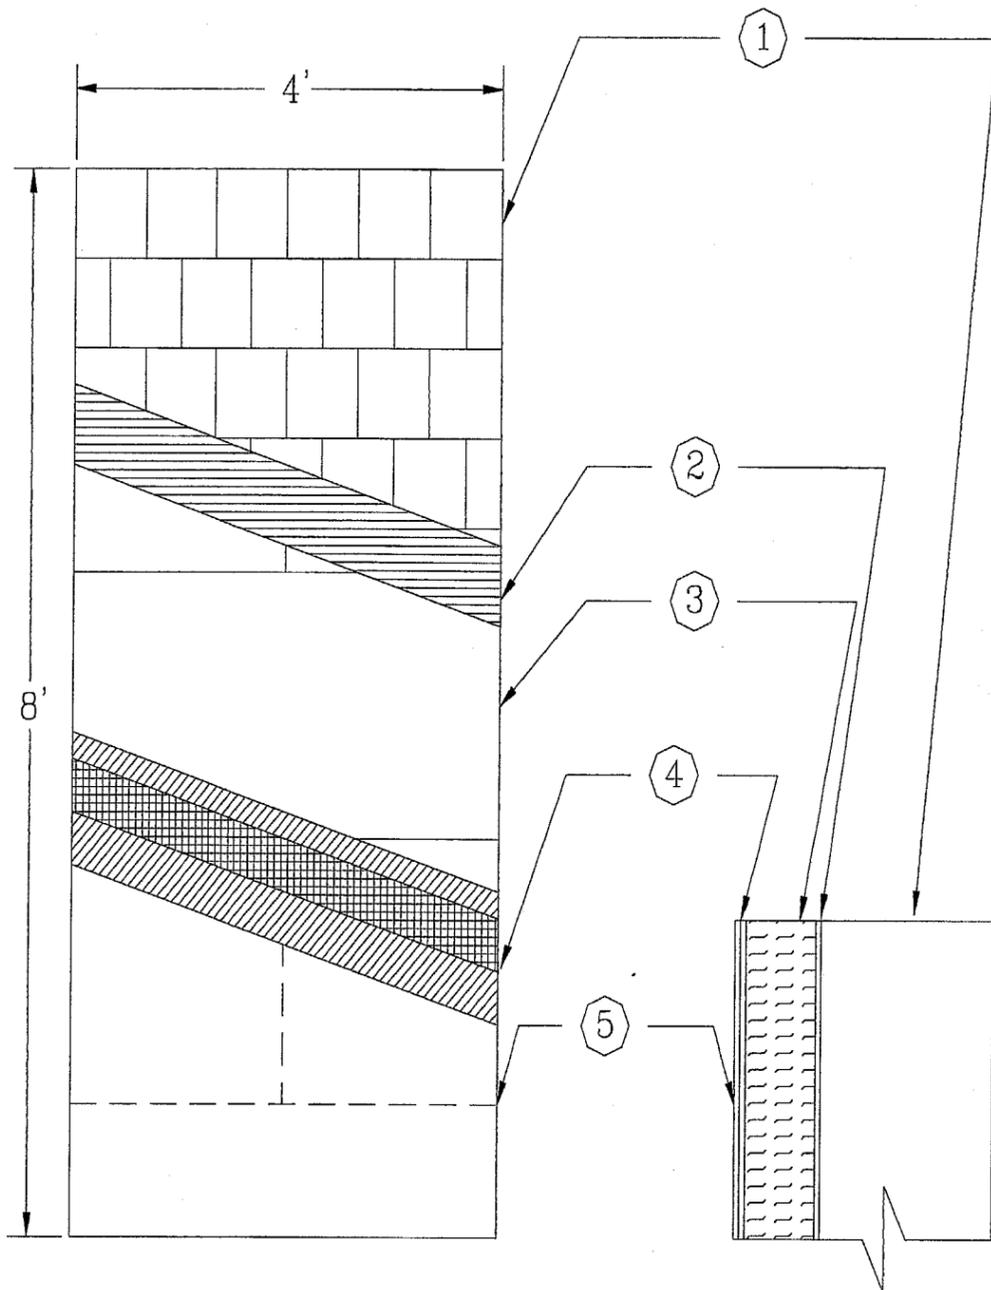

DESCRIPTION

- 1.1 Sto Exterior Insulation and Finish System
 - 1.1.1. Sto (Apache) EPS Expanded Polystyrene insulation 1" thick with a density of 1PCF as approved by Dade County NOA# 98-0904.04
 - 1.1.2. Sto Primer/Adhesive -B (No. 101) is a polymer modified cement based material used as an adhesive and base coat in R-Wall systems
 - 1.1.3. Sto mesh (No. 920) a glass fiber fabric used for impact resistance of the Sto systems
 - 1.1.4. Sto textured finishes (No. 310, 306, and 307) are ready mixed acrylic-based exterior or interior textured finishes, used as decoration and protection with the Sto systems. Three (3) are available: Fine Sand, Medium Sand, and Swirl.
- 1.2 Application
 - 1.2.1. The exposed CMU surface is cleaned to remove any bond inhibiting particles from the application surface.
 - 1.2.2. The Sto Primer /Adhesive-B is mixed with 7-9 quarts of water using a clean rust free high speed electric drill and paddle. the mixture is allowed to set for approximately 5 minutes and then remixed to a uniform consistency. The adhesive is applied to the back of the Sto (Apache) insulation board using a 5/8" x 5/8" square notched trowel. Uniform ribbons of adhesive are formed on the Sto (Apache) insulation board parallel to the long dimension of the board.
 - 1.2.3. The Sto (Apache) insulation board 1" thick is applied to the CMU surface horizontally with staggered joints. Uniform pressure is applied to the insulation board to ensure proper adhesion to the CMU surface. Once the entire surface of the CMU is covered with the insulation board it is left overnight to cure.
 - 1.2.4. The Sto Primer /Adhesive-B is mixed with 7-9 quarts of water using a clean rust free high speed electric drill and paddle. The mixture is allowed to set for approximately 5 minutes and then remixed to a uniform consistency. A 1/8" thick layer is applied to the exposed surface of the STO (Apache) insulation board using a stainless steel trowel.
 - 1.2.5. Sto mesh is embedded in the wet Primer/Adhesive-B by troweling from the center to the edges of the mesh and the excess is removed. This process is repeated until the entire exposed area of the insulation board is covered with mesh. Once covered, it is allowed to dry for a minimum of 12 hours.
 - 1.2.6. Once the mesh reinforcing coat is dry and cured, a minimum 1/16" coat of Sto textured finish is applied to the entire surface.
 - 1.2.7. This system shall be applied by a Dade County licensed plastering contractor, certified registered trained and monitored by Sto Corp., following the recommendations of the manufacturer, this NOA, and all applicable sections of the South Florida Building Code.
 - 1.2.8. This product is approved to be installed for a maximum design pressure of -100 PSF. Its application cannot exceed that pressure.

GENERAL NOTES:

- 1) This system has been designed in accordance with the South Florida Building Code 1994 Edition and its latest supplements.
- 2) This system has been tested in accordance with the Dade County Protocol PA-202 and PA-203 Structural and Cyclic Testing.
- 3) This System shall be applied by a licensed plastering contractor following the recommendations of Sto Corp., this notice of acceptance and the applicable sections of the South Florida Building Code.
- 4) The engineer and/or architect of record for each project using this system shall design the concrete block wall as required by governing codes and this document.
- 5) Insulation boards shall be placed in a running bond pattern.
- 6) All studs used with this system shall be completely sheathed at the interior flange or bridged at maximum every 5 ft. of stud length or as specified by stud manufacturer.
- 7) All concrete masonry units shall conform to ASTM C-90 and Type-S mortar per ASTM C-270.
- 8) Details on page No. 2 and 3 of 3 are typical and show intent to prevent water infiltration into and behind the system. Alternate details and specific conditions not covered by the typical details are the responsibility of the licensed design professional in consultation with Sto Corp.

KEY:

- 1. Nominal 8" Hollow Core Concrete Blocks
- 2. Sto Primer/Adhesive-B
- 3. EPS Board @ 1" Thick
- 4. Sto Primer/Adhesive-B with Sto Mesh Embedded
- 5. Sto Textured Finish

Impact Resistant Substrates

The minimum standards for CBS impact systems are: concrete masonry units (ASTM C-90) with Type S mortar (ASTM C-270) built according to the design of the Engineer or Architect of record per the requirements of the South Florida Building Code and the job specifics.


**Design Pressure Rating
- 100 PSF
Installed over
Impact Resistant Substrate**

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE February 08, 2001
BY [Signature]
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 00-1206.02

CERNY & IVEY ENGINEERS, INC.
CONSULTING ENGINEERS TESTING LABORATORY
5500 PEACHTREE PARKWAY, NORCROSS, GA 30092
1770-640-2932 • FAX 1770-325-1669

Sto Corp.
3800 Camp Creek Parkway
Building 1400, Suite 120
Atlanta, Ga. 30331
Sto HI-CM EIFS
Over CMU
for
Large Missile Impact Resistance
Drawing no. Sto HI-CM-3
Page No. 1 of 3
Date: 11/03/2000
Not to Scale


~~00-1206~~
00-1206.02

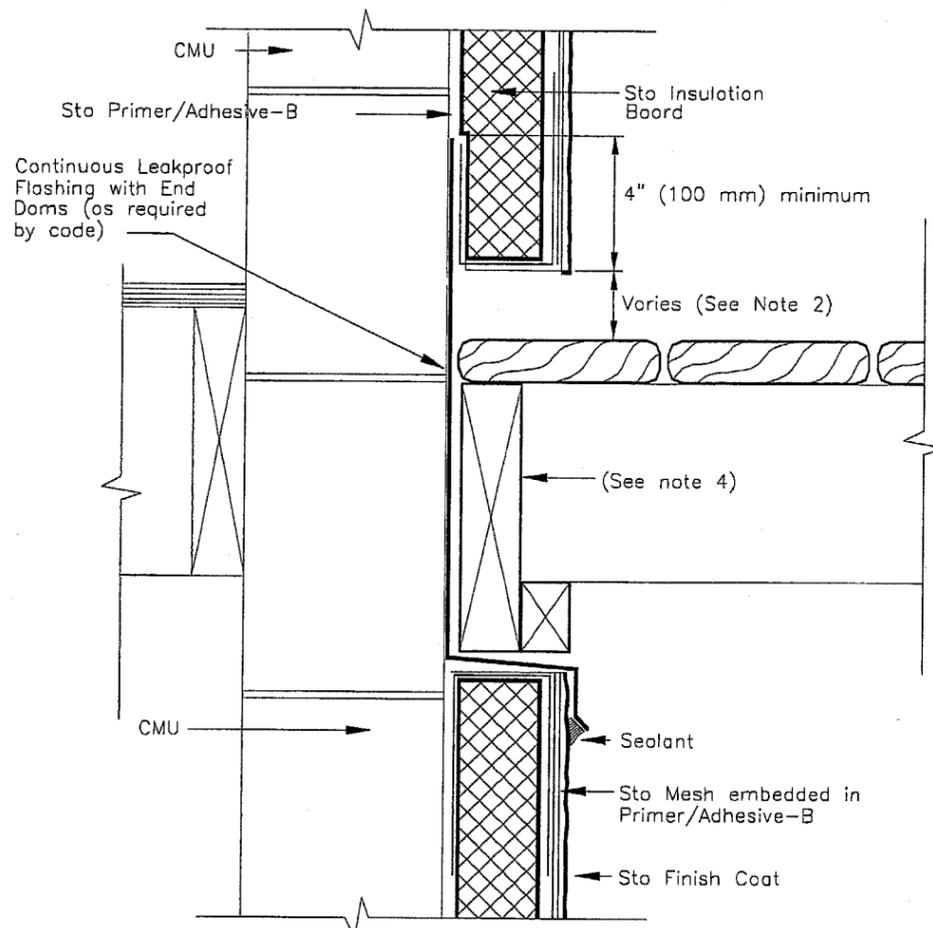


- Notes:**
1. Seal penetrations through flashing where attached to CMU.
 2. Distance of EIFS to deck varies with climate. Allow sufficient distance to prevent snow/ice and puddling water against system.
 3. Provide end dams where flashings terminate at ends of deck.
 4. Pressure treated wood (space from flashing or rout backside to provide drainage).

TERMINATION AT DECK
N.T.S.

TYPICAL DETAILS

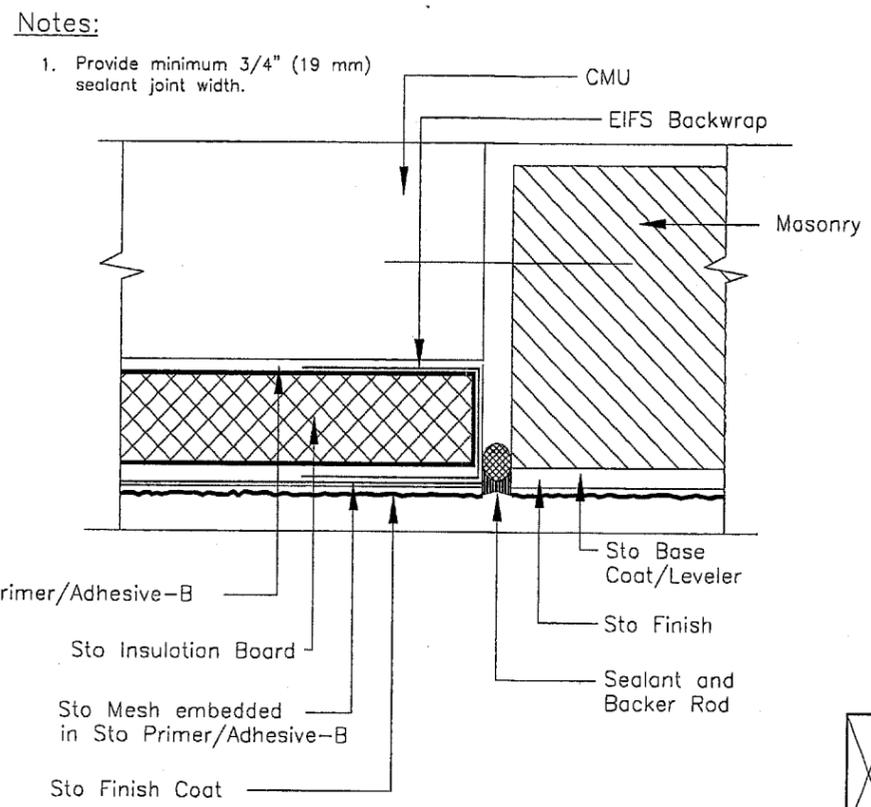


CONSTRUCTION JOINT
N.T.S.

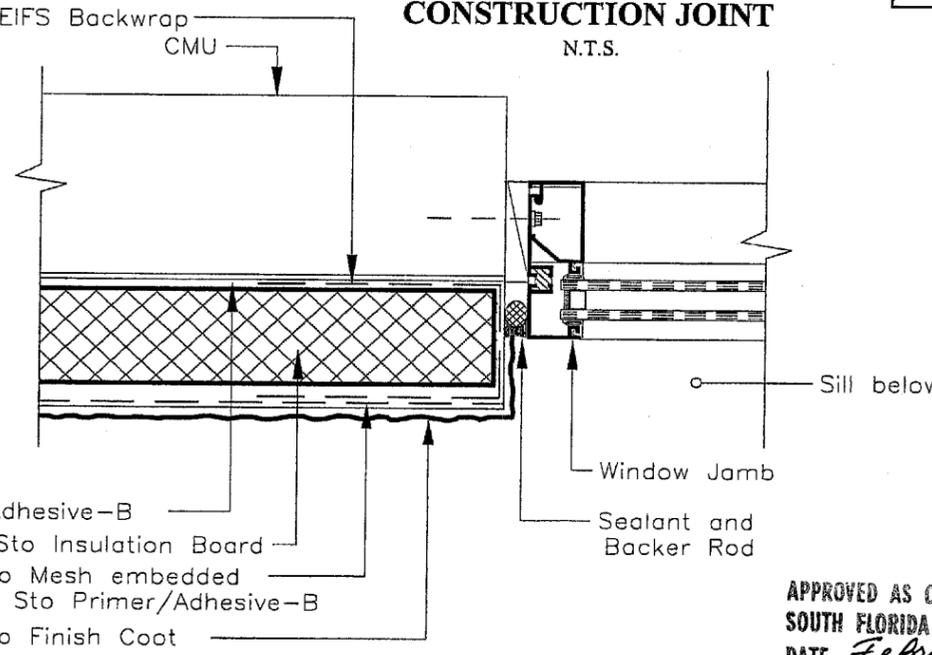

- Notes:**
1. Provide minimum 3/4" (19 mm) depth from back of insulation board to face of window frame for sufficient depth to install sealant.
 2. Provide minimum 1/2" (13 mm) sealant joint width.

WINDOW JAMB
N.T.S.

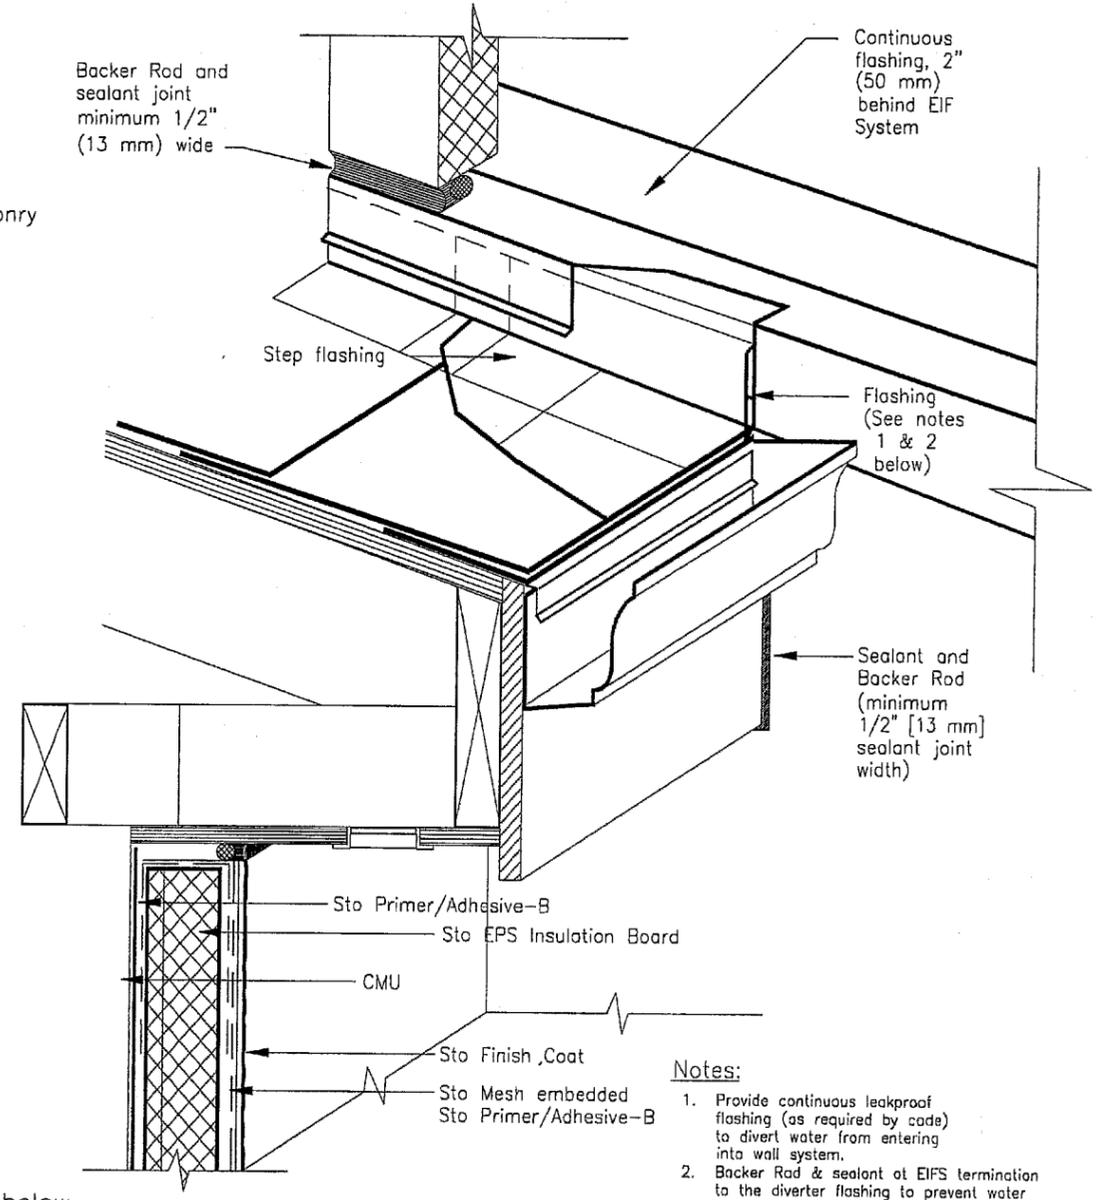

OVERHANG
N.T.S.

- Notes:**
1. Provide continuous leakproof flashing (as required by code) to divert water from entering into wall system.
 2. Backer Rod & sealant at EIFS termination to the diverter flashing to prevent water from penetrating behind EIFS.

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE *February 08, 2001*
BY *[Signature]*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *00-1206.02*

CERNY & IVEY ENGINEERS, INC.
CONSULTING ENGINEERS TESTING LABORATORY
5320 PRACHTREE PARKWAY, NORCROSS, GA 30052
17701-3440-3832 • FAX 17701-383-1180

[Signature]

Sto Corp.
3800 Camp Creek Parkway
Building 1400, Suite 120
Atlanta, Ga. 30331
Sto Hi-CMP BE IF
Over CMU
for
Large Missile Impact Resistance
Drawing no. Sto Hi-CM-3
Page No. 2 of 3
Date: 11/03/2000
Not to Scale

Sto Corp.
 3800 Camp Creek Parkway
 Building 1400, Suite 120
 Atlanta, Ga. 30331
 Sto HI-CMPB EIF
 Over CMU
 for
 Large Missile Impact Resistance
 Drawing no. Sto HI-CM-3
 Page No. 3 of 3
 Date: 11/03/2000
 Not to Scale


Handwritten signature

GERNY & WATT ENGINEERS, INC.
 CONSULTING ENGINEERS
 3800 PARKWAY PARKWAY, SUITE 200
 ATLANTA, GA 30331
 (770) 455-8888 FAX (770) 455-1465


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE February 08, 2001
 BY *Handwritten signature*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 00-1206.02

TYPICAL DETAILS


WINDOW SILL
 N.T.S.

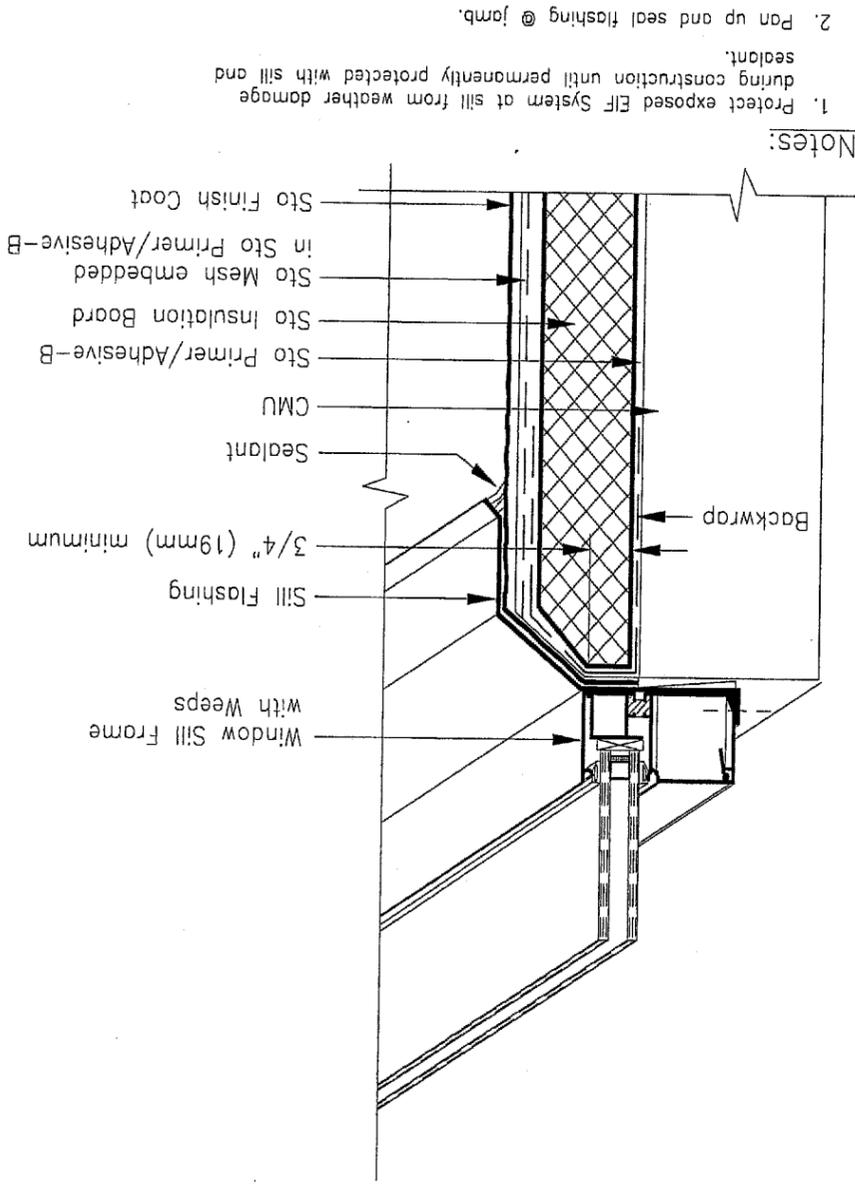

TERMINATION AT PENETRATION
 N.T.S.

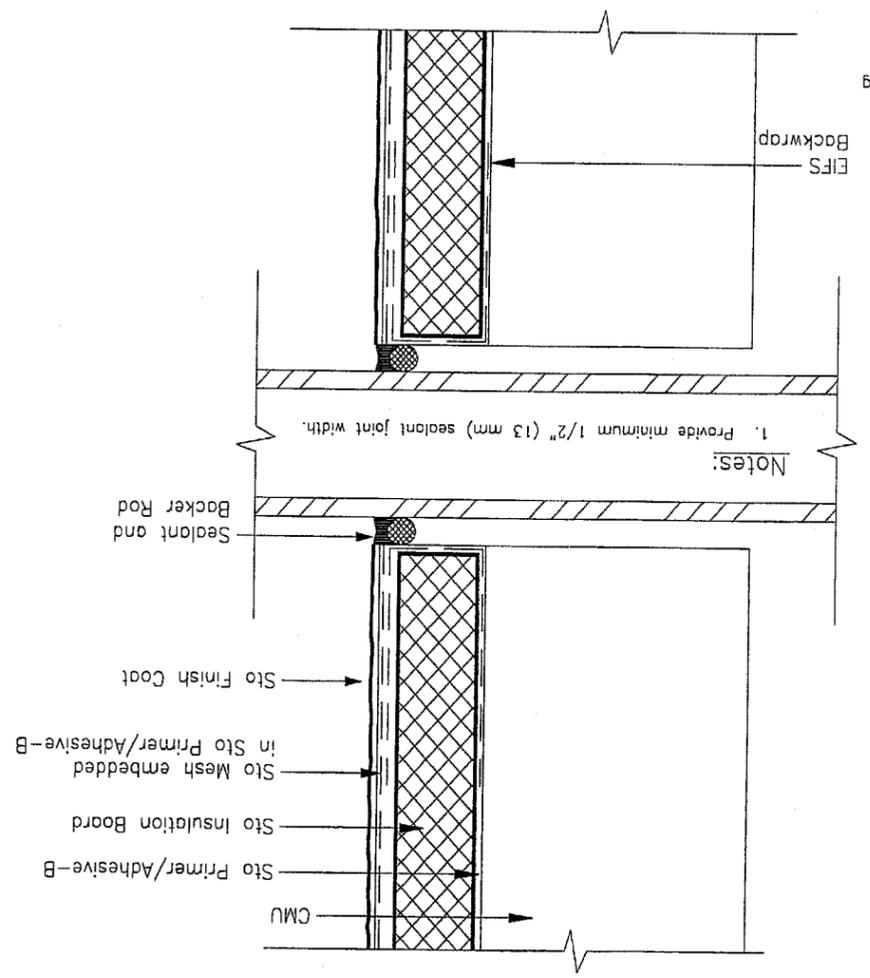

PARAPET
 N.T.S.

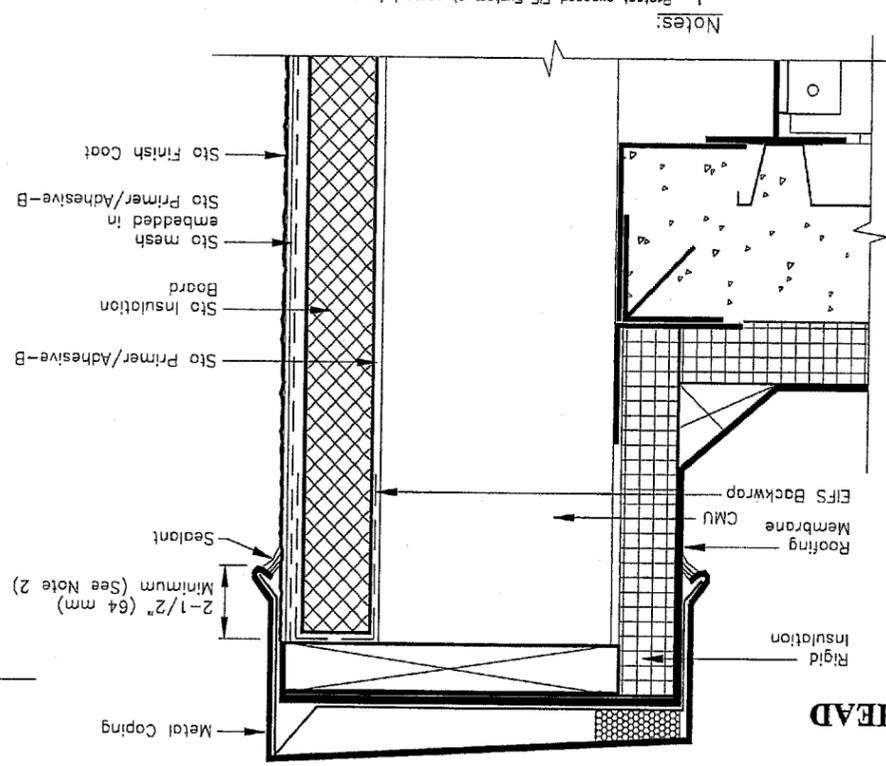

WINDOW HEAD
 N.T.S.

