



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
31725 Highway 97 North
Chiloquin, OR 97624**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Jeld-Wen Series "Door Craft" Single Outswing Insulated Steel Door (Steel edge)

APPROVAL DOCUMENT: Drawing No. S-2075, titled "3-0 x 7-0 Outswing. ", sheets 1 through 5 of 5, prepared by R.W. Building Consultants, Inc, dated 01-15-01 and last revised on 12-03-01, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA 01-0122.09 and consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**



**NOA No 01-0122.09
Expiration Date: April 25, 2007
Approval Date: April 25, 2002
Page 1**

DoorCraft® Steel Door

JELD-WEN OUT-SWING OPAQUE STEEL EDGE DOOR
IN AN ADJUSTABLE SPLIT STEEL JAMB

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SHALL BE AS FOLLOWS:
-SEE DESIGN PRESSURE RATING TABLE SHEET ONE.
5. TO IDENTIFY WHICH SYSTEM MEETS THE REQUIREMENTS FOR WATER IN MIAMI-DADE COUNTY, SEE THRESHOLD DETAILS.


RESIDENTIAL INSULATED STEEL DOOR W/STEEL EDGE (Common to all frame conditions)

Door Leaf Construction:


Face sheets: 24 ga. (0.022") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with min. average yield strength $F_y=34,680$ psi.
Core design: Expanded polystyrene with 1.0 to 1.25 lbs. density, manufactured by Jeld-Wen.

Construction: steel face sheets are glued to the expanded polystyrene (EPS). The steel rails (.040" min.) and steel stiles (.040" min.) are rolled formed. The face skin at the top and sides are bent over and into the stiles & rails to make a mechanical lock. At the bottom the face skin is bent 90° over the rail. A wood lock block reinforcement is used.

Frame Construction (Both Frame Types): The head jambs and side jambs are a two piece formed steel frame. The base frame is 16ga. galvanized steel. The closure frame is formed from 18ga. galvanized steel. The head jamb extends past the side jambs. The side jambs have tabs that are inserted into slots in the header and are bent over 90° to form a mechanical lock with the header. The units use a bump face threshold.

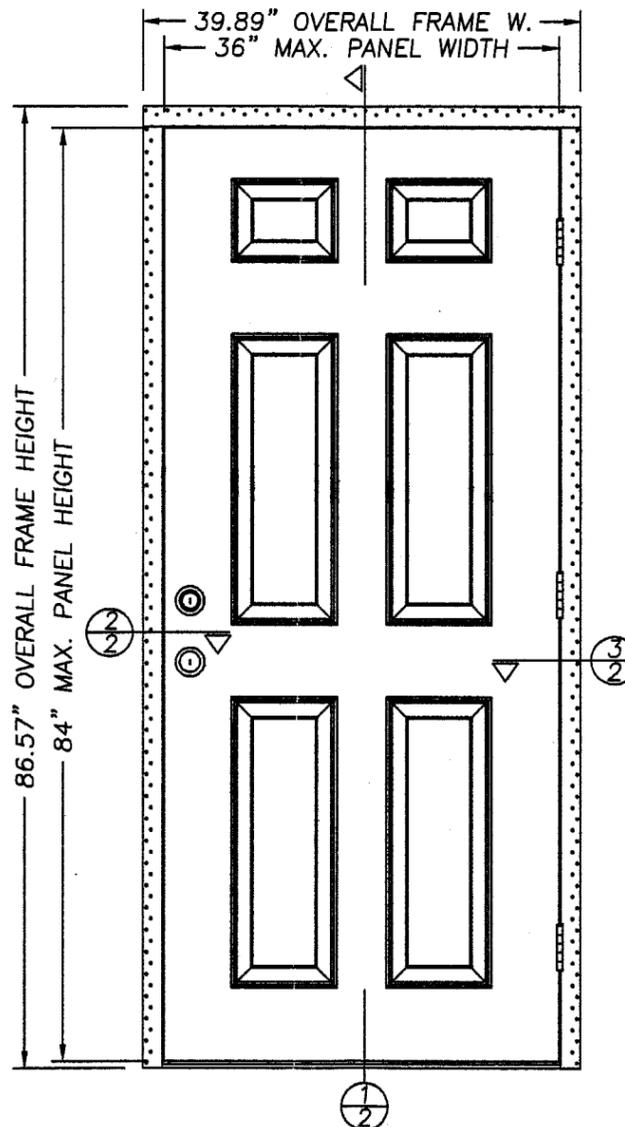

JELD-WEN STEEL EDGE DOOR
IN THE KEWANEE ADJUSTA-FRAME
VIEWED FROM THE EXTERIOR
OUTSWING UNIT

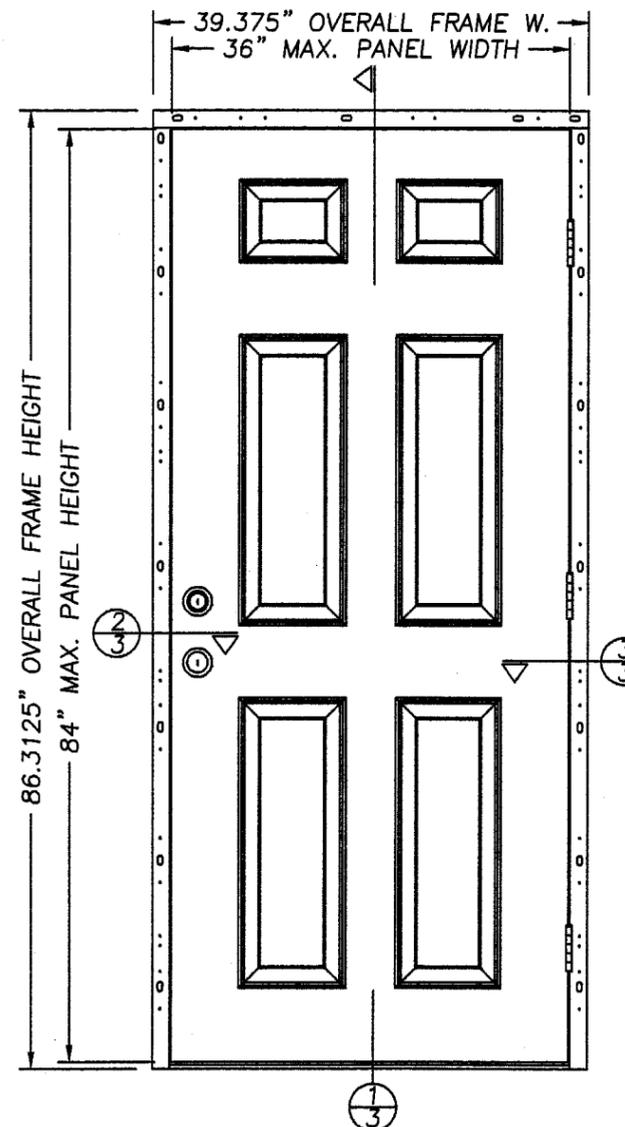

JELD-WEN STEEL EDGE DOOR
IN THE DUNBARTON REDIFLEX FRAME
VIEWED FROM THE EXTERIOR
OUTSWING UNIT

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
3'-0" x 7'-0" OUTSWING
STEEL EDGE DOOR IN AN
ADJUSTABLE STEEL FRAME

PART OR ASSEMBLY:
GENERAL NOTES &
TYPICAL ELEVATIONS

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/03/01			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

DATE: 01/15/01

SCALE: N.T.S.

DWG. BY: TJH

CHK. BY: RW

DRAWING NO.:

S-2075

SHEET 1 OF 5

TABLE OF CONTENTS


SHEET #	DESCRIPTION
1	GENERAL NOTES & TYPICAL ELEVATIONS
2	CROSS SECTIONS W/ THE KEWANEE FRAME
3	CROSS SECTIONS W/THE DUNBARTON FRAME
4	ANCHORING LOCATIONS & DETAILS (BOTH FRAMES)
5	UNIT COMPONENTS & BILL OF MATERIALS

DESIGN PRESSURE RATING


UNIT TYPE	* WHERE WATER INFILTRATION REQUIREMENT IS NEEDED
SINGLE 3'0" X 7'0"	+70.0 PSF -70.0 PSF

* SEE THRESHOLD DETAILS

Approved as complying with the
Florida Building Code
Date APRIL 25, 2002
NOAH 01-0122-09
Miami Dade Product Control
Division
By Shag I. Chanda

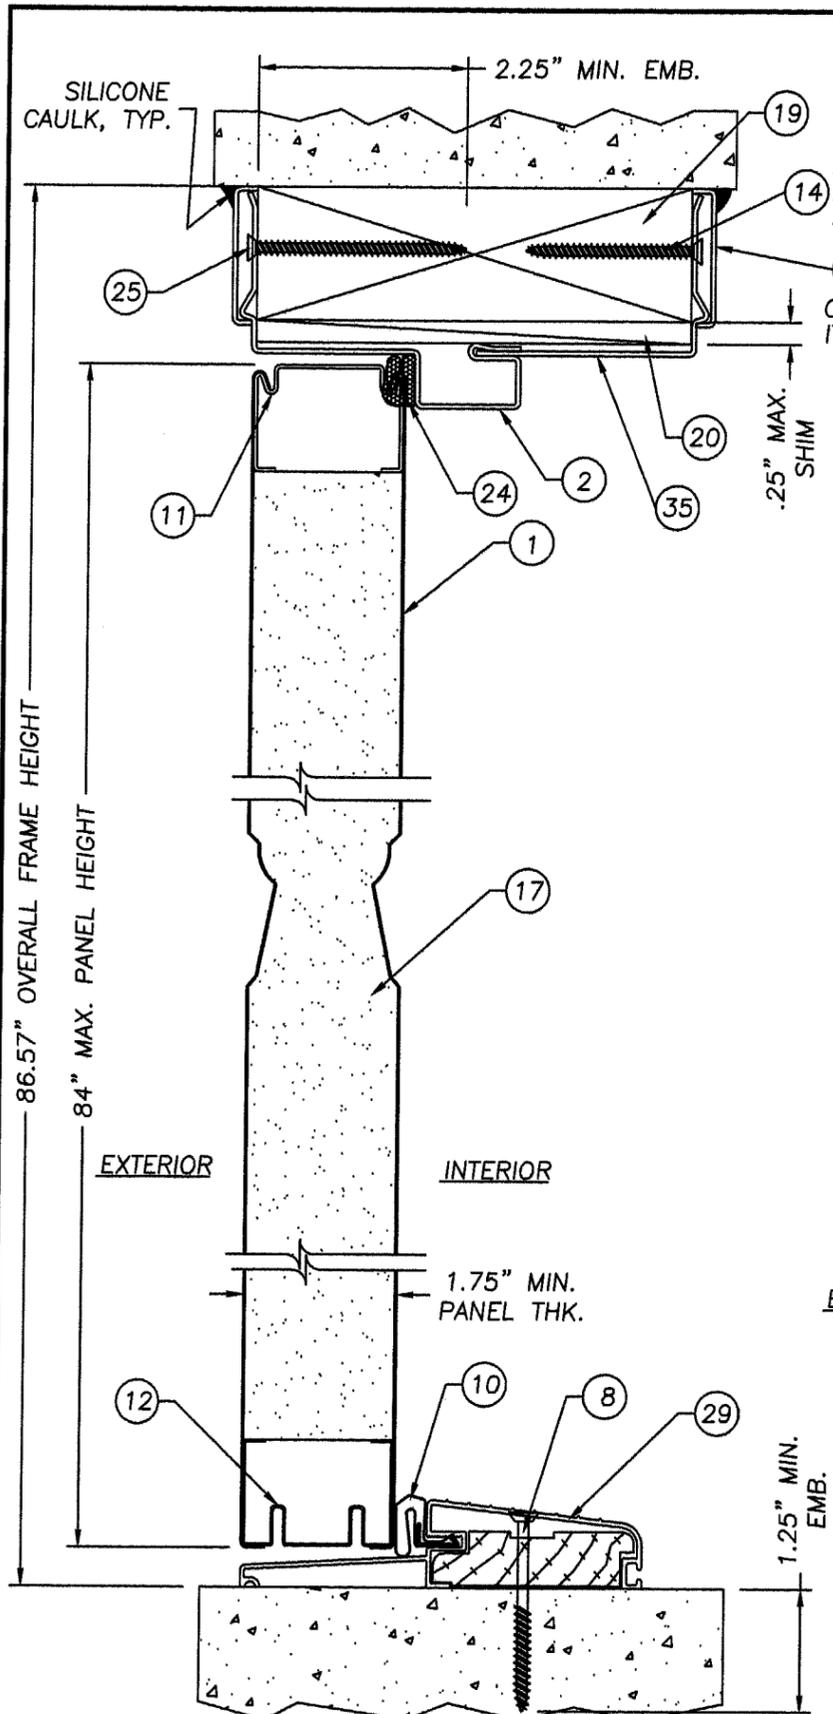


1 VERTICAL CROSS SECTION W/
2 ENDURA BUMPFACE THRESHOLD ITEM #29

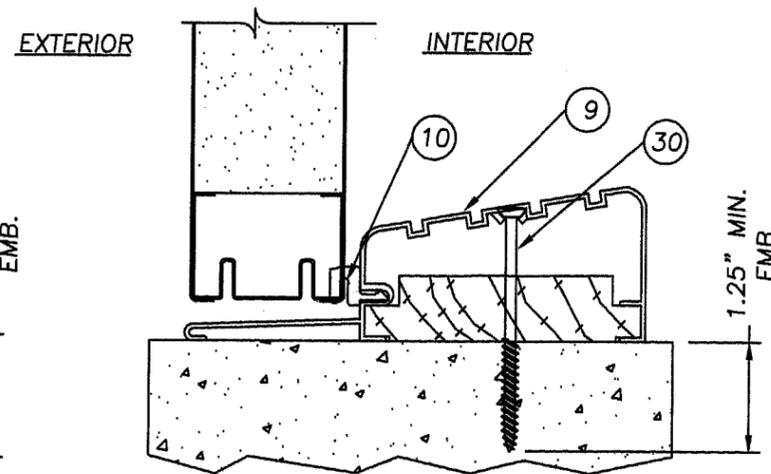


1 VERTICAL CROSS SECTION W/
2 HIGH WATER DAM THRESHOLD ITEM #9
NOTE: THIS THRESHOLD HAS NOT BEEN TESTED FOR WATER INFILTRATION

NOTE:
SNAP-ON TRIM PACKAGES ARE AN OPTION
AND CAN BE ORDERED FOR ONE SIDE, BOTH
SIDES OR NOT ORDERED AT ALL.

SEE NOTE #3
SHT. #4 FOR SPACING

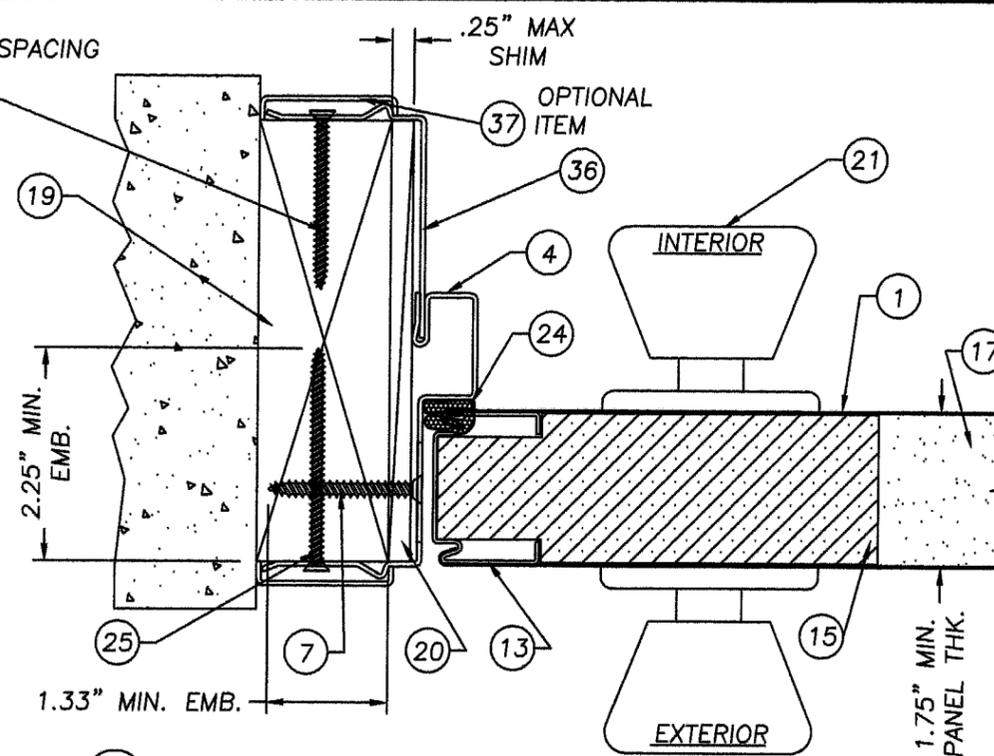

2 HORIZONTAL CROSS SECTION
2 LATCH JAMB TO BUCK

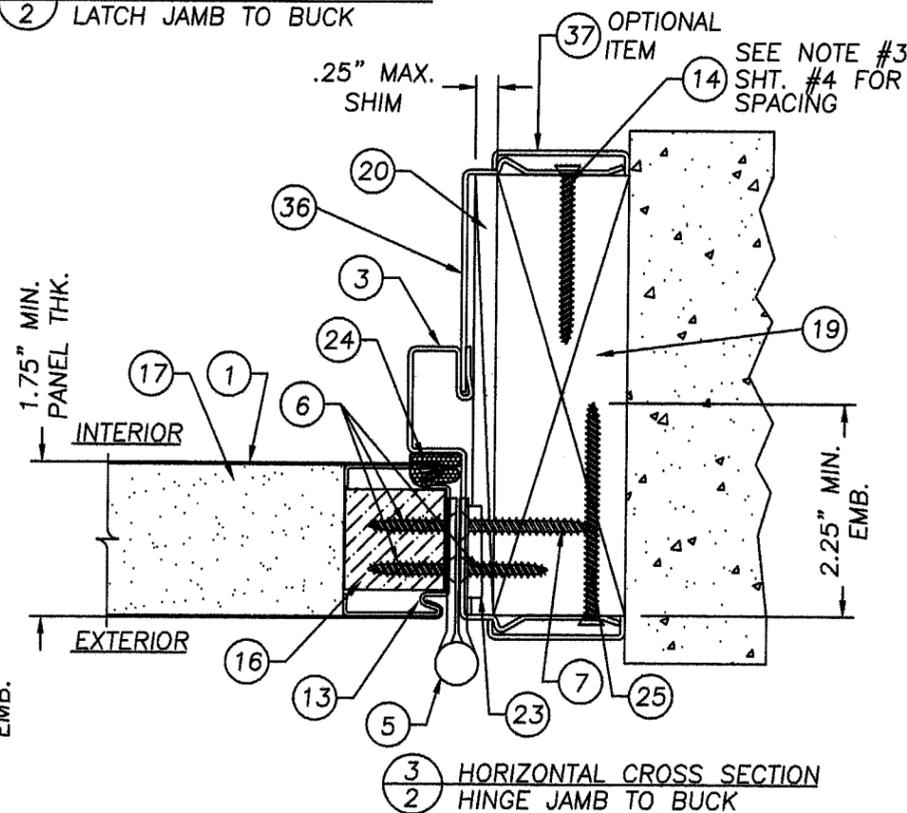

3 HORIZONTAL CROSS SECTION
2 HINGE JAMB TO BUCK

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT:
3-0 x 7-0 OUTSWING
STEEL EDGE DOOR IN AN
ADJUSTABLE STEEL FRAME
PART OR ASSEMBLY:
CROSS SECTIONS W/THE
KEWANEE FRAME

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/03/01			


RW BUILDING
CONSULTANTS, INC.
813.684.3831

Approved as complying with the
Florida Building Code
Date APRIL 25, 2002
NOA# 01-0122-09
Miami Dade Product Control
Division
By Isaac J. L. L...

DATE: 01/15/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2075
SHEET 2 OF 5

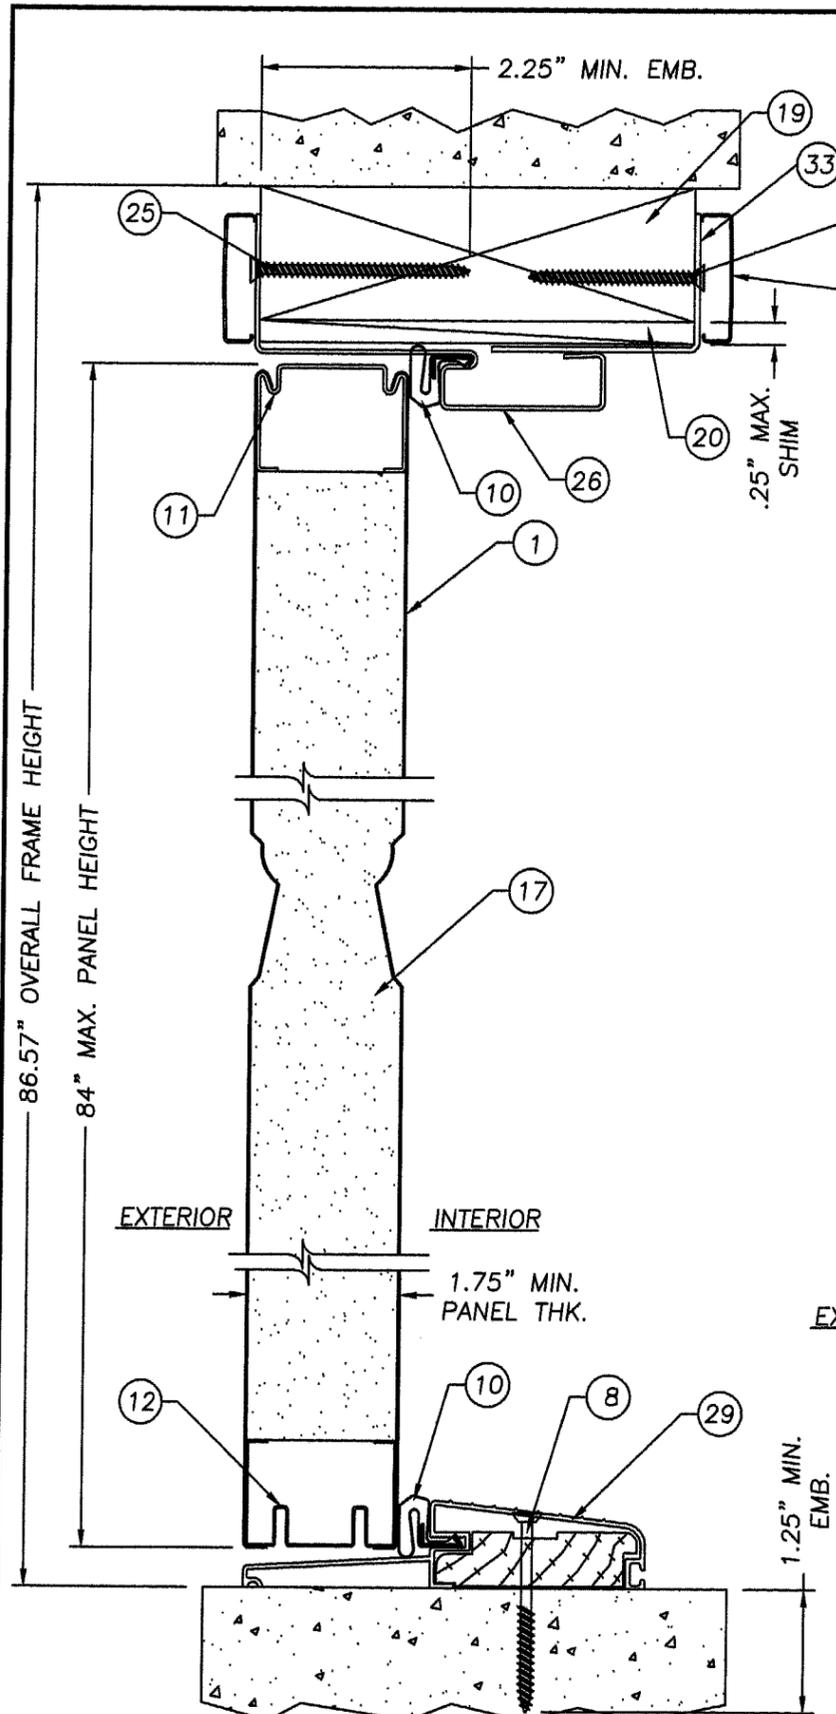


1 VERTICAL CROSS SECTION W/
3 ENDURA BUMPFACE THRESHOLD ITEM #29

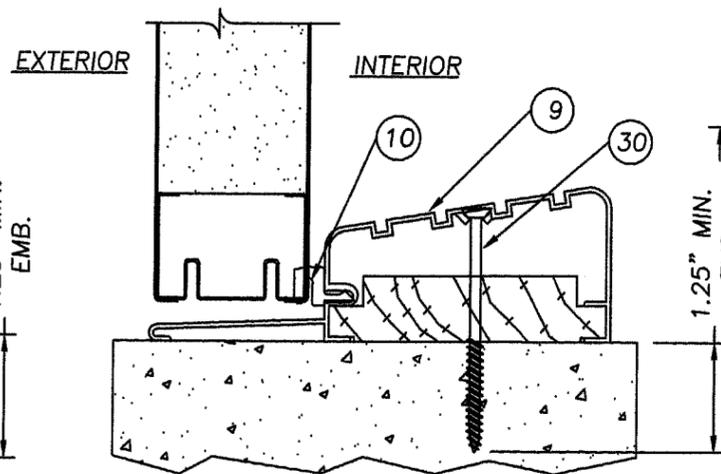


1 VERTICAL CROSS SECTION W/
3 HIGH WATER DAM THRESHOLD ITEM #9
NOTE: THIS THRESHOLD HAS NOT BEEN TESTED FOR WATER INFILTRATION

NOTE:
SNAP-ON TRIM PACKAGES ARE AN OPTION
AND CAN BE ORDERED FOR ONE SIDE, BOTH
SIDES OR NOT ORDERED AT ALL.

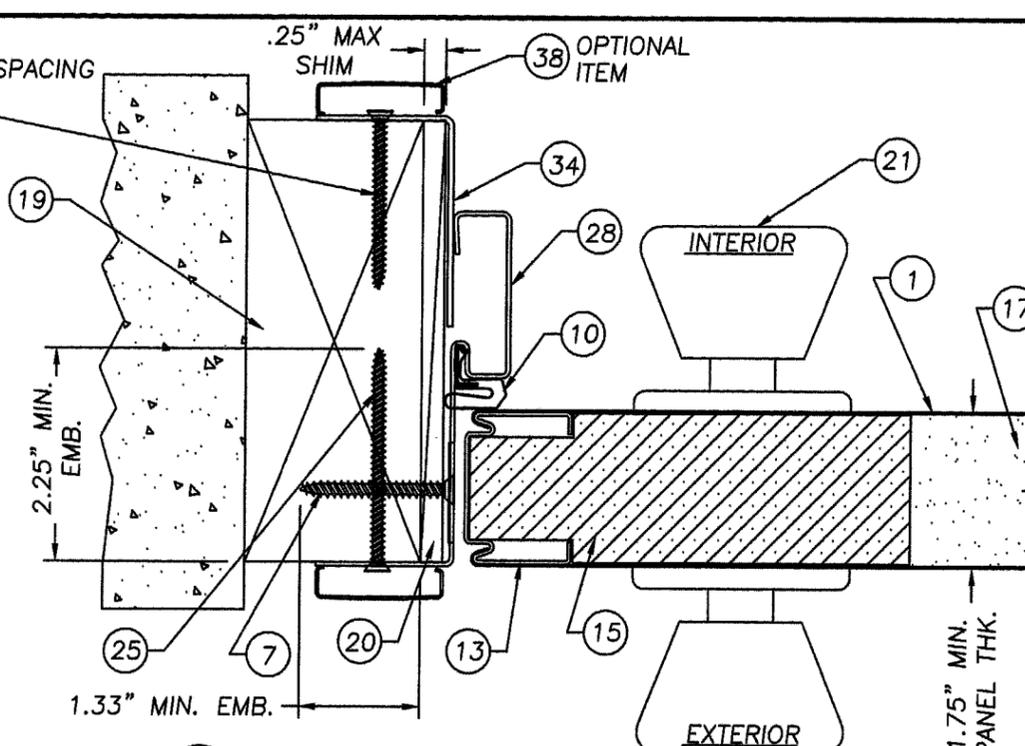

2 HORIZONTAL CROSS SECTION
3 LATCH JAMB TO BUCK

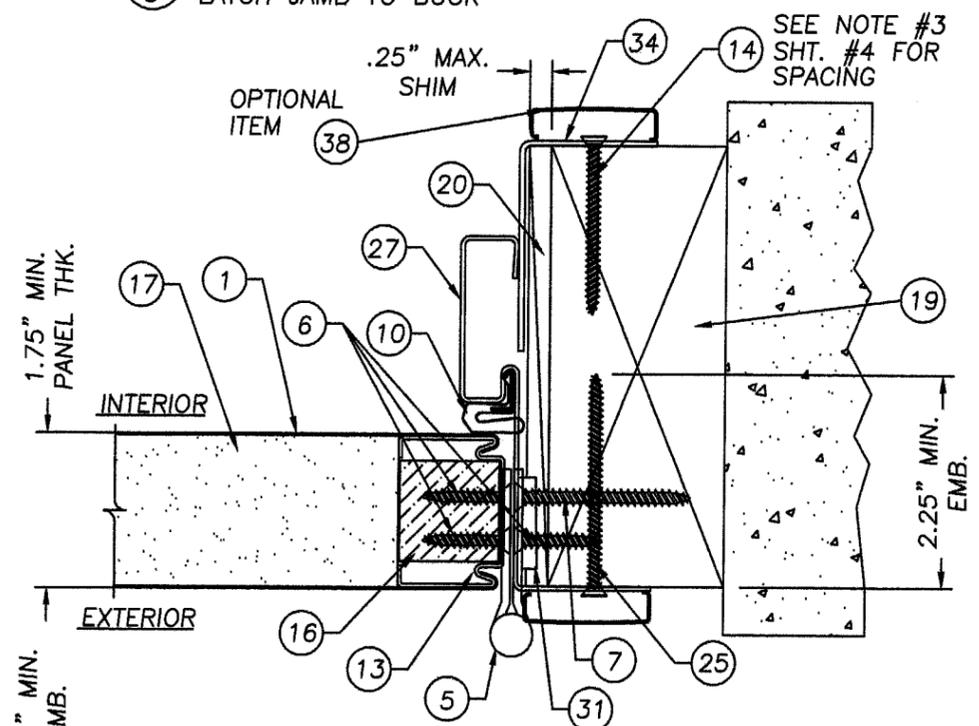

3 HORIZONTAL CROSS SECTION
3 HINGE JAMB TO BUCK

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057






PRODUCT:
3-0 x 7-0 OUTSWING
STEEL EDGE DOOR IN AN
ADJUSTABLE STEEL FRAME
PART OR ASSEMBLY:
CROSS SECTIONS W/THE
DUNBARTON FRAME

NO.	DATE	GENERAL REVISION	BY
1	12/03/01	1	

RW BUILDING
CONSULTANTS, INC.
813.684.3831

Approved as complying with the
Florida Building Code
Date APRIL 25, 2002
NOA# 01-0122-09
Miami Dade Product Control
Division
By Ishaq I. Chanda

DATE: 01/15/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2075
SHEET 3 OF 5

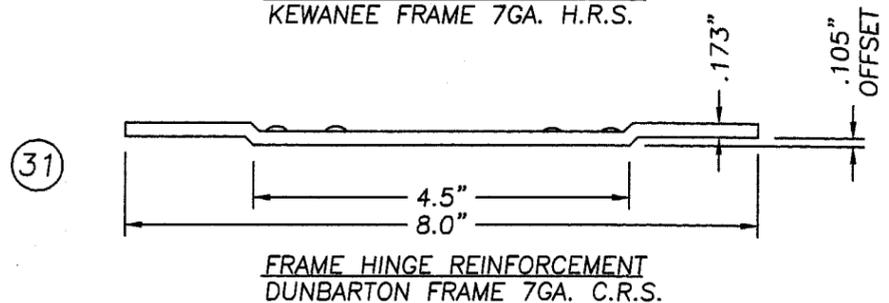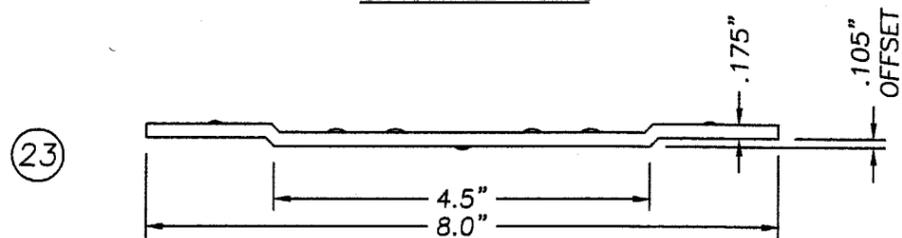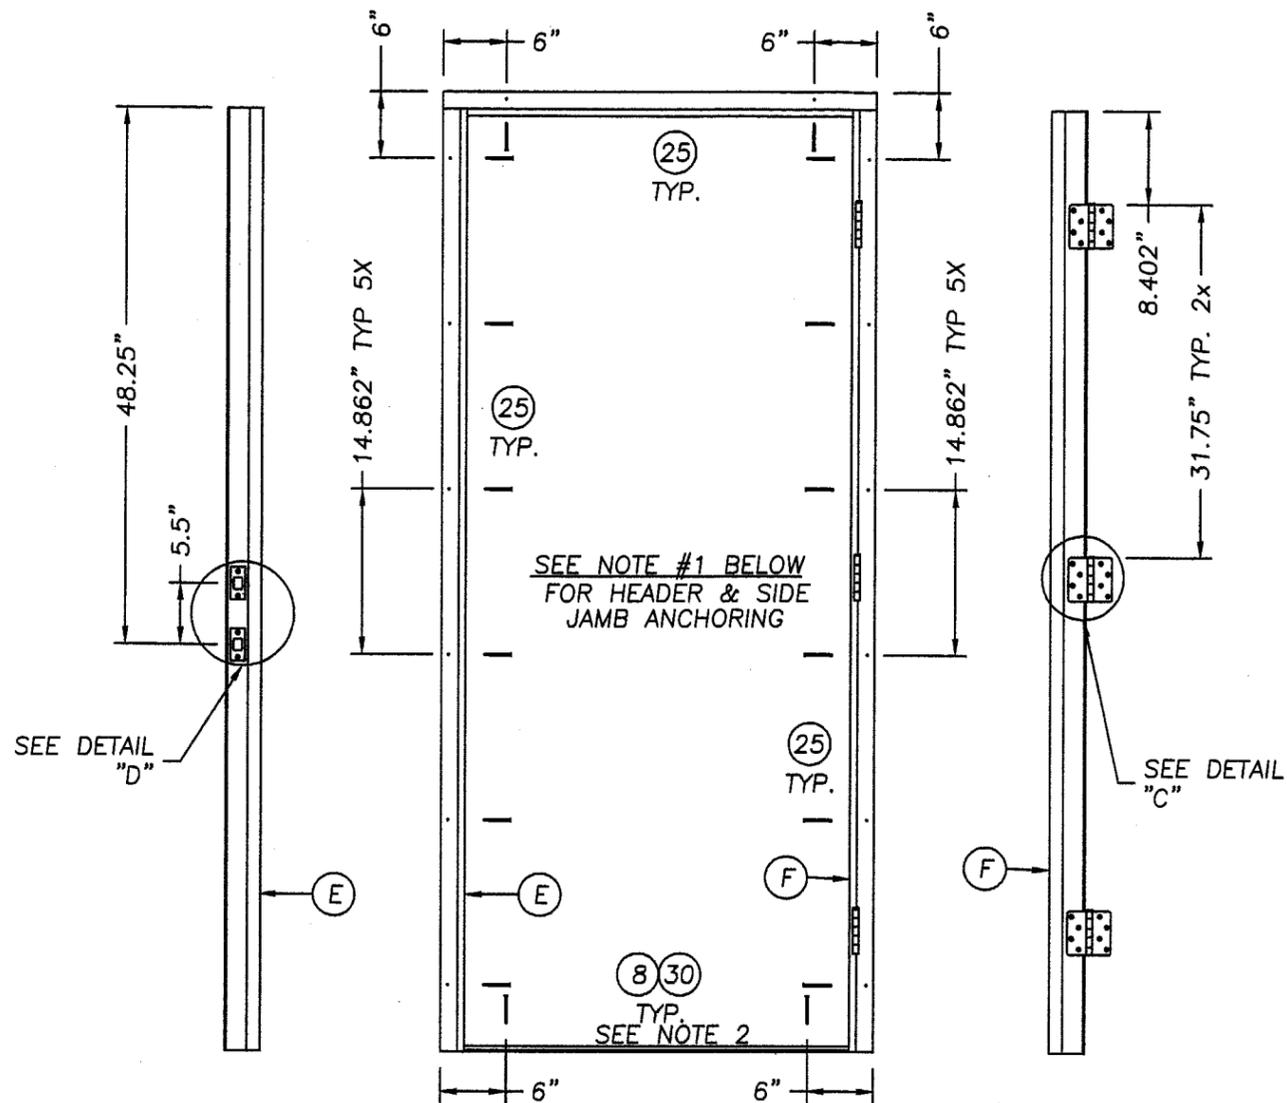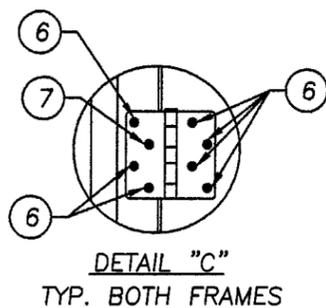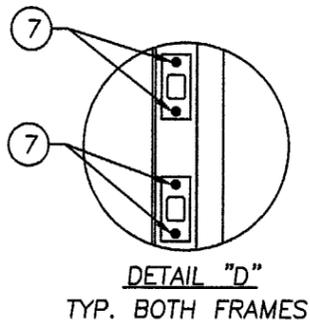

NOTES:

1. ANCHORING SCREWS IN THE HEADER AND SIDE JAMBS ARE IN THE FACE NAILING FLANGE OF THE FRAME. IF THE ANCHORING SPACING DOES NOT FALL ON ONE OF THE PRE-PUNCHED HOLES, DRILL A HOLE IN THE FACE NAILING FLANGE AT THE CORRECT DIMENSION.

2. WHEN USING THRESHOLD ITEM #29 OR #30 USE ITEM #8 TO ANCHOR THEM DOWN. WHEN USING THRESHOLD ITEM #9 USE ITEM #30 TO ANCHOR IT DOWN.

3. THE CLOSURE FRAME FOR BOTH UNITS ARE ANCHORED WITH THE SAME SPACING AS THE BASE HEADER & JAMB FRAME OF THE SAME UNIT. ANCHOR THE CLOSURE FRAMES WITH ITEM #14. SEE SHEETS 2 AND 3.

Approved as complying with the
Florida Building Code
Date APRIL 25, 2002
NOAH 01-0122-09
Miami Dade Product Control
Division
By Isaac J. Chavez















JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
3-0 x 7-0 OUTSWING
STEEL EDGE DOOR IN AN
ADJUSTABLE STEEL FRAME
PART OR ASSEMBLY:
ANCHORING LOCATIONS &
DETAILS (BOTH FRAMES)

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/03/01			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

DATE: 01/15/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2075
SHEET 4 OF 5

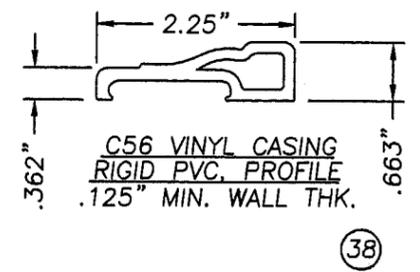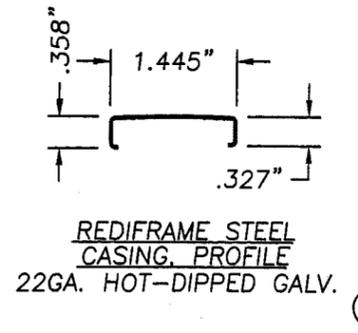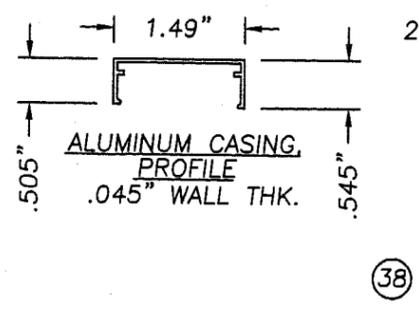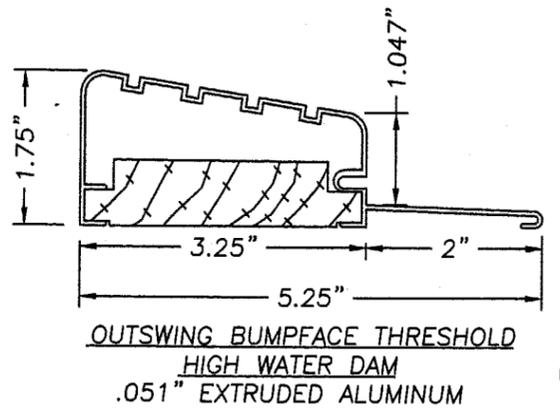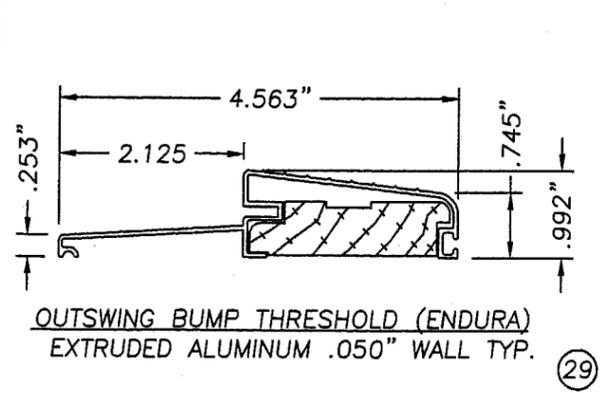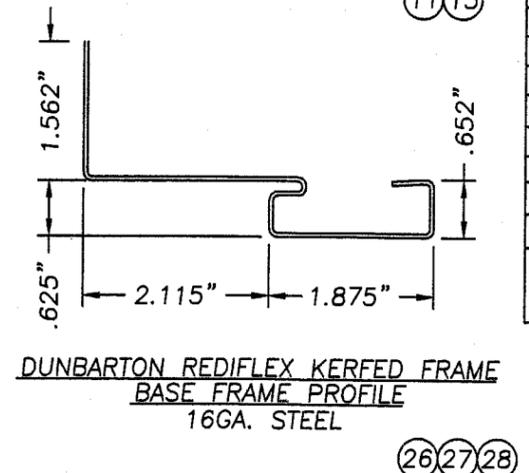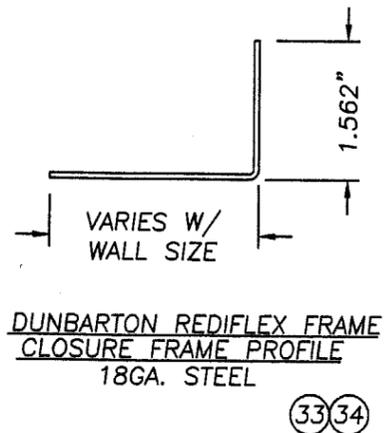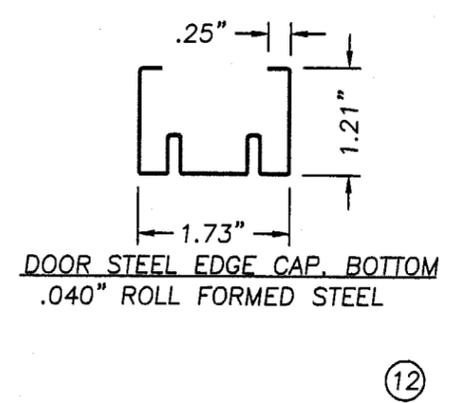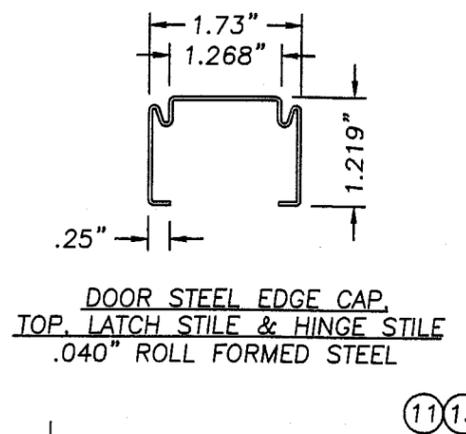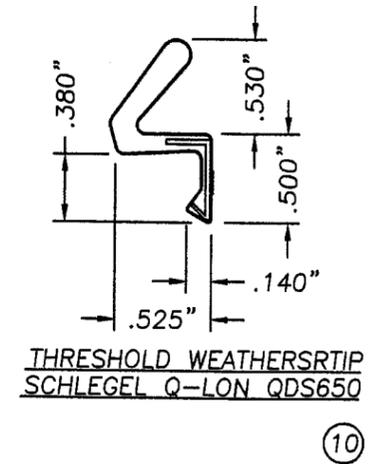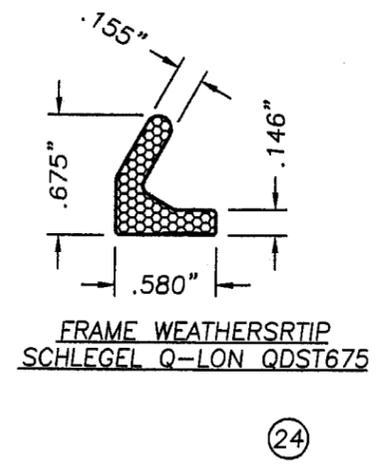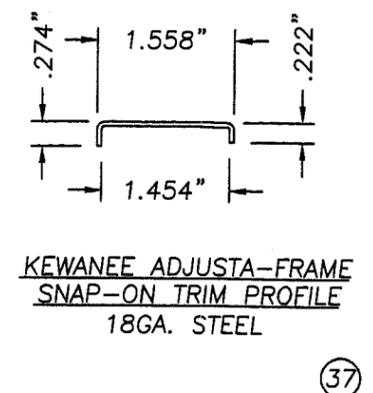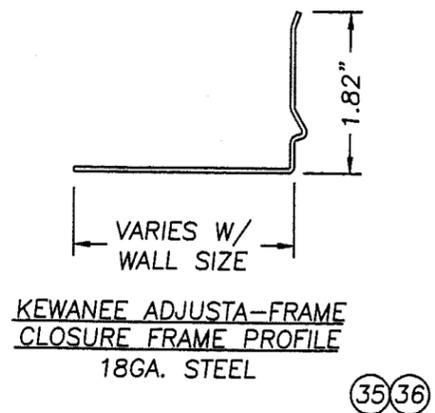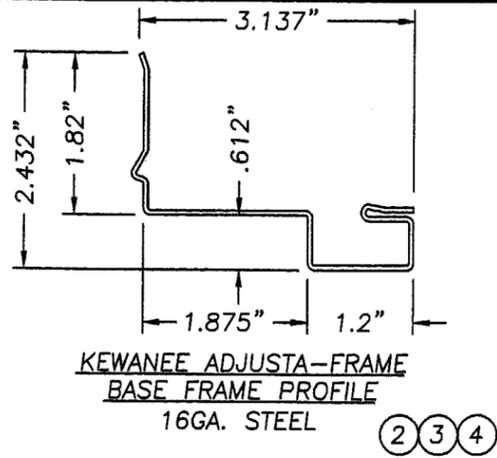

ITEM	DESCRIPTION	MATERIAL
1	DOOR, STEEL FACE SHEET 24GA. (.022"MIN.)	STEEL
2	ADJUSTA-FRAME BASE HEADER 16GA. STEEL (BY KEWANEE)	STEEL
3	ADJUSTA-FRAME HINGE JAMB 16GA. STEEL (BY KEWANEE)	STEEL
4	ADJUSTA-FRAME LATCH JAMB 16GA. STEEL (BY KEWANEE)	STEEL
5	4" x 4" BUTT HINGE 12ga.(.097" HAGER)	STEEL
6	#9 X 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	#10 x 1 3/4" PFH WOOD SCREW	STEEL
8	3/16" TAPCON x 2 1/4" LG.	STEEL
9	BUMPER THRESHOLD (.051" WALL EXTRUDED ALUM. BY IMPERIAL)	ALUM.
10	COMPRESSION WEATHERSTRIP THRESHOLD (SCHLEGEL Q-LON QDS 650)	FOAM
11	TOP RAIL (1.73" x 1.21" x 0.040" THK.)	STEEL
12	BOTTOM RAIL (1.73" x 1.21" x 0.040" THK.)	STEEL
13	SIDE STILE (1.73" x 1.21" x 0.040" THK.)	STEEL
14	# 8 x 2" PFH WOOD SCREW	STEEL
15	WOOD LOCK BLOCK (1.67" x 3.0" x 11.75")	WOOD
16	1.18" x 1.18" x 82" MDF BOARD	-
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb. DENSITY) BY JELD-WEN	FOAM
18	NOT USED	-
19	2x WOOD BUCK	WOOD
20	SHIM MATERIAL (.25" MAX. THK.)	-
21	KWIKSET TITAN 700 SERIES KNOB	-
22	KWIKSET TITAN 700 SERIES DEADBOLT	-
23	FRAME HINGE REIN. PLATE (KEWANEE FRAME)	FOAM
24	COMPRESSION WEATHERSTRIP FRAME (SCHLEGEL Q-LON QDST 675)	FOAM
25	# 8 x 2 1/2" PHILL. FLATHEAD WOOD SCREW	STEEL
26	KERFED REDIFLEX FRAME BASE HEADER 16GA. STEEL (BY DUNBARTON)	STEEL
27	KERFED REDIFLEX FRAME HINGE JAMB 16GA. STEEL (BY DUNBARTON)	STEEL
28	KERFED REDIFLEX FRAME LATCH JAMB 16GA. STEEL (BY DUNBARTON)	STEEL
29	OUTSWING BUMPER THRESHOLD (.050" EXTRUDED ALUM. ENDURA PROD.)	ALUM.
30	3/16" TAPCON x 2 3/4" LG.	STEEL
31	FRAME HINGE REIN. PLATE (DUNBARTON FRAME)	STEEL
32	NOT USED	-
33	REDIFLEX FRAME CLOSURE HEADER 18GA. STEEL (BY DUNBARTON)	STEEL
34	REDIFLEX FRAME CLOSURE JAMB 18GA. STEEL (BY DUNBARTON)	STEEL
35	ADJUSTA-FRAME CLOSURE HEADER 18GA. STEEL (BY KEWANEE)	STEEL
36	ADJUSTA-FRAME CLOSURE JAMB 18GA. STEEL (BY KEWANEE)	STEEL
37	ADJUSTA-FRAME SNAP-ON TRIM 18GA. STEEL (BY KEWANEE SEE NOTE SHT. 2)	STEEL
38	REDIFRAME STEEL CASING, 22GA. HOT-DIPPED GALV. (BY DUNBARTON) ALUMINUM CASING, .045" THK. TYP. (BY DUNBARTON) C56 VINYL CASING, .125" MIN. WALL (BY DUNBARTON)	STEEL ALUM. RIGID PVC

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
3-0 x 7-0 OUTSWING
STEEL EDGE DOOR IN AN
ADJUSTABLE STEEL FRAME

PART OR ASSEMBLY:
UNIT COMPONENTS
& BILL OF MATERIALS

NO.	DATE	GENERAL REVISION	TJH	BY
1	12/03/01			

REVISIONS

RW BUILDING
CONSULTANTS, INC.
813.684.3831

Approved as complying with the
Florida Building Code
Date APRIL 25, 2002
NOA# 01-0122-09
Miami Dade Product Control
Division
By Shay L. Landa

DATE: 01/15/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2075
SHEET 5 OF 5