



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Eagle Window & Door, Inc.**  
**2045 Kerper Boulevard**  
**Dubuque ,IA 52004-1072**

Your application for Notice of Acceptance (NOA) of:

**Aluminum Clad Outswing Wood French Door**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez  
Chief Product Control Division

**ACCEPTANCE NO.: 01-0129.14**  
**EXPIRES: 01/02/2006**

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL**  
**CONDITIONS**  
**BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 03/01/2001**



**Eagle Window & Door, Inc.**

**ACCEPTANCE No.:** 01-0129.14

**APPROVED** : MAR 0 1 2001

**EXPIRES** : January 02, 2006

**NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS**

**1. SCOPE**

- 1.1 This approves a component consisting of a wood French door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

**2. PRODUCT DESCRIPTION**

- 2.1 The **Aluminum Clad Outswing Wood French Door** and its components shall be constructed in strict compliance with the following documents: Drawing No **D025**, titled "Clad Hinged Outswing Double" Sheets 1 through 6 of 6, dated 4/2/97, with revision 1 dated 11/15/00, prepared by R.W. Building Consultants, Inc., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

**3. LIMITATIONS**

- 3.1 This approval applies to single unit applications of pair of doors and single door only, as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.

**4. INSTALLATION**


- 4.1 The wood French door and its components shall be installed in strict compliance with the approved drawings.
- 4.2 Hurricane protection system (shutters): the installation of this unit **will require** a hurricane protection system.

**5. LABELING**

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

**6. BUILDING PERMIT REQUIREMENTS**

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

  
\_\_\_\_\_  
Manuel Perez, P.E, Product Control Examiner  
Product Control Division

**Eagle Window & Door, Inc.**


**ACCEPTANCE No.:** 01-0129.14

**APPROVED** : MAR 0 1 2001

**EXPIRES** : January 02, 2006

**NOTICE OF ACCEPTANCE: STANDARD CONDITIONS**

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process.
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

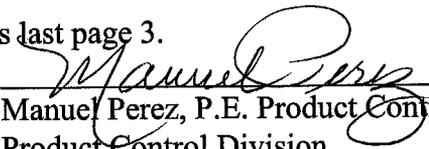  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

**END OF THIS ACCEPTANCE**

Eagle Window & Door, Inc.

ACCEPTANCE No.: 01-0129.14

APPROVED : MAR 0 1 2001

EXPIRES : January 02, 2006

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**  
***(For File ONLY. Not part of NOA.)***

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **D025**, titled "Clad Hinged Outswing Double" Sheets 1 through 6 of 6, dated 4/2/97, with revision 1 dated 11/15/00, prepared by R.W. Building Consultants, Inc.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per PA 202-94  
2) Uniform Static Air Pressure Test, Loading per PA 202-94  
3) Water Resistance Test, per PA 202-94  
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94  
along with marked-up drawings and installation diagram of outswinging wood french doors with fixed light, prepared by Architectural Testing, Inc., Test Report No. **ATI-18351-N**, dated 10/22/96, and revised on 10/31/96 signed and sealed by Allen N. Reeves, P.E.

**C. CALCULATIONS**

1. Anchor calculations for Eagle Double Active Clad Outswing Wood French Door, prepared by Richard Boyette, P.E., dated 12/02/96, signed and sealed by Richard Boyette, P.E.

**D. MATERIAL CERTIFICATIONS**


1. None.

**E. STATEMENTS**

1. Statement letter of conformance, dated September 11, 1997, signed by John M. Carroll, P.E.
2. Statement letter of no financial interest, dated June 19, 1996, signed by Todd Bergstrom

**F. OTHER**

1. Notice of Acceptance No. 97-0107.04, issued to Eagle Window & Door, Inc. for their Aluminum Clad Outswing Wood French Doors, approved on 01/02/98 and expiring on 01/02/01.

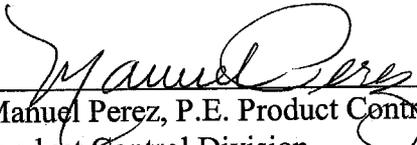  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

**Eagle Window & Door, Inc.**

**ACCEPTANCE No.:** 01-0129.14

**APPROVED** : MAR 0 1 2006

**EXPIRES** : January 02, 2006


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**  
*(For File ONLY. Not part of NOA.)*

**TESTS PERFORMED:**

**TESTS:**

**RESULTS:**

TEST	TEST LOADS	DESIGN LOADS
AIR INFILTRATION @ 1.57 PSF SFBC PA 202-94 (0.50CFM/FT <sup>2</sup> )	0.01 CFM/FT <sup>2</sup> ATI-18351-N	-----
AIR INFILTRATION @ 6.24 PSF SFBC PA 202-94	0.01 CFM/FT <sup>2</sup> ATI-18351-N	-----
UNIFORM STATIC PRESSURE DESIGN LOADS SFBC PA 202-94 POSITIVE	+40.0 PSF ATI-18351-N	+40.0 PSF ATI-18351-N
UNIFORM STATIC PRESSURE DESIGN LOADS SFBC PA 202-94 NEGATIVE	-40.0 PSF ATI-18351-N	-40.0 PSF ATI-18351-N
WATER RESISTANCE (PSF) SFBC PA 202-94	+6.00 PSF ATI-18351-N	+40.0 PSF ATI-18351-N
UNIFORM STATIC PRESSURE FULL TEST LOAD ASTM E330 PA 202-94 POSITIVE 30 Seconds	+60.0PSF ATI-18351-N	+40.0 PSF ATI-18351-N
UNIFORM STATIC PRESSURE FULL TEST LOAD SFBC PA 202-94 NEGATIVE 30 Seconds	-60.0 PSF ATI-18351-N	-40.0PSF ATI-18351-N
FORCED-ENTRY RESISTANCE (FER) ASTM F 588	SATISFACTORY ATI-18351-N	-----
<b>Design Pressure Rating (Positive)</b>		<b>+40.0PSF</b>
<b>Design Pressure Rating (Negative)</b>		<b>-40.0PSF</b>

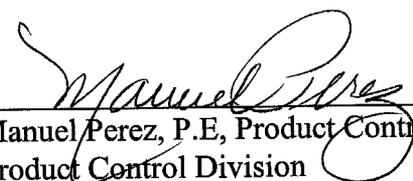  
Manuel Perez, P.E, Product Control Examiner  
Product Control Division

# EAGLE WINDOW & DOOR, INC.

OUTSWING DOUBLE DOOR  
ALUMINUM CLAD GLAZED DOORS & FRAMES

## GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AS SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
4. IMPACT RESISTANT SHUTTERS ARE REQUIRED.
5. DESIGN PRESSURE RATING SHALL BE AS FOLLOW: SEE TABLE 1.
6. ALL DIMENSIONS ARE GIVEN IN INCHES UNLESS OTHERWISE SHOWN.


## RESIDENTIAL ALUMINUM CLAD WOOD FRENCH DOOR (COMMON TO ALL FRAME CONDITIONS)

### FRAME CONSTRUCTION:


1. THE FRAME IS FINGER JOINTED PONDEROSA PINE. THE CORNERS ARE COPE, BUTTED AND SEALED WITH ACRYLIC SEALANT AND SECURED WITH (4) #7 x 2 1/8" SCREWS PER CORNER. THE ALUMINUM CLADDING IS SLIP-FIT OVER THE EXTERIOR WITH THE CORNERS SECURED WITH A CORNER KEY AND (2) #8 x 7/16" SCREWS PER CORNER. A MULTI-PIECE OAK AND ALUMINUM BUMPFACE THRESHOLD IS USED.

### GLAZED PANEL CONSTRUCTION:

1. THE PANEL IS SELECT SOFT WOOD, FINGER JOINTED WITH CLEAR PINE VENEER. THE CORNERS ARE SQUARE CUT AND SECURED WITH GLUE AND (2) #10 x 2 1/2" WOOD SCREWS PER CORNER. THE ALUMINUM CLADDING SLIP-FIT OVER THE EXTERIOR SIDE. THE GLASS IS CAPTURED BETWEEN THE ALUM. CLADDING GLASS STOP ON THE EXTERIOR & THE WOOD GLASS STOP ON THE INTERIOR. THE WOOD GLASS STOP IS SECURED USING 1 1/2" L. BRAD TRIM NAILS.

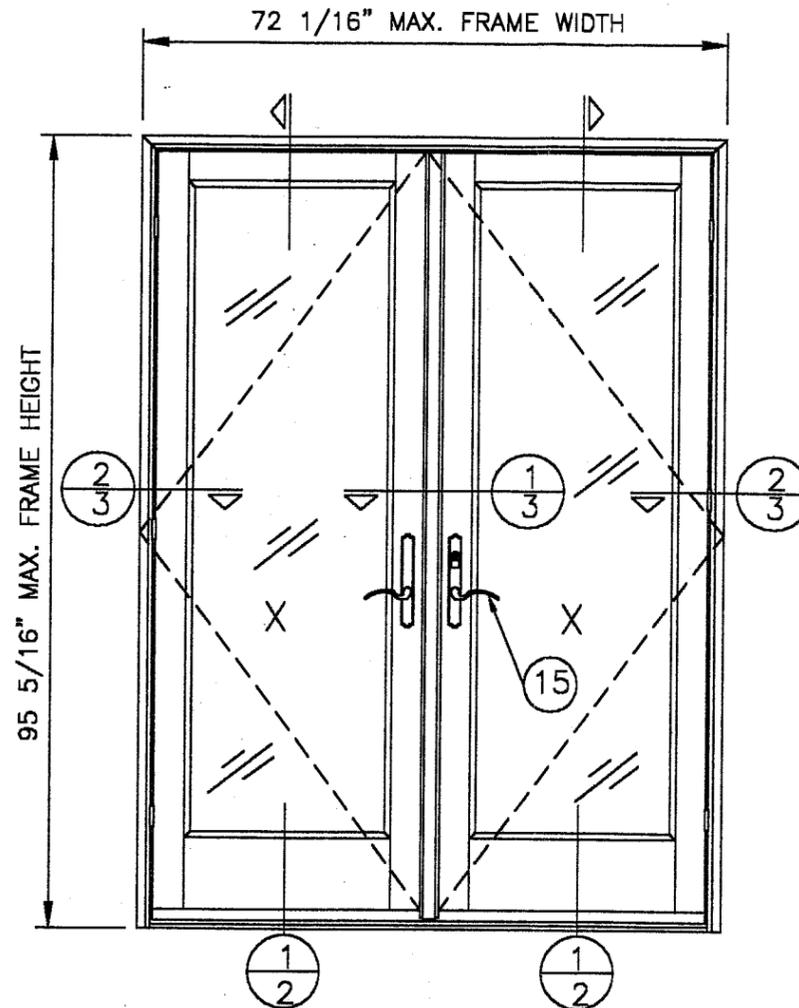

DOUBLE DOOR W/OUT  
DECORATIVE GRILLS

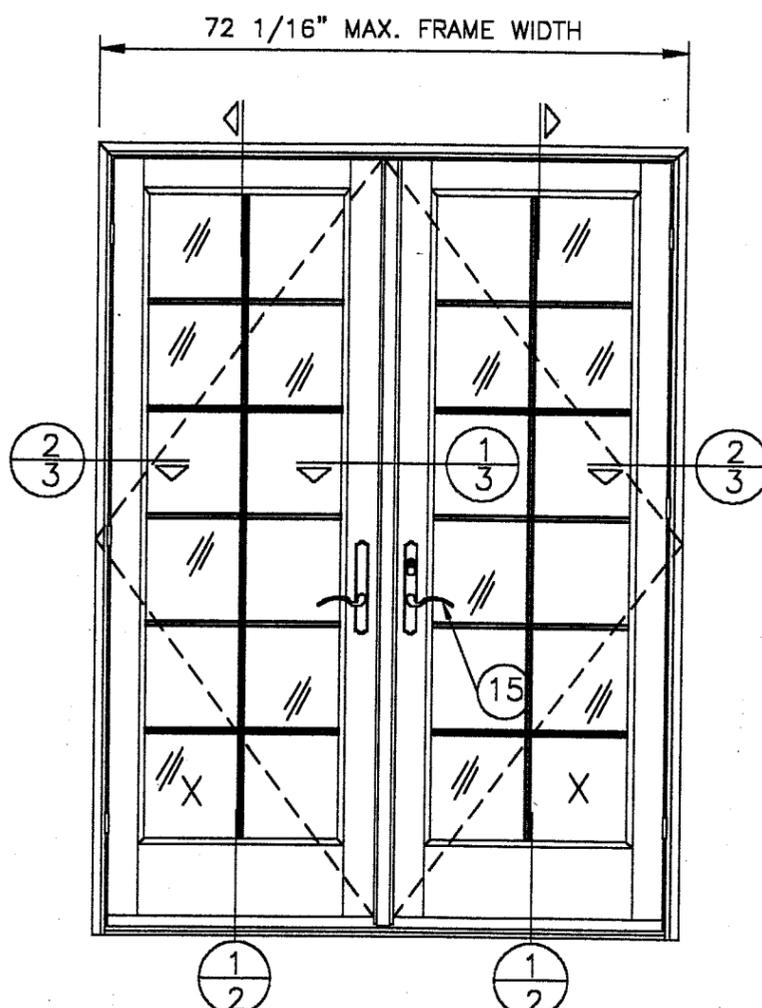

DOUBLE DOOR W/  
DECORATIVE GRILLS

ALL ELEVATIONS ARE VIEWED FROM EXTERIOR

EAGLE WINDOW & DOOR, INC.  
375 EAST 9th St.  
DUBUQUE, IA 52004-1072  
PH. 319.556.4408

PRODUCT: CLAD HINGED OUTSWING DOUBLE		PART OR ASSEMBLY:	
GENERAL NOTES AND ELEVATIONS		REVISIONS	
NO.	DATE	GENERAL REVISION	TJH BY
1	11/15/00		

RW BUILDING CONSULTANTS, INC.  
813.684.3831


## TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES & ELEVATIONS
2	VERTICAL CROSS SECTION & B.O.M.
3	HORIZONTAL CROSS SECTIONS
4	ANCHORING LOCATIONS & DETAILS
5	UNIT COMPONENTS
6	GLAZING DETAILS & UNIT COMPONENTS

DESIGN PRESSURE RATING WHERE WATER INFILTRATION REQUIREMENT IS NEEDED			
PRODUCT	DAYLIGHT OPENING	DESIGN PRESSURE RATING (PSF)	GLASS TYPE AND THICKNESS
OUTSWING	UP TO 13.49 SQ.FT. (PER PANEL)	+40 -40	3/4" INSULATED GLASS
OUTSWING	UP TO 13.49 SQ.FT. (PER PANEL)	+40 -40	1/4" TEMPERED GLASS

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE MAR 01 2001  
BY Manuel  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0129.14

DATE: 4/2/97  
SCALE: N.T.S.  
DWG. BY: TSB  
CHK. BY: -  
DRAWING NO.: D025  
SHEET 1 OF 6

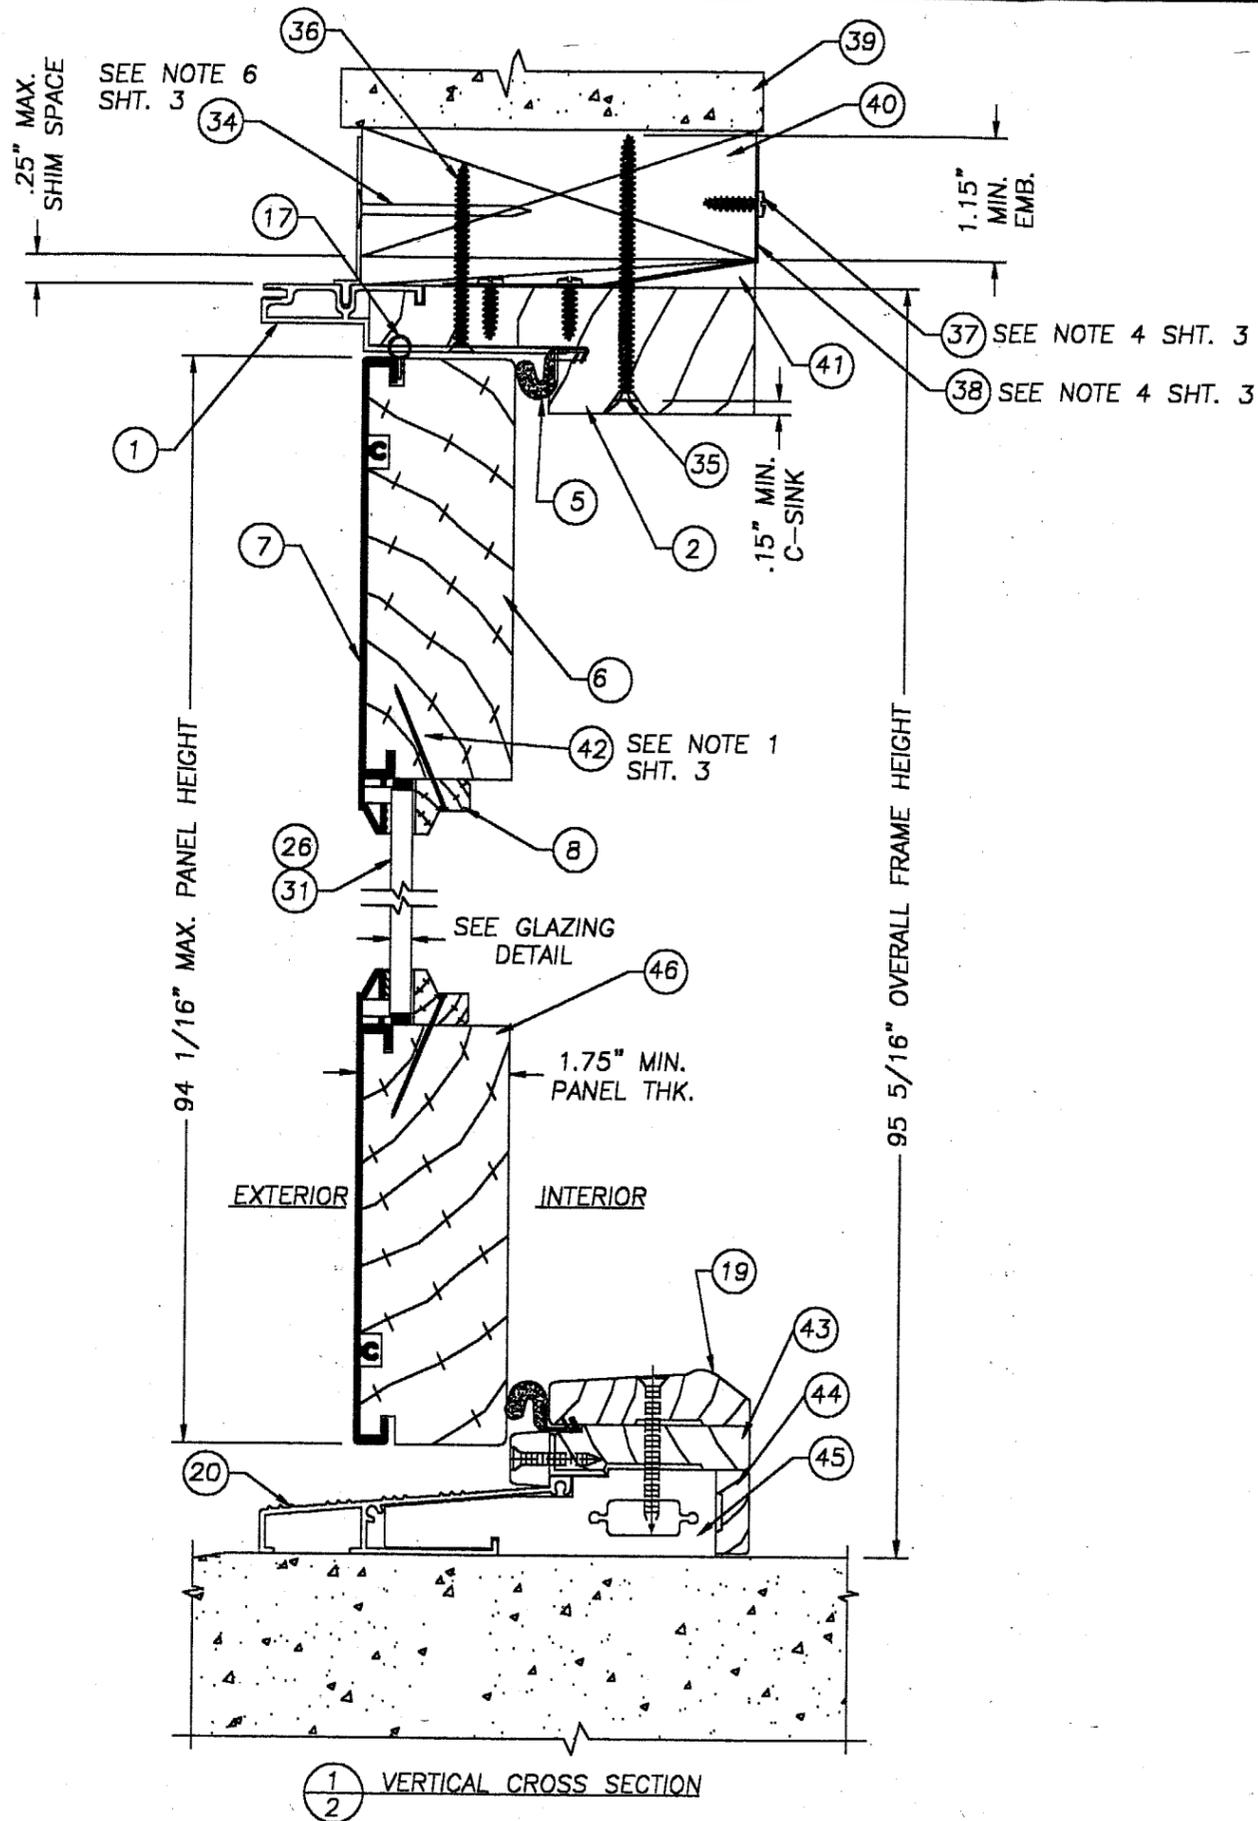

ITEM #	DESCRIPTION	MATERIAL
1	FRAME EXTRUSION 3.499" x .75"	ALUM.
2	SIDE AND HEAD JAMBS 1.250" x 4.438"	WOOD
3	HINGE 4" x 4"	STEEL
4	DADE CO. PROD. CONTROL LABEL .625" x 3.5"	METALLIC
5	FRAME WEATHERSTRIP .650" x .563"	VINYL
6	TOP RAIL & SIDE STILE MEMBER 4.750" x 1.686"	WOOD
7	PANEL CLADDING 5.375" x .400"	ALUM.
8	GLAZING STOP .453" x .625"	WOOD
9	INACTIVE PANEL SHOOT BOLT .394" DIA.	STEEL
10	ASTRAGAL 1.875" x 2.625"	WOOD
11	ASTRAGAL COVER .750" x 2.144"	ALUM.
12	ROLLER STRIKE 2.368" x 1.299" x .331"	STEEL
13	RELEASE STRIKE 1.620" x 1.303" x .331"	BRASS
14	LATCH STRIKE 8.819" x 1.299" x .102"	BRASS
15	MULTI-POINT HARDWARE ASSY .625" x .100"	STEEL
16	ASTRAGAL & SILL WEATHERSTRIP .750" .750"	VINYL
17	PANEL WEATHERSTRIP .250" DIA.	VINYL
18	SHIPPING BLOCK .375" x .320"	WOOD
19	OUTSWING THRESHOLD BUMPER CAP	OAK
20	SILL EXTRUSION 6063-T6	ALUM.
21	EXTERIOR MDL BAR EXTRUSION .875" x .312"	ALUM.
22	INTERIOR MDL BAR .875" x .406"	WOOD
23	MUNTIN BAR .750" x .312"	ALUM.
24	EXTERIOR MDL BAR EXTRUSION 1.500" x .312"	ALUM.
25	INTERIOR MDL BAR 1.500" x .406"	WOOD
26	3/4" TEMPERED GLASS SEE GLAZING DETAIL	-
27	POLYETHYLENE FOAM TAPE .031" x .625"	POLYETH.
28	BUTYL RUBBER GLAZING MASTIC .250" x .125"	BUTYL
29	SETTING BLOCK .125" x .594" x 2"	NEOPRENE
30	GLAZING SHIM .188" x .320" x 4"	NEOPRENE
31	1/4" TEMPERED GLASS SEE GLAZING DETAIL	-
32	SETTING BLOCK .125" x .219" x 2"	NEOPRENE
33	NAILING FLANGE 1.665" x .309" x .045"	VINYL
34	ROOFING NAIL 2" LONG	STEEL
35	#10 x 2 1/2" L. PHILL. FLATHEAD SCREW	STEEL
36	#8 x 2 1/8" L. PHILL. FLATHEAD SCREW	STEEL
37	#8 x 3/4" L. PANHEAD SCREW	STEEL
38	INSTALLATION CLIP 7" x 2" x .025"	STEEL
39	MASONRY	CONCRETE
40	2X WOOD BUCK	WOOD
41	1/4" SHIM MATERIAL	-
42	1 1/2" L BRAD TRIM NAIL 16GA.	STEEL
43	SILL CAP	OAK
44	SILL TRIM	OAK
45	INNER SILL	WOOD
46	BOTTOM RAIL 9.875" W x 1.686" THK.	WOOD
47	#7 x 1 1/4" L. PHILL. FLATHEAD SCREW	STEEL
48	#7 x 2 1/8" L. PHILL. FLATHEAD SCREW	STEEL
49	#10 x 2 1/2" L. FLATHEAD SM SCREW	STEEL

**EAGLE WINDOW & DOOR, INC.**  
 375 EAST 9th St.  
 DUBUQUE, IA 52004-1072  
 PH. 319.556.4408

PRODUCT: CLAD HINGED  
 OUTSWING DOUBLE  
 PART OR ASSEMBLY:  
 VERTICAL CROSS SECTION  
 & BILL OF MATERIALS

NO.	DATE	GENERAL REVISION	TJH	BY
1	11/15/00			


**RW** BUILDING CONSULTANTS, INC.  
 813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE MAR 01 2001  
 BY Manuel Perez  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-0129.14


DATE: 4/2/97  
 SCALE: N.T.S.  
 DWG. BY: TSB  
 CHK. BY: -  
 DRAWING NO.: D025  
 SHEET 2 OF 6

**NOTES:**

1. SPACING FOR THE BRAD TRIM NAIL IS 2" IN FROM CORNERS AND A MAX. OF 12" O.C.
2. THE ASTRAGAL IS SECURED TO THE DOOR PANEL W/SIX #7 1 1/4" SCREWS ALL EVENLY SPACED.
3. THE ASTRAGAL COVER IS SECURED TO THE DOOR PANEL W/SIX #7 2 1/8" SCREWS ALL EVENLY SPACED. THESE SCREWS MUST BE STAGGERED APART FROM THE #7 x 1 1/4" SCREWS.
4. THE INSTALLATION CLIP AT THE HEADER IS LOCATED 6" FROM BOTH CORNERS AND 20" O.C. MAX. EACH CLIP IS SECURED TO THE HEADER WITH (4) #8 x 3/4" SCREWS AND TO THE BUCK WITH (2) #8 x 3/4" SCREWS.
5. THE INSTALLATION CLIP AT THE SIDE JAMBS IS LOCATED 6" FROM THE CORNERS AND 18" O.C. MAX. EACH CLIP IS SECURED TO THE JAMB WITH (4) #8 x 3/4" SCREWS AND TO THE BUCK WITH (2) #8 x 3/4" SCREWS.
6. THE ITHE SPACING FOR THE 2" ROOFING NAIL IS AS FOLLOWS: 3.5" FROM ALL CORNERS AND A MAX. OF 3.5" O.C. USING THE HOLES IN THE NAILING FLANGE.

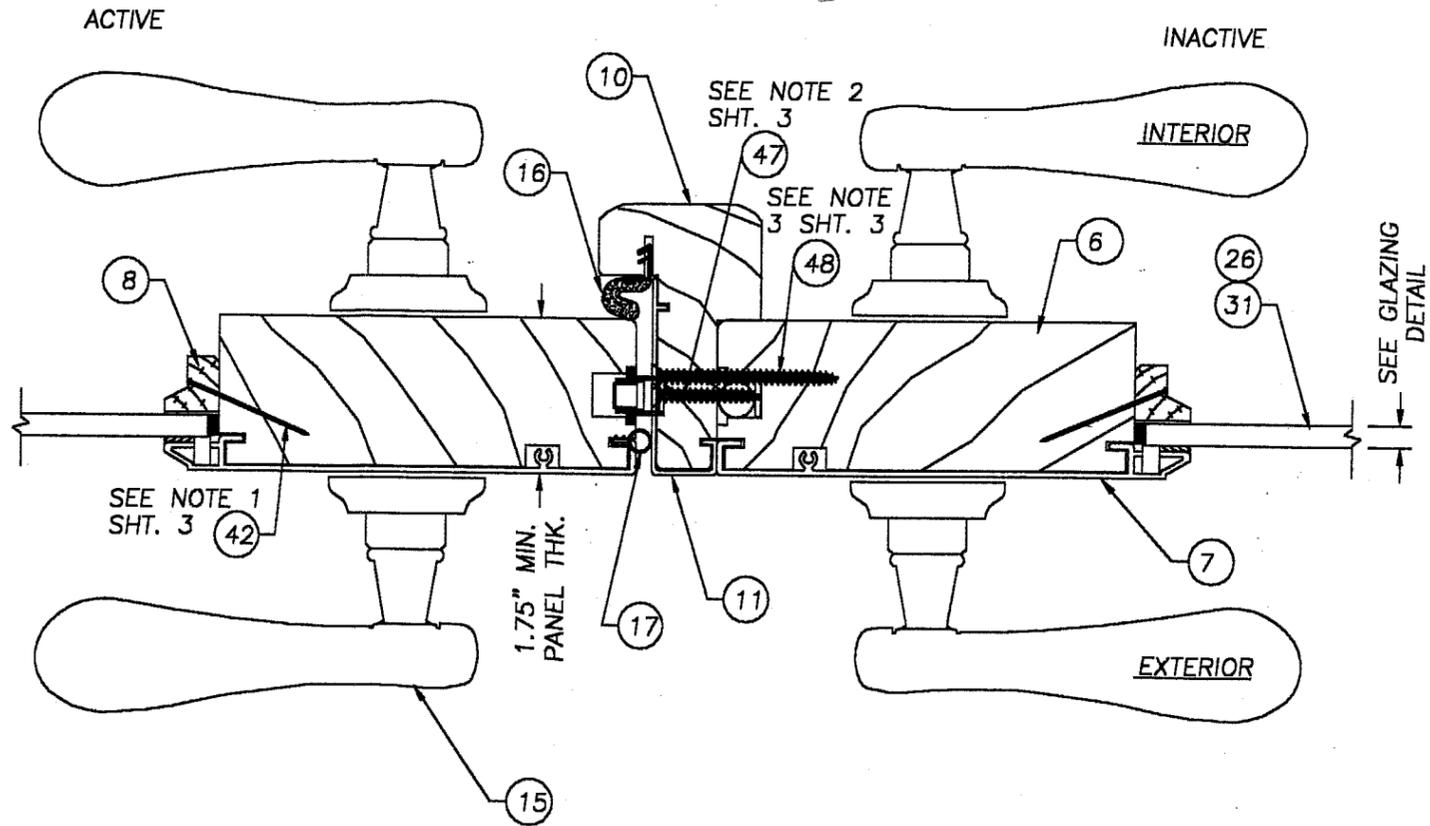

1  
3 HORIZONTAL CROSS SECTION @ ASTRAGAL

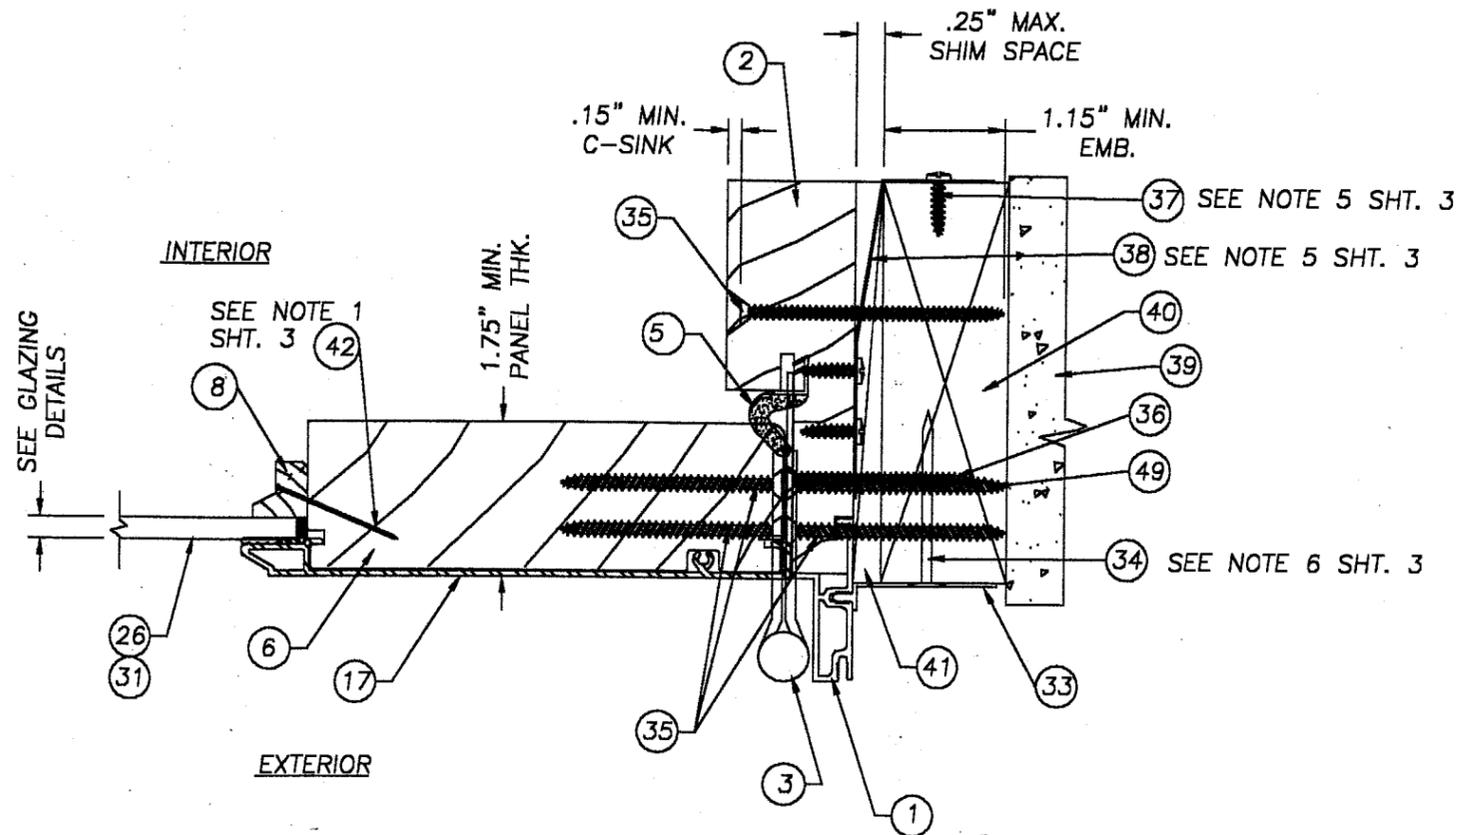

2  
3 HORIZONTAL CROSS SECTION HINGE JAMB TO BUCK, TYP.

**EAGLE WINDOW & DOOR, INC.**  
 375 EAST 9th St.  
 DUBUQUE, IA 52004-1072  
 PH. 319.556.4408


PRODUCT: CLAD HINGED OUTSWING DOUBLE  
 PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS 1/3 & 2/3

NO.	DATE	GENERAL REVISION	TJH	BY
1	11/15/00			

**RW** BUILDING CONSULTANTS, INC.  
 813.684.3831


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE MAR 01 2001  
 BY Manuel  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-0129.14

DATE: 4/2/97  
 SCALE: N.T.S.  
 DWG. BY: TSB  
 CHK. BY: -  
 DRAWING NO.: D025  
 SHEET 3 OF 6

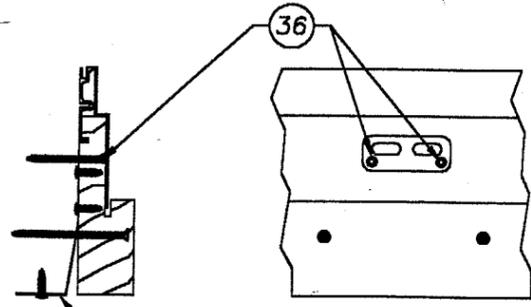


SEE SHT. 3 NOTE 4 AND SECTION 1/2 SHT. 2 FOR HEADER INSTALLATION CLIP ATTACHMENT



DETAIL "A"  
HEADER STRIKE PLATE ATTACHMENT

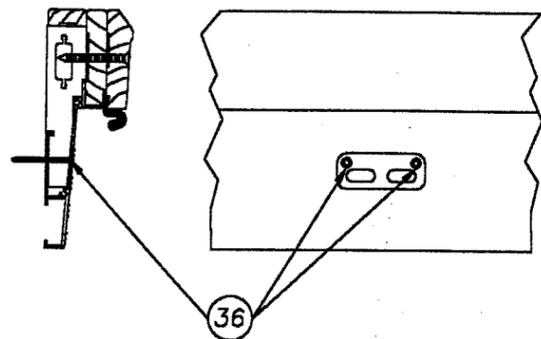


DETAIL "B"  
THRESHOLD STRIKE PLATE ATTACHMENT

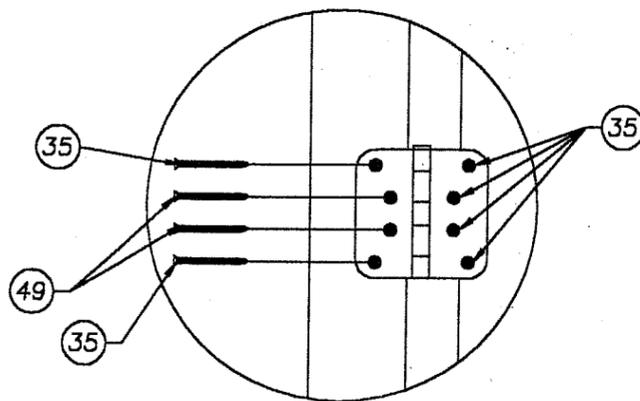

DETAIL "C"  
TYPICAL AT ALL HINGES

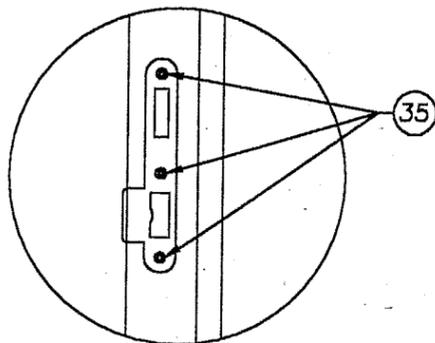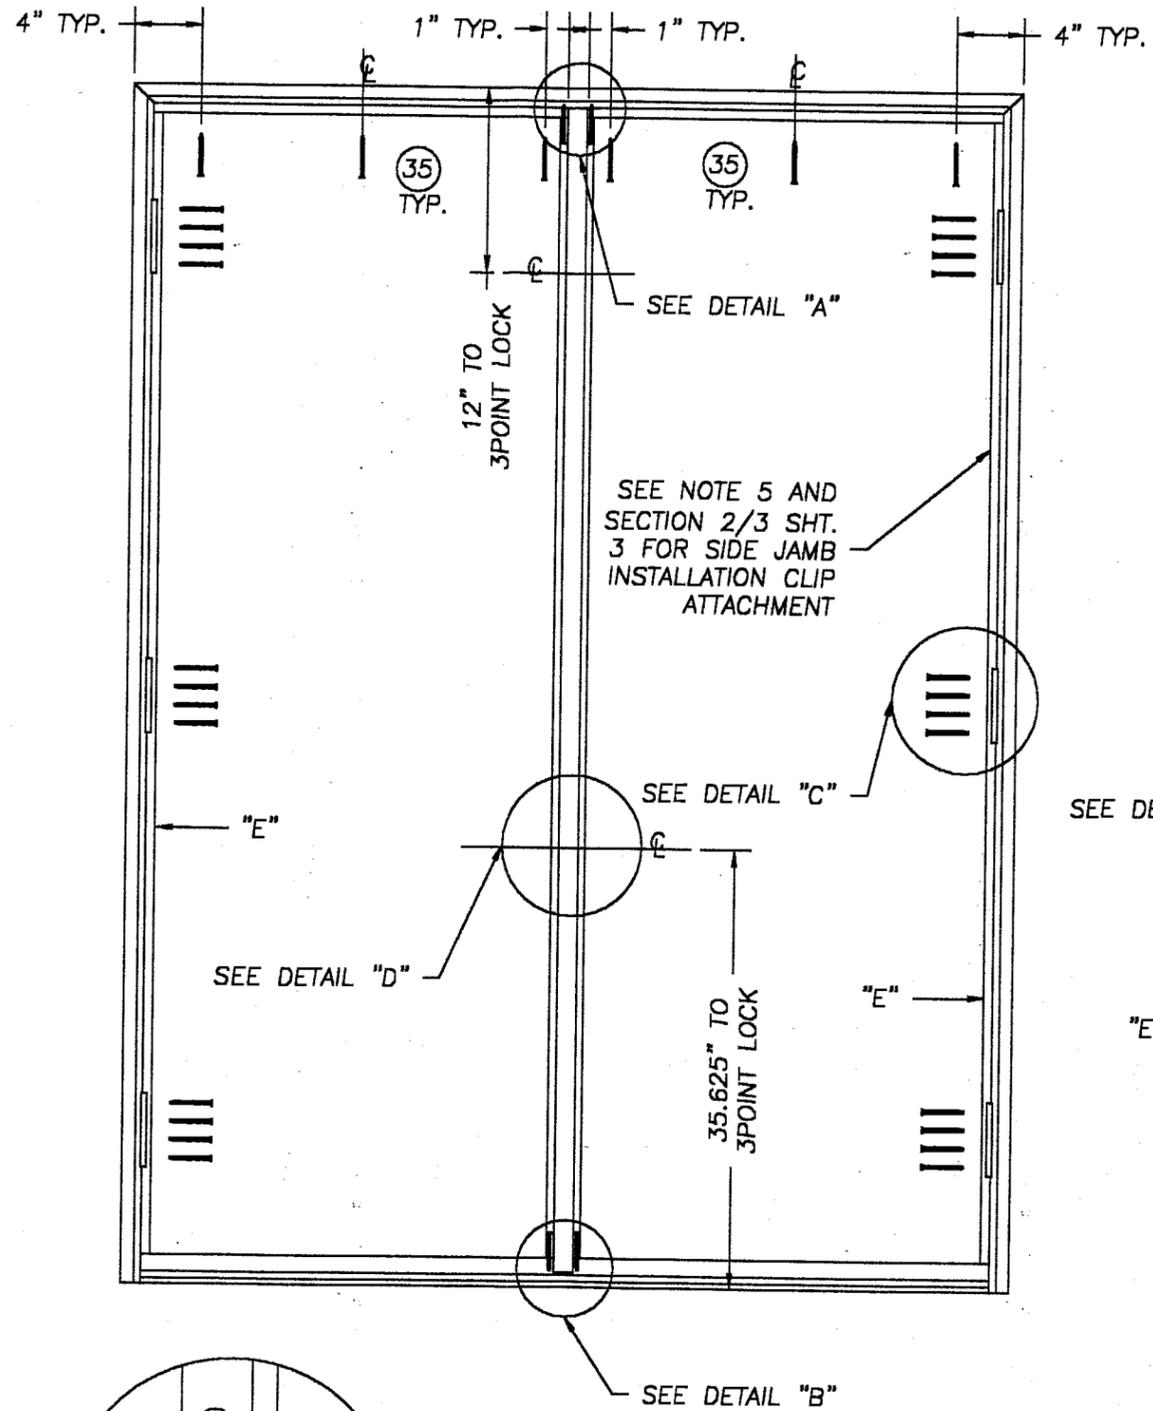

DETAIL "D"

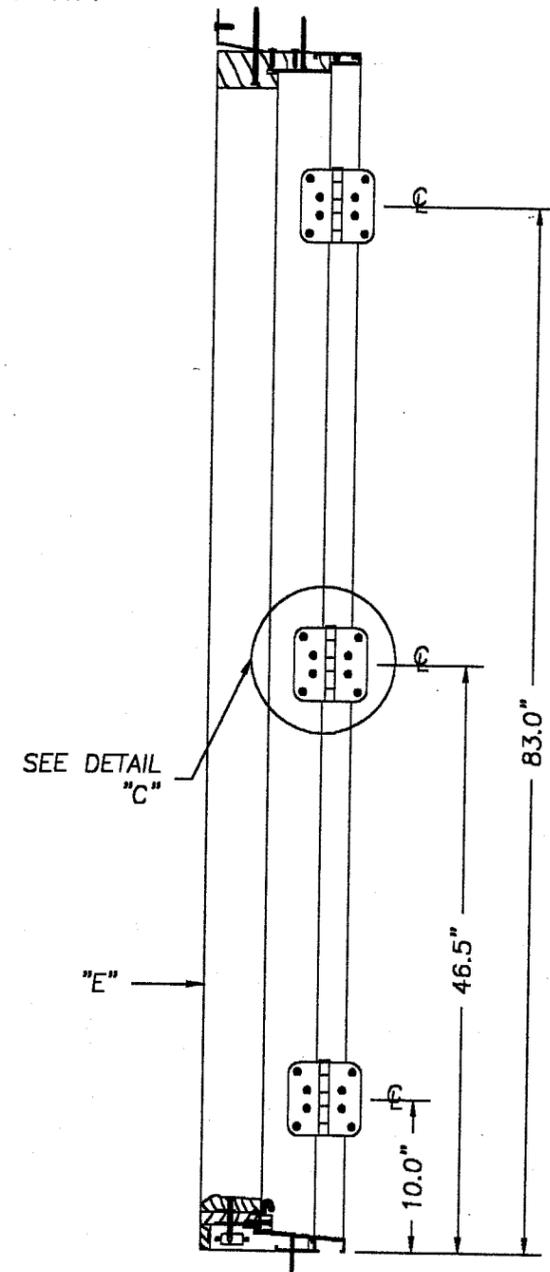


**EAGLE WINDOW & DOOR, INC.**  
375 EAST 9th St.  
DUBUQUE, IA 52004-1072  
PH. 319.556.4408

PRODUCT: CLAD HINGED OUTSWING DOUBLE	
PART OR ASSEMBLY: ANCHORING LOCATION & DETAILS	
NO.	REVISIONS
1	11/15/00
	DATE
	GENERAL REVISION
	TJH
	BY


**RW** BUILDING CONSULTANTS, INC.  
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE **MAR 01 2001**  
BY *Mammel*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. *01-0129.14*


DATE: 4/2/97  
SCALE: N.T.S.  
DWG. BY: TSB  
CHK. BY: -  
DRAWING NO.: D025  
SHEET 4 OF 6

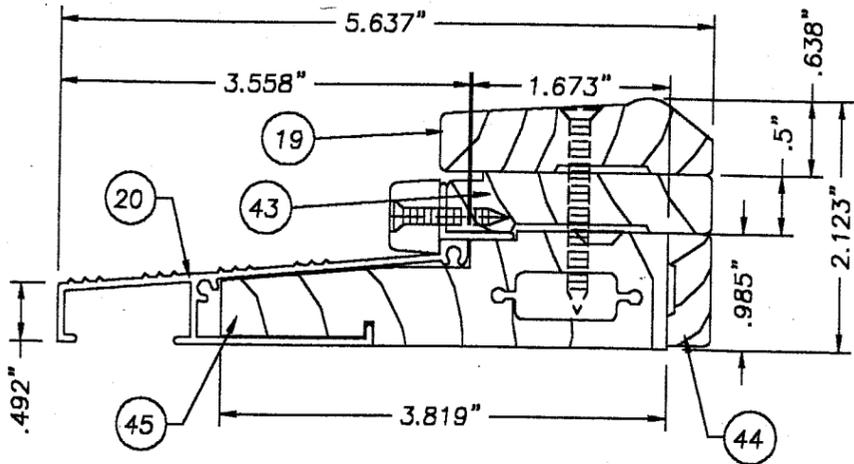


**ASSEMBLED THRESHOLD**  
ALUMINUM & WOOD

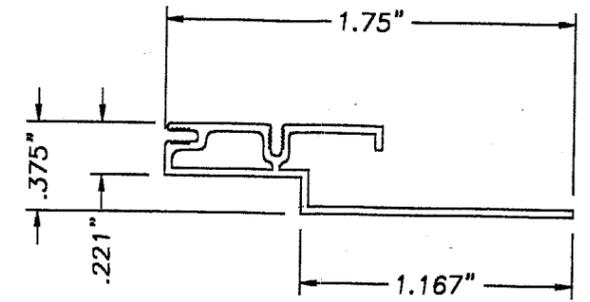


**FRAME COVER**  
ALUMINUM, .063" WALL TYP.

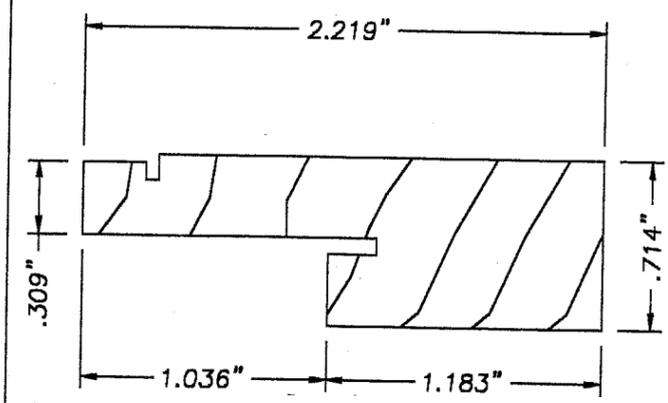


**FRAME MEMBER**  
WOOD

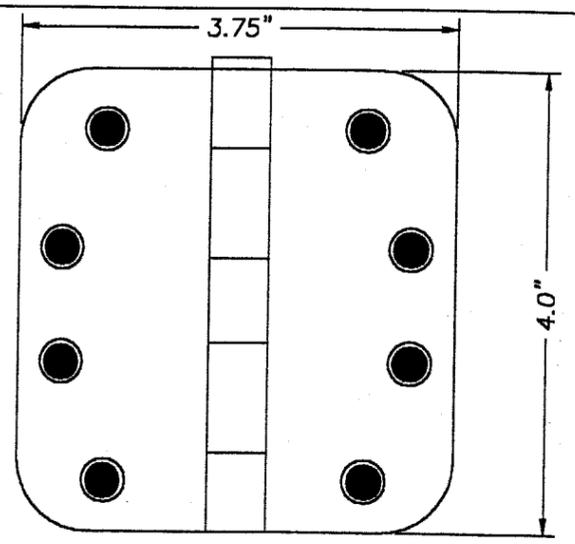


**4" x 3 3/4" HINGE**  
.130" STEEL

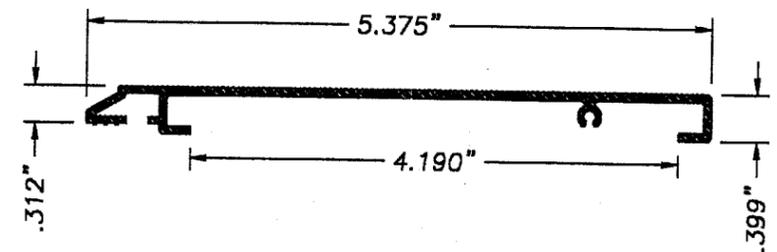


**PANEL CLADDING**  
ALUMINUM, .067" WALL TYP.

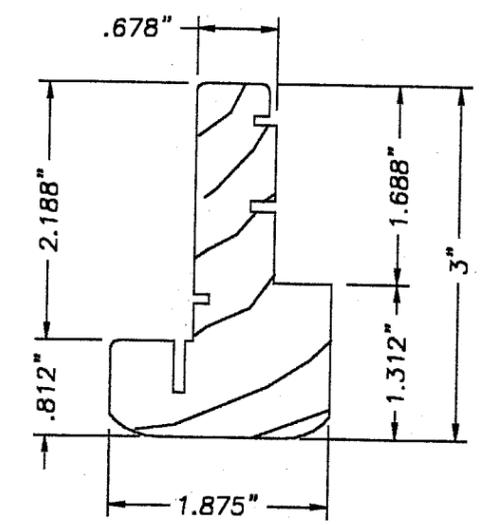


**OUTSWING WOOD ASTRAGAL**

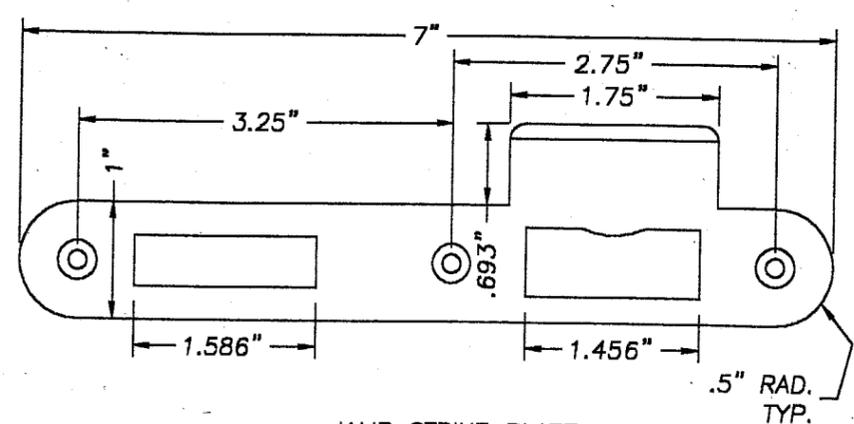


**JAMB STRIKE PLATE**  
.105" THK. STEEL

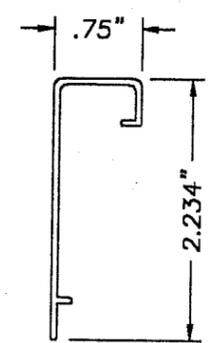

**ASTRAGAL COVER**  
ALUMINUM, .050" WALL TYP.

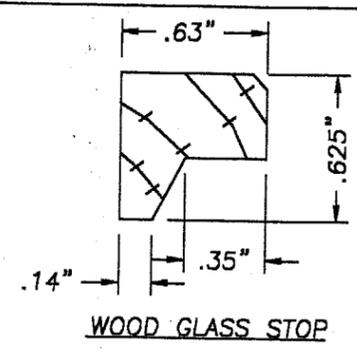

**WOOD GLASS STOP**

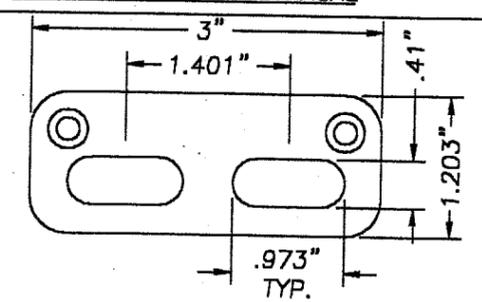

**SILL STRIKE PLATE = .375" THK. STEEL**  
**HEAD STRIKE PLATE = .105" THK. STEEL**

**EAGLE WINDOW & DOOR, INC.**  
375 EAST 9th St.  
DUBUQUE, IA 52004-1072  
PH. 319.556.4408


PRODUCT: CLAD HINGED  
OUTSWING DOUBLE  
PART OR ASSEMBLY:  
UNIT COMPONENTS

NO.	DATE	GENERAL REVISION	TJH	BY
1	11/15/00		TJH	


**RW** BUILDING CONSULTANTS, INC.  
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE **MAR 01 2001**  
BY *Manuel*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0129.14


DATE: 4/2/97  
SCALE: N.T.S.  
DWG. BY: TSB  
CHK. BY: -  
DRAWING NO.: D025  
SHEET 5 OF 6

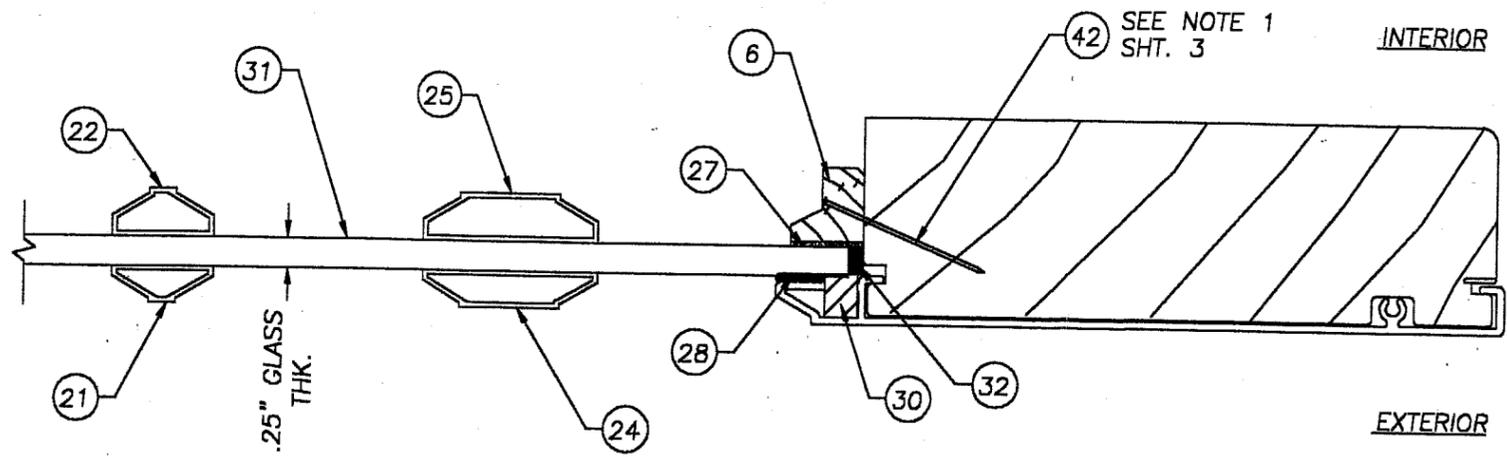


1/4" TEMPERED GLASS GLAZING DETAIL

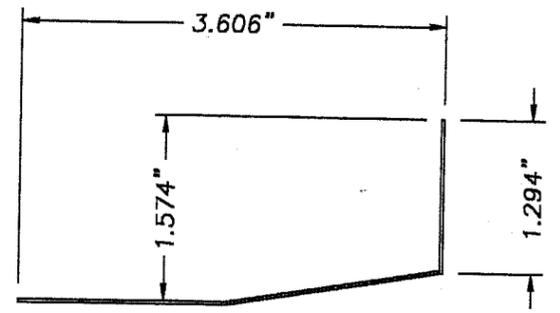

INSTALLATION CLIP  
.025" THK. FORMED STEEL

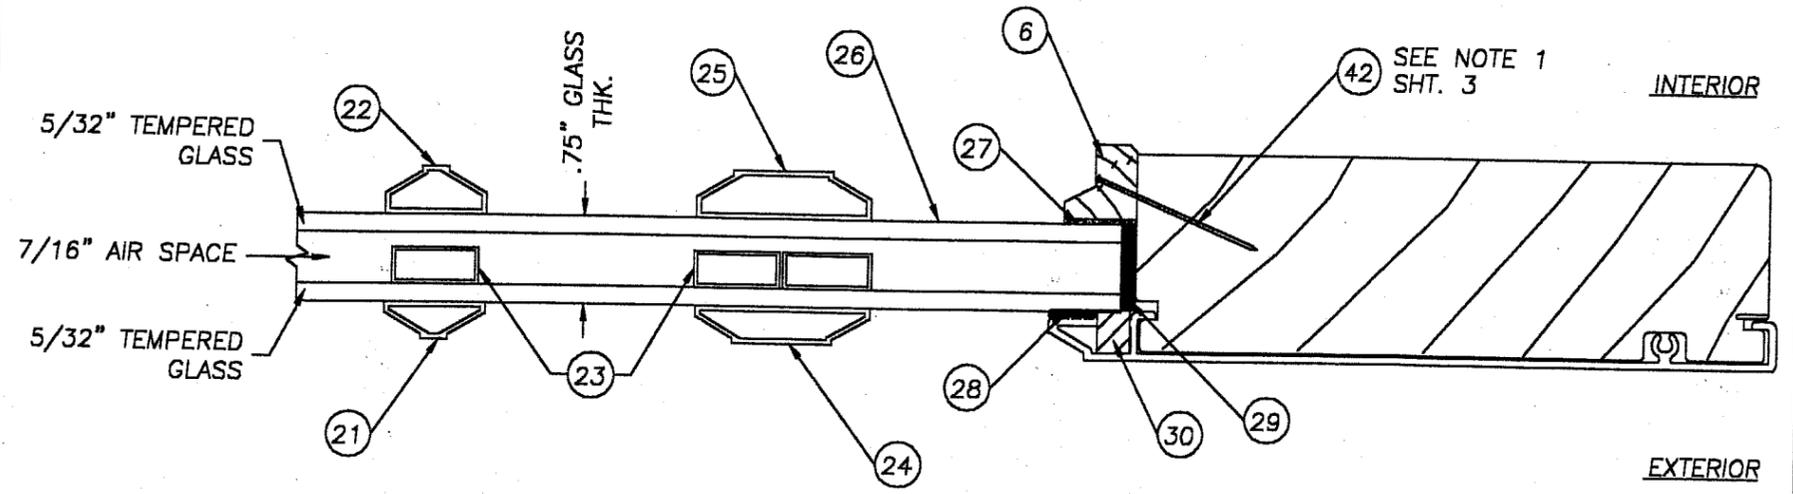

3/4" INSULATED TEMPERED GLASS GLAZING DETAIL



NAILING FLANGE  
.045" THK. VINYL

**EAGLE WINDOW & DOOR, INC.**  
375 EAST 9th St.  
DUBUQUE, IA 52004-1072  
PH. 319.556.4408

PRODUCT: CLAD HINGED OUTSWING DOUBLE  
PART OR ASSEMBLY: GLAZING DETAILS & UNIT COMPONENTS

NO.	DATE	GENERAL REVISION	TJH	BY
1	11/15/00		TJH	

**RW** BUILDING CONSULTANTS, INC.  
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE **MAR 01 2001**  
BY *Manuel Serrano*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0129.14

DATE: 4/2/97  
SCALE: N.T.S.  
DWG. BY: TSB  
CHK. BY: -  
DRAWING NO.: D025  
SHEET 6 OF 6