



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Aeicor Metal Products, Inc.**  
**450 West McNab Road**  
**Fort Lauderdale ,FL 33309**

Your application for Notice of Acceptance (NOA) of:

**1" Snap Cap-Metal Roofing System**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**ACCEPTANCE NO.: 01-0209.06**  
**EXPIRES: 06/07/2006**

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL  
CONDITIONS  
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 06/07/2001**

**ROOFING ASSEMBLY APPROVAL**

**Category:** Roofing  
**Sub-Category:** Metal Roofing  
**Material:** Steel  
**Maximum Design Pressure:** -85.0 psf.

**Approval Date:** June 7, 2001  
**Expiration Date:** June 7, 2006

**Trade Names of Products Manufactured or Labeled by Applicant**

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
SS-4-12 Snap Cap	Length: various Height: 5/8" Width : 12 3/4" Thickness 0.0276		Corrosion resistant, galvalume, preformed, standing seam, coated, pre-finished, metal panels.
CP-4-12 Snap Cap	Length: various Height: 5/8" Width: 12 3/4" Thickness 0.0276		Corrosion resistant, galvalume, preformed, curved, coated, prefinished, metal panels.
Trim Pieces	Length: varies Width: varies Thickness 0.0276		Standard flashing and trim pieces, corrosion resistant galvalume.
Panel Clips	Length: 2" Height: 3/4" Width: 1" Thickness 0.019		Corrosion resistant, formed, plated steel clips for metal panel installation

**EVIDENCE SUBMITTED**

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Construction Research Laboratory, Inc.	6176A	Uplift Pressure Testing ASTM E 330 (12" Wide Panels Direct Deck with no Insulation)	March 1995
Lilly Industries, Inc.	Technical Literature	Salt Spray ASTM B 117	Sept. 1993
Lilly Industries, Inc.	Technical Literature	Accelerated Weathering	Sept. 1993

  
 Frank Zuloaga, RRC  
 Roofing Product Control Examiner

ASTM G 23

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
C.R.L.	Test # 5772	PA 100	March 1993
Hurricane Test Laboratory, Inc.	0154-1211-97	PA 125-95	January 1998
Celotex Corp.	# 258340	PA 100-95	December 1997

**Assembly Approval:**

**System:** SS-4-12 Snap Cap & CP-4-12

**Deck Type:** Wood, Non-insulated

**Deck Description:** New Construction <sup>19</sup>/<sub>32</sub>" or greater plywood or wood plank.

**Slope Range:** 2":12" or greater

**Maximum Uplift Pressure:** The maximum allowable uplift pressure for the 12 ¼" wide panels shall be -85.0 psf.

**Deck Attachment:** In accordance with applicable building code, but in no case shall it be less than # 8 x 2" long screws spaced 6" O.C. In reroofing, where the deck is less than <sup>19</sup>/<sub>32</sub>" thick (Minimum <sup>15</sup>/<sub>32</sub>"") the above attachment method must be in addition to existing attachment.

**Underlayment:** Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 1 ¼" annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll.

**Panel Clips:** Panels shall be installed with approved clips, attached to substrate with one corrosion resistant #8-14 screws of sufficient length to penetrate through the sheathing <sup>3</sup>/<sub>16</sub>" at a spacing not to exceed 12" o.c.

**Valleys:** Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with the current published installation instructions and details in Aecor Metal Roofing Installation Manual version 1.1.9206.

**Fire Barrier Board:** For class A or B fire rating, install minimum ¼" thick Georgia Pacific "Dens Deck" (with curent NOA) or minimum 4mm thick of Tritex, RocRoof (with current NOA) or <sup>5</sup>/<sub>8</sub>" water resistant type X gypsum sheathing with treated core and facer.



**Metal Panels and Accessories:**

Install the "SS-4-12 Snap Cap Panel & CP-4-12" and accessories in compliance with the current published installation instructions and details in Aeicor Metal Roofing Installation Manual. Flashings, penetrations, valley construction and other details shall be constructed in compliance with Roofing Application Standard RAS 133.


**APPROVAL ASSEMBLY:**

**Comments:**


1. Panels shall be roll formed in continuous lengths from eave to ridge not exceeding 45 feet in compliance with Roofing Application Standard RAS 133.
2. Anchor clips to be spaced as needed to meet or exceed design pressures determined in compliance with applicable building code (See System Limitation #2) but not to exceed 12" o.c.

**PROFILE DRAWINGS  
AEICOR SS-4-12 & CP-4-12 PANEL AND ATTACHMENT CLIP**



13 7/8" COIL; 12 3/4" COVERAGE

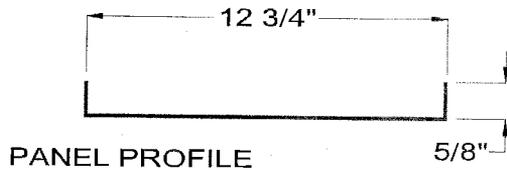

3/16" RADIUS

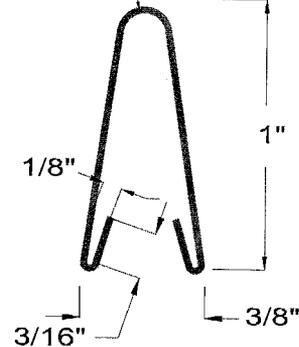

ONE NO. 8-14 x 1"  
WAFER HEAD SCREW  
AT EA. CLIP

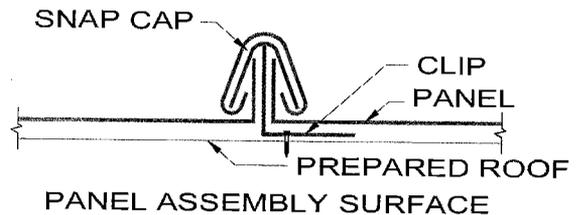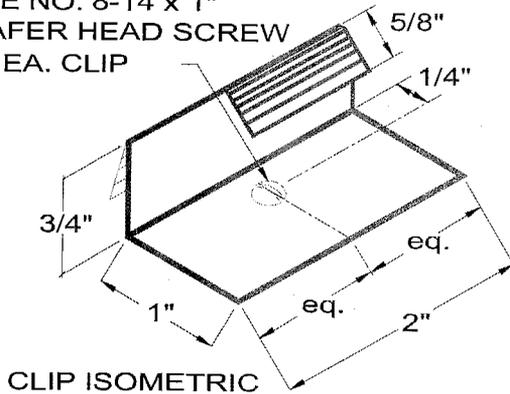

**SYSTEM LIMITATIONS**

1. Increased design pressures at perimeter and corner areas, in compliance with applicable building code, may be met through rational analysis by increasing the number of attachment points in these areas. The maximum fastener spacing noted in the "Systems Description" section of this approval shall not be exceeded. All rational analysis computation shall be prepared, signed and sealed by a Florida registered Professional Engineer, Registered Architect, or Roof Consultant.
2. Panels shall be roll formed in continuous lengths from eave to ridge. Maximum lengths shall be as described in Roofing Application Protocol RAS 133.
3. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved. All clips shall be permanently labeled with manufacturer's name, and/or logo, and/or model.

**NOTICE OF ACCEPTANCE STANDARD CONDITIONS**

- 1 Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
- 2 Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
- 3 Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
- 4 Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
- 5 Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process;
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.



Frank Zuloaga, RRC  
Roofing Product Control Examiner

- 6 The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
- 7 A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all times. The copies need not be resealed by the engineer.
- 8 Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
- 9 This Acceptance contains pages 2 through 6.

**END OF THIS ACCEPTANCE**



---

Frank Zuloaga, RRC  
Roofing Product Control Examiner