



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Recol Enterprises
4117 NW 135th Street
Opalocka ,FL 33054

Your application for Notice of Acceptance (NOA) of:

Aluminum Framed Screen Enclosure

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez
Chief Product Control Division

ACCEPTANCE NO.: 01-0228.08
EXPIRES: 03/12/2006

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 04/26/2001

Recol Enterprises

ACCEPTANCE No. : 01-0228.08

APPROVED : 04/26/2001

EXPIRES : 03/12/2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

This renews the Notice of Acceptance No. 97-1212.02, which was issued on March 12, 1998. It approves an Aluminum Framed Screen Enclosure, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

This Aluminum Framed Screen Enclosure and its components shall be constructed in strict compliance with the following documents: Drawing No. 94-193, titled "Screen Enclosure", prepared by Tilteco, Inc., sheets 1 through 6 of 6, dated September 16, 1994, last revision dated June 10, 1996 (sheets 1, 2, 3, & 6 of 6) and November 6, 1995 (sheets 4 & 5 of 6), bearing the Miami-Dade County Product Control Approval and Renewal stamps with the Notice of Acceptance numbers and approval dates by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

All permanent set components, included but not limited to embedded anchor bolts must be protected against corrosion, contamination and damage at all times.

4. INSTALLATION

This Aluminum Framed Screen Enclosure and its components shall be installed in strict compliance with the approved drawings. The installation of this product will not require a hurricane protection system.

5. LABELING

This Aluminum Framed Screen Enclosure shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved". The label shall be placed at the bottom of the each chair rail, each beam or column of the screen enclosure.


6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.



Helmy A. Makar, P.E., Product Control Examiner
Product Control Division

Recol Enterprises

ACCEPTANCE No. : 01-0228.08


APPROVED : 04/26/2001

EXPIRES : 03/12/2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b. The product is no longer the same product (identical) as the one originally approved;
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d. The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process;
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami -Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Acceptance contains pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE



Helmy A. Makar, P.E.- Product Control Examiner
Product Control Division

BEAM SCHEDULE (ROOF)								
TYPE	SIZE (INCH)		THICKNESS (INCH)		MAXIMUM CLEAR SPAN FOR A GIVEN SPACING			
	B	H	T1	T2	4'-0"	5'-0"	6'-0"	7'-0"
3SB	2	3	.050	.050	10'-0"	9'-4"	8'-9"	8'-4"
4SB	2	4	.050	.050	12'-7"	11'-9"	11'-0"	10'-5"
4LB	2	4	.050	.120	15'-5"	14'-2"	13'-4"	12'-8"
6SB	2	6	.062	.120	21'-5"	19'-9"	18'-7"	17'-8"
7LB	2	7	.062	.120	24'-1"	22'-4"	21'-0"	19'-9"
8LB	2	8	.072	.224	30'-10"	28'-8"	27'-0"	25'-6"
9LB	2	9	.072	.224	33'-11"	31'-6"	29'-7"	27'-10"
10LB	2	10	.092	.389	42'-5"	39'-5"	36'-8"	34'-0"



COLUMN SCHEDULE (BEARING WALLS)								
TYPE	SIZE (INCH)		THICKNESS (INCH)		Max. CLEAR COLUMN HEIGHT FOR A GIVEN SPACING			
	B	H	T1	T2	4'-0"	5'-0"	6'-0"	7'-0"
3SC	2	3	.050	.050	7'-9"	6'-11"	N/A	N/A
4LC	2	4	.050	.120	11'-6"	10'-5"	9'-4"	8'-7"
6SC	2	6	.062	.120	15'-0"	14'-0"	12'-9"	11'-9"

* TO BE USED WITH 3SB, 4SB & 4LB BEAMS ONLY.

PRODUCT RENEWED
 ACCEPTANCE No. 01-0228-08
 EXPIRATION DATE 03/12/2006
 By Helmut A. Mahr
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

* THESE ROOF BEAMS CAN BE ATTACHED TO SUPERGUTTER ONLY WITH REINFORCEMENT TYPE 1 OR WITH REINFORCEMENT TYPE 2 FOR SPACINGS AND SPANS INDICATED AT SCHEDULE.
 ** THESE ROOF BEAMS CAN BE ATTACHED TO SUPERGUTTER ONLY WITH REINFORCEMENT TYPE 2 FOR SPACINGS AND SPANS INDICATED AT SCHEDULE. NEVER USE TYPE 1 REINFORCEMENT IN THIS CASE.

COLUMN SCHEDULE (NON BEARING WALLS)								
TYPE	SIZE (INCH)		THICKNESS (INCH)		Max. CLEAR COLUMN HEIGHT FOR A GIVEN SPACING			
	B	H	T1	T2	4'-0"	5'-0"	6'-0"	7'-0"
3SC	2	3	.050	.050	7'-10"	7'-0"	N/A	N/A
4SC	2	4	.050	.050	9'-6"	8'-7"	7'-10"	7'-2"
4LC	2	4	.050	.120	12'-5"	11'-6"	10'-8"	9'-10"
6SC	2	6	.062	.120	15'-0"	15'-0"	14'-2"	13'-2"

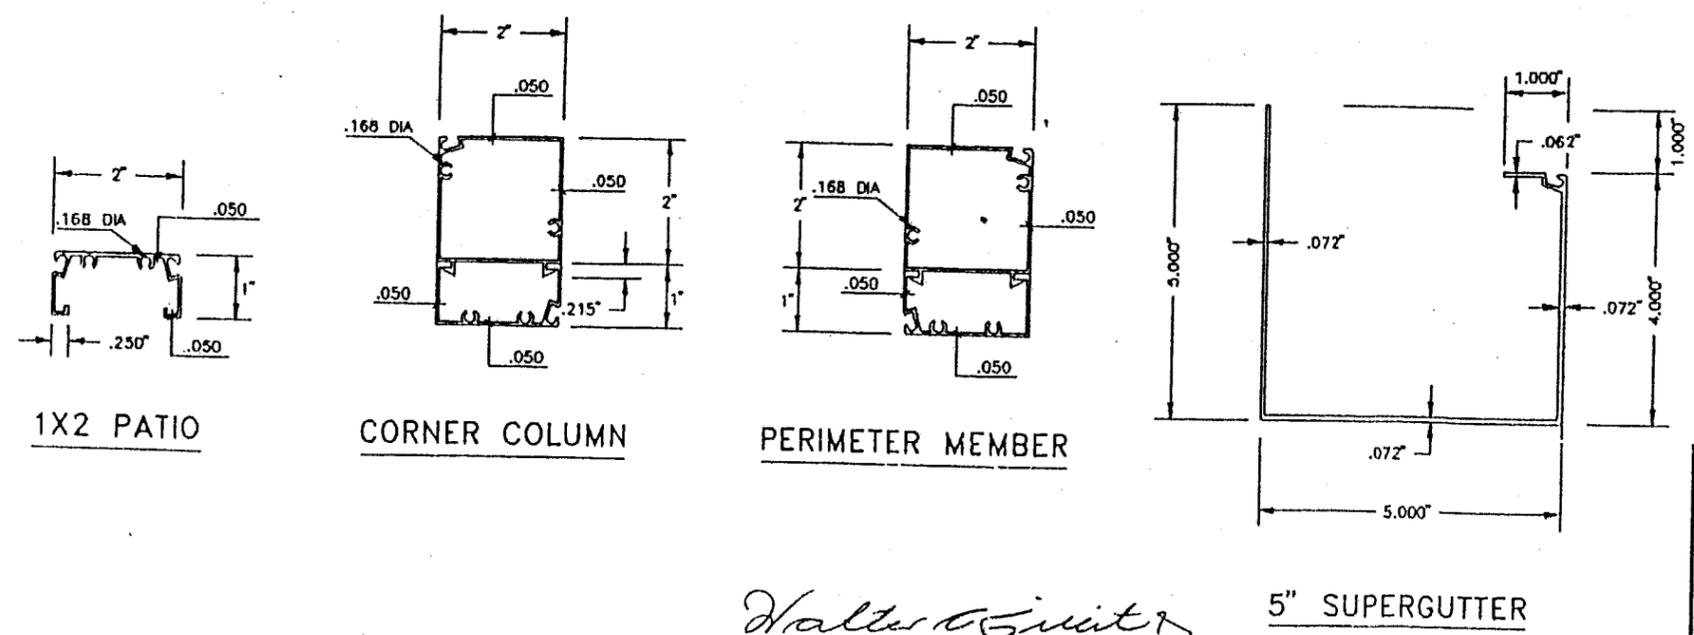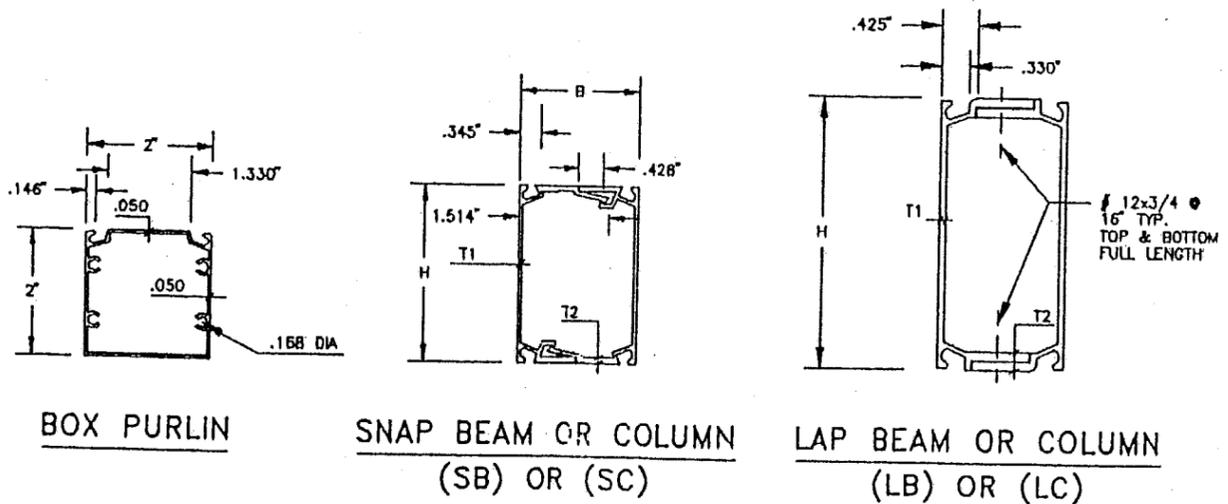

Walter G. Smith
 6/12/96


- GENERAL NOTES**
- THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH THE 1994 EDITION OF THE SOUTH FLORIDA BUILDING CODE. WIND VELOCITY CONSIDERED IS 110 M.P.H.
 - SCREEN FABRIC OPENINGS SHALL BE 60% OR GREATER.
 - MAXIMUM ROOF ELEVATION ABOVE GRADE IS 15'-0".
 - ALUMINUM THICKNESS SHALL BE AS INDICATED ON THESE DRAWINGS WITH APPLICABLE TOLERANCES IN ACCORDANCE WITH THE ALUMINUM ASSOCIATION "ALUMINUM STANDARDS AND DATA", 1988 EDITION.
 - ALL ALUMINUM EXTRUSIONS SHALL BE 6063-T6 UNLESS OTHERWISE NOTED.
 - ALL BOLTS TO BE 2024-T4 ALUMINUM ALLOY, 300 SERIES STAINLESS STEEL, OR ASTM A-307 DESIGNATION GALVANIZED STEEL.
 - ALL SCREWS SHALL BE 2024-T4 ALUMINUM ALLOY OR 300 SERIES STAINLESS STEEL.
 - ALL EXPANSION ANCHORS SHALL BE GALVANIZED OR STAINLESS STEEL. RED HEAD SLEEVE ANCHORS OR TAPCON ANCHORS. MINIMUM PENETRATION INTO CONCRETE SHALL BE 1-3/4". EMBEDMENT LENGTHS NOTED ON DRAWING SHALL NOT INCLUDE STUCCO OR FINISH MATERIAL.
 - WOOD FASCIA WHERE SCREEN ROOF IS TO BE ATTACHED SHALL HAVE A MINIMUM NOMINAL THICKNESS OF 2" AND SHALL BE IN A SOUND STRUCTURAL CONDITION. ADEQUACY OF THE EXISTING STRUCTURE SUPPORTING THE SCREEN ENCLOSURE SHALL BE VERIFIED BY A FLORIDA REGISTERED ENGINEER PRIOR TO ATTACHMENT OF THE SCREEN ENCLOSURE STRUCTURE.
 - DOOR LATCHES AT SCREEN ENCLOSURES BUILT ADJACENT TO SWIMMING POOLS SHALL BE LOCATED AT 5'-6" ABOVE THE FLOOR AND SHALL BE SELF CLOSING.
 - ELECTRICAL SERVICE DROP CONDUCTORS OR ANY OTHER OVERHEAD WIRING SHALL NOT BE INSTALLED OVER ANY PART OF ANY SCREEN ENCLOSURE.
 - ANY METALIC ENCLOSURE WITHIN 5'-0" OF THE INTERIOR WALL OF A SWIMMING POOL SHALL BE ELECTRICALLY BONDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE.
 - MINIMUM SOIL BEARING PRESSURE SHALL BE 2000 P.S.F.
 - CABLES SHALL BE STAINLESS STEEL AND SHALL HAVE A MINIMUM TENSILE CAPACITY OF 2200 Lbs.
 - CONCRETE FOOTING TO DEVELOP A MINIMUM COMPRESSION STRENGTH OF 3000 psi AFTER 28 DAYS. CONCRETE MIXTURE AND PLACEMENT TO COMPLY WITH THE PROVISIONS OF THE ACI CURRENT EDITION.
 - REINFORCING STEEL SHALL BE ASTM A-615 GRADE 60, WELDED WIRE MESH SHALL COMPLY WITH ASTM A-185.
 - ALUMINUM MEMBERS IN CONTACT WITH CONCRETE AND WOOD SHALL BE PROTECTED BY "KOPPERS BITUMINOUS PAINT" ACCORDING TO S.F.B.C. SECTION 3004.4 (d) AND (e), WHEN IN CONTACT WITH PRESSURE TREATED WOOD TO BE IN ACCORDANCE WITH S.F.B.C. SECTION 3004.4 (f).

PRODUCT RENEWED
 ACCEPTANCE No. 97-1212.02
 EXPIRATION DATE MARCH 12 2001
 By Helmut A. Mahr
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE JULY 11 1996
 BY Helmut A. Mahr
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE No. 96-0506.06

TILECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6995 N.W. 38th St., Ste. 217, VIRGINIA BEACH, FL 33109
 Phone: (305)871-1530 Fax: (305)871-1531
 WALTER A. TILLIT Jr., P. E.
 FLORIDA Lic. 44167

SCREEN ENCLOSURE					SCALE
RECOL ENTERPRISES 13280 N.W. 43 AVENUE OPA-LOCKA, FLORIDA 33054					9/16/94 DATE
					94 - 193 DRAWING No
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE
1	GENERAL	11/6/95	2		
2	GENERAL	6/10/96	4		

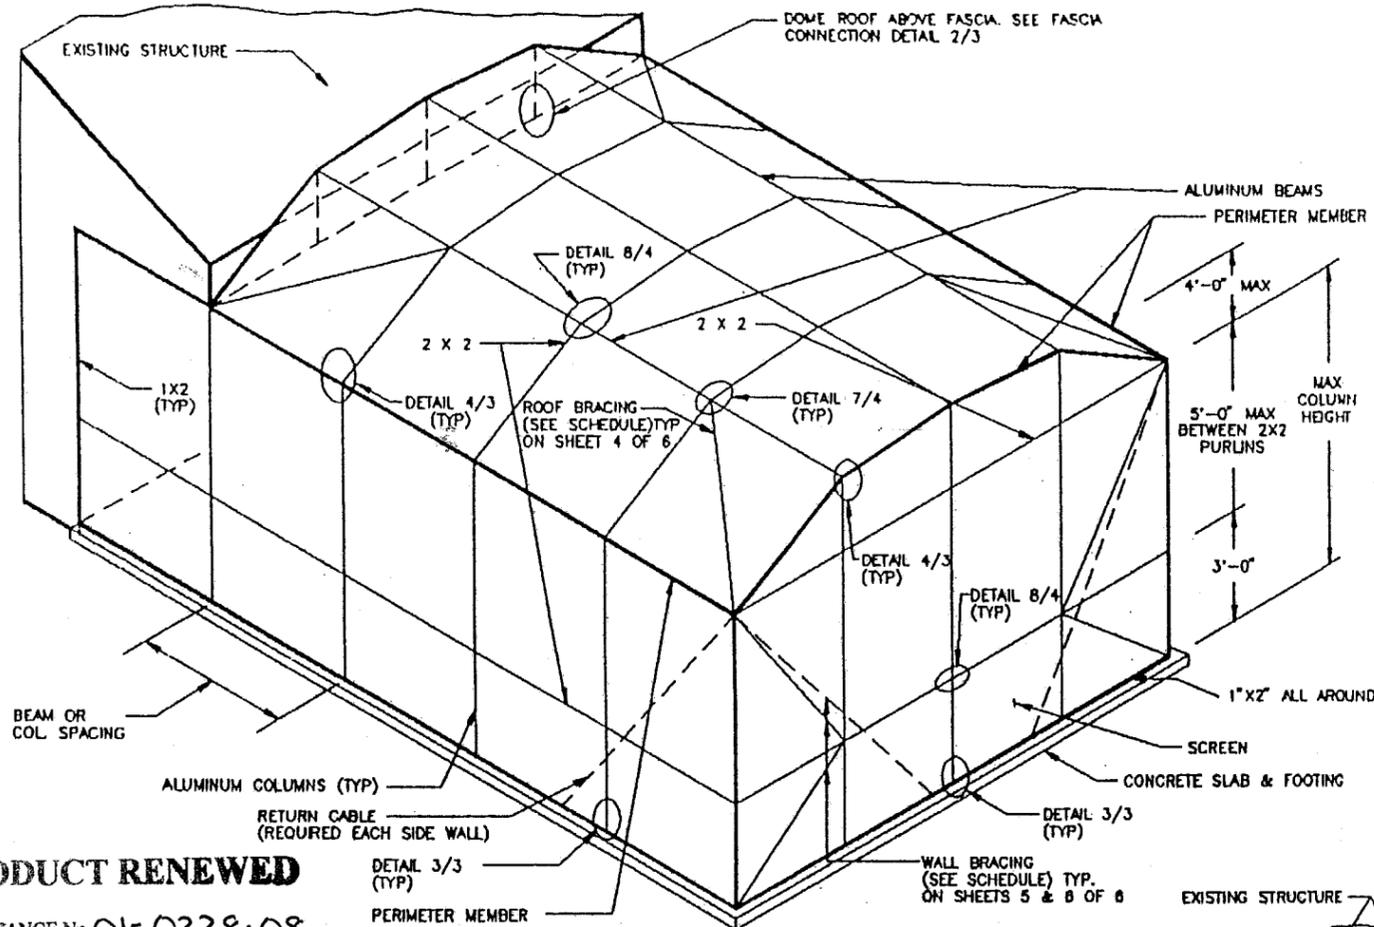


TYPICAL DOME ROOF ISOMETRIC

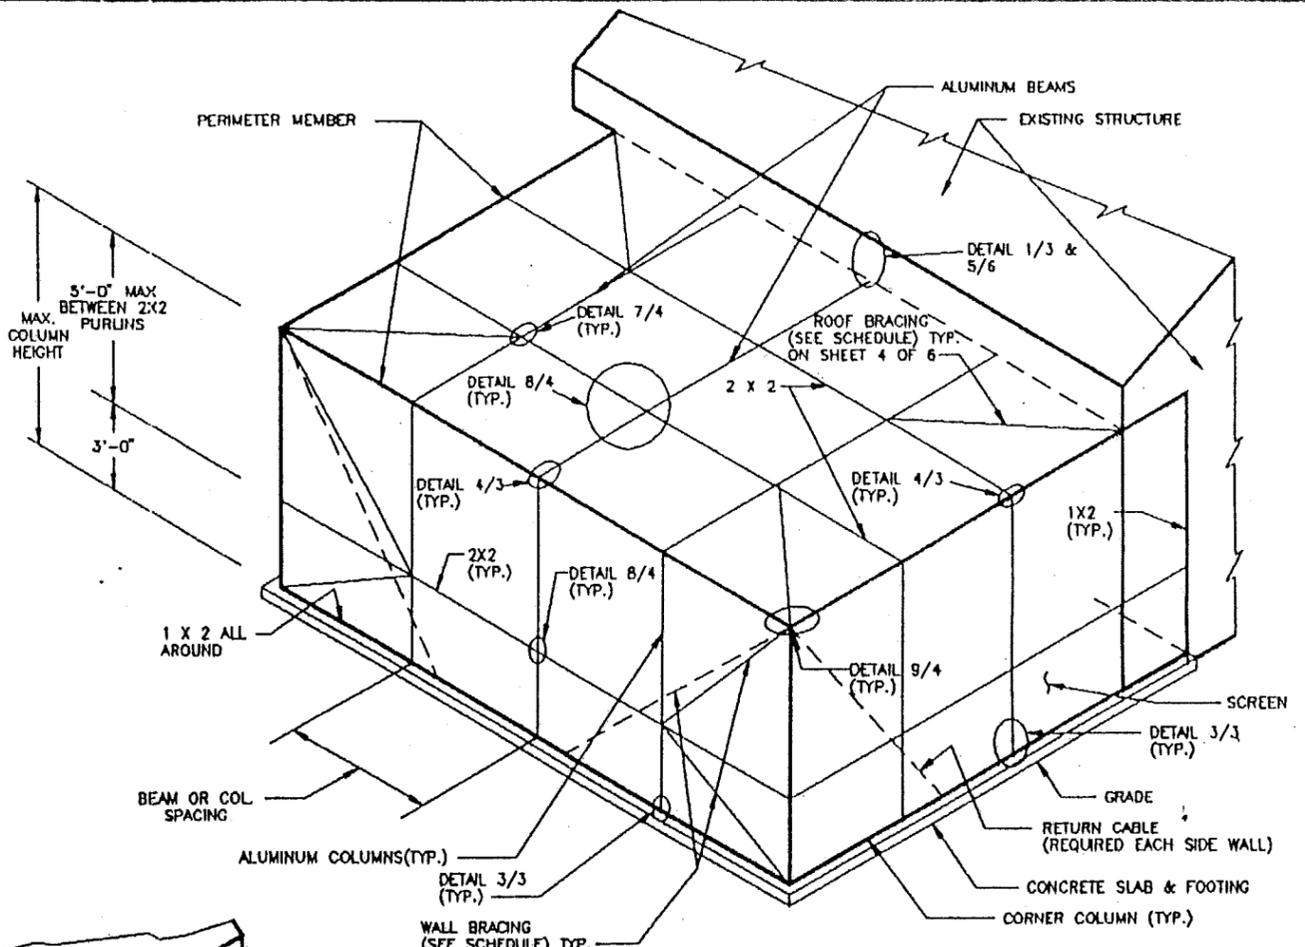


TYPICAL FLAT ROOF ISOMETRIC

PRODUCT RENEWED
 ACCEPTANCE No. 01-0228-08
 EXPIRATION DATE 03/12/2006
Helmy A. Maher
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

- NOTES APPLICABLE TO ISOMETRICS**
1. SEE ROOF BRACING DETAILS ON SHEET 4 OF 6.
 2. SEE WALL BRACING DETAILS AND SCHEDULE ON SHEET 6 OF 6.
 3. SEE DETAILS 1, 2, 3, 4 & 6 ON SHEET 3 OF 6.
 4. SEE DETAILS 7, 8 & 9 ON SHEET 4 OF 6.
 5. SEE DETAIL 5 ON SHEET 6 OF 6.

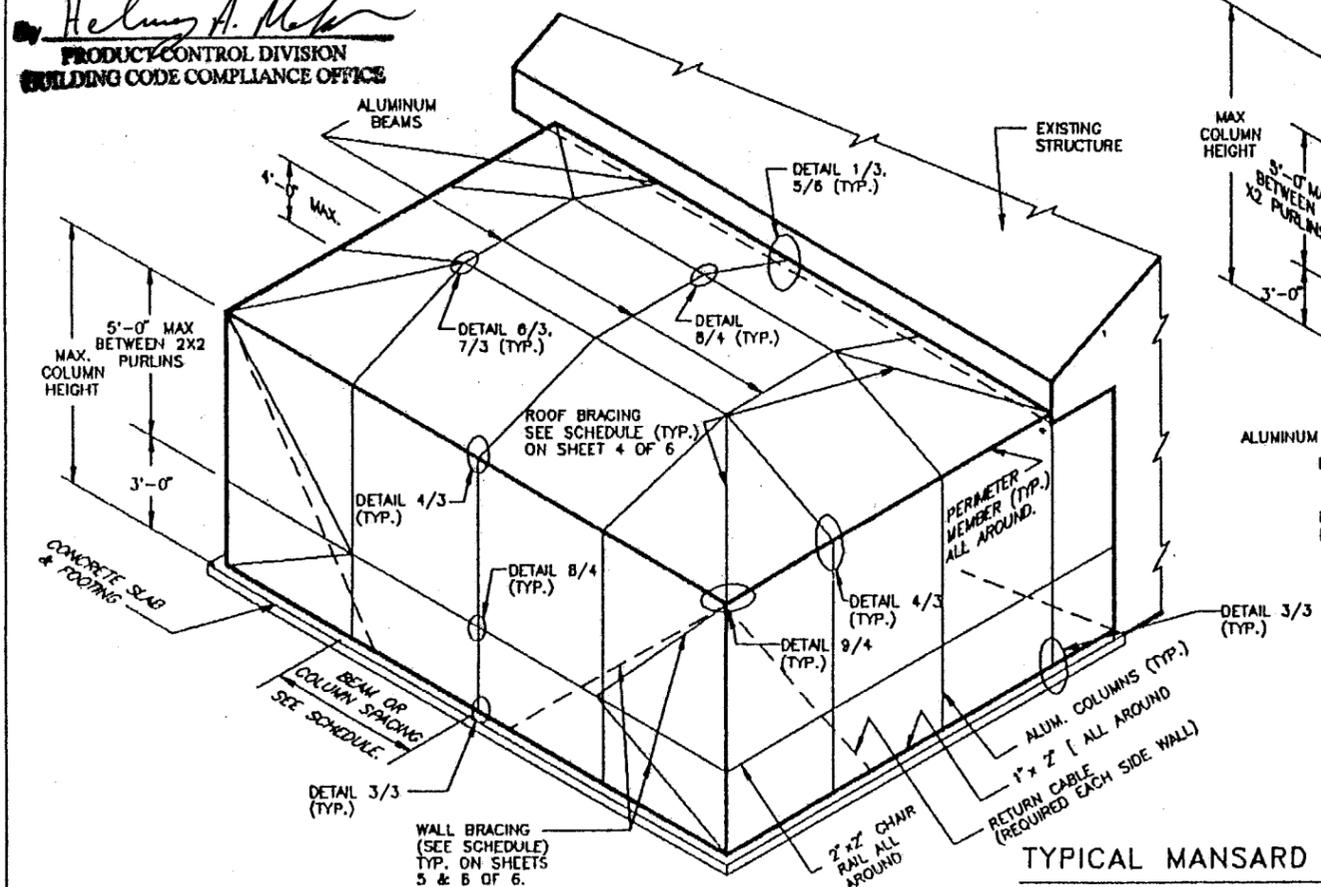

TYPICAL MANSARD ROOF ISOMETRIC

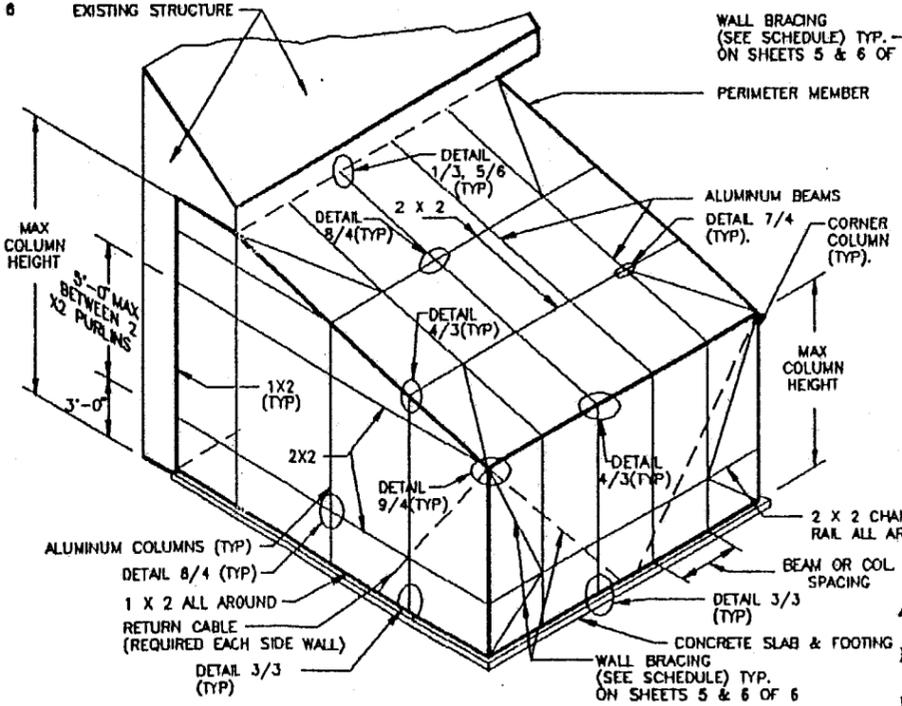


TYPICAL MONOSLOPE ROOF ISOMETRIC

PRODUCT RENEWED
 ACCEPTANCE No. 97-1212-02
 EXPIRATION DATE MARCH 12, 2001
Helmy A. Maher
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE JULY 11, 1996
 BY *Helmy A. Maher*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE No. 96-0506-06

TILECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6095 N.W. 36th St., Ste. 217, VARGHA GARDENS, FL 33166
 Phone: (305)871-1530, Fax: (305)871-1531
 WALTER A. TILLIT Jr., P. E.
 FLORIDA Lic. 44167


SCREEN ENCLOSURE		SCALE	
RECOL ENTERPRISES		9/18/94 DATE	
13280 N.W. 43 AVENUE OPA-LOCKA, FLORIDA 33054		94 - 193 DRAWING No	
REV. NO	DESCRIPTION	DATE	REV. No
1	GENERAL	11/6/93	3
2	GENERAL	6/10/98	4
		SHEET 2 OF 6	

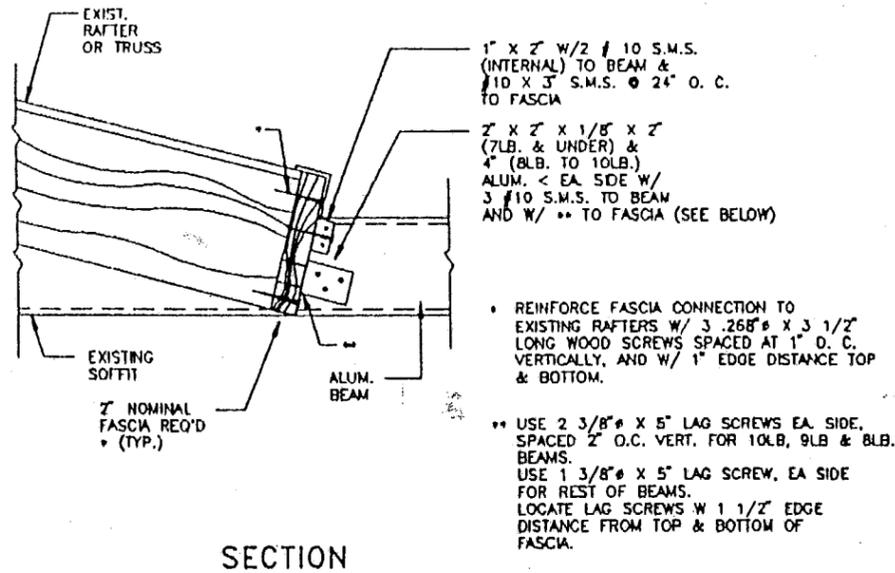


SECTION BEAM/FASCIA CONNECTION DETAIL (1)

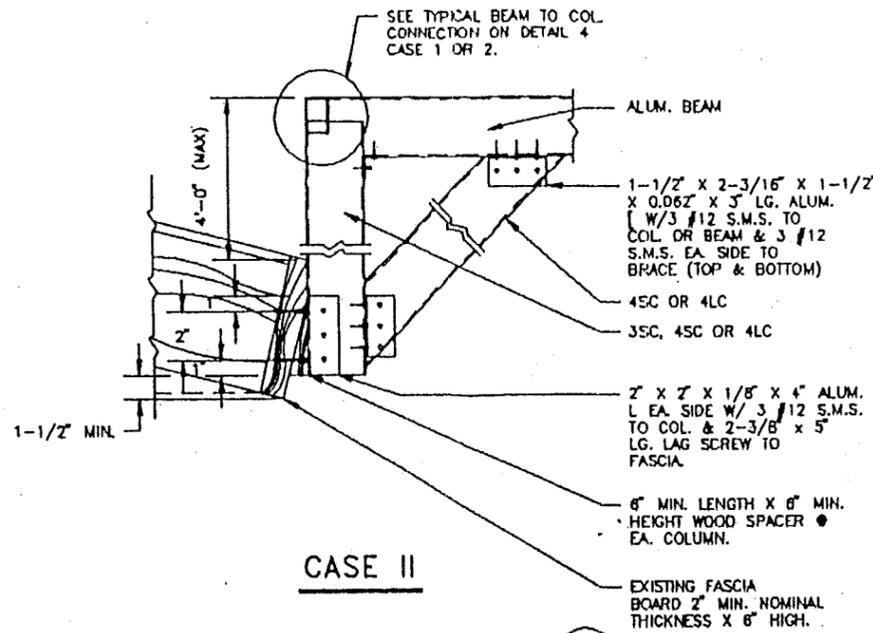


CASE II FASCIA CONNECTION DETAIL (2) (DOME ROOFS)

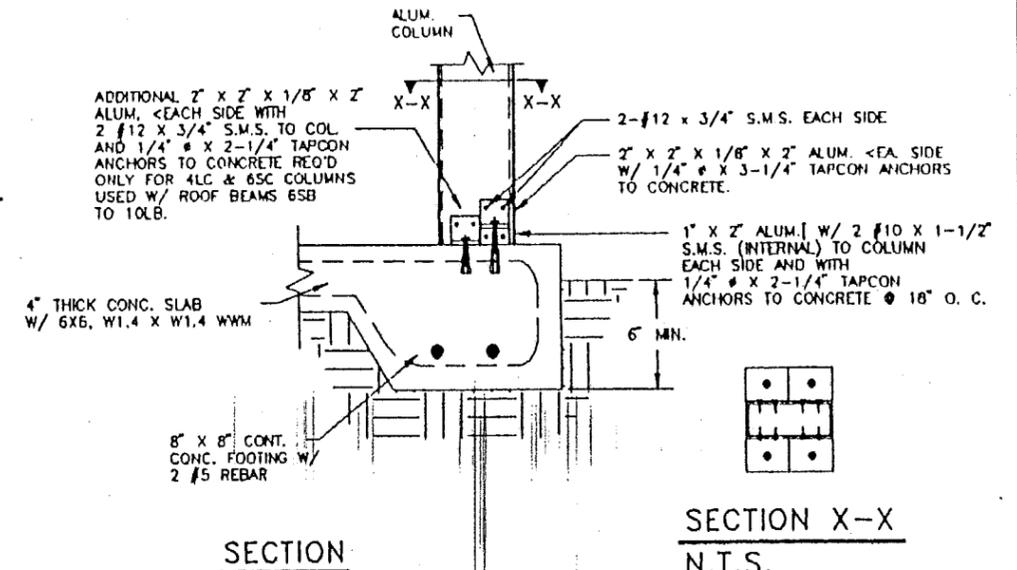


SECTION COLUMN TO FOOTING ANCHORAGE DETAIL (3) N.T.S.

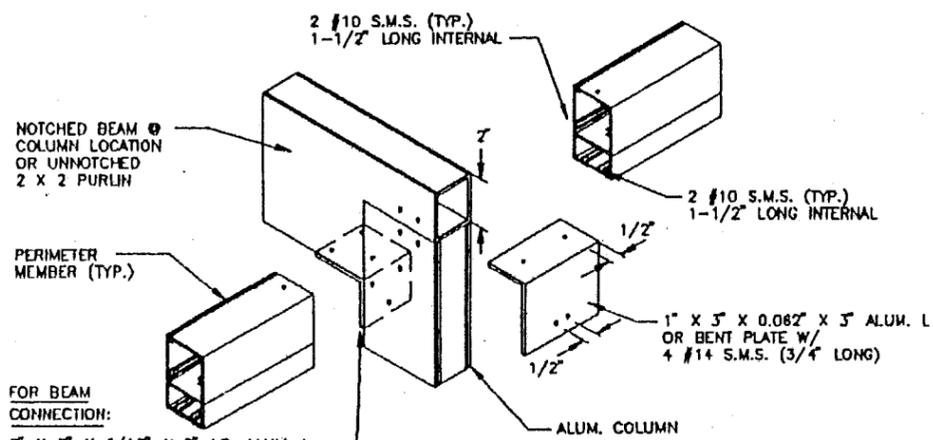


CASE 1 FLAT BEAMS

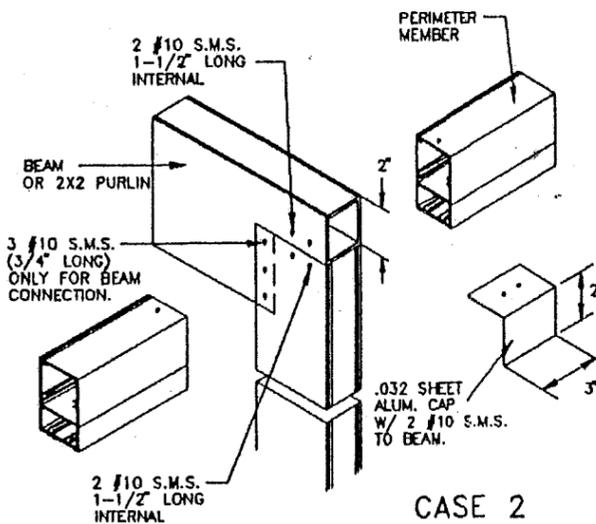

CASE 2 TYPICAL BEAM & PERIMETER MEMBER CONNECTION TO COLUMN DETAIL (4)

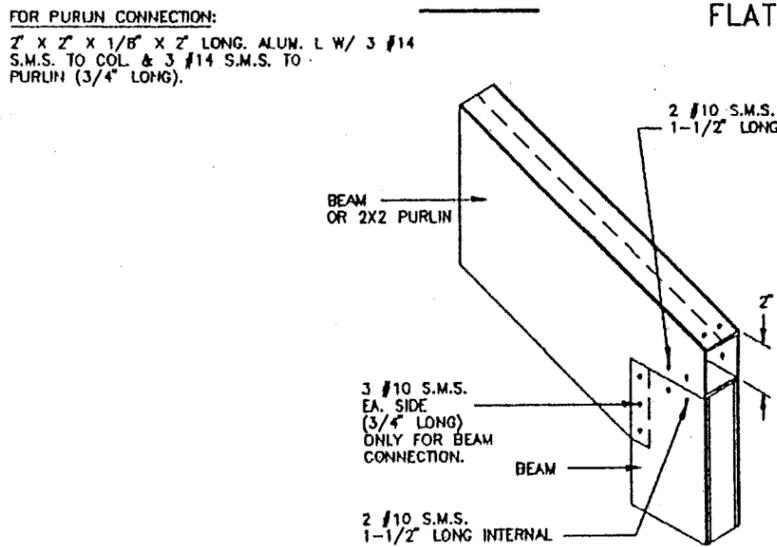

SLOPED BEAMS

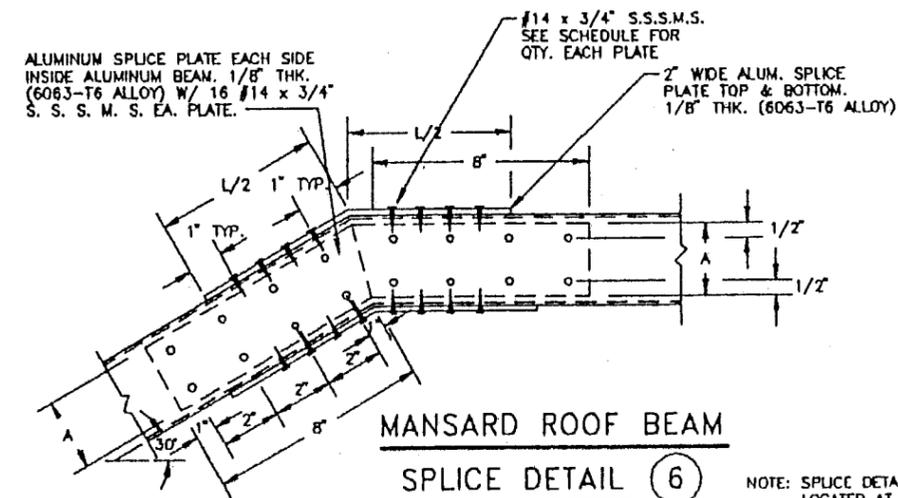

MANSARD ROOF BEAM SPLICE DETAIL (6)

NOTE: SPLICE DETAIL MUST BE LOCATED AT 7'-0\"/>

SIDE PLATE SCHEDULE (INTERIOR)		
BEAM	A	t
4SB	3'	1/8"
4LB	3'	1/8"
6SB	5'	1/8"
7LB	6'	1/8"
8LB	7'	1/8"
9LB	8'	1/8"
10LB	9'	1/8"

TOP & BOTTOM PLATE SCHEDULE			
BEAM	L	t	TOTAL # OF EQUALLY SPACED #14x3/4\"/>
4SB	8'	1/8"	8
4LB	8'	1/8"	8
6SB	10'	1/8"	10
7LB	10'	1/8"	10
8LB	14'	1/8"	16
9LB	14'	1/8"	16
10LB	17'	3/16"	22

PRODUCT RENEWED

ACCEPTANCE No. 01-0228.08

EXPIRATION DATE 03/12/2006

By *Helmut A. M...*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

Walter A. Tillit Jr.
all/2/06

TILECO INC.
TILIT TESTING & ENGINEERING COMPANY
6395 N.W. 36th St., Ste. 217, VIRGINIA GARDENS, FL 33168
Phone: (305)871-1530 Fax: (305)971-1331
WALTER A. TILLIT Jr., P. E.
FLORIDA Lic. 44167

SCREEN ENCLOSURE		SCALE
RECOL ENTERPRISES		9/18/94 DATE
13280 N.W. 43 AVENUE OPA-LOCKA, FLORIDA 33054		94 - 193 DRAWING No
REV. NO	DESCRIPTION	DATE
1	GENERAL	11/6/93
2	GENERAL	8/10/98
3	GENERAL	8/10/98


PRODUCT RENEWED

ACCEPTANCE No. 97-1212.02


EXPIRATION DATE MARCH 12, 2001

By *Helmut A. M...*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE JULY 11 1996
BY *Helmut A. M...*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE No. 96-0506.06

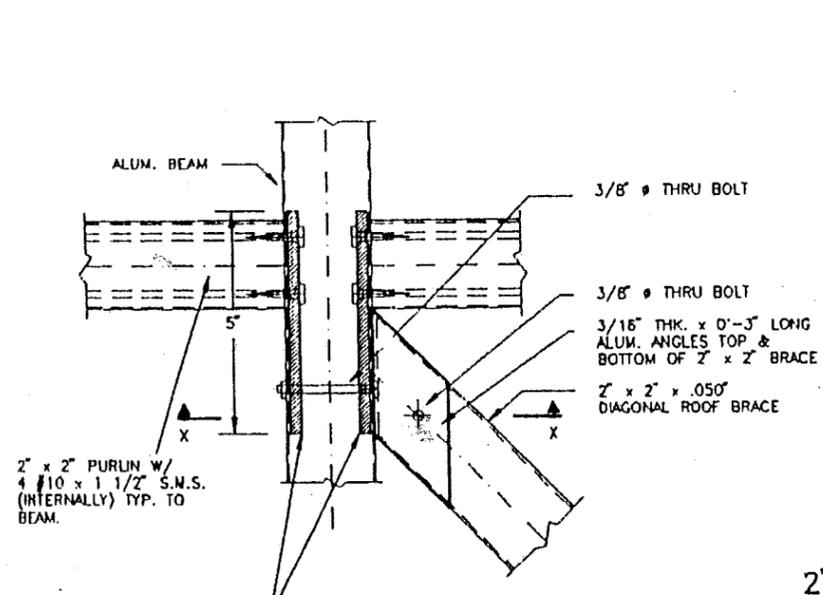

PLAN
3/16" THK. x 5" x BEAM'S DEPTH 6063-T6 ALUM. PLATE EACH SIDE (INTERIOR) REQ'D AT ALL CONNECTIONS EXCEPT AT MANSARD BEAM SPLICE DETAIL (6).

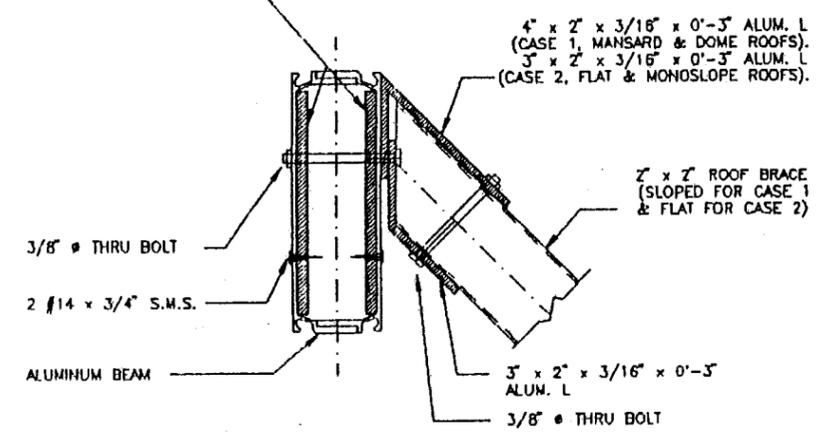


SECTION X-X
CASES 1 & 2
DETAIL (7)

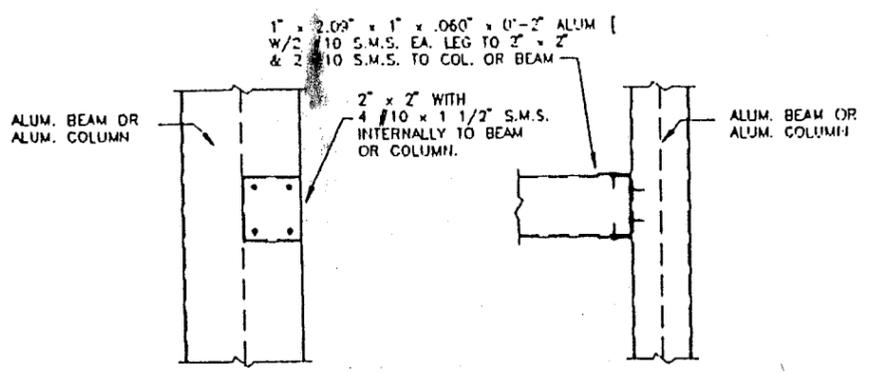


SECTION
(ALTERNATE N° 1)


2" x 2" CONNECTION TO COLUMN OR BEAM DETAIL (8)

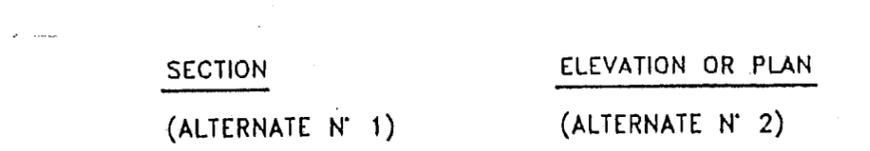


ELEVATION OR PLAN
(ALTERNATE N° 2)

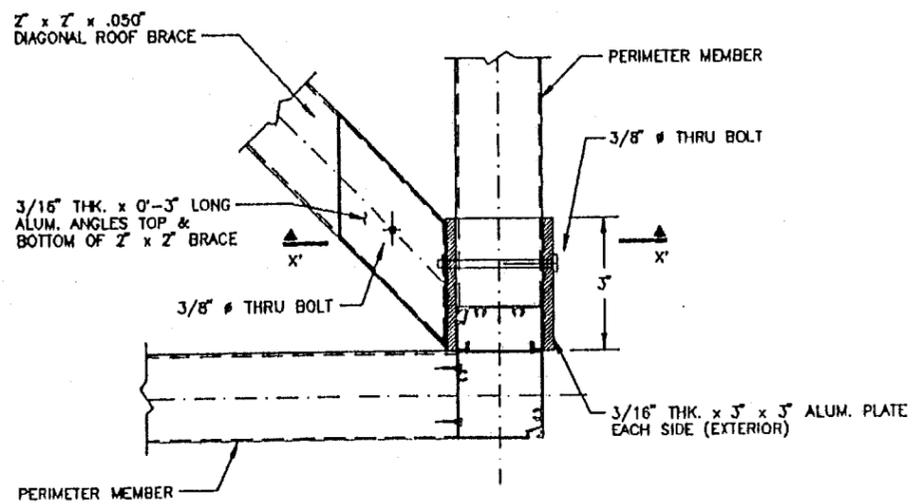

PLAN

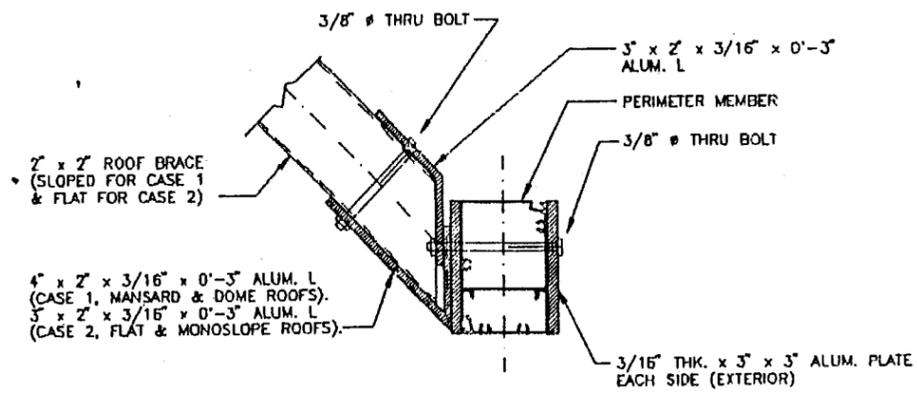

SECTION X'-X'
CASES 1 & 2
DETAIL (9)

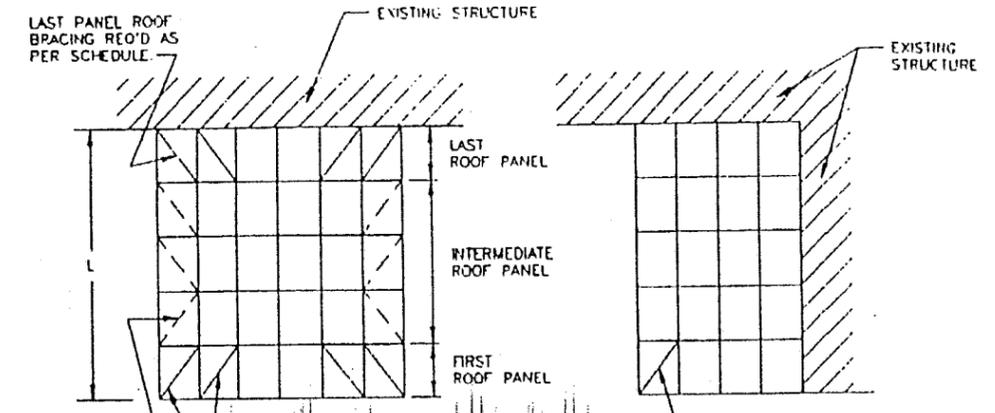

ROOF BRACING REQUIREMENTS

NUMBER OF DIAGONAL BRACING REQ'D AT FIRST AND LAST ROOF PANELS IN ADDITION TO INTERMEDIATE ROOF PANEL BRACES SHOWN ON PLANS

L \ H*	0'-20'	20'-25'	25'-30'	30'-35'	35'-40'	40'-45'
0'-8'	2	2	2	4	4	4
>8'-9'	2	2	2	4	4	4
>9'-10'	2	2	4	4	4	6
>10'-12'	2	4	4	4	4	6
>12'-14'	4	4	4	4	6	6
>14'-15'	4	4	4	4	6	6

L = ROOF PROJECTION
H* = SIDE WALL HEIGHT OR THE AVERAGE BETWEEN THIS FRONT WALL HEIGHT AND THE HEIGHT AT EXISTING STRUCTURE.

PRODUCT RENEWED
ACCEPTANCE No. 01-0228-08
EXPIRATION DATE 03/12/2006
By *Helmy A. Maher*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE


PRODUCT RENEWED
ACCEPTANCE No. 97-1212-02
EXPIRATION DATE MARCH 12 2001
By *Helmy A. Maher*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE *JULY 11 1996*
BY *Helmy A. Maher*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 96-0506-06


DIAGONAL ROOF BRACE CONNECTION

Walter A. Tillit Jr.
6/17/06

 TILLIT TESTING & ENGINEERING COMPANY 6395 N.W. 36th St., Ste. 217, VIRGINIA GARDENS, FL 33168 Phone: (305)871-1530 Fax: (305)871-1531 WALTER A. TILLIT Jr., P. E. FLORIDA Lic. 44167	SCREEN ENCLOSURE	SCALE																		
	RECOL ENTERPRISES 13280 N.W. 43 AVENUE OPA-LOCKA, FLORIDA 33054	9/16/94 DATE	94 - 193 DRAWING No																	
<table border="1"> <thead> <tr> <th>REV. NO</th> <th>DESCRIPTION</th> <th>DATE</th> <th>REV. NO</th> <th>DESCRIPTION</th> <th>DATE</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>GENERAL</td> <td>11/6/95</td> <td>3</td> <td></td> <td></td> </tr> <tr> <td>2</td> <td></td> <td></td> <td>4</td> <td></td> <td></td> </tr> </tbody> </table>	REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE	1	GENERAL	11/6/95	3			2			4				SHEET 4 OF 6
REV. NO	DESCRIPTION	DATE	REV. NO	DESCRIPTION	DATE															
1	GENERAL	11/6/95	3																	
2			4																	

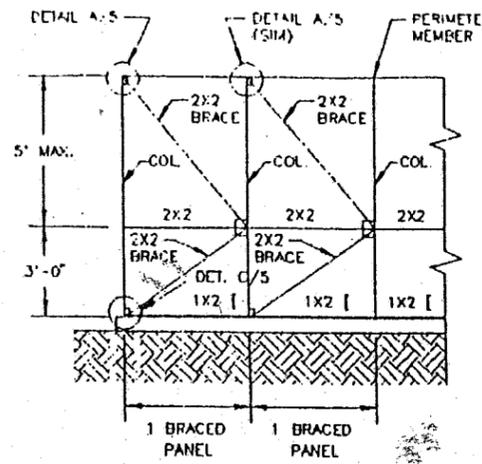

CASE 1


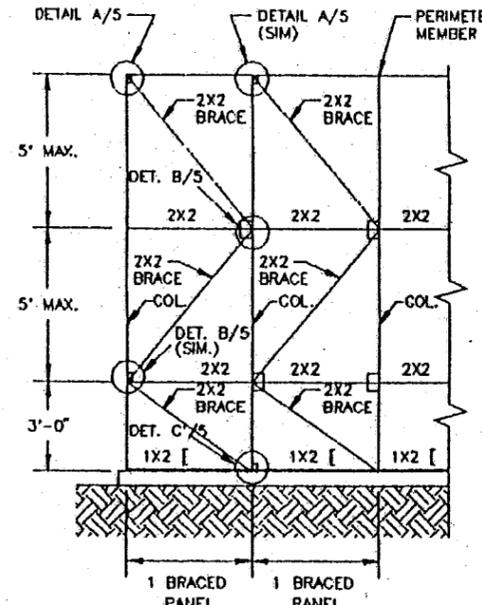


CASE 2


TYPICAL SCREEN WALL BRACING SYSTEMS

BRACED WALL PANELS SCHEDULE							
TOTAL # OF BRACED PANELS REQUIRED AT FRONT WALL							
H _w	L	0'-20'	20'-25'	25'-30'	30'-35'	35'-40'	40'-45'
0'-8"		2	2	2	2	2	2
>8'-9"		2	2	2	2	2	2
>9'-10"		2	2	2	2	2	2
>10'-12"		2	2	2	2	4	4
>12'-14"		2	2	2	4	4	4
>14'-15"		2	2	4	4	4	4


L = ROOF PROJECTION
 H_w = SIDE WALL HEIGHT OR THE AVERAGE BETWEEN THE FRONT WALL HEIGHT AND THE HEIGHT AT EXISTING STRUCTURE.

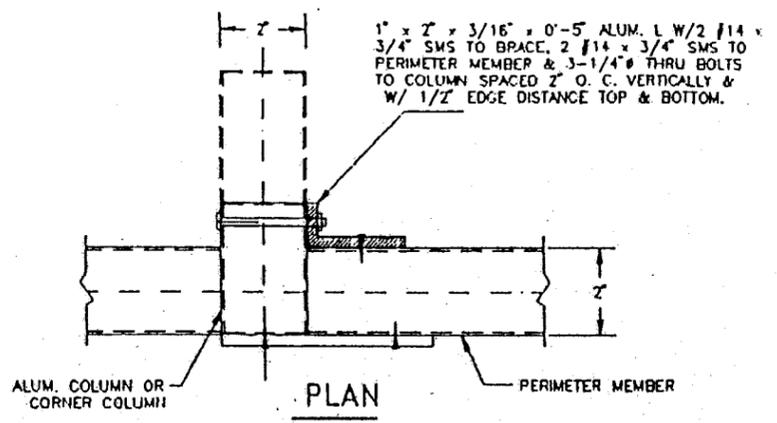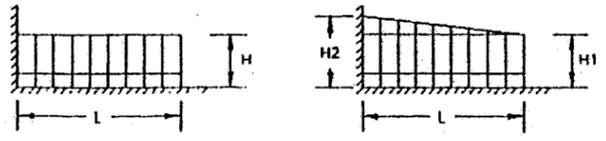


PLAN

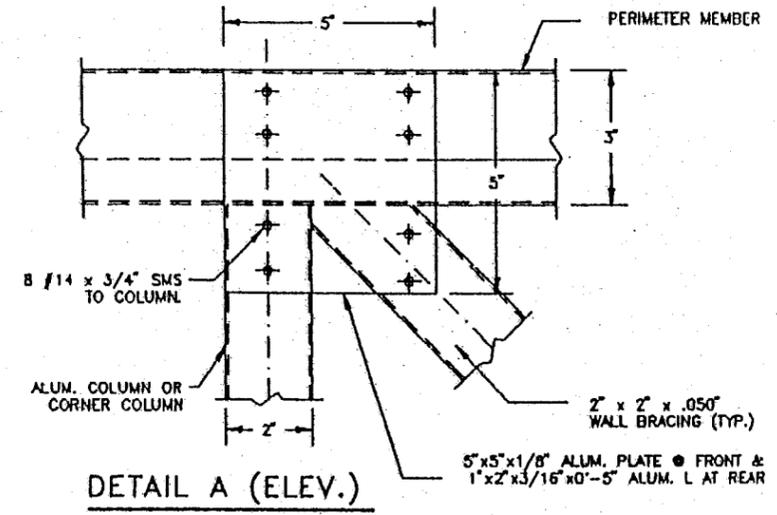


DETAIL A (ELEV.)

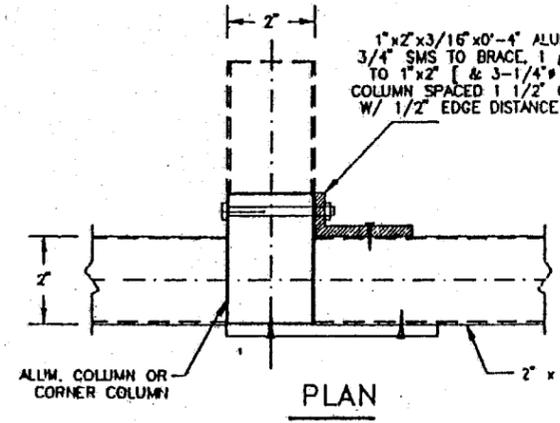


PLAN

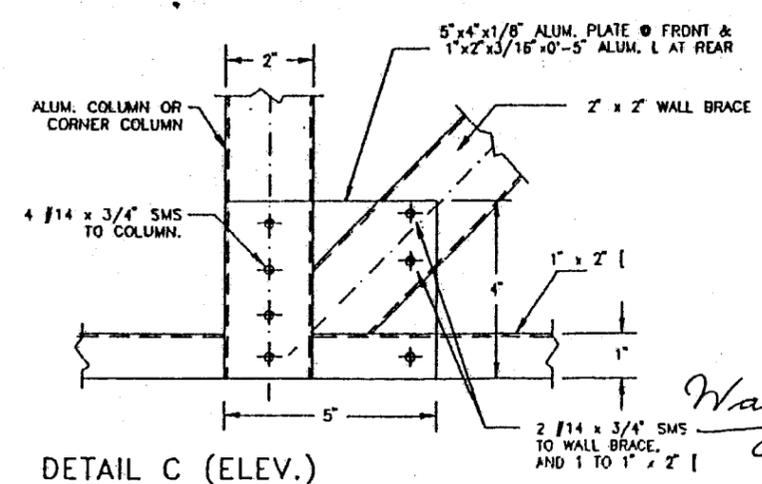


DETAIL C (ELEV.)

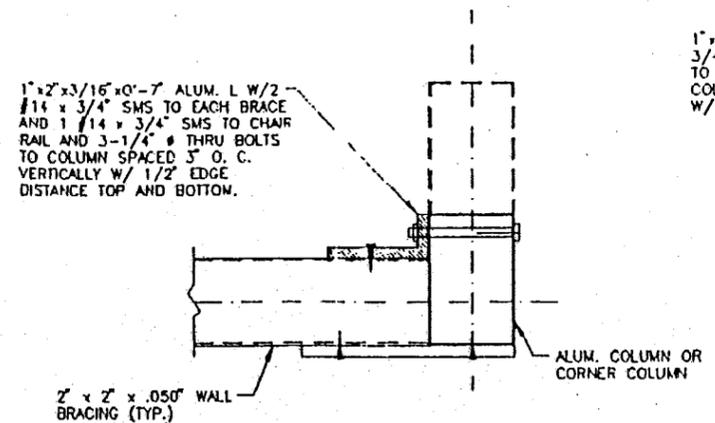


PLAN

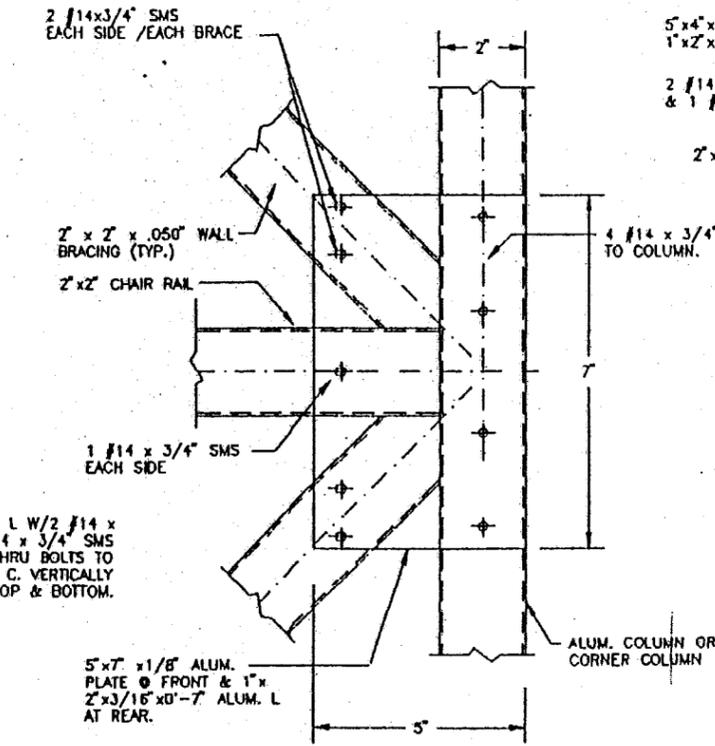

DETAIL B (ELEV.)

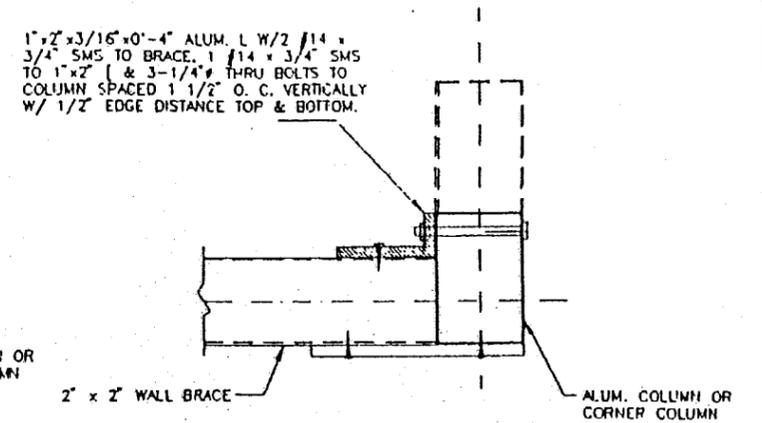

PLAN

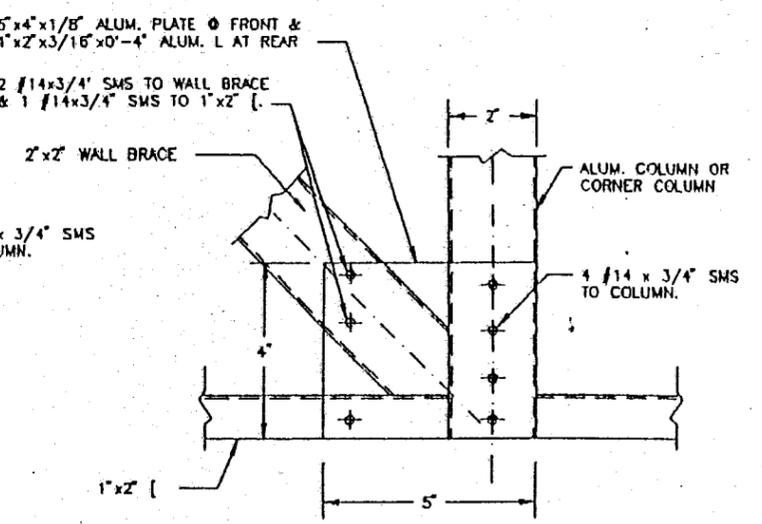

DETAIL C' (ELEV.)




PRODUCT RENEWED
 ACCEPTANCE No. 01-0228-08
 EXPIRATION DATE 03/12/2006
 By Helmut A. Mahr
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

PRODUCT RENEWED
 ACCEPTANCE No. 97-1212.02
 EXPIRATION DATE MARCH 12, 2001
 By Helmut A. Mahr
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE JULY 11, 1996
 BY Helmut A. Mahr
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE No. 96-0506.06

TILECO INC.
 TILT TESTING & ENGINEERING COMPANY
 6595 N.W. 36th St., Ste. 217, MICHIGIA GARDENS, FL 33169
 Phone: (305)871-1530 Fax: (305)871-1531
 WALTER A. TILLI, J., P. E.
 FLORIDA Lic. 44167


SCREEN ENCLOSURE		SCALE	
RECOL ENTERPRISES		9/10/94 DATE	
13280 N.W. 43 AVENUE OPA-LOCKA, FLORIDA 33054		94 - 193	
REV. NO	DESCRIPTION	DATE	REV. NO
1	GENERAL	11/2/95	3
2			4
DRAWING No			SHEET 5 OF 6

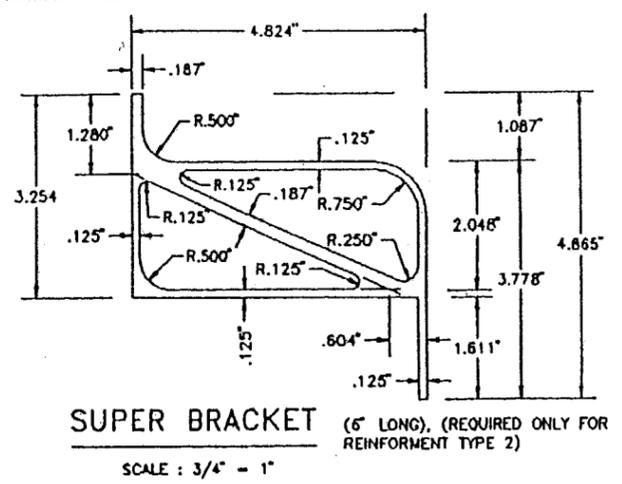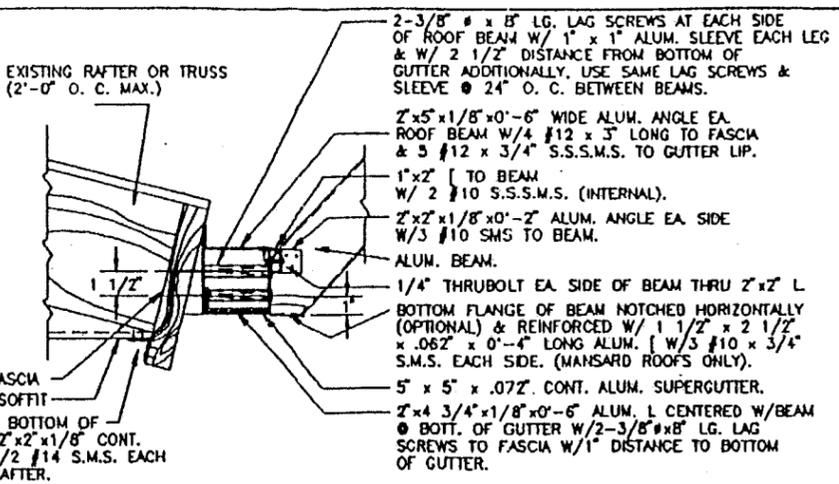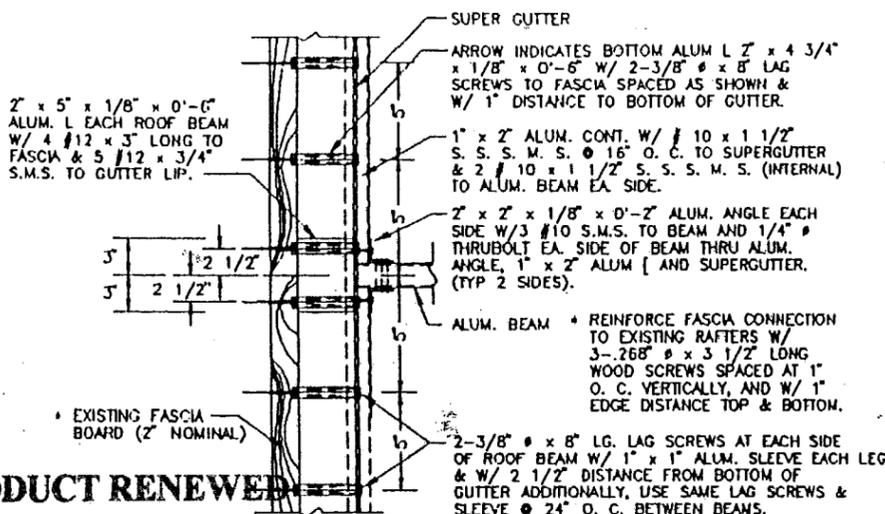

PRODUCT RENEWED
 ACCEPTANCE No. 01-0228.08
 EXPIRATION DATE 03/12/2006
 By *Helmy A. Matar*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

SUPER GUTTER REINFORCEMENT DETAIL TYPE 1

SECTION
SUPER GUTTER CONNECTION DETAIL 5




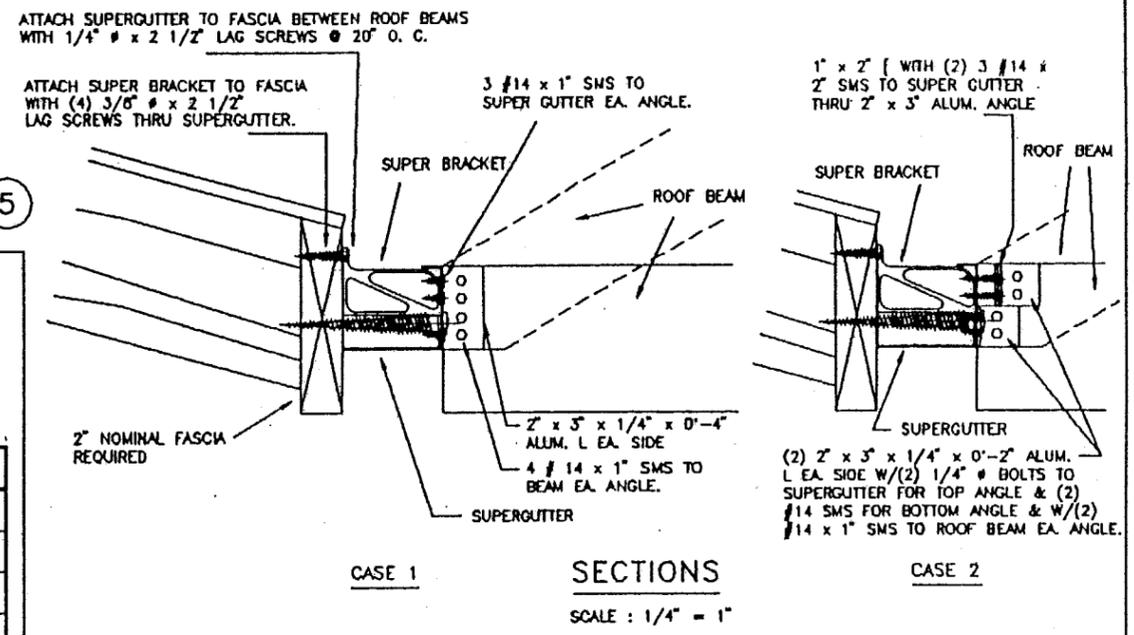


CABLE SCHEDULE **

TOTAL N° OF CABLES REQUIRED AT FRONT WALL
 DISTRIBUTED 50% EA. END

H	L	0'-20'	20'-25'	25'-30'	30'-35'	35'-40'	40'-45'
0'-8'		4	4	4	6	6	6
>8'-9'		4	4	6	6	8	8 *
>9'-10'		4	4	6	6	8 *	10 *
>10'-12'		4	6	6	8 *	10 *	12 *
>12'-14'		6	6	8 *	10 *	12 *	14 *
>14'-15'		6	8 *	10 *	12 *	14 *	14 *

* MAY REQUIRE SPECIAL ENGINEERING OR MAY REQUIRE USE OF K BRACES AS PER SHEET 5 OF 6, SHOULD CABLES DON'T FIT.
 ** USE ONE SET OF CABLES ON RETURN WALLS FOR PROJECTIONS (L) OVER 16 FEET.

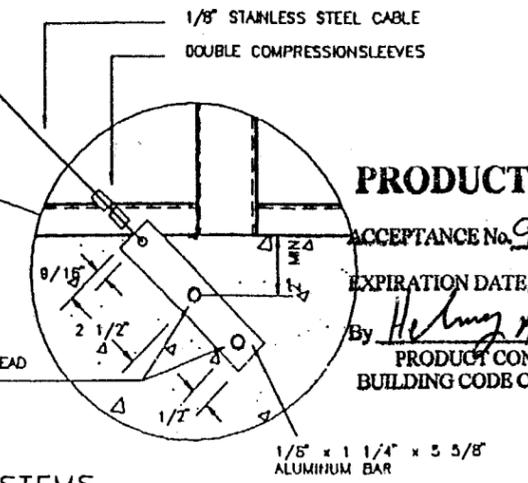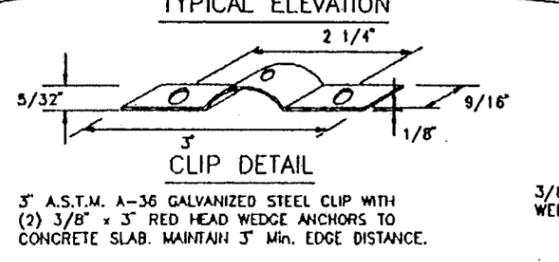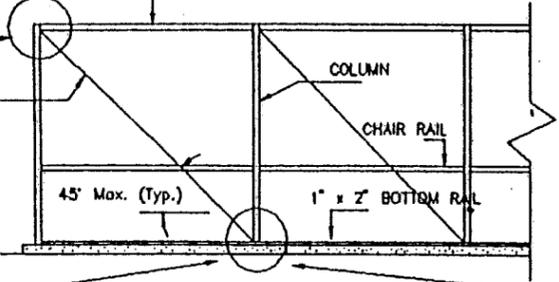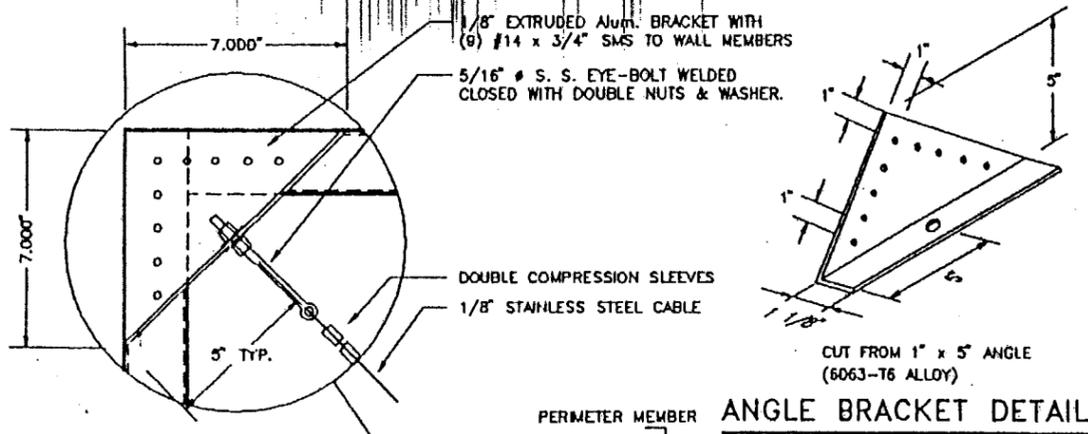

TYPICAL SCREEN WALL CABLE BRACING SYSTEMS

PRODUCT RENEWED
 ACCEPTANCE No. 97-1212.02
 EXPIRATION DATE MARCH 12, 2001
 By *Helmy A. Matar*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

TILECO INC.
 TILLIT TESTING & ENGINEERING COMPANY
 6305 N.W. 34th St., Ste. 217, VARGINA GARDENS, FL 33184
 Phone: (305)871-1530, Fax: (305)871-1531
 WALTER A. TILLIT JR., P. E.
 FLORIDA Lic. 44167

SCREEN ENCLOSURE		AS SHOWN SCALE
RECOL ENTERPRISES		11/6/95 DATE
13280 N.W. 43 AVENUE OPA-LOCKA, FLORIDA 33054		94 - 193 DRAWING No
REV. NO	DESCRIPTION	DATE
1	GENERAL	6/10/94
2		
3		

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE JULY 11, 1996
 BY *Helmy A. Matar*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE No. 96-0506.06