



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Sto Corporation**  
**6175 Riverside Drive, S.W.**  
**Atlanta ,GA 30331**

Your application for Notice of Acceptance (NOA) of:

**Sto Hurricane Impact System HI-G2**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**ACCEPTANCE NO.: 01-0312.04**  
**EXPIRES: 07/19/2006**

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL  
CONDITIONS  
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 07/19/2001**

Sto Corporation.

ACCEPTANCE NO: 01-0312.04

APPROVED: JUL 19 2001

EXPIRES: JUL 19 2006

**NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS**

**1. SCOPE**

- 1.1 This approves an Exterior Insulation and Finish System as described in Section 2 of this Notice of Acceptance (N.O.A.) designed to comply with the South Florida Building Code 1994 Edition for Miami-Dade County (SFBC). For the location where the pressure requirements, as determined by the SFBC Chapter 23 do not exceed the design pressure-rating values indicated in the approved drawing.

**2. PRODUCT DESCRIPTION**

- 2.1 The Sto HI-G2 EIF System and its components shall be constructed in strict compliance with the following documents: Drawing No. Sto HI-G2, sheets 1 through 3 of 3. Titled "Sto HI-G2 EIFS for Large Missile Impact Resistance" prepared by Sto Corporation, dated 12/10/00, with no revisions. They bear the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the Approved Drawing.

**3. LIMITATIONS**

- 3.1 This system is not to be used on horizontal surfaces exposed to weather except as a soffit, it is intended to be used on wall systems only.

**4. INSTALLATION**

- 4.1 The Sto EIFS and its components shall be installed in strict compliance with the approved drawing.  
4.2 The installation of this product does not require Hurricane Protection System.

**5. LABELING**

- 5.1 Each component shall bear a permanent label with the manufacturer's logo, city, state and the following statement "Miami-Dade County Product Control Approved".

**6. BUILDING PERMIT REQUIREMENTS**

- 6.1 Application for Building Permit shall be accompanied by copies of the following:  
6.1.1 This Notice of Acceptance.  
6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this N.O.A.  
6.1.3 Any other document required by the Building Official or the SFBC in order to properly evaluate the installation of this system.



Candido Font PE, Senior Product Control Examiner  
Product Control Division

**Sto Corporation.**

**ACCEPTANCE NO: 01-0312.04**

**APPROVED: JUL 19 2001**

**EXPIRES: JUL 19 2006**

**NOTICE OF ACCEPTANCE STANDARD CONDITIONS**

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test-supporting data, engineering documents, is no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process.
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.



Candido Font PE, Senior Product Control Examiner  
Product Control Division

**END OF THIS ACCEPTANCE**

**Sto Corporation.**

**ACCEPTANCE NO: 01-0312.04**

**APPROVED: JUL 19 2001**

**EXPIRES: JUL 19 2006**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**  
**(For File ONLY. Not part of NOA)**

**A DRAWING**

1. Drawing prepared by Sto Corporation titled "Sto HI-G2 EIFS for Large Missile Impact Resistance", drawing No. Sto HI-G2, Sheets 1 through 3 of 3, dated 12/10/2000, with no revisions, signed and sealed by R. N. Kenney, PE.

**B TEST**

- 1 Test report on Large Missile Impact Test per PA 201, Cyclic Pressure Test per PA 203, Uniform Static Air Test, Air Infiltration Test, Water Leakage Test per PA 202 of "Sto HI-G2 EIFS, system for Large Missile Impact Resistance", prepared by Certified Testing Laboratories, Inc., report No. CTLA 599W, specimens 1, 2, 3 & 4, dated 12/19/2000, signed and sealed by R. Patel, PE.

**C CALCULATIONS.**


- 1 Wind load calculations, sheets 1 through 3, Framing calculations sheets 1 through 52 and Anchorage calculations sheets 1 through 4 for EIFS Wall systems, dated 01/09/01 through 02/09/01 prepared by Cerny & Ivey Engineering, Inc. signed and sealed by R. N. Kenney PE.

**D MATERIAL CERTIFICATION**


- 1 Product Control Notice of Acceptance No. 98-0904.04 issued to Apache Products Company on 11/26/98 and expiring on 01/11/02.

**E STATEMENTS.**

- 1 Engineering evaluation letter prepared by Cerny & Ivey Engineers, Inc. on 02/28/2001, signed and sealed R. N. Kenney, PE.

  
\_\_\_\_\_  
Candido Font PE, Senior Product Control Examiner  
Product Control Division


E1

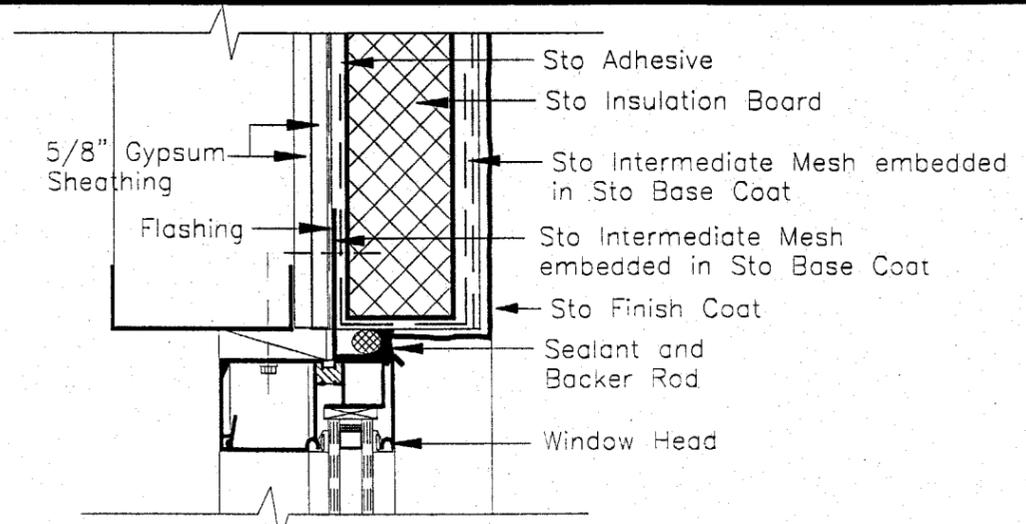

**Notes:**

1. Provide minimum 3/4" (19 mm) depth from back of insulation board to face of window frame for sufficient depth to install sealant.
2. Provide minimum 1/2" (13 mm) sealant joint width.
3. Provide flashing as secondary barrier at sealant joint when called for by design professional.


**WINDOW HEAD**  
N.T.S.

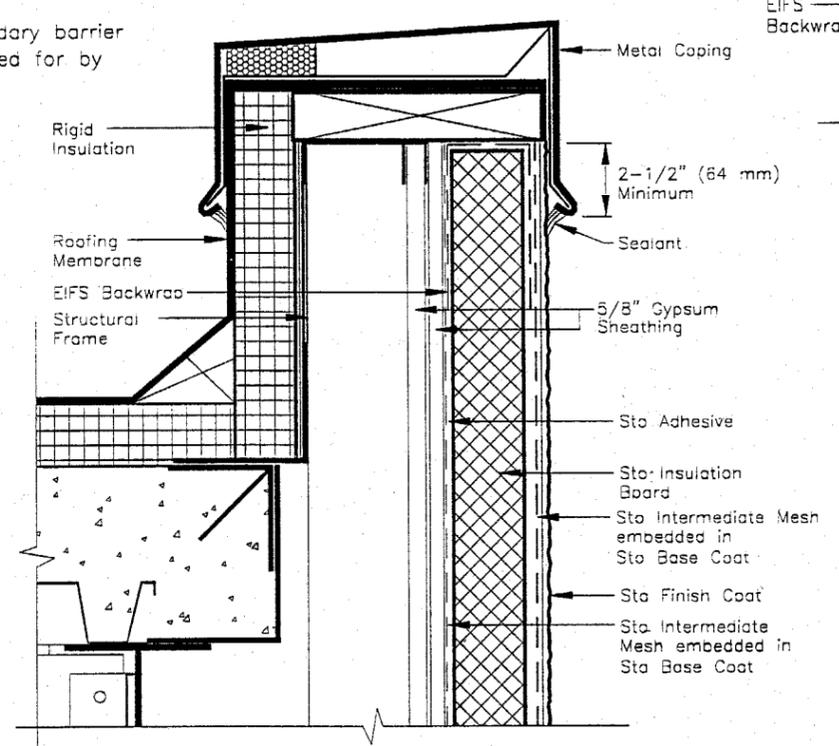

**Notes:**

1. Protect exposed EIF System at parapet from weather damage during construction until permanently protected with coping.
2. Extend dimension of coping overlap for multi-story construction/coastal regions to prevent wind driven rain from entering behind system.


**PARAPET**  
N.T.S.

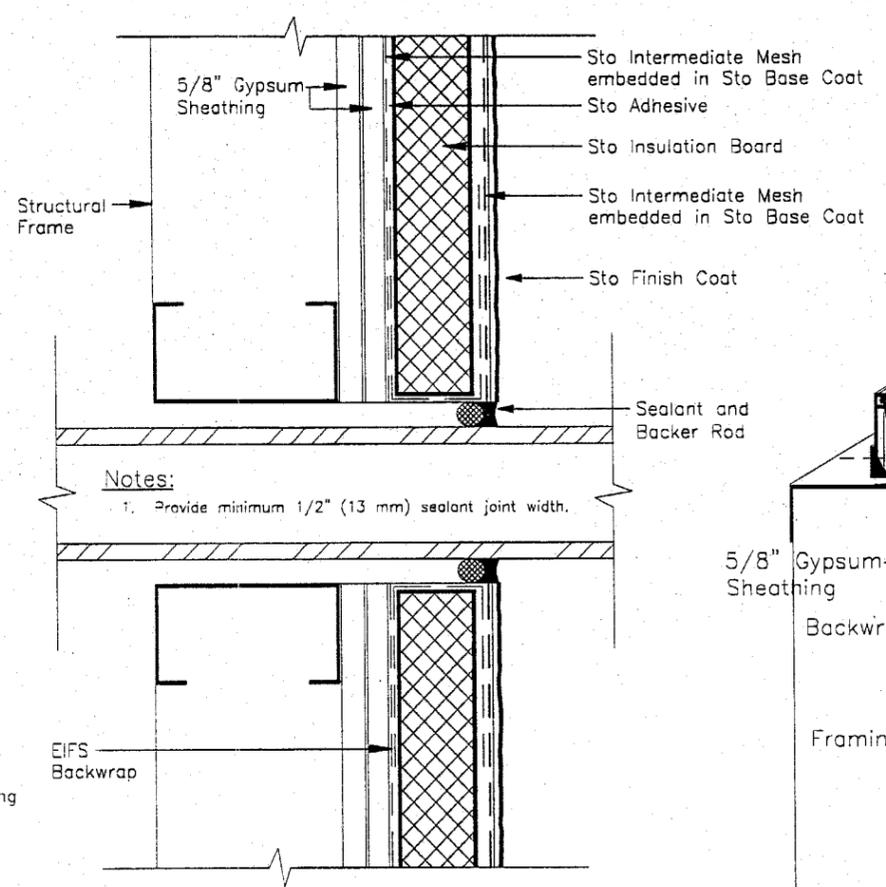

**Notes:**

1. Provide minimum 1/2" (13 mm) sealant joint width.

**TERMINATION AT PENETRATION**  
N.T.S.

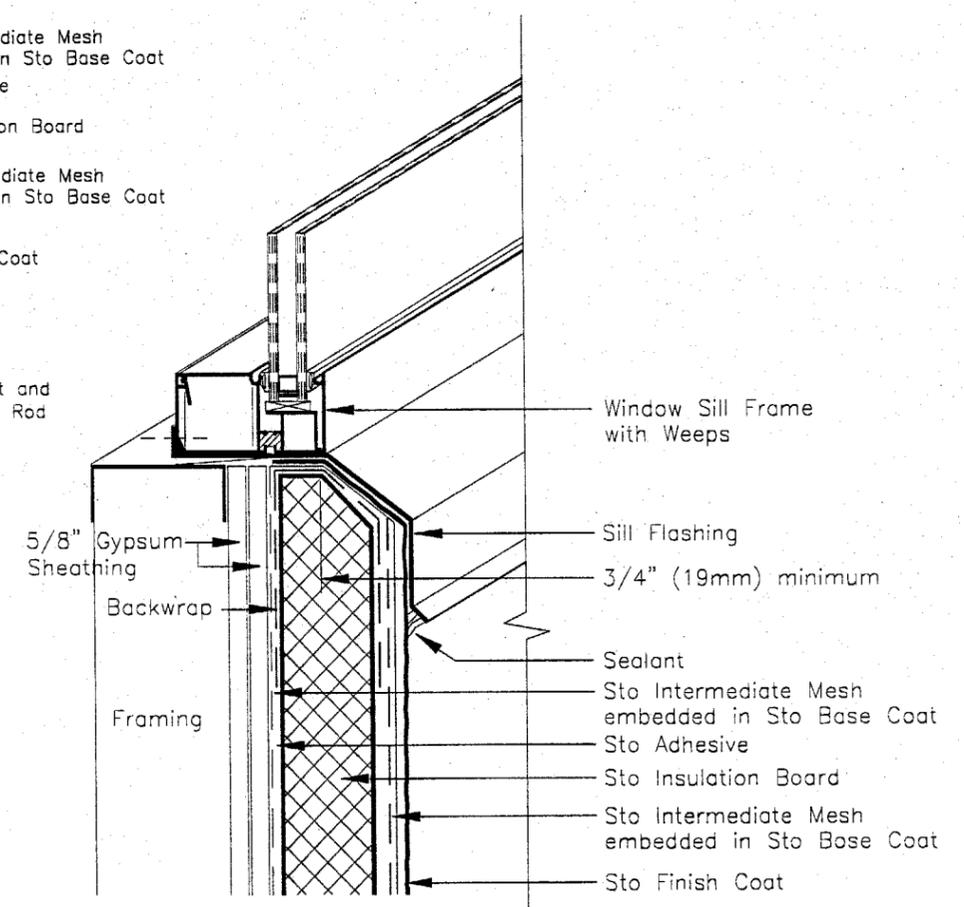

**Notes:**

1. Protect exposed EIF System at sill from weather damage during construction until permanently protected with sill and sealant.
2. Pan up flashing @ jamb.

**WINDOW SILL**  
N.T.S.


**TYPICAL DETAILS**

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE JUL 19 2001  
BY [Signature]  
PROJECT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0312.04

*Robert Kenney*  
C/2/01

**Sto Corp.**  
3800 Camp Creek Parkway  
Building 1400, Suite 120  
Atlanta, Ga. 30331  
Sto HI-G2 EIFS  
for  
**Large Missile Impact Resistance**  
Drawing no. Sto HI-G2  
Page No. 3 of 3  
Date: 12/10/2000  
Not to Scale


**CERNY & IVEY ENGINEERS, INC.**  
CONSULTING ENGINEERS TESTING LABORATORY  
5300 PEACHTREE PARKWAY, NORCROSS, GA 30052  
(770)-445-8833 • FAX (770)-445-1162

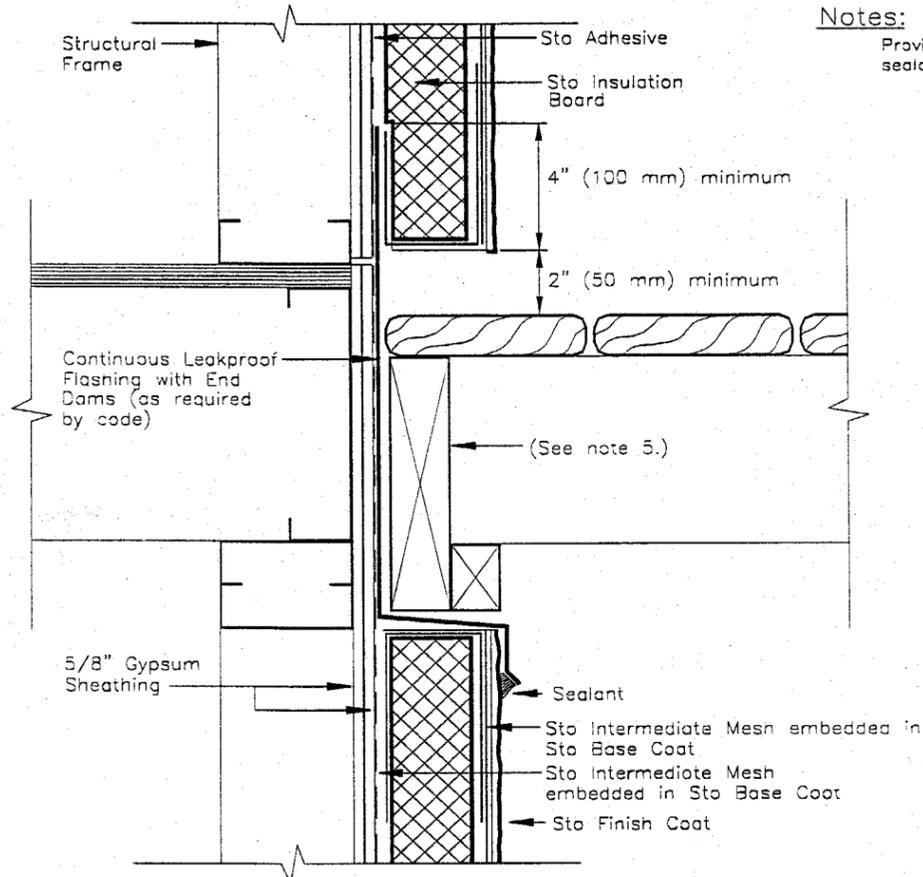


**TERMINATION AT DECK**  
N.T.S.

**Notes:**

Provide minimum 3/4" (19 mm) sealant joint width.

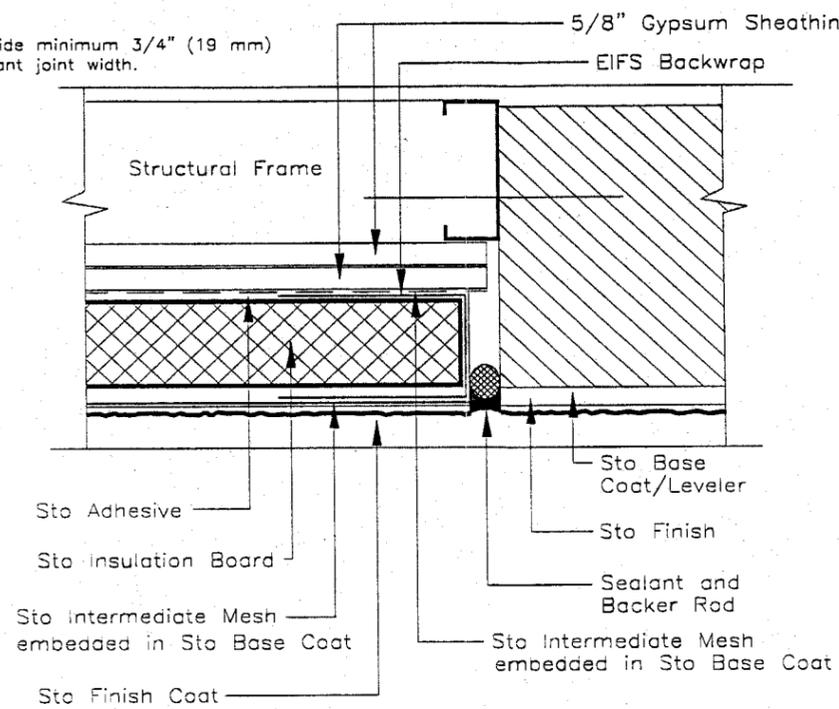


**CONSTRUCTION JOINT**  
N.T.S.

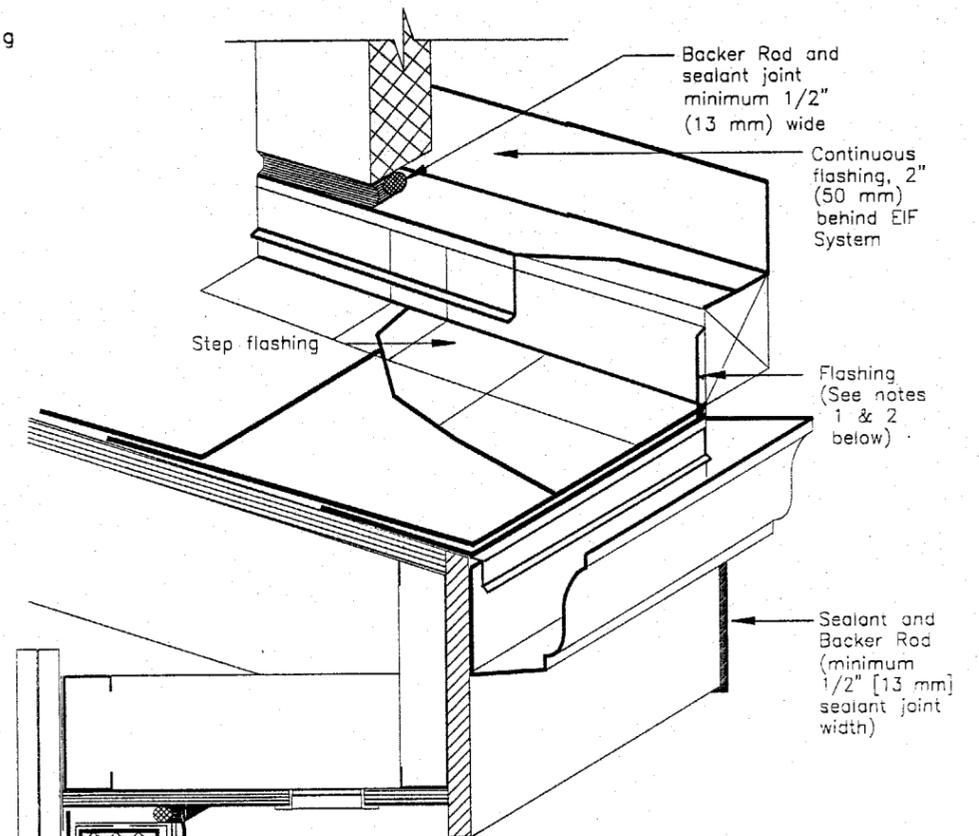

**OVERHANG**  
N.T.S.

**Notes:**

1. Provide continuous leakproof flashing (as required by code) to divert water from entering into wall system.
2. Seal EIFS termination to the diverter flashing to prevent water from penetrating behind EIFS.


APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE **JUL 19 2001**  
BY   
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. **01-0312.04**

**Sto Corp.**  
3800 Camp Creek Parkway  
Building 1400, Suite 120  
Atlanta, Ga. 30331  
Sto HI-G2 EIFS  
for  
Large Missile Impact Resistance  
Drawing no. Sto HI-G2  
Page No. 2 of 3  
Date: 12/10/2000  
Not to Scale

**Notes:**

1. Gap wood sheathing edge and end joints in accordance with APA (American Plywood Association) recommendations.
2. Seal penetrations through flashing where attached to framing.
3. Distance of EIFS to deck varies with climate. Allow sufficient distance to prevent snow/ice and puddling water against system.
4. Provide end dams where flashings terminate at ends of deck.
5. Pressure treated wood (space from flashing or rout backside to provide drainage).

**TYPICAL DETAILS**

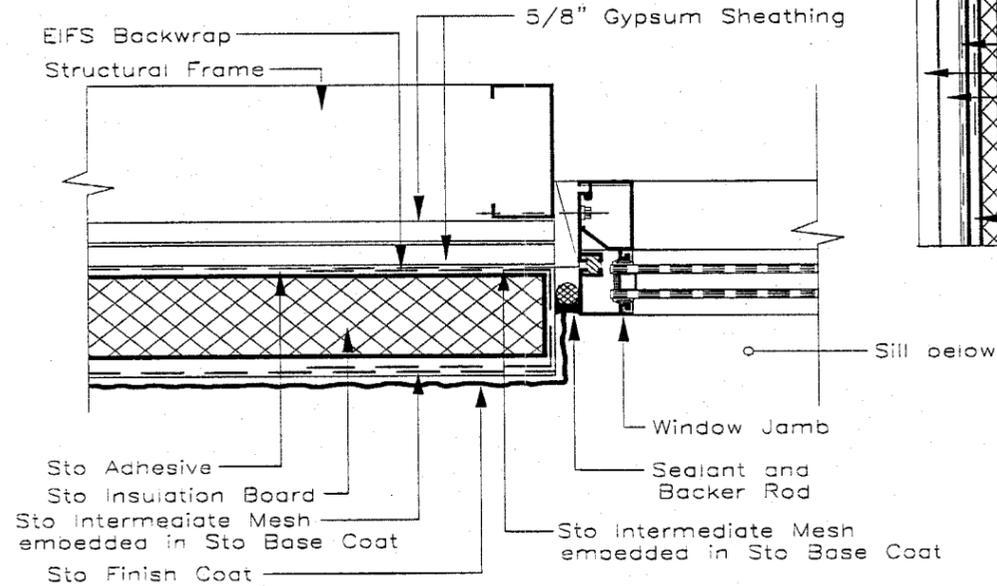

**Notes:**

1. Provide minimum 3/4" (19 mm) depth from back of insulation board to face of window frame for sufficient depth to install sealant.
2. Provide minimum 1/2" (13 mm) sealant joint width.

**WINDOW JAMB**  
N.T.S.


**CERNY & IVEY ENGINEERS, INC.**  
CONSULTING ENGINEERS TESTING LABORATORY  
4520 PEACOCK PARKWAY, NORCROSS, GA 30052  
(770) 448-8888 • FAX (770) 448-1140

**DESCRIPTION**

- 1.1 Substrates approved with the system
- 1.1.1. Minimum 3-5/8" x 1-5/8" x 18 ga. Steel studs @ 16" o.c. First layer of sheathing fastened with "sufficient" fasteners #6 x 1" drywall screws to hold it in place. Second layer fastened with minimum #6 x 1-5/8" type S-12 corrosion resistant bugle head fasteners 8" o.c. along vertical studs.
  - 1.1.2. Sto insulation (Apache) EPS Expanded Polystyrene insulation minimum 2" thick with a density of 1PCF as approved by Dade County NOA# 98-0904.04
  - 1.1.3. Sto Primer/Adhesive-B (No. 101) or Sto BTS-Plus (No.727) are polymer modified cement based materials used as adhesives and base coats in Sto systems
  - 1.1.4. Sto Intermediate (11.0 oz/sq. yd.) Mesh (No. 918) is a glass fiber fabric used for impact resistance of the Sto systems
  - 1.1.5. Sto textured finishes (No. 310, 306, and 307) are ready mixed acrylic-based exterior or interior textured finishes, used as decoration and protection with the Sto systems. Three (3) are available: Fine Sand, Medium Sand, and Swirl
- 1.2 Application
- 1.2.1. The exposed gypsum surface is cleaned to remove any bond inhibiting particles from the surface of the gypsum.
  - 1.2.2. The Sto Primer/Adhesive-B or Sto BTS-Plus are mixed with 6-8 quarts of water using a clean rust free high speed electric drill and paddle. The mixture is allowed to set for approximately 5 minutes and then remixed to a uniform consistency. A 1/16" thick layer is applied to the exposed surface of the gypsum sheathing.
  - 1.2.3. The Sto Intermediate Mesh is embedded in the wet base coat by troweling from the center to the edges of the mesh and the excess base coat is removed. This process is repeated until the entire exposed area of the sheathing board is covered with mesh. The application is allowed to dry before proceeding to the next step.
  - 1.2.4. The Sto base coats are mixed as noted in 1.2.2. The mixture is applied to the back of the Sto (Apache) insulation board using a 1/2" x 1/2" U-notched trowel. Uniform ribbons of adhesive are formed on the Sto (Apache) insulation board parallel to the short dimension of the board.
  - 1.2.5. The Sto (Apache) insulation board minimum 2" thick is applied to the wall surface horizontally with staggered joints. Uniform pressure is applied to the insulation board to ensure proper adhesion to the surface. Once the entire surface of the wall is covered with the insulation board, it is left overnight to cure.
  - 1.2.6. The Sto base coats are mixed as noted in 1.2.2. A 1/16" thick layer is applied to the exposed surface of the STO (Apache) insulation board using a stainless steel trowel.
  - 1.2.7. Sto Intermediate Mesh is embedded in the wet base coat by troweling from the center to the edges of the mesh and the excess base coat is removed. This process is repeated until the entire exposed area of the insulation board is covered with mesh. Once covered, it is allowed to dry for a minimum of 12 hours.
  - 1.2.8. Once the mesh reinforcing coats are dry and cured, a minimum 1/16" coat of Sto textured finish is applied to the entire surface.

**GENERAL NOTES:**

- 1) This system has been designed in accordance with the South Florida Building Code 1994 Edition and its latest supplements.
- 2) This system has been tested in accordance with the Dade County Protocol PA-201, PA-202 and PA-203 Impact, Structural and Cyclic Testing.
- 3) This System shall be applied by a licensed plastering contractor following the recommendations of Sto Corp, this notice of acceptance and the applicable sections of the South Florida Building Code.
- 4) The engineer and/or architect of record for each project using this system shall size all stud framing to ensure conformance with stud deflection and stress limitations as required by governing codes and this document.
- 5) Insulation boards shall be placed in a running bond pattern.
- 6) All studs used with this system shall be completely sheathed at the interior flange or bridged at maximum every 5 ft. of stud length or as specified by stud manufacturer.
- 7) All Steel studs shall be structural with 1-5/8" min. flange width and have minimum yield strength of 33000 PSI.
- 8) Details on sheets 2 and 3 of 3 are typical and show intent to prevent water infiltration into and behind this system. Alternate detailing and specific conditions not covered by the typical details are the responsibility of the licensed design professional in consultation with Sto Corporation.

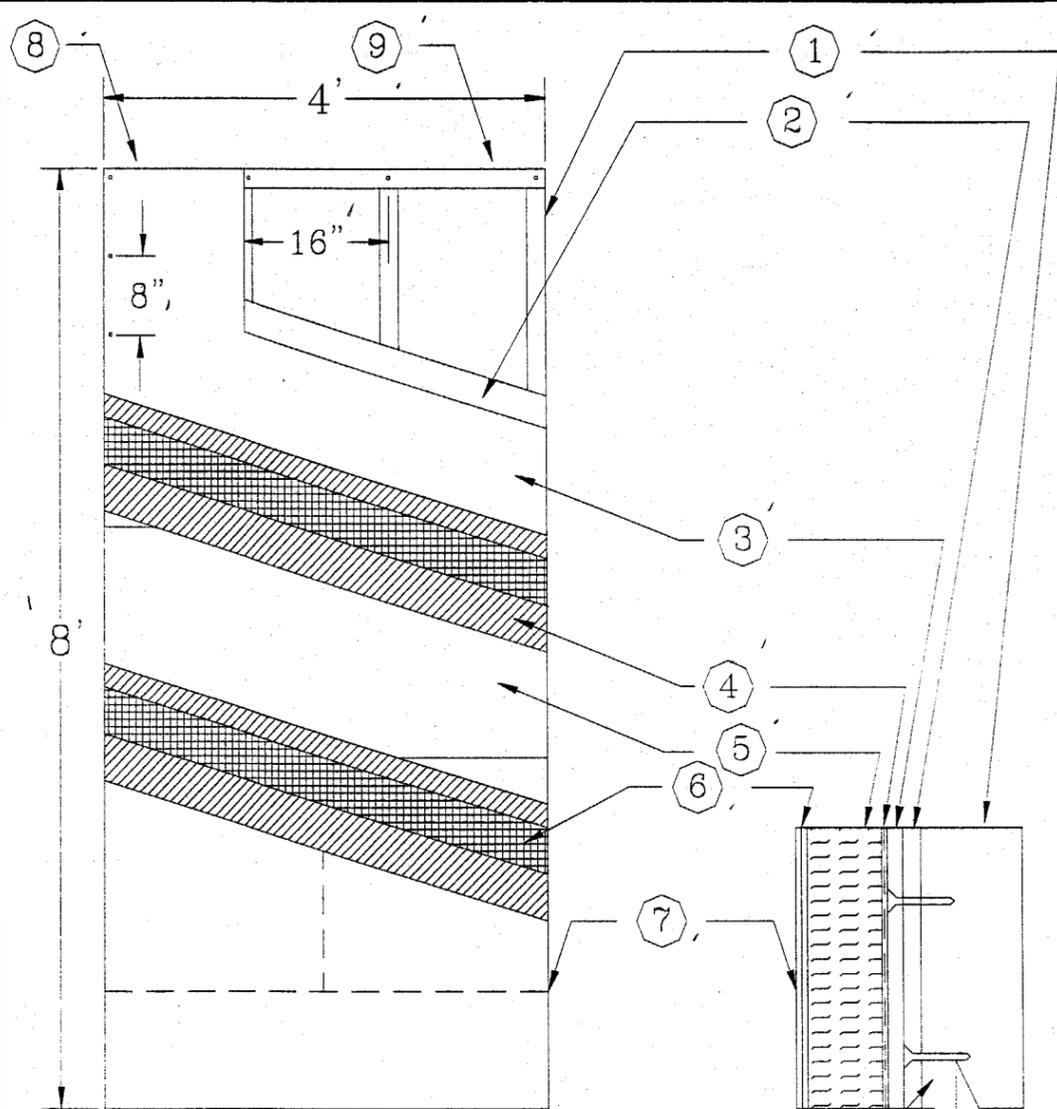

**KEY:**

- 1. 3-5/8" 18ga. Steel Studs @ 16" o.c.
- 2. 5/8" Exterior Grade Gyp Sheathing (ASTM C79)
- 3. 5/8" Exterior Grade Gyp Sheathing (ASTM C79)
- 4. Sto Primer/Adhesive-B (No. 101) or Sto BTS-Plus (No.727) with Sto Intermediate Mesh (No. 918) embedded (11.0 oz/sq. yd.)
- 5. EPS Board @ minimum 2" Thick & 1 PCF by Apache
- 6. Sto Primer/Adhesive-B (No. 101) or Sto BTS-Plus (No.727) with Sto Intermediate Mesh (No. 918) embedded (11.0 oz/sq. yd.)
- 7. Sto Textured Finish (No. 310, 306, and 307)
- 8. Fasteners: First layer of sheathing fastened with "sufficient" #6 x 1" drywall screws to hold it in place. Second layer fastened with minimum #8 or #6 x 1-5/8" type S-12 corrosion resistant bugle head fasteners @ 8" o.c. along vertical studs.
- 9. U Channel on head & sill secured to vertical studs with 1/2" SMS inboard & outboard.

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE **JUL 19 2001**  
BY *[Signature]*  
FRANK J. KENNEDY  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0312.04

**Design Pressure Rating**  
**+125/-125 PSF with # 8 Fastener**  
**Large Missile**  
**Impact Resistance**

*Robert Kenney*  
6/24/01

**Sto Corp.**  
3800 Camp Creek Parkway  
Building 1400, Suite 120  
Atlanta, Ga. 30331  
Sto HI-G2 EIFS  
for  
**Large Missile Impact Resistance**  
Drawing no. Sto HI-G2  
Page No. 1 of 3  
Date: 12/10/2000  
Not to Scale

**CERNY & IVEY ENGINEERS, INC.**  
CONSULTING ENGINEERS TESTING LABORATORY  
5555 PEACOCK PARKWAY, NORCROSS, GA 30062  
17701-668-8888 • FAX 17701-255-1163