



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Platinum Industries Inc.**  
**917 North Railroad Ave.**  
**West Palm Beach ,FL 33401**

Your application for Notice of Acceptance (NOA) of:

**"Mahogany" Outswing Wood Casement Window - Impact Resistant**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**ACCEPTANCE NO.: 01-0312.05**  
**EXPIRES: 03/26/2006**

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL  
CONDITIONS  
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 05/24/2001**

Platinum Industries, Inc.

ACCEPTANCE No.: 01-0312.05

APPROVED : MAY 24 2001

EXPIRES : March 26, 2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

**1. SCOPE**

- 1.1 This **revises and renews** the Notice of Acceptance No. 97-0903.03 which was issued on March 26, 1998. It approves a wood casement window, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

**2. PRODUCT DESCRIPTION**

- 2.1 The **"Mahogany" Outswing Wood Casement Window – Impact Resistant** and its components shall be constructed in strict compliance with the following documents: Drawing No W-1 Sheets 1 through 7 of 7, titled "Mulled Mahogany Casement", prepared by manufacturer, dated 02/26/01, signed and sealed by Stephen M. Sinclair P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

**3. LIMITATIONS**

- 3.1 This approval applies to single unit applications and side-by-side installations, as shown in approved drawings.

**4. INSTALLATION**


- 4.1 The wood casement window and its components shall be installed in strict compliance with the approved drawings.
- 4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.

**5. LABELING**

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

**6. BUILDING PERMIT REQUIREMENTS**

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

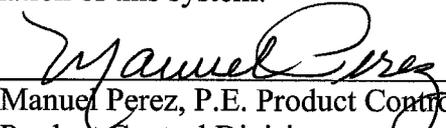  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

**Platinum Industries, Inc.**


**ACCEPTANCE No.:** 01-0312.05

**APPROVED** : MAY 24 2001

**EXPIRES** : March 26, 2006

**NOTICE OF ACCEPTANCE: STANDARD CONDITIONS**

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process.
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

**END OF THIS ACCEPTANCE**

Platinum Industries, Inc.

ACCEPTANCE No.: 01-0312.05

APPROVED : MAY 24 2001

EXPIRES : March 26, 2006

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

*(For File ONLY. Not part of NOA.)*

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No No **W-1** Sheets 1 through 7 of 7, titled "Mulled Mahogany Casement", prepared by manufacturer, dated 02/26/01, signed and sealed by Stephen M. Sinclair P.E.

**B. TESTS**

*(Submitted under previous approval #97-0903.03)*


1. Test reports on
  - 1) Air Infiltration Test, per PA 202-94
  - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
  - 3) Water Resistance Test, per PA 202-94
  - 4) Large Missile Impact Test per SFBC, PA 201-94
  - 5) Cyclic Wind Pressure Loading per SFBC, PA 203-94
  - 6) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94along with marked-up drawings and installation diagram of mulled wood casement windows with 5/8" "Safety Plus" laminated glass by Glasslam, prepared by Hurricane Engineering and Testing, Inc., Test Report No. **HETI-97-1093**, dated 03/13/97, signed and sealed by Hector M. Marshall, P.E.

*(Submitted for revision of NOA #97-0903.03, under previous file #00-0225.01)*

2. Test reports on
  - 1) Air Infiltration Test, per PA 202-94
  - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
  - 3) Water Resistance Test, per PA 202-94
  - 4) Large Missile Impact Test per SFBC, PA 201-94
  - 5) Cyclic Wind Pressure Loading per SFBC, PA 203-94
  - 6) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94along with marked-up drawings and installation diagram of mulled wood casement windows with 7/16" "Wind-Pane Series CT" laminated glass by Globe Amerada, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0137-0402-98**, dated 04/13/98, signed and sealed by Timothy S. Marshall, P.E.
3. Test reports on
  - 1) Large Missile Impact Test per SFBC, PA 201-94
  - 2) Cyclic Wind Pressure Loading per SFBC, PA 203-94along with marked-up drawings and installation diagram of single wood casement windows with 7/16" "Safety Plus" laminated glass, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0137-0606-97**, dated 06/09/97, signed and sealed by Timothy S. Marshall, P.E.

**C. CALCULATIONS**

1. Anchor calculations for Wood Casement Window prepared by Robert J. Kraft P.E. dated 01/14/98 and signed and sealed by Robert J. Kraft P. E.

  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

Platinum Industries, Inc.

ACCEPTANCE No.: 01-0312.05

APPROVED : MAY 24 2001

EXPIRES : March 26, 2006

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

*(For File ONLY. Not part of NOA.)*

**D. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **97-0527.04** issued to Nebula Glass International Inc. for "Glasslam Safety-Plus Laminated Glass" dated 09/09/97, expiring on 09/09/00.
2. Notice of Acceptance No. **97-1224.07** issued to Solutia Inc. for "Polyvinyl Butyral Interlayer Saflex" dated 06/25/98, expiring on 01/09/00.

**E. STATEMENTS**

1. Letter by Platinum Industries Inc., stating what the revision consists of.
2. Laboratory compliance letter for Test Report no. HTL-0137-0402-98, issued by Hurricane Test Laboratory, Inc., dated 04/13/98, signed and sealed by Timothy S. Marshall, P.E.
3. Letter by Platinum Industries Inc., stating that Sinclair Engineering Company has no affiliation with Platinum Industries or with the lab that performed the wind testing on the subject window assemblies.

**F. OTHER**

1. Notice of Acceptance No. **97-0903.03**, issued to Platinum Industries Inc. for their Outswing Casement Window, approved on 03/26/98 and expiring on 03/26/01.

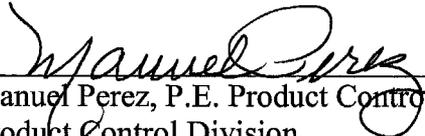  
\_\_\_\_\_  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

**Platinum Industries, Inc.**

**ACCEPTANCE No.:** 01-0312.05

**APPROVED** : MAY 24 2001


**EXPIRES** : March 26, 2006


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**  
*(For File ONLY. Not part of NOA.)*

**TESTS PERFORMED**

**RESULTS:**

TEST	TEST LOADS	DESIGN LOADS
AIR INFILTRATION @ 1.57 PSF PA 202-94 (0.34 CFM/FT)	0.006 CFM/FT HETI 97-1091	-----
UNIFORM STATIC PRESSURE AT DESIGN LOAD PA 202-94 POSITIVE	+70.0 PSF HETI 97-1091	+70.0 PSF HETI 97-1091
UNIFORM STATIC PRESSURE AT DESIGN LOAD PA 202-94 NEGATIVE	-70.0 PSF HETI 97-1091	-70.0 PSF HETI 97-1091
WATER RESISTANCE (PSF) PA 202-94 (NO LEAKAGE)	+15.0 PSF HETI 97-1091	+100.0 PSF HETI 97-1091
UNIFORM STATIC PRESSURE AT FULL TEST LOAD PA 202-94 POSITIVE 30 Seconds	+105.0PSF HETI 97-1091	+70.0 PSF HETI 97-1091
UNIFORM STATIC PRESSURE AT FULL TEST LOAD PA 202-94 NEGATIVE 30 Seconds	-105.0 PSF HETI 97-1091	-70.0 PSF HETI 97-1091
FORCED ENTRY RESISTANCE (FER) ASTM F-588	SATISFACTORY HETI 97-1091	-----
LARGE MISSILE IMPACT PA 201-94	SATISFACTORY HTL-0137-0606-97	-----
CYCLIC WIND PRESSURE PA 203-94 POSITIVE	+90.0 PSF HTL-0137-0606-97	+90.0 PSF HTL-0137-0606-97
CYCLIC WIND PRESSURE PA 203-94 NEGATIVE	-90.0 PSF HTL-0137-0606-97	-90.0 PSF HTL-0137-0606-97
Design Pressure Rating (Positive)		+70.0 PSF
Design Pressure Rating (Negative)		-70.0 PSF

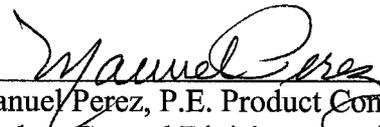
  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

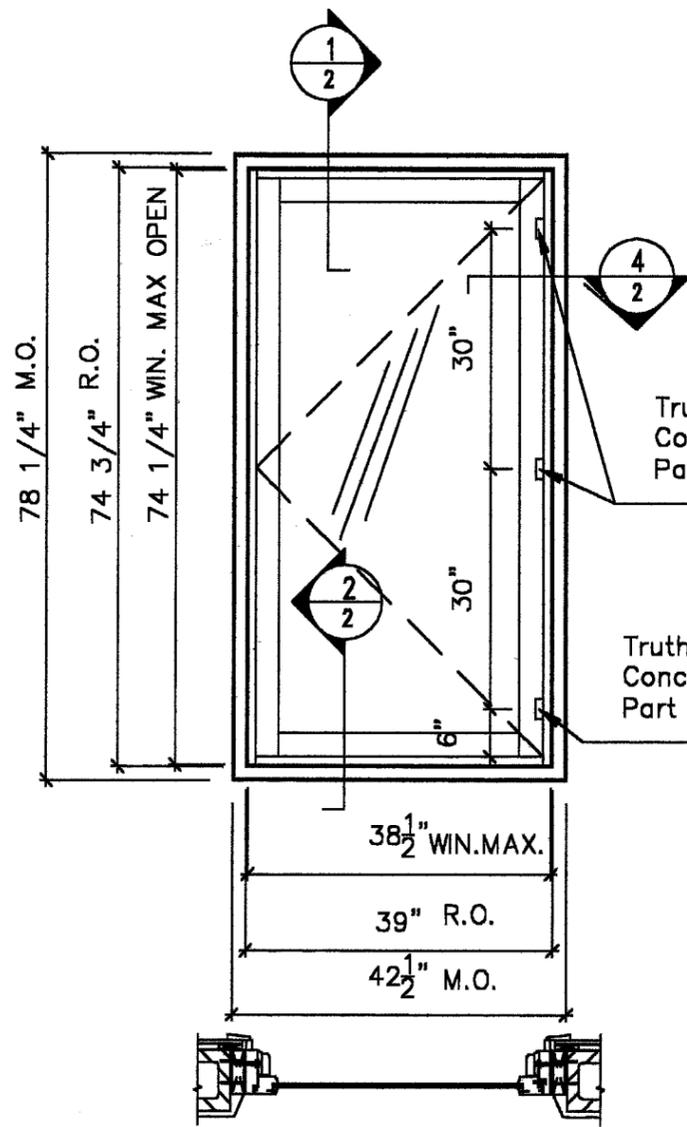

Truth Hardware Secondary  
Concealed Sash Lock  
Part # 16.34.00

Truth Hardware Primary  
Concealed Sash Lock  
Part # 16.33.03

① SINGLE CASEMENT WINDOW  
scale: 1/2" = 1'-0"

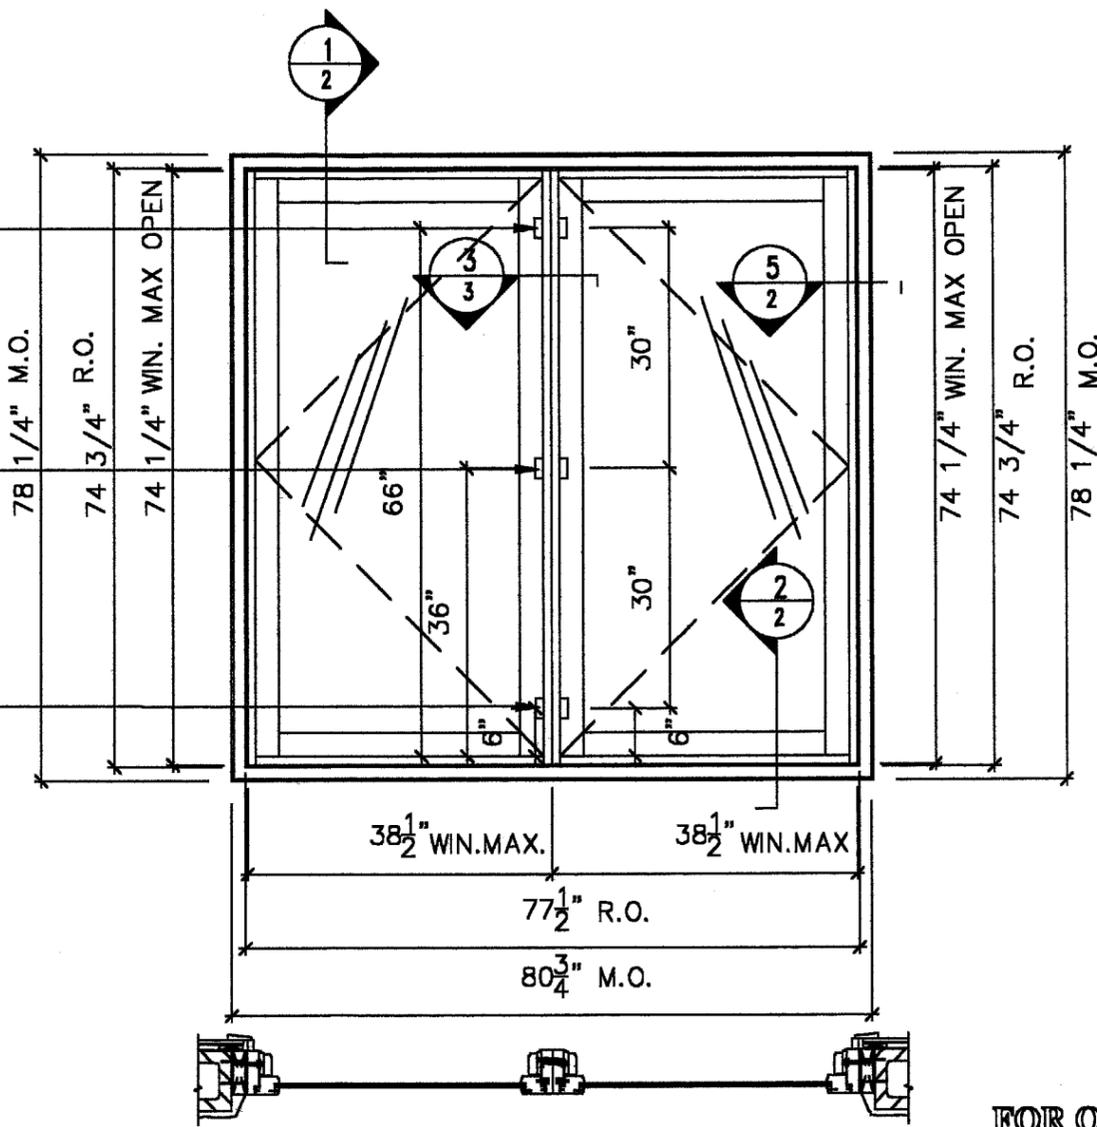

② DOUBLE CASEMENT WINDOW  
scale: 1/2" = 1'-0"

NOTE: FOR OTHER APPROVED CONFIGURATIONS  
SEE SHEET NUMBER 6 OF 7

FOR OFFICIAL USE ONLY

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE MAY 24 2001  
BY Manuel Cruz  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO 01-0312.05

SINCLAIR ENGINEERING  
3114 45th STREET, SUITE 3  
WPB, FLORIDA 33407  
TEL. (561) 640-7144  
FL. Lic. # 35631

**Mulled Mahogany Casement  
WINDOW ELEVATION**

**PLATINUM INDUSTRIES INC.**  
917 NORTH RAILROAD AVENUE WEST PALM BEACH, FLORIDA  
PHONE 561-829-1377 FAX 561-655-4418

DRAWN  
VSO

DATE  
02-26-2001

SCALE  
1/2" = 1'0"




SHEET  
**W-1**  
1 OF 7 SHEETS

*Manuel Cruz*  
MAR 05 2001

01-0312.05


**HARDWARE AND WEATHERSTRIPING PER UNIT:**

Quantity	Location	Description
1	5 11/16" away from lower corner of window frame on sill member.	Truth Hardware Entry Gard Casement Dual-Arm Operator, part # 15.10.00
1	Window frame sill	Truth Hardware EntryGard Operator bracket, part # S/A 10339.92
1	Window frame sill.	Truth Hardware EntryGard Operator track, part # 30473.92.
1	On jamb of window frame, located 6" above bottom edge of window frame.	Truth Hardware Primary concealed sash lock, part # 16.33.03.
2	On jamb of window frame, located 36" and 66" above bottom edge of window frame.	Truth hardware Secondary concealed sash lock, part # 16.34.00.
3	Located on stile of window sash 6", 36", 66", away from bottom edge of sash.	Oliveri Woodworks brass keepers.
2	Jamb of window frame.	Truth Hardware tie bars, part # 10346.
2	Head and sill of window frame.	Anderberg Manufacturing 12" long, four bar, stainless steel hinge, part # 34.55.00.
18lf.	Used on all four sides of frame for a positive seal between frame and sash.	Schlegel Q-Lon QDS-650 cellular modified foam core clad in an embossed, non-vinyl paint resistant liner which is U.V. stabilized.
3lf.	Bottom edge of sash	Schlegel # 1556-8601-D Kerf Pile Brush.
15lf.	Top Rail & Stiles of sash.	Schlegel O-Lon QEZ-320 seal.

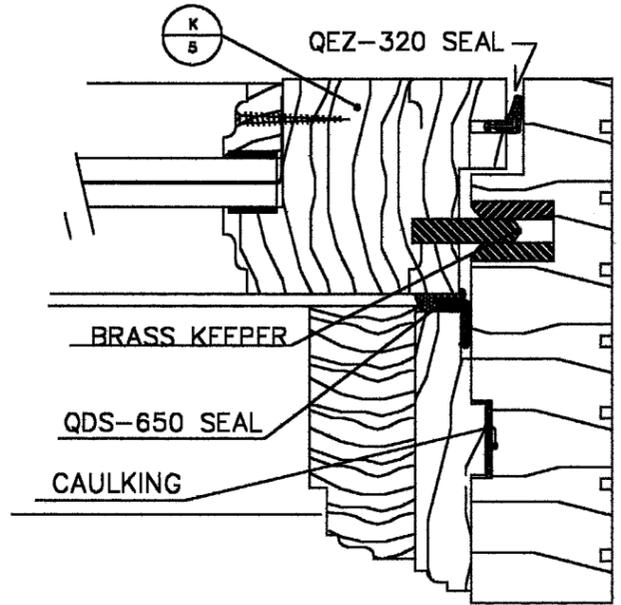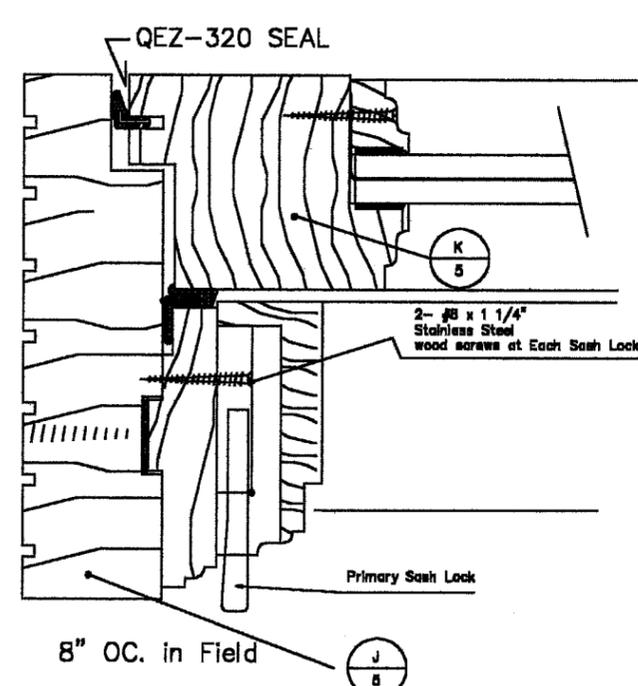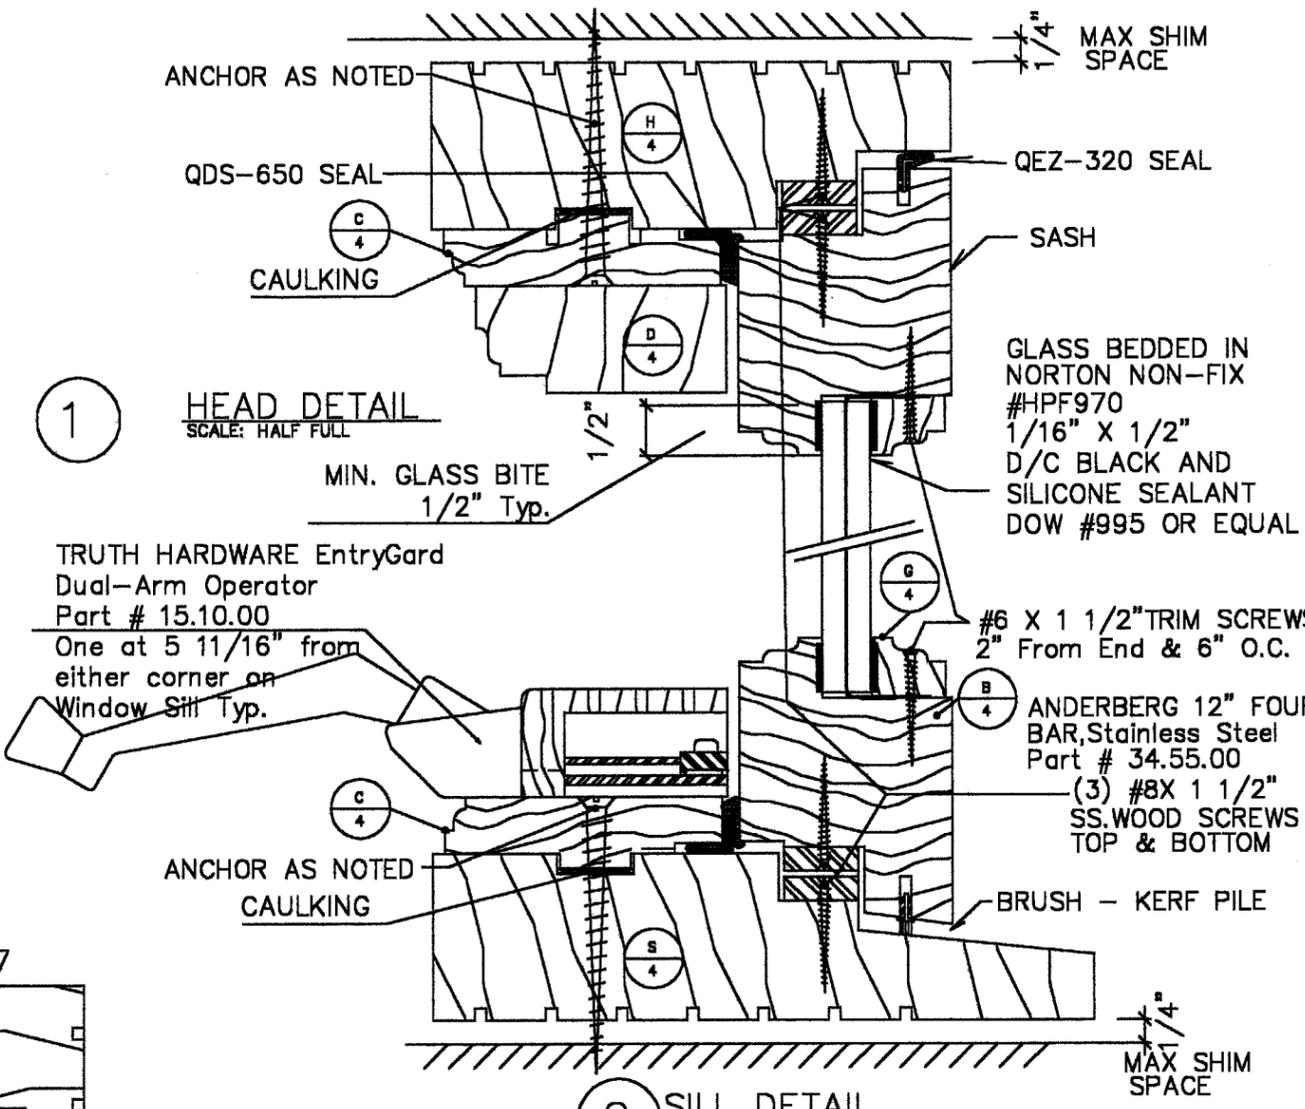

**5 JAMB SECTION Lock Side**  
SCALE: HALF FULL

**4 JAMB SECTION Hinge Side**  
SCALE: HALF FULL

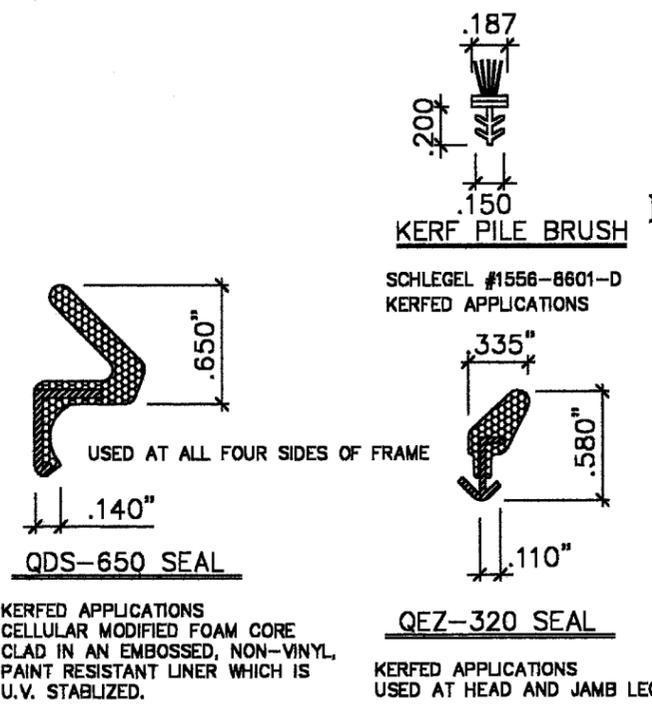

**FOR OFFICIAL USE ONLY**

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE **MAY 24 2001**  
BY *Maurice Perry*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0312.05

**Mahogany Casement**

**PLATINUM INDUSTRIES INC.**

917 NORTH RAILROAD AVENUE WEST PALM BEACH, FLORIDA  
PHONE 561-829-1377 FAX 561-655-4418

---

SINCLAIR ENGINEERING  
3114 45th STREET, SUITE 3  
WPB, FLORIDA 33407  
TEL. (561) 640-7144  
Fl. Lic. # 356631

*M. Perry*

---

DRAWN  
VSO


DATE  
02-26-2001

SCALE  
1/2" = 1'0"

SHEET  
**W-1**

2 OF 7 SHEETS

MAR 05 2001

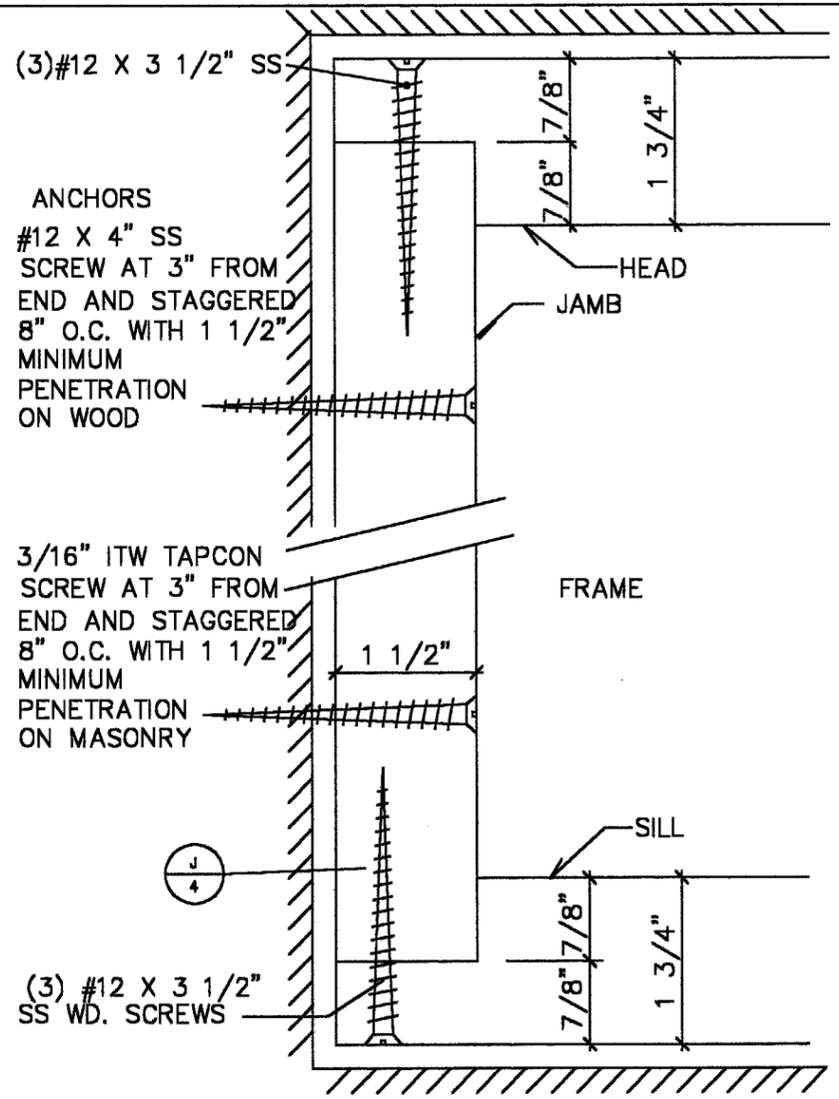


(3) #12 X 3 1/2" SS  
 ANCHORS  
 #12 X 4" SS  
 SCREW AT 3" FROM  
 END AND STAGGERED  
 8" O.C. WITH 1 1/2"  
 MINIMUM  
 PENETRATION  
 ON WOOD

3/16" ITW TAPCON  
 SCREW AT 3" FROM  
 END AND STAGGERED  
 8" O.C. WITH 1 1/2"  
 MINIMUM  
 PENETRATION  
 ON MASONRY

(3) #12 X 3 1/2"  
 SS WD. SCREWS

**7 CORNER DETAILS**  
 SCALE: HALF FULL

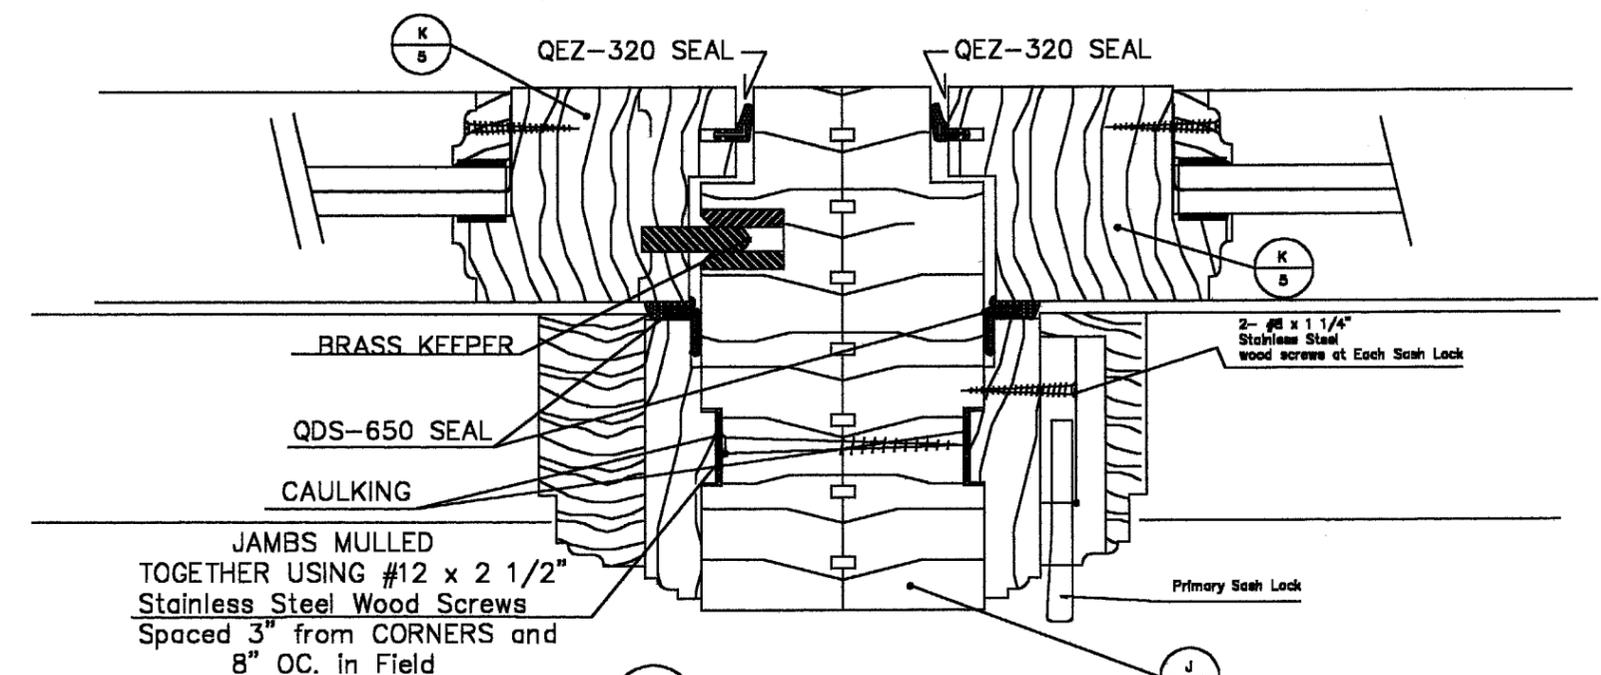

JAMBS MULLED  
 TOGETHER USING #12 x 2 1/2"  
 Stainless Steel Wood Screws  
 Spaced 3" from CORNERS and  
 8" OC. in Field

**3 MULLED JAMB SECTION**  
 SCALE: HALF FULL

**GENERAL NOTES**

- CASEMENT WINDOW HAS BEEN DESIGNED IN ACCORDANCE WITH SOUTH FLORIDA BUILDING CODE 1994 EDITION
- POSITIVE AND NEGATIVE DESIGN PRESSURE CALCULATIONS SHALL BE PERFORMED IN ACCORDANCE WITH ACSE 7-88 MINIMUM DESIGN LOADS FOR BUILDING AND OTHER STRUCTURES
- CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI IN 28 DAYS.
- THE DETAILS AND SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS PROPOSED FOR IMPACT. CYCLIC AND UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH DADE COUNTY PROTOCOLS PA 201, 202, 203 WITH DESIGN LOADS AS FOLLOWS:
  - POSITIVE DESIGN LOAD 90 PSF
  - NEGATIVE DESIGN LOAD 90 PSF
 THE DADE COUNTY CERTIFIED TESTING LABORATORY PERFORMING THE TESTS ACKNOWLEDGED THE SATISFACTORY COMPLETION OF SUCH TESTS AND VERIFIED THE PRODUCTS TESTED ARE AS NOTED HEREIN.
- ANCHORS SHALL BE INSTALLED AS FOLLOWS:
  - WOOD STRUCTURE - USE ONLY
    - #12 X 4" LG. STAINLESS STEEL SCREW
    - 8" O.C. BEGIN 1ST SCREW WITHIN 3" OF TOP AND BOTTOM (MIN. PENETRATION 1 1/2")
    - SYP WOOD - 176 LB TENSION
  - CONCRETE OR BLOCK STRUCTURE -
    - 3/16" TAPCON CONCRETE SCREW
    - 8" O.C. BEGIN 1ST SCREW WITHIN 3" OF TOP AND BOTTOM (MIN. PENETRATION 1 1/2")
  - CONCRETE BLOCK - 170 LB. TENSION/SHEAR
  - CONCRETE - 218 LB. TENSION/SHEAR
- THE WINDOWS ARE TESTED WITH "Safety-Plus" BY GLASSLAM, N.G.I., Inc. NOTICE OF ACCEPTANCE: 97-0527.04 DADE COUNTY FLORIDA-EXPIRES 09/09/2000 0.505 LAMINATED GLASS CONSISTING OF THE FOLLOWING:
  - 2 LAYER OF 3/16" TEMPERED OR ANNEALED GLASS
  - 2 LAYERS OF .060 RESIN
  - 1 CENTER LAYER OF 0.010 PET FILM
 OR THE WINDOWS ARE TESTED WITH "Wind-Pane Series CT" BY Globe Amerada Glass Co., NOTICE OF ACCEPTANCE 97-1224.07 DADE COUNTY FLORIDA - EXPIRES 08/04/2001 0.465 LAMINATED GLASS CONSISTING OF :
  - 2 LAYERS OF 3/16" TEMPERED OR ANNEALED GLASS
  - 1 LAYERS OF .090 SAFLEX
- THE WINDOWS are tested with 1/2" MIN. Glass Bite Typical all sides.

**FOR OFFICIAL USE ONLY**

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE MAY 24 2001  
 BY [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-0312.05








**MAHOAGANY CASEMENT**  
**PLATINUM INDUSTRIES INC.**  
 917 NORTH RAILROAD AVENUE WEST PALM BEACH, FLORIDA  
 PHONE 561-980-1377 FAX 561-655-4418

SINCLAIR ENGINEERING  
 3114 45th STREET, SUITE 3  
 WPB, FLORIDA 33407  
 TEL. (561) 640-7144  
 FL. Lic. # 35631

MAR 05 2001  
 [Signature]

DRAWN DWS
CHECKED
DATE 02-26-2001
SCALE HALF SCALE
JOB NO.
SHEET
W - 1
3 OF 7 SHEETS

SPECIES: MAHOGANY

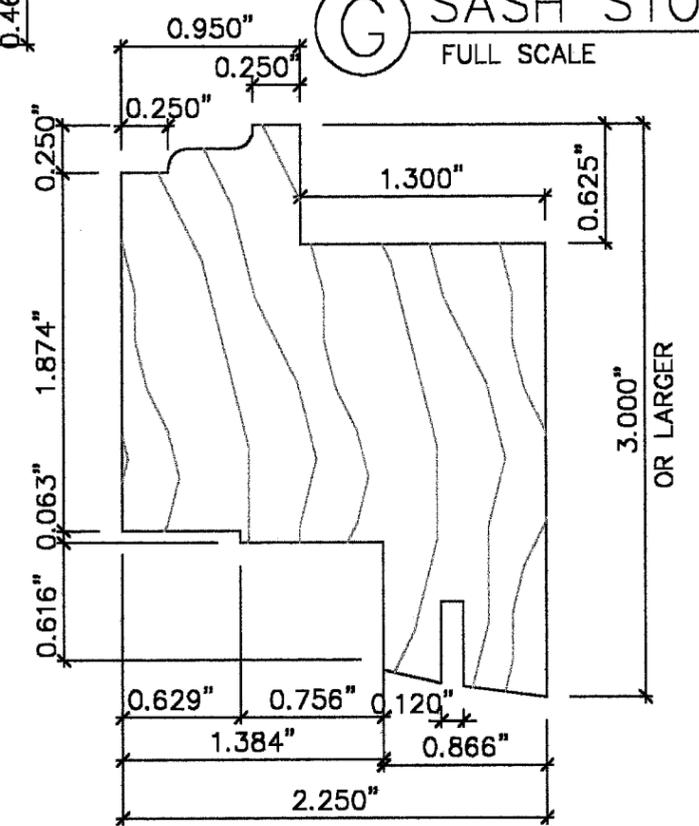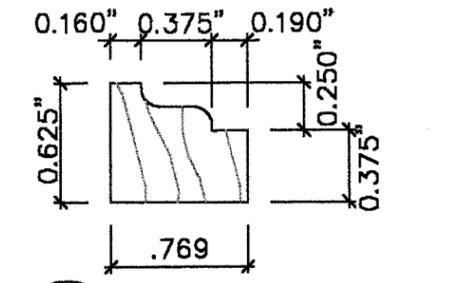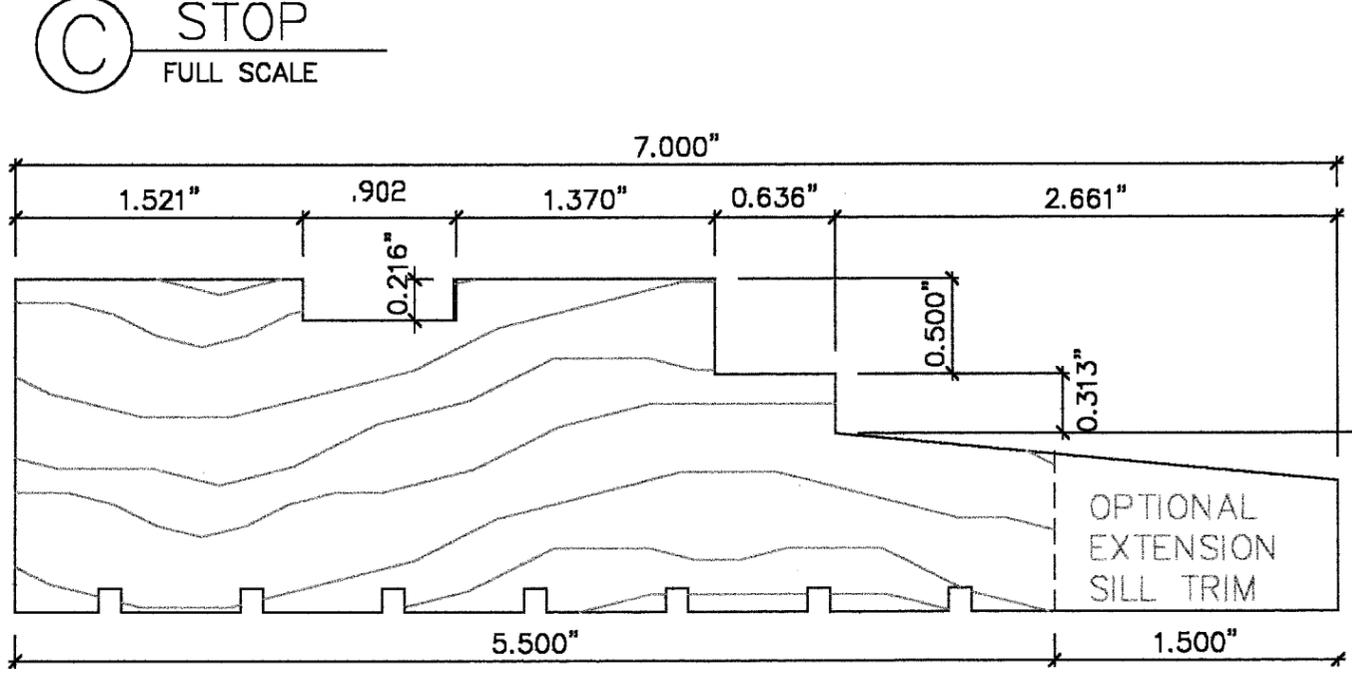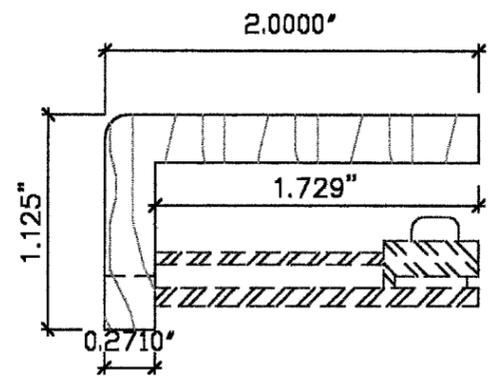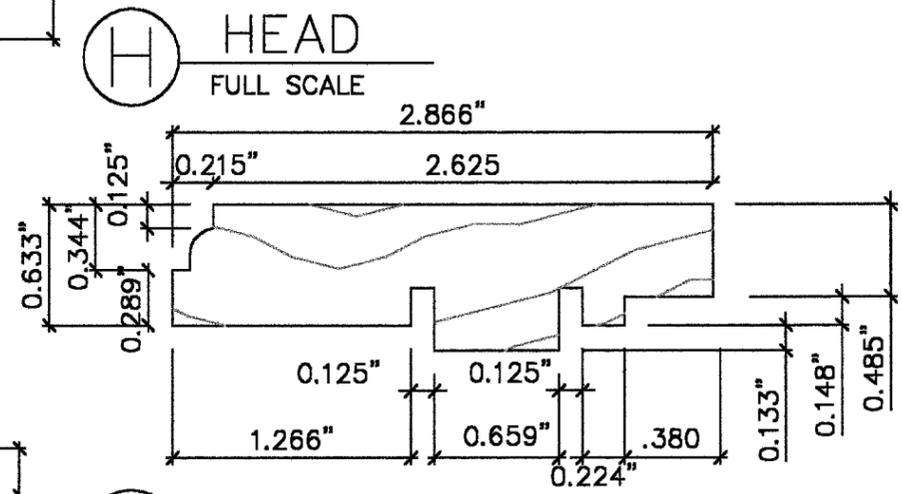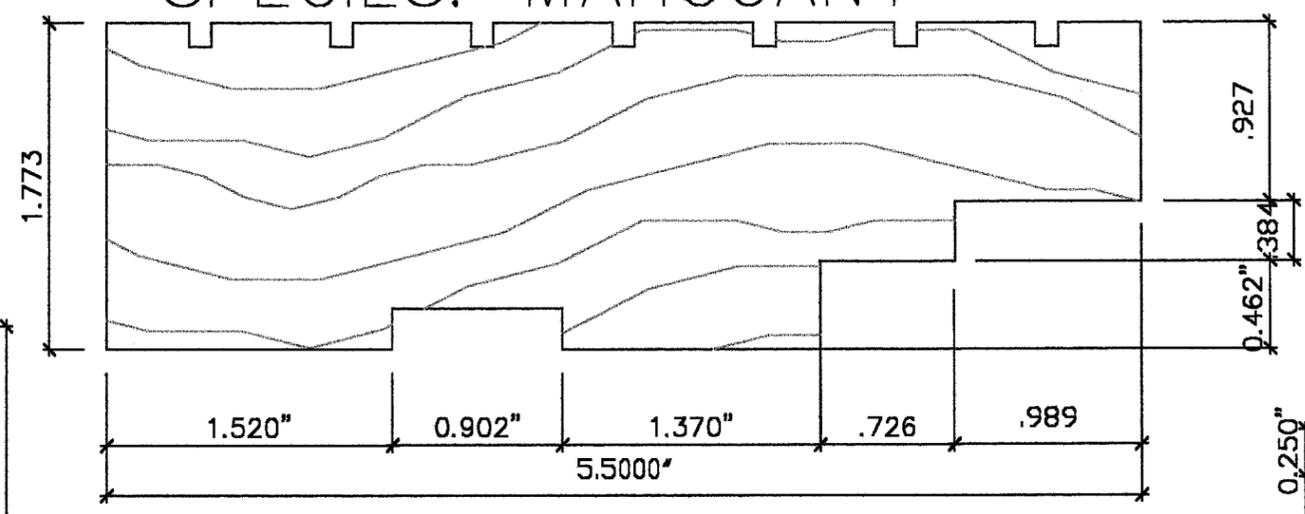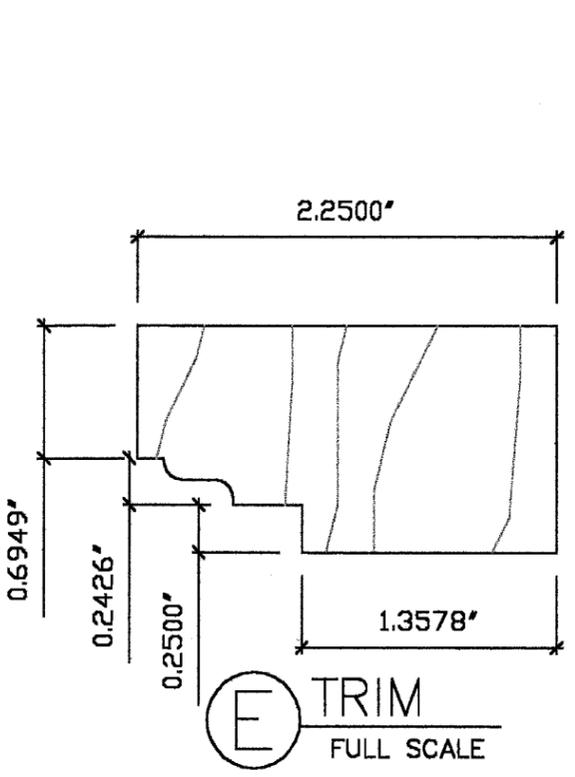

FOR OFFICIAL USE ONLY

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE MAY 24 2001  
 BY Manuel Serrano  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-0312.05

SINCLAIR ENGINEERING  
 3114 45th STREET, Suite 3  
 WPB, FLORIDA 33407  
 TEL. (561) 640-7144  
 FL. Lic. # 35631

*Manuel Serrano*

MAR 05 2001


FULL SCALE CASEMENT WINDOW PROFILES

PLATINUM INDUSTRIES INC.


917 NORTH RAILROAD AVENUE WEST PALM BEACH, FLORIDA  
 PHONE 561-980-1377 FAX 561-655-4418

DRAWN DWS
CHECKED
DATE 02-26-2001
SCALE FULL SCALE
JOB NO.
SHEET
<b>W-1</b>
4 OF 7 SHEETS


SPEICES: MAHOGANY

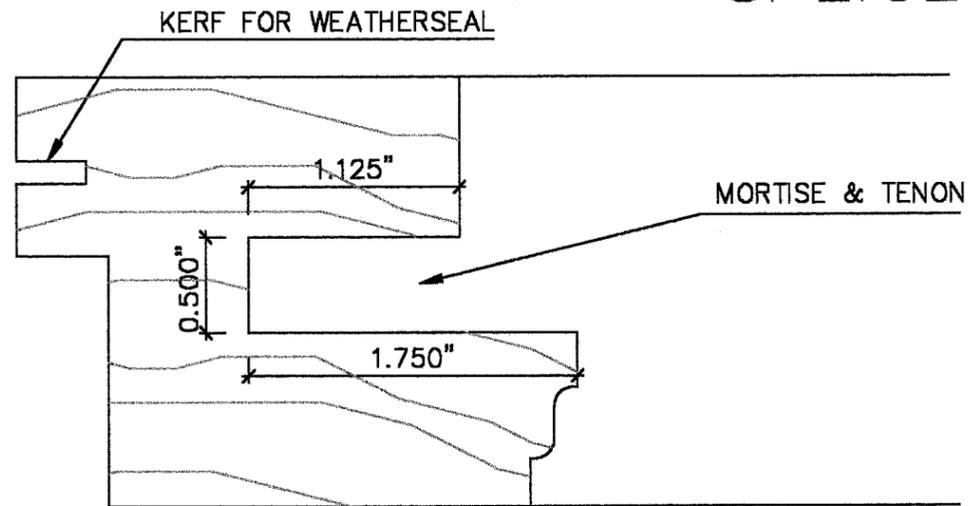


**(M)** SASH SECTION  
FULL SCALE

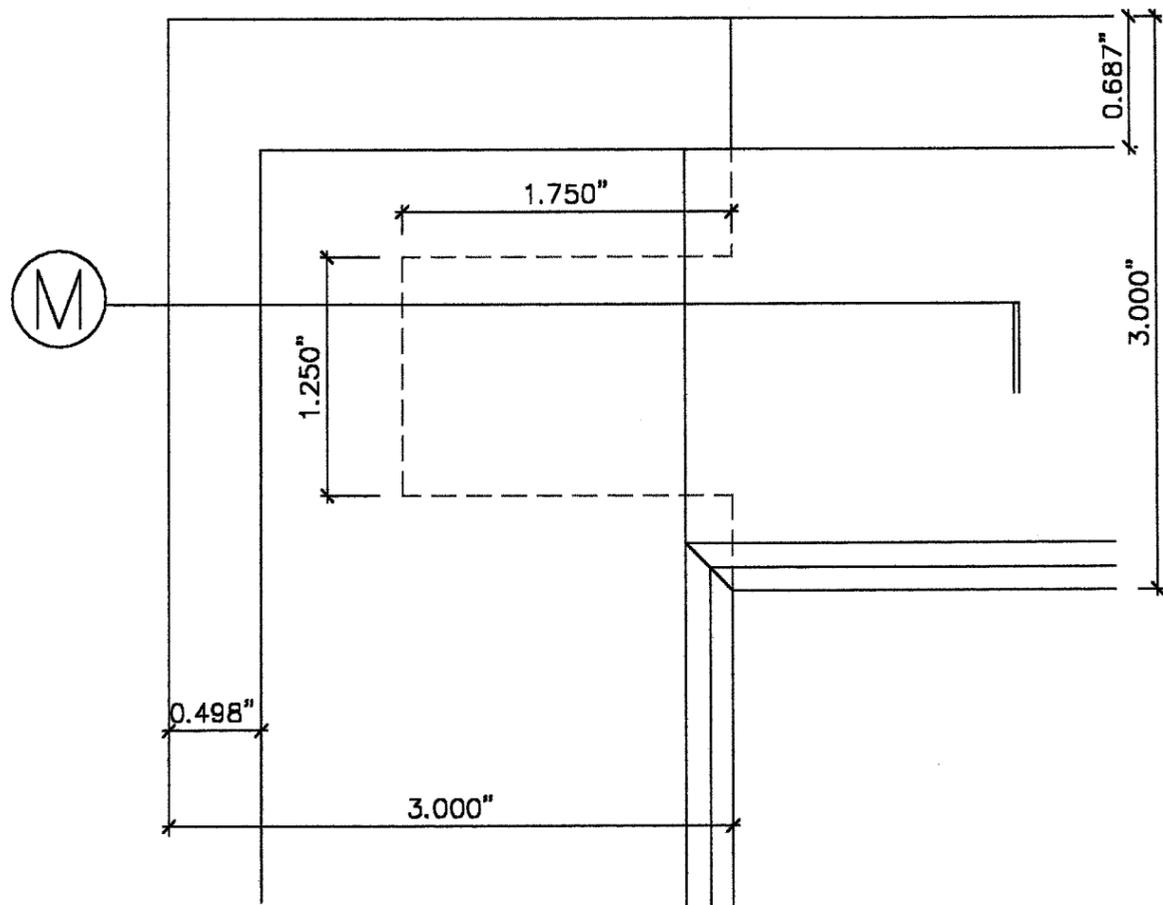

**(N)** SASH DETAIL  
FULL SCALE

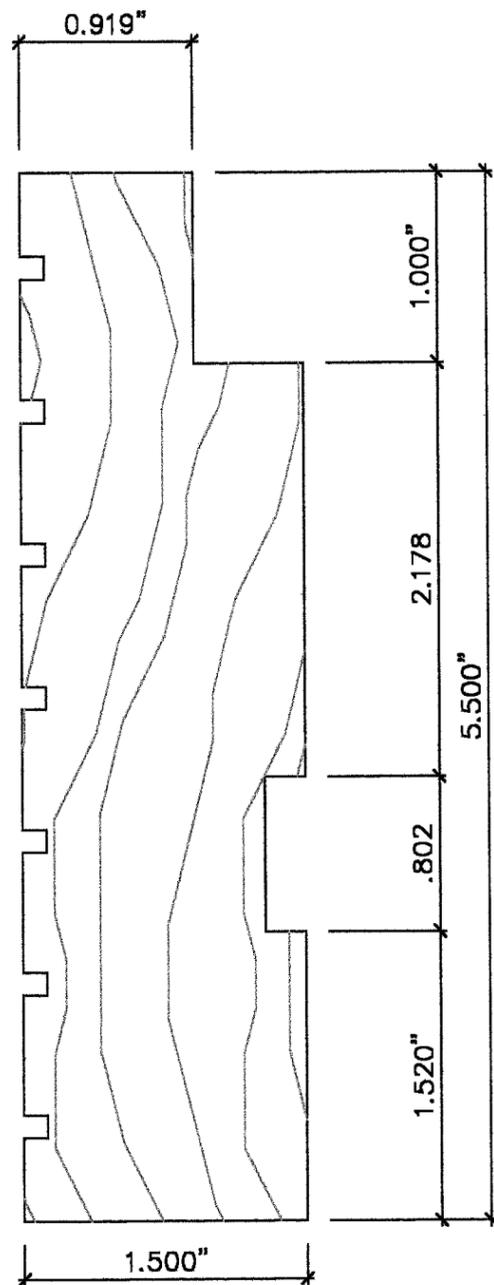

**(J)** JAMB  
FULL SCALE

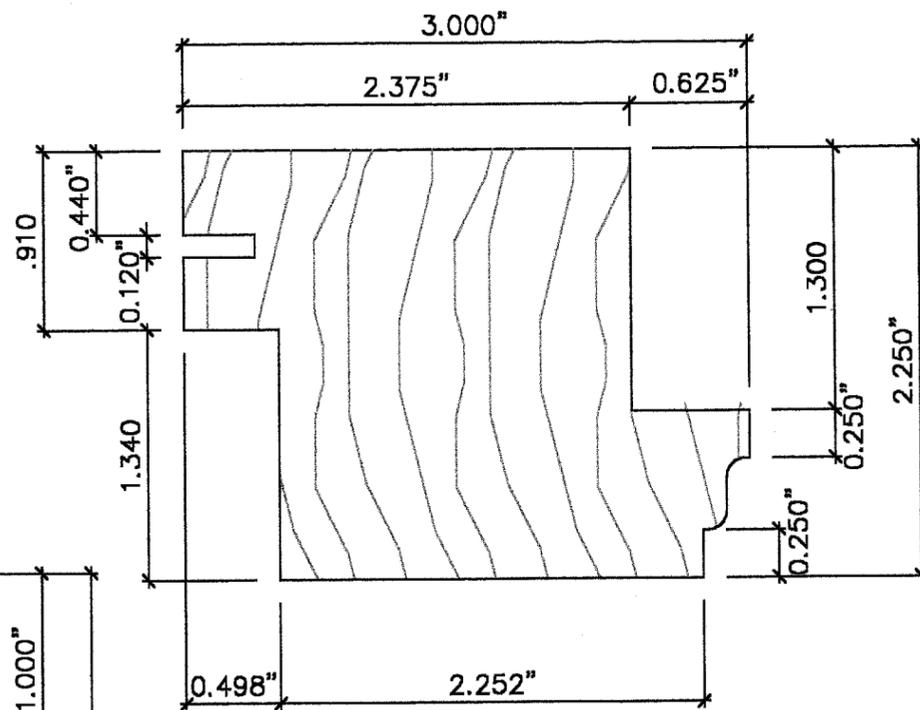

**(K)** SASH STILE  
FULL SCALE

FOR OFFICIAL USE ONLY


APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE **MAY 24 2001**  
BY *Manuel*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0312.05

DRAWN DWS
CHECKED
DATE 02-26-2001
SCALE FULL SCALE
JOB NO.
SHEET
<b>W-1</b>
5 OF 7 SHEETS


SINCLAIR ENGINEERING  
3114 45th STREET, Suite 3  
WPB, FLORIDA 33407  
TEL. (561) 640-7144  
FL Lic. # 35631

*Manuel*  
**PLATINUM INDUSTRIES INC.**  
917 NORTH RAILROAD AVENUE WEST PALM BEACH, FLORIDA  
PHONE 561-820-1377 FAX 561-655-4418


MAR 05 2001

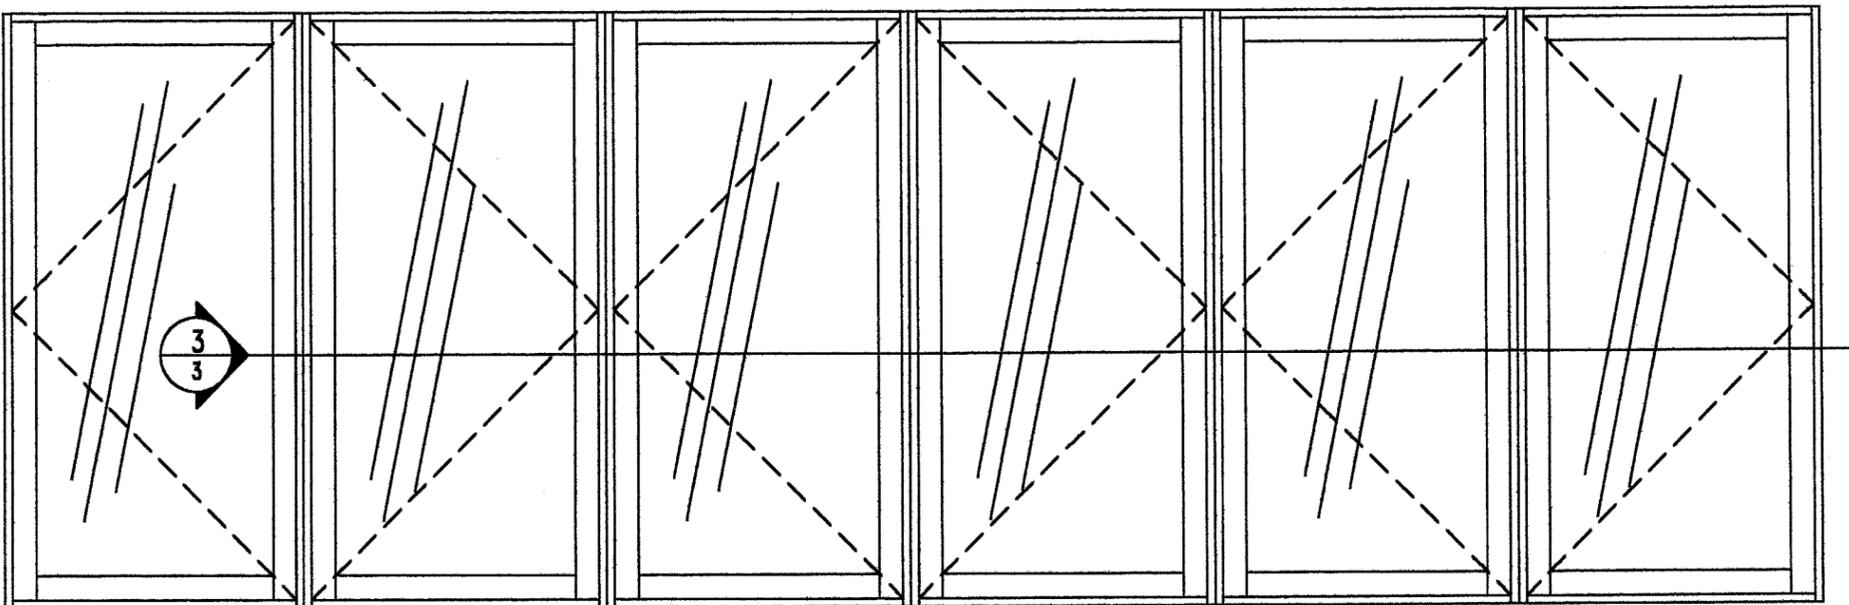

SIX UNIT COMBINATION

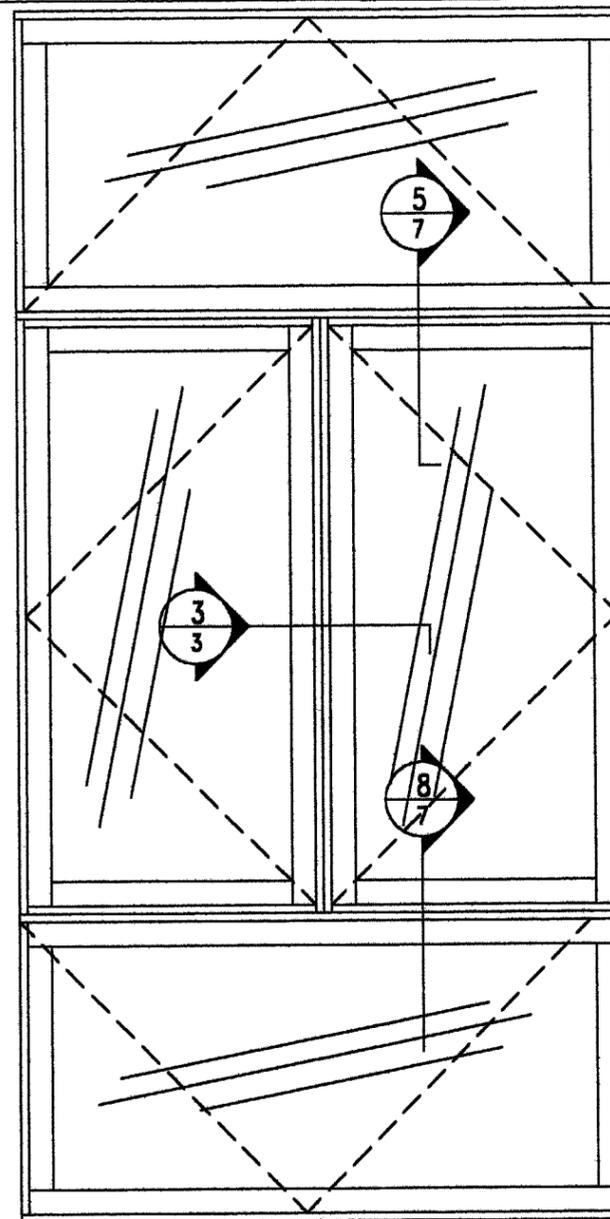

FOUR UNIT COMBINATION

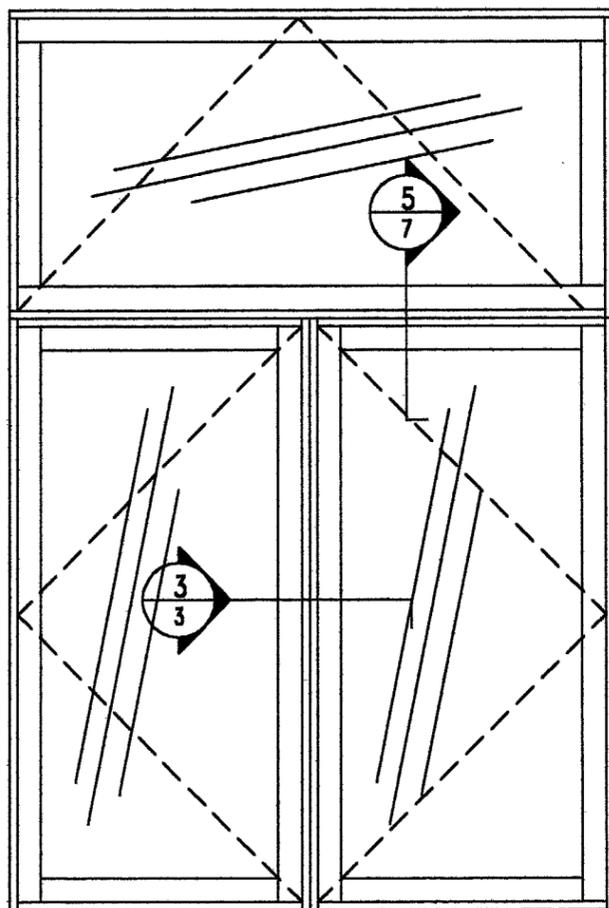

THREE UNIT COMBINATION

MAXIMUM SINGLE UNIT SIZE 38 1/2" x 74 1/4"

SPECIES: MAHOGANY

Mulled Mahogany Casement  
ALTERNATIVE COMBINATIONS

PLATINUM INDUSTRIES INC.

917 NORTH RAILROAD AVENUE WEST PALM BEACH, FLORIDA

PHONE 561-829-3777 FAX 561-635-4418


SINCLAIR ENGINEERING  
3114 45th STREET, Suite 3  
WPB, FLORIDA 33407  
TEL. (561) 640-7144  
Fl. Lic. # 35631

*[Signature]*  
MAY 24 2001

FOR OFFICIAL USE ONLY

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE MAY 24 2001  
BY *[Signature]*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0312.05

DRAWN DWS
DATE 02-26-2001
SCALE 1/2" = 1'0"
SHEET W-1 6 OF 7 SHEETS

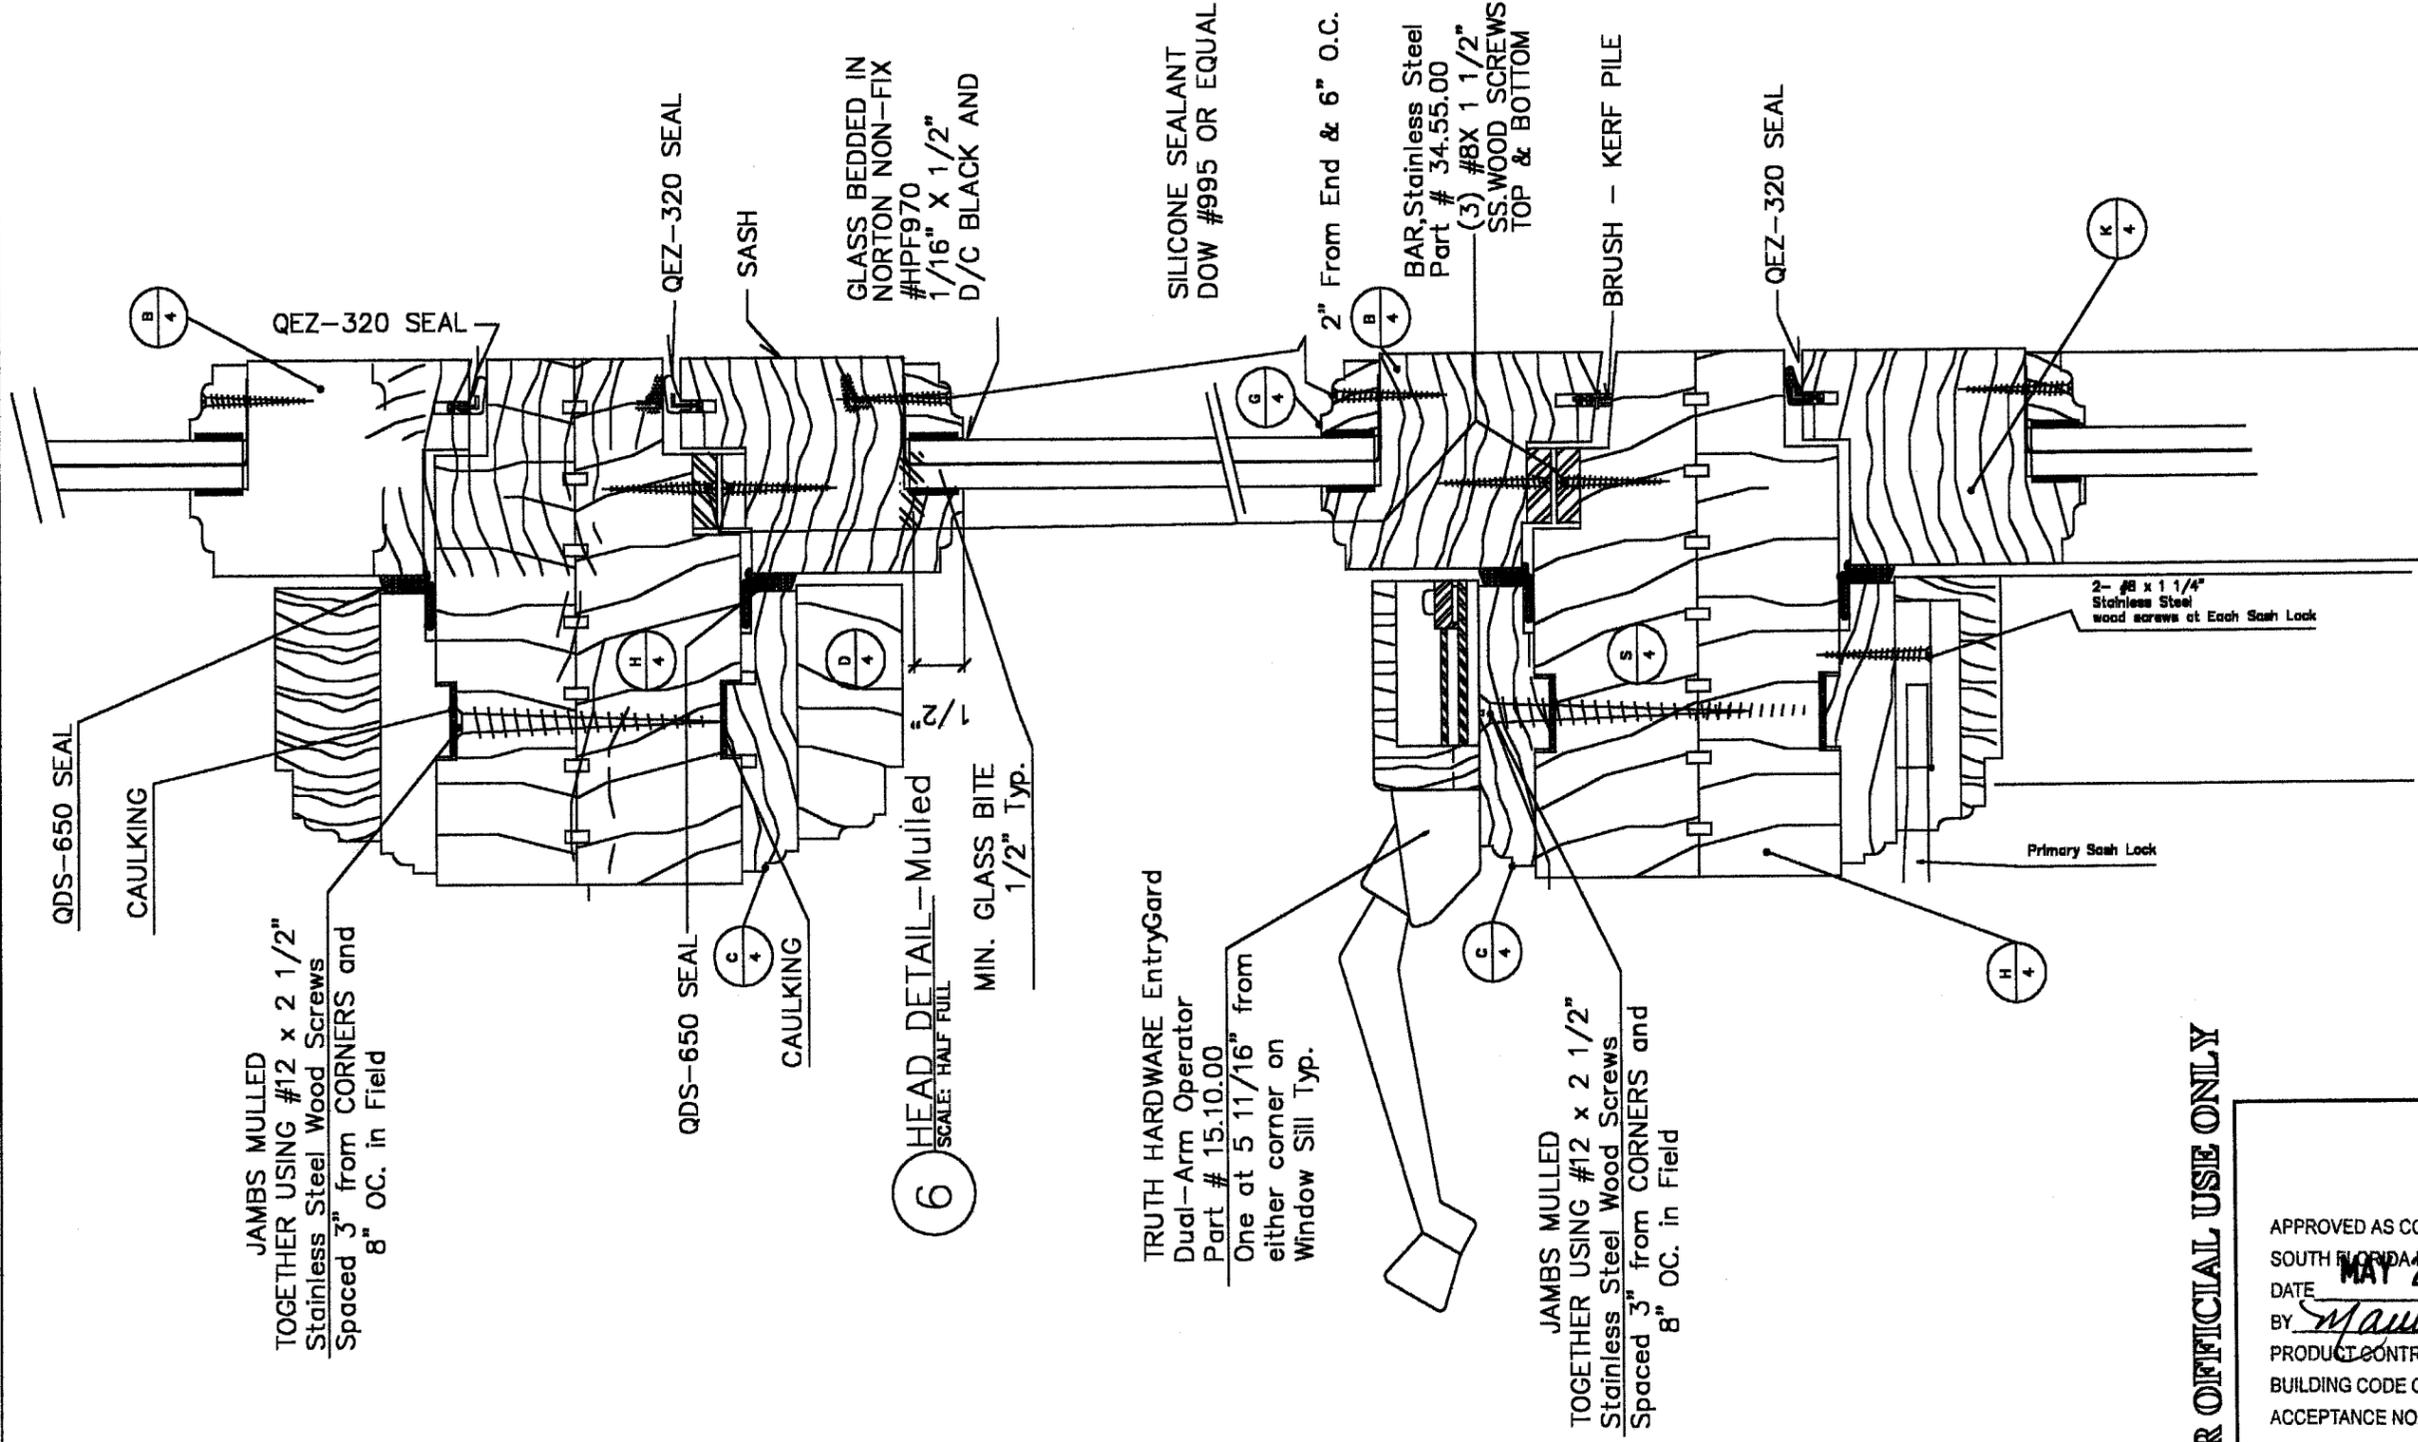

JAMBS MULLED TOGETHER USING #12 x 2 1/2" Stainless Steel Wood Screws Spaced 3" from CORNERS and 8" OC. in Field

6 HEAD DETAIL - Mullied SCALE: HALF FULL MIN. GLASS BITE 1/2" Typ.

TRUTH HARDWARE EntryGard Dual-Arm Operator Part # 15.10.00 One at 5 11/16" from either corner on Window Sill Typ.

JAMBS MULLED TOGETHER USING #12 x 2 1/2" Stainless Steel Wood Screws Spaced 3" from CORNERS and 8" OC. in Field

FOR OFFICIAL USE ONLY

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE MAY 24 2001  
 BY Manuel Soria  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-0312.05

8 SILL DETAIL - Mullied

DRAWN DWS CHECKED
DATE 02-08-2001 R
SCALE HALF FULL
JOB NO.
SHEET W - 1
7 OF 7 SHEETS

ROBERT KRAFT ENGINEERING  
 1470 S.W. DYER POINT ROAD  
 PALM CITY, FLORIDA 34990  
 TEL. (561) 288-3381  
 FL. Lic. # 0043331

MAHOGANY MULLED CASEMENT

PLATINUM INDUSTRIES INC.

917 NORTH RAILROAD AVENUE WEST PALM BEACH, FLORIDA  
 PHONE 561-980-1377 FAX 561-655-4418

MAR 6 2001