



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Calleja's Accordion Shutters, Inc.
295 West 27 Street
Hialeah ,FL 33010

Your application for Notice of Acceptance (NOA) of:

"HPMA / Performance System 1" Aluminum Accordion Shutter

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-0328.03
EXPIRES: 04/23/2006

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 04/23/2001

Calleja's Accordion Shutters, Inc.

ACCEPTANCE No. : 01-0328.03

APPROVED : 04/23/2001

EXPIRES : 04/23/2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. SCOPE

This approves an Aluminum Accordion Shutter, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

This Aluminum Accordion Shutter and its components shall be constructed in strict compliance with the following documents: Drawing No. 01-070, titled "HPMA / Performance System 1 Accordion Shutter", prepared by Tilteco, Inc., dated March 26, 2001, signed and sealed by Walter A. Tillit Jr., P.E., sheets 1 through 6 of 6, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

All permanent set components, included but not limited to embedded anchor bolts, threaded cones, metal shields, headers and sills, must be protected against corrosion, contamination and damage at all times.

4. INSTALLATION

This Aluminum Accordion Shutter and its components shall be installed in strict compliance with the approved drawings.

5. LABELING

Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.



Helmy A. Makar, P.E.- Product Control Examiner
Product Control Division

Calleja's Accordion Shutters, Inc.

ACCEPTANCE No. : 01-0328.03


APPROVED : 04/23/2001

EXPIRES : 04/23/2006


NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer, who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer needs not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.


END OF THIS ACCEPTANCE




Helmy A. Makar, P.E.- Product Control Examiner
Product Control Division

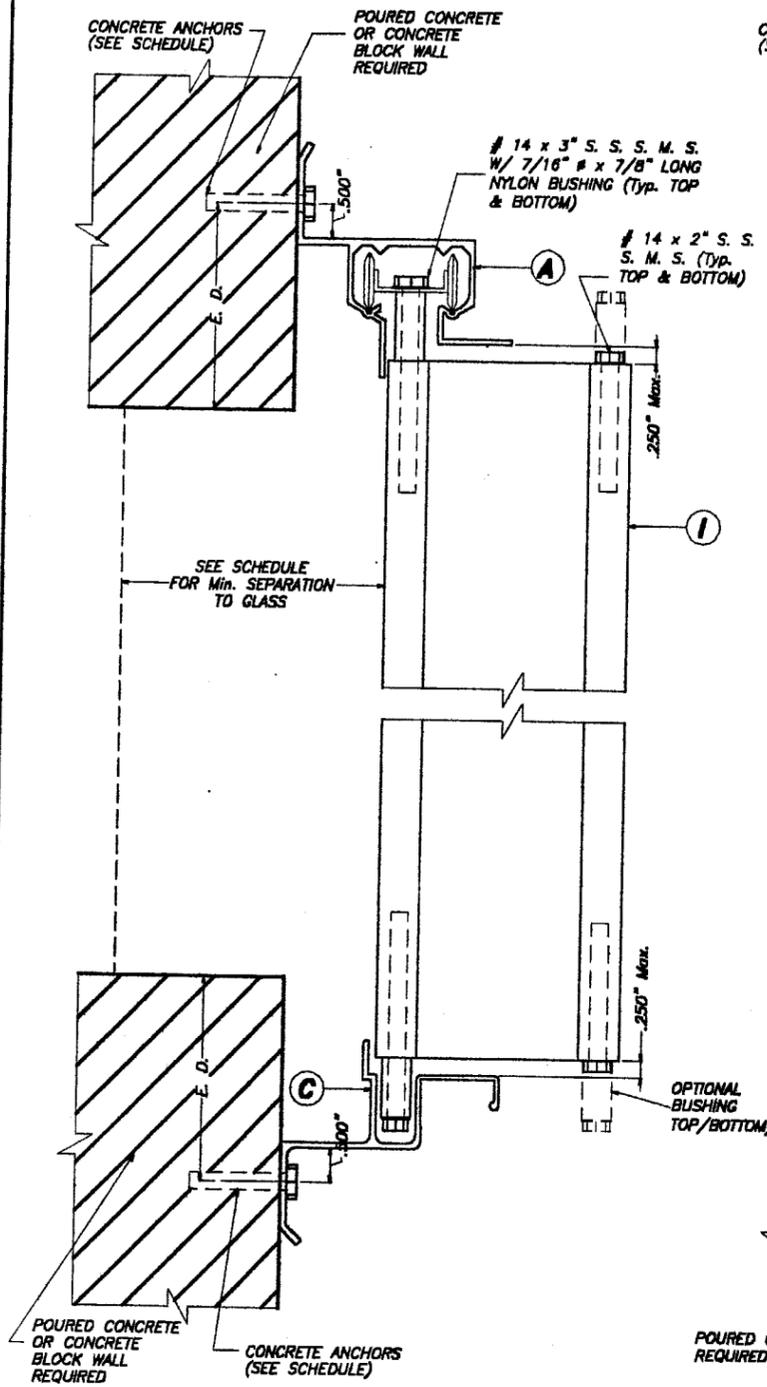


**WALL MOUNTING
INSTALLATION
SECTION A**
SCALE : 3/8" = 1"

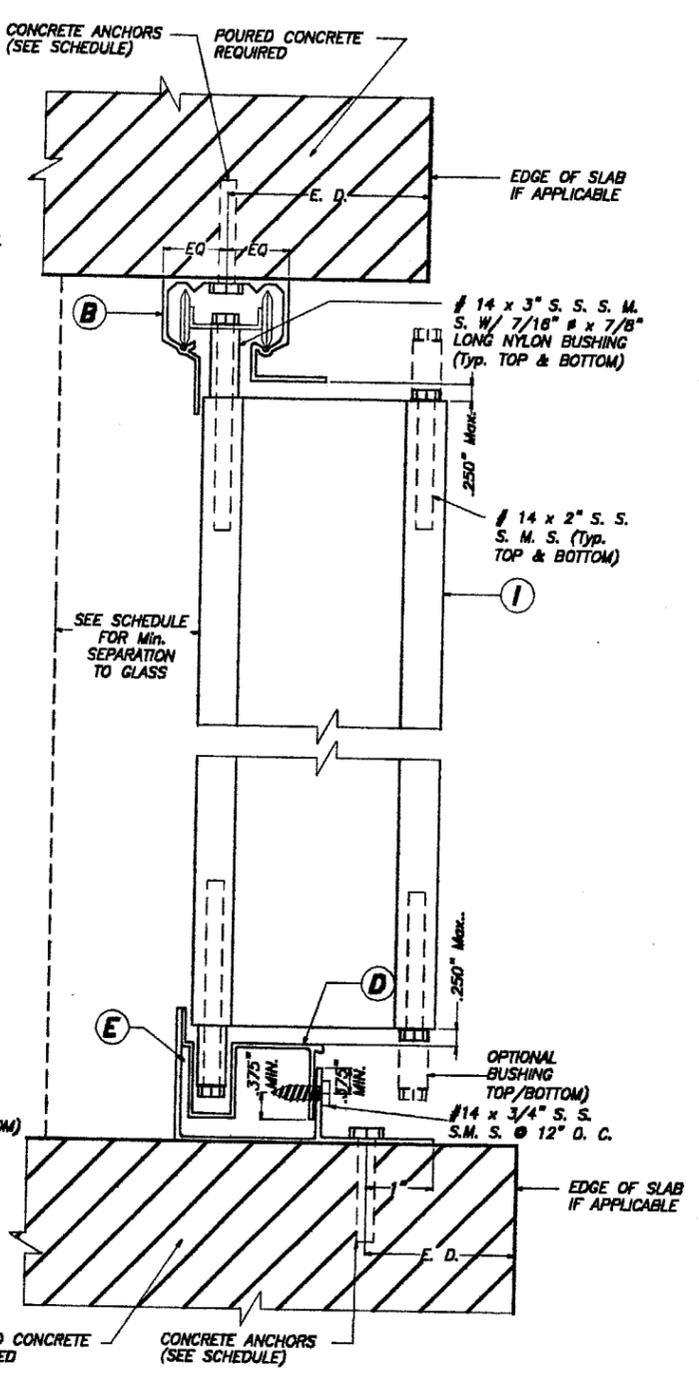

**CEILING & FLOOR
MOUNTING INSTALLATION
SECTION B**
SCALE : 3/8" = 1"

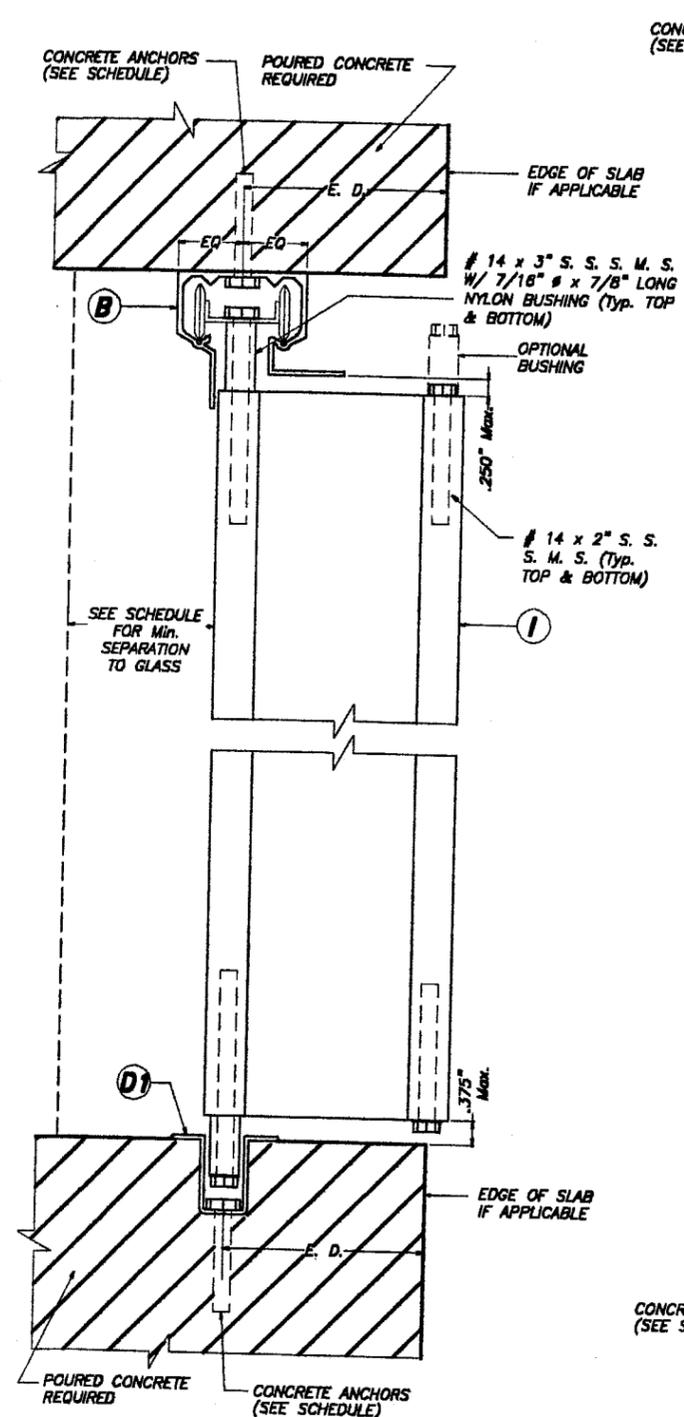

**CEILING & FLOOR
MOUNTING INSTALLATION
SECTION B1**
SCALE : 3/8" = 1"

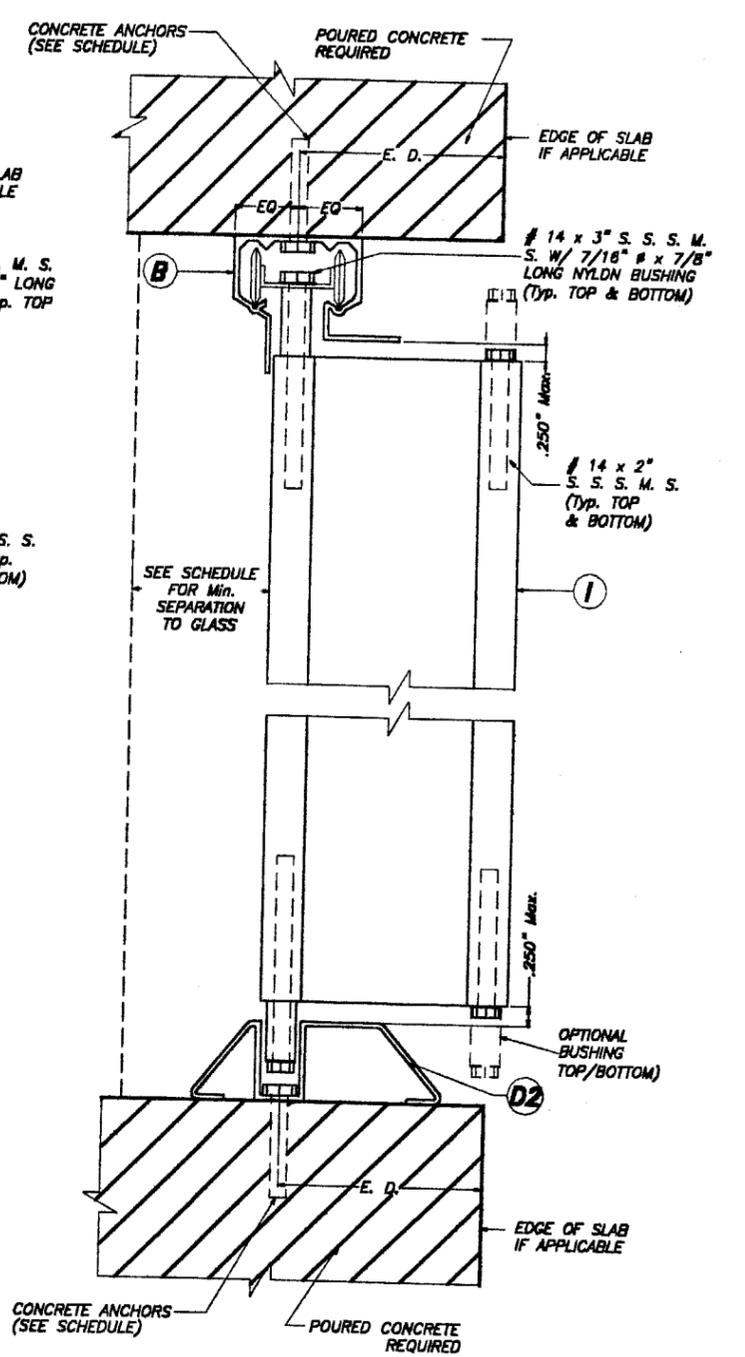


**CEILING & FLOOR
MOUNTING INSTALLATION
SECTION B2**
SCALE : 3/8" = 1"


APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE 04/23/2001
BY *Heather H. McW...*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0328-03

David...
3/26/01


<p>TILTECO Inc. TILLIT TESTING & ENGINEERING COMPANY 8885 N.W. 38th St., Ste. 217, VIRGINIA GARDENS, FL 33188 Phone : (305)871-1530 . Fax : (305)871-1531 EB-0006719 WALTER A. TILLIT Jr., P. E. FLORIDA Lic. # 44187</p>		<p>HPMA/PERFORMANCE SYSTEM 1 ACCORDION SHUTTER</p>		<p>MIAMI-DADE COUNTY</p>	
		<p>CALLEJA'S ACCORDION SHUTTERS, INC. 295 W 27 ST. HIALEAH, FL. 33010</p>		<p>AS SHOWN SCALE 3/28/01 DATE 01-070 DRAWING No SHEET 2 OF 6</p>	
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	-	-	3	-	-
2	-	-	4	-	-

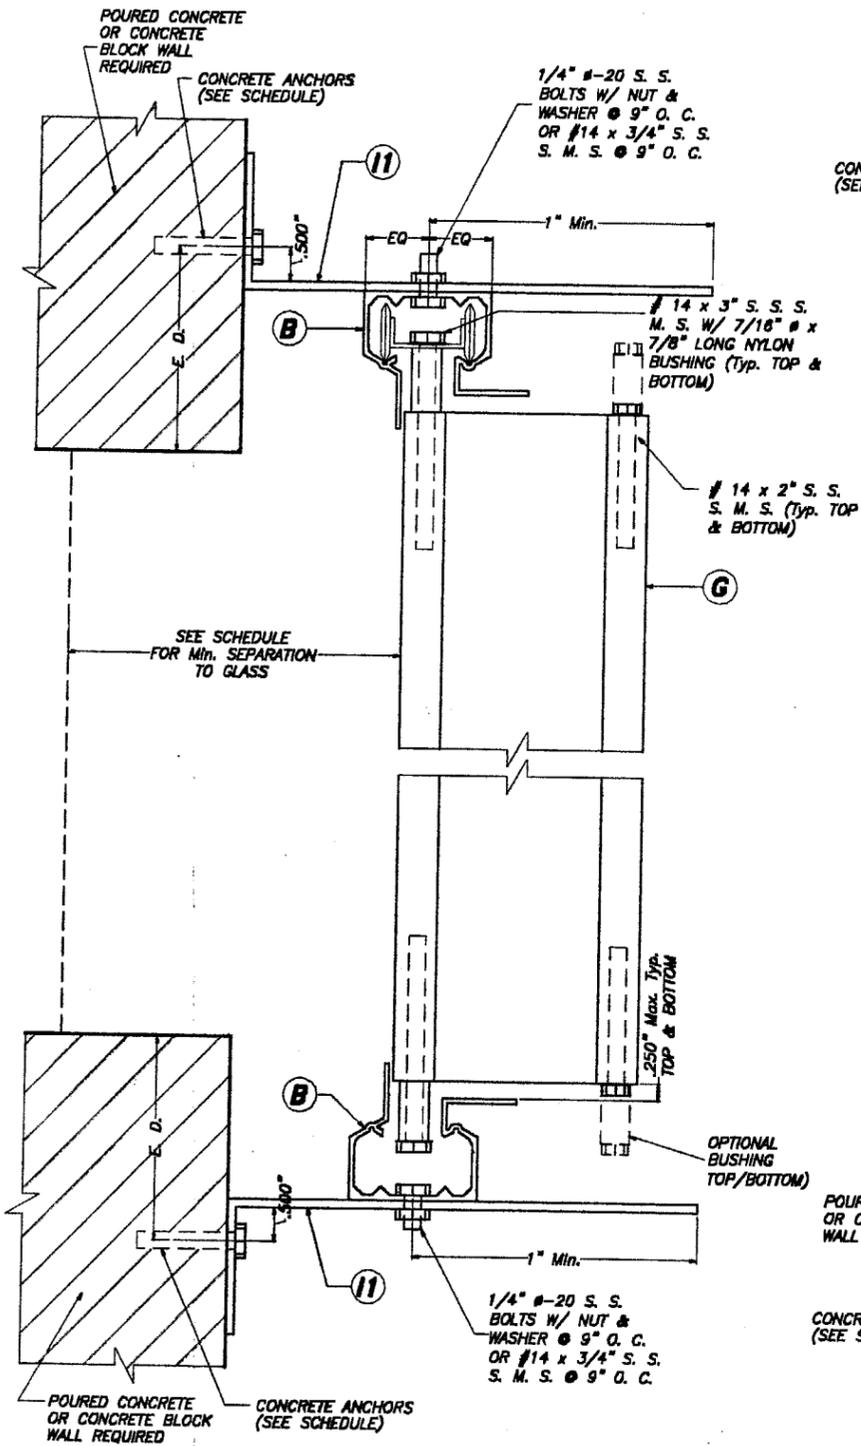

BUILD-OUT INSTALLATION
- SECTION C
 SCALE : 3/8" = 1"

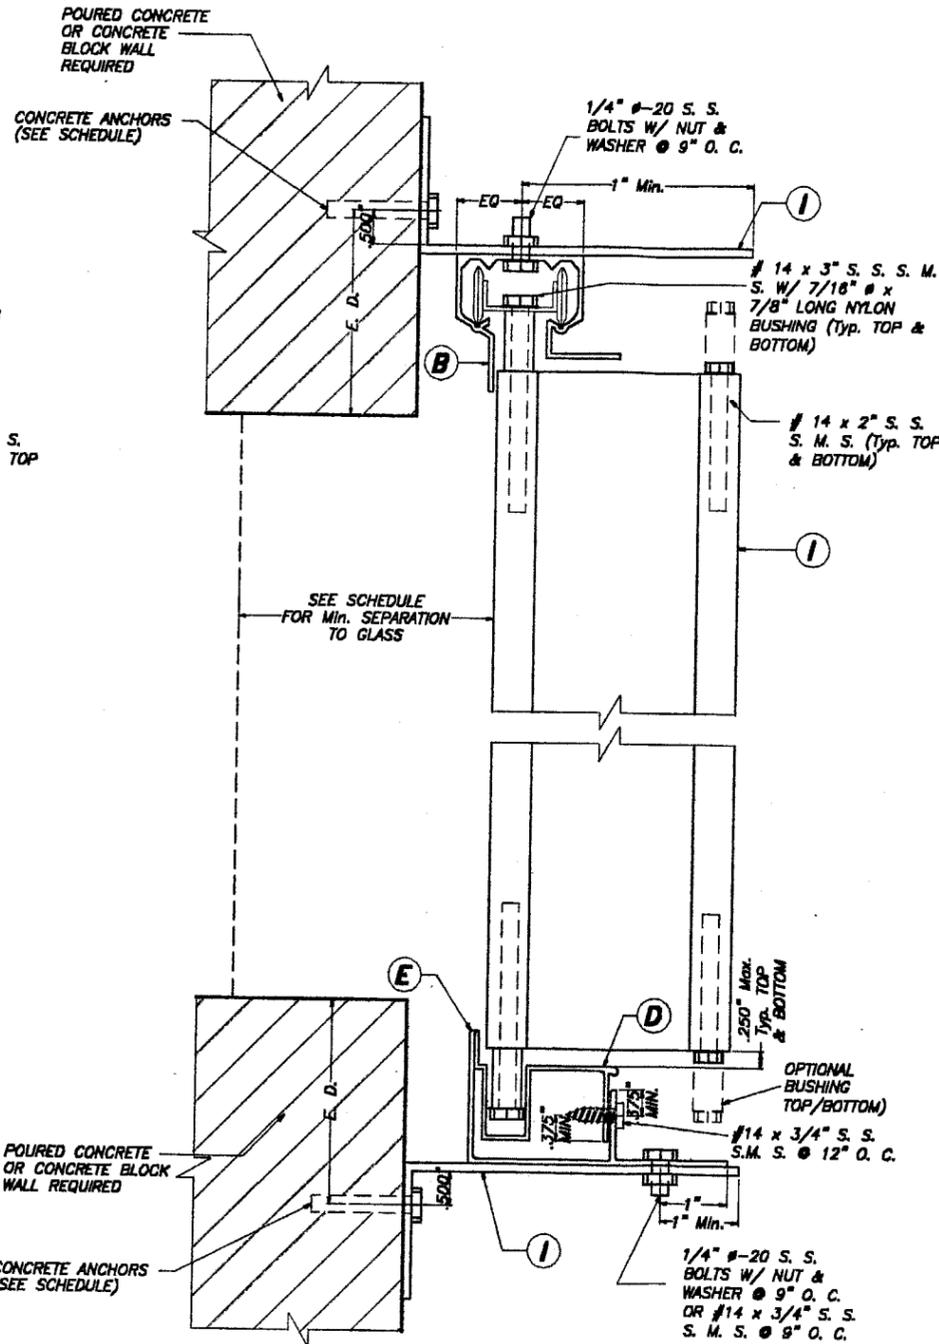

BUILD-OUT INSTALLATION
- SECTION C1
 SCALE : 3/8" = 1"

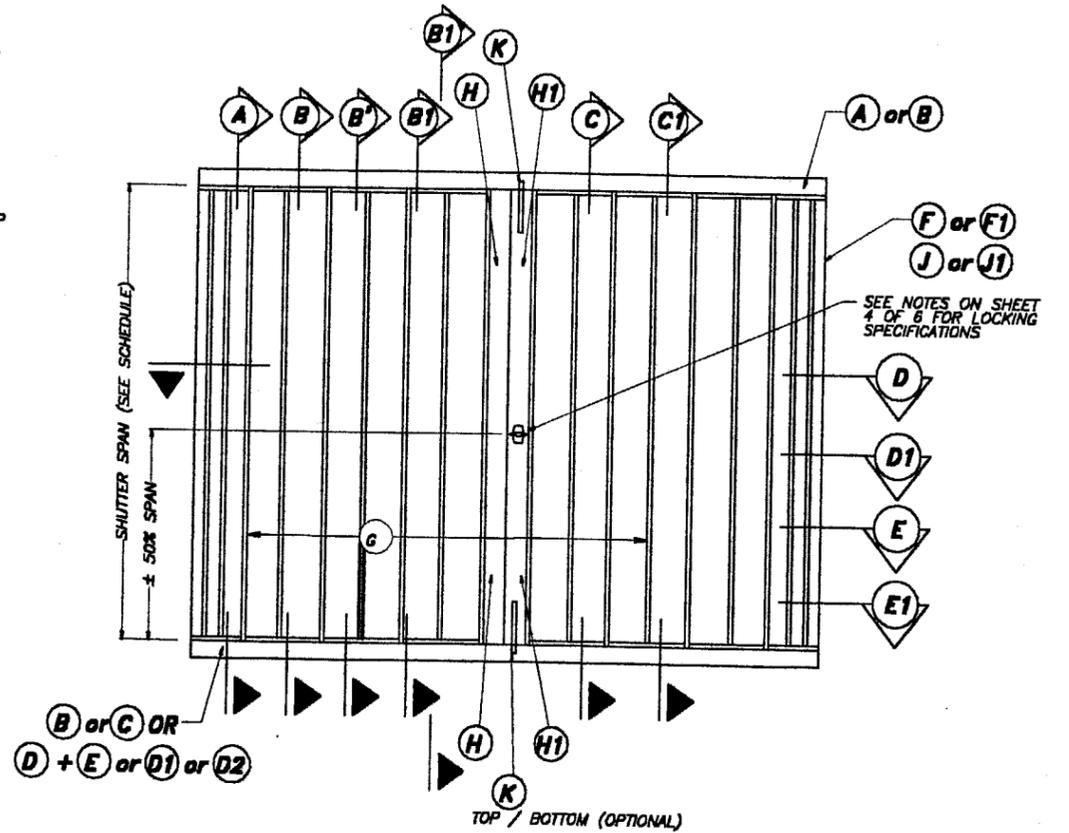


TYPICAL ELEVATION
 N. T. S.

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE 04/23/2001
 BY *Heung A. Mak*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0328.03

MIAMI-DADE COUNTY

David
 3/26/01

 TILLIT TESTING & ENGINEERING COMPANY 6595 N.W. 38th St., Ste. 217, VIRGINIA GARDENS, FL 33188 Phone : (305)871-1530 Fax : (305)871-1531 EB-0006719 WALTER A. TILLIT Jr. P. E. FLORIDA Lic. # 44167		HPMA/PERFORMANCE SYSTEM 1 ACCORDION SHUTTER AS SHOWN SCALE			
		CALLEJA'S ACCORDION SHUTTERS, INC. 295 W 27 ST. HIALEAH, FL. 33010			
		3/26/01 DATE			
		01-070 DRAWING No			
		SHEET 3 OF 6			
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	-	-	3	-	-
2	-	-	4	-	-

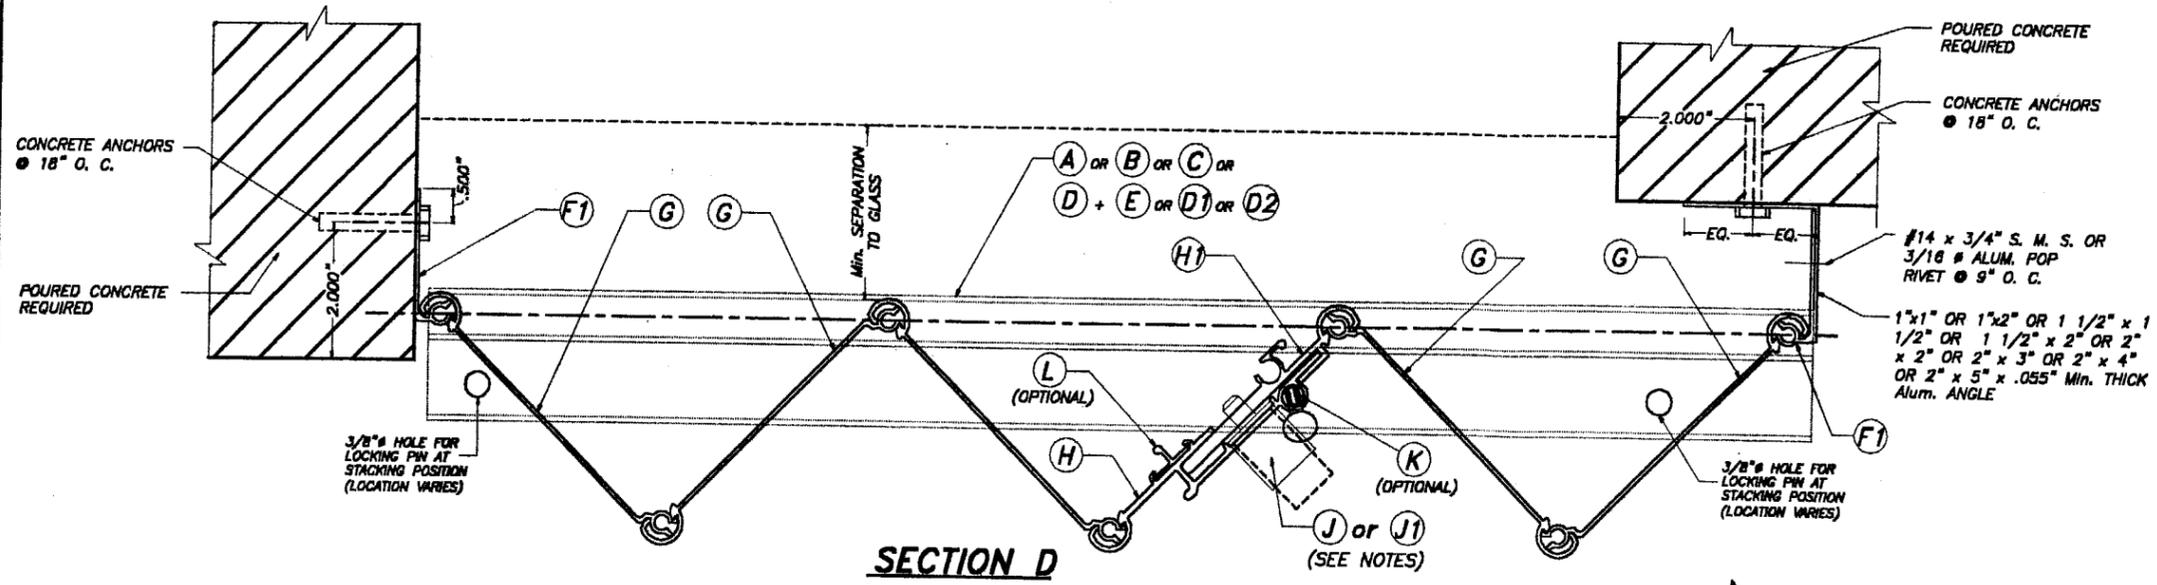


SECTION D

SCALE : 3/8" = 1"

NOTES FOR LOCKING OF (H) & (H1)


1-PUSH BOTTOM LOCK (J) MAY BE USED FOR INSTALLATIONS SECURED FROM THE OUTSIDE OR INSIDE OF SHUTTER. WHEN INSTALLING (J) FROM THE OUTSIDE, A 7/8" HOLE SHALL BE DRILLED AT (H) AND (J) MUST BE RIVETED FROM THE BACK OF (H) TO THE FRONT W/ (2) 3/16" ALUM. POP RIVETS. A 3/8" HOLE MUST THEN BE DRILLED AT (H1) TO ALLOW FOR (J)'S PIN TO PASS THRU. WHEN INSTALLING (J) FROM THE INSIDE, (J) MUST BE RIVETED TO (H) W/ (2) 3/16" ALUM. POP RIVETS. A 3/8" HOLE MUST THEN BE DRILLED THRU (H) AND (H1) TO ALLOW FOR (J)'S PIN TO PASS THRU.

2-5/16"x1" LOCK (J1) MAY BE USED ALTERNATIVELY TO (J) LOCK FOR INSTALLATIONS SECURED FROM THE OUTSIDE OR INSIDE OF SHUTTER. IN THIS CASE, A 5/16" HOLE SHALL BE DRILLED THRU (H) AND (H1). HOLE DRILLED TO (H1) SHALL BE TAPPED TO ACCEPT 18 THREADS PER INCH MACHINE SCREW.

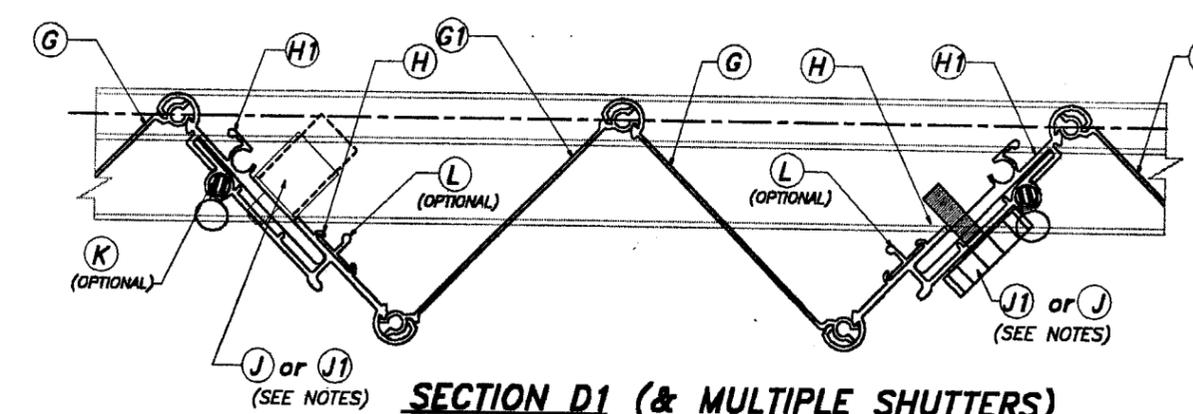


SECTION D1 (& MULTIPLE SHUTTERS)

SCALE : 3/8" = 1"

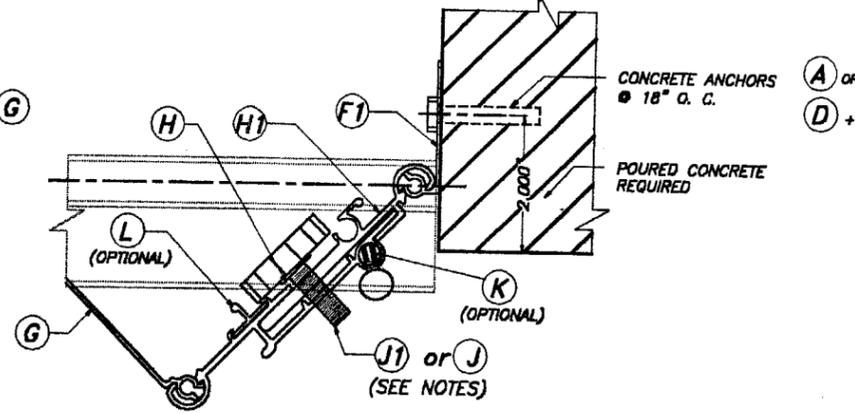


ONE SIDED SECTION : END CONNECTION DETAIL

SCALE : 3/8" = 1"

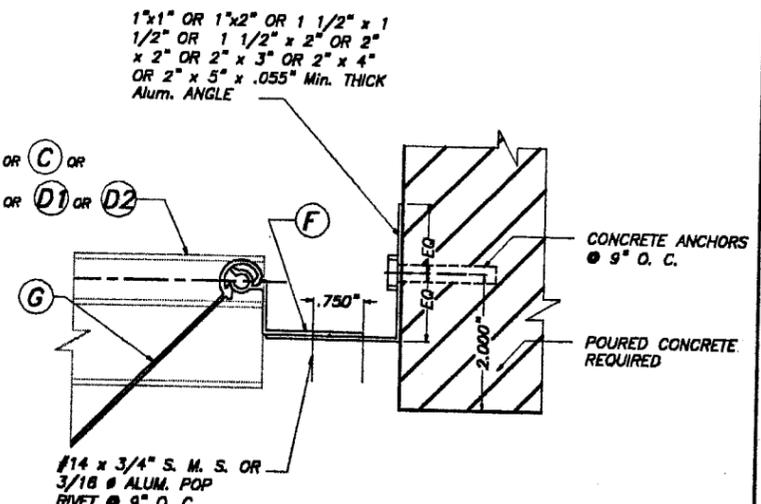

ALTERNATE CLOSURE DETAIL W / (F)

SCALE : 3/8" = 1"

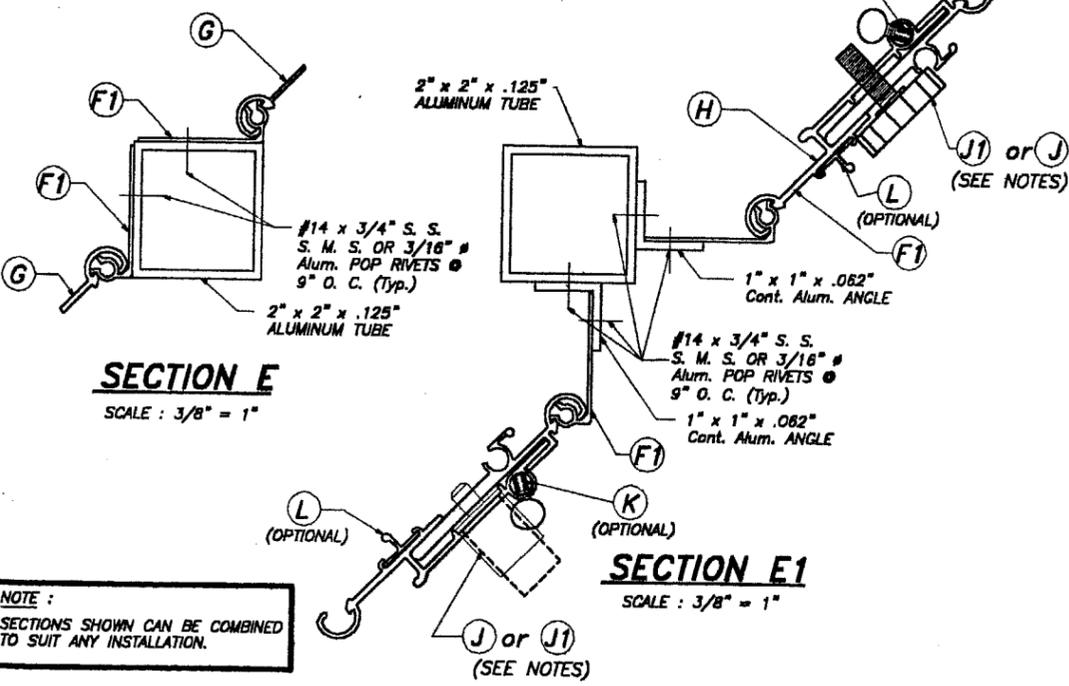


SECTION E

SCALE : 3/8" = 1"


SECTION E1

SCALE : 3/8" = 1"

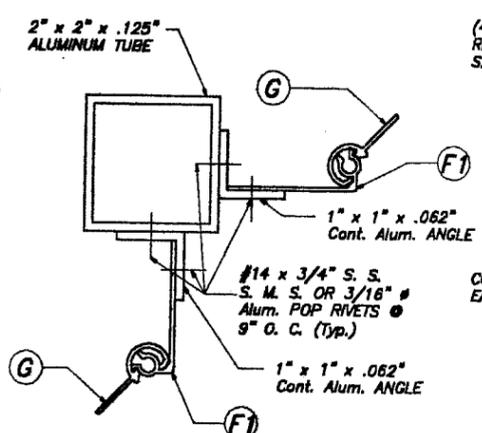

SECTION E2

SCALE : 3/8" = 1"

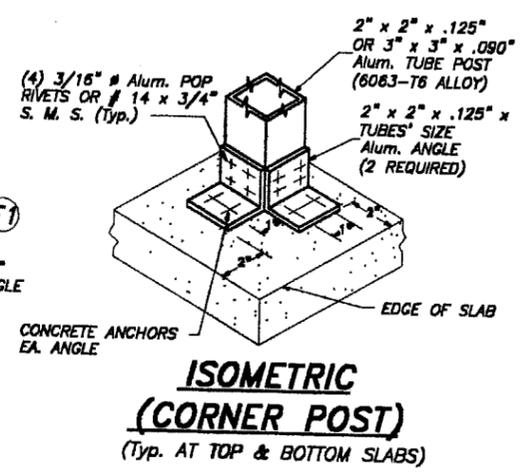

ISOMETRIC (CORNER POST)

(Typ. AT TOP & BOTTOM SLABS)

NOTE :
SECTIONS SHOWN CAN BE COMBINED TO SUIT ANY INSTALLATION.

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE 04/23/2001
BY *Helmut H. Meier*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0328.03

MIAMI-DADE COUNTY

<p>TILTECO Inc. TILLIT TESTING & ENGINEERING COMPANY 6285 N.W. 38th. St., Ste. 217, VIRGINIA GARDENS, FL 33186 Phone : (305)871-1530 . Fax : (305)871-1531 EB-0006719 WALTER A. TILLIT Jr., P. E. FLORIDA Lic. # 44167</p>		<p>HPMA/PERFORMANCE SYSTEM 1 ACCORDION SHUTTER</p>		AS SHOWN SCALE		
		<p>CALLEJA'S ACCORDION SHUTTERS, INC. 295 W 27 ST. HIALEAH, FL 33010</p>		3/26/01 DATE		
<p>REV. No 1</p>		DESCRIPTION	DATE	REV. No 3	DESCRIPTION	DATE
<p>REV. No 2</p>				REV. No 4		
DRAWING No 01-070						
SHEET 4 OF 6						

David D.
3/26/01

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM SPAN "L" SCHEDULE.

(VALID FOR SECTIONS A, B, B1, B2, C & C1 ON SHEET 2 & 3).

NOTE: DESIGN PRESSURE RATING CORRESPONDS ONLY TO NEGATIVE PRESSURE (SUCTION) LOADS, IN ACCORDANCE WITH ASCE 7-88 CRITERIA FOR A GIVEN OPENING. IF NEGATIVE PRESSURE VALUES COMPLY WITH THE REQUIRED PRESSURE FOR THE OPENING, THE POSITIVE PRESSURE WILL AUTOMATICALLY QUALIFY AND NEED NOT TO BE CHECKED.

MAXIMUM DESIGN LOAD "W" (p.s.f.)	MAXIMUM SHUTTER SPAN FOR SECTIONS "L" (ft.)		MINIMUM SEPARATION TO GLASS (in.)	
	B, B1, B2 C & C1	A	*	**
40	14'-1"	12'-5"	3"	3"
45	13'-8"	11'-8"	3"	3"
50	13'-0"	11'-1"	3"	3"
55	12'-5"	10'-7"	2 3/4"	2 1/2"
60	11'-10"	10'-1"	2 3/4"	2 1/2"
65	11'-5"	9'-9"	2 3/4"	2 1/2"
70	11'-0"	9'-4"	2 3/4"	2 1/2"
75	10'-7"	9'-1"	2 3/4"	2 1/2"
80	10'-3"	8'-9"	2 3/4"	2 1/2"
85	10'-0"	8'-6"	2 3/4"	2 1/2"
90	9'-8"	8'-3"	2 3/4"	2 1/2"
95	9'-5"	8'-0"	2 3/4"	2 1/2"
100	9'-2"	7'-8"	2 3/4"	2 1/2"
105	9'-0"	7'-4"	2 3/4"	2"
110	8'-9"	7'-0"	2 3/4"	2"
115	8'-7"	6'-8"	2 3/4"	2"
120	8'-5"	6'-5"	2 3/4"	2"
125	8'-3"	6'-2"	2 3/4"	2"
130	8'-1"	5'-11"	2 3/4"	2"
135	7'-10"	5'-8"	2 1/4"	2"
140	7'-8"	5'-6"	2 1/4"	2"
145	7'-3"	5'-4"	2 1/4"	2"
150	7'-0"	5'-1"	2 1/4"	2"
155	6'-10"	4'-11"	2 1/4"	2"
160	6'-7"	4'-10"	2 1/4"	2"
165	6'-5"	4'-8"	2 1/4"	2"
170	6'-2"	4'-6"	2 1/4"	2"
175	6'-0"	4'-5"	2 1/4"	2"
180	5'-10"	4'-3"	2 1/4"	2"
185	5'-8"	4'-2"	2 1/4"	2"
190	5'-7"	4'-1"	2 1/4"	2"
195	5'-5"	3'-11"	2 1/4"	2"
200	5'-3"	3'-10"	2 1/4"	2"
205	5'-2"	3'-9"	2 1/4"	2"
210	5'-0"	3'-8"	2 1/4"	2"
215	4'-11"	3'-7"	2 1/4"	2"
220	4'-9"	3'-6"	2 1/4"	2"
225	4'-8"	3'-5"	2 1/4"	2"
230	4'-7"	3'-4"	2 1/4"	2"

* FOR SHUTTERS INSTALLED WITHIN THE FIRST 30'-0" ELEVATION OF BUILDING MEASURED AT BOTTOM OF SHUTTER.

** FOR SHUTTERS INSTALLED ABOVE 30'-0" ELEVATION OF BUILDING, MEASURED AT BOTTOM OF SHUTTER.

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM ANCHOR SPACING (in.) SCHEDULE. †
(VALID FOR SECTION A ON SHEET 2).

MAXIMUM DESIGN LOAD "W" (p.s.f.)	WALL MOUNTING INSTALLATION AT TOP OR BOTTOM (TO CONCRETE)			WALL MOUNTING INSTALLATION AT TOP OR BOTTOM (TO MASONRY)		
	SHUTTER SPAN			SHUTTER SPAN		
	5'-0" OR LESS	5'-0" TO 8'-6"	8'-6" TO MAX. ALLOWED	5'-0" OR LESS	5'-0" TO 8'-6"	8'-6" TO MAX. ALLOWED
FROM 40.0 TO 60.0	9	9	9	9	8	4.5
	9	9	9	9	9	6.5
	9	9	9	9	9	9
FROM >60.0 TO 75.0	9	9	9	9	4	3
	9	9	9	9	5.5	5
	9	9	9	9	8.5	6.5
FROM >75.0 TO 90.0	9	8.5	8.5	9	-	-
	9	8.5	8.5	9	4	4
	9	9	9	9	5.5	5.5
FROM >90.0 TO 120.0	9	7.5	7.5	4.5	-	-
	9	7.5	7.5	6.5	3.5	-
	9	9	9	9	5	-
FROM >120.0 TO 170.0	8	8	-	-	-	-
	8	8	-	3.5	3.5	-
	9	9	-	5	5	-
FROM >170.0 TO 230.0	8	8	-	-	-	-
	8	8	-	3.5	3.5	-
	9	9	-	5	5	-

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM ANCHOR SPACING (in.) SCHEDULE. †
(VALID FOR SECTIONS C1 ON SHEET 3).

MAXIMUM DESIGN LOAD "W" (p.s.f.)	WALL MOUNTING INSTALLATION AT TOP OR BOTTOM (TO CONCRETE)			WALL MOUNTING INSTALLATION AT TOP OR BOTTOM (TO MASONRY)		
	SHUTTER SPAN			SHUTTER SPAN		
	5'-0" OR LESS	5'-0" TO 8'-6"	8'-6" TO MAX. ALLOWED	5'-0" OR LESS	5'-0" TO 8'-6"	8'-6" TO MAX. ALLOWED
FROM 40.0 TO 60.0	9	9	9	9	9	4.5
	9	9	9	9	9	6.5
	9	9	9	9	9	9
FROM >60.0 TO 75.0	9	9	9	9	6	3.5
	9	9	9	9	8.5	5.5
	9	9	9	9	9	7.5
FROM >75.0 TO 90.0	9	9	9	9	4	3
	9	9	9	9	5.5	4.5
	9	9	9	9	9	6.5
FROM >90.0 TO 120.0	9	7.5	7.5	7	-	-
	9	7.5	7.5	9	3.5	3.5
	9	9	9	9	5	5
FROM >120.0 TO 170.0	9	7	-	3	-	-
	9	7	-	4.5	3	-
	9	9	-	6.5	4.5	-
FROM >170.0 TO 230.0	7	7	-	-	-	-
	7	7	-	3	3	-
	9	9	-	4.5	4.5	-

† MAXIMUM ANCHOR SPACINGS ARE VALID FOR 3 1/2" EDGE DISTANCE. FOR E. D. LESS THAN 3 1/2", REDUCE ANCHOR SPACING BY MULTIPLYING SPACING SHOWN ON SCHEDULE BY THE FOLLOWING FACTORS. (NOTE: Min. E. D. FOR CALK-IN ANCHORS IS 2 1/2"). FOR THIS OPERATION TO BE POSSIBLE, REDUCED SPACING OBTAINED USING FACTOR SHALL NOT BE LESS THAN MINIMUM SPACING INDICATED FOR EACH ANCHOR TYPE AT ANCHORS LEGEND.

ACTUAL E. D.	FACTOR
3"	.86
2 1/2"	.75
2"	.50

David D.
3/26/01

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM ANCHOR SPACING (in.) SCHEDULE. †
(VALID FOR SECTIONS B, B1, B2 ON SHEET 2).

MAXIMUM DESIGN LOAD "W" (p.s.f.)	FLOOR/CEILING MOUNTING INSTALLATION TOP OR BOTTOM (TO CONCRETE)		
	SHUTTER SPAN		
	5'-0" OR LESS	5'-0" TO 8'-6"	8'-6" TO MAX. ALLOWED
FROM 40.0 TO 60.0	9	9	8.5
	9	9	9
	9	9	9
FROM >60.0 TO 75.0	9	9	8
	9	9	8
	9	9	9
FROM >75.0 TO 90.0	9	8	7
	9	8.5	7.5
	9	9	9
FROM >90.0 TO 120.0	9	6	6
	9	6.5	6.5
	9	9	9
FROM >120.0 TO 170.0	7.5	6	-
	7.5	6	-
	9	8.5	-
FROM >170.0 TO 230.0	6	6	-
	6	6	-
	8.5	8.5	-

MAXIMUM DESIGN PRESSURE RATING "W" (p.s.f.) AND CORRESPONDING MAXIMUM ANCHOR SPACING (in.) SCHEDULE. †
(VALID FOR SECTION C ON SHEET 3).

MAXIMUM DESIGN LOAD "W" (p.s.f.)	WALL MOUNTING INSTALLATION AT TOP OR BOTTOM (TO CONCRETE)			WALL MOUNTING INSTALLATION AT TOP OR BOTTOM (TO MASONRY)		
	SHUTTER SPAN			SHUTTER SPAN		
	5'-0" OR LESS	5'-0" TO 8'-6"	8'-6" TO MAX. ALLOWED	5'-0" OR LESS	5'-0" TO 8'-6"	8'-6" TO MAX. ALLOWED
FROM 40.0 TO 60.0	9	9	9	9	9	6.5
	9	9	9	9	9	9
	9	9	9	9	9	9
FROM >60.0 TO 75.0	9	9	9	9	7.5	6
	9	9	9	9	9	8.5
	9	9	9	9	9	9
FROM >75.0 TO 90.0	9	9	9	9	6	5.5
	9	9	9	9	9	8
	9	9	9	9	9	9
FROM >90.0 TO 120.0	9	9	9	8	4.5	4.5
	9	9	9	9	7	7
	9	9	9	9	9	9
FROM >120.0 TO 170.0	9	9	-	5	4.5	-
	9	9	-	8	6.5	-
	9	9	-	9	9	-
FROM >170.0 TO 230.0	9	9	-	4.5	4.5	-
	9	9	-	6.5	6.5	-
	9	9	-	9	9	-

ANCHORS LEGEND

ANCHORS TYPE	ANCHOR MIN. SPACING
TAPCON OR MAXI-SET TAPCONS	3.0"
CALK-IN 3000 psi. (MIN.) CONCRETE	2.5"
CRETE-FLEX SS4 3350 psi. (MIN.) CONCRETE	3.0"


TAPCON OR MAXI-SET TAPCONS
CALK-IN
CRETE-FLEX SS4

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE 04/23/2001
BY *Heather H. Walker*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0328-03


MIAMI-DADE COUNTY

TILECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6595 N.W. 36th St., Ste. 217, VIRGINIA GARDENS, FL 33186
Phone: (305)871-1530 Fax: (305)871-1531
EB-0006719
WALTER A. TILLIT Jr. P. E.
FLORIDA Lic. # 44167


HPMA/PERFORMANCE SYSTEM 1 ACCORDION SHUTTER						AS SHOWN SCALE
CALLEJA'S ACCORDION SHUTTERS, INC. 295 W 27 ST. HIALEAH, FL 33010						3/26/01
						DATE
REV. No						DRAWING No
1	-	-	3	-	-	01-070
2	-	-	4	-	-	SHEET 5 OF 6

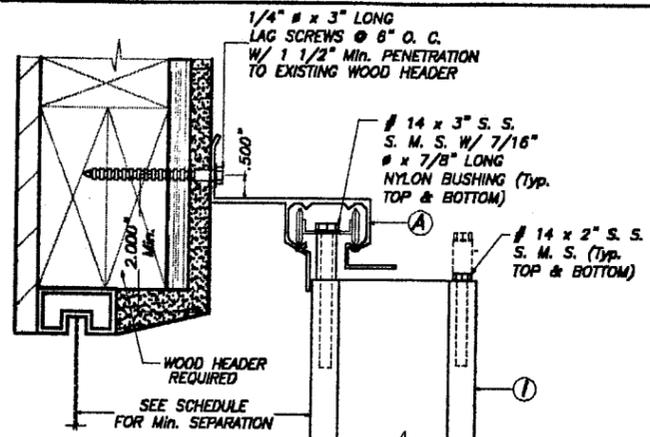


ALTERNATIVE 1

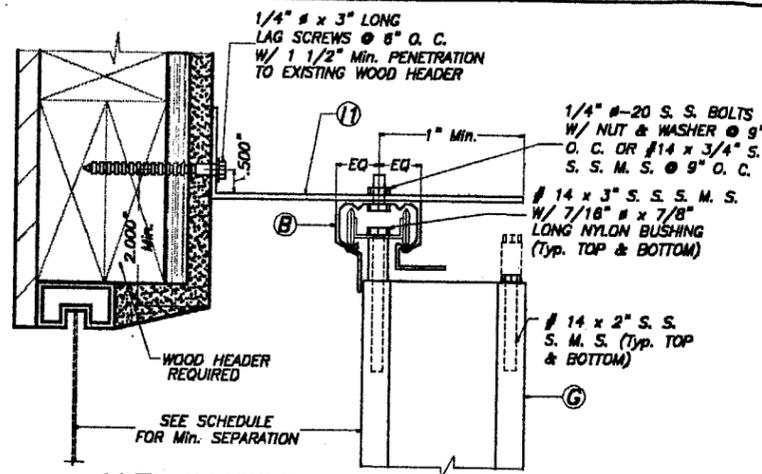


ALTERNATIVE 3

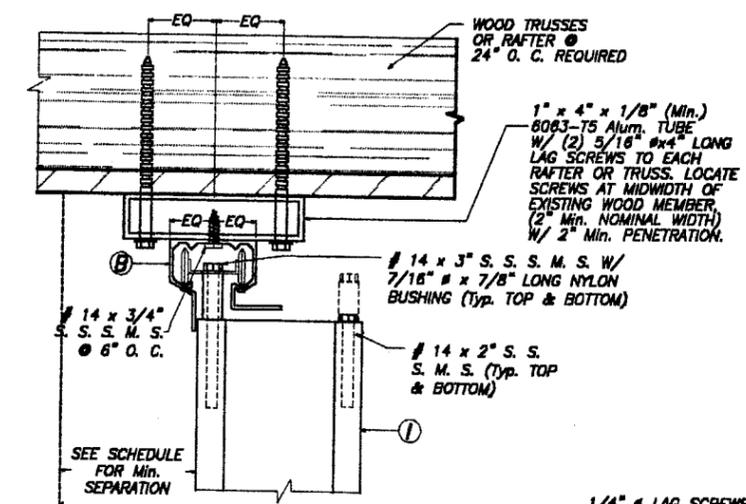


ALTERNATIVE 1

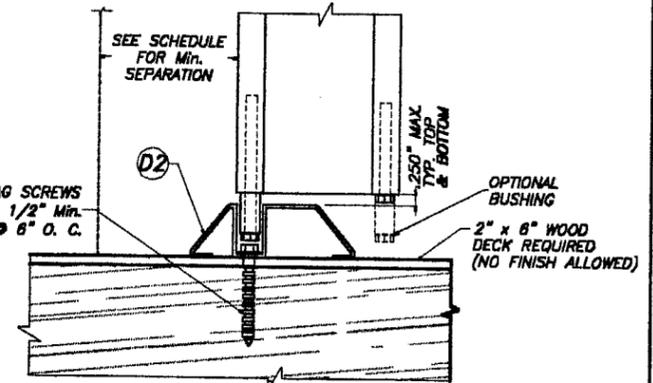


ALTERNATIVE 3

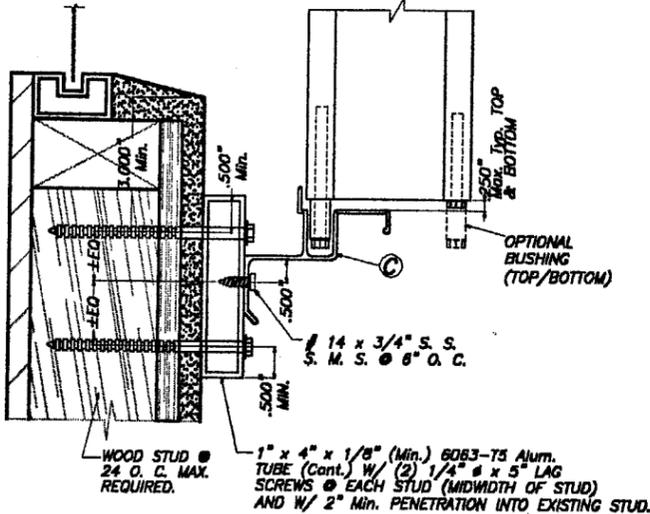


ALTERNATIVE 2

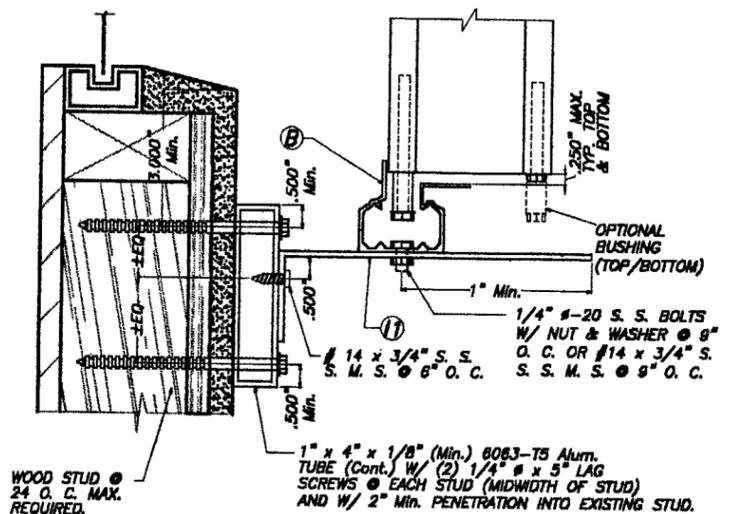


ALTERNATIVE 4

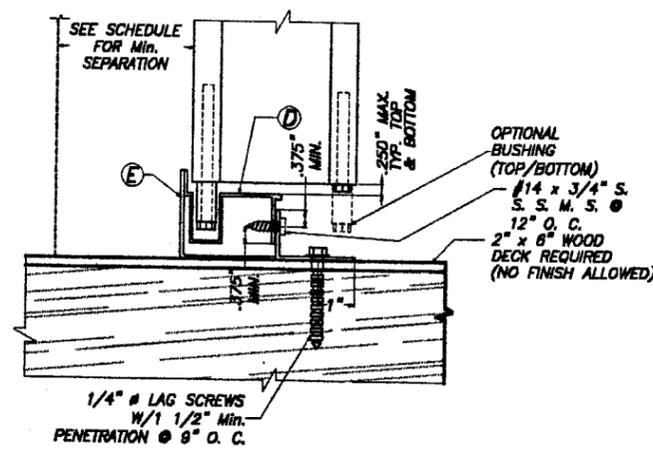

ALTERNATIVE 2

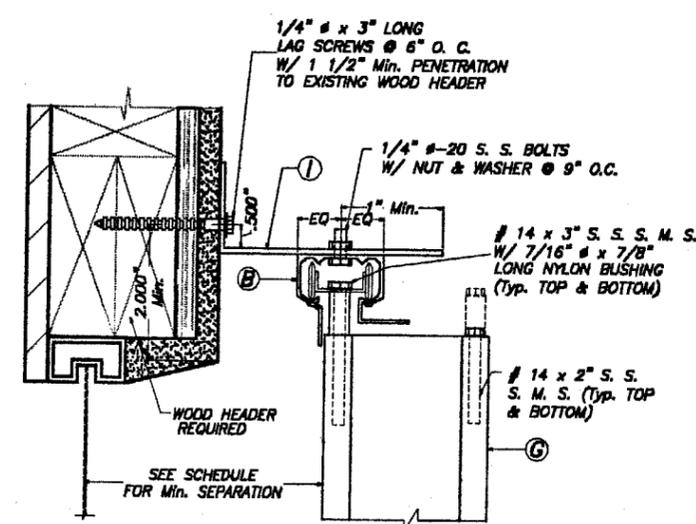

ALTERNATIVE 5

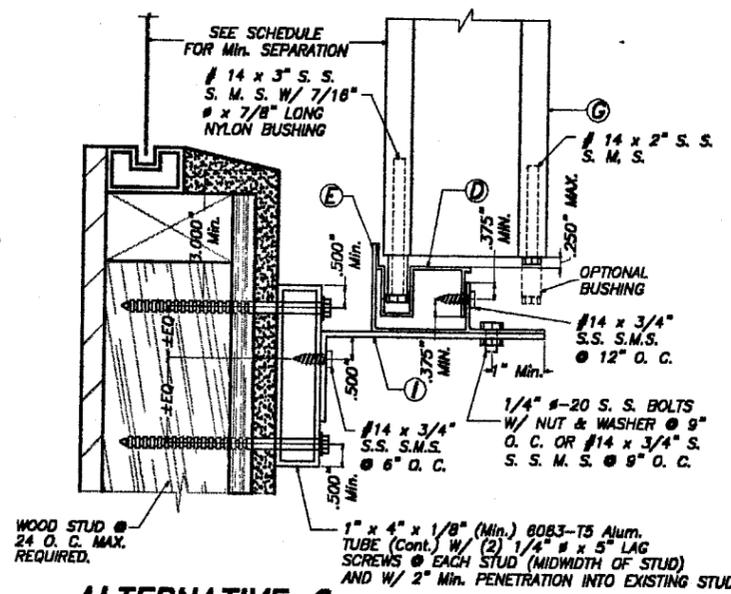

ALTERNATIVE 6

WALL MOUNTING INSTALLATION (OFFSET)

SECTIONS B

SCALE: 1/4"=1"

NOTE: WALL/FLOOR/CEILING MOUNTING SECTIONS CAN BE COMBINED IN ANY WAY TO SUIT ANY INSTALLATION.

- NOTES:
- INSTALLATIONS ARE ONLY VALID FOR INSTALLATIONS WITH DESIGN WIND LOADS LESS THAN OR EQUAL TO 75 p.s.f. AND 9'-0" Max. SHUTTER SPAN.
 - FOR NEW WOOD FRAME CONSTRUCTION: WOOD MEMBERS TO BE SOUTHERN PINE No. 2, W/ SPECIFIC DENSITY OF 0.55 OR EQUAL.

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE 04/23/2001 BY *Walter A. Tillit Jr.* PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. 01-0328.03

MIAMI-DADE COUNTY

WALL MOUNTING INSTALLATION (OFFSET)
SECTIONS A
SCALE: 1/4"=1"
INSTALLATION DETAILS ON EXISTING WOOD BUILDINGS

Walter A. Tillit Jr.
3/26/01

<p>TILECO INC. TILLIT TESTING & ENGINEERING COMPANY 6585 N.W. 38th St., Ste. 217, WIRSHAW GARDENS, FL 33188 Phone: (305)871-1530 Fax: (305)871-1531 EB-0006719 WALTER A. TILLIT, JR., P. E. FLORIDA Lic. # 44167</p>		HPMA/PERFORMANCE SYSTEM 1 ACCORDION SHUTTER		AS SHOWN SCALE	
		<p>CALLEJA'S ACCORDION SHUTTERS, INC. 295 W 27 ST. HALEAH, FL 33010</p>		3/28/01 DATE	
		01-070		DRAWING No	
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	-	-	2	-	-
2	-	-	4	-	-
				DRAWING No	
				SHEET 6 OF 8	