



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Kawneer Company, Inc.
555 Guthridge Court
Norcross, GA 30092

Your application for Notice of Acceptance (NOA) of:

Seriew 350 Medium Stile Outswing Aluminum Storefront Door - Impact w/IR 500 Framing System
under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez
Chief Product Control Division

ACCEPTANCE NO.: 01-0418.01
EXPIRES: 02/02/2004

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL CONDITIONS BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 06/14/2001

Kawneer Company, Inc.

ACCEPTANCE No. : 01-0418.01

APPROVED : JUN 14 2001

EXPIRES : February 02, 2004

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

1.1 This **revises** the Notice of Acceptance No. **00-0705.10**, which was issued on February 20, 1997. It approves an outswing aluminum storefront door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

2.1 The **Series "350" Medium Stile Outswing Aluminum Storefront Door- Impact with IR 500 Framing System** and its components shall be constructed in "Product Approval Drawings, Kawneer 350 Doors – Impact, Multiple Infills, Protocols strict compliance with the following documents: Drawing No. **T200-800**, Sheets 1 thru 8 of 8, titled PA 201/202/203", dated 12/4/00, with revision #1 dated 1/11/01, and revision #2 dated 4/10/01, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

3.1 This approval applies to single unit applications of pair of doors and single door with sidelite and transom, as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.

3.2 Unit shall be installed only at locations protected by a canopy or overhang such that the angle between the edge of canopy or overhang to sill is less than 45 degrees. Unless unit is installed in non-habitable areas where the unit and the area are designed to accept water infiltration.

4. INSTALLATION

4.1 The outswing aluminum storefront door, and its components shall be installed in strict compliance with the approved drawings.

4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.

5. LABELING


5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance.

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

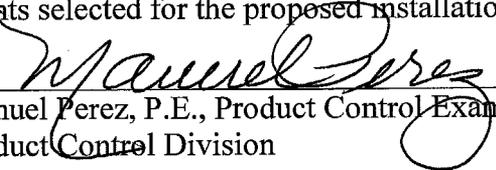
Manuel Perez, P.E., Product Control Examiner
Product Control Division

Kawneer Company, Inc.

ACCEPTANCE No. : 01-0418.01


APPROVED : JUN 14 2001

EXPIRES : February 02, 2004

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documents, including test-supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approval", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes.
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product.
 - d. The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process.
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE

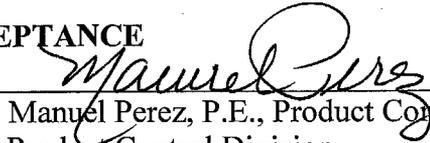
Manuel Perez, P.E., Product Control Examiner
Product Control Division

Kawneer Company, Inc.

ACCEPTANCE No. : 01-0418.01

APPROVED : JUN 14 2001

EXPIRES : February 02, 2004

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA.)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **T200-800**, Sheets 1 thru 8 of 8, titled "Product Approval Drawings, Kawneer 350 Doors – Impact, Multiple Infills, Protocols PA 201/202/203", dated 12/4/00, with revision #1 dated 1/11/01, and revision #2 dated 4/10/01.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94.
 - 4) Large Missile Impact Test, SFBC PA 201-94
 - 5) Cyclic Loading Test, per SFBC PA 203-94

along with installation diagram of a Kawneer "350" medium stile aluminum out-swinging storefront entrance door with two point lock, prepared by American Test Lab of South Florida No. **ATL-1118.01-99** dated 4/25/00, signed and sealed by William R. Mehner, P.E. and Henry Hattem, P.E.

C. CALCULATIONS


1. Anchor calculations prepared by Robt. E. Fisher - Wm. M. Meyers, P.E. Consulting Engineers, dated 5/31/00, signed and sealed by Wm. M. Meyers, P.E.

D. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **96-0904.07** issued to E.I. DuPont DeNemours for "Sentry Glass Series 457 Laminate Glass" dated 04/24/97, expiring on 04/24/00.
2. Notice of Acceptance No. **99-0930.01** issued to Security Impact Glass Holdings L.L.C. for "SAF-GLAS" dated 12/16/99, expiring on 12/16/2002.
3. Notice of Acceptance No. **00-0614.09** issued to Viracon Inc. for "HRG-2 Laminated Glass" dated 11/02/2000, expiring on 10/16/2003.
4. Laboratory compliance letter, issued by American Test Lab of South Florida, dated 04/25/00, signed and sealed by William R. Mehner, P.E. and Henry Hattem, P.E.

E. STATEMENTS

1. Statement letter of conformance, dated June 02, 2000, signed and sealed by Robert E. Fisher and William M. Meyers, P.E.
2. Statement letter of no financial interest, dated June 02, 2000, signed and sealed by Robert E. Fisher and William M. Meyers, P.E.

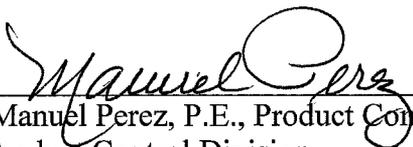
Manuel Perez, P.E., Product Control Examiner
Product Control Division

Kawneer Company, Inc.

ACCEPTANCE No. : 01-0418.01

APPROVED : JUN 14 2001

EXPIRES : February 02, 2004


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


(For File ONLY. Not part of NOA.)

3. Laboratory compliance letter, issued by American Test Lab of South Florida, dated 04/25/00, signed and sealed by William R. Mehner, P.E. and Henry Hattem, P.E.

F. OTHER

1. Notice of Acceptance No. **00-0705.10** issued to Kawneer Company, Inc. for their Series "350" Medium Stile Outswing Aluminum Storefront Door- Impact with IR 500 Framing System, dated 02/01/01, expiring on 02/01/04.

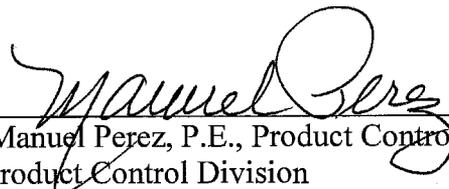
Manuel Perez, P.E., Product Control Examiner
Product Control Division

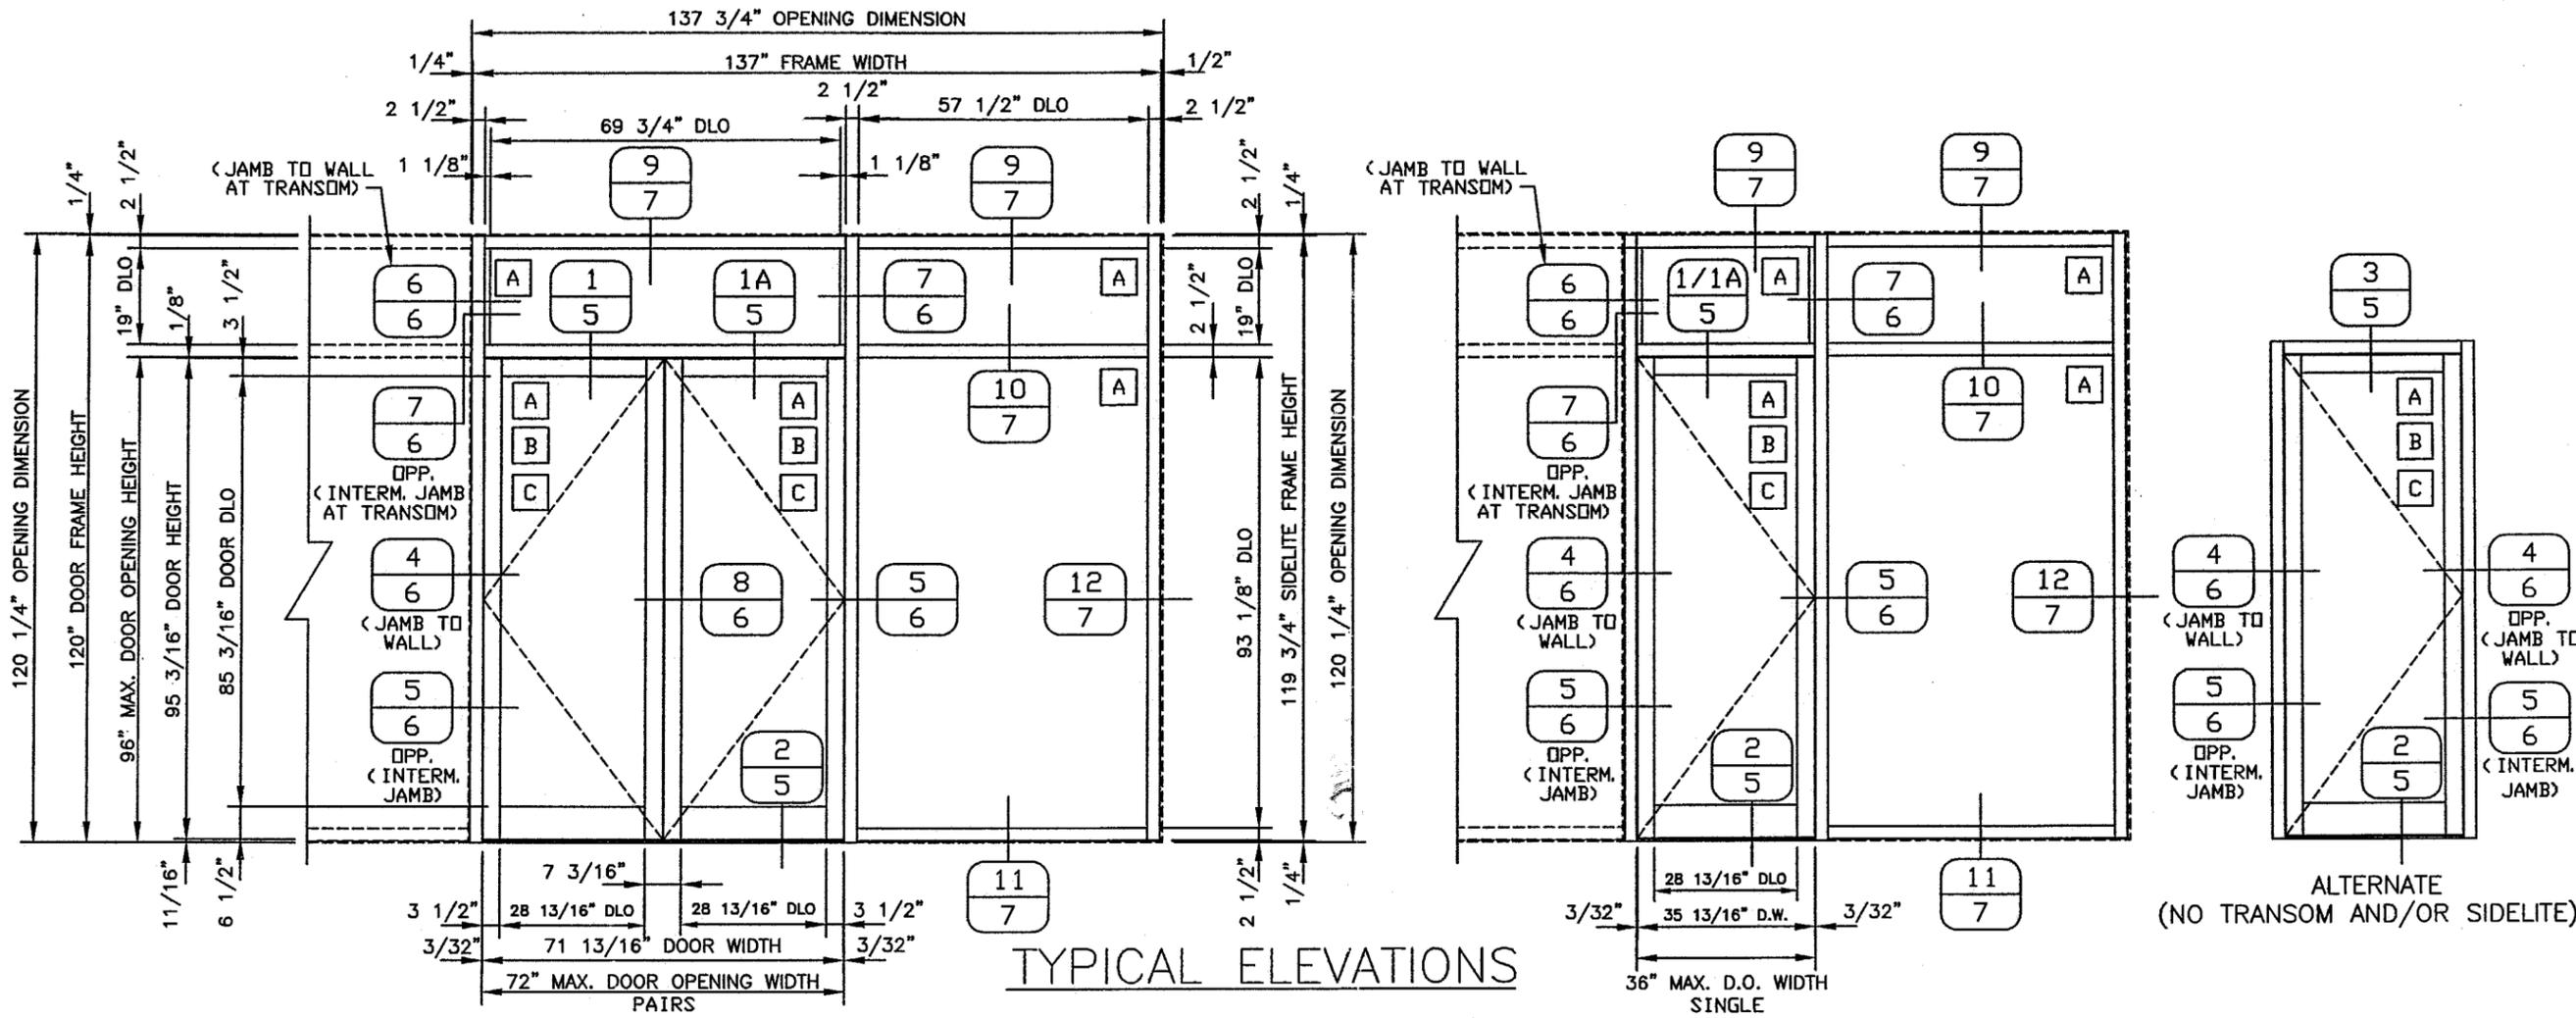

TYPICAL ELEVATIONS

DESIGN PRESSURE = +/- 85 PSF

GLAZING SCHEDULE	
GLASS TYPE	MAX. DLO SIZE
[A] = 1/4" TEMPERED SentryGlas® [B] = 9/16" HRG-2 LAMINATED GLASS BY VIRACON 3/16" HEAT STRENGTHENED OUTBOARD LITE/.050 URETHANE/.080 POLYCARBONATE/ .050 URETHANE/3/16" HEAT STRENGTHENED INBOARD LITE [C] = 7/16" SAF-GLAS LAMINATED GLASS BY SECURITY IMPACT GLASS 3/16" HEAT STRENGTHENED OUTBOARD LITE/.070 POLYCARBONATE/ 3/16" HEAT STRENGTHENED INBOARD LITE	28.813" x 85.188" = 17.1 SQ. FT.
TYPICAL DOOR GLASS SIZE = DLO - 1/2"	TYPICAL FRAME GLASS SIZE = DLO + 1-1/4"

- NOTES:
- SEE SHEET 2 OF 8 FOR PERIMETER FASTENER SCHEDULE AND LOCATIONS.
 - SEE IR 500 PRODUCT APPROVALS FOR OTHER FRAME AND FRAME GLAZING OPTIONS.
 - THESE DRAWINGS SHOULD BE USED IN CONJUNCTION WITH THE STANDARD PRODUCT INSTALLATION INSTRUCTIONS.

ALTERNATE (NO TRANSOM AND/OR SIDELITE)

E.C. NO.	REV.	DATE	DESCRIPTION	JME	JME	JME	BY
				NO CHANGE	REVISED PER DADE COUNTY	INITIAL SUBMITTAL	
2	4-10-01						
1	1-11-01						
1	12-4-00						

01-04 18.01

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE JUN 14 2001
 BY [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0418.01

DADE COUNTY NOA NO. 00-0705.10
Kawneer
 An Alcoa Company
 Product Engineering & Development
 555 GUTHRIDGE COURT
 NORCROSS, GEORGIA 30092
 PHONE (770) 449-5555
 FAX (770) 734-1560

THIS DRAWING IS FOR DADE COUNTY PRODUCT APPROVAL ONLY

DESCRIPTION	DRAWN BY	DATE
PRODUCT APPROVAL DRAWINGS KAWNEER 350 DOORS - IMPACT MULTIPLE INFILLS PROTOCOLS PA 201/202/203	JME	12-4-00
	DRWG. NO.	T200-800
	SHEET	1 of 8
		T200-800-1.DWG

#	PT. NO.	DESCRIPTION	DIMENSIONS	MATERIAL	MANUFACTURER	NOTES
36	963-239	INTERIOR DOOR GLASS STOP	1.354 x 1.359 x .100	6063-T5 ALUMINUM	KAWNEER	
37	963-240	EXTERIOR DOOR GLASS STOP	1.273 x .500 x .070	6063-T5 ALUMINUM	KAWNEER	
38	28-260	DOOR STOP ATTACHMENT SCREW	#8 x 3/8" PHTFS	CARBON STEEL - ZINC PLATED	VARIES	
39	128-267	SPLINE SCREW	#12 x 1" PHTFS	300 SERIES STAINLESS STEEL	VARIES	
40	128-271	STEEL ATTACHMENT SCREW	#12 x 5/8" PHTFS	300 SERIES STAINLESS STEEL	VARIES	
41	128-910	DOOR GLASS STOP ATTACHMENT SCREW	#10 x 1/2" FHTFS	300 SERIES STAINLESS STEEL	VARIES	
42	28-315	DOOR BOTTOM RAIL WEATHER SWEEP ATTACHMENT SCREW	#6 x 3/8" FHTFS	400 SERIES STAINLESS STEEL	VARIES	
43	128-439	DOOR ADJUST. ASTRAGAL WEATHERING ATTACHMENT SCREW	#6 x 11/16" FH	ZINC PLATED CARBON STEEL	VARIES	

MATERIALS LIST


REVISIONS	DOOR NO.: DADE COUNTY APPROVED PRODUCT				ELEV.:			
	DOOR TYPE: 350, S/A PAIR, D.P. or B.H.		SIZE: 6'-0" X 8'-0"	FIN.:	QTY.:	ARCH. HDWR. SET: -		
	HARDWARE DESCRIPTION	PART NUMBER	FINISH	QUANTITY	BY KAWNEER OTHERS	PHYSICAL HDWR BY OTHERS REQ'D AT KAWNEER	PREPARATION KAWNEER FIELD	SHIP LOOSE
	CLOSER OPTIONAL	-	-	-				
	TOP OFFSET PIVOT	50-322		2	X		X	
	INTERMEDIATE OFFSET PIVOT	50-331		2	X		X	
	BOTTOM OFFSET PIVOT	50-326/327		2	X		X	
	A/R CYL. OPERATER FLUSHBOLT	1871W-30-628		4	X		X	
	A/R FLUSHBOLT GUIDE PACKAGE	41-0828		4	X		X	
	A/R 1850A MS LOCK	50-112		2	X		X	
	CYLINDERS	37-177		5	X		X	
	THRESHOLD	69-139	10	1	X		X	
	BOTTOM DOOR WEATHERING	200-795		2	X		X	X
	THUMBURNS (INTERIOR)	37-176		5	X		X	
	ALTERNATE HINGING							
	BUTT HINGES	37-232		6	X		X	

200-795 BOTTOM DOOR WEATHERING: 27-406 SWEEP GASKET EXTRUSION
27-407 SWEEP GASKET FILLER
27-309 SWEEP GASKET
A/R = ADAMS RITE


REVISIONS	DOOR NO.: DADE COUNTY APPROVED PRODUCT				ELEV.:			
	DOOR TYPE: 350, S/A SINGLE, D.P. or B.H.		SIZE: 3'-0" X 8'-0"	FIN.:	QTY.:	ARCH. HDWR. SET: -		
	HARDWARE DESCRIPTION	PART NUMBER	FINISH	QUANTITY	BY KAWNEER OTHERS	PHYSICAL HDWR BY OTHERS REQ'D AT KAWNEER	PREPARATION KAWNEER FIELD	SHIP LOOSE
	CLOSER OPTIONAL	-	-	-				
	TOP OFFSET PIVOT	50-322		1	X		X	
	INTERMEDIATE OFFSET PIVOT	50-331		1	X		X	
	BOTTOM OFFSET PIVOT	50-326/327		1	X		X	
	A/R CYL. OPERATER FLUSHBOLT	1871W-30-628		2	X		X	
	A/R FLUSHBOLT GUIDE PACKAGE	41-0828		2	X		X	
	A/R 1850A MS LOCK	50-112		1	X		X	
	CYLINDERS	37-177		3	X		X	
	THRESHOLD	69-139	10	1	X		X	
	BOTTOM DOOR WEATHERING	200-795		1	X		X	X
	THUMBURNS (INTERIOR)	37-176		3	X		X	
	ALTERNATE HINGING							
	BUTT HINGES	37-232		3	X		X	

200-795 BOTTOM DOOR WEATHERING: 27-406 SWEEP GASKET EXTRUSION
27-407 SWEEP GASKET FILLER
27-309 SWEEP GASKET
A/R = ADAMS RITE

HARDWARE SCHEDULES

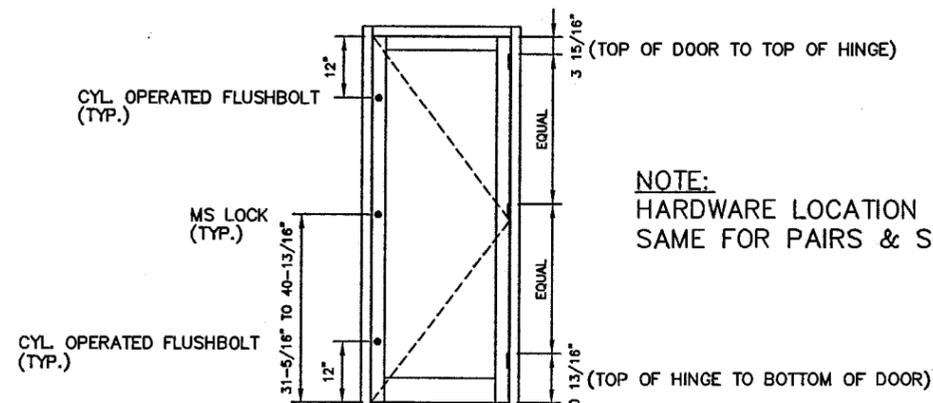

TYPICAL HARDWARE LOCATION (BUTT HINGES)

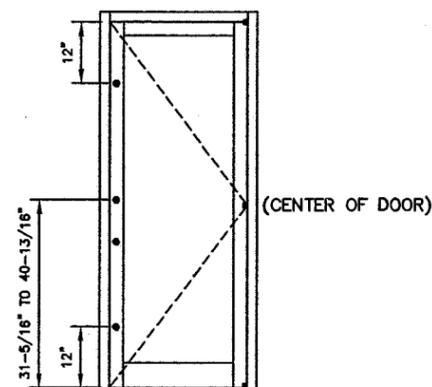

TYPICAL HARDWARE LOCATION (OFFSET PIVOTS)

NOTE:
HARDWARE LOCATION IS THE
SAME FOR PAIRS & SINGLES

DOOR CORNER CONSTRUCTION

VERTICAL STILES RUN THROUGH AND ARE ATTACHED TO THE TOP AND BOTTOM RAILS WITH 1/4" THICK EXTRUDED ALUMINUM CHANNELS, 1/4-20 x 3/4" PAN HEAD MACHINE SCREWS, AND 3/16" THICK STEEL NUT PLATES. THE INTERSECTION OF EACH CORNER JOINT IS WELDED WITH A 1/2" DIAMETER PLUG WELD AND A 1-1/8" LONG FILLET WELD AT BOTH WEBS OF EACH RAIL.

DADE COUNTY NOA NO. 00-0705.10

Kawneer
An Alcoa Company
Product Engineering & Development

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560

THIS DRAWING IS FOR
DADE COUNTY
PRODUCT APPROVAL
ONLY



DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

DRAWN BY JME DATE 12-4-00
DRWG. NO. T200-800
SHEET 4 of 8 T200-800-4.DWG

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 14 2001
BY *[Signature]*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0418.01

REVISIONS	DATE	DESCRIPTION
2	4-10-01	REVISED MS LOCK LOCATION
1	1-11-01	REVISED PER DADE COUNTY
-	12-4-00	INITIAL SUBMITTAL

OPENING DIMENSION
FRAME HEIGHT

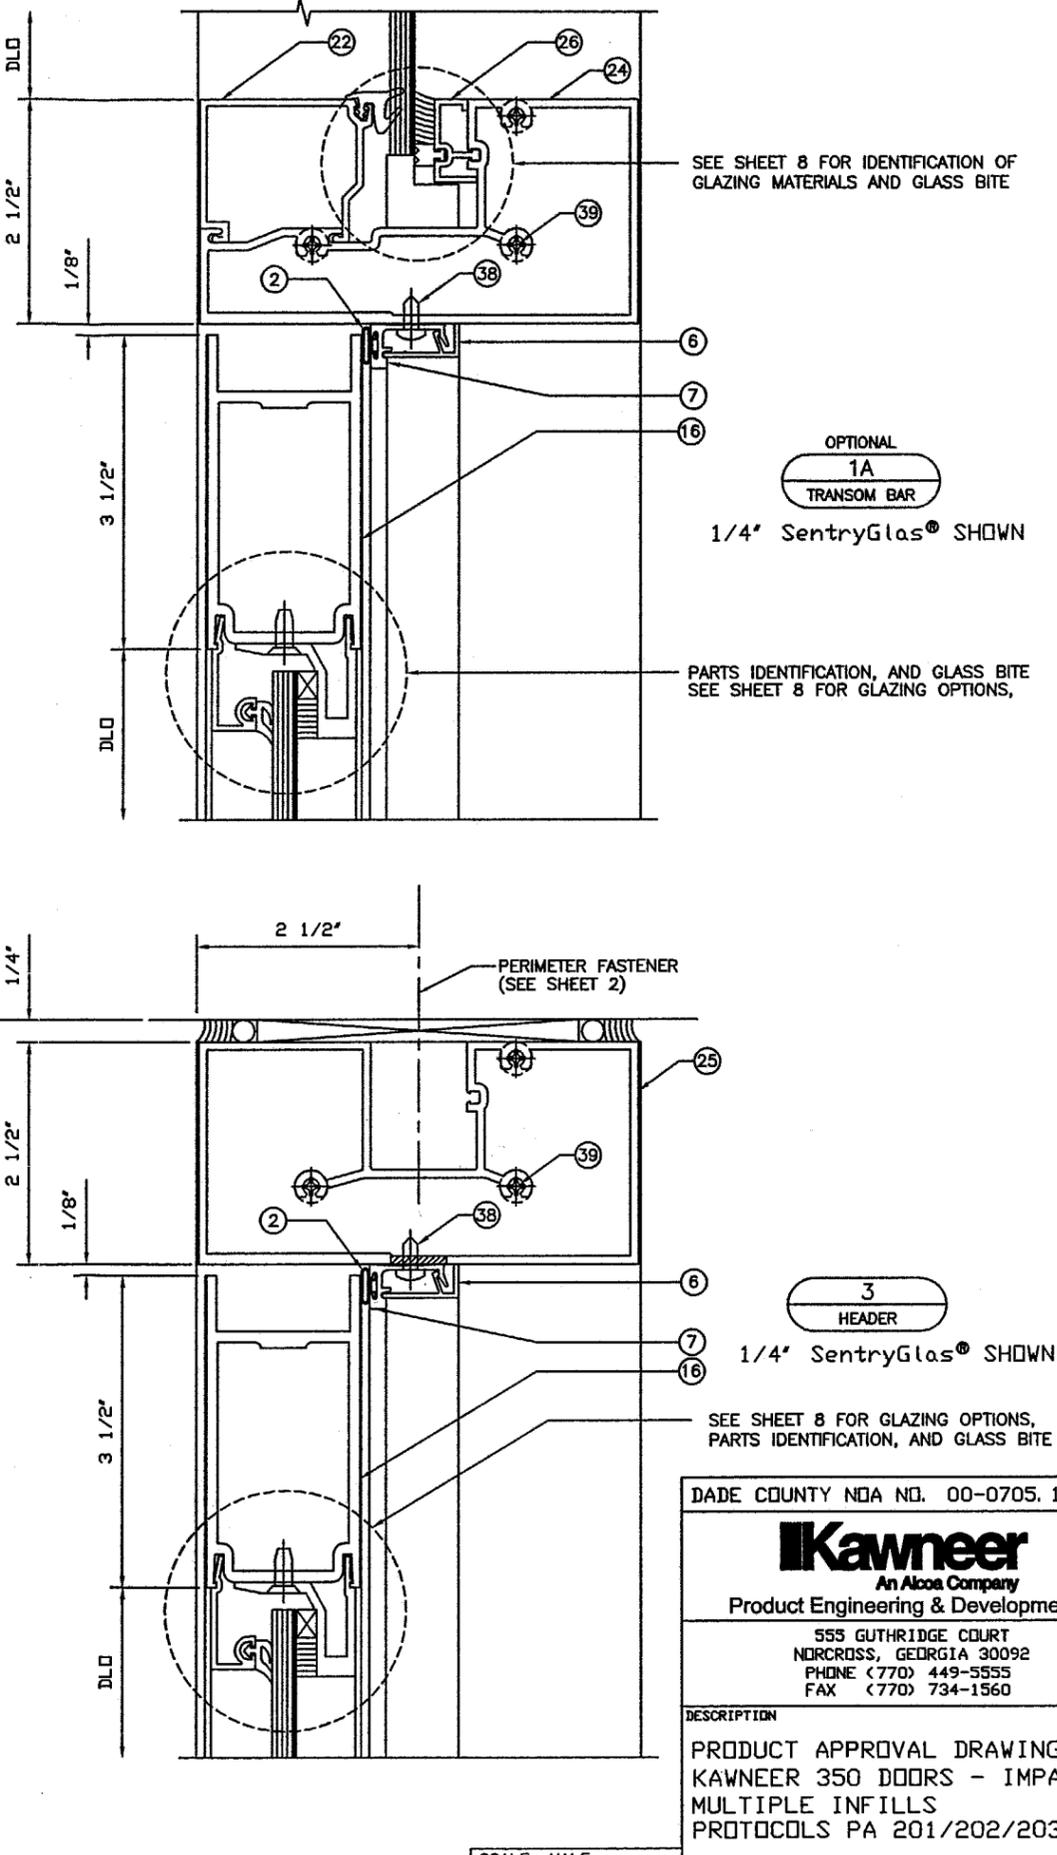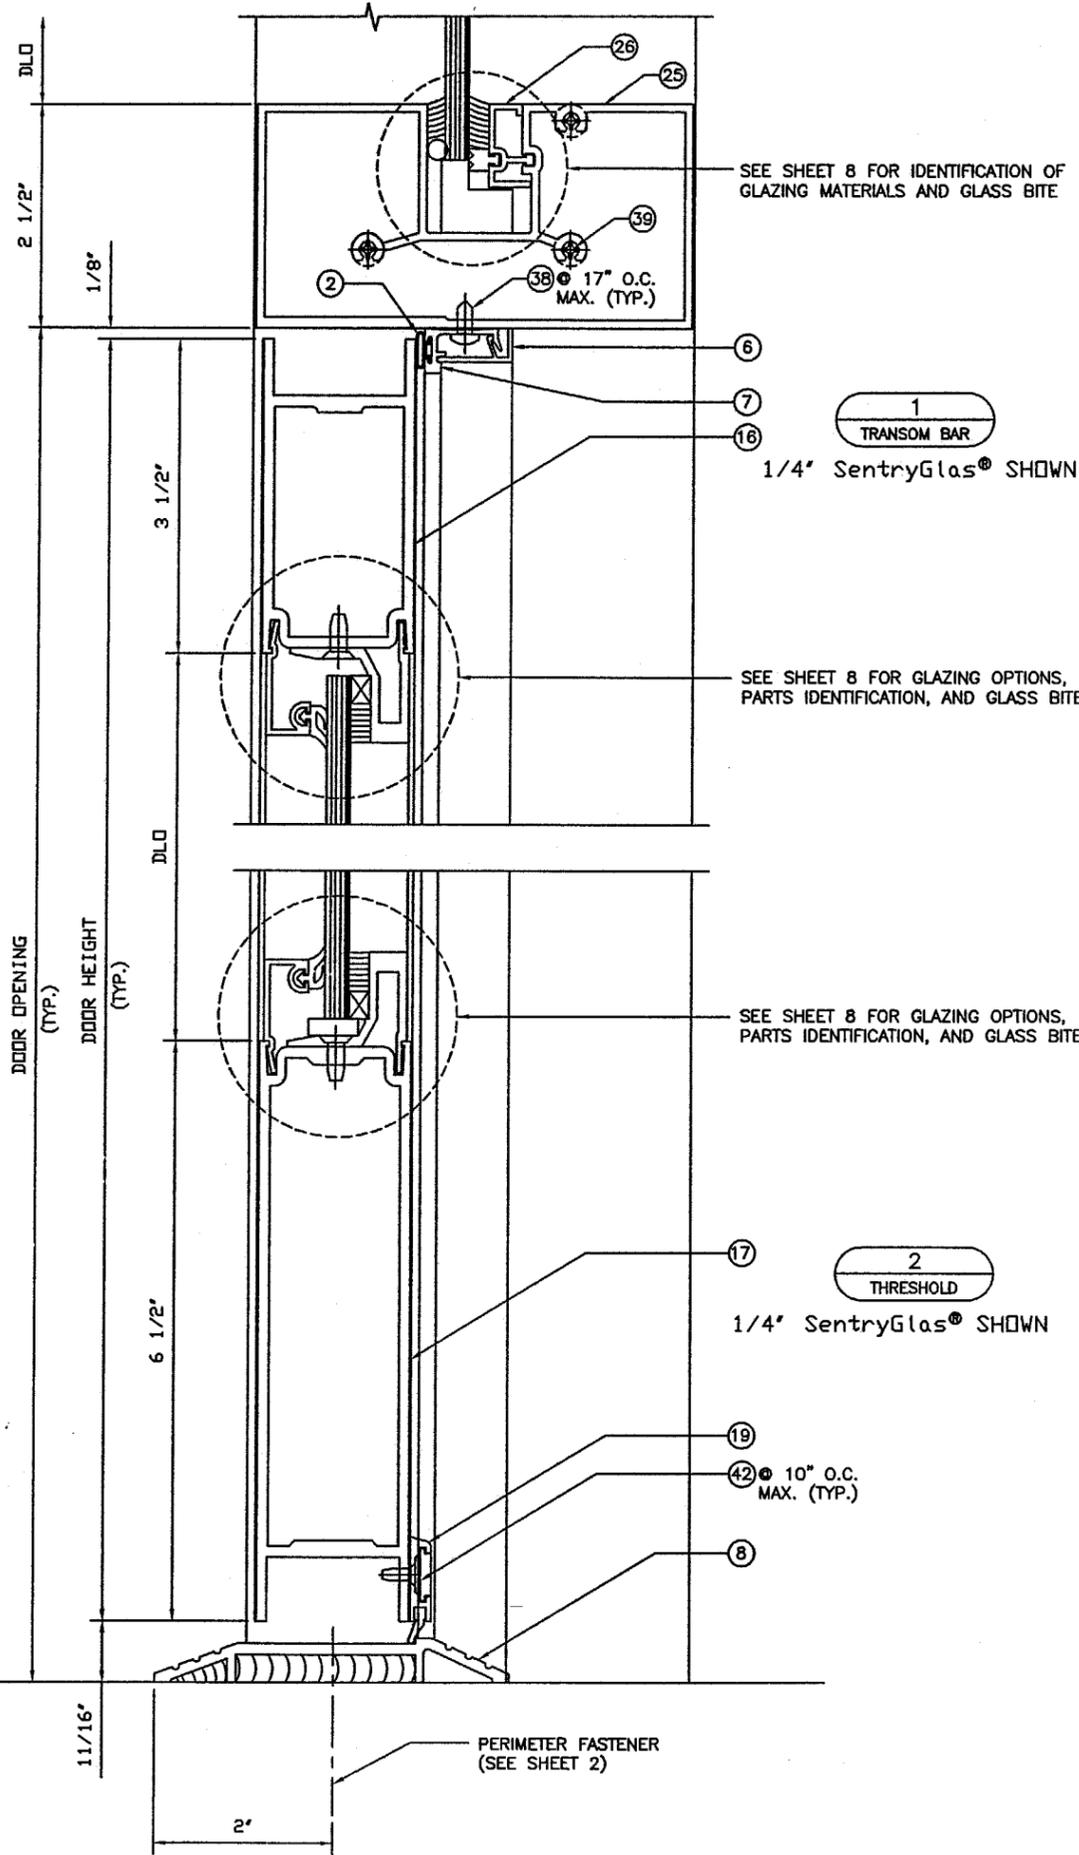

DADE COUNTY NDA NO. 00-0705.10

Kawneer
An Alcoa Company
Product Engineering & Development

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE JUN 14 2001
BY Michael King
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0418.01

THIS DRAWING IS FOR
DADE COUNTY
PRODUCT APPROVAL
ONLY


DADE COUNTY NDA NO. 00-0705.10

DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

DRAWN BY JME DATE 12-4-00
DRWG. NO. T200-800
SHEET 5 of 8 T200-800-5.DWG


NO CHANGE	REVISED PER DADE COUNTY	INITIAL SUBMITTAL	DESCRIPTION
2	4-10-01		
1	1-11-01		
-	12-4-00		
E. C. NO.	REV.	DATE	

SCALE: HALF

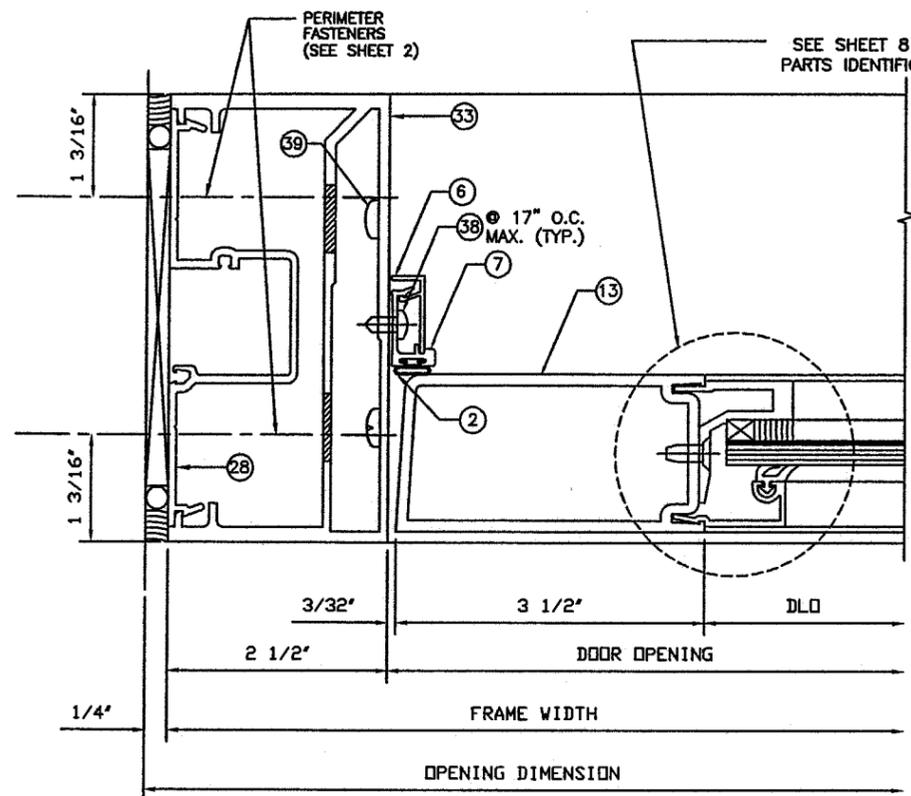


4
JAMB TO WALL

1/4" SentryGlas® SHOWN

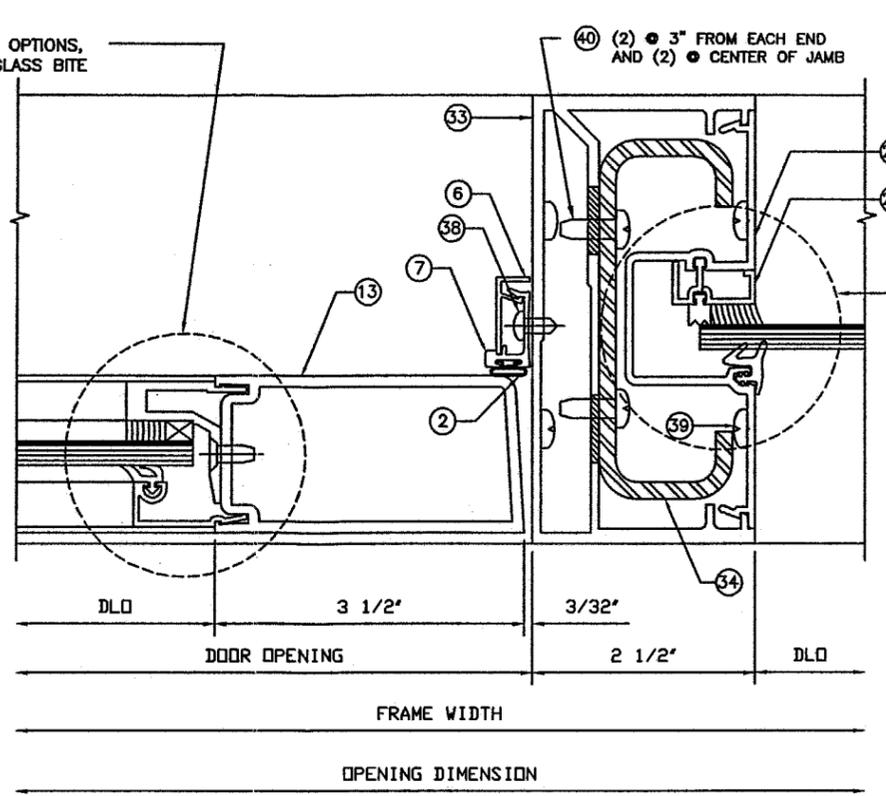


5
INTERM. JAMB

1/4" SentryGlas® SHOWN

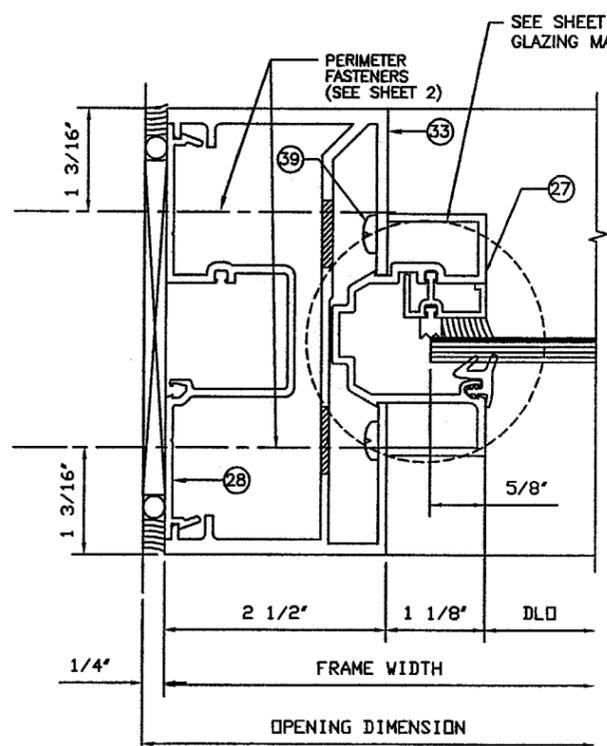


6
JAMB TO WALL

1/4" SentryGlas® SHOWN

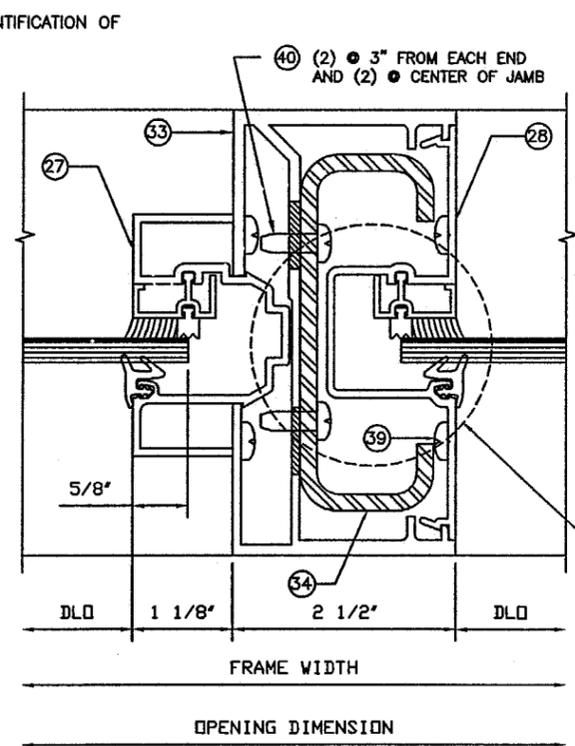

7
INTERM. JAMB

1/4" SentryGlas® SHOWN

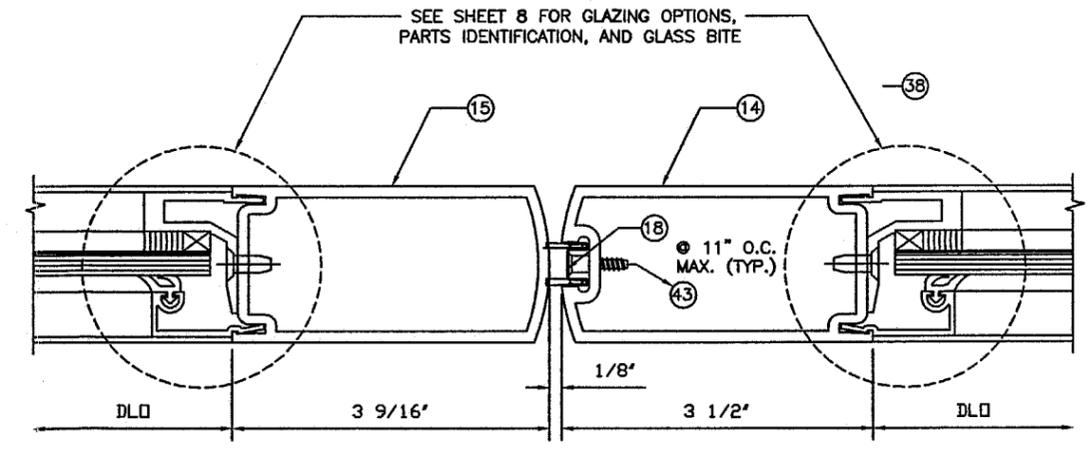

8
MEETING STILES

1/4" SentryGlas® SHOWN

SEE SHEET 8 FOR IDENTIFICATION OF GLAZING MATERIALS

SCALE: HALF

NO CHANGE	REVISED PER DADE COUNTY	INITIAL SUBMITTAL	DESCRIPTION
2	1	-	E. C. NO. REV. DATE
			4-10-01
			1-11-01
			12-4-00

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE JUN 14 2001
 BY *Walter Jera*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0418.01

DADE COUNTY NOA NO. 00-0705.10


Kawneer
 An Alico Company
 Product Engineering & Development
 555 GUTHRIDGE COURT
 NORCROSS, GEORGIA 30092
 PHONE (770) 449-5555
 FAX (770) 734-1560

THIS DRAWING IS FOR DADE COUNTY PRODUCT APPROVAL ONLY

DESCRIPTION
 PRODUCT APPROVAL DRAWINGS
 KAWNEER 350 DOORS - IMPACT
 MULTIPLE INFILLS
 PROTOCOLS PA 201/202/203

DRAWN BY	DATE
JME	12-4-00
DRWG. NO.	T200-800
SHEET	T200-800-6.DWG
6 of 8	

E. C. NO.	REV.	DATE	DESCRIPTION
2	4-10-01		NO CHANGE
1	1-11-01		REVISED PER DADE COUNTY
-	12-4-00		INITIAL SUBMITTAL
			JME
			JME
			JME
			BY

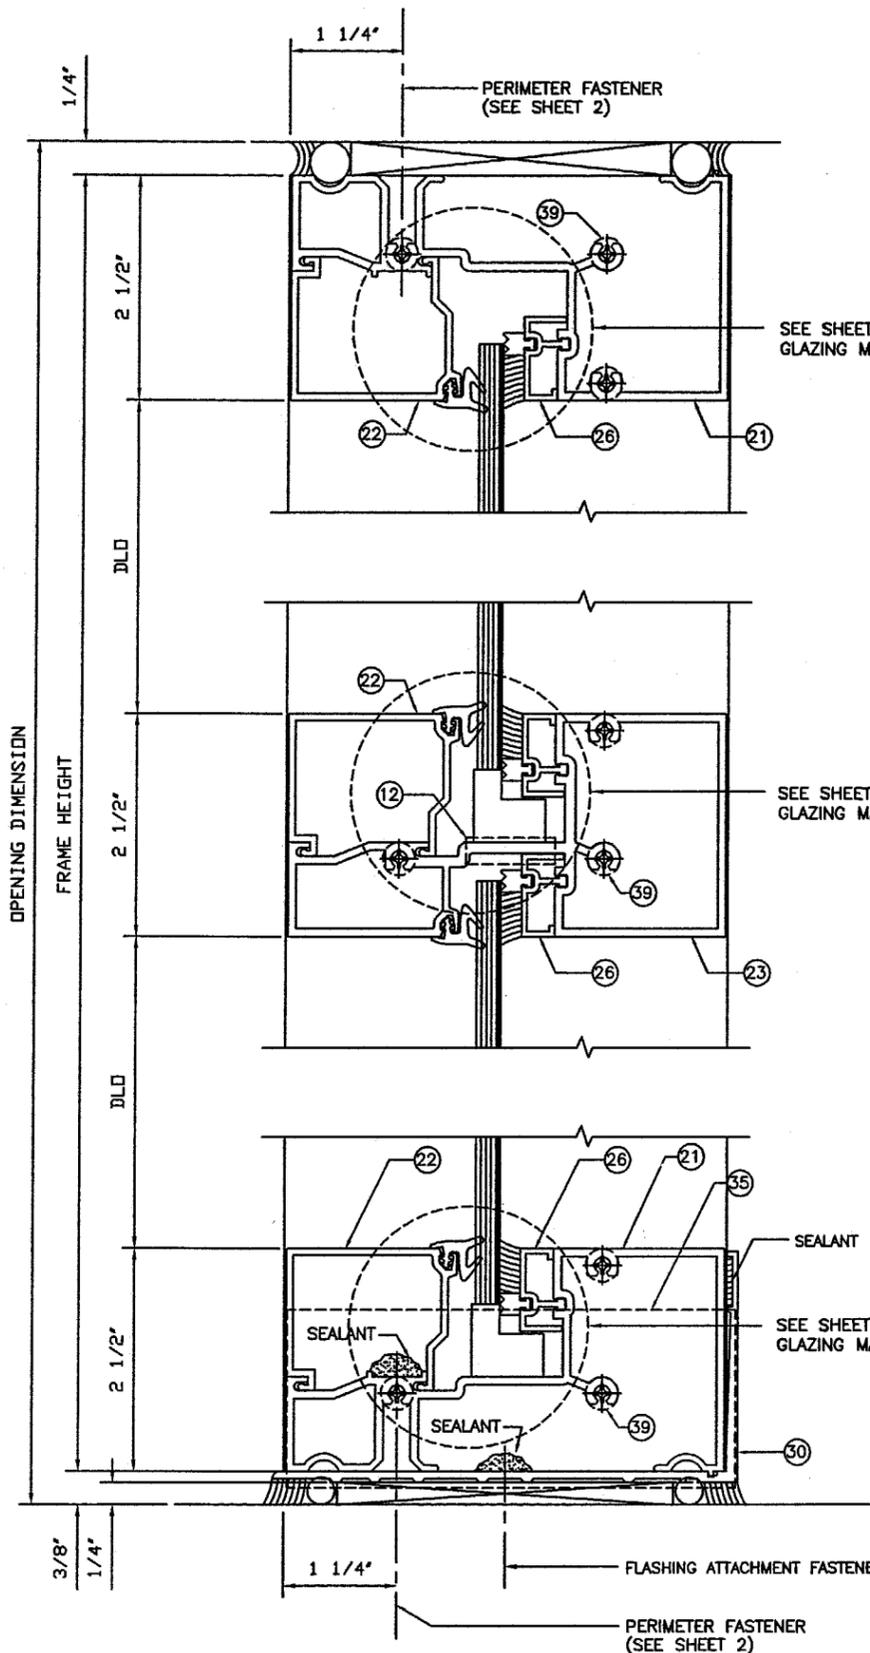

9
HEAD
1/4' SentryGlas® SHOWN
SEE IR 500 PRODUCT APPROVALS FOR OTHER FRAME AND ANCHORAGE OPTIONS


10
INTERM. HORIZ.
1/4' SentryGlas® SHOWN

11
SILL
1/4' SentryGlas® SHOWN
SEE IR 500 PRODUCT APPROVALS FOR OTHER FRAME AND ANCHORAGE OPTIONS

SEE SHEET 8 FOR IDENTIFICATION OF GLAZING MATERIALS AND GLASS BITE

SEE SHEET 8 FOR IDENTIFICATION OF GLAZING MATERIALS AND GLASS BITE

SEE SHEET 8 FOR IDENTIFICATION OF GLAZING MATERIALS AND GLASS BITE

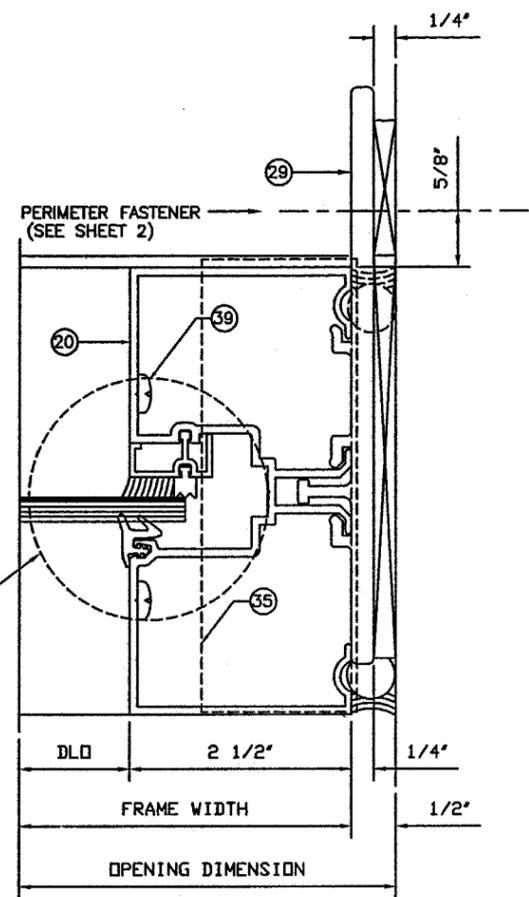

12
JAMB
1/4' SentryGlas® SHOWN
SEE IR 500 PRODUCT APPROVALS FOR OTHER ANCHORAGE OPTIONS

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE JUN 14 2001
BY *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0418.01

DADE COUNTY NOA NO. 00-0705.10

Kawneer
An Alcoa Company
Product Engineering & Development

555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560

THIS DRAWING IS FOR DADE COUNTY PRODUCT APPROVAL ONLY


DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

DRAWN BY JME DATE 12-4-00


DRWG. NO. T200-800

SHEET 7 of 8 T200-800-7.DWG


SCALE: HALF

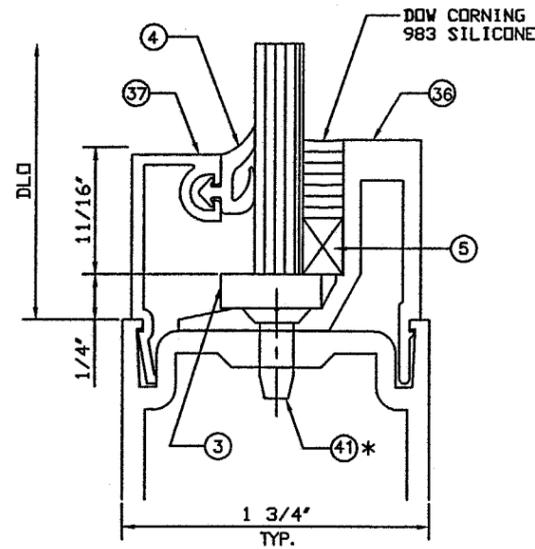


TYPICAL DOOR GLAZING DETAIL
1/4" SentryGlas®
ACTUAL SIZE

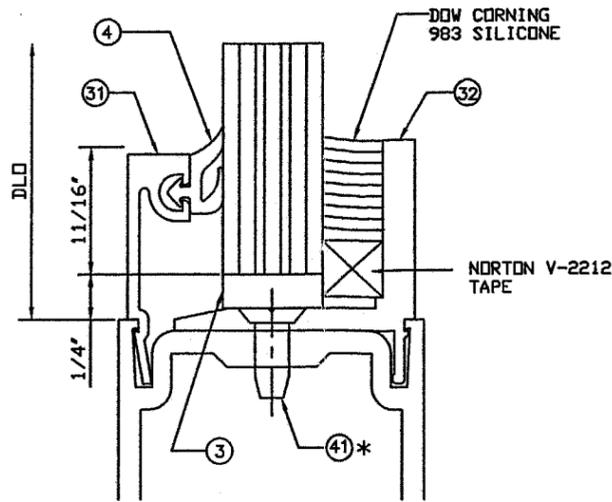

TYPICAL DOOR GLAZING DETAIL
9/16" HRG-2
ACTUAL SIZE

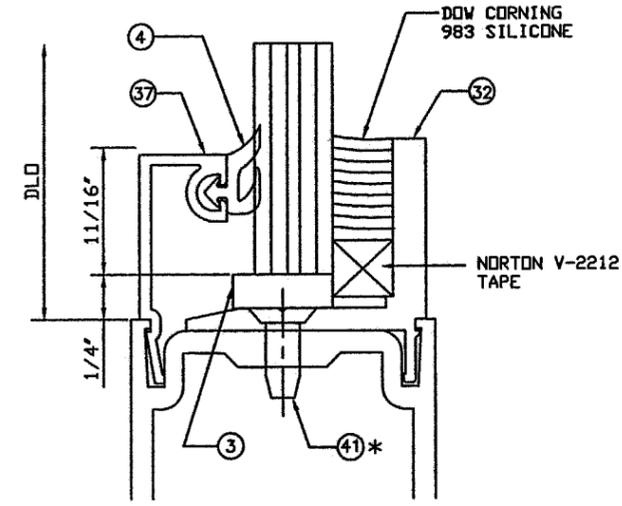

TYPICAL DOOR GLAZING DETAIL
7/16" SAF-GLAS
ACTUAL SIZE

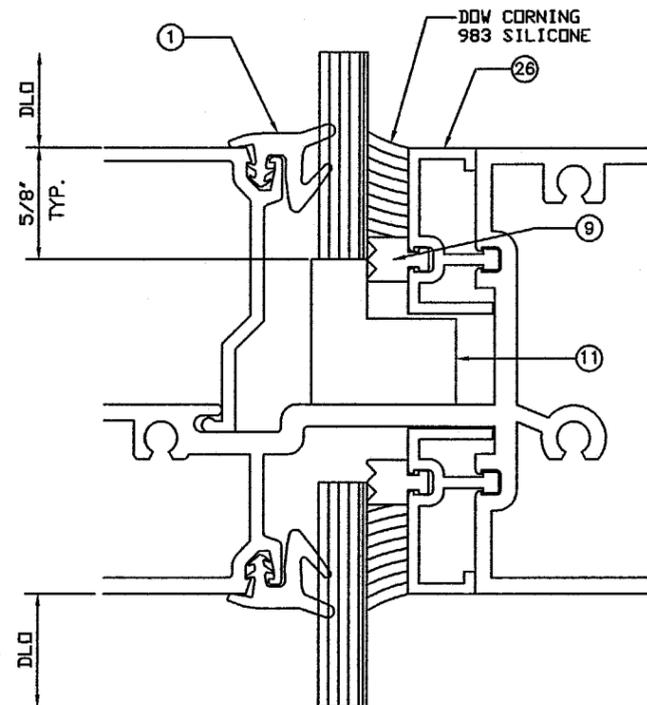

TYPICAL FRAME GLAZING DETAIL
1/4" SentryGlas® SHOWN
ACTUAL SIZE

* 3" FROM EACH END AND MAX. 7-1/2" O.C. @ TOP AND BOTTOM RAIL
3" FROM EACH END AND MAX. 11-1/8" O.C. @ VERTICAL STILES

SEE IR 500 PRODUCT APPROVALS FOR OTHER FRAME GLAZING OPTIONS

NO CHANGE	REVISED PER DADE COUNTY	INITIAL SUBMITTAL	DESCRIPTION
2	1	-	
4-10-01	1-11-01	12-4-00	DATE
			E. C. NO. REV.
			BY

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **JUN 14 2001**
BY *Manuel...*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0418.0

DADE COUNTY NOA NO. 00-0705.10
Kawneer
An Alcoa Company
Product Engineering & Development
555 GUTHRIDGE COURT
NORCROSS, GEORGIA 30092
PHONE (770) 449-5555
FAX (770) 734-1560

THIS DRAWING IS FOR
DADE COUNTY
PRODUCT APPROVAL
ONLY

DESCRIPTION
PRODUCT APPROVAL DRAWINGS
KAWNEER 350 DOORS - IMPACT
MULTIPLE INFILLS
PROTOCOLS PA 201/202/203

DRAWN BY JME DATE 12-4-00
DRWG. NO. T200-800
SHEET 8 of 8 T200-800-8.DWG

SCALE: FULL