



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Englert, Inc.**  
**1200 Amboy Avenue**  
**Perth Amboy ,NJ 08862**

Your application for Notice of Acceptance (NOA) of:

**Englert Series 2000 over Wood Deck**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**ACCEPTANCE NO.: 01-0420.01**  
**EXPIRES: 05/17/2006**

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL  
CONDITIONS  
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 05/17/2001**

**ROOFING ASSEMBLY APPROVAL**

**Category:** Roofing Approval Date: May 17, 2001  
**Sub-Category:** Non-Structural Metal Roofing Expiration Date: May 17, 2006  
**Materials:** Steel  
**Maximum Design Pressure** -62.5 psf

**TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:**

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Series 2000	l = various w = 18" Thickness 0.0276 44,700 psi Grade D Class 2	PA 110 & PA 125	Corrosion resistant, galvanized, preformed, standing seam, coated, prefinished, metal panels.
Series 2000 Clip	min. 0.048" 3 1/2" long x 1 3/4" high	PA 114 Appendix E	Corrosion resistant, formed, steel clips for metal panel installation.
Trim Pieces	l = varies w = varies Thickness 0.0276.	PA 110	Standard flashing and trim pieces. Manufactured for each panel width.

**EVIDENCE SUBMITTED:**

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Underwriters Laboratories, Inc.	91NK26936	Uplift Pressure Testing UL 580-Construction No. 359, 359A	Oct. 1992
Architectural Testing, Inc.	01-32796.01	PA 100	Sep. 1998
Architectural Testing, Inc.	01-32796.03	Tensile Test ASTM E 8-96	Oct. 1998
Architectural Testing, Inc.	ATI 99023	PA 125-95	Dec. 1999
Architectural Testing, Inc.	01-35899.01	PA 125-95	Feb. 2000




Frank Zuloaga, RRC  
 Roofing Product Control Examiner

**SERIES 2000:**



ENGLERT, INC.  
1200 AMBOY AVE.  
PERTH AMBOY, NEW JERSEY 08862

SERIES 2000  
"PANEL AND ATTACHMENT CLIP"

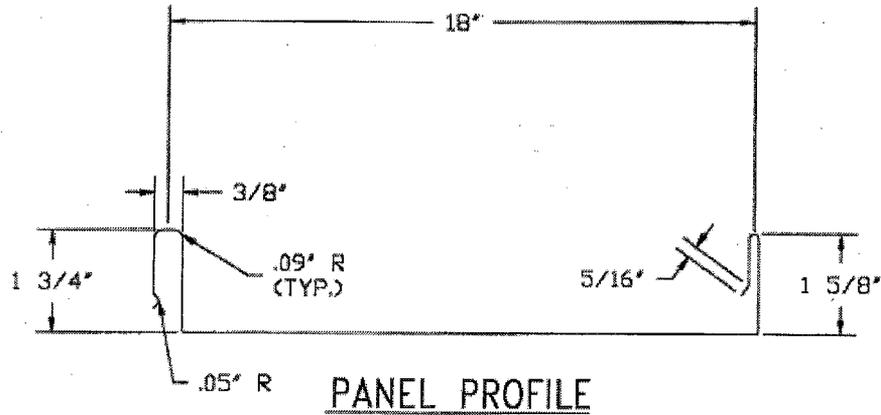


**NOTES:**

- 1. ALL DIMENSIONS ARE TO CENTER LINE OF MATERIAL.
- 2. ALL RADII ARE 0.09" UNO
- 3. PANEL TO BE MINIMUM 24 GA. STEEL
- 4. CLIPS TO BE MINIMUM 18 GA. STEEL

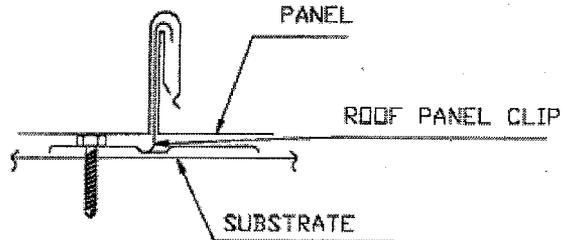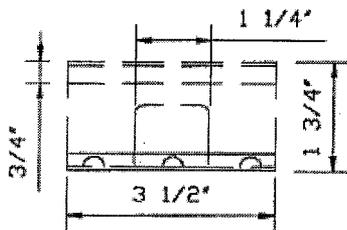

#10 FASTENERS

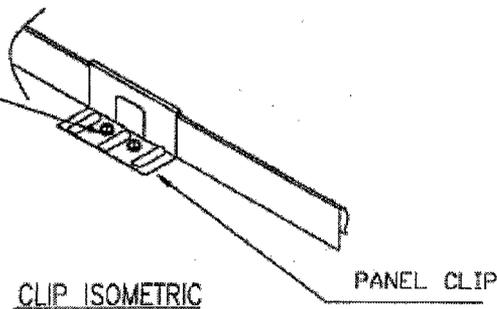

  
Frank Zuloaga, RRC  
Roofing Product Control Examiner

**APPROVED ASSEMBLIES:**

- Deck Type:** Wood, Non - Insulated
- Deck Description:** New Construction  
 $1\frac{9}{32}$ " or greater plywood or wood plank.
- Slope Range:** 2":12" or greater
- Maximum Uplift Pressure:** The maximum allowable uplift pressure for 18" panels shall be -62.5 psf.
- Deck Attachment:**  
In accordance with applicable Building Code, but in no case shall it be less than # 8 x 2" long screws spaced 6" o.c.. In reroofing, where the deck is less than  $1\frac{9}{32}$ " thick (Minimum  $1\frac{5}{32}$ ") The above attachment method must be in addition to existing attachment.
- Underlayment:** Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with approved corrosion resistant tin caps and annular ring shank nails. Spaced 6" o.c. on the laps and two rows spaced 12" o.c. in the field of roll.
- Valleys:** Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with the current published installation instructions and details in Englert Metal Roofing Installation Manual.
- Panel Clips:** Panels shall be installed with approved clips, attached to substrate with two corrosion resistant #10-16 self-tapping pancake screws of sufficient length to penetrate through the structural deck a minimum of  $\frac{3}{4}$ " at a maximum spacing not to exceed 24 inches o.c.
- Fire Barrier Board:** For class A or B fire rating, install minimum  $\frac{1}{4}$ " thick Georgia Pacific "Dens Deck" (with current NOA) or minimum 4mm thick of Tritex, RockRoof (with current NOA) or  $\frac{5}{8}$ " water resistant type X gypsum sheathing with treated core and facer.
- Metal Panels and Accessories:** Install the "Series 2000 Panel" and accessories in compliance with the current published installation instructions and details in Englert Metal Roofing Installation Manual. Flashings, penetrations, valley construction and other details shall be constructed in compliance with Roofing Application Standard RAS 133. Female leg of snap seam shall be caulked with a minimum  $\frac{1}{8}$ " bead of sealant prior to installation.



Frank Zuloaga, RRC  
Roofing Product Control Examiner

**SYSTEM LIMITATIONS:**

1. Increased design pressures at perimeter and corner areas, in compliance with applicable building code may be met through rational analysis by increasing the number of attachment points in these areas. The maximum fastener spacing noted in the "Systems Description" section of this approval shall not be exceeded. All rational analysis computation shall be prepared, signed and sealed by a Florida registered Professional Engineer, Registered Architect, or Registered Roof Consultant.
2. Panels shall be roll formed in continuous lengths from eave to ridge. Maximum lengths shall be as described in Miami-Dade County Roofing Application Protocol RAS 133.
3. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved. All clips shall be permanently labeled with manufacturer's name, and/or logo, and/or model.



Frank Zuloaga, RRC  
Roofing Product Control Examiner

**NOTICE OF ACCEPTANCE STANDARD CONDITIONS**

- 1 Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
- 2 Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
- 3 Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
- 4 Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
- 5 Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process;
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purposes.
- 6 The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
- 7 A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all times. The copies need not be resealed by the engineer.
- 8 Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
- 9 This Acceptance contains pages 1 through 7.

**END OF THIS ACCEPTANCE**

Frank Zuloaga, RRC  
Roofing Product Control Examiner