



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Caradco Windows & Doors**  
**201 Evans Road**  
**Rantoul, IL 61866**

Your application for Notice of Acceptance (NOA) of:

**Series "Car Clad" Aluminum Clad Wood Awning Window - Impact Resistant**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

**ACCEPTANCE NO.: 01-0502.12**  
**EXPIRES: 05/07/2006**

Raul Rodriguez  
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL  
CONDITIONS  
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 08/02/2001**

**Caradco Windows & Doors**

**ACCEPTANCE No.:** 01-0502.12

**APPROVED** : AUG 0 2 2001

**EXPIRES** : May 07, 2006

**NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS**

**1. SCOPE**

**1.1** This **renews** the Notice of Acceptance No. 98-1110.14, which was issued on 04/01/99. It approves an aluminum clad wood awning window, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

**2. PRODUCT DESCRIPTION**

**2.1** The Series **"Car Clad" Aluminum Clad Wood Awning Window - Impact Resistant** and its components shall be constructed in strict compliance with the following documents: Drawing No **W98-78**, Sheets 1 through 5 of 5, titled **"Car Clad Wood Awning Window,"** prepared by Al-Farooq Corporation, dated 10/10/98, with revision A dated 05/21/01, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

**3. LIMITATIONS**

**3.1** This approval applies to single unit applications, side-by-side and top-and-bottom installations, as shown in approved drawings.

**4. INSTALLATION**

**4.1** The aluminum clad wood awning window and its components shall be installed in strict compliance with the approved drawings.

**4.2** Hurricane protection system (shutters): to determine whether the installation requires a hurricane protection system or not, see corresponding "Design Load Capacity" table in approved drawing.

**5. LABELING**

**5.1** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".


**6. BUILDING PERMIT REQUIREMENTS**

**6.1** Application for building permit shall be accompanied by copies of the following:

**6.1.1** This Notice of Acceptance

**6.1.2** Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

**6.1.3** Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

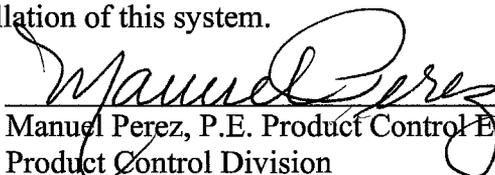  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

**Caradco Windows & Doors**

**ACCEPTANCE No.:** 01-0502.12


**APPROVED** : AUG 0 2 2001

**EXPIRES** : May 07, 2006

**NOTICE OF ACCEPTANCE: STANDARD CONDITIONS**


1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process.
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

**END OF THIS ACCEPTANCE**

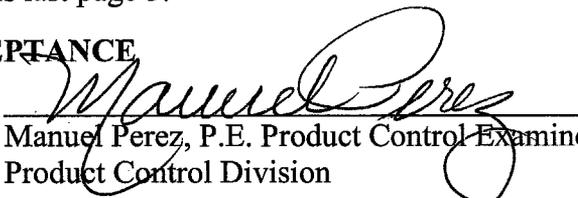  
Manuel Perez, P.E. Product Control Examiner  
Product Control Division

DESIGN LOAD CAPACITY - PSF


WINDOW DIMENSIONS		NON-IMPACT WINDOWS DADE COUNTY APPD. SHUTTERS REQD.				IMPACT RESISTANT WINDOWS SHUTTERS NOT REQUIRED			
		GLASS TYPE 'A'		GLASS TYPE 'B'		GLASS TYPE 'C'		GLASS TYPE 'D'	
WIDTH	HEIGHT	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
24"	17"	100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
30"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
32"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
36"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
40"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
48"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
24"	20"	100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
30"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
32"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
36"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
40"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
48"		90.1	94.5	90.1	100.0	66.0	78.0	66.0	78.0
24"	24"	100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
30"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
32"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
36"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
40"		94.9	94.9	100.0	100.0	66.0	78.0	66.0	78.0
48"		72.4	72.4	77.6	92.3	66.0	78.0	66.0	78.0
24"	30"	100.0	95.6	100.0	95.6	66.0	78.0	66.0	78.0
30"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
32"		100.0	100.0	100.0	100.0	66.0	78.0	66.0	78.0
36"		97.0	95.6	100.0	95.6	66.0	78.0	66.0	78.0
40"		85.9	85.9	100.0	94.2	66.0	78.0	66.0	78.0
48"		66.0	68.9	66.0	78.5	66.0	69.2	66.0	78.0

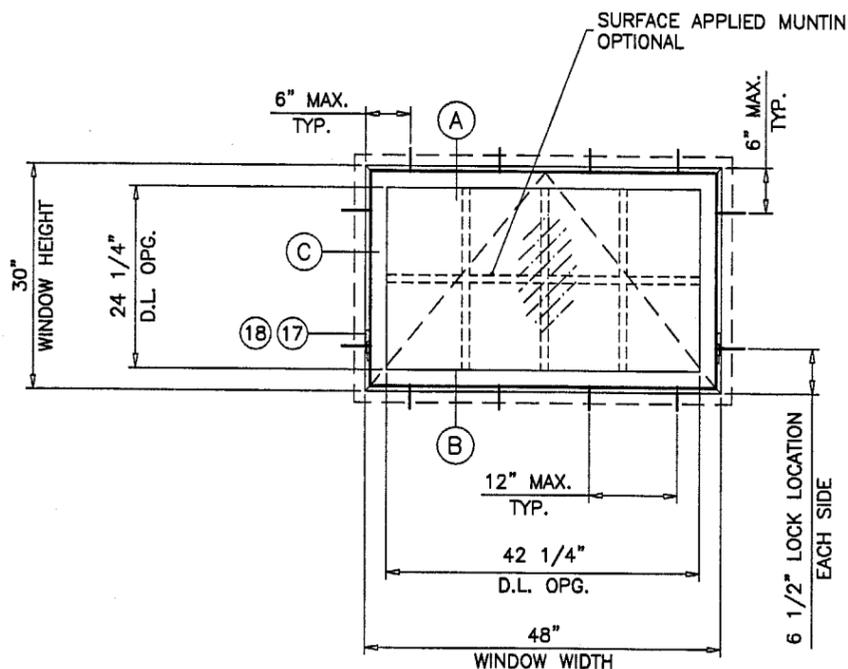

TYPICAL ELEVATION  
TESTED UNIT


NOTES

1. THIS STRUCTURE IS DESIGNED AS PER THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR DADE COUNTY. ALSO FOR WIND LOADS AS PER ASCE 7 USING CORRESPONDING LOADS.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. ANCHORING OR LOADING CONDITION NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

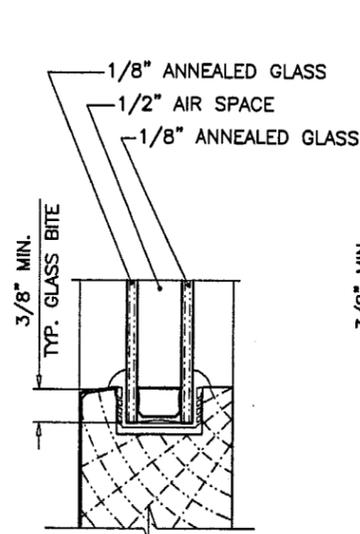


3/4" INSULATED  
NON-IMPACT GLASS

GLASS TYPE 'A'

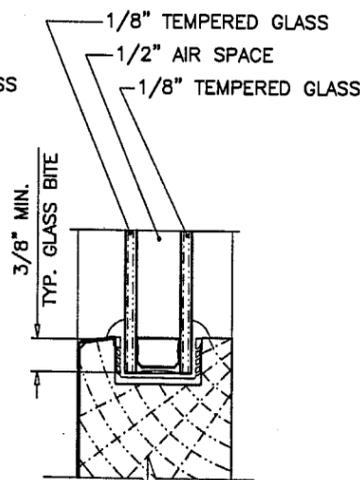

3/4" INSULATED  
NON-IMPACT GLASS


GLASS TYPE 'B'

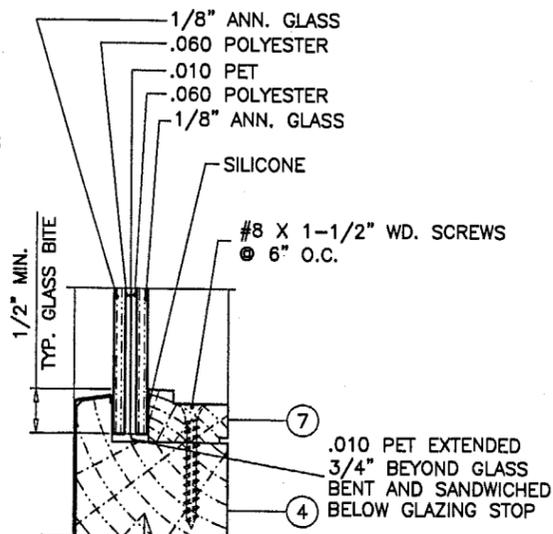

GLASSLAM SAFETY PLUS  
IMPACT GLASS

GLASS TYPE 'C'

GLASS OPTIONS

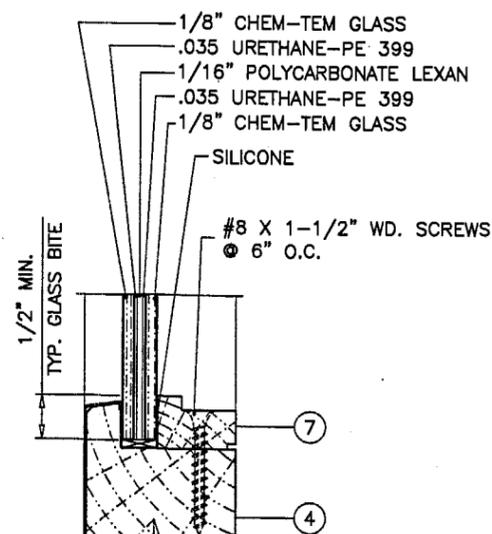

3/8" THICK NOMINAL  
IMPACT GLASS  
GLOBE AMERADA P380 WIND-PANE

GLASS TYPE 'D'

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557

AUG 01 2001

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE **AUG 02 2001**  
BY *Manuel...*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. **01-0502.12**

afc

AL-FAROOQ CORPORATION  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978


'CAR CLAD' WOOD AWNING WINDOW  
CARADCO WOOD WINDOWS & PATIO DOORS  
201 EVANS ROAD  
RANTOUL, ILLINOIS 61866  
TEL (217) 893-4444 FAX (217) 893-0921

no	date	description
A	05.21.01	CHARTS UPDATED TO ASTM-E1300


date: 10-10-98  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W98-78**  
sheet 1 of 5

EXTERIOR WINDOW HEIGHT

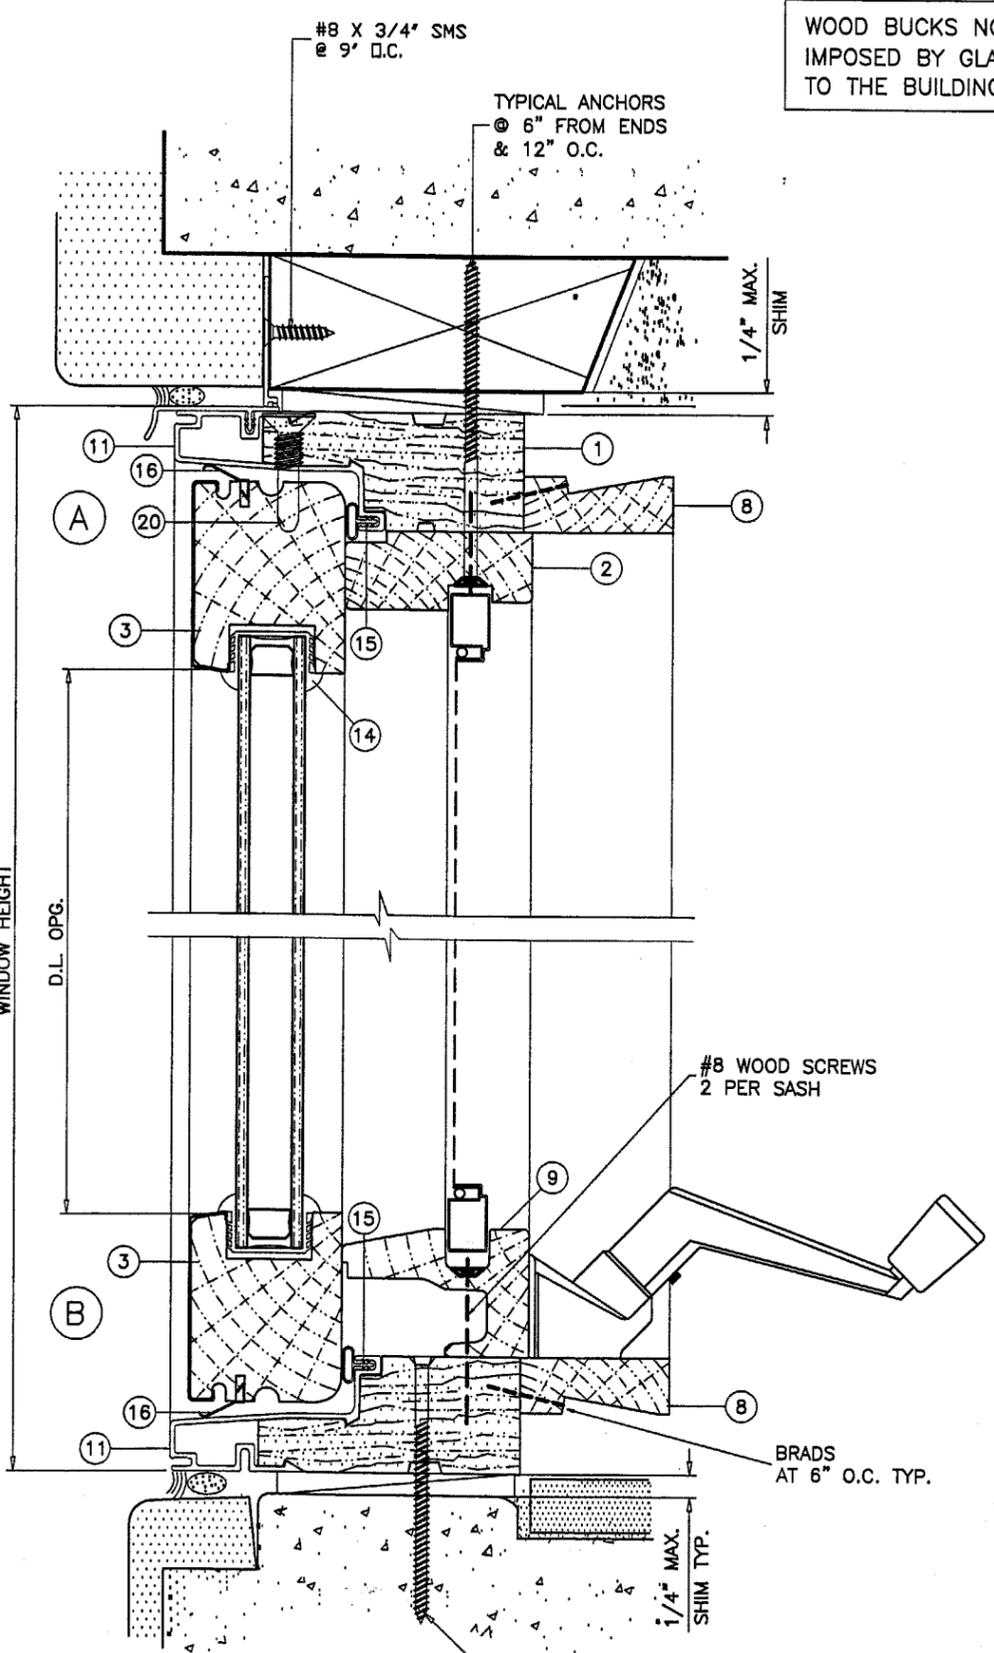

WOOD BUCKS NOT BY CARADCO, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

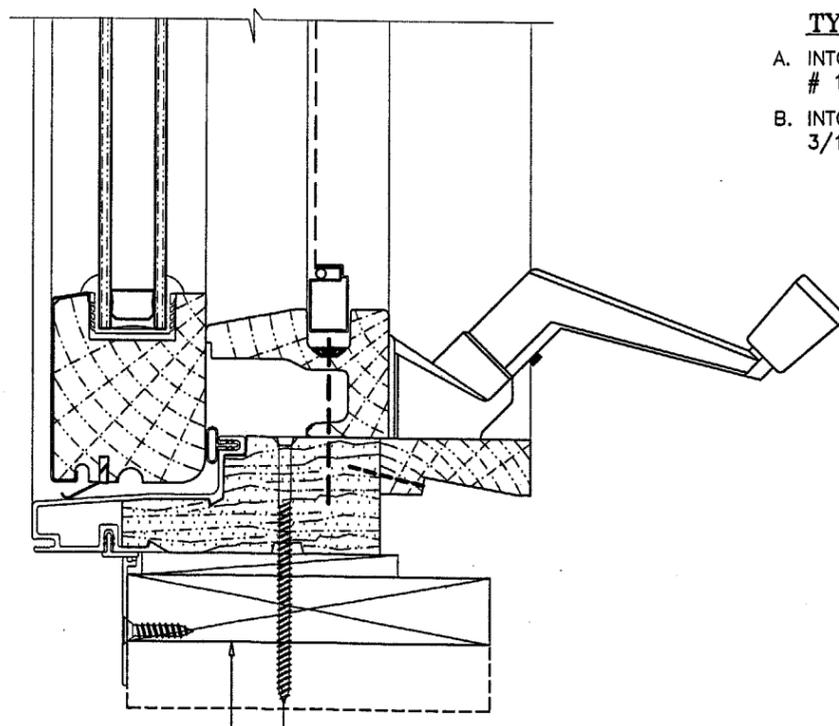

**TYPICAL ANCHORS:**  
 A. INTO 2BY WOOD BUCKS OR WOOD STRUCTURE  
 # 10 SMS WITH 1-3/8" MIN. PENETRATION INTO WOOD  
 B. INTO 1BY WOOD BUCKS OR INTO MASONRY  
 3/16" DIA. TAPCONS WITH 1-1/4" MIN. EMBED INTO MASONRY

1 BY OR 2 BY WOOD BUCK  
 TYPICAL ANCHORS  
 @ 6" FROM ENDS  
 & 12" O.C.

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE **AUG 02 2001**  
 BY *Muhammad Farooq*  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-0502.12

**AUG 01 2001**

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W98-78CO

'CAR CLAD' WOOD AWNING WINDOW  
**CARADCO** WOOD WINDOWS & PATIO DOORS  
 201 EVANS ROAD  
 RANTOUL, ILLINOIS 61866  
 TEL. (217) 893-4444 FAX (217) 893-0921

no	date	description
A	05.21.01	CHARTS UPDATED TO ASTM-E1300

date: 10-10-98  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:  
 drawing no. **W98-78**  
 sheet 2 of 5

ITEM #	REQD.	PART NO.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	AS REQD.	CA-03/04	HEAD/SILL/JAMB	TIMBERSTRAND	CARADCO
2	1	CA-09	HEAD STOP	WOOD	CARADCO
3	2/SASH	-	SASH RAIL (INSUL. GLASS)	WOOD	CARADCO
4	2/ SASH	CA-14	SASH RAIL (LAM. GLASS)	WOOD	CARADCO
5	2/ SASH	-	SASH STILE (INSUL. GLASS)	WOOD	CARADCO
6	2/ SASH	CA-15	SASH STILE (LAM. GLASS)	WOOD	CARADCO
7	4/ SASH	CA-16/17	GLASS STOP (LAM. GLASS ONLY)	WOOD	CARADCO
8	4	CA-18/19	X-JAMB	WOOD	CARADCO
9	1	CA-05	SILL COVER	WOOD	CARADCO
10	2/ WINDOW	CA-06/07	SIDE STOP	WOOD	CARADCO
11	AS REQD.	P-14	FRAME NOSING	6063-T5	-
12	1/MULLION	CA-13	MULLION CASING	WOOD	CARADCO
13	1/ MULLION	PP25	MULLION CONNECTOR	6063-T5	CARADCO
14	AS REQD.	P52	3/4" GLAZING GASKET (INSUL. GLASS ONLY)	VINYL	CARADCO
15	AS REQD.	S90-078	BULB WEATHERSTRIP	PVC	AT EACH FRAME MEMBER
16	AS REQD.	PPO	LEAF WEATHERSTRIP	POLYPROPYLENE	AT EACH SASH MEMBER
17	2/ WINDOW	-	METAL CAM-TYPE SWEEP LOCK AT LOCK STILES	STEEL	AT 6-1/2" FROM BOTTOM
18	2/ SASH	-	KEEPERS AT LOCK LOCATIONS	STEEL	AT ACTIVE SASH
19	1/SASH	-	ROTO-GEAR AWNING OPERATOR SYSTEM	-	AT SILL
20	2/ SASH	-	RETAINING PINS AT TOP RAIL	STEEL	AT 20" FROM ENDS
21	2/ SASH	-	SERIES 13 2 BAR HINGES	STEEL	TRUTH

TYPICAL ANCHORS  
@ 6" FROM ENDS

1 BY OR 2 BY  
WOOD BUCK

#8 X 3/4" SMS  
@ 9' O.C.

# 8 X 2-1/4" WOOD SCREWS  
2 PER LATCH

1/4" MAX.  
SHIM


TYPICAL ANCHORS  
@ 6" FROM ENDS  
& 12" O.C.

LATCH AT EACH SIDE OF VENT  
LOCATED AT 6-1/2" FROM  
BOTTOM OF STILES

# 8 X 1" FH SMS  
2/ KEEPER

D.L. OPG.

WINDOW WIDTH  
EXTERIOR

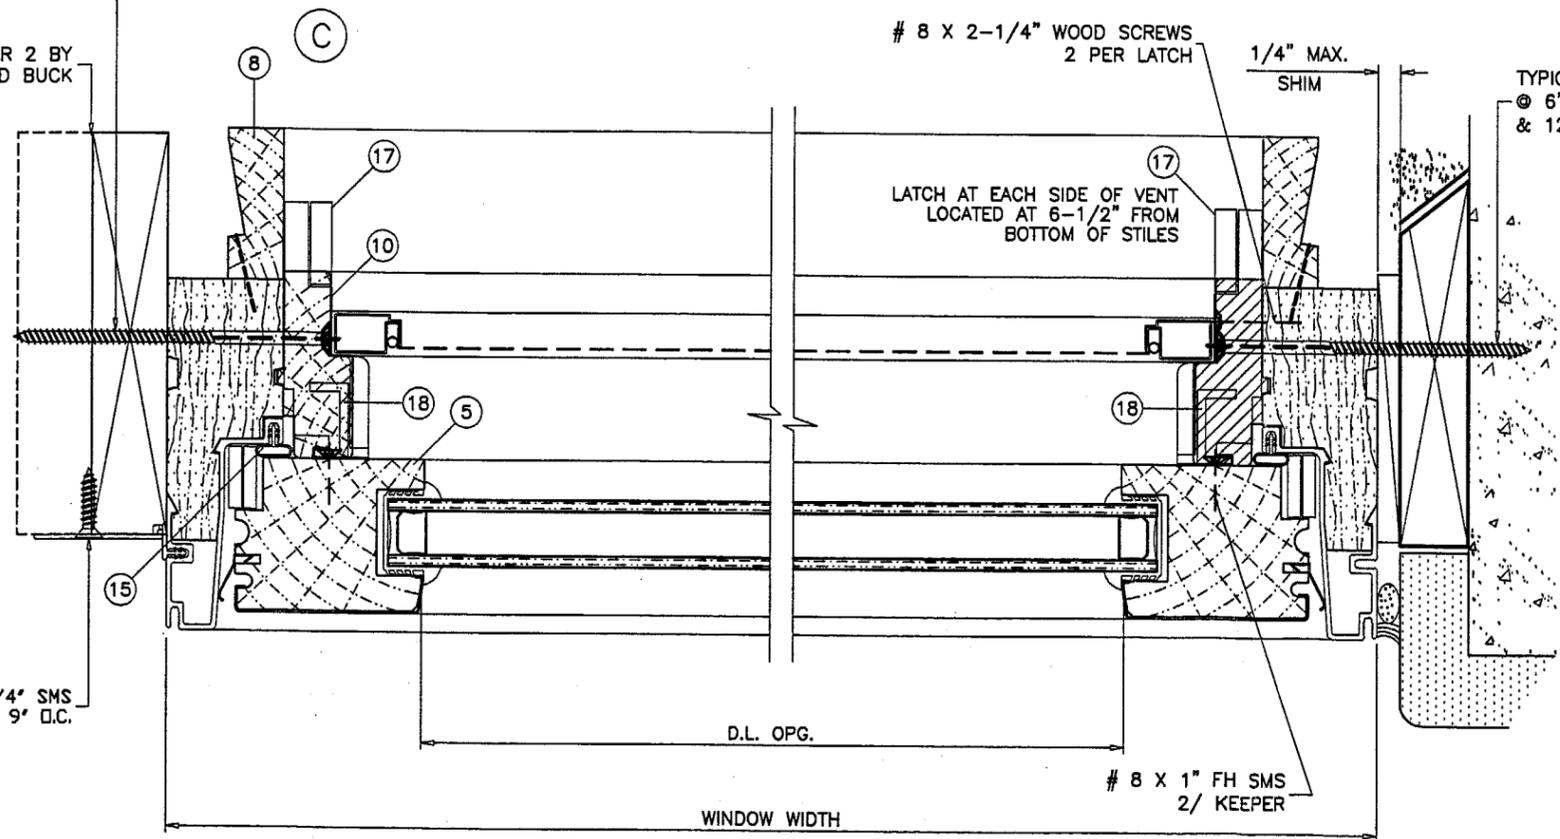

Engr: DR. HUMAYOUN FAROOQ  
STRUCTURES  
FLA. PE # 16557

AUG 01 2001








APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE **AUG 02 2001**  
BY *Maumud Siraj*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. **01-0502.12**

**AL-FAROOQ CORPORATION**  
ENGINEERS, PLANNERS & PRODUCT DESIGN  
1235 SW 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 264-8100 FAX (305) 262-8978










'CAR CLAD' WOOD AWNING WINDOW  
**CARADCO** WOOD WINDOWS & PATIO DOORS  
201 EVANS ROAD  
RANTOUL, ILLINOIS 61866  
TEL (217) 893-4444 FAX (217) 893-0921

no	date	by	description

date: 10-10-98  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:  
drawing no. **W98-78**  
sheet 3 of 5

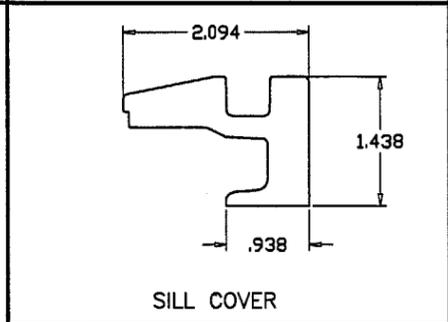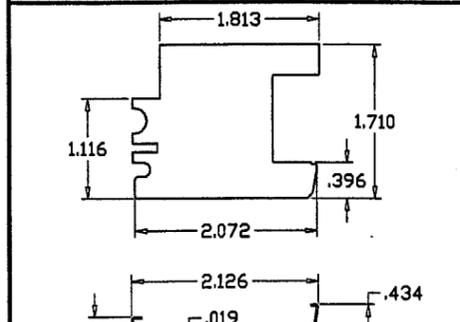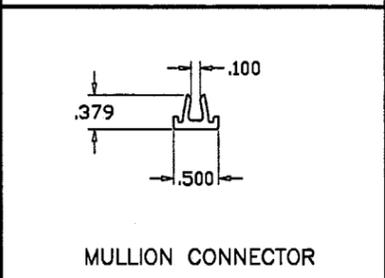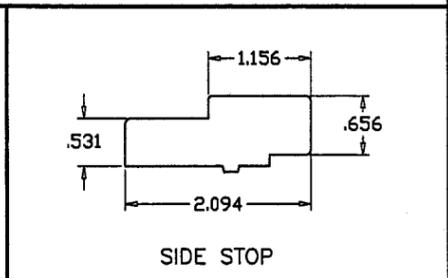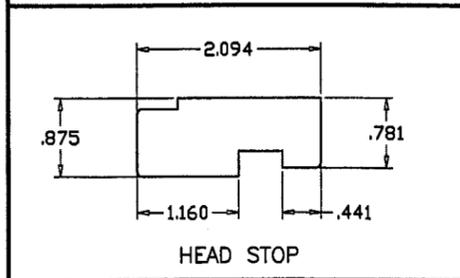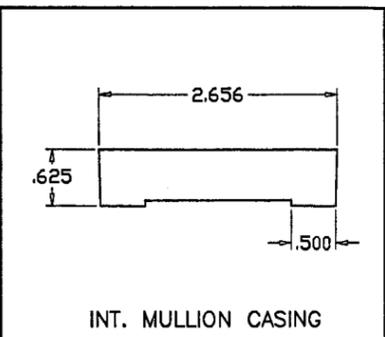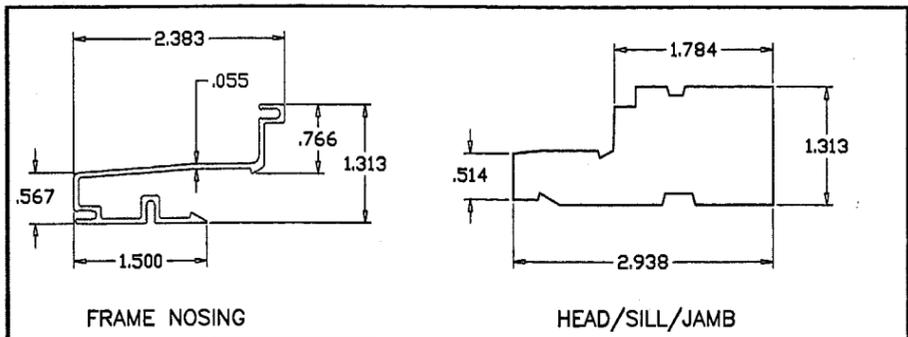

SASH AND OTHER WOOD COMPONENTS TO BE WHITE PINE OR PONDEROSA PINE. FRAME MEMBERS TO BE TIMBERSTRAND.

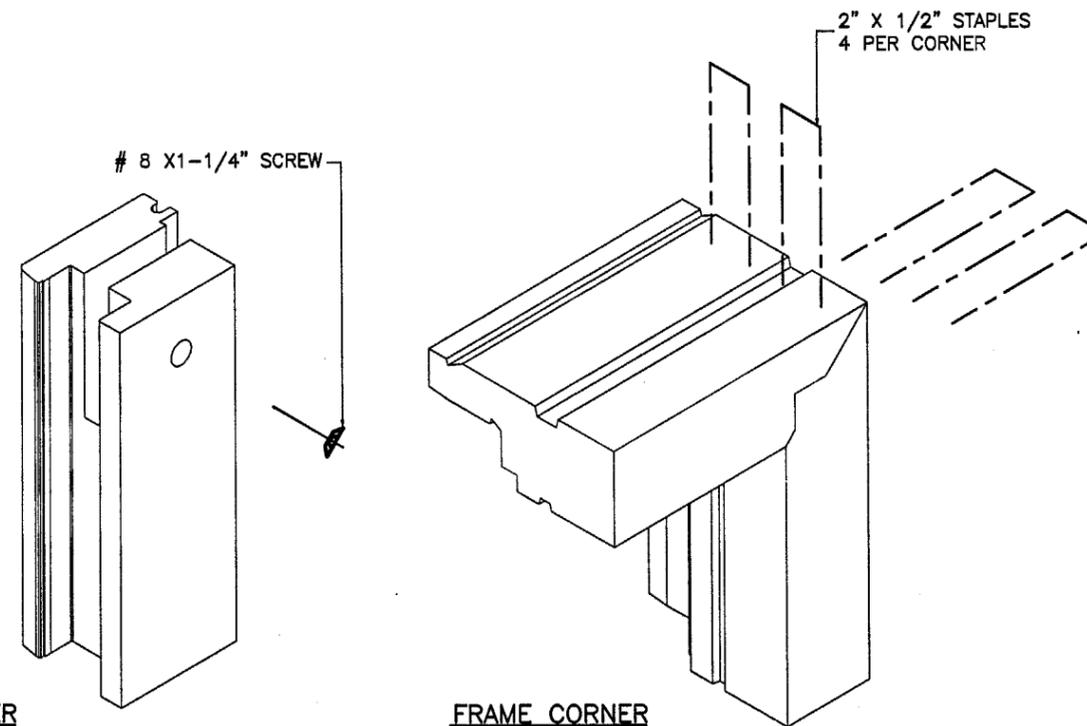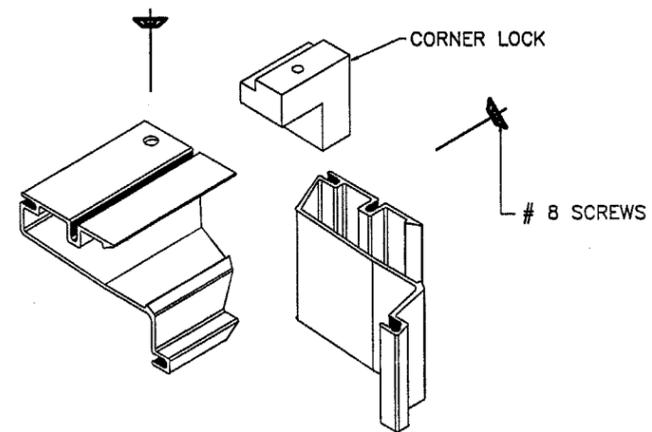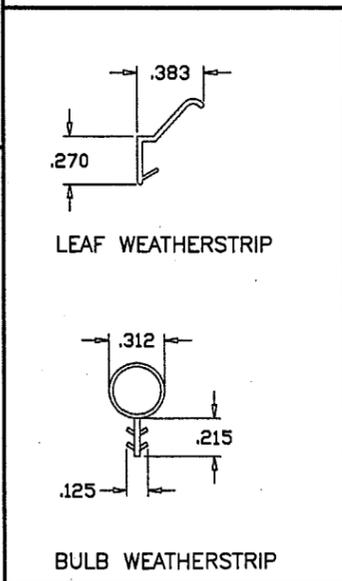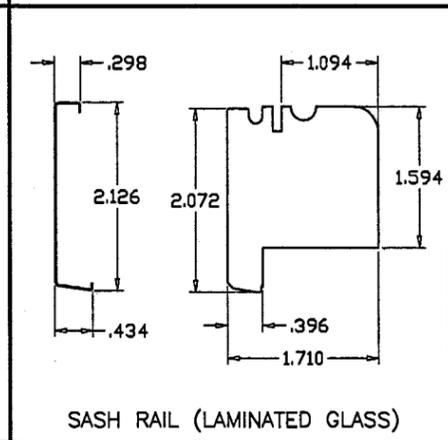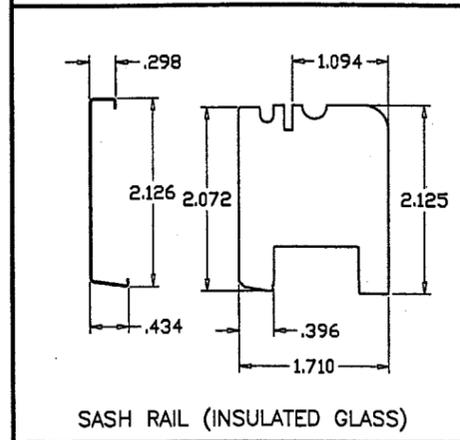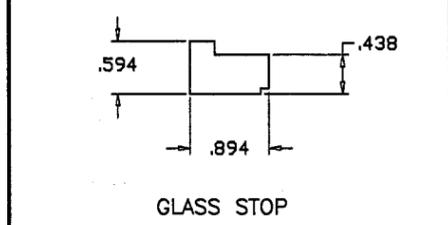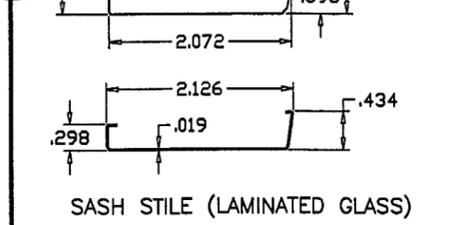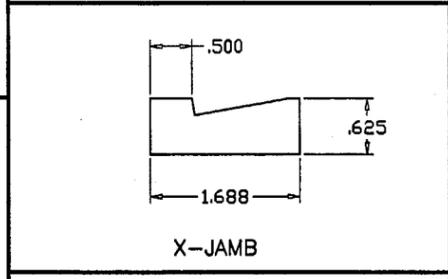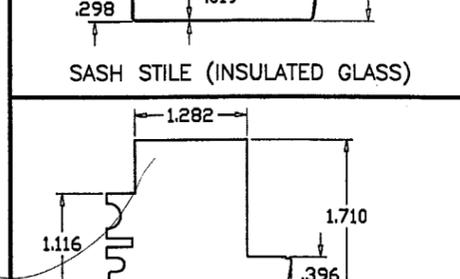

FRAME AND SASH CORNERS SEALED WITH BUTYL TAPE SEALANT. BUTYL CAULK USED IN BETWEEN ALUMINUM/WOOD JOINTS.

**afc**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL/W98-78CO

'CAR CLAD' WOOD AWNING WINDOW  
**CARADCO** WOOD WINDOWS & PATIO DOORS  
 201 EVANS ROAD  
 RANTOUL, ILLINOIS 61866  
 TEL. (217) 893-4444 FAX (217) 893-0921

no	date	description



Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557  
 BY *Maamul Siriz*  
 AUG 01 2001

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE **AUG 07 2001**  
 BY *Maamul Siriz*  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-0502.12

date: 10-10-98  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:  
 drawing no. **W98-78**  
 sheet 4 of 5


**DESIGN LOAD CAPACITY - PSF (SIDE/SIDE OR TOP/BOTTOM WINDOWS)**  
 AWNING, OPERATING CASEMENT, FIXED CASEMENT OR ANY COMBINATION THEREOF

WINDOW DIMENSIONS		NON-IMPACT WINDOWS (SHUTTERS REQUIRED) DSB-INSULATED GLASS		IMPACT RESISTANT WINDOWS (SHUTTERS NOT REQD.) 3/8" LAMINATED GLASS	
WIDTH (W)	HEIGHT (H)	EXT.	INT.	EXT.	INT.
15'	40'	100.0	100.0	66.0	80.0
20'		100.0	100.0	66.0	80.0
25'		100.0	100.0	66.0	80.0
30'		100.0	100.0	66.0	80.0
35'		100.0	100.0	66.0	80.0
40'		100.0	100.0	66.0	80.0
45'		100.0	100.0	66.0	80.0
50'		100.0	100.0	66.0	80.0
55'		100.0	100.0	66.0	80.0
55'		40'	100.0	100.0	66.0
15'	48'	100.0	100.0	66.0	80.0
20'		100.0	100.0	66.0	80.0
25'		100.0	100.0	66.0	80.0
30'		100.0	100.0	66.0	80.0
35'		100.0	100.0	66.0	80.0
40'		100.0	100.0	66.0	80.0
45'		100.0	100.0	66.0	80.0
50'		100.0	100.0	66.0	80.0
55'		100.0	100.0	66.0	80.0
55'		48'	100.0	100.0	66.0
15'	56'	100.0	100.0	66.0	80.0
20'		100.0	100.0	66.0	80.0
25'		100.0	100.0	66.0	80.0
30'		99.0	99.0	66.0	80.0
35'		88.3	88.3	66.0	80.0
40'		81.0	81.0	66.0	80.0
45'		76.2	76.2	66.0	76.2
50'		73.4	73.4	66.0	73.4
55'		72.2	72.2	66.0	72.2
55'		56'	100.0	100.0	66.0
15'	60'	100.0	100.0	66.0	80.0
20'		100.0	100.0	66.0	80.0
25'		96.6	96.6	66.0	80.0
30'		83.2	83.2	66.0	80.0
35'		74.2	74.2	66.0	74.2
40'		68.0	68.0	66.0	68.0
45'		63.8	63.8	63.8	63.8
50'		61.0	61.0	61.0	61.0
55'		59.3	59.3	59.3	59.3
55'		60'	100.0	100.0	66.0
15'	64'	96.5	96.5	66.0	80.0
20'		78.9	78.9	66.0	78.9
25'		67.7	67.7	66.0	67.7
30'		60.0	60.0	60.0	60.0
35'		54.7	54.7	54.7	54.7
40'		50.9	50.9	50.9	50.9
45'		48.3	48.3	48.3	48.3
50'		46.6	46.6	46.6	46.6
55'		46.6	46.6	46.6	46.6
55'		64'	100.0	100.0	66.0
15'	72'	88.4	88.4	66.0	80.0
20'		67.2	67.2	66.0	67.2
25'		54.7	54.7	54.7	54.7
30'		46.6	46.6	46.6	46.6
35'		41.0	41.0	41.0	41.0

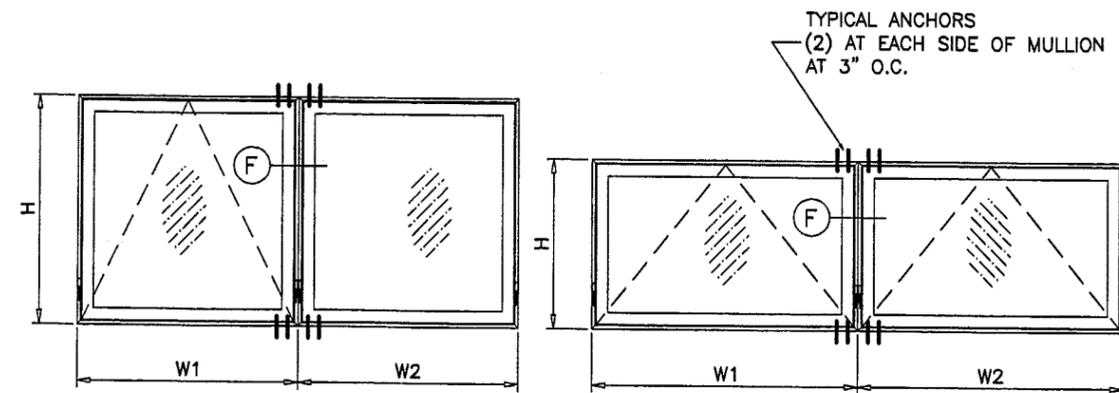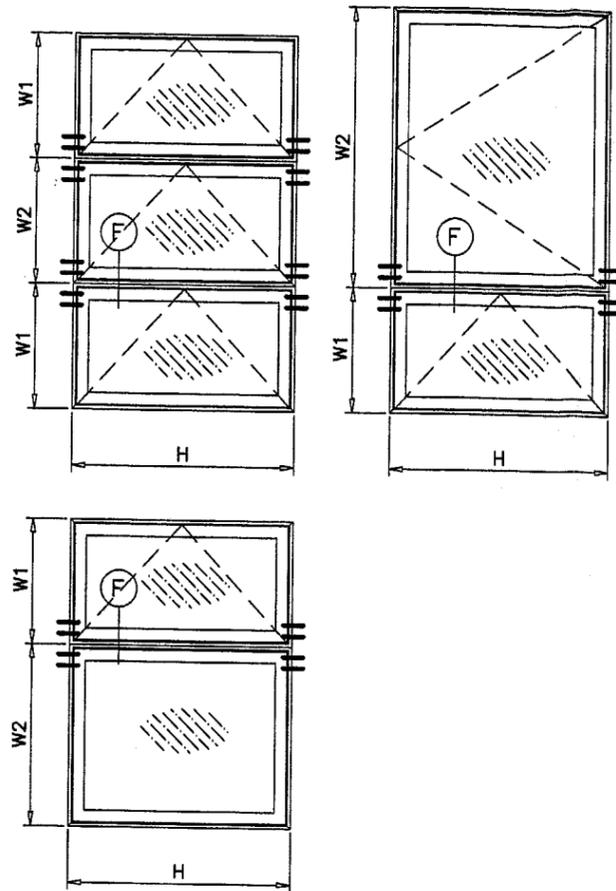

**TYPICAL ELEVATIONS**  
 SIDE BY SIDE WINDOWS  
 SIDE BY SIDE APPLIES TO TWO OR MORE WINDOWS

$$\text{AVG. WINDOW WIDTH} = \frac{W1 + W2}{2}$$

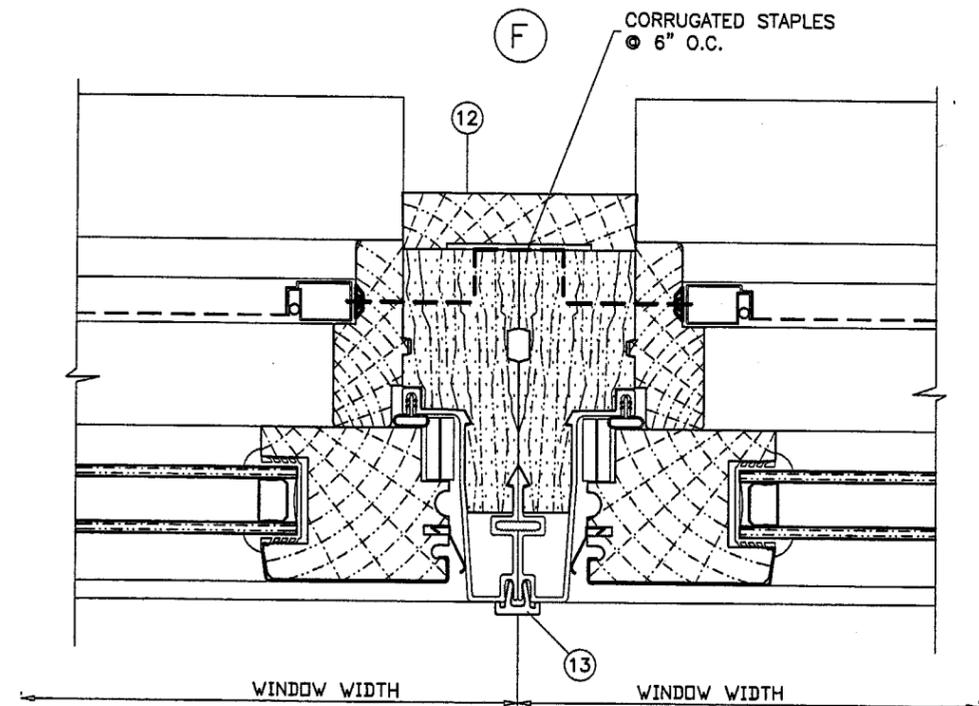

**EXTERIOR**  
 VERTICAL OR HORIZONTAL SECTION

- NOTES:**
- USE CHART ON THIS SHEET FOR SIDE BY SIDE CONNECTION CAPACITY OF AWNING WINDOW, FIXED CASEMENT, OPERATING CASEMENT OR ANY COMBINATION OF ABOVE. (WINDOWS WITH IDENTICAL FRAME MEMBERS)
  - FOR AWNING TYPE WINDOW CAPACITY SEE SHEET 1. FOR FIXED CASEMENT OR OPERATING CASEMENT CAPACITY SEE THEIR CORRESPONDING NOA.
  - USE SMALLER DESIGN LOAD CAPACITY OF 1 OR 2 ABOVE.

Engr: DR. HUMAYOUN FAROOQ  
 STRUCTURES  
 FLA. PE # 16557

AUG 0 1 2001

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE **AUG 0 2 2001**  
 BY *Mamuel*  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 01-0502.12

**afsc**

**AL-FAROOQ CORPORATION**  
 ENGINEERS, PLANNERS & PRODUCT DESIGN  
 1235 SW 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL W98-78CO

'CAR CLAD' WOOD AWNING WINDOW

**CARADCO** WOOD WINDOWS & PATIO DOORS  
 201 EVANS ROAD  
 RANTOUL, ILLINOIS 61866  
 TEL. (217) 893-4444 FAX (217) 893-0921

no.	date	by	description

date: 10-10-98  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by: *Mamuel*

drawing no. **W98-78**  
 sheet 5 of 5