



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Kinco Ltd.
5245 Old Kings Road North
Jacksonville ,FL 32254

Your application for Notice of Acceptance (NOA) of:

Series "RW-XHP" Aluminum Horizontal Sliding Window

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez
Chief Product Control Division

ACCEPTANCE NO.: 01-0525.01
EXPIRES: 12/24/2006

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 08/02/2001



Kinco Ltd.

ACCEPTANCE No.: 01-0525.01

APPROVED : AUG 02 2001

EXPIRES : December 24, 2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

1.1 This renews the Notice of Acceptance No. **98-1009.02**, which was issued on December 24, 1998. It approves an aluminum horizontal sliding window, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

2.1 The Series "**RW-XHP**" **Aluminum Horizontal Sliding Window** and its components shall be constructed in strict compliance with the following documents: Drawing No **W98-55**, Sheets 1 through 5 of 5, titled "Series RW-XHP Aluminum Horizontal Sliding Window", prepared by Al-Farooq Corporation, dated 07/29/98 and revised on 5/10/01, signed and sealed by Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

3.1 This approval applies to single unit applications only, as shown in approved drawings.

4. INSTALLATION

4.1 The aluminum horizontal sliding window and its components shall be installed in strict compliance with the approved drawings.

4.2 The installation of this product **will require** a hurricane protection system.

5. LABELING

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".


6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

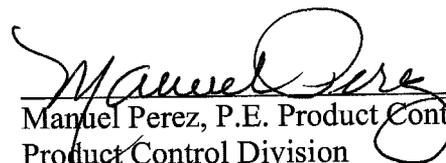
Manuel Perez, P.E. Product Control Examiner
Product Control Division

Kinco Ltd.


ACCEPTANCE No.: 01-0525.01

APPROVED : AUG 02 2001

EXPIRES : December 24, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3

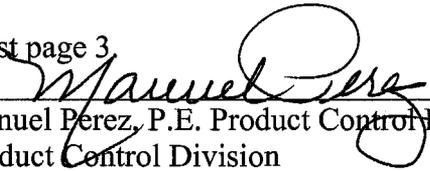
Manuel Perez, P.E. Product Control Examiner
Product Control Division

END OF THIS ACCEPTANCE

Kinco Ltd.

ACCEPTANCE No.: 01-0525.01

APPROVED : AUG 02 2001

EXPIRES : December 24, 2006

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not Part of NOA)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **W98-55**, Sheets 1 through 5 of 5, titled "Series RW-XHP Aluminum Horizontal Sliding Window", prepared by Al-Farooq Corporation, dated 07/29/98 and revised on 5/10/01, signed and sealed by Humayoun Farooq, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test,
 - 2) Uniform Static Air Pressure Test,
 - 3) Water Resistance Test,
 - 4) Forced Entry Test, per SFBC 3603.2 (b)along with marked-up drawings and installation diagram of a Horizontal Sliding Window, glazed with 3/16" ann. glass, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-2071**, dated 06/25/98, signed and sealed by Gilbert Diamond, P.E.
2. Test reports on:
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94along with marked-up drawings and installation diagram of a Horizontal Sliding Window, glazed with 1/8" ann. glass, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-2070**, dated 06/25/98, reissued 8/31/98, signed and sealed by Gilbert Diamond, P.E.

C. CALCULATIONS

1. Anchor calculations and comparative analysis, prepared by Al-Farooq Corporation, dated August 22, 1998, revised on May 17, 2001, signed and sealed by Humayoun Farooq, P.E.

D. MATERIAL CERTIFICATIONS


1. None.


E. STATEMENTS

1. Letter from Kinco, Ltd., dated May 18, 2001, stating that the product has not changed since it was originally approved.
2. Letter from Al-Farooq Corporation, dated May 18, 2001, stating that the engineer who performed the review of the product is still in the engineering business.
3. Statement letter of conformance, dated Aug. 28, 1998, signed by Humayoun Farooq, P.E.
4. Statement letter of no financial interest, dated Aug. 28, 1998, signed by Humayoun Farooq, P.E.
5. Laboratory Compliance Letters for Test Report FTL-2070 and FTL-2071, dated July, 10, 1998, signed and sealed by Gilbert Diamond, P.E.

F. OTHER

1. Notice of Acceptance No. **98-1009.02**, issued to Kinco Ltd. for their Aluminum Horizontal Sliding Window, approved 12/24/98 and expiring on 12/24/01.


Manuel Perez, P.E. Product Control Examiner
Product Control Division

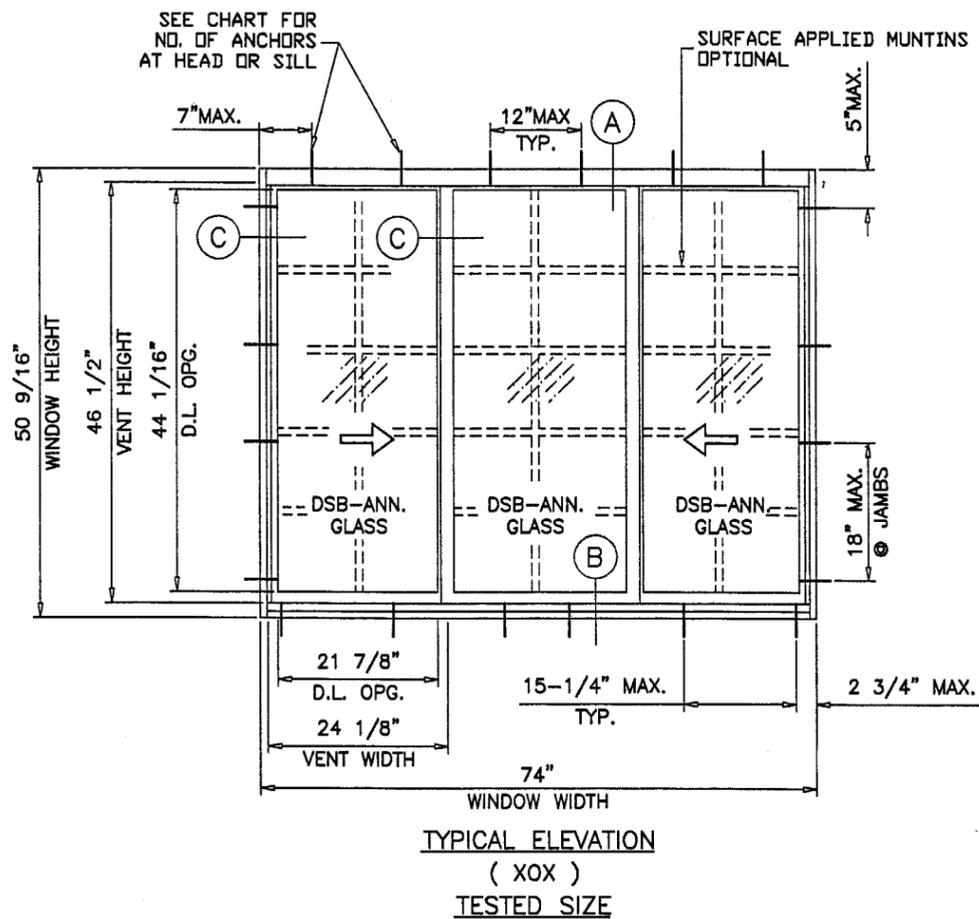

DESIGN LOAD CAPACITY - PSF (DSB - ANN. GLASS)					
WINDOW DIMS.		ANCHORS		XOX SIZES	
WIDTH	HEIGHT	HEAD	SILL	EXT.	INT.
73'	25'	7	6	55.0	75.0
85'		8	7	55.0	68.5
97'		9	8	55.0	61.7
109'		10	8	51.8	51.8
73'	37'	7	6	51.7	51.7
85'		8	7	48.9	48.9
97'		9	8	44.8	44.8
73'	49'	7	6	35.1	35.1
74'	26'	7	6	55.0	75.0
74'	38-3/8'	7	6	49.4	49.4
74'	50-5/8'	7	6	34.0	34.0

SERIES RW-XHP ALUM. HORIZ. SLIDING WINDOWS COMPARATIVE ANALYSIS CHART


BASED ON FTL-2070
 TEST SIZE = 74" X 50-9/16" (XOX)
 TEST LOADS = +82.5, -82.5 PSF
 DESIGN LOADS = +55.0, -55.0 PSF
 WATER INFILTRATION TEST = 8.25 PSF
 TESTED GLASS = DSB-ANNEALED

IMPACT RESISTANT SHUTTERS REQUIRED

DESIGN LOAD CAPACITY - PSF (DSB - ANN. GLASS)						
WINDOW DIMS.		ANCHORS		XO OR OX SIZES		
WIDTH	HEIGHT	HEAD	SILL	EXT.	INT.	
25'	25'	3	2	55.0	75.0	
37'		4	4	55.0	75.0	
49'		5	4	55.0	75.0	
61'		6	5	55.0	63.7	
73'		7	6	51.5	51.5	
25'		37'	3	2	55.0	75.0
37'	4		4	55.0	60.8	
49'	5		4	51.5	51.5	
61'	6		5	46.7	46.7	
25'	49'		3	2	55.0	75.0
37'			4	4	47.7	47.7
49'		5	4	35.0	35.0	
26-1/2'		26'	3	3	55.0	75.0
37'			4	4	55.0	75.0
53-1/8'			5	5	55.0	70.6
74'	7		6	49.6	49.6	
26-1/2'	38-3/8'	3	3	55.0	75.0	
37'		4	4	55.0	58.5	
53-1/8'		5	5	49.4	49.4	
74'		7	6	39.1	39.1	
26-1/2'	50-5/8'	3	3	55.0	70.5	
37'		4	4	47.2	47.2	

NOTES:

- THIS STRUCTURE IS DESIGNED AS PER THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR DADE COUNTY. ALSO FOR WIND LOADS AS PER ASCE 7-88 USING CORRESPONDING LOADS.
- WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

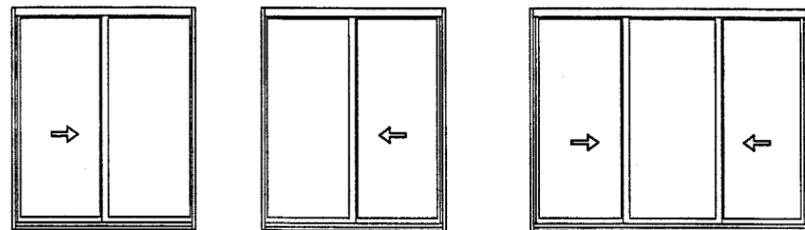

APPROVED CONFIGURATIONS
 GLASS WIDTHS TO BE EQUAL ON MOVING AND FIXED LITES

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557

[Signature]
 JUL 17 2001

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE AUG 02 2001
 BY Maunel
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0525.01


AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W98-55KL

KINCO LTD.
 280 S.W. 14TH AVE
 POMPANO BEACH, FL 33069
 TEL (305) 783-0111

revisions:
 no. date by description
 A 05.10.01 CHARTS REV. TO ASTM E-1300

date: 07-29-98
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no. **W98-55**
 sheet 1 of 5

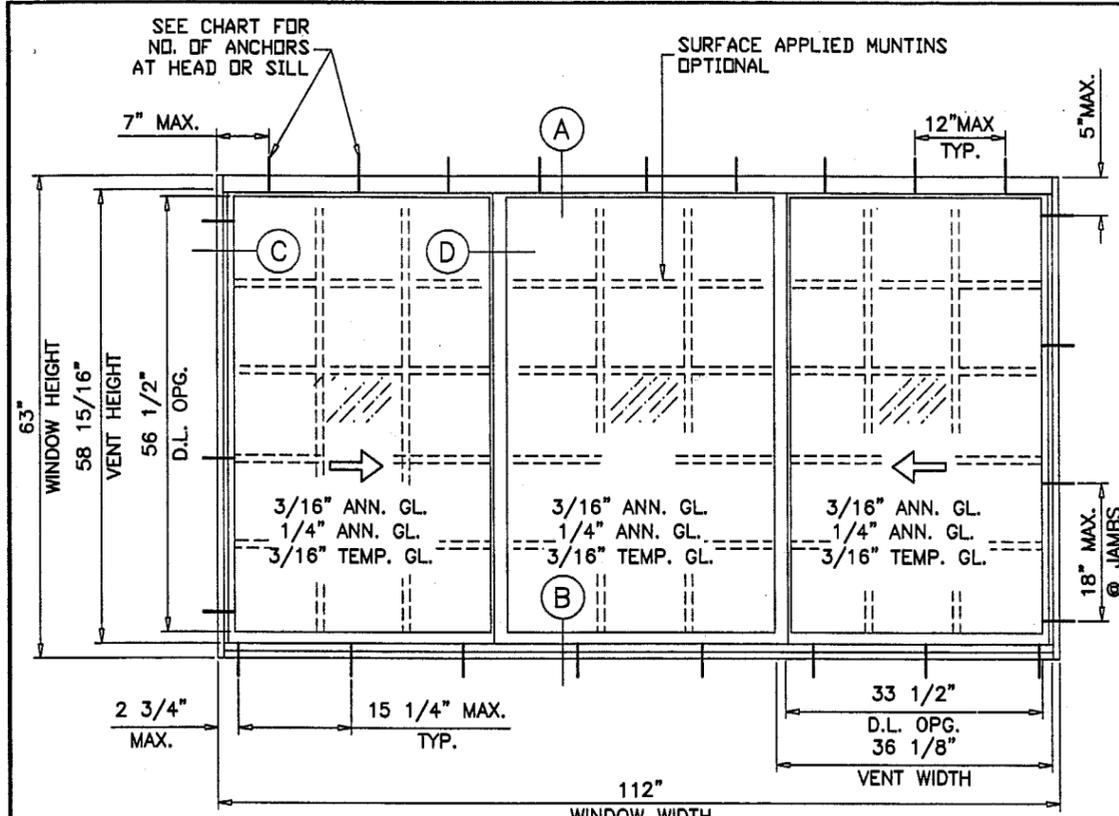

TYPICAL ELEVATION
(XOX)
TESTED SIZE


DESIGN LOAD CAPACITY - PSF (XOX SIZES)							
WINDOW DIMS.		ANCHORS		3/16" ANN. GLASS		1/4" ANN. GLASS 3/16" TEMP. GLASS	
WIDTH	HEIGHT	HEAD	SILL	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
73'	25'	7	6	55.0	90.0	55.0	90.0
85'		8	7	55.0	90.0	55.0	90.0
97'		9	8	55.0	90.0	55.0	90.0
109'		10	8	55.0	90.0	55.0	90.0
73'	37'	7	6	55.0	81.7	55.0	81.7
85'		8	7	55.0	79.2	55.0	80.1
97'		9	8	55.0	71.2	55.0	79.0
109'		10	8	55.0	65.3	55.0	78.1
73'	49'	7	6	55.0	61.7	55.0	61.7
85'		8	7	55.0	59.5	55.0	60.5
97'		9	8	52.3	52.3	55.0	59.7
109'		10	8	50.8	50.8	55.0	59.0
73'	61'	7	6	55.0	49.5	55.0	49.5
85'		8	7	45.9	45.9	55.0	48.6
97'		9	8	42.0	42.0	51.4	47.9
109'		10	8	39.3	39.3	47.9	47.4
74'	26'	7	6	55.0	90.0	55.0	90.0
74'	38-3/8'	7	6	55.0	77.7	55.0	77.7
74'	50-5/8'	7	6	55.0	58.9	55.0	58.9
74'	63'	7	6	54.8	47.3	55.0	47.3

DESIGN LOAD CAPACITY - PSF (XO OR OX SIZES)							
WINDOW DIMS.		ANCHORS		3/16" ANN. GLASS		1/4" ANN. GLASS 3/16" TEMP. GLASS	
WIDTH	HEIGHT	HEAD	SILL	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
25'	25'	3	2	55.0	90.0	55.0	90.0
37'		4	4	55.0	90.0	55.0	90.0
49'		5	4	55.0	90.0	55.0	90.0
61'		6	5	55.0	90.0	55.0	90.0
73'		7	6	55.0	90.0	55.0	90.0
25'	37'	3	2	55.0	90.0	55.0	90.0
37'		4	4	55.0	90.0	55.0	90.0
49'		5	4	55.0	86.9	55.0	86.9
61'		6	5	55.0	74.7	55.0	83.8
73'		7	6	55.0	65.0	55.0	80.5
25'	49'	3	2	55.0	77.2	55.0	77.2
37'		4	4	55.0	69.5	55.0	69.5
49'		5	4	55.0	65.6	55.0	65.6
61'		6	5	55.0	55.4	55.0	63.2
73'		7	6	50.6	50.6	55.0	61.7
25'	61'	3	2	55.0	62.0	55.0	62.0
37'		4	4	55.0	55.8	55.0	55.8
49'		5	4	55.0	52.7	55.0	52.7
61'		6	5	42.2	42.2	53.4	50.8
73'		7	6	39.1	39.1	47.7	47.7
26-1/2'	26'	3	3	55.0	90.0	55.0	90.0
37'		4	4	55.0	90.0	55.0	90.0
53-1/8'		5	5	55.0	90.0	55.0	90.0
74'		7	6	55.0	86.1	55.0	90.0
26-1/2'	38-3/8'	3	3	55.0	90.0	55.0	90.0
37'		4	4	55.0	88.8	55.0	88.8
53-1/8'		5	5	55.0	77.3	55.0	77.3
74'		7	6	55.0	62.1	55.0	77.3
26-1/2'	50-5/8'	3	3	55.0	70.5	55.0	70.5
37'		4	4	55.0	67.3	55.0	67.3
53-1/8'		5	5	55.0	58.6	55.0	58.6
74'		7	6	48.6	48.6	55.0	58.9
26-1/2'	63'	3	3	55.0	56.6	55.0	56.6
37'		4	4	55.0	54.1	55.0	54.1
53-1/8'		5	5	48.3	47.1	55.0	47.1
74'		7	6	37.4	37.4	45.2	45.2

SERIES RW-XHP ALUM. HORIZ. SLIDING WINDOWS
COMPARATIVE ANALYSIS CHART

BASED ON FTL-2071
TEST SIZE = 112" X 63" (XOX)
TEST LOADS = +67.5, -67.5 PSF
DESIGN LOADS = +45.0, -45.0 PSF
WATER INFILTRATION TEST = 8.25 PSF
TESTED GLASS = 3/16"-ANNEALED

IMPACT RESISTANT SHUTTERS REQUIRED

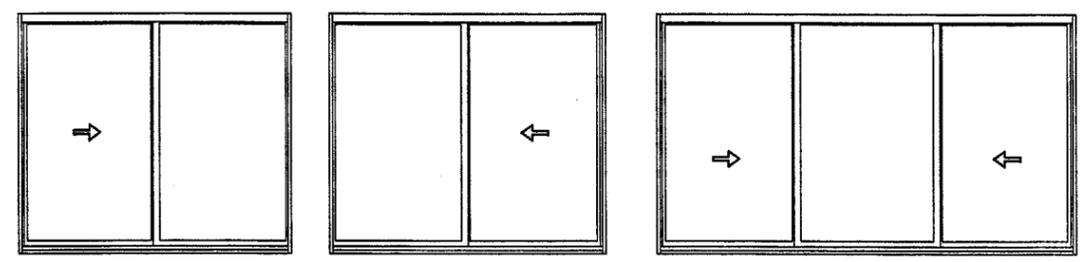

XO OX XOX

APPROVED CONFIGURATIONS
GLASS WIDTHS TO BE EQUAL ON MOVING AND FIXED LITES

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

[Signature]
JUL 17 2001

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE AUG 02 2001
BY *[Signature]*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0525.01

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL \W98-55KL

KINCO LTD.
280 S.W. 14TH AVE
POMPANO BEACH, FL 33069
TEL.(305) 783-0111



revisions:
no. date by description

date: 07-29-98
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W98-55

sheet 2 of 5

WOOD BUCKS NOT BY KINCO LTD., MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

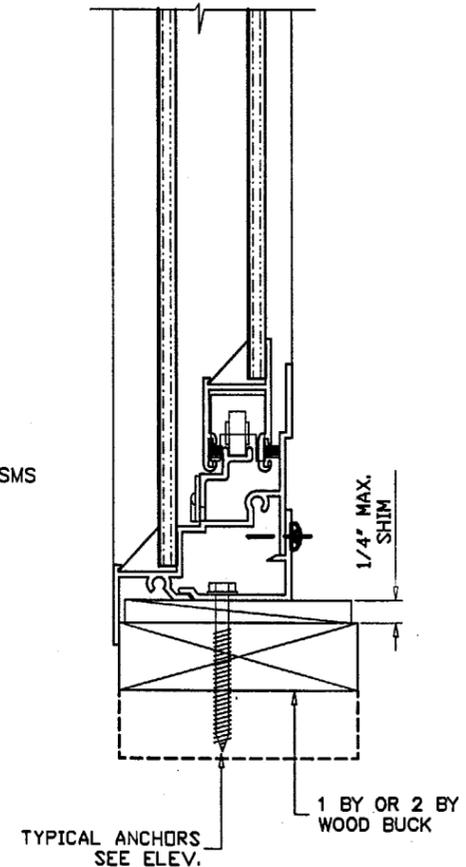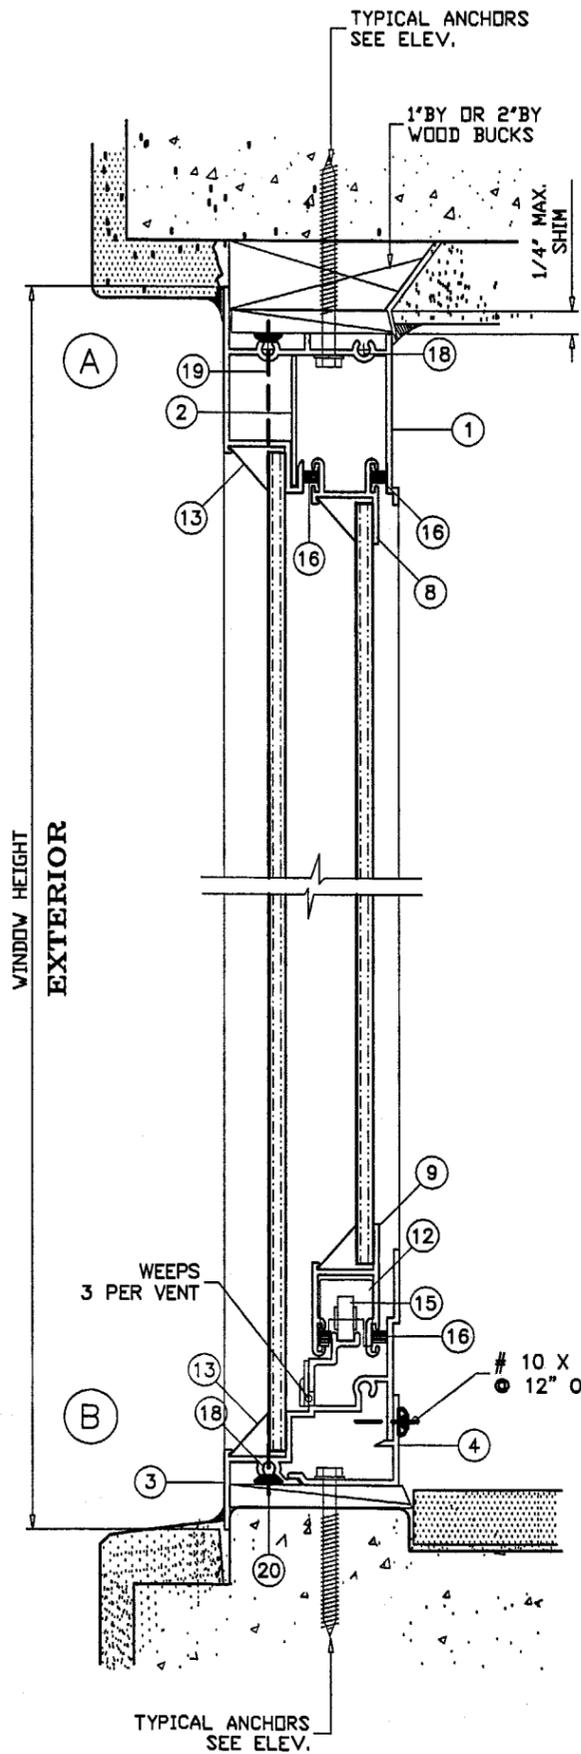

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER
1	AF-12148	1	FRAME HEAD	6063-T6	ALUMAX/BONNELL
2	AF-12132	1/VENT	HEAD SPACER, 2-7/16' LONG AT FIXED RAIL	6063-T6	ALUMAX/BONNELL
3	AF-534693	1	FRAME SILL	6063-T6	ALUMAX/BONNELL
4	AF-534692	1	FRAME SUB SILL	6063-T6	ALUMAX/BONNELL
5	AF-12152	1	FRAME MOVING JAMB	6063-T6	ALUMAX/BONNELL
6	AF-12153	1	FRAME FIXED JAMB	6063-T6	ALUMAX/BONNELL
7	AF-533041	1/ VENT	FIXED MTG. STILE	6063-T6	ALUMAX/BONNELL
8	AF-12141	1/ VENT	VENT TOP RAIL	6063-T6	ALUMAX/BONNELL
9	AF-12142	1/ VENT	VENT BOTTOM RAIL	6063-T6	ALUMAX/BONNELL
10	AF-12143	1/ VENT	VENT SIDE RAIL	6063-T6	ALUMAX/BONNELL
11	AF-12165	1/ VENT	VENT LOCK STILE	6063-T6	ALUMAX/BONNELL
12	L-015	2/ VENT	WHEEL HOUSING	-	HUGHES SUPPLY
13	05-175	AS REQD.	GLAZING BEAD ROLL FORMED ALUM.	-	FL. SCREEN/MARLIN METAL
14	421	2/ VENT	WHEEL AXLE	-	SAUNDERS ENG.
15	141	2/ VENT	WHEEL	BRASS	SAUNDERS ENG.
16	7518	AS REQD.	FIN-SEAL W' STRIP .270W X .310H	-	SCHLEGEL
17	7518	AS REQD.	FIN-SEAL W' STRIP .270W X .130H	-	SCHLEGEL
18	#8X5/8' SMS	AS REQD.	VENT AND FRAME ASSEMBLY SCREWS	-	-
19	#8X2' FH SMS	2/ STILE	HEAD TO FIXED STILE	-	-
20	#8X1' FH SMS	2/ STILE	SILL TO FIXED STILE	-	-
21	-	-	-	-	-
22	7538-153	1/ LOCK STILE	VENT LATCH L.H. AT MIDSPAN	ZINC CAST	ALLEN-STEVENSON
23	7538-169	1/ LOCK STILE	VENT LATCH R.H. AT MIDSPAN	ZINC CAST	ALLEN-STEVENSON

TYPICAL ANCHORS:

- A. #12 X 1-3/4" SMS INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
- B. 3/16" TAPCONS THRU 1BY WOOD BUCK 1-1/4" MIN. EMBED INTO CONC. OR BLOCK

SEALANTS:

ALL FRAME AND VENT CORNERS, INSTALLATION SCREWS SEALED WITH 'SCHNEE MOREHEAD 5504' SEALANT.

EXTERIOR GLAZED BY USING ROLL FORMED ALUMINUM BEAD AND 'SCHNEE MOREHEAD 5555' ADHESIVE BEDDING COMPOUND.

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

[Signature]
JUL 17 2001

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE **AUG 02 2001**
BY *[Signature]*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. **01-0525.01**

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL W98-55KL



SERIES RW-XHP ALUM. HORIZ. SLD. WINDOW

KINCO LTD.
280 S.W. 14TH AVE
POMPANO BEACH, FL 33069
TEL(305) 783-0111

no	date	description

date: 07-29-98	scale: 1/2" = 1"
dr. by: HAMID	chk. by:

drawing no. **W98-55**
sheet 3 of 5

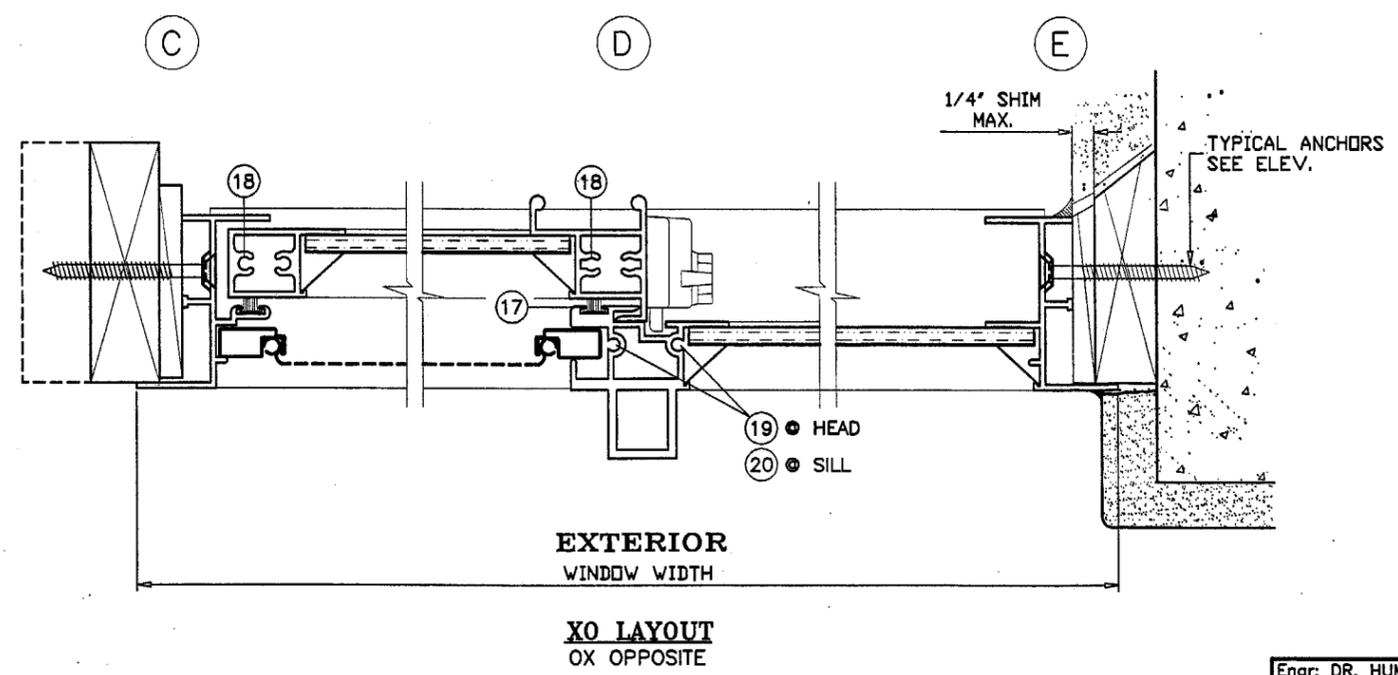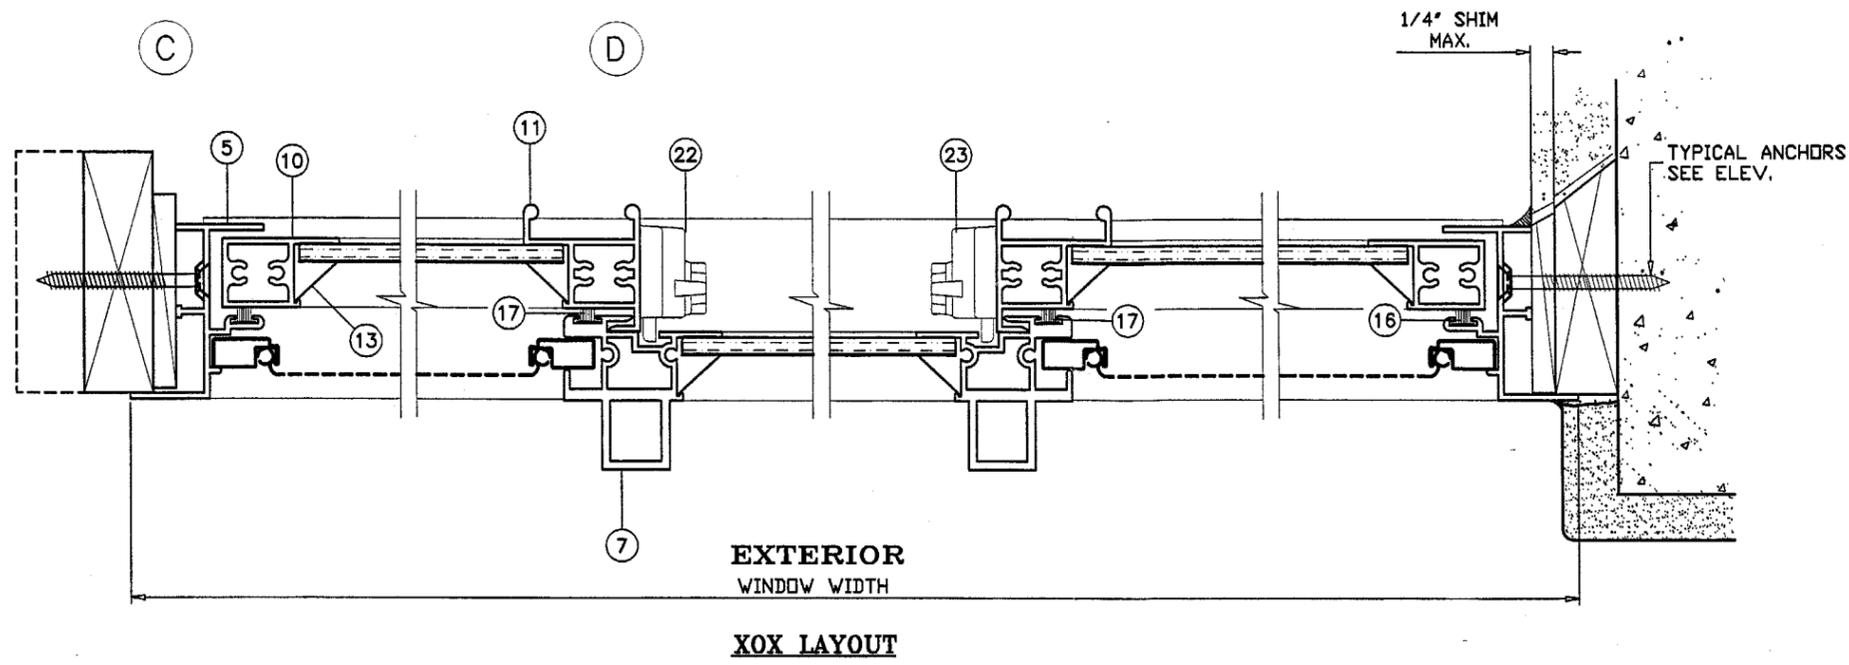

Engr: DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

#

JUL 17 2001

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE AUG 02 2001
BY Manned
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0525.01

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W98-55KL


SERIES RW-XHP ALUM. HORIZ. SLID. WINDOW
KINCO LTD.
280 S.W. 14TH AVE
POMPANO BEACH, FL 33069
TEL.(305) 783-0111

revisions:	no	date	description


date: 07-29-98	scale: 1/2" = 1"	dr. by: HAMID	chk. by:
----------------	------------------	---------------	----------

drawing no.
W98-55


sheet 4 of 5

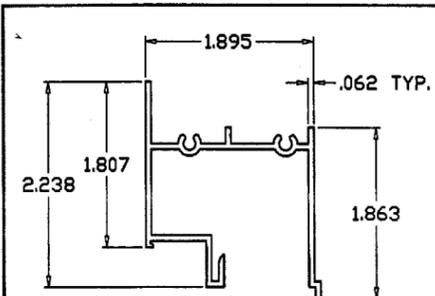


FRAME HEAD

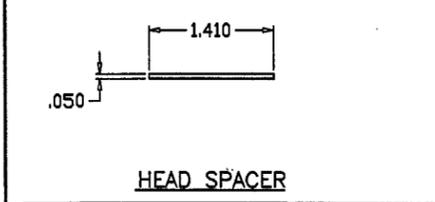


HEAD SPACER

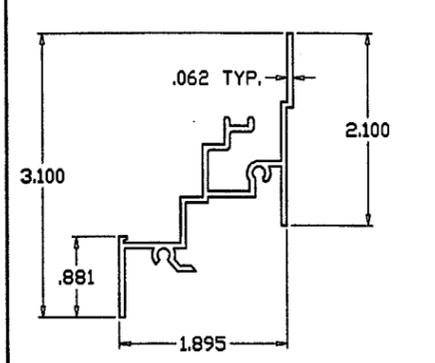


FRAME SILL

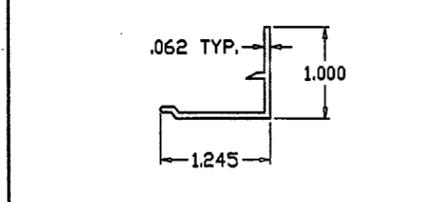


SUB SILL

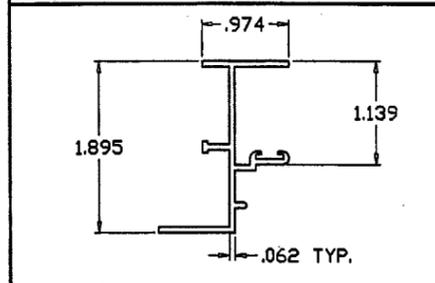


MOVING JAMB

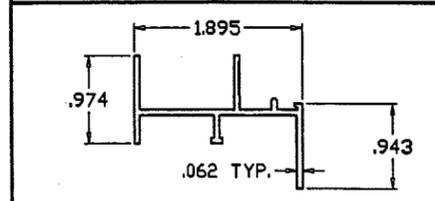


FIXED JAMB

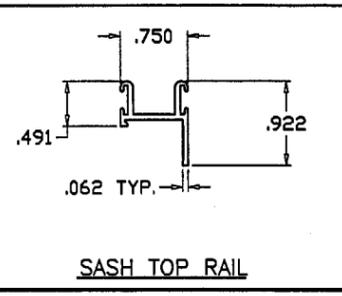


SASH TOP RAIL

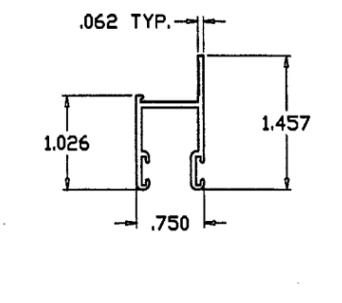


SASH BOTTOM RAIL

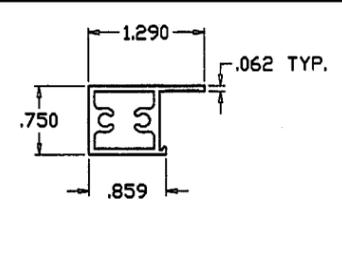


LEAD RAIL

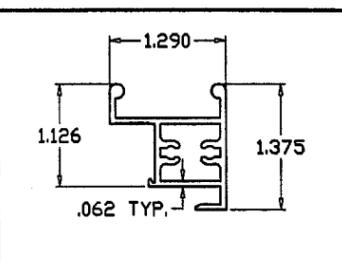


LOCK RAIL

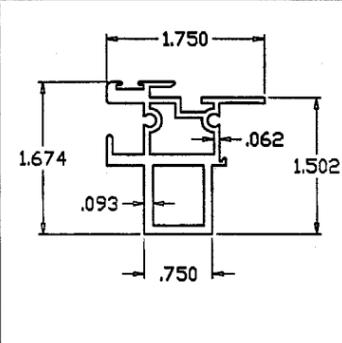


FIXED MTG. RAIL

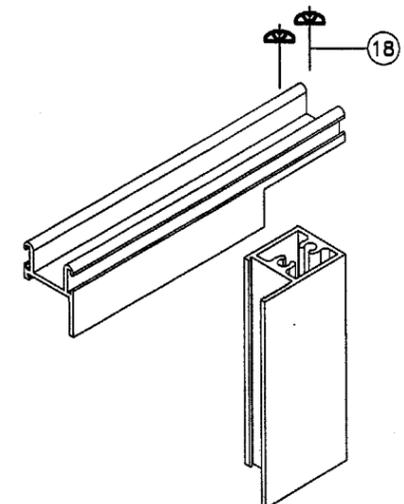


VENT TOP CORNER

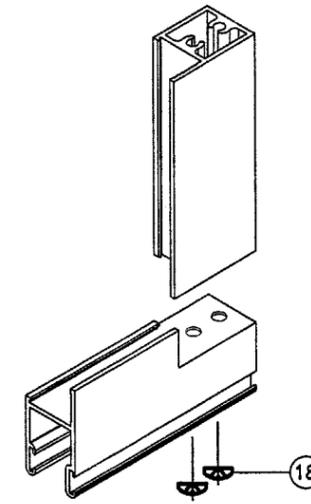

VENT BOTTOM CORNER

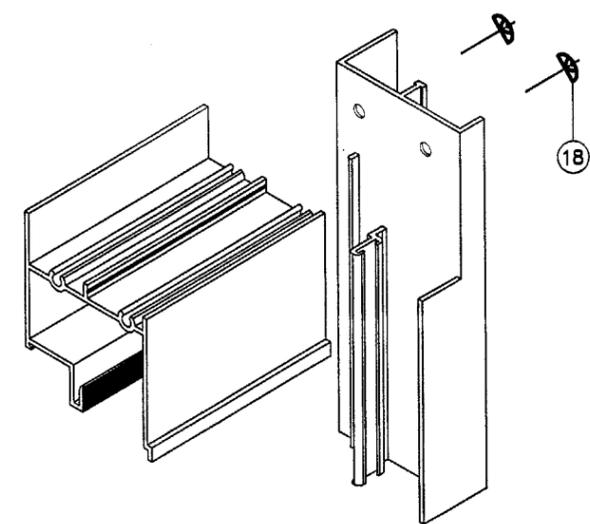

FRAME TOP CORNER

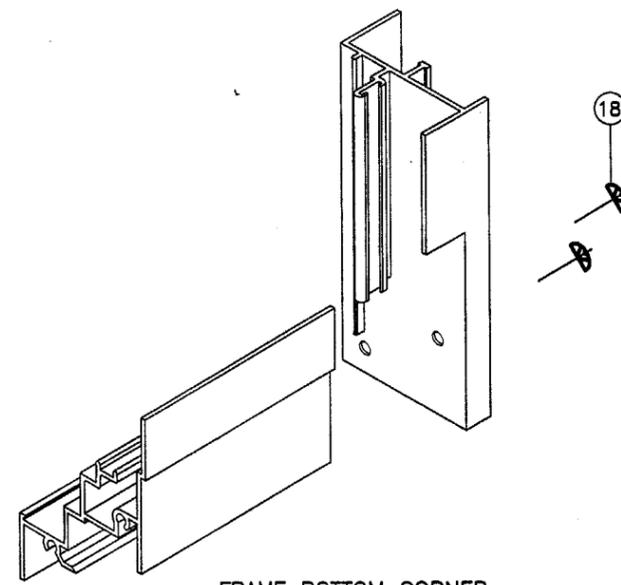

FRAME BOTTOM CORNER

Engr. DR. HUMAYOUN FAROOQ
STRUCTURES
FLA. PE # 16557

JUL 17 2001

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE AUG 02 2001
BY *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0525.01

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W98-55KL

SERIES RW-XHP ALUM. HORIZ. SLD. WINDOW
KINCO LTD.
280 S.W. 14TH AVE
POMPANO BEACH, FL 33069
TEL.(305) 783-0111

no	date	description

date: 07-29-98
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W98-55
sheet 5 of 5