



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

## **NOTICE OF ACCEPTANCE (NOA)**

---

**GAMMA, U. S. A.  
15407 West Dixie Highway  
N. Miami, FL 33162**

### **SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by the BCCO and accepted by the Building Code and Product Review Committee (BCPRC) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The BCCO (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BCPRC reserves the right to revoke this acceptance, if it is determined by BCCO that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County or Florida Building Code.

### **DESCRIPTION: Series "Platinum" Aluminum Window Wall System**

**APPROVAL DOCUMENT:** Drawing No. WWLG-14., titled "Platinum Window Wall LG-14 ", sheets 1 through 2 of 2, prepared by manufacturer, dated 08-02-2000 and last revised on 02-07-02, signed and sealed by Farrokh Rasekhi, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

### **MISSILE IMPACT RATING: Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **01-0612.08** and consists of this page 1 as well as approval document mentioned above. The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**



**NOA No 01-0612.08  
Expiration Date: March 07, 2007  
Approval Date: March 07, 2002  
Page 1**

W-WALL 2 000 42 120 90 SI LG-14


**Gamma**

15407 West Dixie Highway,  
North Miami Beach, FL 33162  
Phone: (305) 957-7004 FAX: (305) 957-7006




**WINDOW**

PROJECT:	PLATINUM WINDOW WALL LG-14	DATE:	08-02-2000
DWG. NAME:	WWLG-14	PROJECT #	0004
TITLE:	TYPICAL DETAILS	SCALE:	

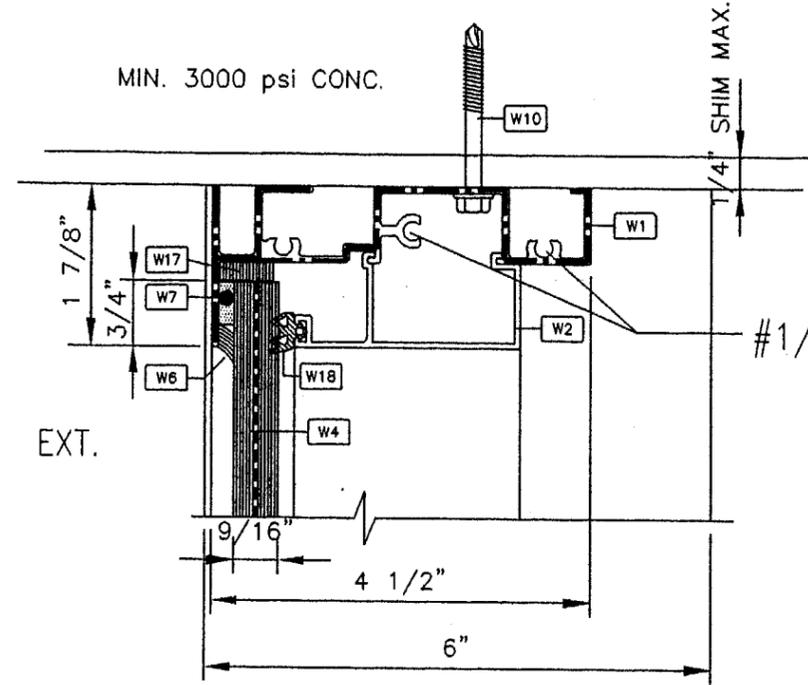


HEAD-101

#1/4"-20x1 1/2" SS SMS

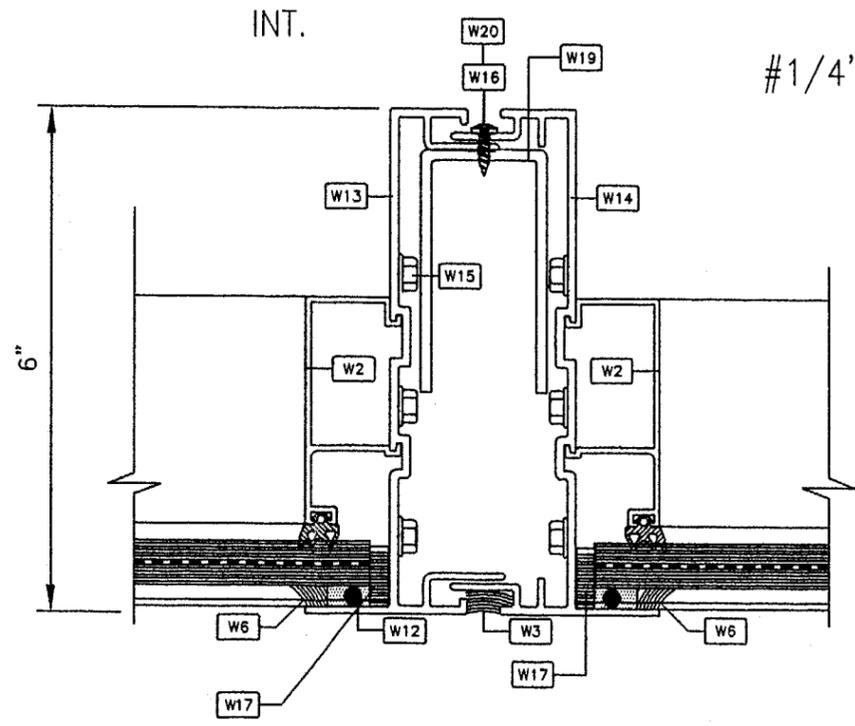


SPLIT-103

#1/4"-20x1 1/2" SS SMS

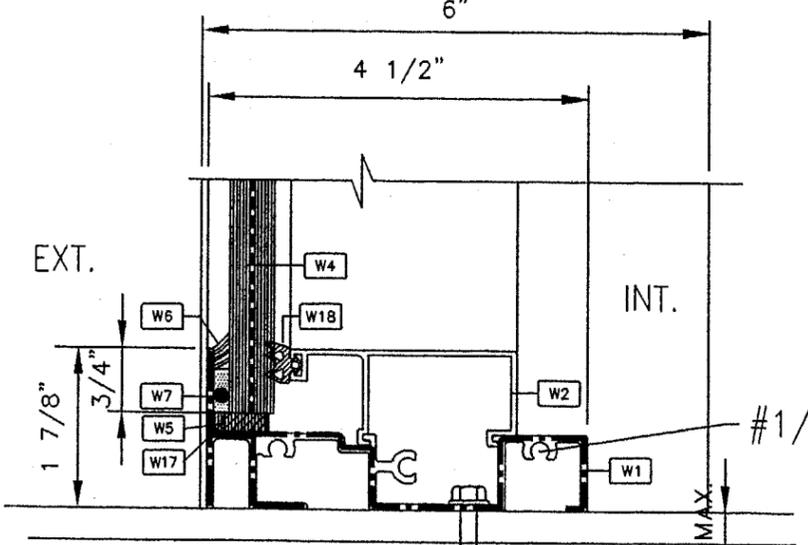

SILL-100

#1/4"-20x1 1/2" SS SMS

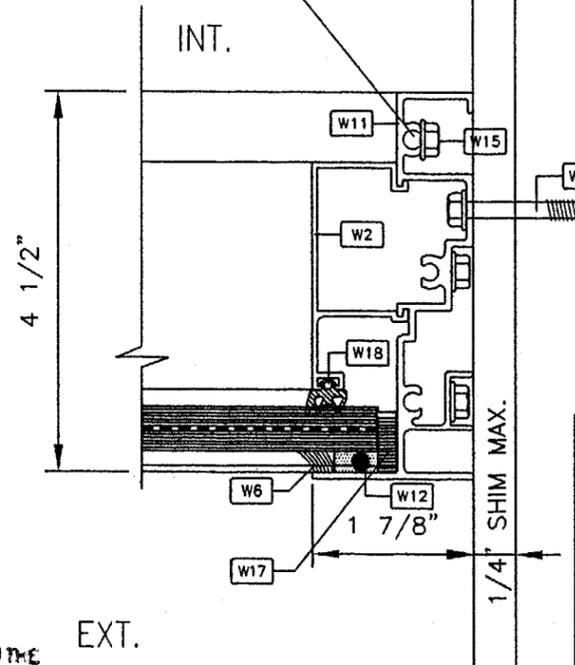

JAMB-102

*Farrokh Rasekhi*  
2/7/02  
Farrokh Rasekhi, P.E.  
Consulting Struct. Engineer  
FL. REG. NO. 38001

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE March 07, 2002  
BY Shaqi Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0612-08

FRAME CORNERS SEALED WITH WHITE COLORED SEALANT AS INDICATED

REVISION:	R4 1/7/02	R5 2/7/02
DRAWN BY:	R1 09-14-00	R2 09-25-00
CHECKED BY:	PHILIPPE MICHAUD	
CAD NAME:	P0004E1	

2  
2

W-WALL 2 000 42 120 90 SI LG-14




15407 West Dixie Highway,  
North Miami Beach, FL 33162  
Phone: (305) 957-7004 FAX: (305) 957-7006



# WINDOW

PROJECT:	PLATINUM WINDOW WALL LG-14	DATE:	08-02-2000
DWG. NAME :	WWLG-14	PROJECT #	0004
TITLE:	TYPICAL ELEVATION	SCALE:	

DESCRIPTION	
W1	ALUMINUM FRAME ( SILL AND HEAD ) # 945587 AL6063 T6
W2	ALUMINUM STOPPER # 945584 AL 6063 T6
W3	SEALANT SPECTREM 2
W4	9/16" LAMINATED GLASS 1/4" CLEAR TEMPERED GLASS 0.060" PVB SAFLEX /KEEPSAFE BY SOLUTIA LAMINATED BY PRELCO 1/4" CLEAR TEMPERED GLASS
W5	1/4" X 1/2" X 3" NEOPRENE SITTING BLOCK AT L/4. 2 AT SILL OF EACH SECTION OF GLASS: TOTAL OF 6
W6	SEALANT SPECTREM2
W7	POLYSHIM 3/16"
W10	1/4" TAPCON SCREW, 2 1/4" LONG
W11	ALUMINUM FRAME JAMB # 945591 AL6063 T6
W12	POLYSHIM 1/4"
W13	ALUMINUM FRAME (SPLIT MULLION) # 945585 AL 6063 T6
W14	ALUMINUM FRAME (SPLIT MULLION) # 945586 AL6063 T6
W15	# 14 HH, 1 1/2" LONG SCREW
W16	# 8 PH STS SCREW 3/4" LONG. (3 BY MULLION) @ 24", 59 1/2", 96" INT. ONLY
W17	SEALANT SPECTREM 2 FOR EACH CORNER 3" X 3" HEAD; 6" STRIP AT MIDSPAN OF CENTER LIGHT FRAME JAMB ; 6" STRIP @ 20" , 54" , 88"
W18	GASKET # 3054
W19	C 2 7/8" x 1 1/2" x 2 7/8" x 1/8" x 108" AL 6063 T6
W20	#12 PH STS SCREW 1" LONG.(5 BY REINFORCEMENT) FROM BOTTOM @ 8, 34, 59 1/2, 85 & 111"

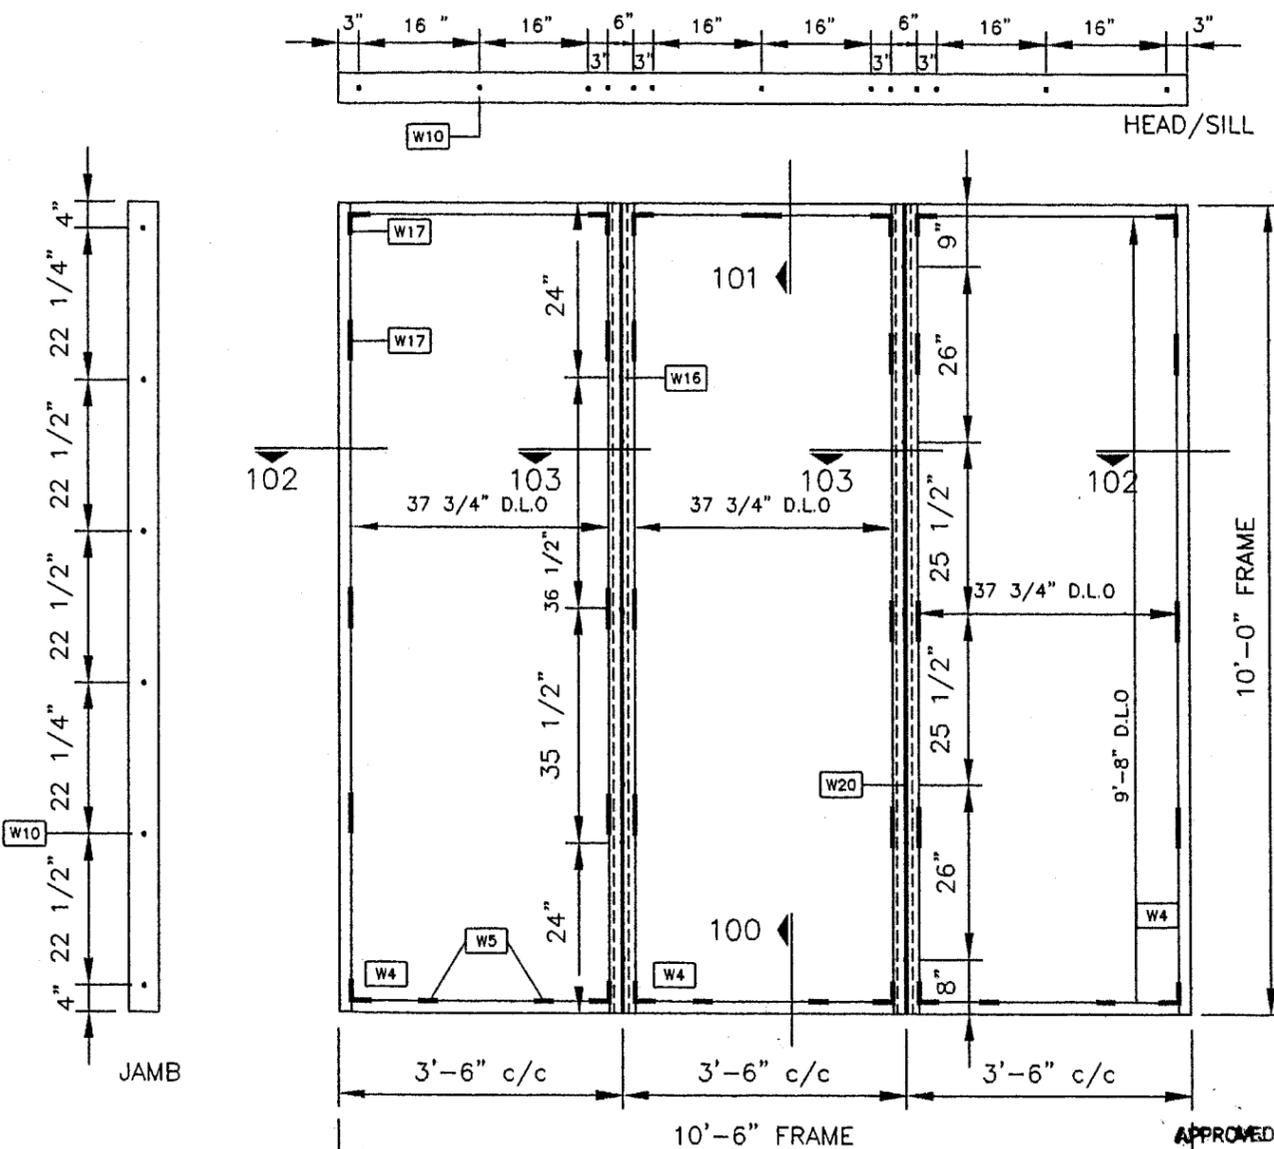

*Farrokh Rasekhi*  
2/7/02  
Farrokh Rasekhi, P.E.  
Consulting Struct. Engineer  
FL. REG. NO. 38001

SHUTTER REQUIREMENTS:  
1- INSTALLATION OF THIS UNIT ABOVE 30 FT ABOVE GRADE WILL NOT REQUIRE SHUTTERS  
2- MIAMI DADE COUNTY APPROVED SHUTTERS WIL BE REQUIRED FOR BELOW 30 FT ABOVE THE GRADE

SMALL IMPACT TEST  
DESIGN PRESSURE + 90 psf  
DESIGN PRESSURE - 90 psf

Typical elevation

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE March 07, 2002  
BY Ishag I. Chayda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 01-0612-08

R4 1/7/02	R5 2/7/02
R1 09-14-00	R2 09-25-00
DRAWN BY: PHILIPPE MICHAUD	
CHECKED BY:	
CAD NAME: P0004E1	
1	2

R3 01-16-01