



MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Pozzi Window Company
62845 Boyd Acres Rd. (P.O. Box 5249)
Bend ,OR 97701

BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

Your application for Notice of Acceptance (NOA) of:

Series "Straight Line & Radius Top" Outswing Aluminum Clad Wood Casement Window - Impact Resistant

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-0620.05
EXPIRES: 09/10/2006

Raul Rodriguez
Chief Product Control Division

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL CONDITIONS BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 08/30/2001

Pozzi Window Company

ACCEPTANCE No.: 01-0620.05

APPROVED : AUG 30 2001

EXPIRES : September 10, 2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1 This **renews** the Notice of Acceptance No. **98-0318.05**, which was issued on September 10, 1998. It approves an aluminum clad outswing wood casement window, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1 The Series **"Straight Line & Radius Top" Outswing Aluminum Clad Wood Casement Window with Mullion - Impact Resistant** and its components shall be constructed in strict compliance with the following documents: Drawing No **CC-1**, Sheets 1 of 8 of 8, titled "Pozzi Aluminum Clad Wood Casement Windows up to 60" x 72"." prepared by R. W. Building Consultants, Inc., dated 11/14/97, revised on 07/17/01, bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1 This approval applies to single unit applications of only, as shown in approved drawings.

4. INSTALLATION


- 4.1 The aluminum clad outswing wood casement window and its components shall be installed in strict compliance with the approved drawings.
- 4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.

5. LABELING

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

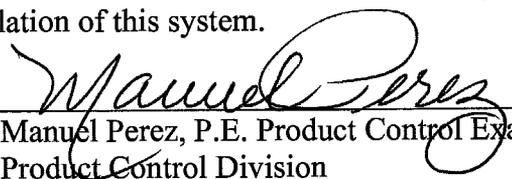
Manuel Perez, P.E. Product Control Examiner
Product Control Division

Pozzi Window Company

ACCEPTANCE No.: 01-0620.05


APPROVED : AUG 30 2001

EXPIRES : September 10, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE

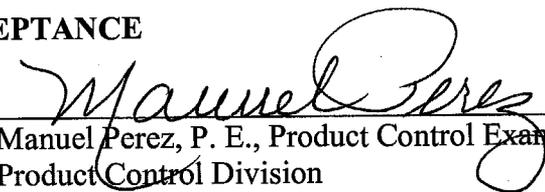
Manuel Perez, P. E., Product Control Examiner
Product Control Division

Pozzi Window Company

ACCEPTANCE No.: 01-0620.05

APPROVED : AUG 30 2001

EXPIRES : September 10, 2006

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA.)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No **CC-1**, Sheets 1 of 8 of 8, titled "Pozzi Aluminum Clad Wood Casement Windows up to 60" x 72"." prepared by R. W. Building Consultants, Inc., dated 11/14/97, revised on 07/17/01

B. TESTS

1. Test reports on 1) Air Infiltration Test, per PA 202-94.
2) Uniform Load Static Air Pressure Test, per PA 202-94.
3) Water Resistance Test, per PA 202-94.
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
along with marked-up drawings and installation diagram of an aluminum clad wood casement window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0112-0508-97**, dated 06/04/97, signed and sealed by Timothy S. Marshall, P.E.
2. Test reports on 1) Large Missile Impact Test per SFBC, PA 201-94
2) Cyclic Wind Pressure Loading per SFBC, PA 203-94
along with marked-up drawings and installation diagram of an aluminum clad wood casement window, prepared by Hurricane Test Laboratory, Inc., Test Report No. **HTL-0112-0604-97**, dated 06/04/97, signed and sealed by Timothy S. Marshall, P.E.

C. CALCULATIONS

1. Anchor Calculations and structural analysis, prepared by Tilteco Inc., dated 01/10/98, signed and sealed by Walter A. Tillit, Jr., P.E

D. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **97-0527.04** issued to Nebula Glass International Inc., for "Glasslam Safety-Plus Laminated Glass" dated 9/09/97, expiring on 9/09/00.

E. STATEMENTS

1. Statement letter of conformance dated on March 16, 1998, issued by Tilteco Inc., signed and sealed by Walter A. Tillit Jr., P.E.
2. Statement letter of no financial interest, dated December 12, 1997, issued by Pozzi Windows Co., signed by Kevin Campbell, Pozzi Product Engineer.
3. Laboratory Compliance Letter dated on January 13, 1998, issued by Hurricane Testing Laboratory, Inc., signed and sealed by Timothy S. Marshall, P.E.

F. OTHER

1. Notice of Acceptance No. **98-0318.05**, issued to Pozzi Window Company for their aluminum clad wood casement window, approved on 9/10/98 and expiring on 9/10/01.

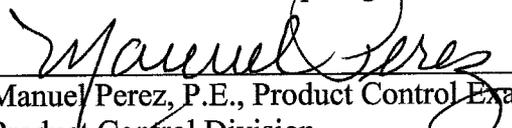
Manuel Perez, P.E., Product Control Examiner
Product Control Division

POZZI WINDOW COMPANY

ALUMINUM CLAD WOOD CASEMENT WINDOWS
W/ AND W/OUT NAILING FLANGE

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS ARE NOT REQUIRED.
5. FOR DESIGN PRESSURE RATING SEE CHART THIS PAGE:

CASEMENT WINDOW CONSTRUCTION

(Common to all conditions)

Wood Frame Construction: The wood frame is 1.219" x 3.320" max. Finger Jointed Ponderosa Pine, or Clear Laminated Pine Veneer. The corners are coped, butted and sealed. Each corner is fastened with (2) 2.0" x .375" W. staples and (1) corner key. A wood frame extension of Ponderosa Pine .65625" x 1.375" is attached to the head, sill and jambs on the interior with 15ga. x 2" L. finish nails.

Wood Sash Construction: The wood sash is 1.484" x 2.09375" max. Clear Pine. The corners are coped, butted and sealed. Each corner is fastened with (1) #8 x 1 3/4" brass Phillips Flathead Wood Screw.


Aluminum Cladding: Custom extrusions of 6063-T5 aluminum 1.773" x .718" x .055" thk. wall or 1.764" x 0.718" x .055" thk. wall, for the frame. The sash is clad with a roll formed 3105-H15 .019" thk. coiled aluminum stock .350" x 1.537" for the rectangle top. The radius top sash is clad with 6063-T1 extruded aluminum 1.764" x .718" x .055" thk.

Window Construction: The aluminum cladding is tongue and groove fit to the wood frame with mitered corners and secured with (2) #6 x 2" screws per corner. It is secured to the wood frame with .375" W. x 1" L. wire staples spaced at 24" O.C. An aluminum drip cap/nailling flange is snap fitted to the head of the window and a PVC nailling flange is snap fitted to the jambs and sill.

Glazing Method: .380" or .505" Laminated Annealed glass By Glasslam. The interior and exterior are both glazed with Dow Corning 1199. The interior side has a wood glass stop attached to the frame with 3/16" x 3/4" wire staples at 2" in from the corners and 12" O.C.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATION
2	VERTICAL CROSS SECTIONS
3	HORIZONTAL CROSS SECTIONS W/OUT NAILING FLANGE
4	HORIZONTAL CROSS SECTIONS W/NAILING FLANGE
5	ANCHORING LOCATIONS
6	UNIT COMPONENTS
7	UNIT COMPONENTS
8	BILL OF MATERIALS & GLAZING DETAILS

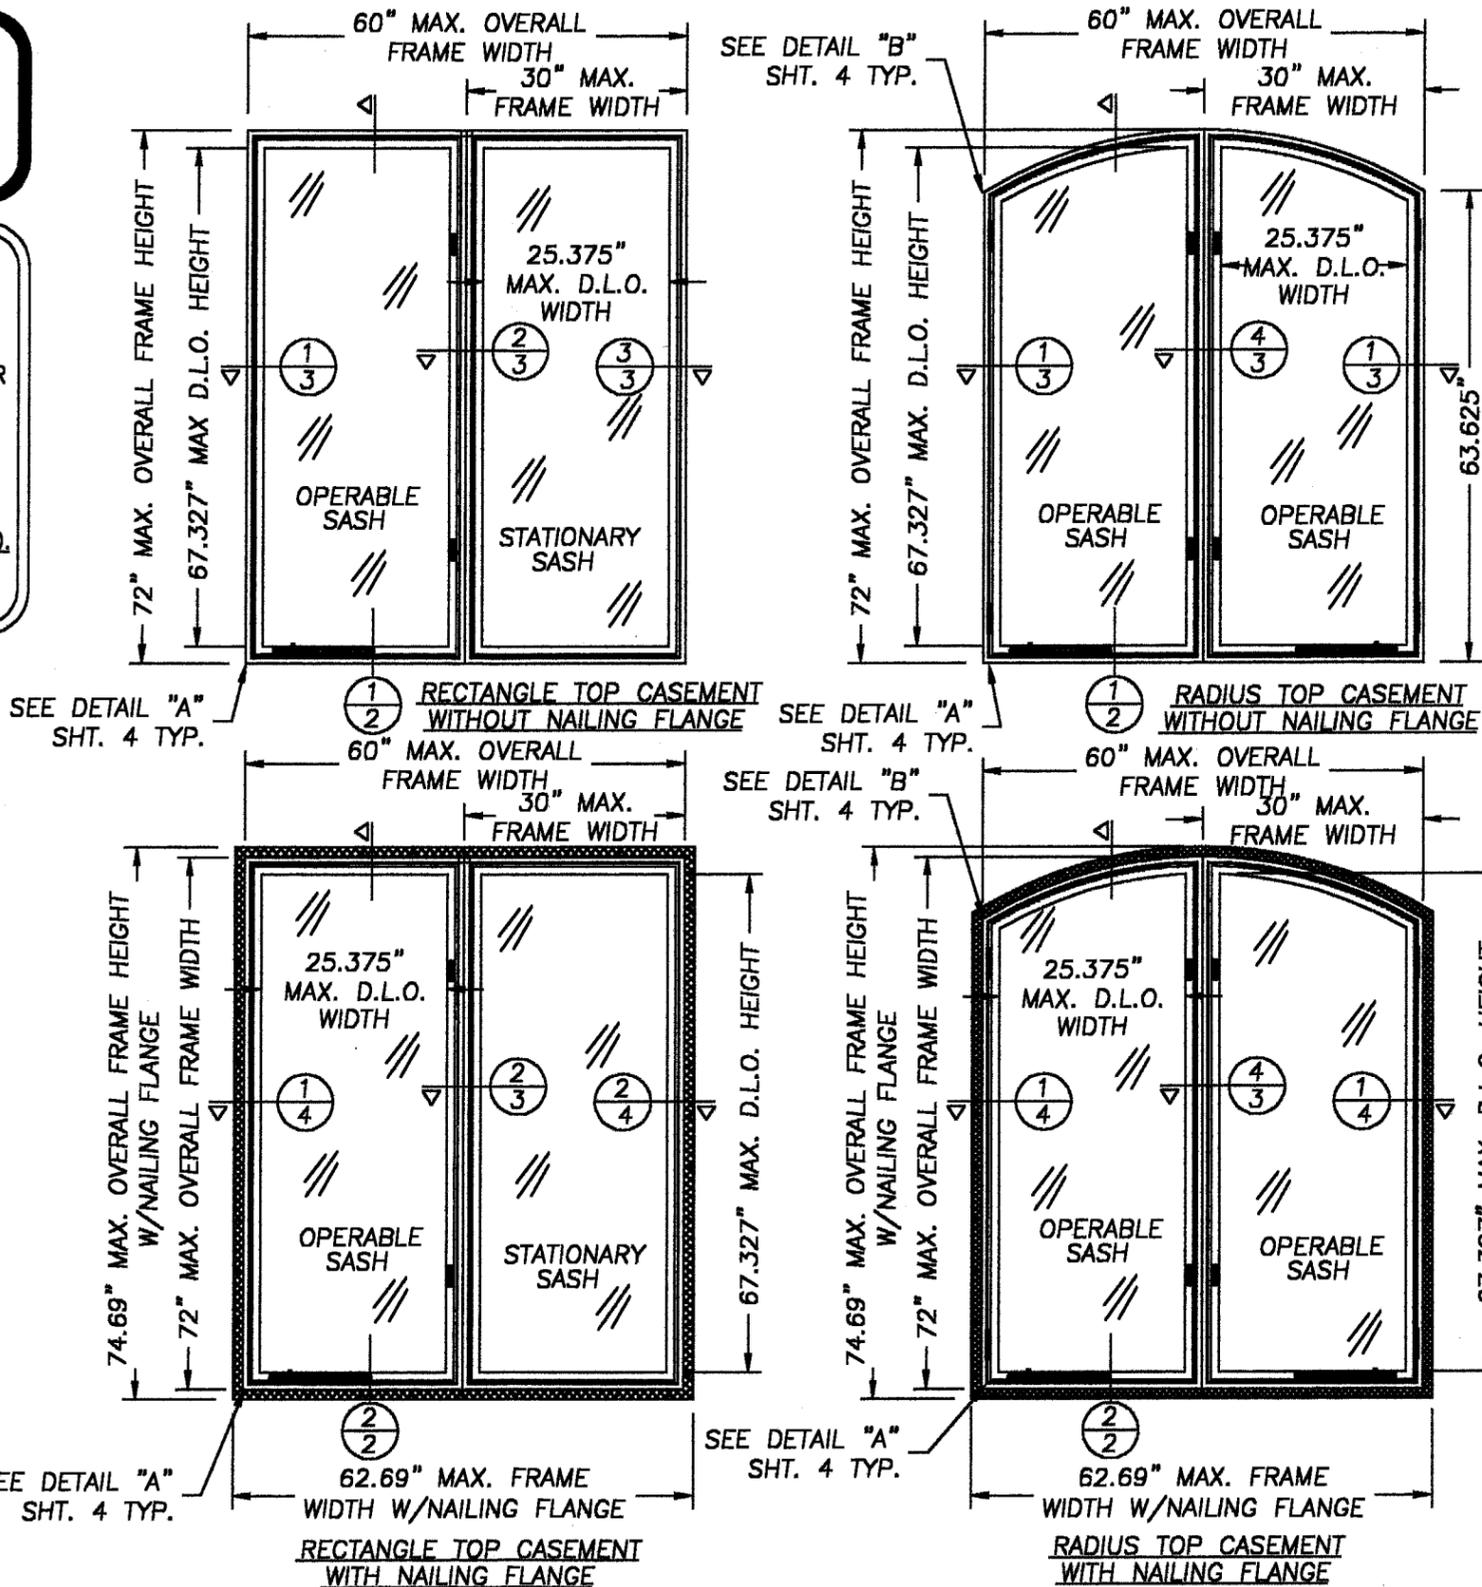

DESIGN PRESSURE RATING ALL MODELS SHOWN		
GLAZING TYPE & SQUARE FEET	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	
.380" THK. GLASS W/ 1/8" ANNEALED UP TO 8.33 sq. ft.	+60.0 psf	-60.0 psf
.505" THK. GLASS W/ 3/16" ANNEALED UP TO 11.86 sq. ft.	+60.0 psf	-60.0 psf

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Manuel...*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0620.05

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD WOOD CASEMENT WINDOWS UP TO 60" x 72"
PART OR ASSEMBLY: GENERAL NOTES & TYPICAL ELEVATIONS

NO.	DATE	REVISIONS	BY
2	07/17/01	COMPLY W/ASTM E 1300	TJH
1	06/13/01	GENERAL REVISION	TJH

RW BUILDING CONSULTANTS, INC.
813.684.3831

DATE: 11/14/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.: CC-1
SHEET 1 OF 8

POZZI WINDOW COMPANY
 62845 BOYD ACRES RD.
 BEND, OREGON 97701
 PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD
 WOOD CASEMENT WINDOWS
 UP TO 60" x 72"
 PART OR ASSEMBLY:
 VERTICAL
 CROSS SECTIONS

NO.	DATE	REVISIONS	BY
2	07/17/01	COMPLY W/ASTM E 1300	TJH
1	06/13/01	GENERAL REVISION	TJH


RW BUILDING
 CONSULTANTS, INC.
 813.684.3831

DATE: 11/14/97
 SCALE: 1/2" = 1"
 DWG. BY: P.H.G.
 CHK. BY:
 DRAWING NO.:
 CC-1
 SHEET 2 OF 8

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE **AUG 30 2001**
 BY *Manuel...*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0620.05

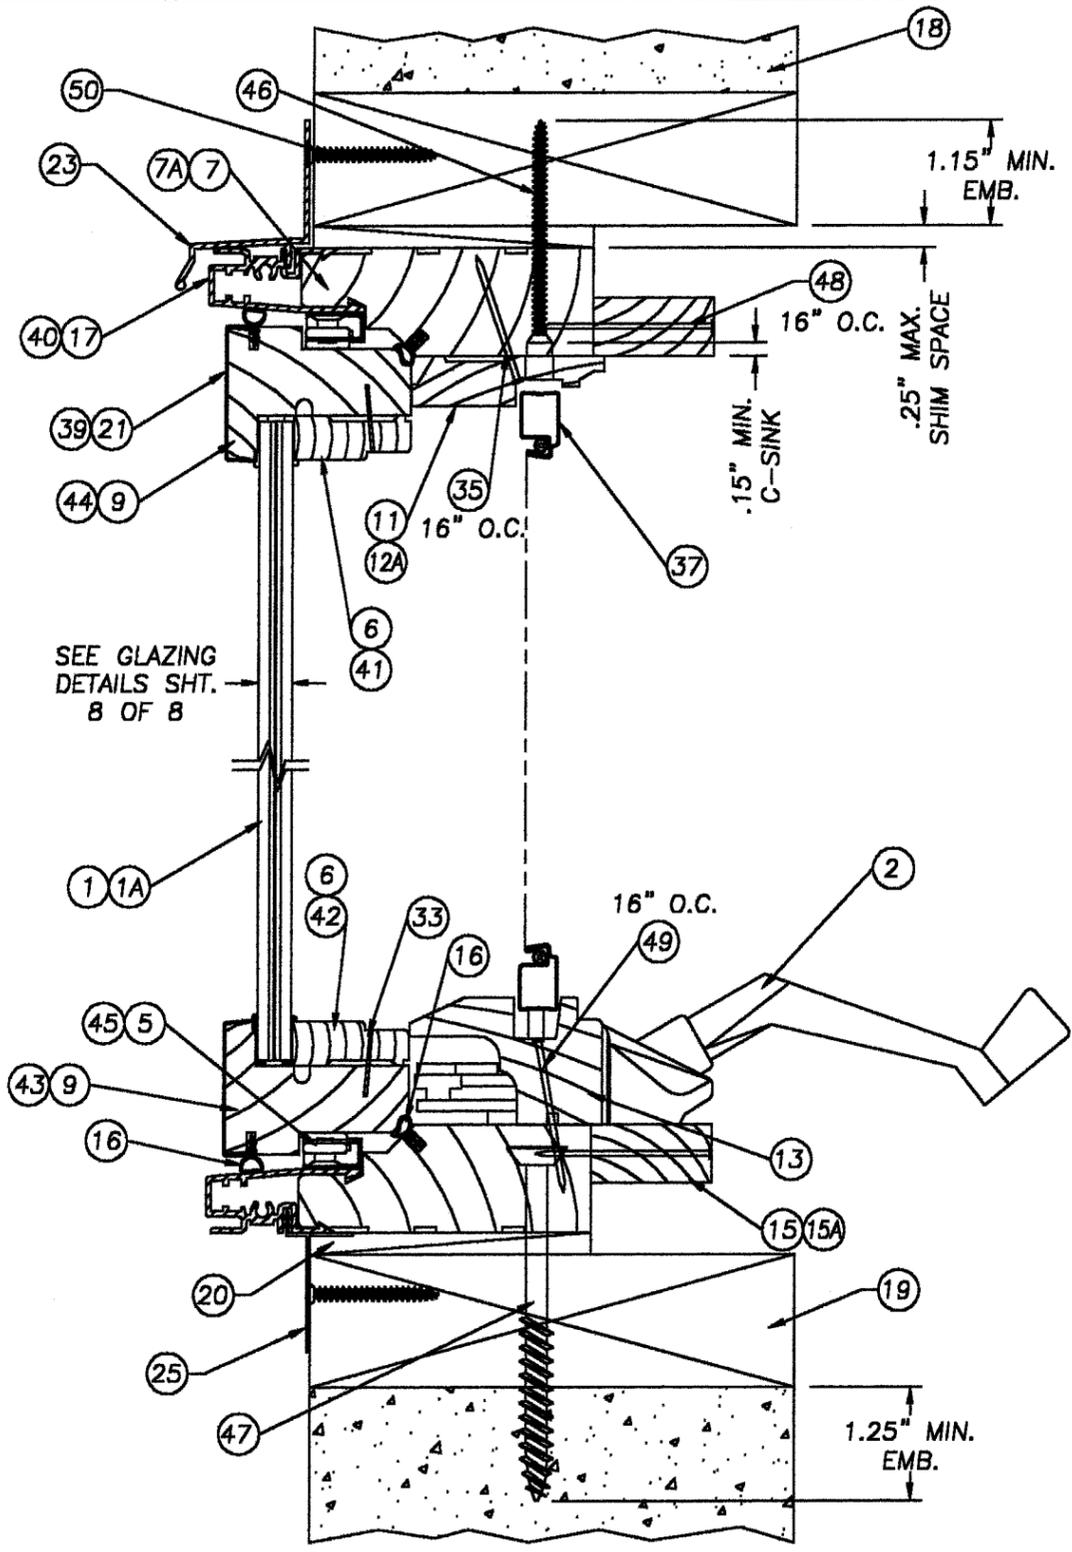


1 VERTICAL CROSS SECTION
 2 W/NAILING FLANGE

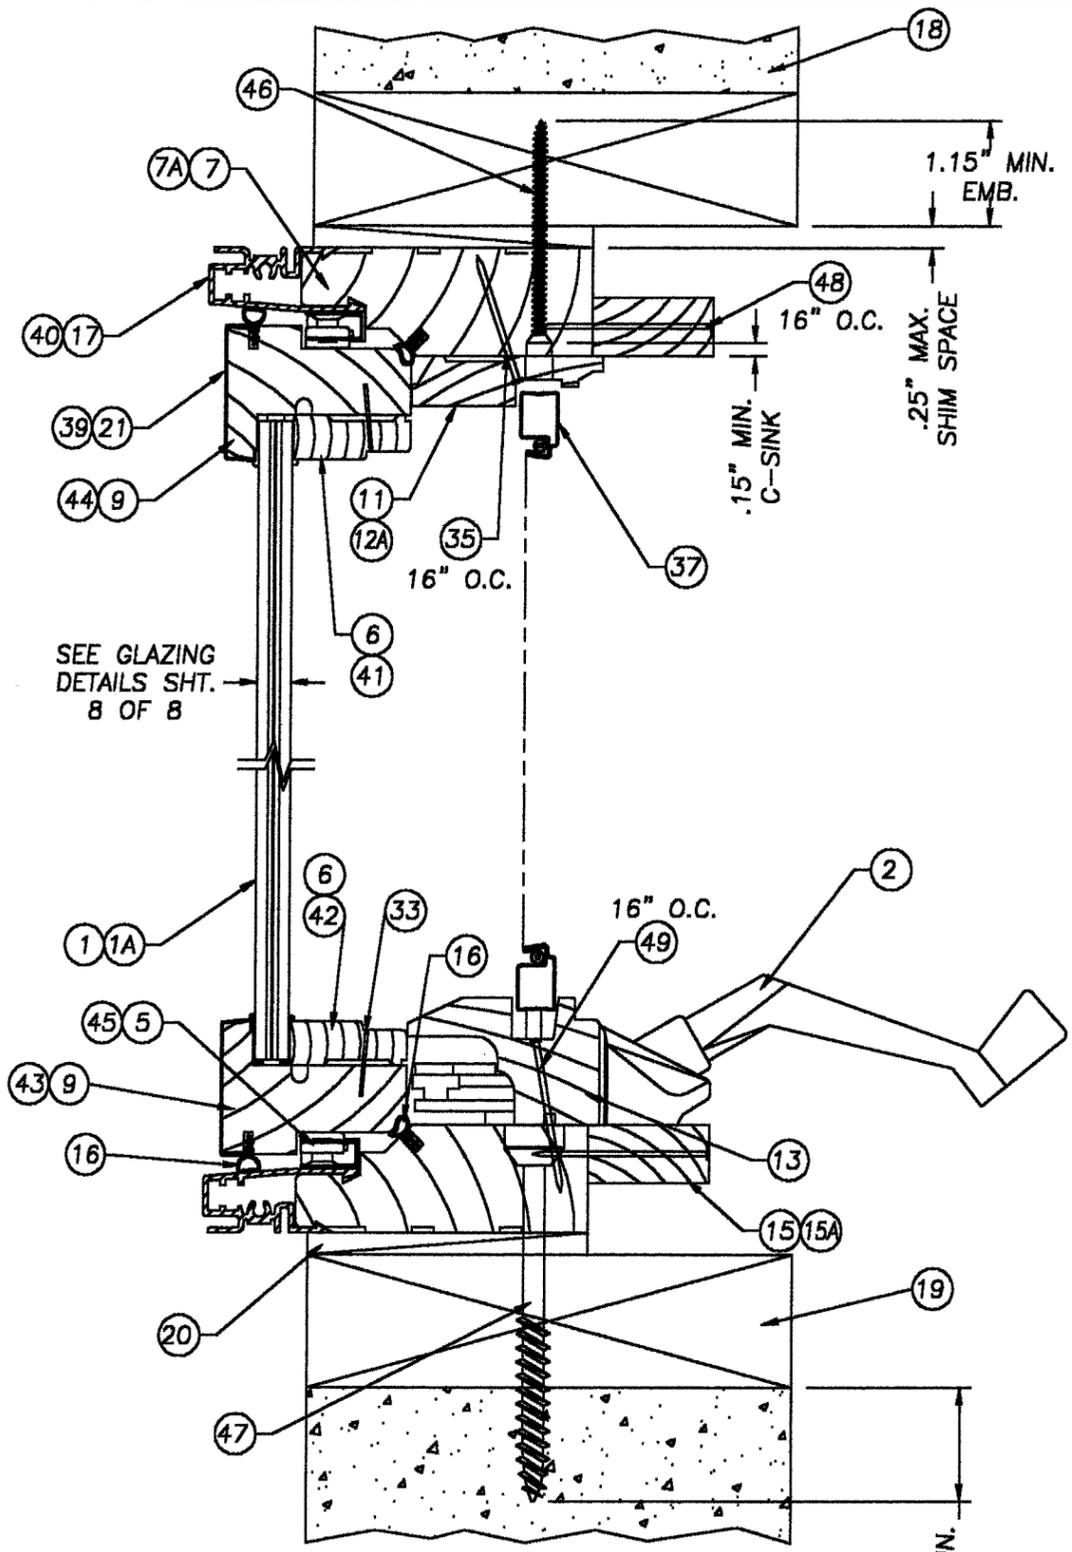


1 VERTICAL CROSS SECTION
 2 W/OUT NAILING FLANGE

SEE GLAZING
 DETAILS SHT.
 8 OF 8


SEE GLAZING
 DETAILS SHT.
 8 OF 8

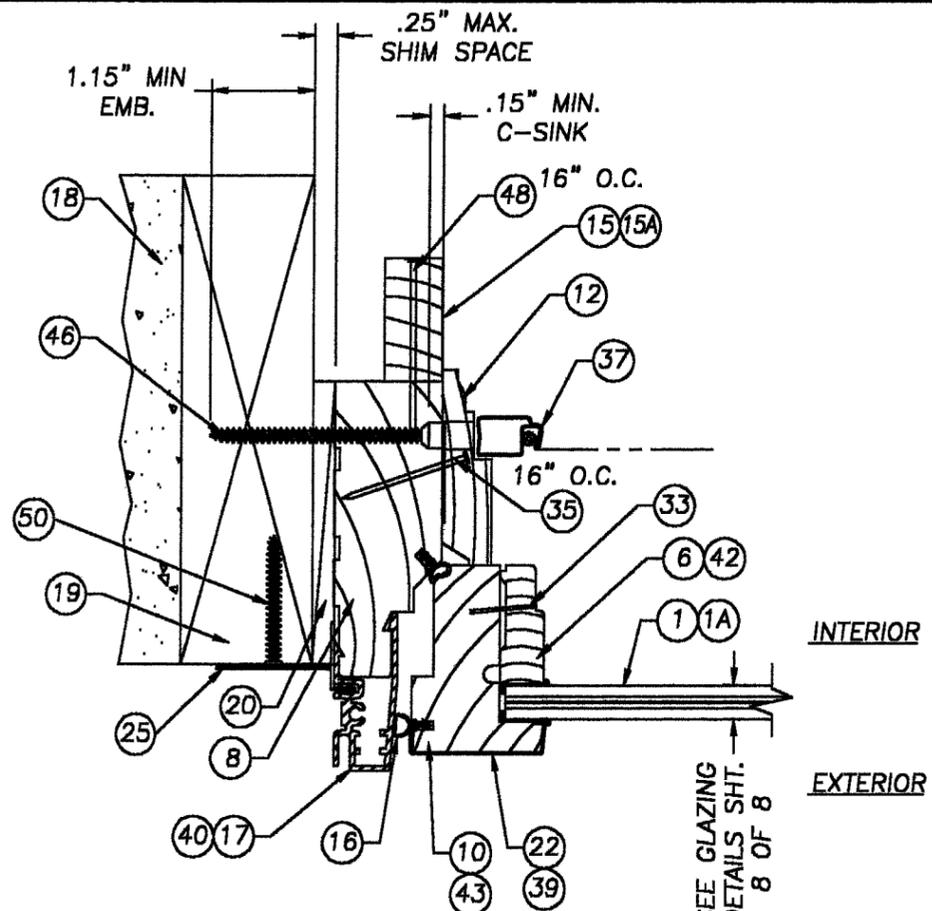


1 HORIZONTAL CROSS SECTION
4 OPERABLE SASH TO BUCK
W/NAILING FLANGE

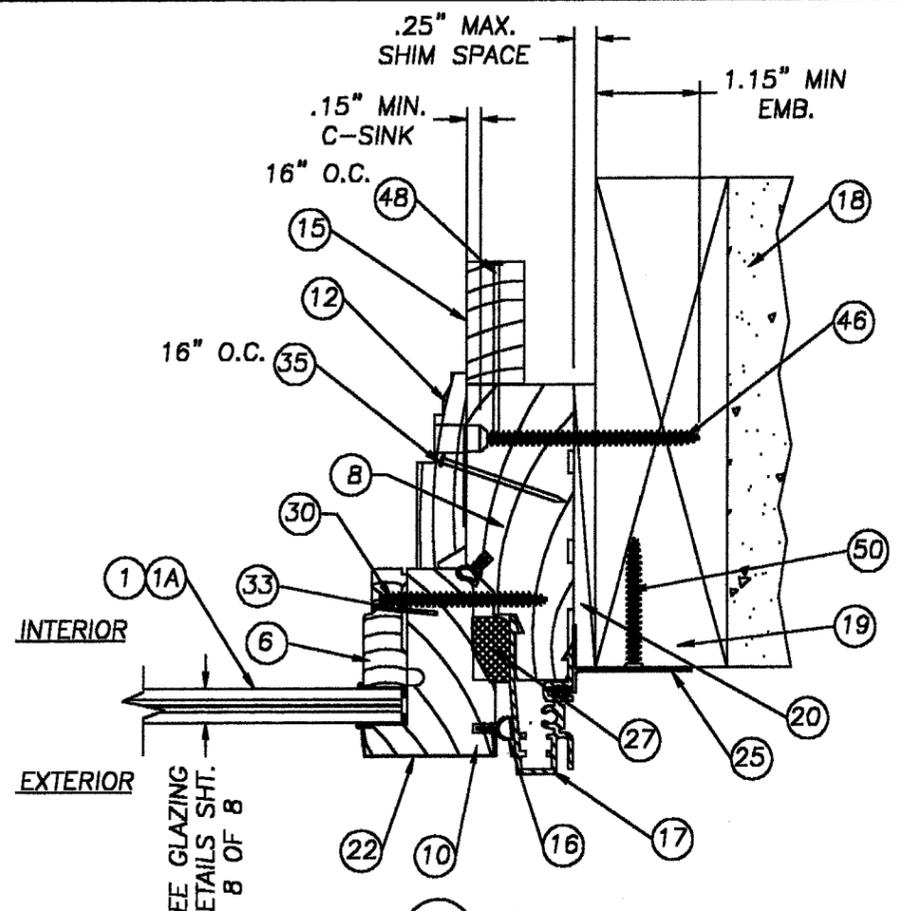


2 HORIZONTAL CROSS SECTION
4 STATIONARY SASH TO BUCK
W/NAILING FLANGE

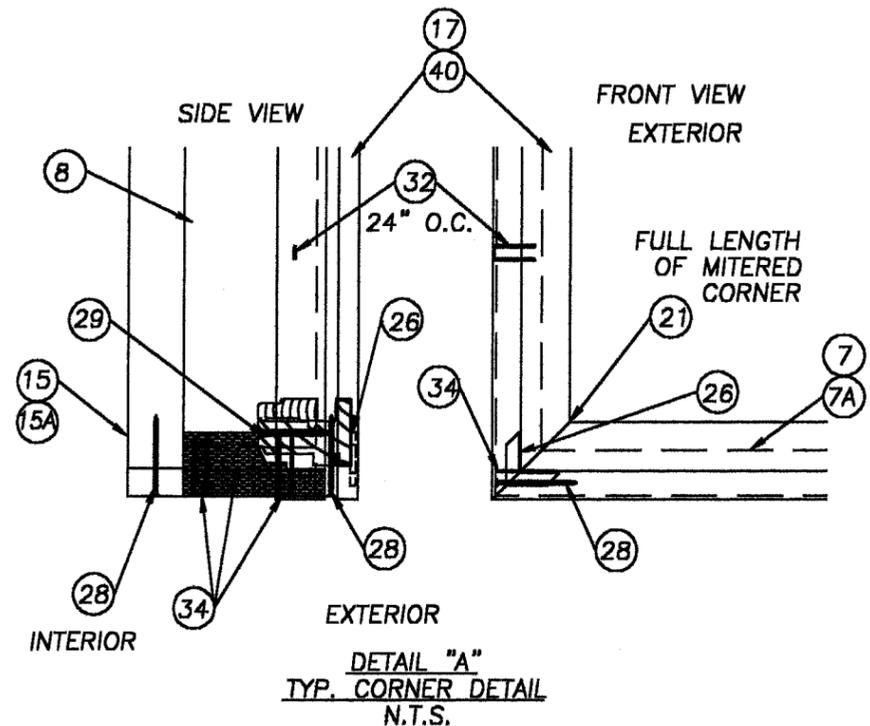

DETAIL "A"
TYP. CORNER DETAIL
N.T.S.

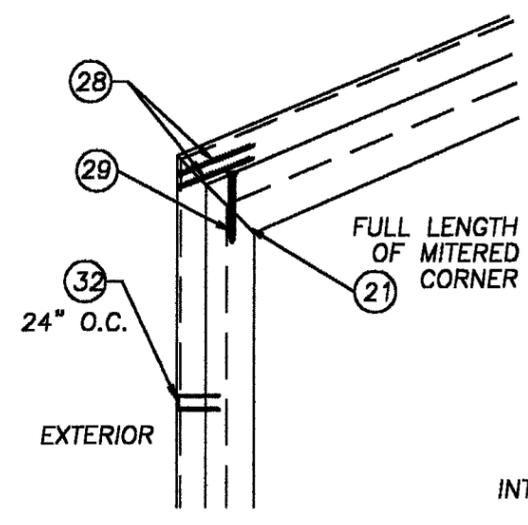

DETAIL "B"
TYP. CORNER DETAIL
N.T.S.

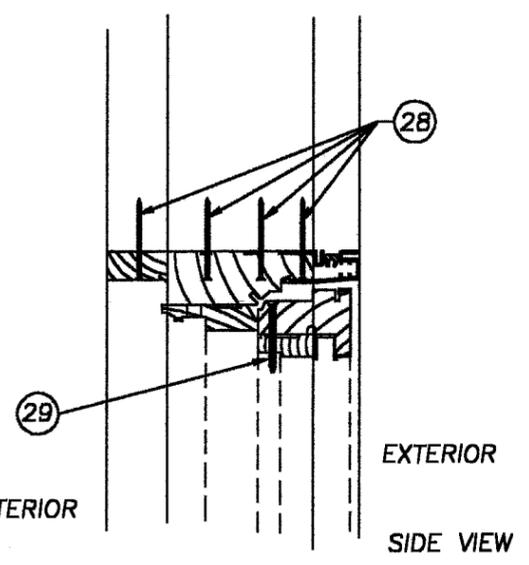

SIDE VIEW

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD
WOOD CASEMENT WINDOWS
UP TO 60" x 72"
PART OR ASSEMBLY:
HORIZONTAL X-SECTIONS
W/NAILING FLANGE

NO.	DATE	BY	REVISIONS
2	07/17/01	COMPLY W/ASIM E 1300 TJH	TJH
1	06/13/01	GENERAL REVISION	TJH


RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Manuel Carr*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0620.05

DATE: 11/14/97
SCALE: 1/2" = 1"
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.:
CC-1
SHEET 4 of 8

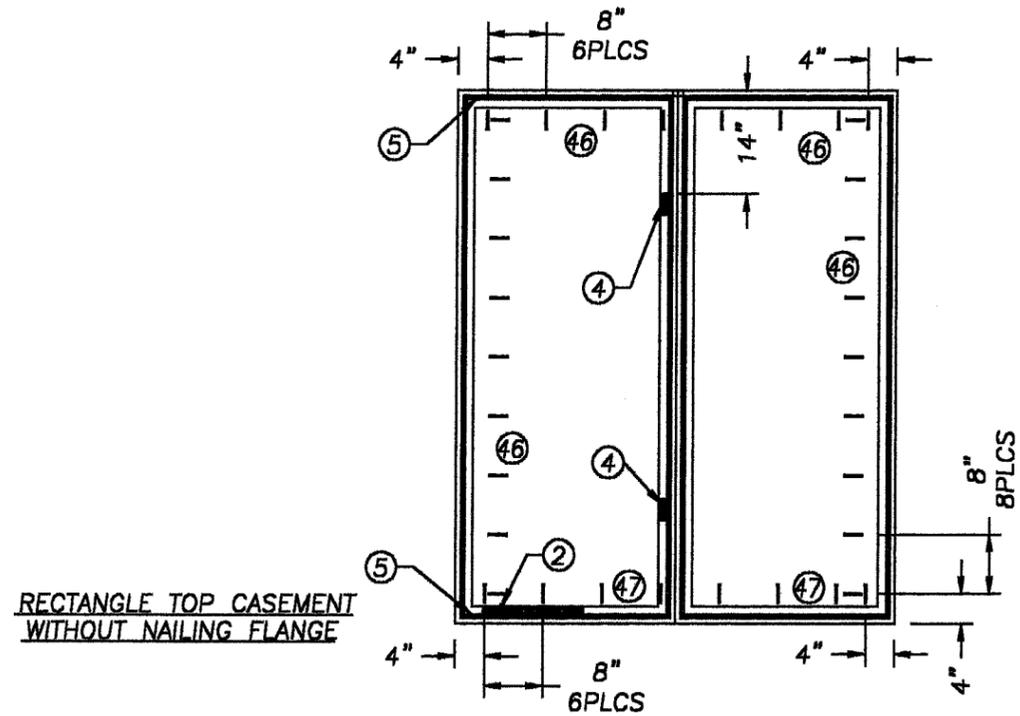

RECTANGLE TOP CASEMENT
WITHOUT NAILING FLANGE

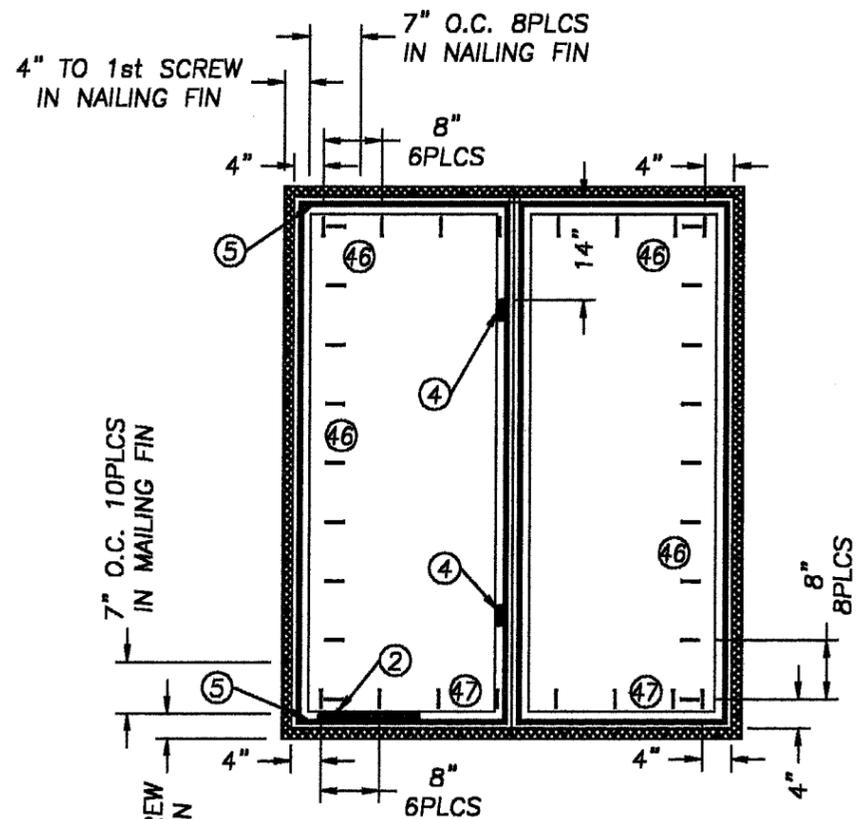

RECTANGLE TOP CASEMENT
WITH NAILING FLANGE
SEE NOTE THIS SHT.


4" TO 1st SCREW
IN NAILING FIN

7" O.C. 10PLCS
IN NAILING FIN


4" TO 1st SCREW
IN NAILING FIN

7" O.C. 8PLCS
IN NAILING FIN

NOTE: ALL SCREWS IN THE NAILING FIN
ARE ITEM #50 FROM THE BILL OF
MATERIALS A #8 x 1 1/2" GALVANIZED SCREW.

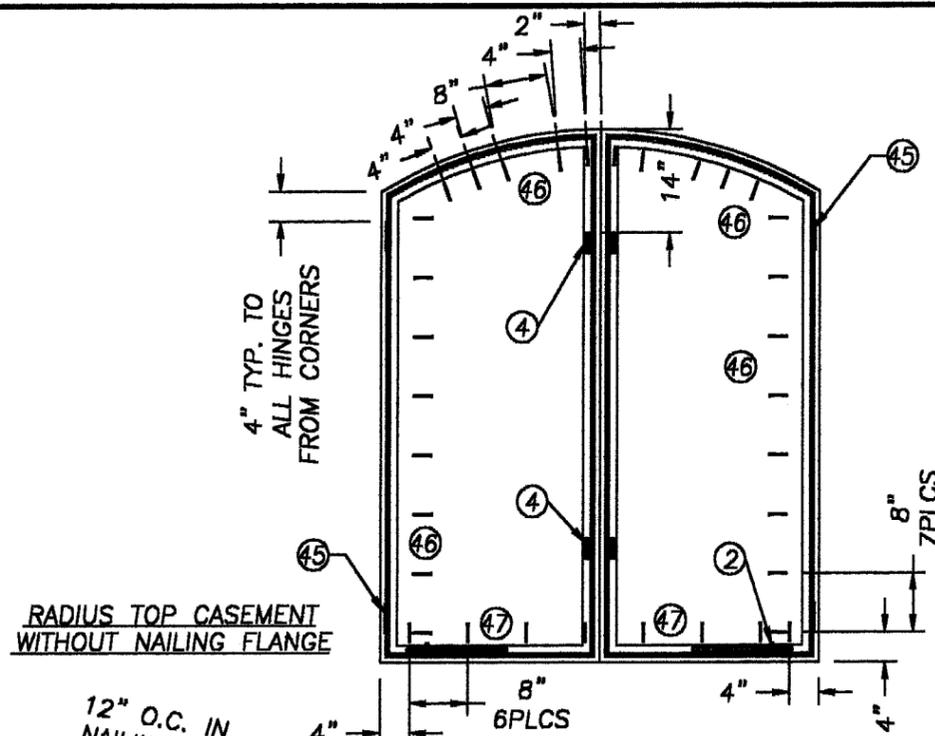

RADIUS TOP CASEMENT
WITHOUT NAILING FLANGE

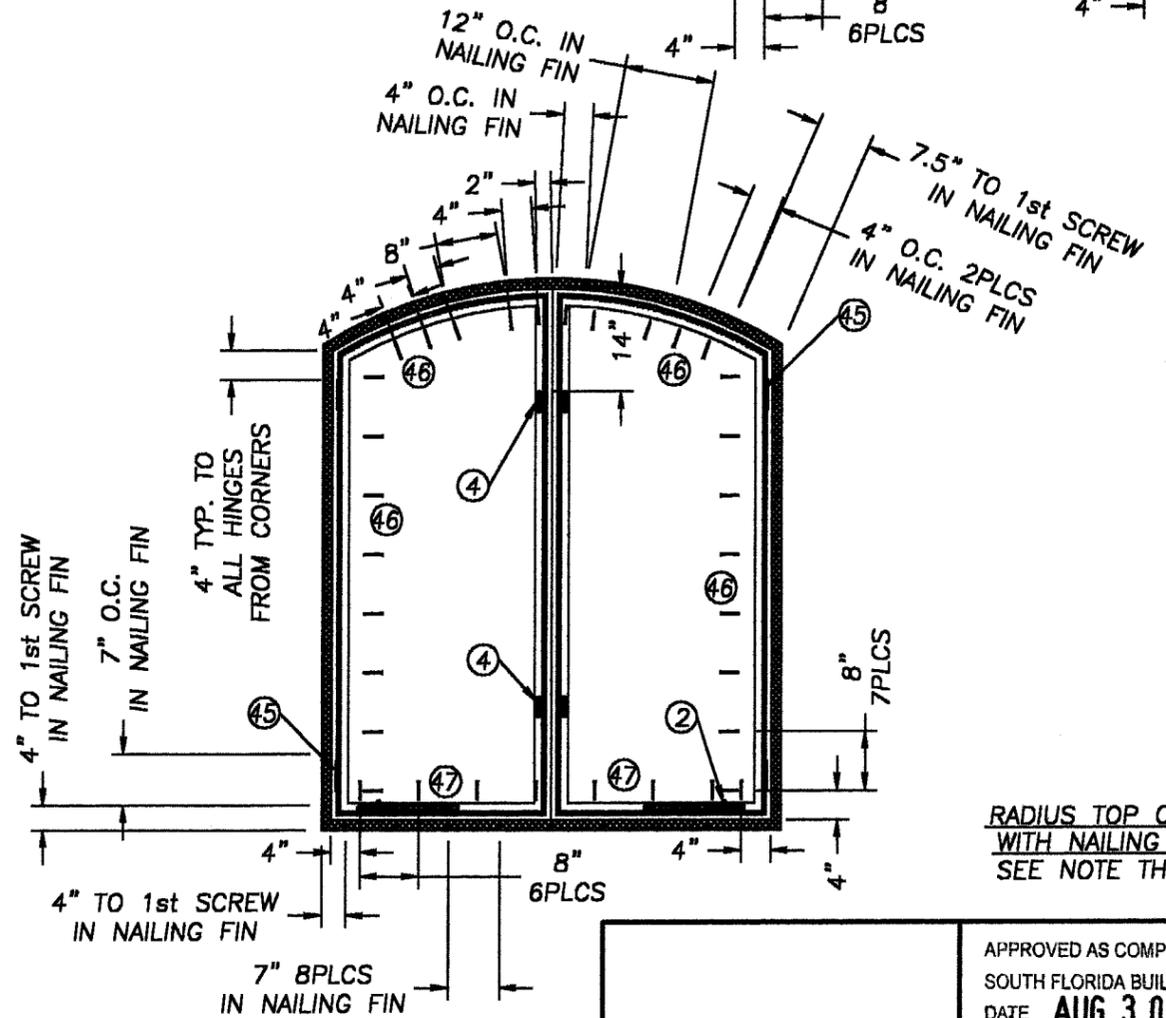

RADIUS TOP CASEMENT
WITH NAILING FLANGE
SEE NOTE THIS SHT.

4" TO 1st SCREW
IN NAILING FIN

4" TO 1st SCREW
IN NAILING FIN

7" 8PLCS
IN NAILING FIN

4" TYP. TO
ALL HINGES
FROM CORNERS

12" O.C. IN
NAILING FIN

4" O.C. IN
NAILING FIN

7.5" TO 1st SCREW
IN NAILING FIN

4" O.C. 2PLCS
IN NAILING FIN

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *01-0620.05*


POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT:
POZZI ALUMINUM CLAD
WOOD CASEMENT WINDOWS
UP TO 60" x 72"
PART OR ASSEMBLY:
ANCHORING LOCATIONS


NO.	DATE	REVISIONS	BY
2	07/17/01	COMPLY W/ASTM E 1300	TJH
1	06/13/01	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.684.3831

DATE: 11/14/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.: CC-1
SHEET 5 OF 8

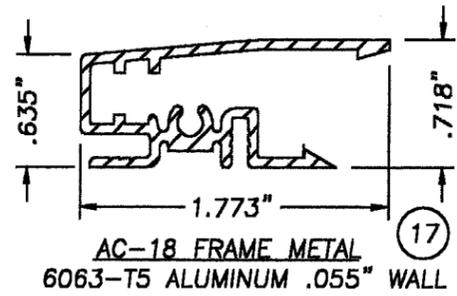


AC-18 FRAME METAL
6063-T5 ALUMINUM .055" WALL

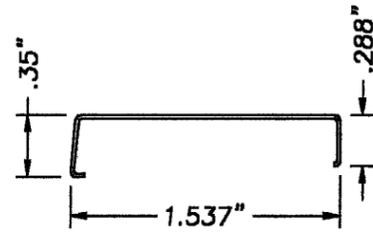

AC-45 (22)


AC-46 (21)

ROLL FORMED SASH CLADDING
COILED ALUMINUM STOCK 3105-H15
.019 TYP. WALL

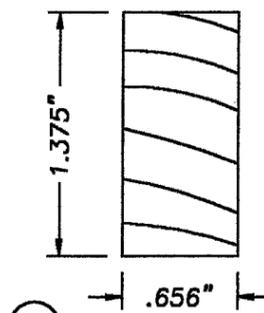


(15)

AC-11 JAMB EXTENSION
CLEAR PIN

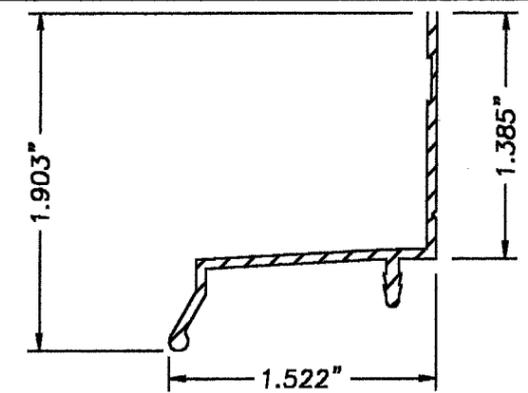


(23)

AC-172 DRIP CAP
6063-T5 ALUMINUM .055" WALL

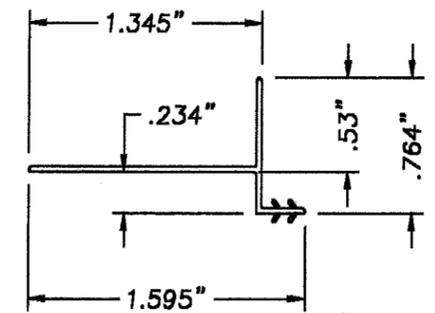


(25)

AC-35 NAIL FIN
EXTRUDED PVC .030" WALL

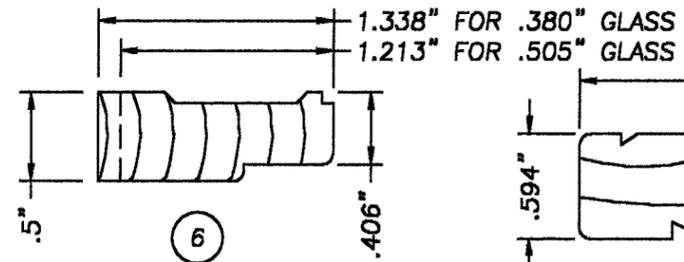


(6)

AC-162 GLASS STOP
FINGER JOINTED PIN

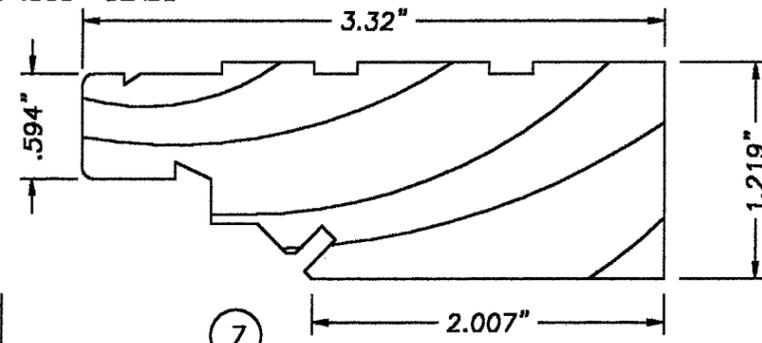


(7)

AC-2 HEAD & SILL WOOD FRAME
AC-4 SIDE WOOD FRAME
FINGER JOINTED PIN

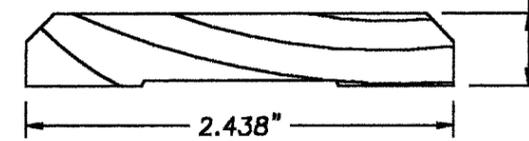


(14)

AC-6 INTERIOR MULL COVER
CLEAR PIN

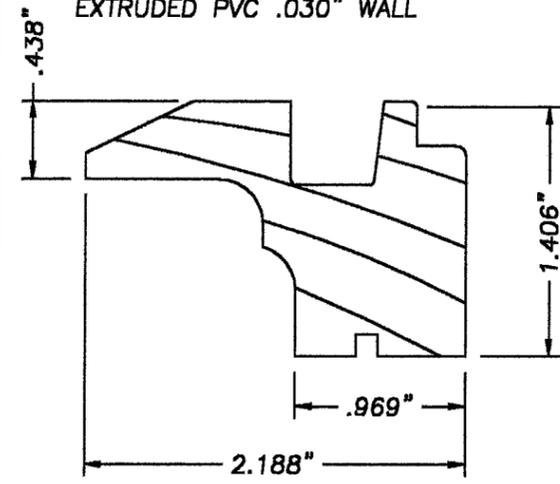


(13)

DC-22 OPERATOR COVER
CLEAR PIN

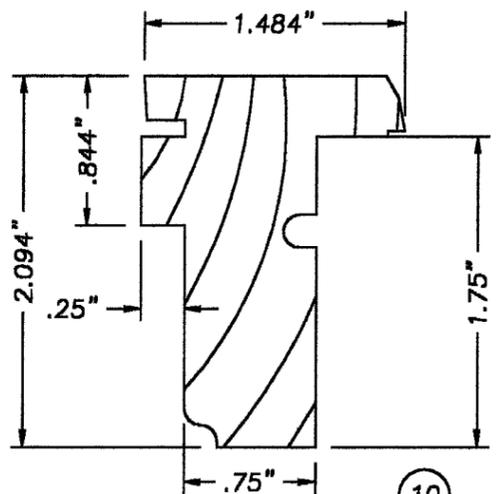


(9)

AC-161 SASH STILE
AC-160 SASH TOP & BOTTOM RAIL
CLEAR PIN

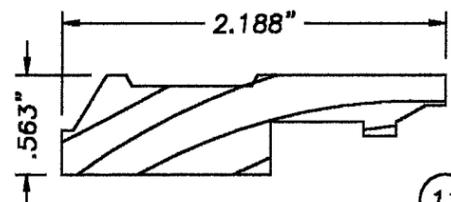


(11)

DC-5 HEAD SCREEN STOP
CLEAR PIN

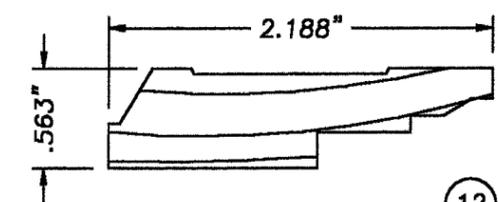


(12)

DC-7 SIDE SCREEN STOP
CLEAR PIN

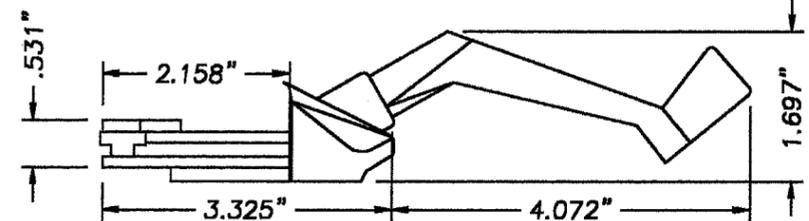


(2)

OPERATOR WITH HANDLE
TRUTH #15-94, DIE-CAST ZINC BASE,
CRANK HANDLE AND KNOB. HARDENED
STEEL WORM AND GEAR. HIGH STRENGTH
PLASTIC COVER

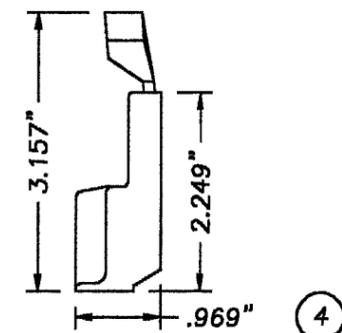

(4)

SASH LOCK TRUTH #16-18
DIE-CAST ZINC HANDLE AND
CASE STEEL BACK PLATE AND
LOCKING CAM

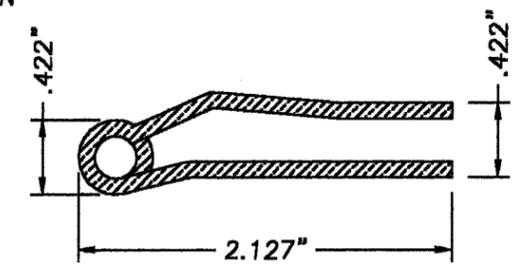

(45)

DV-215 HINGE RADIUS TOP
.089" WALL SOLID BRASS


PRODUCT: POZZI ALUMINUM CLAD
WOOD CASEMENT WINDOWS
UP TO 60" x 72"
PART OR ASSEMBLY:
UNIT COMPONENTS

NO.	DATE	REVISIONS	TJH	BY
2	07/17/01	COMPLY W/ASTM E 1300	TJH	
1	06/13/01	GENERAL REVISION	TJH	


RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Wammel*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *01-0620.05*


DATE: 11/14/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.: CC-1
SHEET 6 OF 8

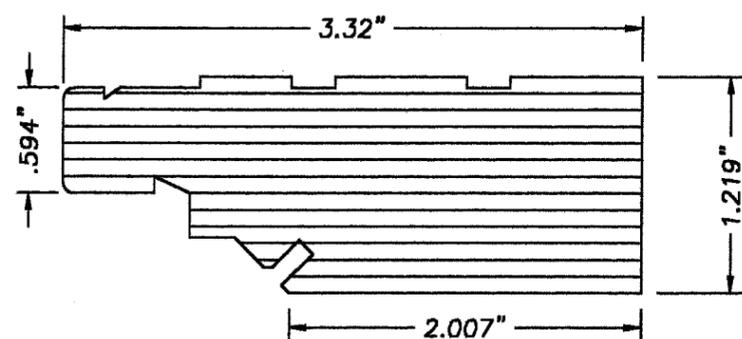


AC-2 HEAD RADIUS WOOD FRAME
CLEAR LAMINATED PINE VENEER (7A)

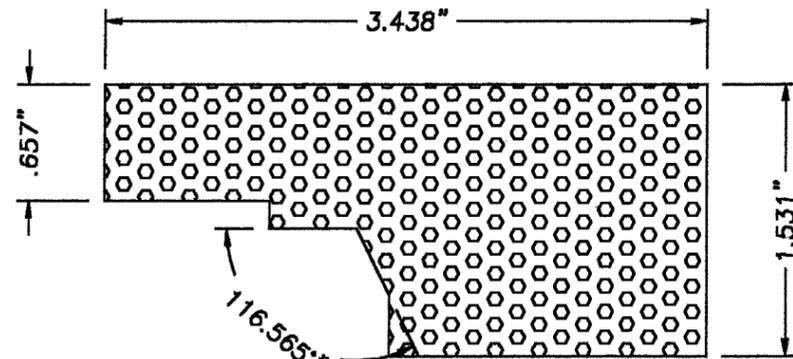


1/16" CLOSED CELL FOAM FRAME GASKET (38)

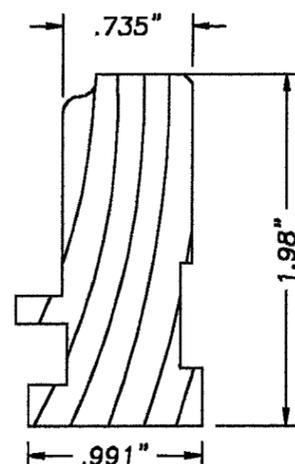


AC-191 SASH STILE & BOTTOM RAIL
RADIUS WINDOW, CLEAR PINE (43)




SASH HINGE TRUTH #14-75
10" LONG STEEL TRACK & ARMS
WITH STAINLESS STEEL INSERT INSIDE
DELTRIN SLIDE SHOE WITH A BRASS
POST & LOCKING SNAP RING (5)

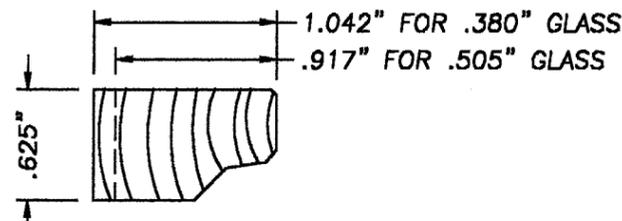


AC-193 SIDE & SILL GLASS STOP
RADIUS WINDOW, FINGER JOINTED PIN
AC-193 HEAD RADIUS GLASS STOP
CLEAR LAMINATED PINE VENEER (42)




AC-11 RADIUS JAMB EXTENSION
CLEAR LAMINATED PINE VENEER (15A)

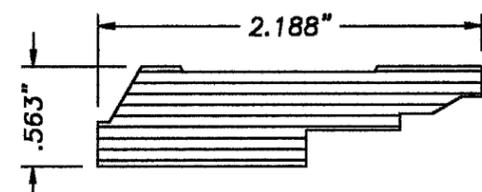


DC-7 HEAD RADIUS SCREEN STOP
CLEAR LAMINATED PINE VENEER (12A)

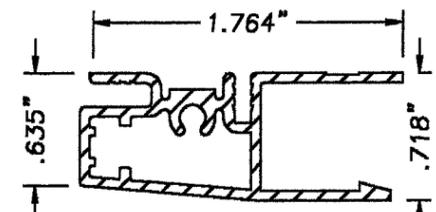


AC-194 FRAME METAL
RADIUS WINDOW
EXTRUDED ALUM. .055" WALL
6063-T1 (40)

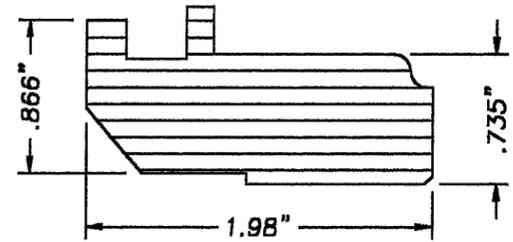


AC-191 RADIUS TOP RAIL
CLEAR LAMINATED PINE VENEER (44)

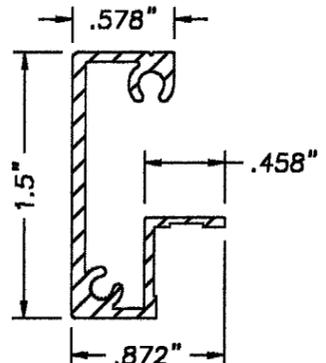


AC-192 SASH METAL
RADIUS WINDOW
EXTRUDED ALUM. .075" WALL
6063-T1 & T5 (39)

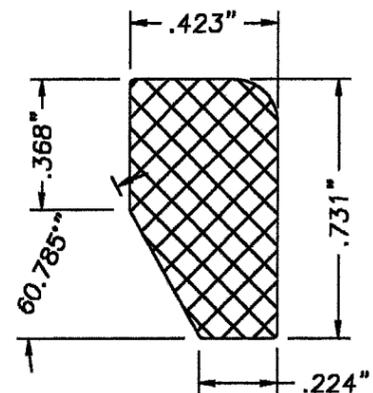


DC-209 STA. SASH
SETTING BLOCK
EXTRUDED VINYL (27)

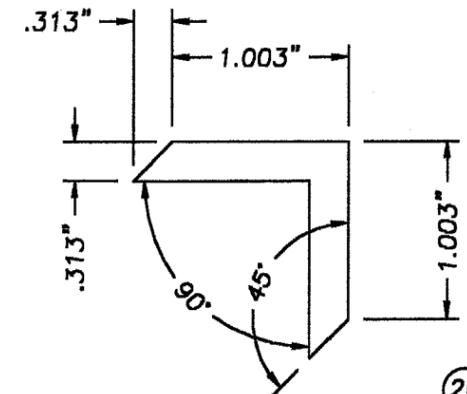


AC-74 FRAME CORNER KEY
ALUM. ALLOY 6061-T6511
.125" THK. (26)



AB-200 1/4" VINYL BULB
.020" WALL (16)



AC-220 MULL COVER
EXTRUDED ALUM. .072" WALL
6063-T5 (24)



SASH OPERATING TRACK
TRUTH #30706
.050" WALL STEEL (3)

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD
WOOD CASEMENT WINDOWS
UP TO 60" x 72"
PART OR ASSEMBLY:
UNIT COMPONENTS


NO.	DATE	REVISIONS	TJ/H	BY
2	07/17/01	COMPLY W/ASTM E 1300	TJ/H	
1	06/13/01	GENERAL REVISION	TJ/H	

RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0620.05


DATE: 11/14/97
SCALE: N.T.S.
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.: CC-1
SHEET 7 OF 8

Item	Description	Material
1	GLASSLAM GLAZING .380" OVERALL THK. BY GLASSLAM	-
1A	GLASSLAM GLAZING .505" OVERALL THK. BY GLASSLAM	-
2	OPERATOR W/HANDLE & COVER (15-94 TRUTH HARDWARE)	-
3	SASH TRACK (30706 TRUTH HARDWARE .050" WALL)	STEEL
4	SASH LOCK & KEEPER (16-18 TRUTH HARDWARE)	-
5	SASH HINGE RECTANGLE TOP (14-75 TRUTH HARDWARE)	-
6	GLASS STOP WOOD REC. TOP (AC-162 BEND MILLWORKS)	FINGER J. PINE
7	HEAD & SILL WOOD FRAME REC. TOP (AC-2 BEND MILLWORKS)	FINGER J. PINE
7A	HEAD & SILL WOOD FRAME RADIUS TOP (AC-2 BEND MILLWORKS)	CLEAR LAM. PINE VEN.
8	SIDE WOOD FRAME (AC-4 BEND MILLWORKS)	FINGER J. PINE
9	SASH TOP & BOTTOM RAIL REC. TOP (AC-160 BEND MILLWORKS)	CLEAR PINE
10	SASH STILE REC. TOP (AC-161 BEND MILLWORKS)	CLEAR PINE
11	HEAD SCREEN STOP REC. TOP (DC-5 BEND MILLWORKS)	CLEAR PINE
12	SIDE SCREEN STOP REC. TOP (DC-7 BEND MILLWORKS)	CLEAR PINE
12A	HEAD SCREEN STOP RAD. TOP (DC-7 BEND MILLWORKS)	CLEAR LAM. PINE VEN.
13	OPERATOR COVER (DC-22 BEND MILLWORKS)	CLEAR PINE
14	INT. MULL COVER (AC-6 BEND MILLWORKS)	CLEAR PINE
15	STRAIGHT JAMB EXTENSION REC. TOP (AC-11 BEND MILLWORKS)	CLEAR PINE
15A	STRAIGHT JAMB EXTENSION RAD. TOP (AC-11 BEND MILLWORKS)	CLEAR LAM. PINE VEN.
16	1/4" VINYL BULB WEATHERSTRIP (AB-200 INTEK)	VINYL
17	FRAME METAL CLADDING REC. TOP ALUM. (AC-18 ANODIZING INC.)	6063-T5
18	MASONRY WALL	CONC.
19	2x WOOD BUCK	WOOD
20	1/4" SHIM	-
21	SASH ROLL FORMED RAIL ALUM. CLADDING (AC-46 NICHOLS-HOMESHIELD)	3105 H-15
22	SASH ROLL FORMED STILE ALUM. CLADDING (AC-45 NICHOLS-HOMESHIELD)	3105 H-15
23	ALUM. DRIP CAP (AC-172 ANODIZING INC.)	6063-T5
24	ALUM. EXT. MULL COVER (AC-220 ANODIZING INC.)	6063-T5
25	PVC NAILING FIN (AC-35 PLASTIC PROFILES INC.)	PVC
26	ALUM. FRAME CORNER KEY (AC-74 MITCHELL METALS)	6061-T6511
27	VINYL STATION. SASH SETTING BLOCK (DC-209 INTEK)	VINYL
28	#6 x 2" PHILLIPS WOOD SCREW (CRONIN FASTENERS)	STEEL
29	#8 x 1 3/4" PHILLIPS WOOD SCREW (CRONIN FASTENERS)	BRASS
30	#8 x 2" PHILLIPS WOOD SCREW (CRONIN FASTENERS)	BRASS
31	6.91 MIL x 1" x 1/2" CORRUGATED FASTENER (STANLEY/BOSTITCH)	STEEL
32	3/8" x 1" WIRE STAPLES (CRONIN FASTENERS)	STEEL
33	3/16" x 3/4" WIRE STAPLES (STANLEY/BOSTITCH)	STEEL
34	3/8" x 2" WIRE STAPLES (STANLEY/BOSTITCH)	STEEL
35	15 GA. x 1 1/2" FINISH NAIL (STANLEY/BOSTITCH)	STEEL
36	GLAZING COMPOUND DOW CORNING SILICONE #1199	SILICONE
37	SCREEN ASSEMBLY (POZZI WINDOWS MFG.)	-
38	1/16" FRAME GASKET (DERRY)	-
39	SASH METAL CLADDING RADIUS TOP (AC-192 ANODIZING INC.)	6063-T1 & T5
40	FRAME METAL CLADDING RADIUS TOP (AC-194 ANODIZING INC.)	6063-T1
41	HEAD GLASS STOP RADIUS TOP (AC-193 BEND MILLWORKS)	CLEAR LAM. PINE VEN.
42	SIDE & SILL GLASS STOP RADIUS TOP (AC-193 BEND MILLWORKS)	FINGER J. PINE
43	SASH STILE & BOTTOM RAIL RADIUS TOP (AC-191 BEND MILLWORKS)	CLEAR PINE
44	SASH TOP RAIL RADIUS TOP (AC-191 BEND MILLWORKS)	CLEAR LAM. PINE VEN.
45	CASEMENT HINGE RADIUS TOP (DV-215)	SOLID BRASS
46	#8 x 2 1/4" GALVANIZED PHILLIPS FLATHEAD WOOD SCREW	STEEL
47	1/4" x 4" TAPCON	STEEL
48	15 GA. x 2" FINISH NAIL	STEEL
49	15 GA. x 1 3/4" FINISH NAIL	STEEL
50	#8 x 1 1/2" GALVANIZED PHILLIPS FLATHEAD SCREW	GALV. STEEL

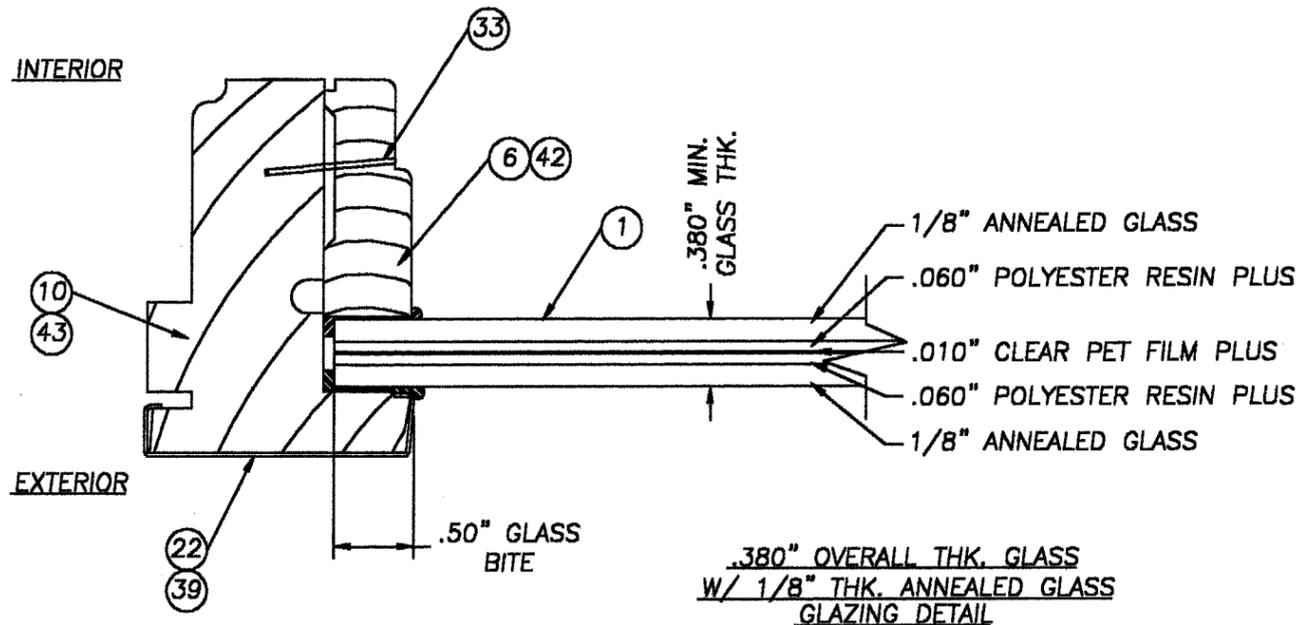

Note:

The above glass configuration can be used up to a maximum Daylight Opening of 8.33 square feet.

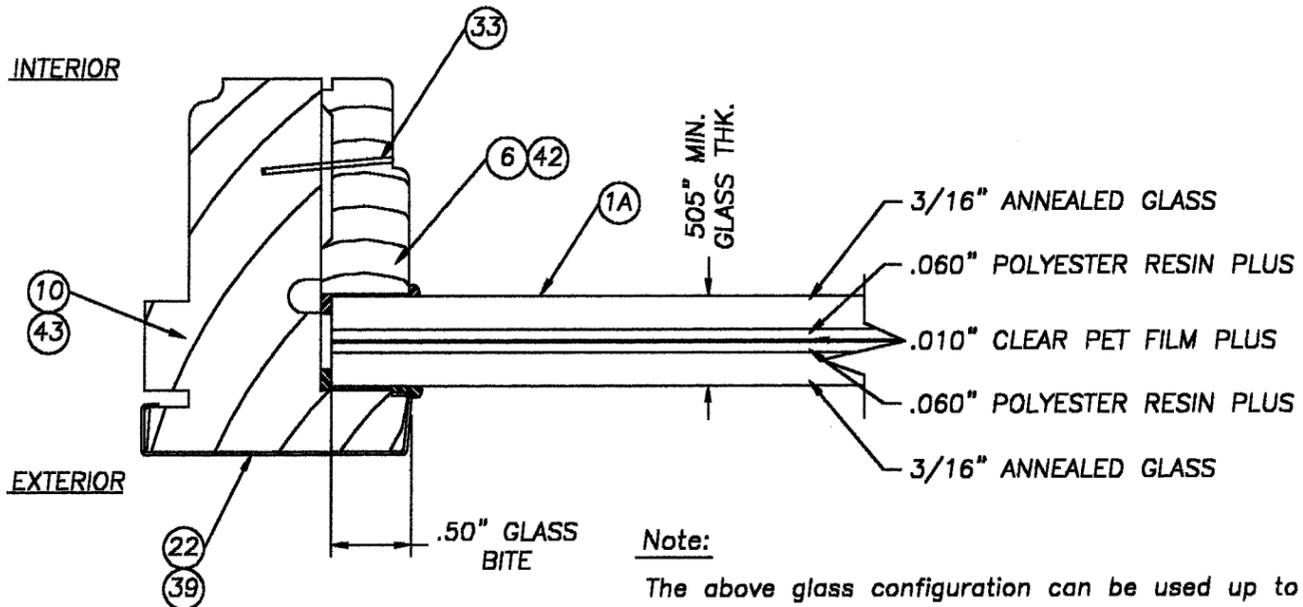

Note:

The above glass configuration can be used up to a maximum Daylight Opening of 11.86 square feet.

**.505" OVERALL THK. GLASS
W/ 3/16" THK. ANNEALED GLASS
GLAZING DETAIL**

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD
WOOD CASEMENT WINDOWS
UP TO 60" x 72"
PART OR ASSEMBLY:
BILL OF MATERIALS &
GLAZING DETAILS

NO.	DATE	REVISIONS	BY
2	07/17/01	COMPLY W/ASTM E 1300	TJH
1	06/13/01	GENERAL REVISION	TJH

RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Manuel Sery*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. **01-0620.05**

DATE: 11/14/97
SCALE: 1/2" = 1"
DWG. BY: P.H.G.
CHK. BY:
DRAWING NO.:
CC-1
SHEET 8 OF 8