



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Alutech Corporation
8548 N.W. 64 St.
Miami, FL 33166

Your application for Notice of Acceptance (NOA) of:

Series 200I Flush Single Outswing Aluminum Insulated Commercial Door-Impact

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-0628.01
EXPIRES: 07/19/2006

Raul Rodriguez
Chief Product Control Division

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 07/19/2001

Alutech Corporation

ACCEPTANCE No.: 01-0628.01

APPROVED : July 19, 2001

EXPIRES : July 19, 2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

1.1 This approves an aluminum storefront door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

2.1 The **Series 200I Flush Single Outswing Aluminum Insulated Commercial Storefront Doors-Impact Resistant** and its components shall be constructed in strict compliance with the following documents: Drawing No **A95214**, titled "Series200I Aluminum Door" Sheets 1 through 7 of 7, prepared by manufacturer dated 12/15/95 and revised on dated 05-03-01, signed and sealed by Walter A. Tillit Jr. , P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

3.1 This approval applies to single unit application of single door only, as shown in approved drawings

4. INSTALLATION

4.1 The aluminum outswing storefront doors and its components shall be installed in strict compliance with the approved drawings.
4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.

5. LABELING

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

Ishaq I. Chanda

Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

Alutech Corporation

ACCEPTANCE No.: 01-0628.01

APPROVED : July 19, 2001


EXPIRES : July 19, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS


1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

Ishaq I. Chanda
Ishaq I. Chanda, P. E., Product Control Examiner
Product Control Division

END OF THIS ACCEPTANCE

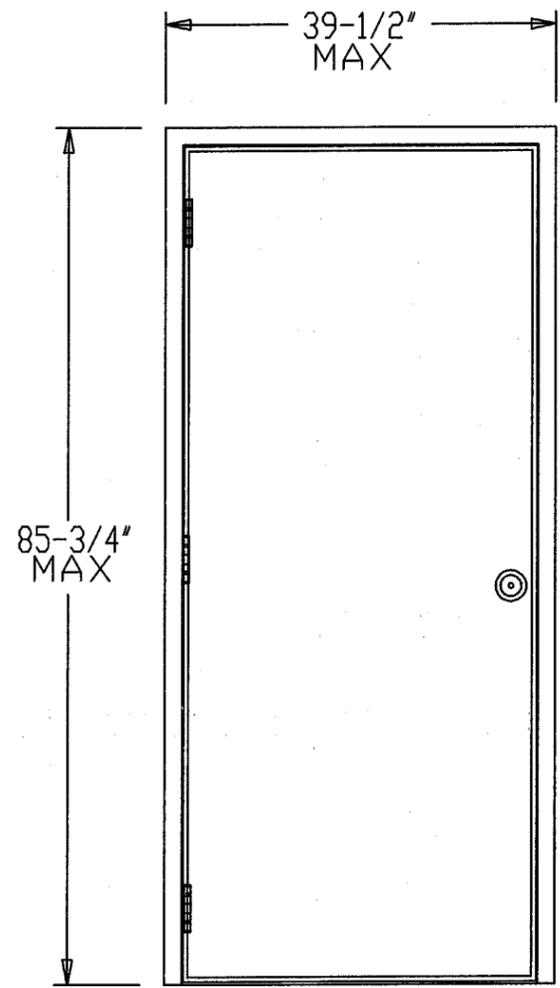

DESIGN PRESSURE RATING		
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED
POSITIVE	+93.3 PSF	+95 PSF
NEGATIVE	-95 PSF	-95 PSF

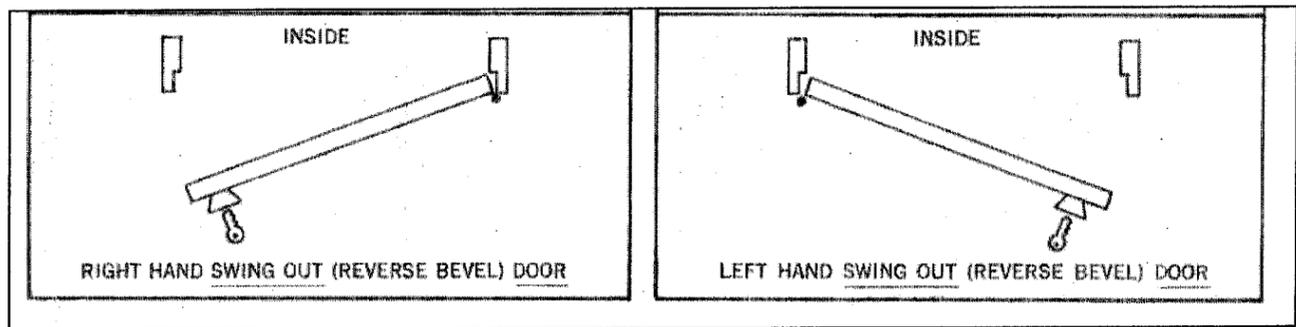

OUT-SWING DOOR

STRUCTURALLY REVIEWED BY:


TILECO inc.
 TILLIT TESTING & ENGINEERING COMPANY
 6595 NW 38th STREET, STE. 217
 MIAMI, FLORIDA 33166






WALTER A. TILLIT JR., P.E.
 STRUCTURAL ENGINEER
 FL LIC. NO. 44167

[Signature]
 6/26/01

BILL OF MATERIAL FOR 3'-0" X 7'-0" DOOR	
DESCRIPTION	QTY
FLUSH ALUMINUM DOOR 35-13/16"x83-5/8"	1
ALUMINUM FRAME 39-1/2"x85-3/4"	1
WEATHERSTRIPPING SANTOPRENE	17
WALL ANCHORS	SEE SHT 3 OF 7
YALE 5407 CYLINDRICAL LOCK SERIES 1 WITH 4-7/8" STRIKE	1
HINGES 4-1/2 X 4-1/2 X .134	3
ALUMINUM THRESHOLD 1" BUMPER TYPE 36" BY ALUTECH	1
DOOR SWEEP 36" BY ALUTECH	1

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE July 19, 2001
 BY Isaac I. Chauda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0628-01

	ALUTECH CORPORATION 8548 NW 64th STREET MIAMI, FL 33166 305/593-2080	SERIES 2001 ALUMINUM DOOR WITH 0.040", 0.063", OR 0.090" ALUMINUM FACE SHEET AND FR575 OR FR450S ALUMINUM FRAME.	
		REV: 05/03/01	
DATE: 12/15/95		DRAWN BY: A. PEREZ	
JOB No.: 95214		DWG No.: A95214	
		SHEET No.: 1 OF 7	

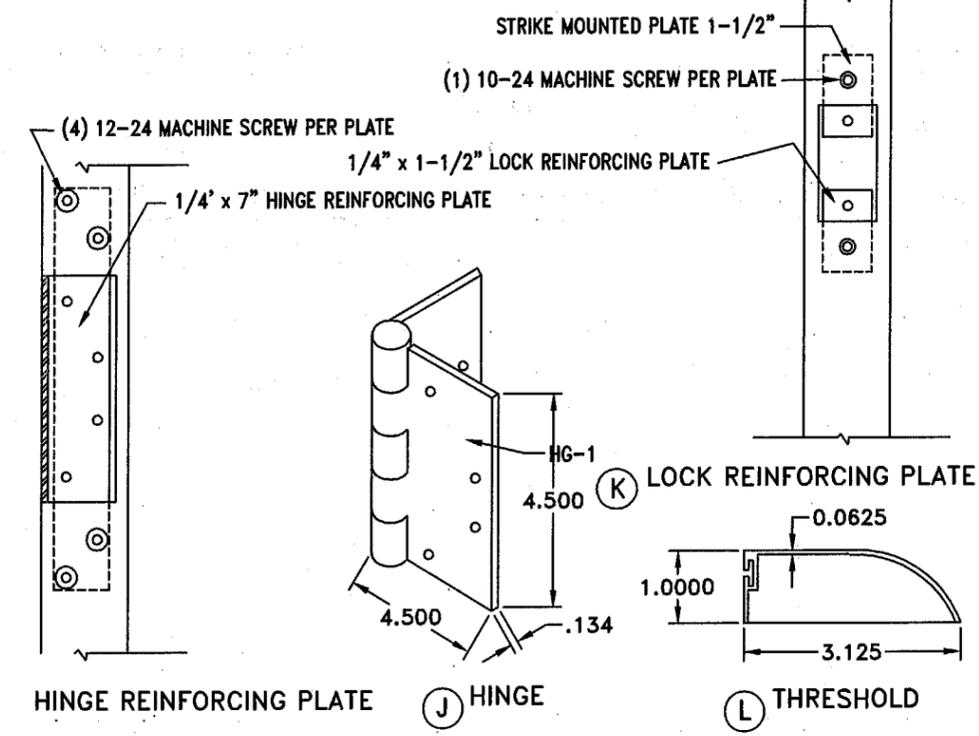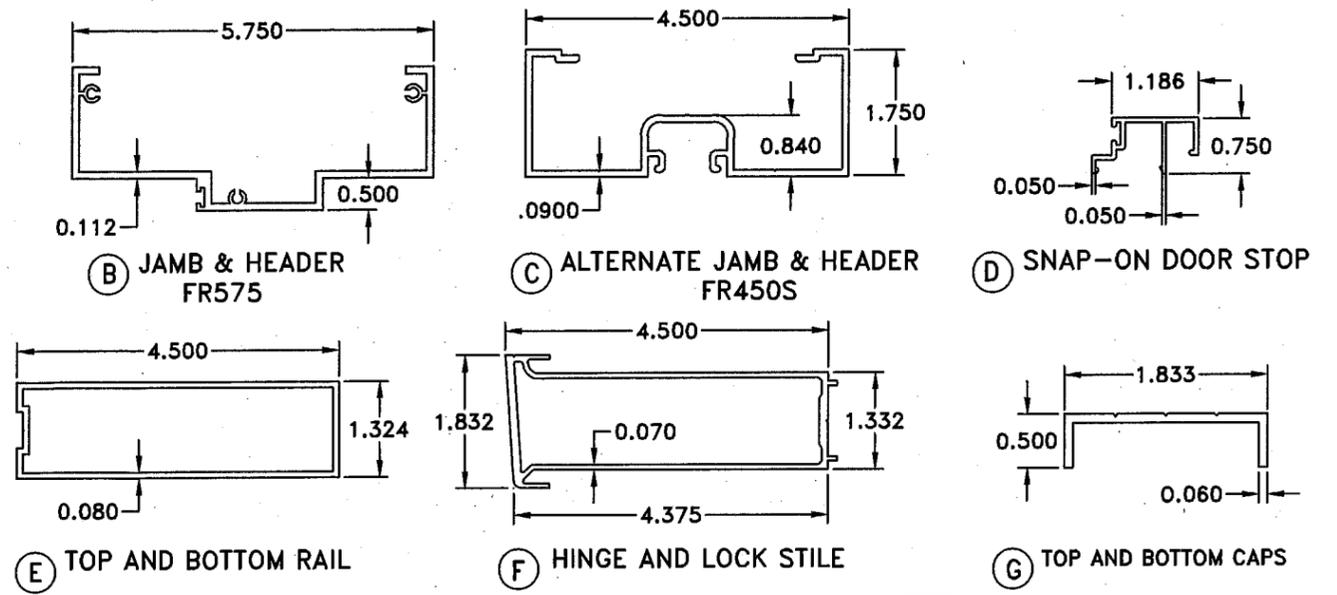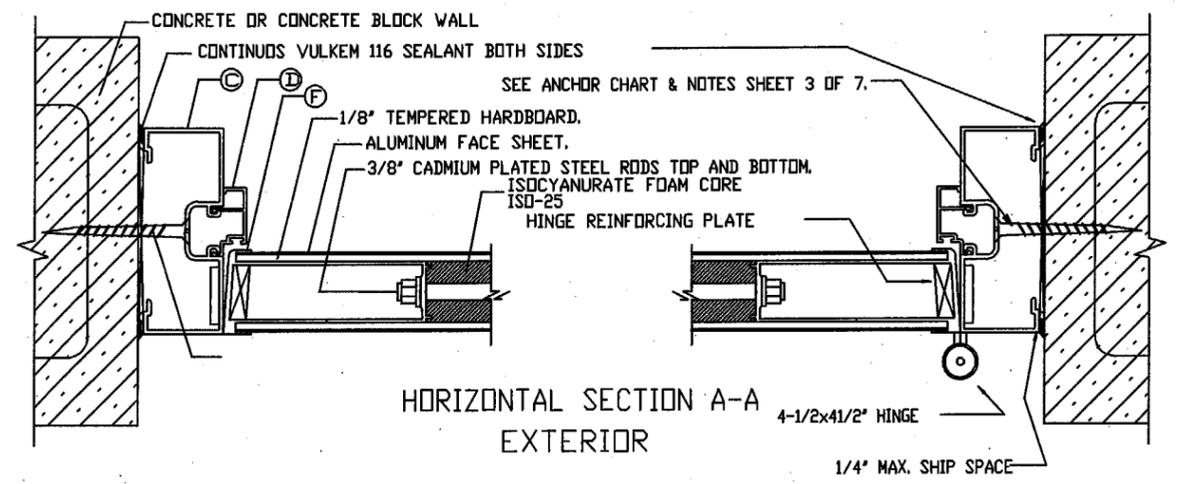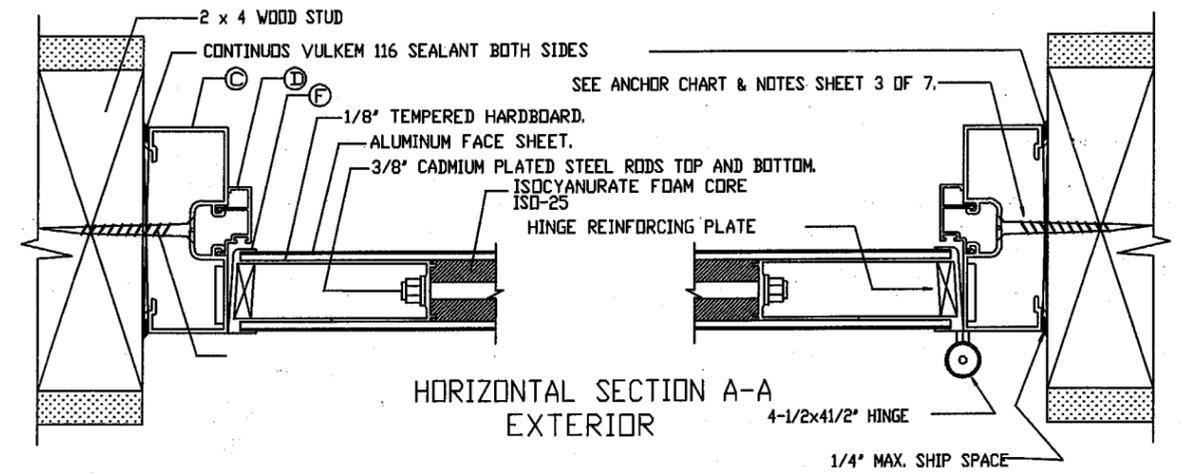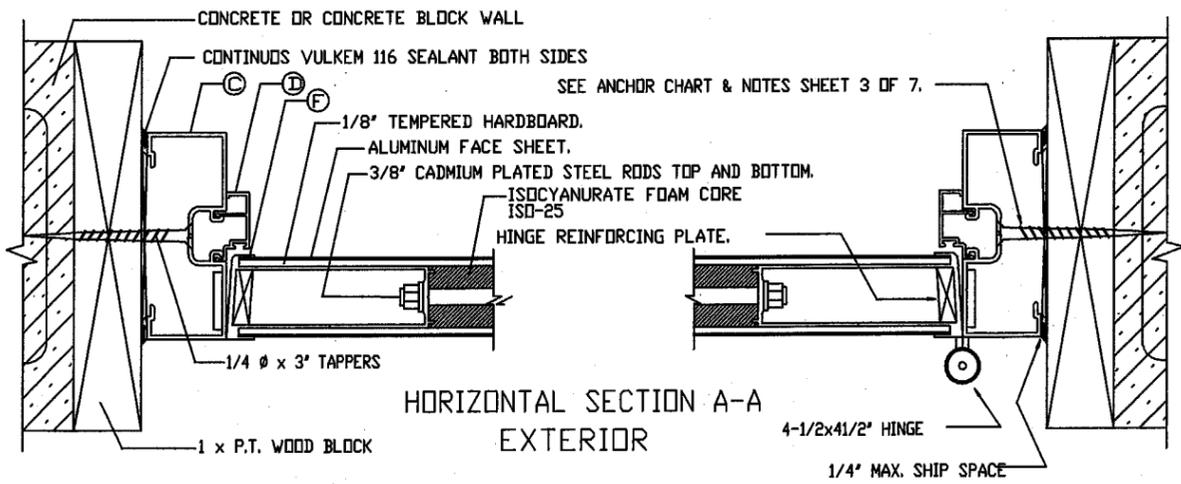


COMPONENTS

STRUCTURALLY REVIEWED BY:

TILECO INC.
TILLIT TESTING & ENGINEERING COMPANY
6595 NW 30th STREET, STE. 217
MIAMI, FLORIDA 33166
WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL LIC. NO. 44167

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE July 19, 2001
BY Shag L. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0623.01






ALUTECH CORPORATION
8548 NW 64th STREET
MIAMI, FL 33166
PH: 305/593-2080
FAX: 305/591-8481

SERIES 200I ALUMINUM DOOR
WITH 0.040", 0.063", OR 0.090"
ALUMINUM FACE SHEET AND
FR575 OR FR450S ALUMINUM
FRAME. REV. DATE: 05/03/01

DATE: 12/15/95	DRAWN BY: P. SARDA
JOB No.: 95214	DWG No.: A95214 SHEET No.: 2 OF 7

MAXIMUM ANCHOR SPACING ("S") SCHEDULE

FRAME TYPE	ANCHOR TYPE				
	POWERS FASTENING, INC. TAPPER		ITW BUILDEX 410 S.S. TAPCON	WOOD SCREWS	
	1/4" F.H.	3/8" F.H.	1/4" F.H.	18 GAGE (5/16" F.H.)	24 GAGE (3/8" F.H.)
FR 575	7 1/2' o.c.	18' o.c.	11 1/2' o.c.	9' o.c.	18' o.c.
FR 450S	14' o.c.	18' o.c.	18' o.c.	17' o.c.	18' o.c.

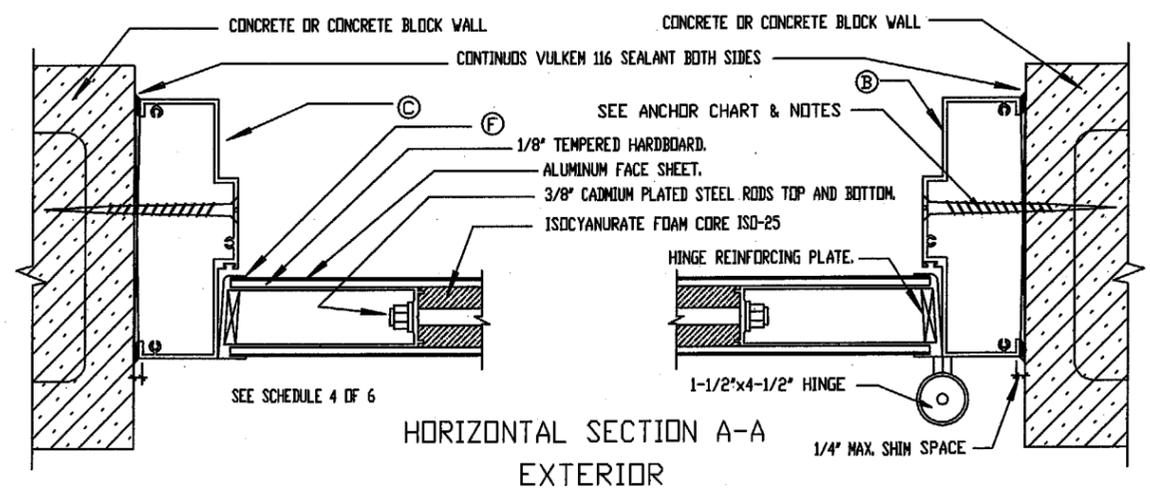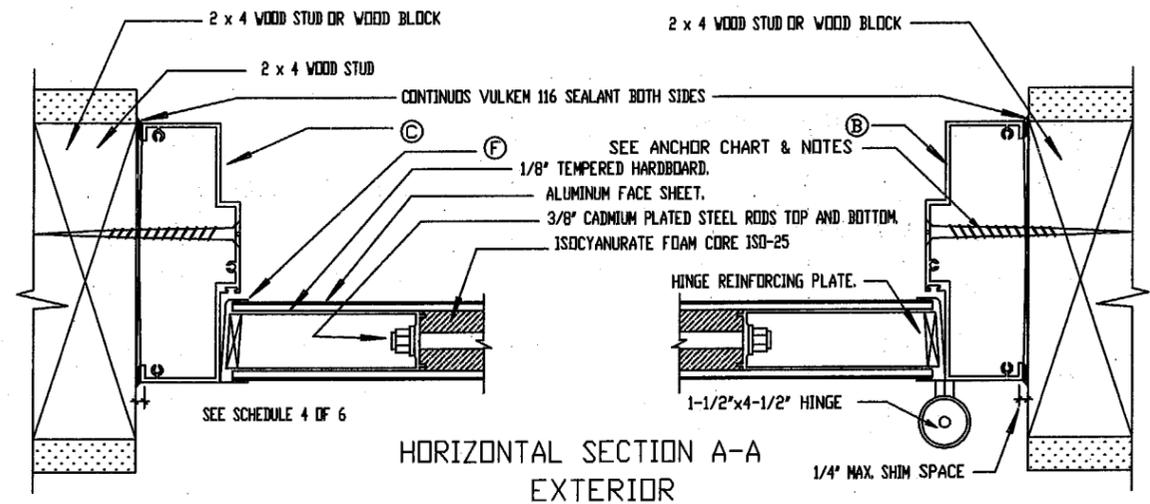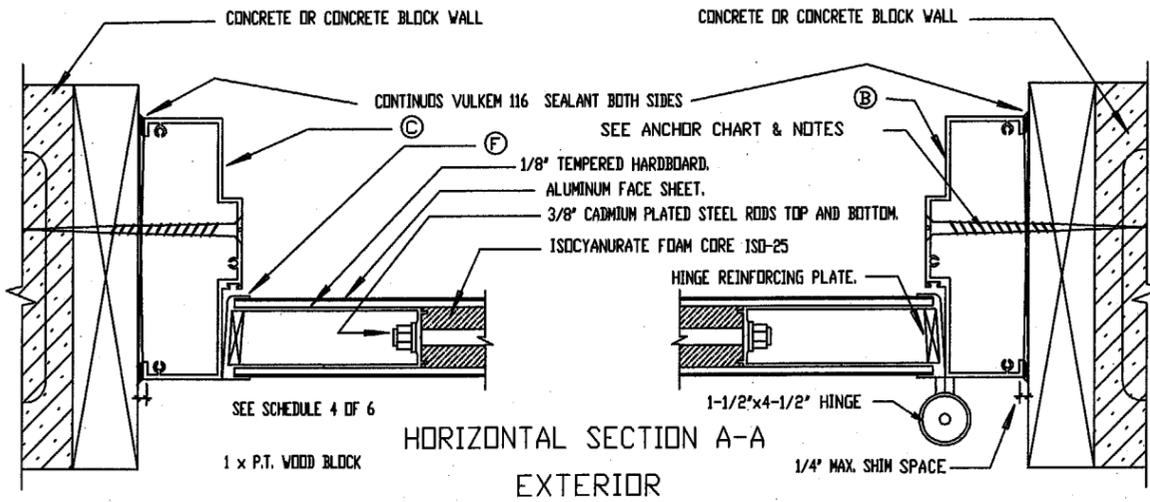

NOTES:


- (1) MINIMUM EMBEDMENT OF POWERS FASTENING, INC. TAPPER AND ITW BUILDEX 410 S.S. TAPCON INTO MASONRY OR CONCRETE IS 1 1/2".
- (2) MINIMUM EMBEDMENT OF WOOD SCREWS INTO WOOD BUCK (BY OTHERS) IS 1 1/2".
- (3) SEE FRAME ELEVATION WITH ANCHOR SPACING AND LOCATION ON SHEET 4 OF 6.

STRUCTURALLY REVIEWED BY:

TILECO inc.
TILLIT TESTING & ENGINEERING COMPANY
 8595 NW 36th STREET, STE. 217
 MIAMI, FLORIDA 33166
WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL LIC. NO. 44167

David J. G... 6/24/01

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE July 19, 2001
 BY Ishag J. Ghanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0628-01




ALUTECH CORPORATION
 8548 NW 64th STREET
 MIAMI, FL 33166
 PH: 305/593-2080
 FAX: 305/591-8481


SERIES 2001 ALUMINUM DOOR
 WITH 0.040", 0.063", OR 0.090"
 ALUMINUM FACE SHEET AND
 FR575 OR FR450S ALUMINUM
 FRAME. REV. DATE: 05/03/01

DATE: 12/15/95 DRAWN BY: P. SARDA
 DWG No.: A95214 SHEET No.: 3 OF 7

JOB No.: 95214

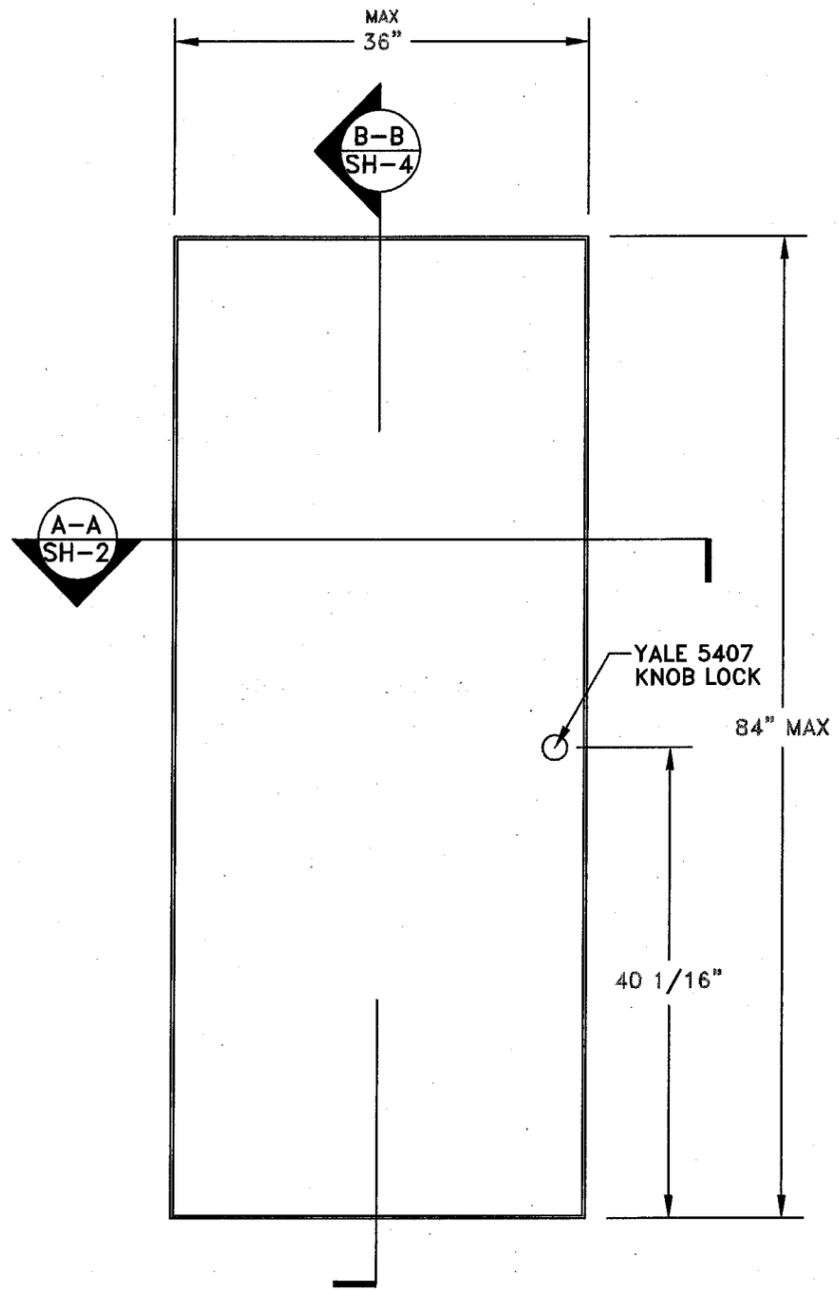


FLUSH ALUMINUM DOOR ELEVATION

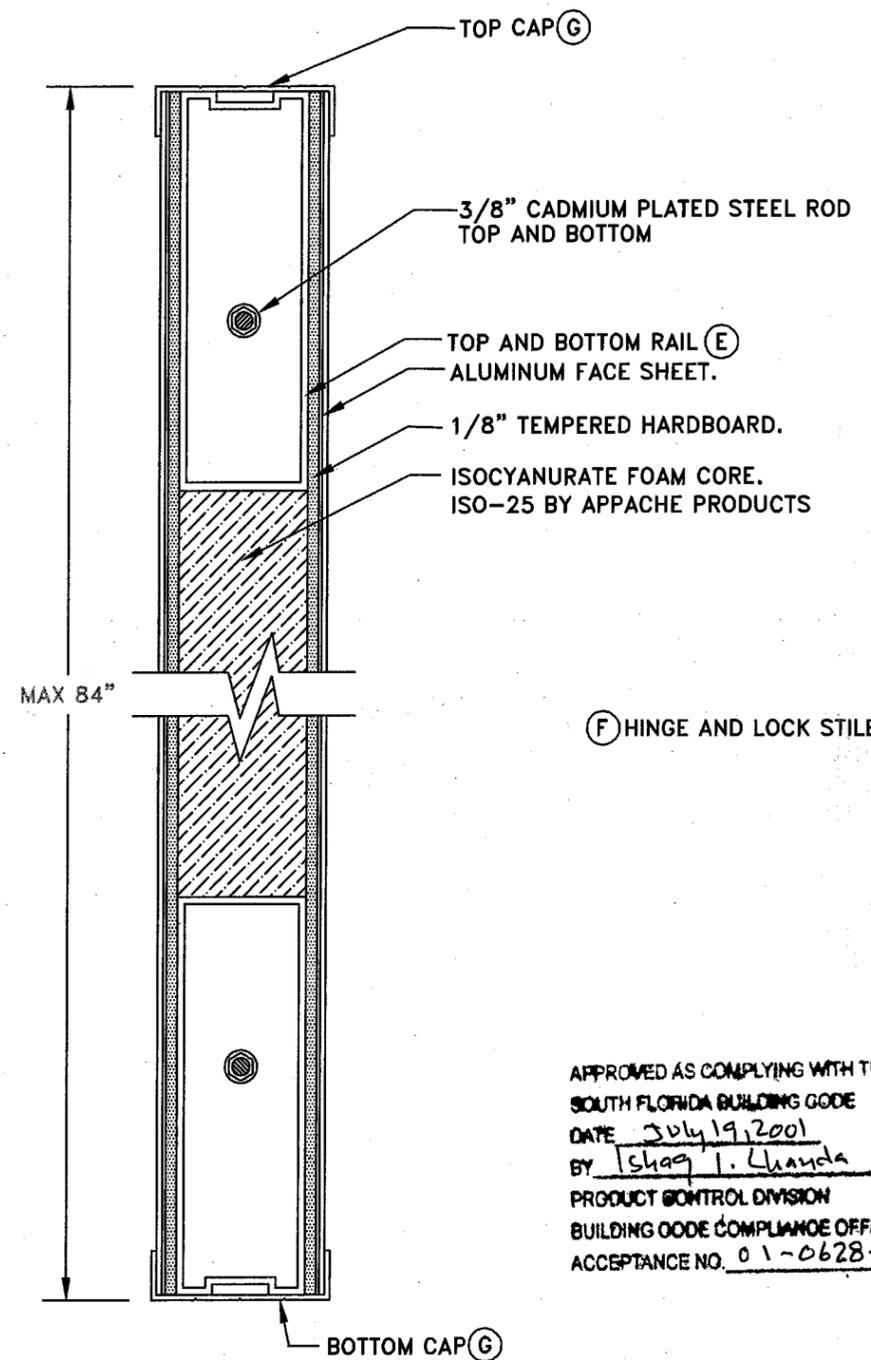

VERTICAL SECTION B-B

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE July 19, 2001
 BY Ishaq I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0628-01

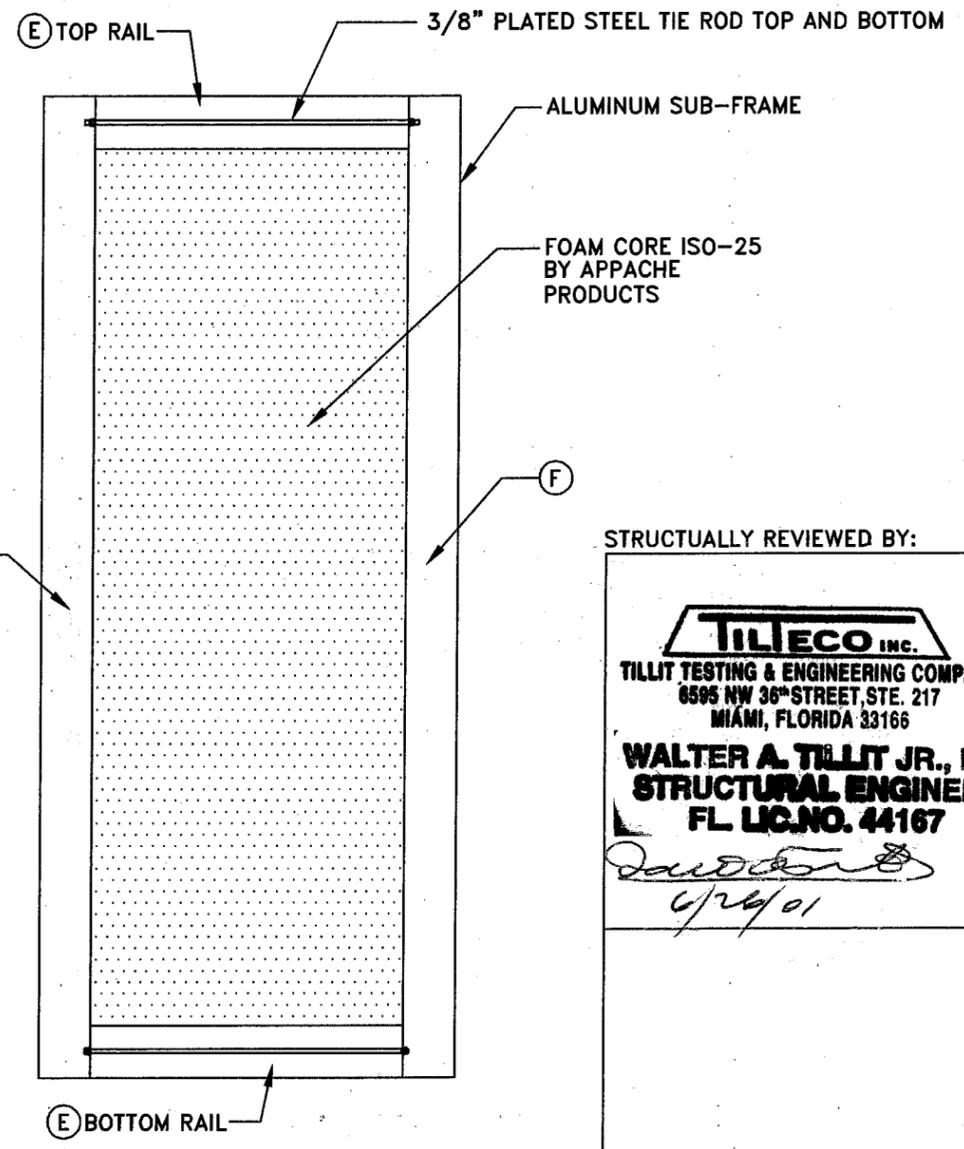


INTERNAL TUBE REINFORCING ELEVATION

STRUCTURALLY REVIEWED BY:

 TILLIT TESTING & ENGINEERING COMPANY
 6595 NW 36th STREET, STE. 217
 MIAMI, FLORIDA 33166
WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL LIC. NO. 44167
[Signature]
 4/24/01

DOOR PANEL DETAILS



ALUTECH CORPORATION
 8548 NW 64th STREET
 MIAMI, FL 33166
 PH: 305/593-2080
 FAX: 305/591-8481

SERIES 2001 ALUMINUM DOOR
 WITH 0.040", 0.063", OR 0.090"
 ALUMINUM FACE SHEET AND
 FR575 OR FR450S ALUMINUM
 FRAME. **REV: 05/03/01**


JOB No: 95214

DATE: 12/15/95

DRAWN BY: P. SARDA



DWG No: A95214

SHEET No: 4 OF 7

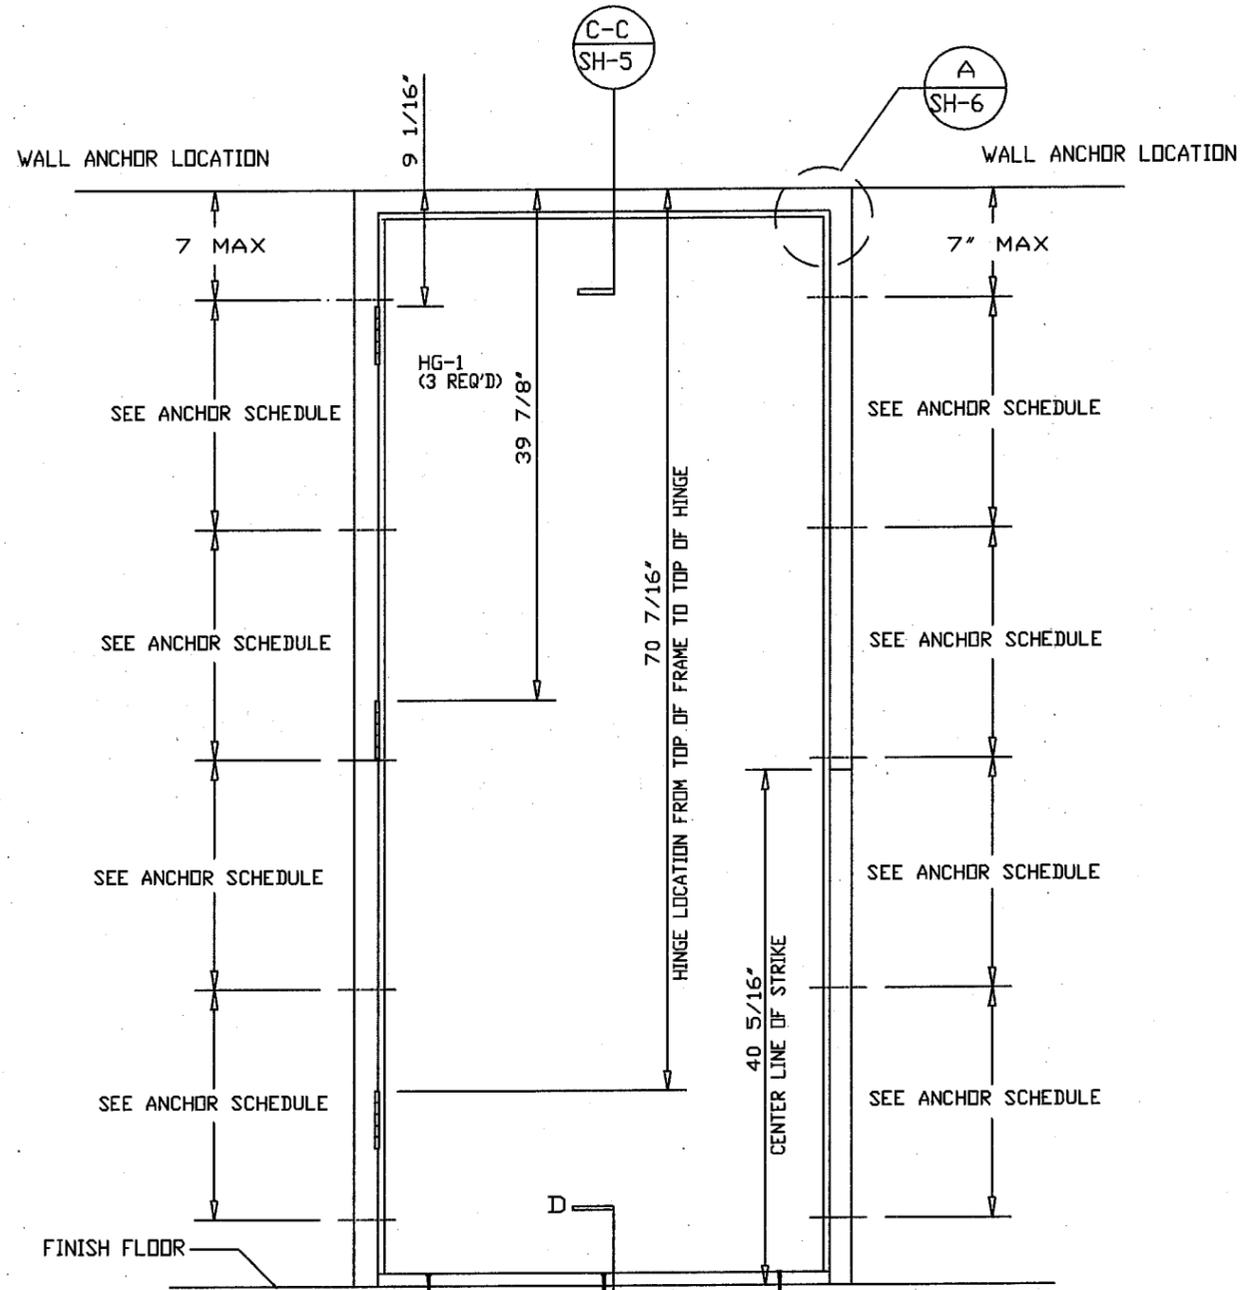


#12x1-3/4 SMS 3/4" EMBEDMENT
 7-1/4" FROM END & ONE ON CENTER
 THRESHOLD IS NOT ATTACHED TO FRAME

WALL ANCHOR, HINGE & STRIKE LOCATION

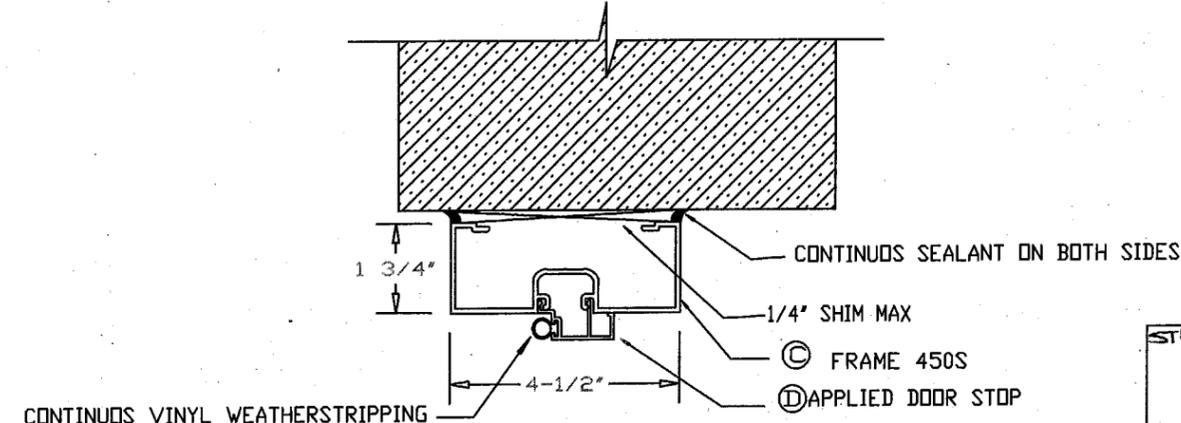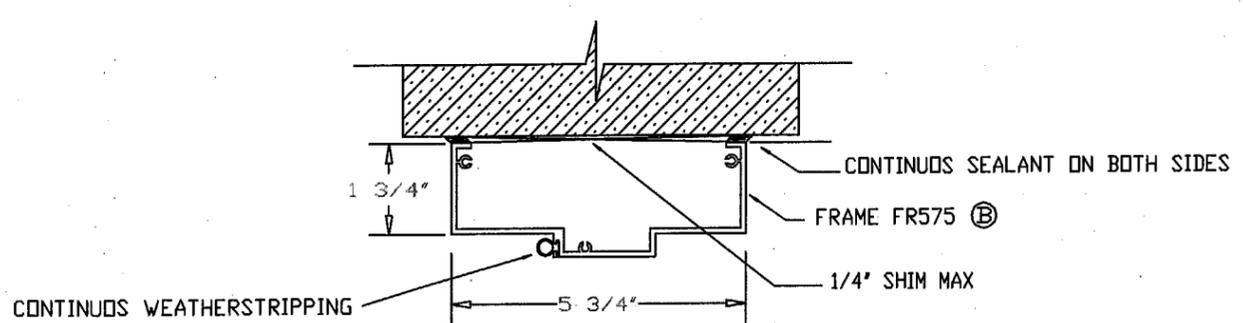


SECTIONS C-C

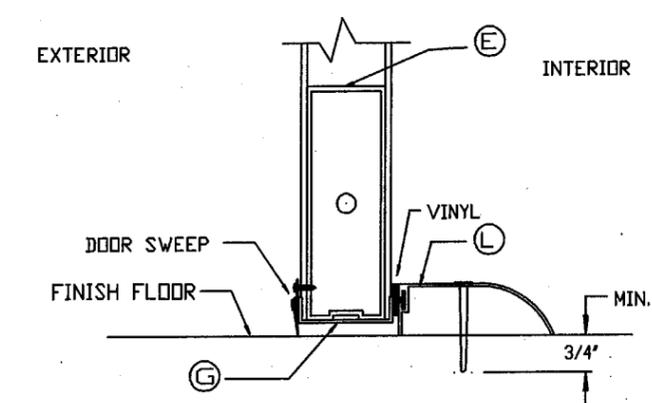

SECTION D-D: BUMPER THRESHOLD

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE July 19, 2001
 BY Iskay I. Llandu
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0678-01

STRUCTURALLY REVIEWED BY:
TILECO inc.
 TILLIT TESTING & ENGINEERING COMPANY
 6506 NW 36th STREET, STE. 217
 MIAMI, FLORIDA 33166
WALTER A. TILLIT JR., P.E.
 STRUCTURAL ENGINEER
 FL LIC. NO. 44167
Walter A. Tillit Jr.
 6/26/01




ALUTECH CORPORATION
 8548 NW 64th STREET
 MIAMI, FL 33166
 PH: 305/593-2080
 FAX: 305/591-8481

SERIES 2001 ALUMINUM DOOR
 WITH 0.040", 0.063", OR 0.090"
 ALUMINUM FACE SHEET AND
 FR575 OR FR450S ALUMINUM
 FRAME. REV: 05/03/01


DATE: 12/15/95 DRAWN BY: P. SARDA
 DWG No.: A95214 SHEET No.: 5 OF 7

JOB No.: 95214

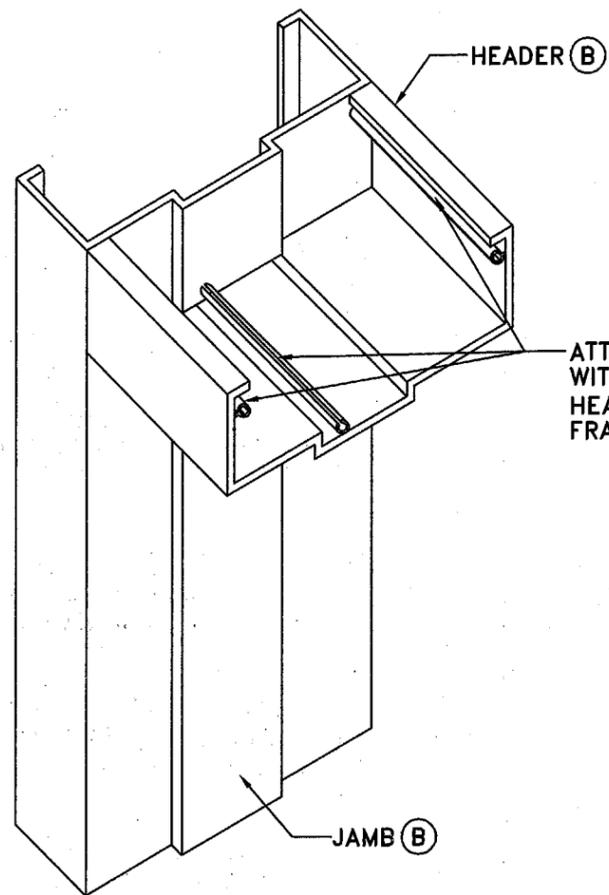

FRAME FR575

ATTACH HEADER TO JAMBS WITH (3) #10 x 1" PAN HEAD SS SM SCREWS ON FR575 FRAME.

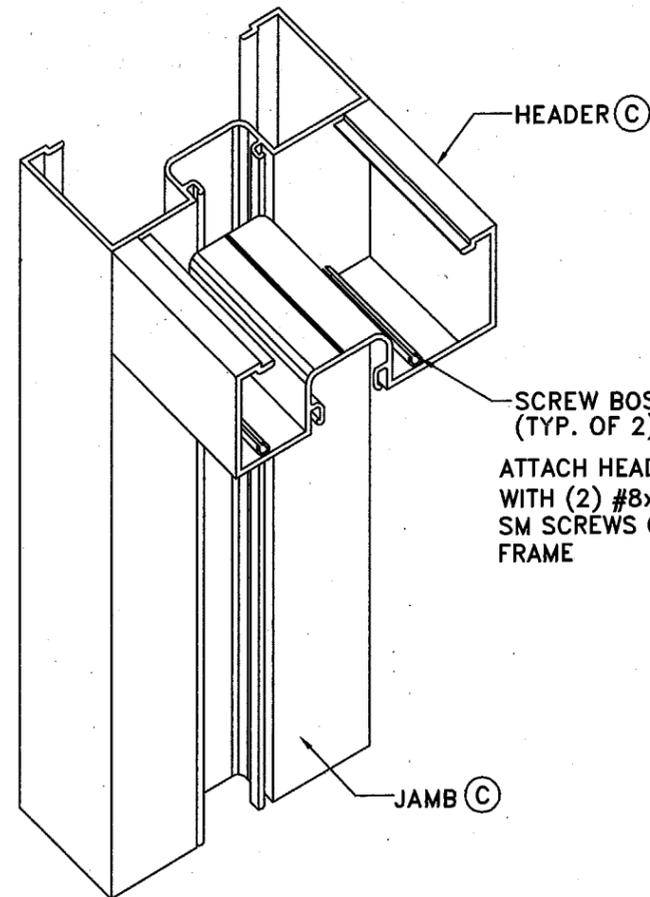

FRAME FR450

SCREW BOSS (TYP. OF 2)
ATTACH HEADER TO JAMBS WITH (2) #8x1 PAN HEAD SS SM SCREWS ON FR450S FRAME

DETAIL 'A':
CORNER CONSTRUCTION

ALUMINUM FRAME: ALUMINUM DOOR FRAMES SHALL BE SERIES FR575 1-3/4" X 5-3/4" OPEN BACK WITH AN INTEGRAL DOOR STOP OR FR450S 1-3/4" X 4-1/2" OPEN BACK WITH A SNAP ON DOOR STOP.

MATERIAL: FRAME MEMBERS SHALL BE MADE OF 6063-T6 EXTRUDED ALUMINUM ALLOY WITH A MINIMUM WALL THICKNESS OF 0.125" FOR THE FR575 AND 0.090" FOR THE FR450S FRAME AND A MIN. YIELD STRENGTH OF 28,750 PSI. ALL SCREWS AND MISCELLANEOUS FASTENERS SHALL BE STAINLESS STEEL, OR OTHER CORROSION RESISTANT MATERIAL. WEATHERSTRIPPING SHALL BE COMPOUND SANTOPRENE BULB.

CONSTRUCTION: FRAME SHALL BE SQUARED CUT TO PROVIDE NEAT HAIRLINE JOINTS. JAMBS AND HEADER SHALL BE FASTENED WITH STAINLESS STEEL SCREWS. ALL FRAMES SHALL BE MORTISE FOR HINGES AND LOCK STRIKE PLATES. SURFACE MOUNTED HARDWARE SHALL BE DRILLED AND TAPPED IN THE FIELD. HINGE, LOCK AND STRIKE REINFORCING PLATE SHALL BE MADE OF 1/4" ALUMINUM PLATE 6063-T6 ALLOY.


INSTALLATION: INSPECT WALL CONDITION, IF NECESSARY MAKE ANY WALL REPAIRS OR ADJUSTMENTS BEFORE INSTALLATION OF DOOR FRAME. ASSEMBLE DOOR FRAME BY ATTACHING JAMBS TO HEADER USING (3) #10x1" PAN HEAD SCREWS ON THE FR575 AND (2) #8x1 ON THE FR450S" FRAME (DO NOT FILLED JAMBS OR HEADER WITH MORTAR). ERRECT FR575 HINGE JAMB TO WALL AND FR450S FRAME TO WALL WITH AS PER ANCHOR SCHEDULE ON SHEET 4 OF 6 STARDING AT 7" FROM TOP. AFTER HINGE SIDE IS INSTALLED START WITH LOCK SIDED AND REPEAT THE SAME PROCEDURE. USE SHIMS AT HINGE AND LOCK SIDE TO PROPERLY LEVELED, SQUARED AND PLUMBED FRAME IF NECESSARY (MAXIMUM SHIM SPACE TO BE 1/4").

HARDWARE: EACH DOOR SHALL BE EQUIPPED WITH (3) 4 1/2" x 4 1/2" x .134" HINGE, ATTACHED TO DOOR AND FRAME WITH (4) 12-24 FLAT HEAD MACHINE SCREW, (1) YALE 5407 CYLINDRICAL LOCK 2-3/4" BACKSET AND 2-1/8" BORE WITH A 4-7/8" STAINLESS STEEL STRIKE PLATE, (1) BUMPER THRESHOLD 1" HIGH. AND (1) DOOR SWEEP #DS-10 OR EQUAL.

PROTECTION & CLEANING: AFTER ERECTION, THE GENERAL CONTRACTOR SHALL ADEQUATELY PROTECT EXPOSED PORTIONS OF ALUMINUM SURFACES FROM DAMAGE BY PLASTER, LIME, ACID, CEMENT, OR OTHER HARMFUL COMPOUNDS. AFTER INSTALLATION, ALL ALUMINUM SHALL BE CLEANED WITH SOAPY WATER OR OTHER MILD CLEANING SOLUTION.

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE July 19, 2001
BY Isaac J. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0628-01

STRUCTURALLY REVIEWED BY:
TILECO inc.
TILLIT TESTING & ENGINEERING COMPANY
6896 NW 30th STREET, STE. 217
MIAMI, FLORIDA 33166
WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL. LIC. NO. 44167
Walter A. Tillit Jr.
6/20/01



ALUTECH CORPORATION
8548 NW 64th STREET
MIAMI, FL 33166
PH: 305/593-2080
FAX: 305/591-8481


SERIES 2001 ALUMINUM DOOR WITH 0.040", 0.063", OR 0.090" ALUMINUM FACE SHEET AND FR575 OR FR450S ALUMINUM FRAME. REV: 05/03/01

DATE: 12/15/95 DRAWN BY: P. SARDA

JOB No.: 95214

DWG No.: A95214

SHEET No.: 6 OF 7

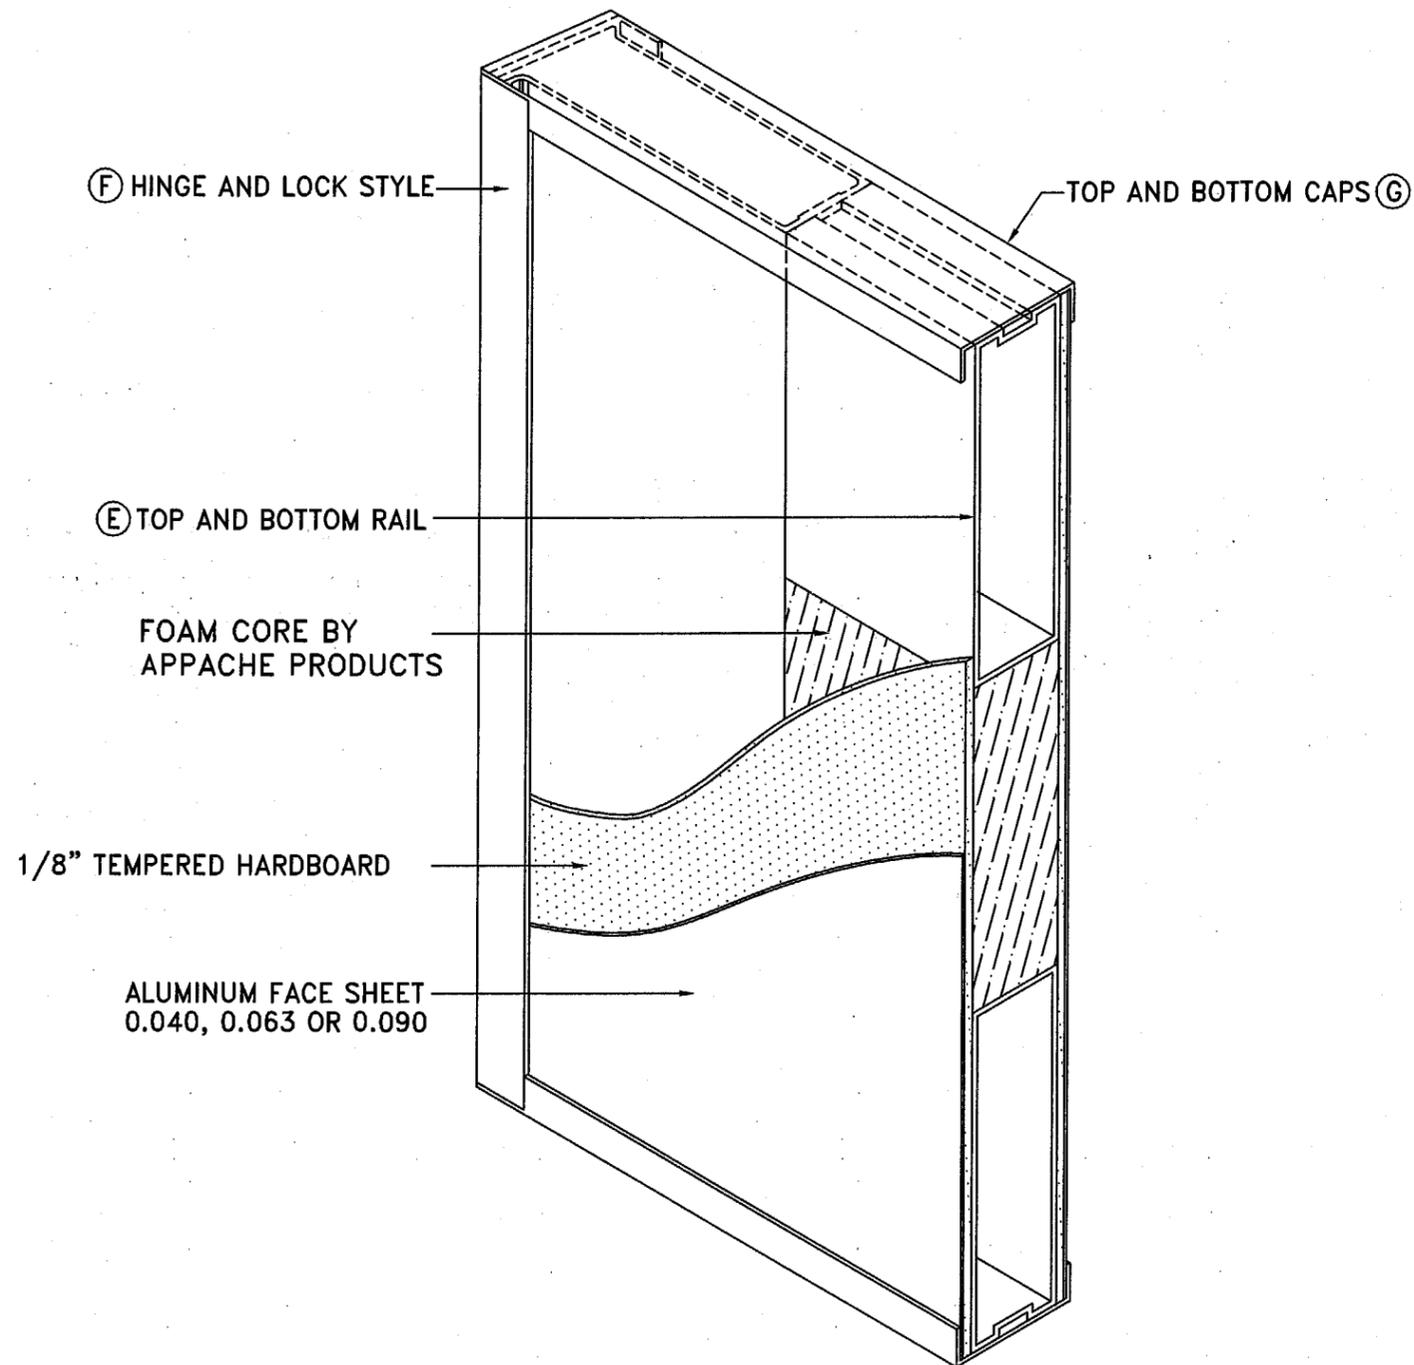

FLUSH DOOR: ISOMETRIC

ALUMINUM DOOR: ALUMINUM DOOR TO BE NOMINAL 1-3/4" THICK FLUSH DESIGN, SERIES 2001. DOOR STILES AND RAILS SHALL HAVE A STRONG, RIGID ALUMINUM SUB-FRAME WITH INTEGRAL EDGE CAPS. THE SUB-FRAME SHALL BE CONNECTED BY A 3/8" STEEL TIE ROD TOP AND BOTTOM. NO SNAP-ON OR APPLIED DOOR EDGES AT HINGE OR LOCK STILES.

FACE SHEET: FACE SHEET SHALL BE ALU. 3003-H14/5005-H34 ALLOY WITH A MINIMUM THICKNESS OF 0.040", 0.063", OR 0.090" WITH A MINIMUM YIELD STRENGTH OF 26,450 PSI. FACE SHEETS SHALL BE CONCEALED UNDER A 1/2" EDGE CAP FULL PERIMETER.

INSULATED CORE: ALL VOIDS BETWEEN SUB-FRAMES SHALL BE FILLED WITH A ISOCYANURATE(ISO-25) RIGID FOAM BOARD AS MANUFACTURED BY APACHE PRODUCTS CO #98-0904.03., WITH AN "R" VALUE OF 9. CORE SHALL BE LAMINATED BETWEEN TWO SHEETS OF 1/8" TEMPERED HARDBOARD FOR IMPACT REINFORCING.

LAMINATION: SUB-FRAME, FACE SHEETS AND INSULATED CORE SHALL BE BONDED TOGETHER WITH A MOISTURE CURE, ONE-PART ADHESIVE AS MANUFACTURED BY MORTON INTERNATIONAL OR EQUAL UNDER PRESSURE TO FORM A WATER, HEAT, AND CHEMICAL RESISTANT BOND.

ALUMINUM SUB-FRAME FULL PERIMETER: 1-3/8" X 4-1/2" SUB-FRAME WITH AN INTEGRAL EDGE CAP AT HINGE AND LOCK EDGE, TOP AND BOTTOM OF DOOR SHALL BE CAPPED TO INSURE PROPER PROTECTION FROM THE ELEMENTS. MINIMUM WALL THICKNESS AT HINGE AND LOCK EDGE SHALL BE 0.125" AND BEVEL 1/8" IN 2". STILE AND RAILS SHALL BE CONNECTED WITH A 3/8" PLATED STEEL TIE ROD TOP AND BOTTOM. OVERALL DOOR TOLERANCE SHALL BE PLUS OR MINUS 1/16". EXTRUSION TOLERANCES SHALL BE AS SET BY THE AMERICAN ALUMINUM MANUFACTURE'S ASSOCIATION.

HARDWARE REINFORCING: HINGE REINFORCING PLATES SHALL BE OF 1/4" X 1" X 7" LONG ALUMINUM PLATE 6063-T6 MOUNTED TO DOOR STILE WITH (4) 12-24 MACHINE SCREWS, LOCK REINFORCING PLATES SHALL BE 1/4" X 1" X 1 1/2" LONG ALUMINUM PLATE 6063-T6 MOUNTED TO DOOR STILE WITH (1) 10-24 MACHINE SCREW.

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE July 19, 2001
 BY J. L. Landa
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0628-01

STRUCTURALLY REVIEWED BY:

TILLIT TESTING & ENGINEERING COMPANY
 6595 NW 36th STREET, STE. 217
 MIAMI, FLORIDA 33166
WALTER A. TILLIT JR., P.E.
STRUCTURAL ENGINEER
FL LIC. NO. 44167
Walter A. Tillit Jr.
 6/26/01

	ALUTECH CORPORATION 8548 NW 64th STREET MIAMI, FL 33166 PH: 305/593-2080 FAX: 305/591-8481		SERIES 2001 ALUMINUM DOOR WITH 0.040", 0.063", OR 0.090" ALUMINUM FACE SHEET AND FR575 OR FR450S ALUMINUM FRAME. REV. DATE: 05/03/01	
	DATE: 12/15/95	DRAWN BY: P. SARDA	JOB No.: 95214	DWG No.: A95214