



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**T. M. Window and Door
601 N. W. 12th Ave
Pompano Beach, Florida, 33609**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "605 " Single Hung Aluminum Window (reinforced)-Small Missile Impact

APPROVAL DOCUMENT: Drawing No. S605-SM., titled "series 605 single Hung window. ", sheets 1 through 4 of 4, prepared by manufacturer, dated 07-23-01 and last revised on 06-20-02, signed and sealed by Ballard L. Argus, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **01-0703.02** and consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P. E.**



**NOA No 01-0703.02
Expiration Date: July 11, 2007
Approval Date: July 11, 2002
Page 1**

T. M. Window and Door

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

(For File ONLY. Not part of NOA)

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **S605-SM.**, titled "series 605 single Hung window. ", sheets 1 through 4 of 4, prepared by manufacturer, dated 07-23-01 and last revised on 06-20-02, signed and sealed by Ballard L. Argus, P. E.

B. TESTS

1. Test report on
 - 1) Air Infiltration Test, per PA 202-94
 - 2) Uniform Static Air Pressure Test, Loading per PA 202-94
 - 3) Water Resistance Test, per PA 202-94
 - 4) Small Missile Impact Test, SFBC PA 201-94
 - 5) Cyclic Loading Test, per SFBC PA 203-94

along with installation diagram of an aluminum Single Hung window, prepared by Manufacturer, verified by Fenestration Testing Lab, Test Report No. **FTL 2761 (00110)** dated September 20, 2000, signed and sealed by Antonio Acevedo, P.E. (This report has been revised per addendum letter November 07, 2000, issued by Fenestration Testing Lab, signed and sealed by Antonio Acevedo, P.E.)

C. CALCULATIONS

1. Structural performance, comparative analysis and anchor verification calculations dated 01-14-01, 01-15-01, 01-23-02, 02-08-02, 02-27-02, 02-28-02, 03-06-02, 03-08-02, 03-21-02, 04-24-02, 05-01-02, 05-08-02 and last revised on 06-07-02 prepared, signed and sealed by Ballard L. Argus, P. E.

D. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **01-0205.02** issued to Solutia Inc for "Saflex/Keepsafe Max", expiring on 05/21/2006.

E. STATEMENTS

1. Letter of conformance and "No financial interest, dated 08-03-2001 signed & sealed by Ballard L. Argus, P.E.
2. Statement letter of compliance, part of test report, issued by Fenestration Testing Lab, Test Report No. **FTL 2761 (00110)** dated September 20, 2000, signed and sealed by Antonio Acevedo, P.E.
4. Addendum letter dated 11-07-2000, issued by Fenestration Testing Lab, Test Report No. **FTL 2761 (00110)** dated September 20, 2000, signed and sealed by Antonio Acevedo, P.E.

F. OTHER


1. This file has been submitted under ERP (In-house)

Ishaq I. Chanda

Ishaq I. Chanda, P. E.
Product Control Examiner
NOA No 01-0703.02
Expiration Date: July 11, 2007
Approval Date: July 11, 2002

DRAWING INDEX

- SHEET 1. -GENERAL NOTES, ANCHOR NOTES, TYPICAL ELEVATION AND ANCHOR LAYOUT
- SHEET 2. -CROSS SECTIONS AND BILL OF MATERIALS
- SHEET 3. -INSTALLATION FASTENER CHART
- SHEET 4. -PARTS LIST

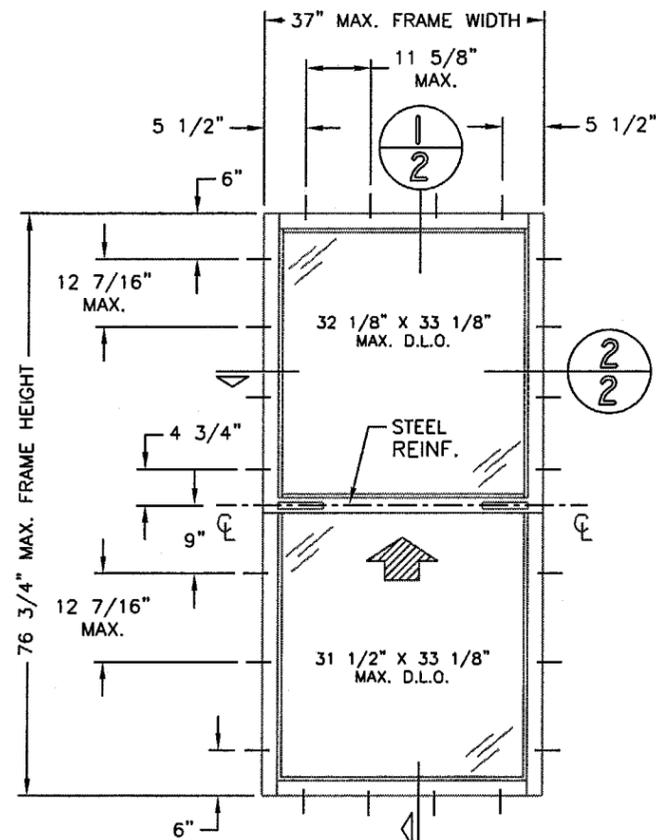

(9/16" SAFLEX IIIIG POLYVINYL BUTRYAL)

SERIES 605 SINGLE HUNG (REINFORCED)

(LARGEST TESTED UNIT VIEWED FROM EXTERIOR)

SCALE: 1/2" = 1'-0"

REINFORCED	DESIGN PRESSURE (PSF)
	SEE CHART #1 (SHEET 3 OF 4)
	GLAZING: 9/16" SAFLEX
	WATER RESISTANCE TEST: 17.00 PSF (NO SCREENS)
	TEST REPORT: FTL-2761

Approved as complying with the
Florida Building Code
Date July 11, 2002
NOA# 01-0703-02
Miami Dade Product Control
Division
By Isaac J. Chanda

FOR INSTALLATIONS OF THIS WINDOW UP TO 30 FEET ABOVE GRADE,
SHUTTERS ARE REQUIRED
FOR INSTALLATIONS OF THIS WINDOW ABOVE 30 FEET ABOVE GRADE,
SHUTTERS ARE NOT REQUIRED

GENERAL NOTES

1. PRODUCT APPROVAL DRAWINGS ARE BASED ON TEST REPORT FTL-2761, AS LISTED ACCORDINGLY
2. DRAWINGS PROVIDE ANCHOR INFORMATION FOR STRUCTURAL CONCRETE AND CONCRETE BLOCK CONSTRUCTION ONLY.
3. WINDOW MINIMUM HARDWARE REQUIREMENTS:
 - A. TWO (2) 5/8" SPIRAL BALANCES. - LOCATE ONE (1) AT EACH JAMB.
 - B. TWO (2) SURFACE MOUNTED METALLIC CAM LOCKS, LOCKING INTO A GROOVE IN THE FIXED MEETING RAIL. - LOCATE AT VENT MEETING RAIL, WITHIN 5 1/2" FROM EACH END.
 - C. TWO (2) ALUMINUM VENT STOPS, 4 1/2" LONG. - LOCATE ONE AT TOP OF EACH JAMB.
 - D. FOUR (4) VINYL SASH GUIDES. - LOCATE TWO (2) AT EACH JAMB STILE OF THE OPERATING VENT, WITHIN 2 3/8" FROM THE BOTTOM OF THE VENT AND WITHIN 2" FROM THE TOP.
 - E. TWO (2) BALANCE CLIPS, WITH I.D. MARK "69N". - LOCATE ONE (1) AT THE BOTTOM OF EACH JAMB RAIL OF THE OPERATING VENT.
 - F. TWO (2) EXTRUDED ALUMINUM BALANCE COVERS. - LOCATE ONE (1) IN EACH FRAME JAMB.
4. WEATHERSTRIPPING REQUIREMENTS:
 - A. SINGLE ROW, WOOL PILE WITH INTEGRAL PLASTIC FIN. - LOCATE AT FRAME SILL FLANGE, FIXED MEETING RAIL, VENT MEETING RAIL AND EACH JAMB RAIL OF VENT (ON THE INTERIOR AND EXTERIOR.)
 - B. DOUBLE ROW, WOOL PILE WITH INTEGRAL PLASTIC FIN. - LOCATE AT VENT BOTTOM RAIL.
 - C. ONE (1) 1 3/8" LONG STRIP OF SINGLE ROW, WOOL PILE WITH INTEGRAL PLASTIC FIN. - LOCATE AT EACH END OF FIXED MEETING RAIL.
 - D. ONE (1) WOOL PILE PAD, 1 1/2" X 7/8" X .750" HIGH. - LOCATE AT EACH SILL CORNER.
 - E. ONE (1) WOOL PILE STRIP, 1 3/8" X 1/2" X .350" HIGH. - LOCATE AT BOTTOM RAIL INTERIOR, VERTICAL UNDER LIFT RAIL BUTTED TO STILE.
5. PROVIDE TWO (2) WEEP NOTCHES 1 3/16" LONG X LEG HEIGHT. - LOCATE ONE (1) AT EACH END OF THE SILL EXTRUSION INTERMEDIATE AND SCREEN RETAINER LEGS.
6. GLAZING METHOD: EXTERIOR GLAZED WITH ADHESIVE BACK BEDDING COMPOUND AND EXTRUDED ALUMINUM ANGLE (1/2"x1/4"x1/16" THK.), WITH CLEAR SILICONE BETWEEN BEAD AND GLASS.
7. ALL STRUCTURAL FRAMING MEMBERS ARE ALUMINUM ALLOY 6063-T6.
8. SHUTTERS REQUIRED FOR INSTALLATIONS UP TO 30 FEET ABOVE GRADE, FOR INSTALLATIONS ABOVE 30 FT. ABOVE GRADE, SHUTTERS ARE NOT REQUIRED.

ANCHORING NOTES

A. INTO STRUCTURAL CONCRETE CONSTRUCTION:

1. TYPICAL ANCHOR TYPE IS 1/4"Ø TAPCON AND 1 1/4" EMBEDMENT DEPTH FOR 2000/4000 PSI STRUCTURAL CONCRETE AND HOLLOW CONCRETE BLOCK.
2. MINIMUM ANCHOR QUANTITIES ARE DEPICTED AS SOLID LINES LOCATED AROUND THE PERIMETER OF EACH UNIT ELEVATION, DRAWN PERPENDICULAR TO THE FRAME (SEE ELEVATIONS)
3. MAXIMUM SHIM SPACE BETWEEN WINDOW FRAME AND CONCRETE SUBSTRATE IS 1/4".
4. MINIMUM 1/4"Ø TAPCON EDGE DISTANCE FROM EDGE OF CONCRETE/BLOCK IS 2 1/2"
5. MINIMUM SPACING BETWEEN ADJACENT 1/4"Ø TAPCON IS 3".

B. INTO ALUMINUM SUBSTRATE:

1. TYPICAL ANCHOR TYPE IS SAE GRADE 5 1/4"Øx3/4" SHEET METAL SCREW
2. MINIMUM ANCHOR QUANTITIES ARE DEPICTED AS SOLID LINES LOCATED AROUND THE PERIMETER OF EACH UNIT ELEVATION.

MAXIMUM ANCHOR SPACING REQUIREMENTS:
(SEE NOTE 1 ON SHEET 3 OF 4)

BALLARD L. ARGUS, P.E.
844 N.W. 91 TERRACE
PLANTATION, FL 33324

Glazoz
FLORIDA No.35686, CIVIL

601 N.W. 12th AVE.
POMPANO BEACH, FL 33069
PHONE: (954) 781-4430
FAX: (954) 781-3595




DWG. TITLE: GENERAL NOTES, TYP. ELEV. AND ANCHOR LAYOUT

SERIES 605 SINGLE HUNG WINDOW
SMALL MISSILE IMPACT (REINFORCED)


REVISIONS	DATE	BY	DESCRIPTION
4	10/6/20/02		ADD SPEC'S OF STEEL REINFORCEMENT TO BM
3	10/6/07/02		ALT. SUBSTRATES
2	10/5/06/02		UPDATE ENG. CALC'S
1	10/17/23/02		GENERAL REVISION

DATE: 07/23/01	SCALE: AS NOTED	DWG. BY: R.P.	CHK. BY: L.G.
----------------	-----------------	---------------	---------------


DRAWING No.:
S605-SM
SHEET 1 OF 4

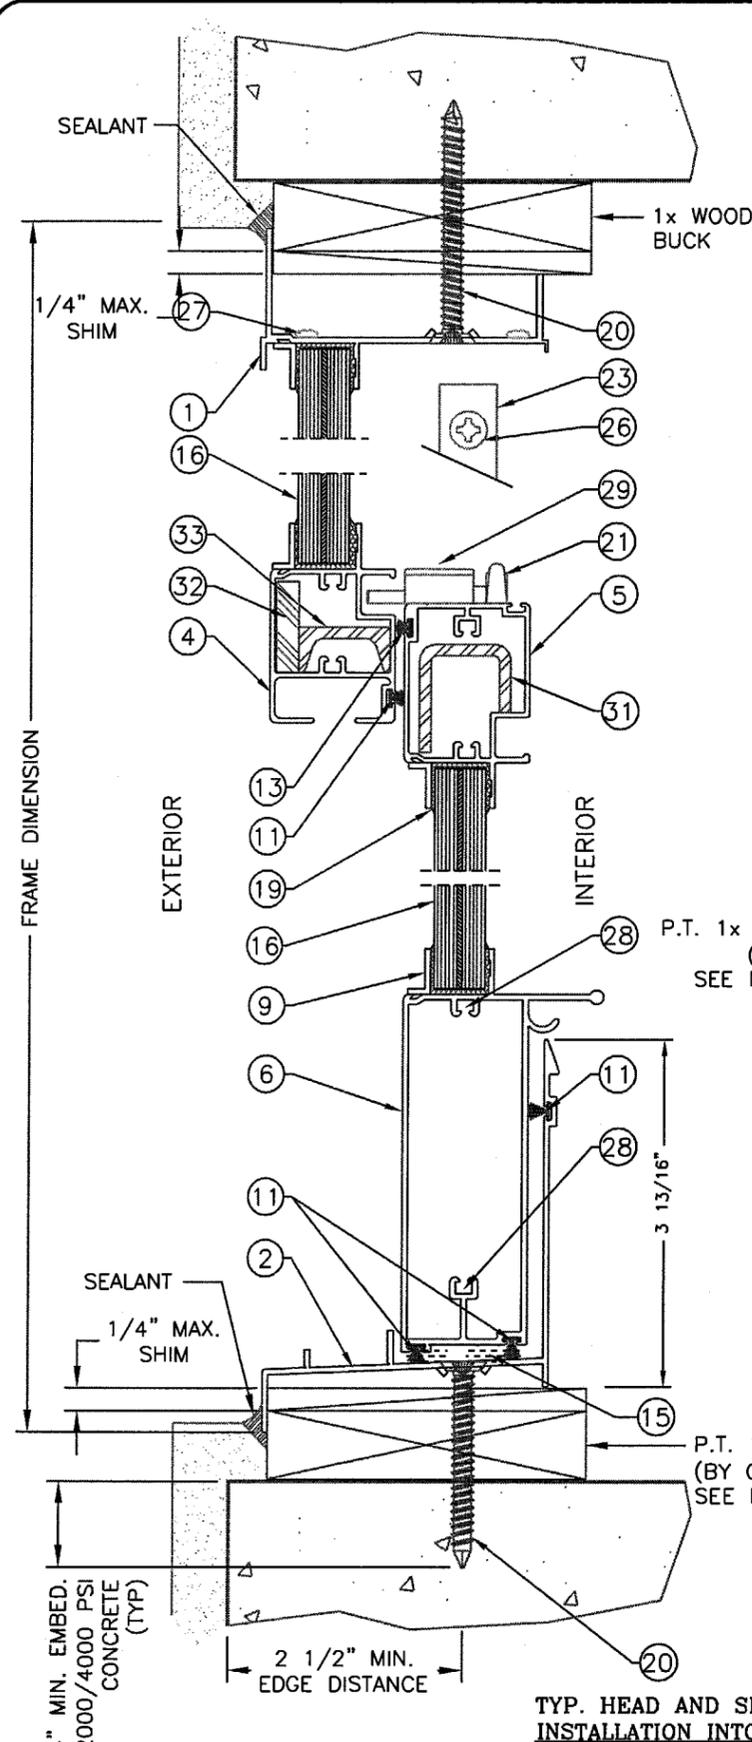

1 VERTICAL SECTION
SCALE: HALF SIZE

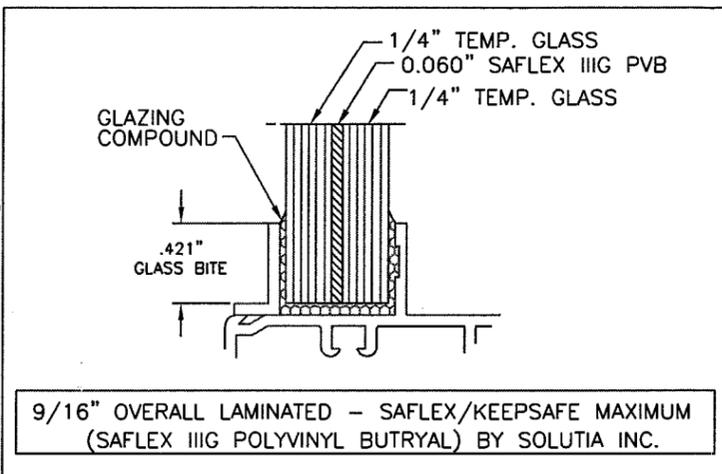

GLASS DETAIL
SCALE: FULL SIZE

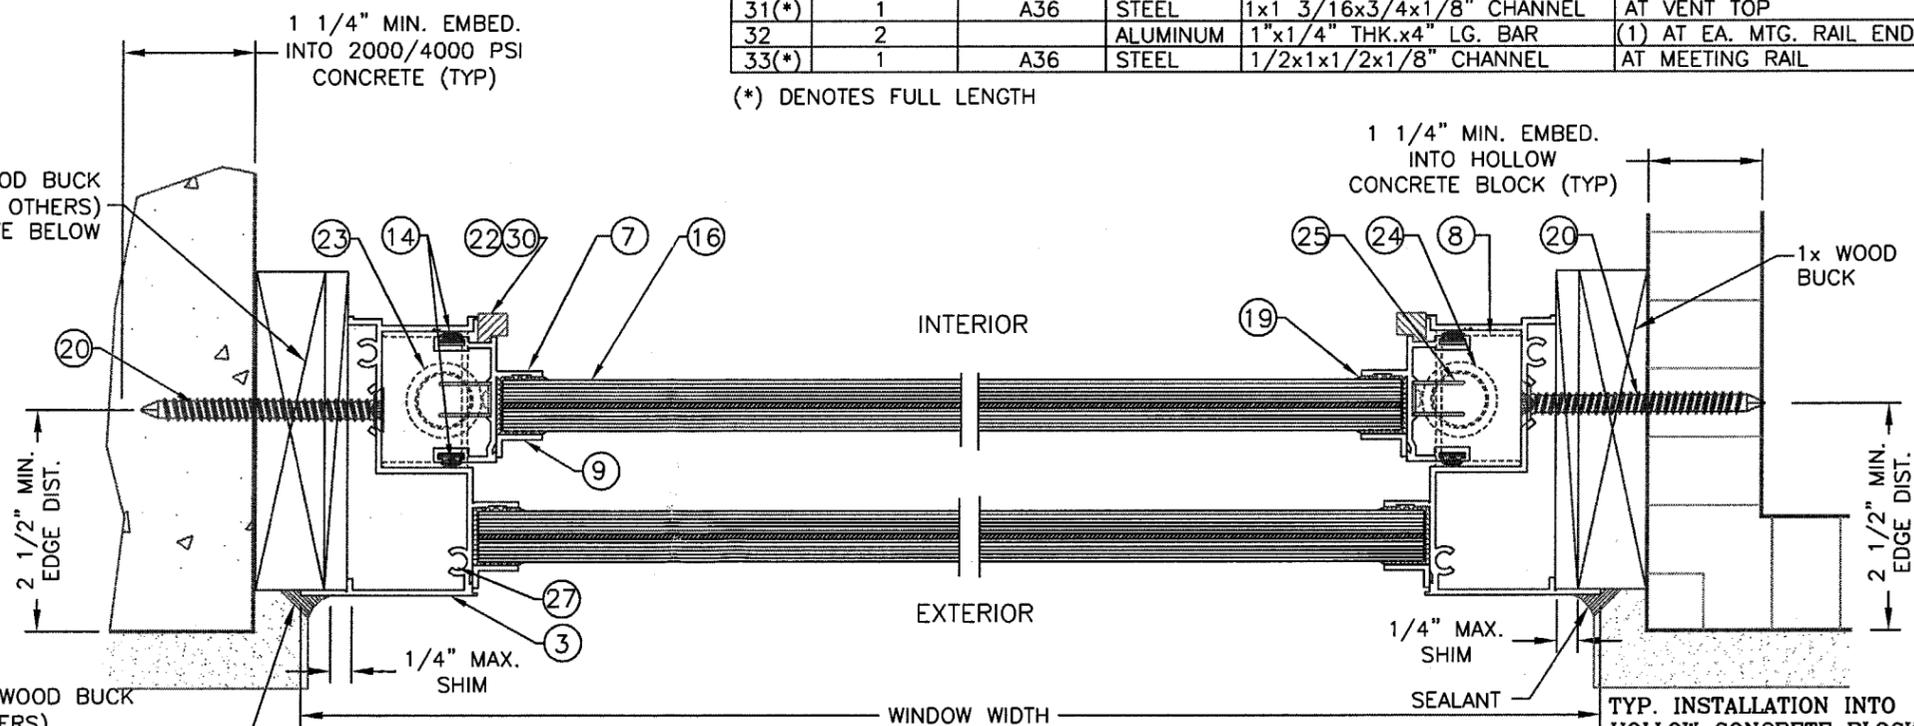

2 HORIZONTAL SECTION
SCALE: HALF SIZE

WOOD BUCK INSTALLATION NOTE:
WOOD BUCK SHALL BE ATTACHED TO SUBSTRATE AS RECOMMENDED BY ARCHITECT OR ENG. OF RECORD (TYP.)

FOR INSTALLATIONS OF THIS WINDOW UP TO 30 FEET ABOVE GRADE, SHUTTERS ARE REQUIRED
FOR INSTALLATIONS OF THIS WINDOW ABOVE 30 FEET ABOVE GRADE, SHUTTERS ARE NOT REQUIRED

BILL OF MATERIALS

ITEM	QTY.	PART No.	MATERIAL	DESCRIPTION	LOCATION
1	1	GW-36763	6063-T6	FRAME HEAD	WINDOW FRAME
2	1	GW-37731	6063-T6	FRAME SILL	WINDOW FRAME
3	2	GW-31445	6063-T6	FRAME JAMB	WINDOW FRAME
4	1	GW-36706	6063-T6	MEETING RAIL	WINDOW VENT
5	1	GW-36685	6063-T6	VENT TOP RAIL	WINDOW VENT
6	1	GW-37730	6063-T6	VENT BOTTOM RAIL	WINDOW VENT
7	2	GW-31134	6063-T6	VENT JAMB STILE	WINDOW VENT
8	2	GW-31470	6063-T5	VENT STOP	FRAME JAMBS (AT TOP)
9	4/VENT	19-56	6063-T5	GLAZING BEAD ANGLE	WINDOW VENT
11	(1) STRIP	#4037	WOOL	FIN SEAL WEATHERSTRIP	MEETING RAIL/FRAME SILL
13	(2) STRIP	#2240	WOOL	FIN SEAL WEATHERSTRIP	VENT TOP
14	(2) STRIP	#3722	WOOL	FIN SEAL WEATHERSTRIP	VENT JAMB STILES
15	2		WOOL	1 1/2 x 7/8 x .750" PAD	FRAME SILL CORNERS
16	2		GLASS	9/16" TEMPERED LAMINATED	WINDOW FRAME/VENT
19	AS REQ'D		SILICONE	STRUCTURAL GLAZING	FRAME/GLASS
20	(SEE CHART)		STEEL	1/4" Ø TAPCON BY ITW BUILDEX	FRAME PERIMETER
21	2/VENT		CAST	LATCH LOCK	VENT TOP
22	4/VENT		NYLON	VENT GUIDE	VENT INTERIOR CORNERS
23	2/VENT			CALDWELL SPIRAL BALANCES	AT FRAME JAMBS
24	2/VENT	WVR-9302	VINYL	BALANCE COVER	FRAME HEAD/JAMBS
25	2/VENT	N69		CALDWELL BALANCE CLIP	VENT BOTTOM CORNERS
26	2		STEEL	#12 x 3/4" P.H. SMS	(1) AT EACH BALANCE
27	8		STEEL	#12 x 1" P.H. SMS	FRAME CORNERS
28	8		STEEL	#10 x 1" P.H. SMS	VENT CORNERS
29	2		STEEL	#8 x 3/4" F.H. SMS.	(2) AT EACH LATCH
30	4		STEEL	#6 x 3/8" F.H. SMS.	AT EACH PLASTIC GUIDE
31(*)	1	A36	STEEL	1x1 3/16x3/4x1/8" CHANNEL	AT VENT TOP
32	2		ALUMINUM	1"x1/4" THK.x4" LG. BAR	(1) AT EA. MTG. RAIL END
33(*)	1	A36	STEEL	1/2x1x1/2x1/8" CHANNEL	AT MEETING RAIL

(*) DENOTES FULL LENGTH

BALLARD ARGUS, P.E.
844 N.W. 91 TERRACE
PLANTATION, FL 33324

[Signature]
6/24/02
FLORIDA No.35686, CIVIL

Approved as complying with the Florida Building Code
Date: July 11, 2002
NOA# 01-0703.02
Miami Dade Product Control Division
By: *[Signature]*

601 N.W. 12th Ave.,
POMPANO BEACH, FL 33069
PHONE: (954) 781-4430
FAX: (954) 781-3595

WINDOW AND DOOR

WINDOW AND DOOR

DWG. TITLE: CROSS SECTIONS AND BILL OF MATERIALS

SERIES 605 SINGLE HUNG WINDOW
SMALL MISSILE IMPACT (REINFORCED)


REVISIONS	DATE	BY	DESCRIPTION
4	06/20/02		ADD SPEC'S OF STEEL REINFORCEMENT TO BM
3	06/07/02		ALT. SUBSTRATES
2	05/06/02		UPDATE ENG. CALC'S
1	01/23/02		GENERAL REVISION

DATE: 07/23/01
SCALE: AS NOTED
DWG. BY: R.P.
CHK. BY: L.G.


DRAWING No.:
S605-SM
SHEET 2 OF 4

OPTIONAL SUBSTRATES

1. ALUMINUM MULLIONS

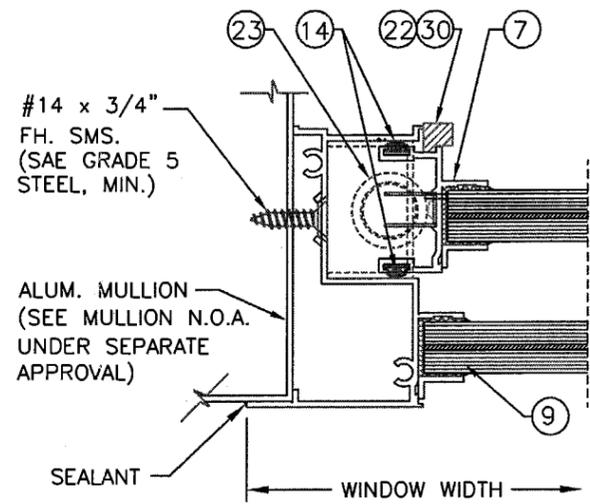

TYP. INSTALLATION INTO
RECTANGULAR ALUMINUM TYPE MULLION
MIN. WALL THICKNESS = .062"
MIN. ALLOY=6063-T5

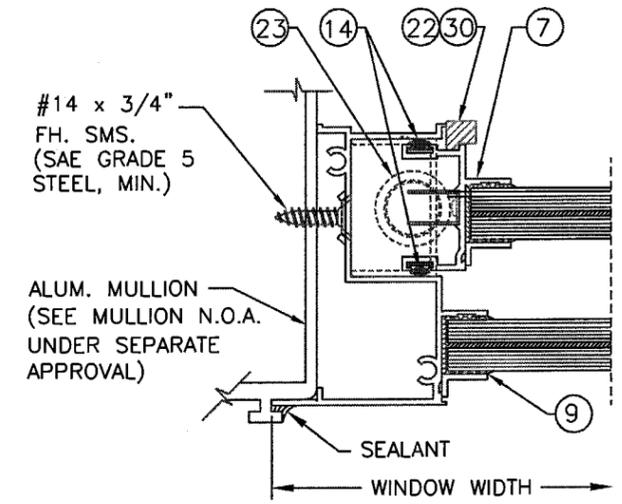

TYP. INSTALLATION INTO
FLANGE ALUMINUM TYPE MULLION
MIN. WALL THICKNESS = .062"
MIN. ALLOY=6063-T5

Approved as complying with the
Florida Building Code
Date July 11, 2002
NOA# 01-0703-02
Miami Dade Product Control
Division
By Shaq I. Chanda

INSTALLATION FASTENER CHART # 1
 BASED ON TEST REPORT No.: FTL-2761
GLAZING: 9/16" SAFLEX IIIIG POLYVINYL BUTRYAL
3 13/16" SILL HEIGHT, WATER RESISTANCE TEST: 17.00 PSF
 PROTOCOLS: PA 201, 202, 203 (SMALL MISSILE IMPACT)

SERIES 605 S.H.		WINDOW FRAME SIZE		MAX. DESIGN PRESSURE		REQ'D ANCHOR QUANTITIES		
SIZE CODES	PRODUCT CODE	WIDTH (in.)	HEIGHT (in.)	POSITIVE	NEGATIVE	HEAD/SILL	JAMB	
INDUSTRY SIZE CODES	1 2	19 1/8	26	+113.3	-180.0	2	4	
	1 3	19 1/8	38 3/8	+113.3	-180.0	2	4	
	1 4	19 1/8	50 5/8	+113.3	-180.0	2	5	
	1 4.5	19 1/8	56 5/8	+113.3	-180.0	2	6	
	1 5	19 1/8	63	+113.3	-180.0	2	6	
	1 6	19 1/8	76 3/4	+113.3	-152.3	2	7	
	H3 2	26 1/2	26	+113.3	-180.0	3	4	
	H3 3	26 1/2	38 3/8	+113.3	-180.0	3	4	
	H3 4	26 1/2	50 5/8	+113.3	-166.6	3	5	
	H3 4.5	26 1/2	56 5/8	+113.3	-148.9	3	6	
	H3 5	26 1/2	63	+113.3	-133.9	3	6	
	H3 6	26 1/2	76 3/4	+109.9	-109.9	3	7	
	MODULAR SIZE CODES	2 2	37	26	+113.3	-180.0	4	4
		2 3	37	38 3/8	+113.3	-157.4	4	4
		2 4	37	50 5/8	+113.3	-119.3	4	5
		2 4.5	37	56 5/8	+106.7	-106.7	4	6
		2 5	37	63	+95.9	-95.9	4	6
		2 6	37	76 3/4	+78.7	-78.7	4	7
3 2		53 1/8	26	+107.2	-113.5	5	4	
3 3		53 1/8	38 3/8	+74.7	-79.1	5	4	
3 4		53 1/8	50 5/8	+59.0	-62.4	5	5	
20 70		24	84	+110.9	-110.9	3	8	
20 76	24	90	+103.5	-103.5	3	8		
20 80	24	96	+97.0	-97.0	3	8		
20 86	24	102	+91.3	-91.3	3	9		

NOTE 1:

MAXIMUM ANCHOR SPACING REQUIREMENTS:

1. HEAD AND SILL FRAME ANCHORS: LOCATE ANCHORS 5 1/2" FROM ENDS, AND 11 5/8" O.C. MAX. (SINGLE ROW)
2. JAMB FRAME ANCHORS: LOCATE ANCHORS 6" FROM ENDS, ONE ANCHOR AT 4 3/4" ABOVE THE MEETING RAIL CENTER LINE AND ONE ANCHOR 9" BELOW THE MEETING RAIL CENTER LINE, AND 12 7/16" O.C. MAX. (SINGLE ROW)
3. ABOVE ANCHOR SPACING ARE MAXIMUMS; REDUCE ANCHOR SPACING FROM FRAME ENDS, IF REQUIRED, TO MAINTAIN 3" MINIMUM SPACING BETWEEN ADJACENT ANCHORS.


FOR INSTALLATIONS OF THIS WINDOW UP TO 30 FEET ABOVE GRADE,
SHUTTERS ARE REQUIRED
FOR INSTALLATIONS OF THIS WINDOW ABOVE 30 FEET ABOVE GRADE,
SHUTTERS ARE NOT REQUIRED

BALLARD L. ARGUS, P.E.
844 N.W. 91 TERRACE
PLANTATION, FL 33324

[Signature]

6/24/02
FLORIDA No.35686, CIVIL

601 N.W. 12th AVE.
POMPANO BEACH, FL 33069
PHONE: (954) 781-4430
FAX: (954) 781-3595




DWG. TITLE: INSTALLATION FASTENER CHART

SERIES 605 SINGLE HUNG WINDOW
SMALL MISSILE IMPACT (REINFORCED)


REVISIONS		No.	DATE	BY	DESCRIPTION
4	06/20/02	ADD SPEC'S OF STEEL REINFORCEMENT TO BM			
3	06/07/02	ALT. SUBSTRATES			
2	05/06/02	UPDATE ENG. CALC'S			
1	01/23/02	GENERAL REVISION			

DATE: 07/23/01
SCALE:
DWG. BY: R.P.
CHK. BY: L.G.


DRAWING No.:
S605-SM
SHEET 3 OF 4

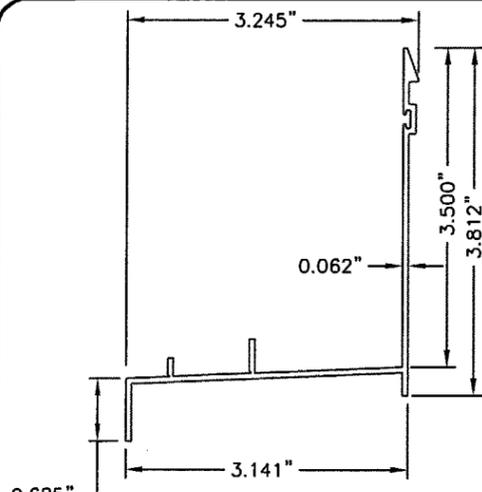


GW 37731
FRAME SILL
SCALE: HALF SIZE

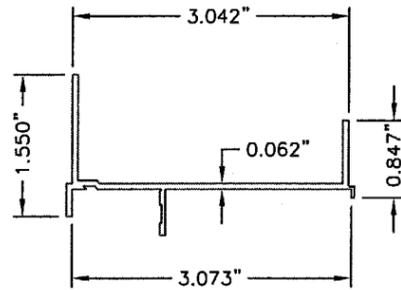


GW 36763
FRAME HEAD
SCALE: HALF SIZE

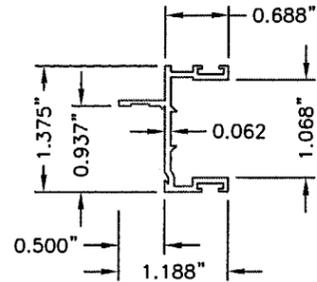


GW 31134
VENT JAMB STILE
SCALE: HALF SIZE




ITEM 33
STEEL REINFORCEMENT CHANNEL
(INTO THE MEETING RAIL-FULL LENGTH)
SCALE: FULL SIZE

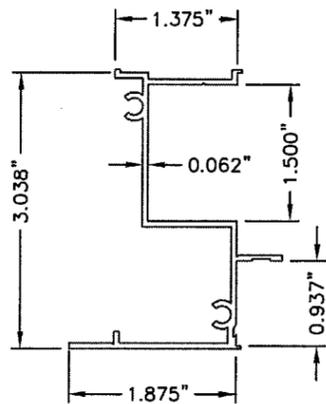


GW 31445
FRAME JAMB
SCALE: HALF SIZE

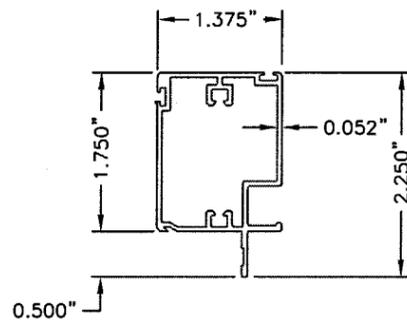


GW 36685
VENT TOP RAIL
SCALE: HALF SIZE

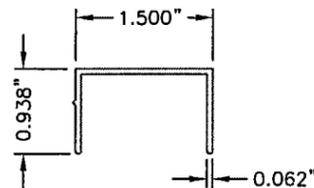


GW 31470
VENT STOP
SCALE: HALF SIZE

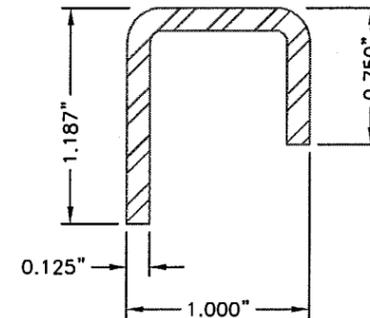


ITEM 31
STEEL REINFORCEMENT CHANNEL
(INTO THE VENT TOP-FULL LENGTH)
SCALE: FULL SIZE

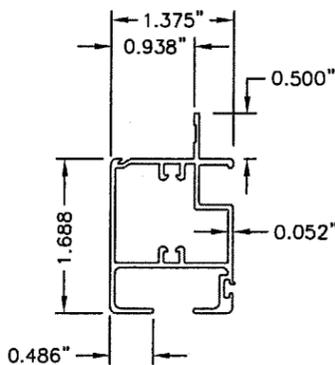


GW 36706
VENT MEETING RAIL
SCALE: HALF SIZE

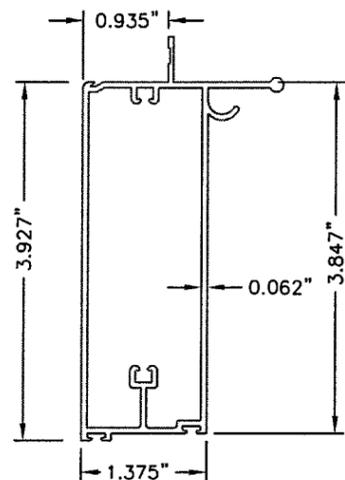

GW 37730
VENT BOTTOM RAIL
SCALE: HALF SIZE



19-56
GLAZING BEAD ANGLE
SCALE: FULL SIZE



ITEM 32
ALUMINUM BAR-4\"/>

Approved as complying with the
Florida Building Code
Date July 11, 2002
NOAS 01-0703.02
Miami Date Product Control
Division
By Shaq I. Chanda

BALLARD L. ARGUS, P.E.
844 N.W. 91 TERRACE
PLANTATION, FL 33324

6/20/02
FLORIDA No.35686, CIVIL

601 N.W. 12th AVE.,
POMPANO BEACH, FL 33069
PHONE: (954) 781-4430
FAX: (954) 781-3595

DWG. TITLE: PARTS LIST

SERIES 605 SINGLE HUNG WINDOW
SMALL MISSILE IMPACT (REINFORCED)

REVISIONS	
No.	DESCRIPTION
4	06/20/02 ADD SPECS OF STEEL REINFORCEMENT TO BM
3	06/07/02 ALT. SUBSTRATES
2	05/06/02 UPDATE ENG. CALC'S
1	01/23/02 GENERAL REVISION

DATE: 07/23/01

SCALE: AS NOTED

DWG. BY: R.P.

CHK. BY: L.G.

DRAWING No.:
S605-SM

SHEET 4 OF 4