



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Pozzi Window Company
62845 Boyd Acres Rd. (P.O. Box 5249)
Bend ,OR 97701

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

Your application for Notice of Acceptance (NOA) of:
Series "Half Circle Over Casement (IG)" Aluminum Clad Mulled Wood Casement Window
under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-0802.03
EXPIRES: 09/30/2006

Raul Rodriguez
Chief Product Control Division

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 08/30/2001



Pozzi Window Company

ACCEPTANCE No.: 01-0802.03

APPROVED : AUG 30 2001

EXPIRES : September 30, 2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1 This renews the Notice of Acceptance No. **98-1008.01**, which was issued on February 18, 1999. It approves an aluminum clad wood casement window, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1 The Series "**Half Circle Over Casement (IG)**" **Aluminum Clad Muller Wood Casement Window** and its components shall be constructed in strict compliance with the following documents: Drawing No **CC-1.5**, Sheets 1 of 7 of 7, titled "Pozzi Aluminum Clad Wood Muller Casement Windows w/Half Circle Transom," prepared by R. W. Building Consultants, Inc., dated 11/12/98, revised on 6/19/01, bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1 This approval applies to single unit applications of only, as shown in approved drawings.

4. INSTALLATION


- 4.1 The aluminum clad wood casement window and its components shall be installed in strict compliance with the approved drawings.
- 4.2 Hurricane protection system (shutters): the installation of this unit **will require** a hurricane protection system.

5. LABELING

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

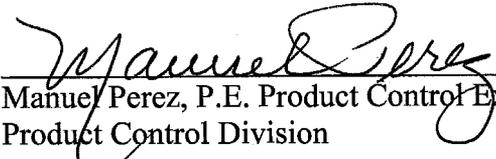
Manuel Perez, P.E. Product Control Examiner
Product Control Division

Pozzi Window Company

ACCEPTANCE No.: 01-0802.03

APPROVED : AUG 30 2001

EXPIRES : September 30, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE


Manuel Perez, P. E., Product Control Examiner
Product Control Division

POZZI WINDOW COMPANY

ALUMINUM CLAD WOOD CASEMENT MULLED WINDOWS
W/HALF CIRCLE TRANSOM. INSULATED GLASS UNITS

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED.
5. FOR DESIGN PRESSURE RATING SEE CHART THIS PAGE:

CASEMENT WINDOW CONSTRUCTION

(Common to all conditions)

Wood Frame Construction: Rectangle Top; The wood frame is 1.21875" x 3.3125" max. Finger Jointed Ponderosa Pine. The corners are coped, butted and sealed. Each corner is fastened with (2) 2.0" x 0.375" W. staples and (1) corner key. A wood frame extension of clear pine 0.65625" x 1.375" is attached to the sill and side jambs on the interior with 15ga. x 2" L. finish nails. An interior mull cover measuring 2.438" x .406" of Clear Pine is attached to the mullion section with 15GA. x 2" finish nails on the sill and side jambs.


Wood Sash Construction: The wood sash is 1.484" x 2.094" clear pine. The corners are coped, butted and sealed. Each corner is fastened with (1) #8 x 1 3/4" brass phillips flathead wood screw.

Wood Frame Construction: Half Circle Top; The wood frame is 3.21825" x 1.21875" max. Finger Jointed Ponderosa Pine for the sill & 3.28125" x 1.21875" max. Pine Veneer Bent Wood for the radius top. The corners are coped butted and sealed. Each corner is fastened with (2) 1.5" x 0.375" W. staples. A wood frame extension of Pine Veneer Bent Wood measuring 0.65625" x 1.375" is attached to the half circle on the interior with 15ga. x 2" L. finish nails.

Aluminum Cladding: Custom extrusions of 6063-T5 aluminum 1.773" x 0.718" x .055" thk. wall for the Rectangle Top Casement frame. The sash is clad with a roll formed coil stock aluminum 3105-H15 0.019" thk. measuring .350" x 1.537". The Half Circle Top frame is clad with a custom extrusion of 6063-T5 aluminum measuring 2.023" x 1.916" x 0.055" thk.

Window Construction: The aluminum cladding is tongue and groove fit to the wood frame with mitered corners and secured with (2) #6 x 2" screws per corner. It is secured to the wood frame with 0.375" W. x 1" L. wire staples spaced at 24.0" O.C.. An aluminum dripcap/nailling flange is snap fitted to the head of the window unit and a PVC nailling flange is snap fitted to the jambs and sill. All mullion joints on the interior are joined with 6.91 mil x 1" x 1/2" corrugated fasteners. All exterior mullion joints are clipped with an extruded aluminum mullion cover.

Glazing Method: Rectangular units are glazed with 7/8" IG (1/8" annealed on the int. & ext. sides). A boot glazing gasket was used to seal and secure the glass. The Half Circle transom is 1" IG (1/4" annealed or 1/8" heat strengthened on the int. & ext. sides). The glass is glazed into the unit with 1/8" x 1/2" glazing tape.

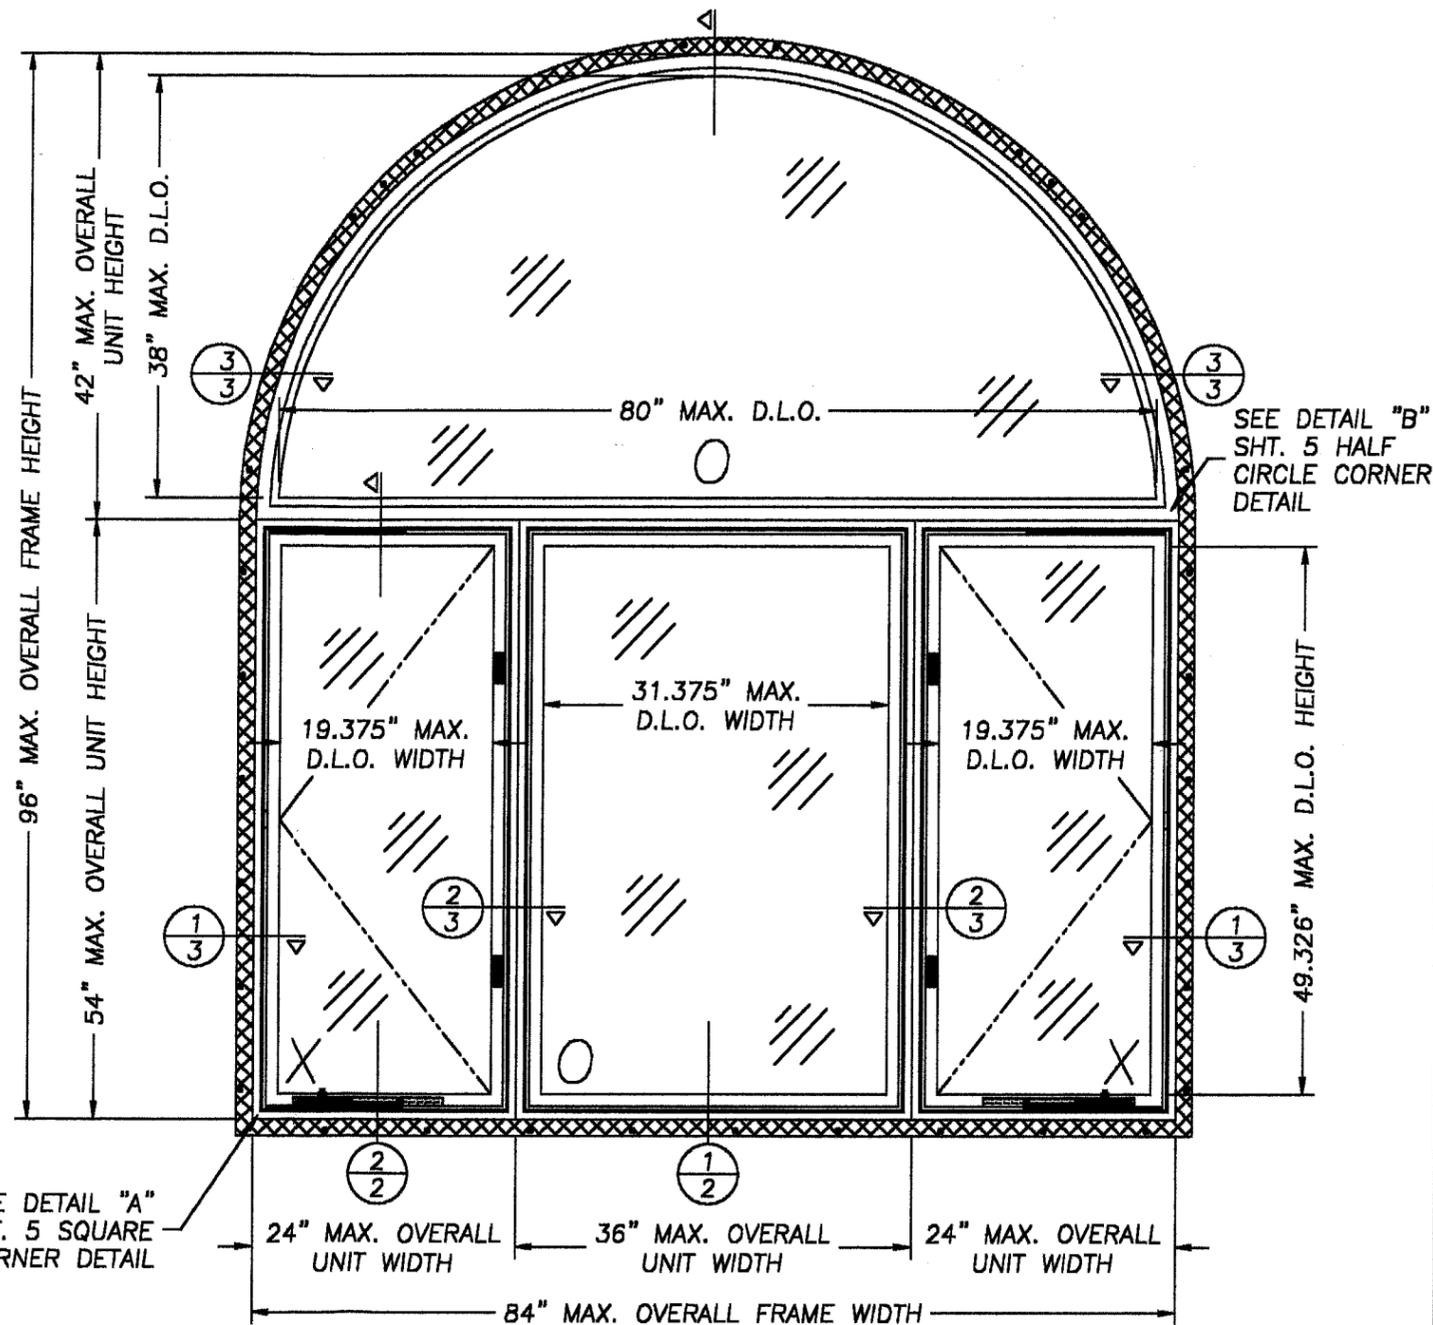

MULLED CASEMENT WINDOW ELEVATION VIEW
VIEWED FROM EXTERIOR

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATION
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTION
4	ANCHORING LOCATIONS & HARDWARE
5	GLAZING DETAILS AND DETAILS "A" & "B"
6	UNIT COMPONENTS
7	UNIT COMPONENTS

DESIGN PRESSURE RATING ALL MODELS SHOWN

UNIT	GLAZING TYPE & SQUARE FEET	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED
FIXED REC.	1/8" ANNEALED IG UP TO 10.75 SQ. FT.	+ 50.0 psf - 52.0 psf
1/2 CIRCLE	1/4" ANNEALED IG UP TO 15.74 SQ. FT.	+ 50.0 psf - 52.0 psf
1/2 CIRCLE	1/8" HEAT STRENGTHENED IG UP TO 15.74 SQ. FT.	+ 50.0 psf - 52.0 psf
OP. SASH	1/8" ANNEALED IG UP TO 6.63 SQ. FT.	+ 50.0 psf - 52.0 psf

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT:
POZZI ALUMINUM CLAD WOOD
MULLED CASEMENT WINDOWS
W/HALF CIRCLE TRANSOM
PART OR ASSEMBLY:
GENERAL NOTES &
TYPICAL ELEVATION

NO.	DATE	REVISIONS
2	06/19/01	GENERAL REVISION & CHANGE TJH
1	01/11/99	GENERAL REVISION
		BY


RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE AUG 30 2001
BY *Manuel Perez*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0802.03

DATE: 11/12/98
SCALE: N.T.S.
DWG. BY: C.A.B.
CHK. BY:
DRAWING NO.:
CC-1.5
SHEET 1 OF 7

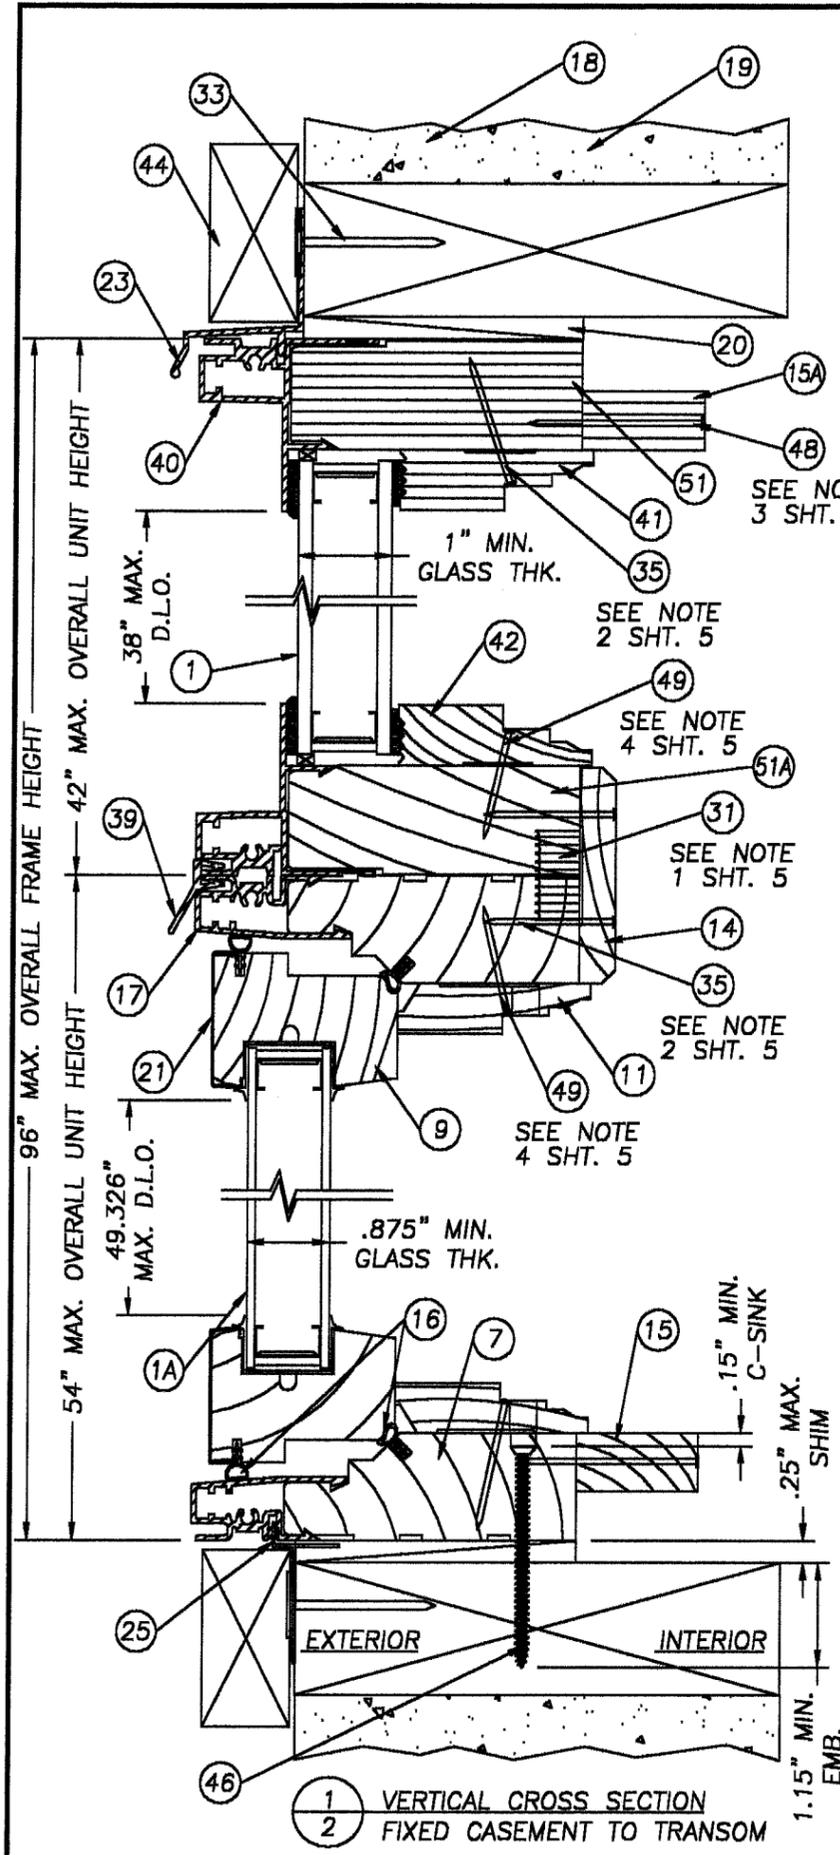

1 VERTICAL CROSS SECTION
2 FIXED CASEMENT TO TRANSOM

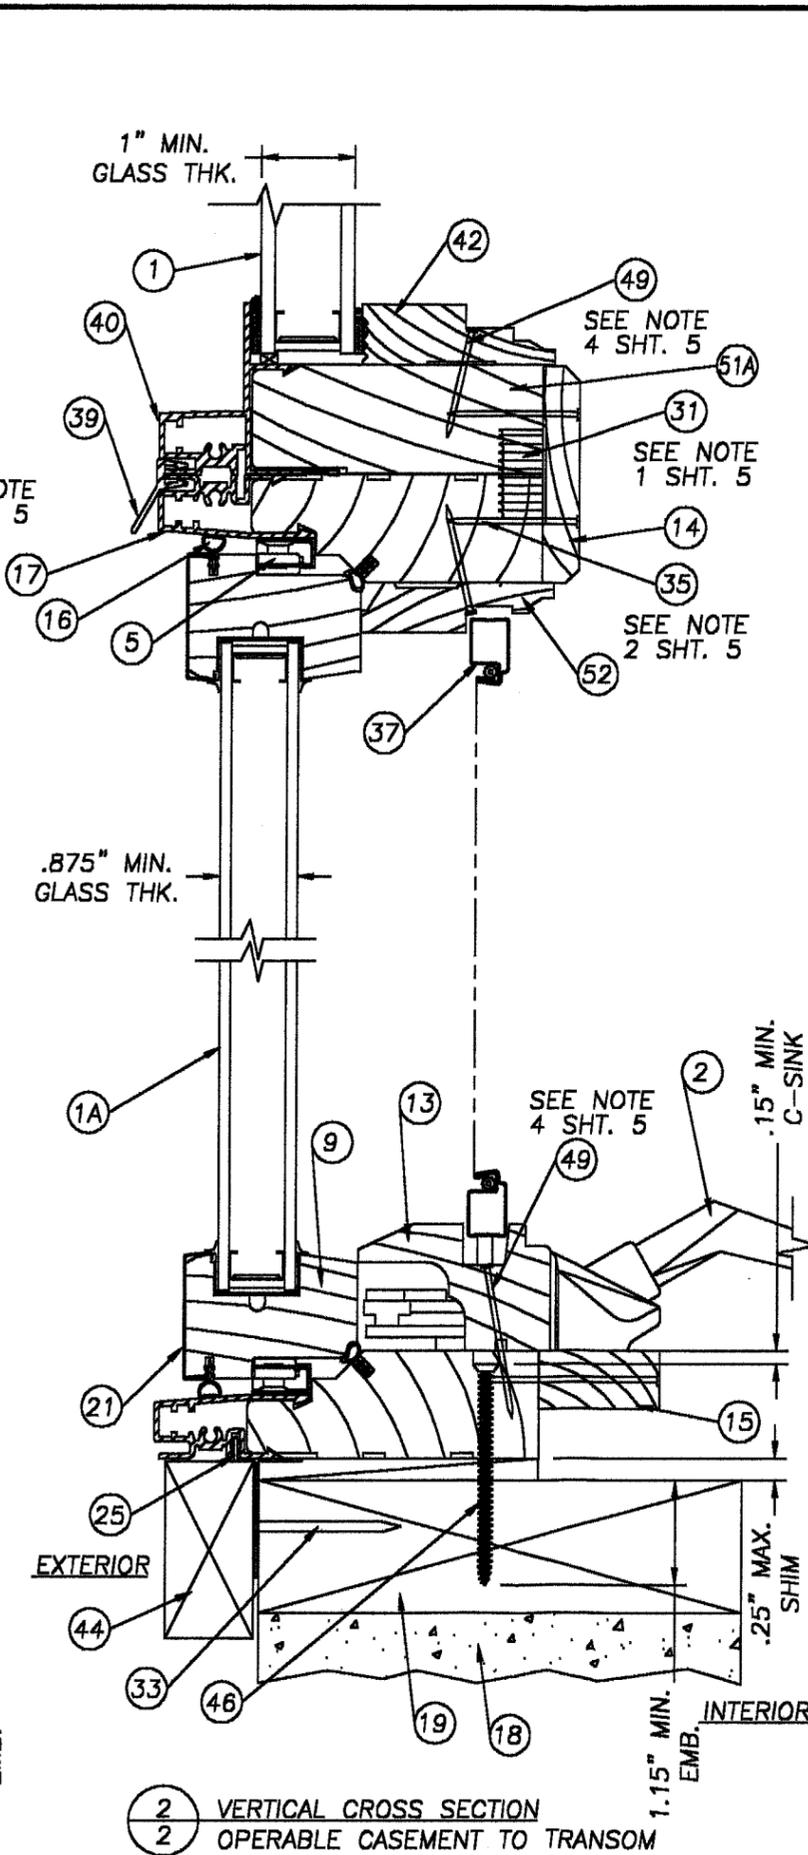

2 VERTICAL CROSS SECTION
2 OPERABLE CASEMENT TO TRANSOM

Item	Description	Material
1	1" INSULATED ANNEALED GLASS BY PPG	-
1A	7/8" INSULATED ANNEALED GLASS BY PPG	-
2	OPERATOR W/HANDLE & COVER (15-94 TRUTH HARDWARE)	-
3	SASH TRACK (30706 TRUTH HARDWARE .050" WALL)	STEEL
4	SASH LOCK (16-18 TRUTH HARDWARE) & KEEPER (#31360 TRUTH HARDWARE)	-
5	SASH HINGE (14-75 TRUTH HARDWARE)	-
6	SASH SNUBBER (10390 TRUTH HARDWARE)	FINGER J. PINE
7	HEAD & SILL WOOD FRAME REC. TOP (AC-2 BEND MILLWORKS)	FINGER J. PINE
8	SIDE WOOD FRAME (AC-4 BEND MILLWORKS)	FINGER J. PINE
9	SASH TOP & BOTTOM RAIL (AC-20 BEND MILLWORKS)	CLEAR PINE
10	SASH STILE (AC-21 BEND MILLWORKS)	CLEAR PINE
11	STA. HEAD & SILL SCREEN STOP (DC-17 BEND MILLWORKS)	CLEAR PINE
12	SIDE SCREEN STOP REC. TOP (DC-7 BEND MILLWORKS)	CLEAR PINE
13	OPERATOR COVER (DC-22 BEND MILLWORKS)	CLEAR PINE
14	INT. MULL COVER (AC-6 BEND MILLWORKS)	CLEAR PINE
15	STRAIGHT JAMB EXTENSION REC. TOP (AC-11 BEND MILLWORKS)	CLEAR PINE
15A	STRAIGHT JAMB EXTENSION RAD. TOP (AC-11 BEND MILLWORKS)	CLEAR LAM. PINE VEN.
16	1/4" VINYL BULB WEATHERSTRIP (AB-200 INTEK)	VINYL
17	FRAME METAL CLADDING ALUM. REC. TOP (AC-18 ANODIZING INC.)	6063-T5
18	MASONRY WALL	CONC.
19	2x WOOD BUCK	WOOD
20	1/4" SHIM	-
21	SASH ROLL FORMED RAIL ALUM. CLADDING (AC-46 NICHOLS-HOMESHIELD)	3105 H-15
22	SASH ROLL FORMED STILE ALUM. CLADDING (AC-45 NICHOLS-HOMESHIELD)	3105 H-15
23	ALUM. DRIP CAP (AC-172 ANODIZING INC.)	6063-T5
24	ALUM. VERT. EXT. MULL COVER (AC-220 ANODIZING INC.)	6063-T5
25	PVC NAILING FIN (AC-35 PLASTIC PROFILES INC.)	PVC
26	ALUM. FRAME CORNER KEY (AC-74 MITCHELL METALS)	6061-T6511
27	VINYL STATION. SASH SETTING BLOCK (DC-209 INTEK)	VINYL
28	#6 x 2" PHILLIPS WOOD SCREW (CRONIN FASTENERS)	STEEL
29	#8 x 1 3/4" PHILLIPS WOOD SCREW (CRONIN FASTENERS)	BRASS
30	#8 x 2" PHILLIPS WOOD SCREW (CRONIN FASTENERS)	BRASS
31	6.91 MIL X 1" X 1/2" CORRUGATED FASTENER (STANLEY BOSTITCH)	STEEL
32	3/8" x 1" WIRE STAPLES (CRONIN FASTENERS)	STEEL
33	1 5/8" ROOFING NAIL	STEEL
34	3/8" x 2" WIRE STAPLES (STANLEY BOSTITCH)	STEEL
35	15 GA. x 1 1/2" FINISH NAIL	STEEL
36	GLAZING COMPOUND DOW CORNING SILICONE #1199	SILICONE
37	SCREEN ASSEMBLY (POZZI WINDOWS MFG.)	-
38	1/16" FRAME GASKET (DERBY)	-
39	ALUM. HORT. EXT. MULL COVER (AC-65 ANODIZING INC.)	6063-T5
40	FRAME METAL CLADDING ALUM. RAD. TOP (AC-88 ANODIZING INC.)	6063-T5
41	HEAD GLASS STOP RADIUS TOP (AC-147 BEND MILLWORKS)	CLEAR LAM. PINE VEN.
42	SIDE & SILL GLASS STOP RADIUS TOP (AC-147 BEND MILLWORKS)	FINGER J. PINE
43	GLAZING BOOT (#FV-6032 AEROQUIP)	-
44	1 x 2 EXTERIOR TRIM	-
45	1/8" x 1/2" GLAZING TAPE	-
46	#8 x 2 1/2" GALVANIZED PHILLIPS FLATHEAD WOOD SCREW	STEEL
47	1/4" x 4" TAPCON	STEEL
48	15 GA. x 2" FINISH NAIL	STEEL
49	15 GA. x 1 1/4" FINISH NAIL	STEEL
50	3/8" x 1 1/2" WIRE STAPLES (CRONIN FASTENERS)	STEEL
51	HEAD WOOD FRAME RADIUS TOP (AC-151 BEND MILLWORKS)	CLEAR LAM. PINE VEN.
51A	SILL & SIDE WOOD FRAME RADIUS TOP (AC-151 BEND MILLWORKS)	FINGER J. PINE
52	HEAD SCREEN STOP REC. TOP (DC-5 BEND MILLWORKS)	CLEAR PINE

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD WOOD MULLED CASEMENT WINDOWS W/HALF CIRCLE TRANSOM
PART OR ASSEMBLY: VERTICAL CROSS SECTIONS & BILL OF MATERIALS

NO.	DATE	REVISIONS
2	06/19/01	GENERAL REVISION & CHANGE T/JH
1	01/11/99	GENERAL REVISION

RW BUILDING CONSULTANTS, INC.
813.884.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Manuel Ortiz*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0802.03

DATE: 11/12/98
SCALE: 1/2" = 1"
DWG. BY: C.A.B.
CHK. BY:
DRAWING NO.: CC-1.5
SHEET 2 OF 7

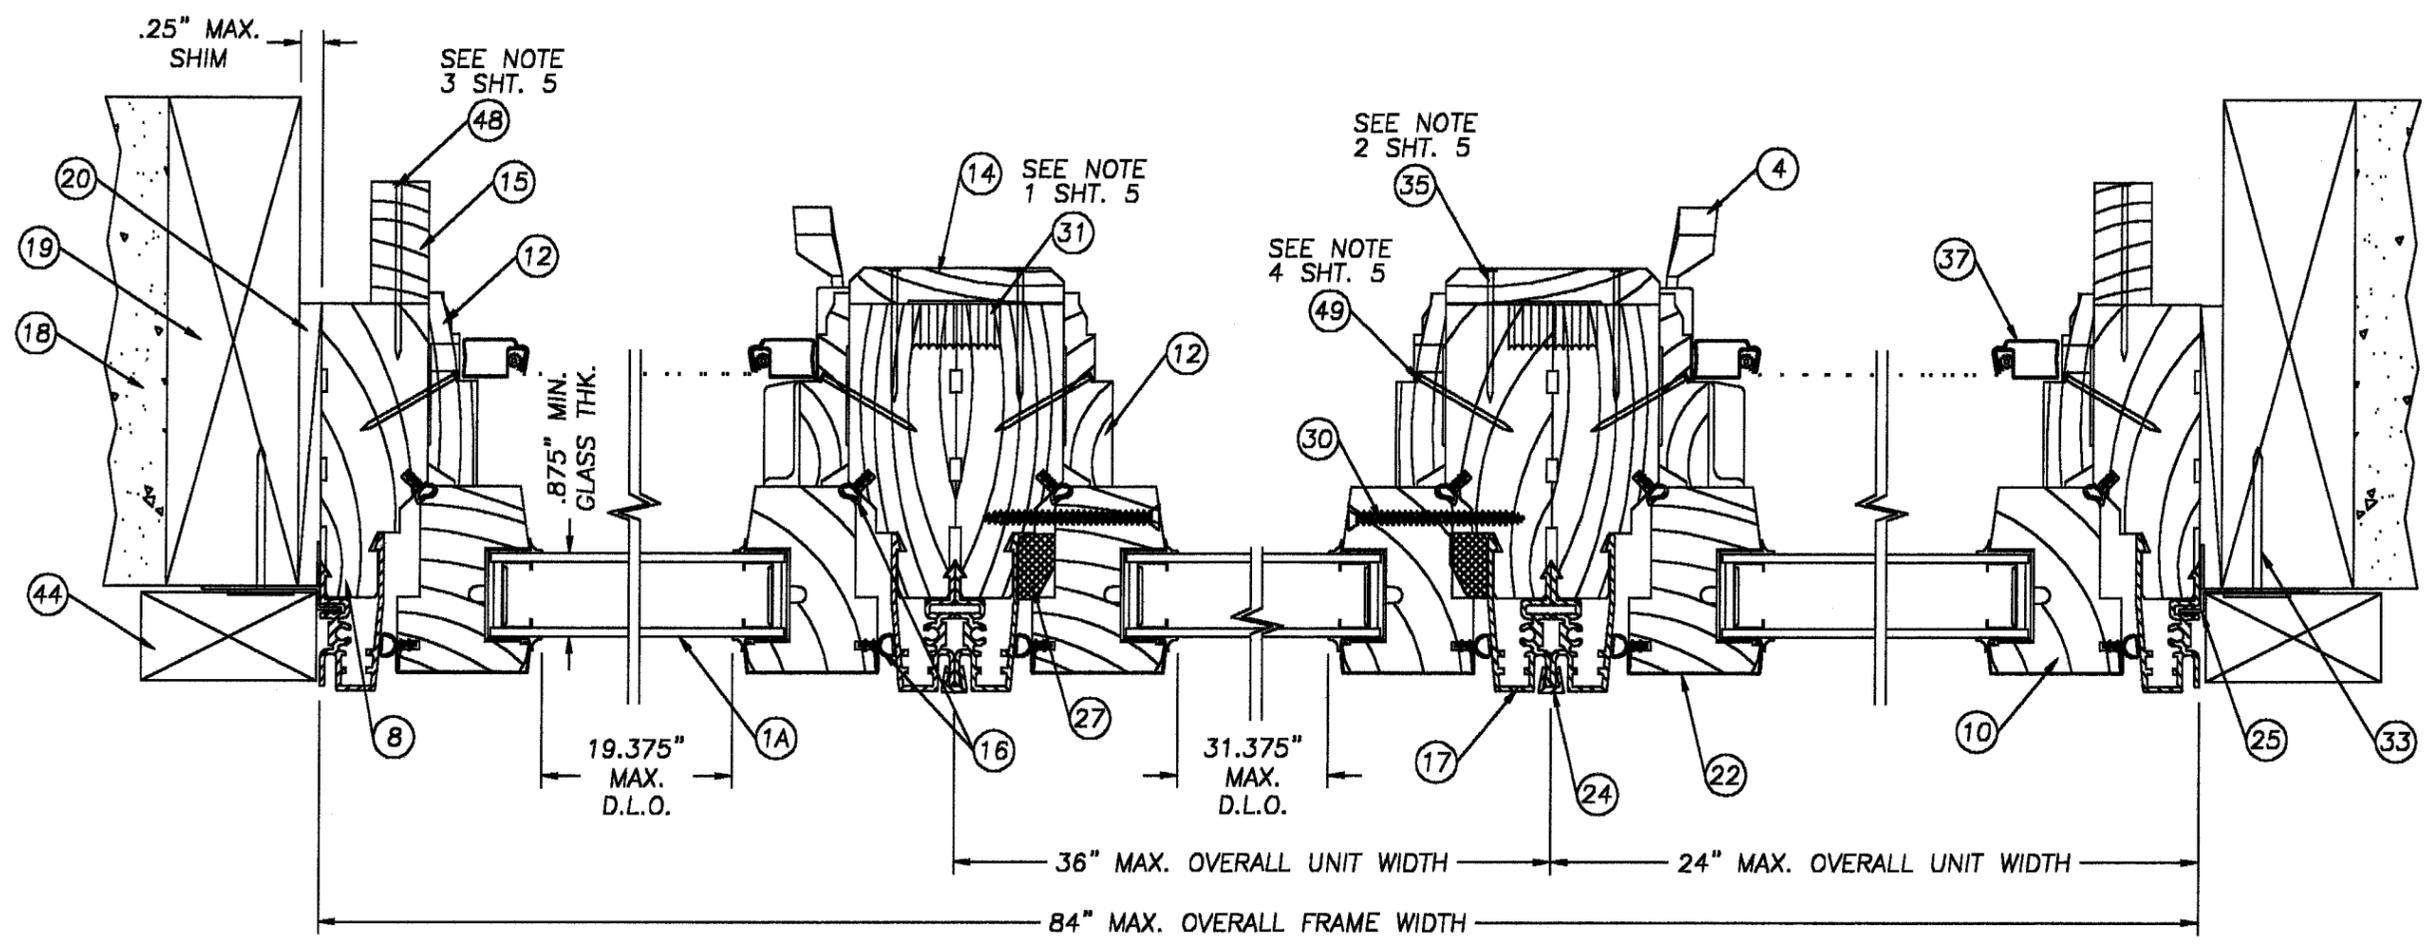

1
3 HORIZONTAL CROSS SECTION

POZZI WINDOW COMPANY
 62845 BOYD ACRES RD.
 BEND, OREGON 97701
 PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD WOOD MULLED CASEMENT WINDOWS W/HALF CIRCLE TRANSOM
 PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS

NO.	DATE	REVISIONS	BY
2	06/19/01	GENERAL REVISION & CHANGE	TJH
1	01/11/99	GENERAL REVISION	-

RW BUILDING CONSULTANTS, INC.
 813.684.3831


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE **AUG 30 2001**
 BY *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0802.03

DATE: 11/12/98
 SCALE: 1/2" = 1"
 DWG. BY: C.A.B.
 CHK. BY:
 DRAWING NO.: CC-1.5
 SHEET 3 OF 7

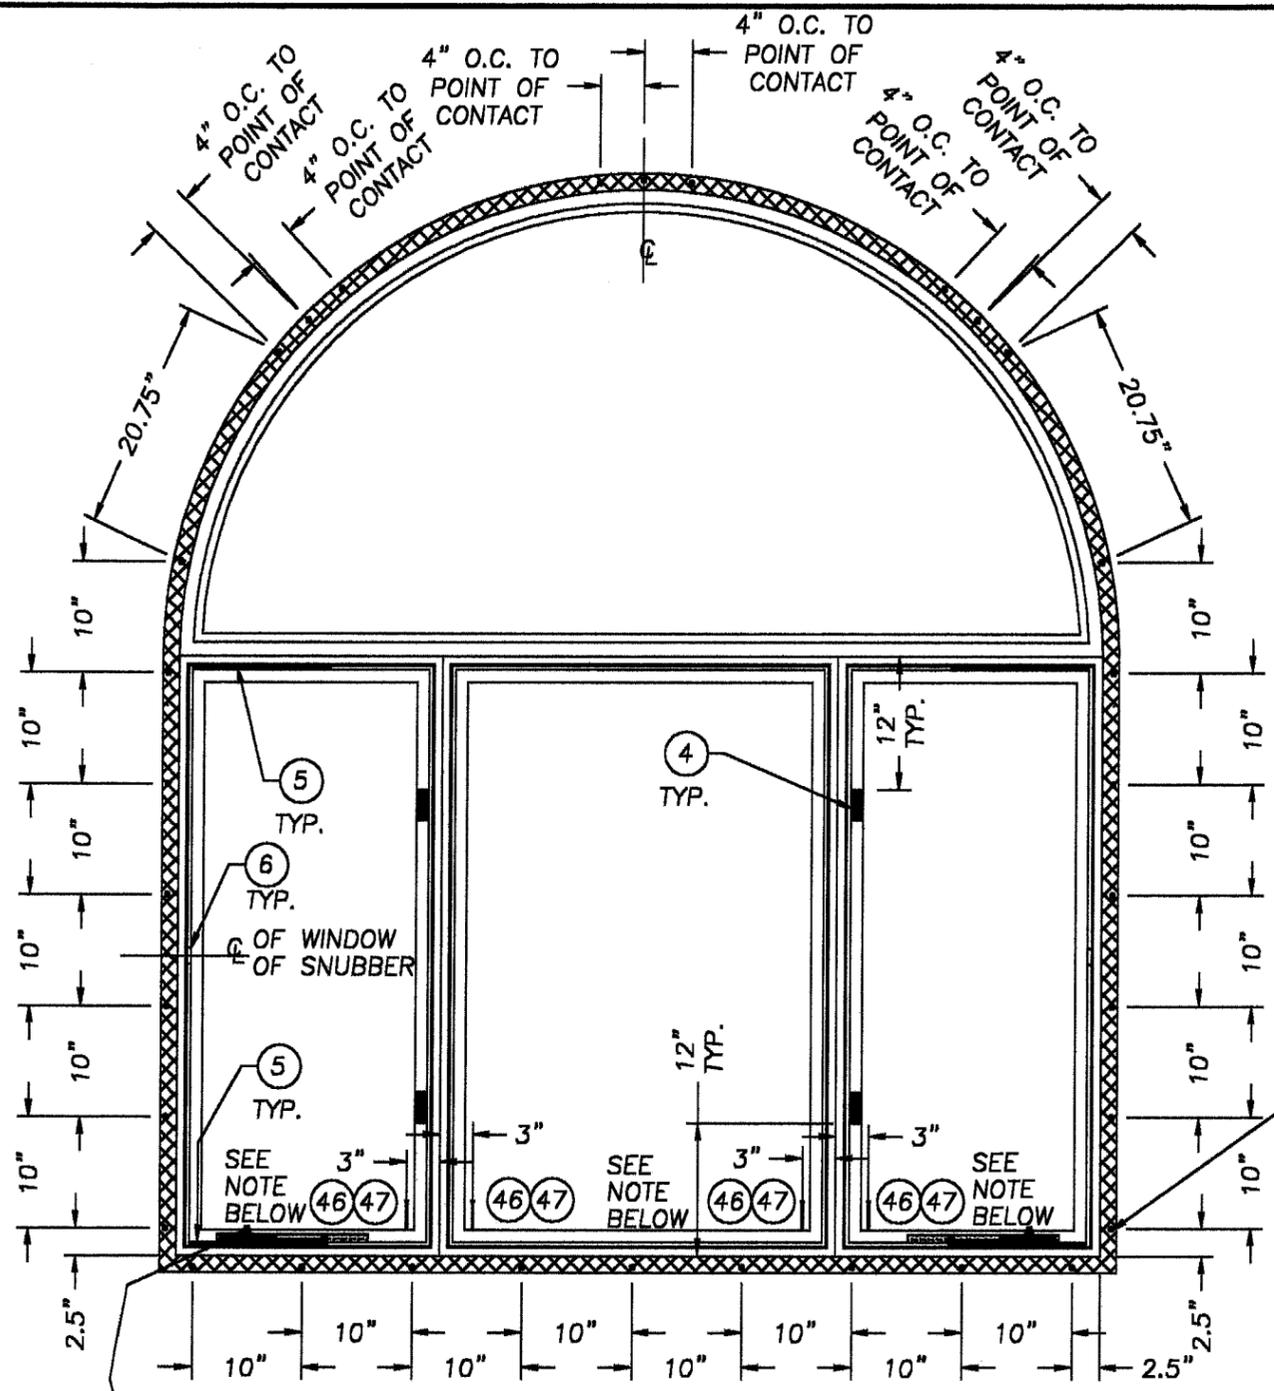


MULLED CASEMENT WINDOW ANCHORING LOCATIONS
VIEWED FROM EXTERIOR


NOTE: WHEN ANCHORING THE UNIT INTO A WOOD BUCK USE ITEM #46, A #8 x 2 1/2" L. SCREW. WHEN ANCHORING THE UNIT DIRECTLY TO MASONRY USE ITEM #47, A 1/4" x 4" L. TAPCON.

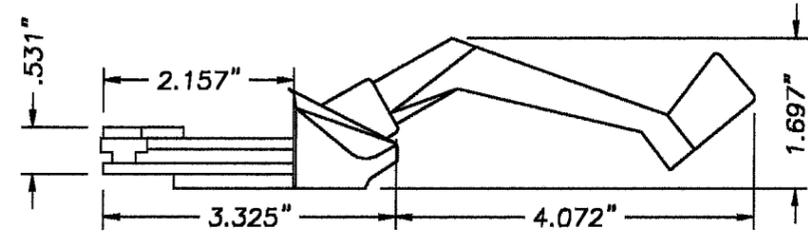


OPERATOR WITH HANDLE
TRUTH #15-94, DIE-CAST ZINC BASE, CRANK HANDLE AND KNOB. HARDENED STEEL WORM AND GEAR. HIGH STRENGTH PLASTIC COVER

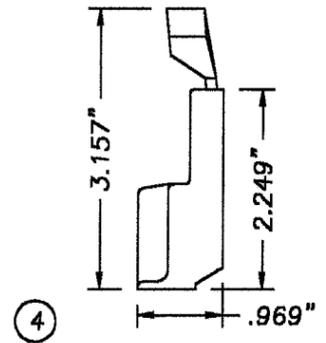


SASH LOCK TRUTH #16-18
DIE-CAST ZINC HANDLE AND CASE STEEL BACK PLATE AND LOCKING CAM




SASH HINGE TRUTH #14-75
10" LONG STEEL TRACK & ARMS WITH STAINLESS STEEL INSERT INSIDE DELRIN SLIDE SHOE WITH A BRASS POST & LOCKING SNAP RING



SASH SNUBBER
TRUTH #10390
.060" WALL STEEL



SASH OPERATING TRACK
TRUTH #30706
.050" WALL STEEL



STAINLESS STEEL SASH KEEPER
TRUTH #31360
.106" WALL STEEL

33 TYP. IN THE NAILING FLANGE

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD WOOD MULLED CASEMENT WINDOWS W/HALF CIRCLE TRANSOM
PART OR ASSEMBLY: ANCHORING LOCATIONS & HARDWARE

NO.	DATE	REVISIONS	BY
2	06/19/01	GENERAL REVISION & CHANGE	TJH
1	01/11/99	GENERAL REVISION	-

RW BUILDING CONSULTANTS, INC.
813.684.3831


APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Manuel Soria*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0802.03

DATE: 11/12/98
SCALE: N.T.S.
DWG. BY: C.A.B.
CHK. BY:
DRAWING NO.: CC-1.5
SHEET 4 OF 7

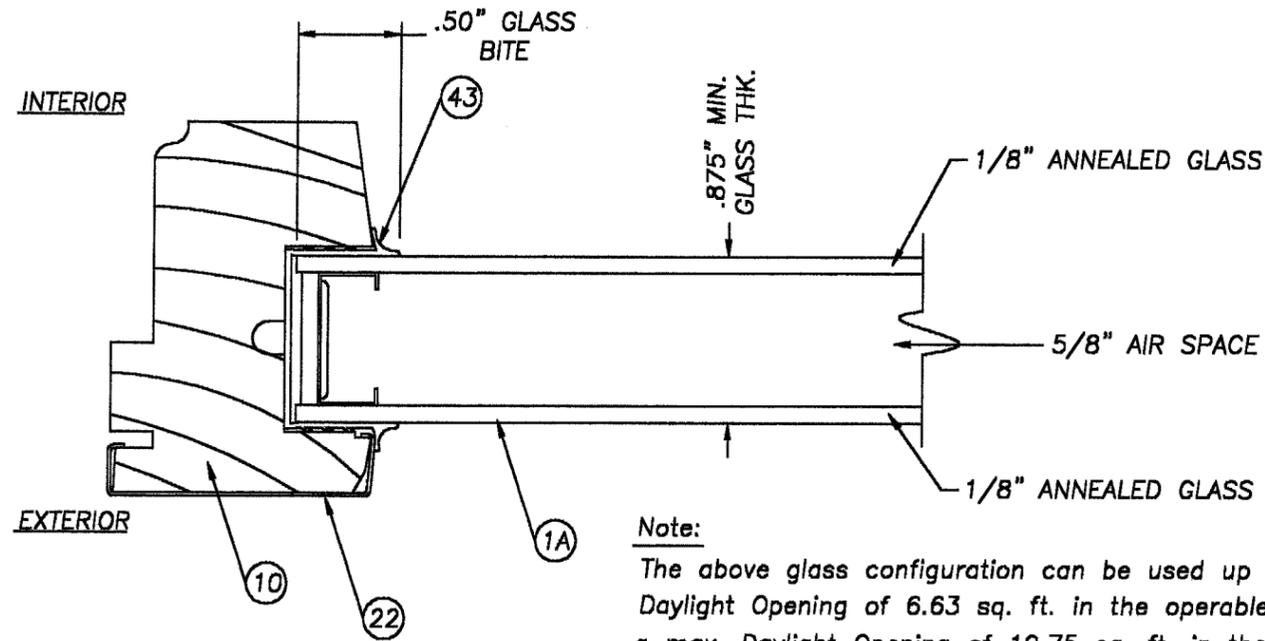


Note:
The above glass configuration can be used up to a max. Daylight Opening of 6.63 sq. ft. in the operable sash & a max. Daylight Opening of 10.75 sq. ft. in the fixed sash.

.875" INSULATED ANNEALED GLASS
W/ 1/8" ANNEALED GLASS & 5/8" AIR SPACE
FIXED AND OPERABLE CASEMENT WINDOWS
GLAZING DETAIL

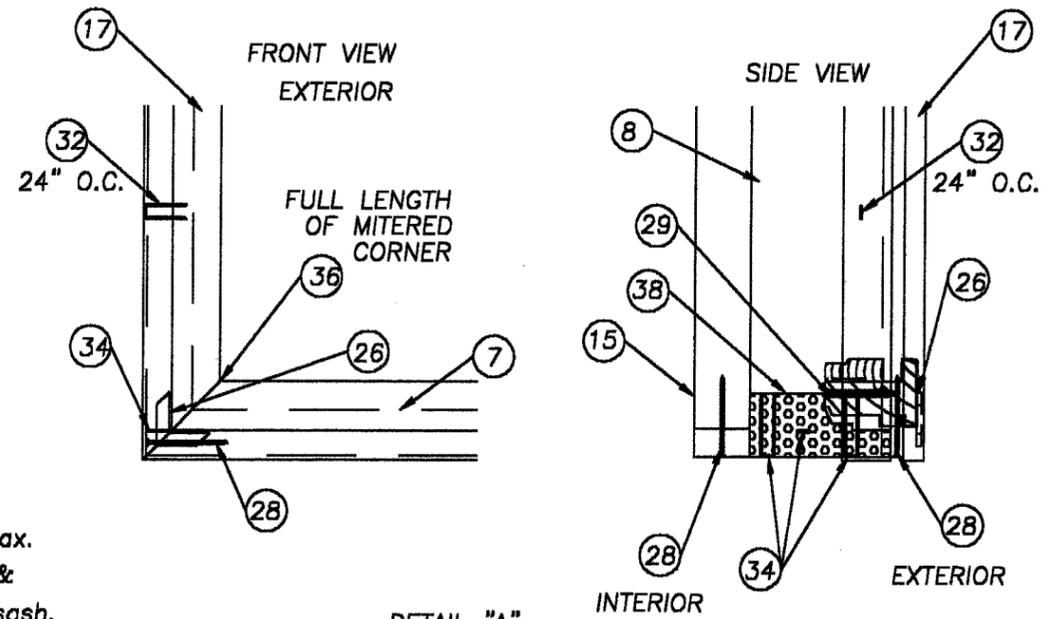


DETAIL "A"
TYP. SQUARE CORNER DETAIL
N.T.S.

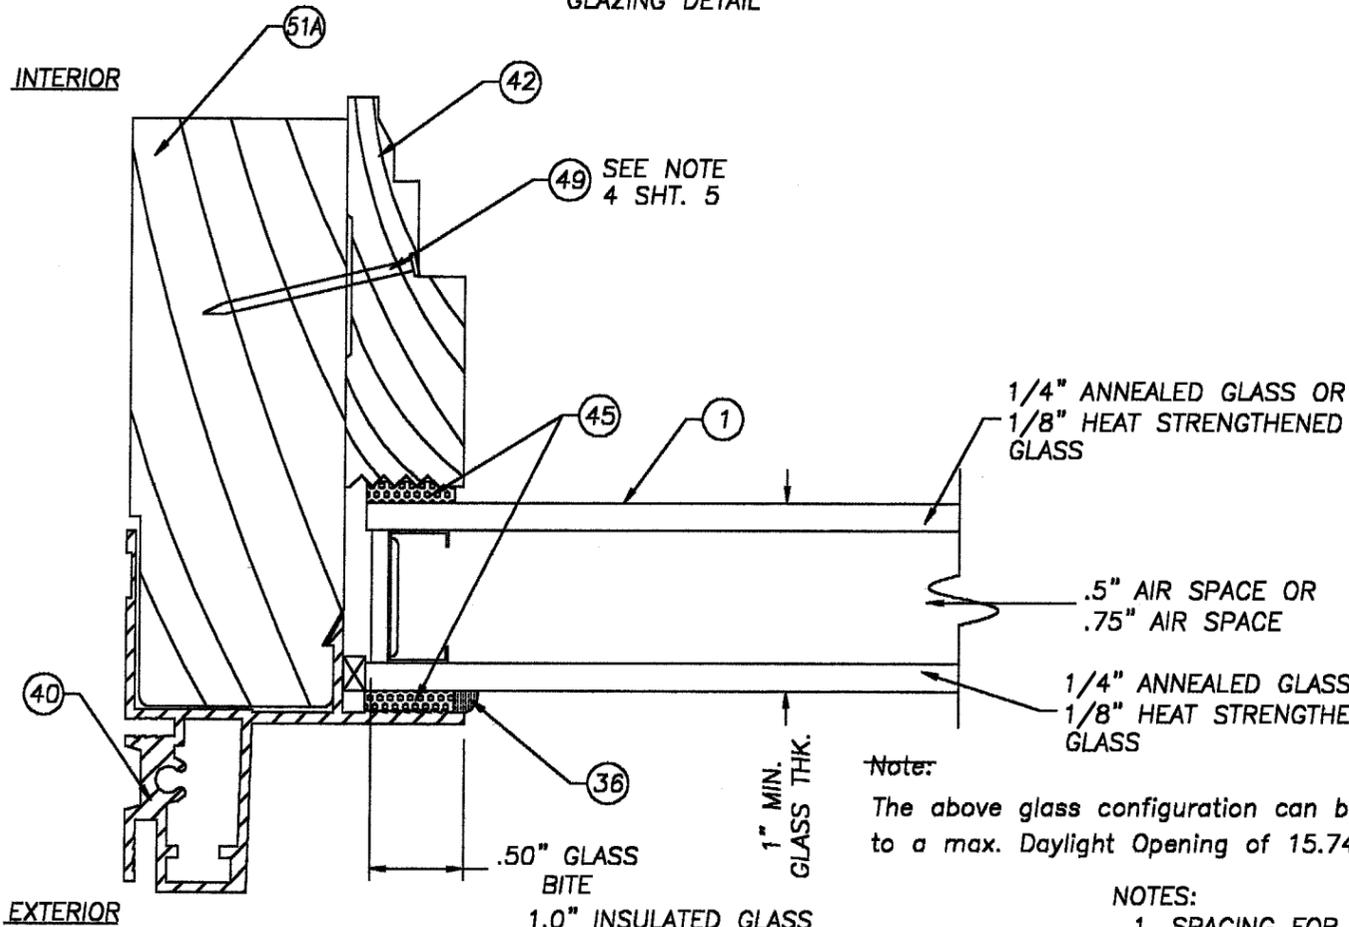

Note:
The above glass configuration can be used up to a max. Daylight Opening of 15.74 sq. ft.

1.0" INSULATED GLASS
W/ 1/4" ANNEALED GLASS & .5" AIR SPACE OR
W/ 1/8" HEAT STRENGTHENED GLASS & .75" AIR SPACE
FIXED CIRCLE TOP TRANSOM
GLAZING DETAIL

- NOTES:**
1. SPACING FOR ITEM #31 IS 4" O.C. MAX.
 2. SPACING FOR ITEM #35 IS 16" O.C. MAX.
 3. SPACING FOR ITEM #48 IS 16" O.C. MAX.
 4. SPACING FOR ITEM #49 IS 16" O.C. MAX.

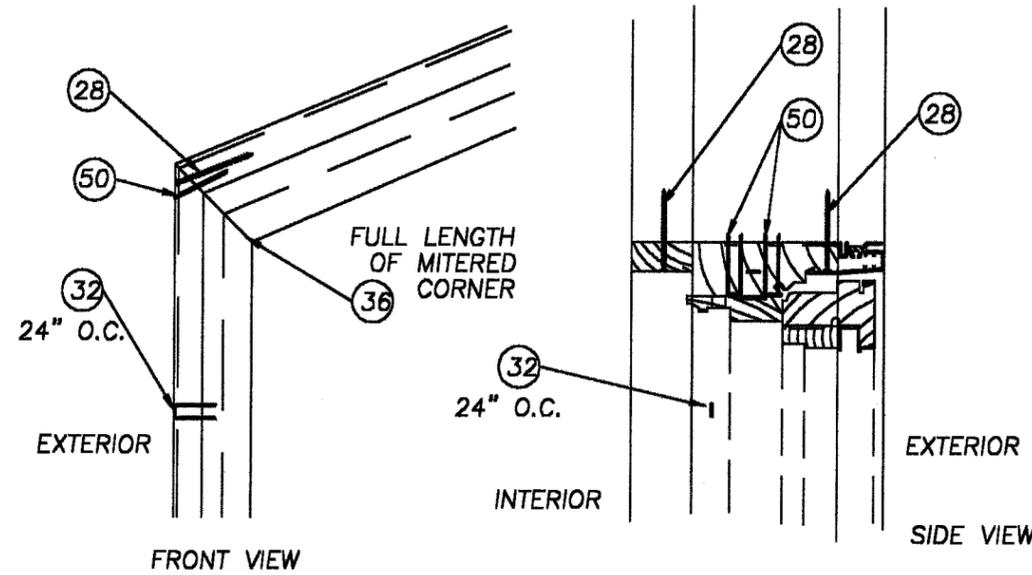

DETAIL "B"
TYP. CORNER DETAIL
N.T.S.

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT:
POZZI ALUMINUM CLAD WOOD
MULLED CASEMENT WINDOWS
W/HALF CIRCLE TRANSOM
PART OR ASSEMBLY:
GLAZING DETAILS &
DETAILS "A" & "B"

NO.	DATE	REVISIONS	BY
2	06/19/01	GENERAL REVISION & CHANGE	TJH
1	01/11/99	GENERAL REVISION	


RW BUILDING
CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE **AUG 30 2001**
BY *Manuel Sere*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0602.03


DATE: 11/12/98
SCALE: N.T.S.
DWG. BY: C.A.B.
CHK. BY:
DRAWING NO.: CC-1.5
SHEET 5 OF 7

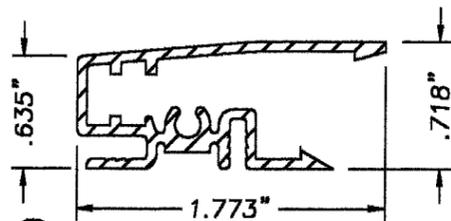


17 AC-18 FRAME METAL
6063-T5 ALUMINUM .055" WALL

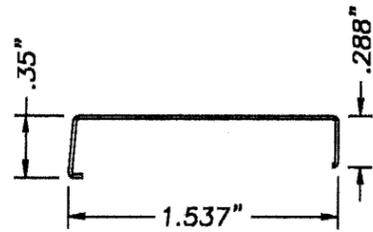


22 AC-45 & 46 21
ROLL FORMED SASH CLADDING
COILED ALUMINUM STOCK 3105-H15
.019 TYP. WALL




15 AC-11 JAMB EXTENSION
CLEAR PIN

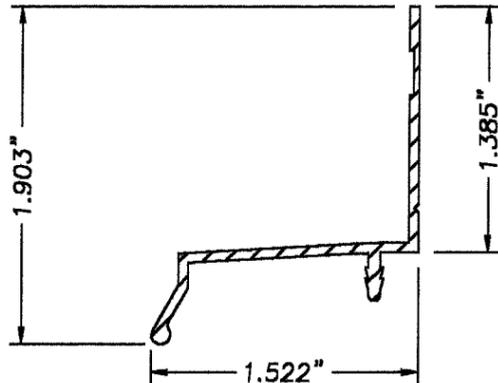


23 AC-172 DRIP CAP
6063-T5 ALUMINUM .055" WALL

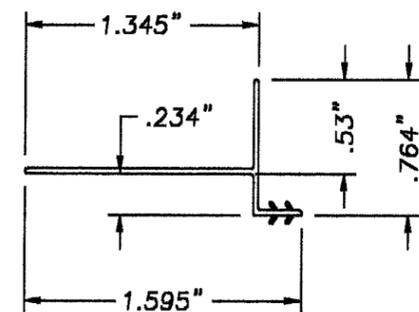


25 AC-35 NAIL FIN
EXTRUDED PVC .030" WALL

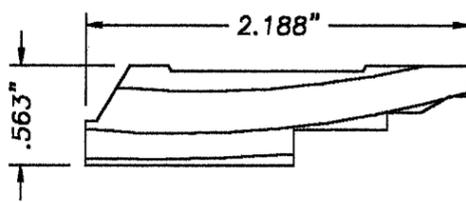


DC-7 SIDE SCREEN STOP
CLEAR PIN 12

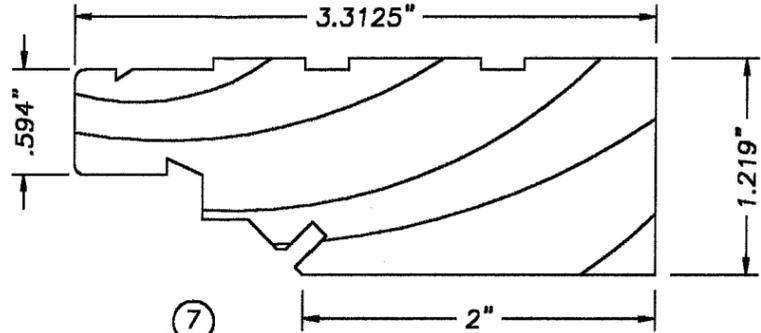


7 AC-2 HEAD & SILL WOOD FRAME
8 AC-4 SIDE WOOD FRAME
FINGER JOINTED PINE

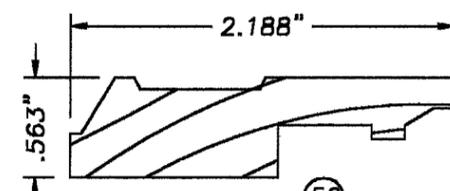


52 DC-5 HEAD SCREEN STOP
CLEAR PIN

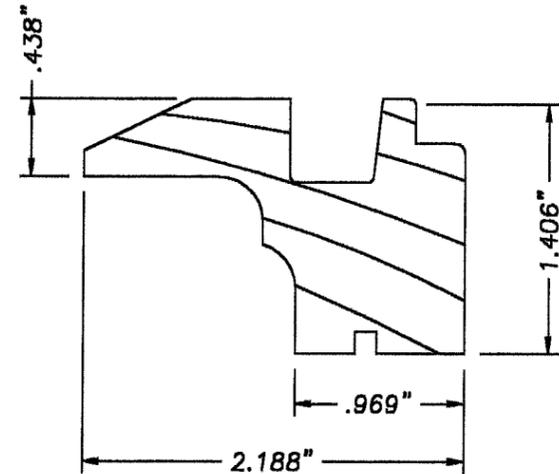


DC-22 OPERATOR COVER
CLEAR PINE 13

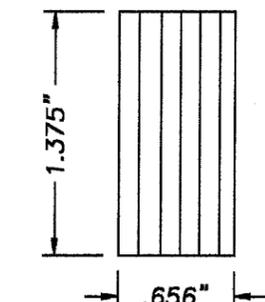


15A AC-11 JAMB EXTENSION
CLEAR LAM. PINE VEN.

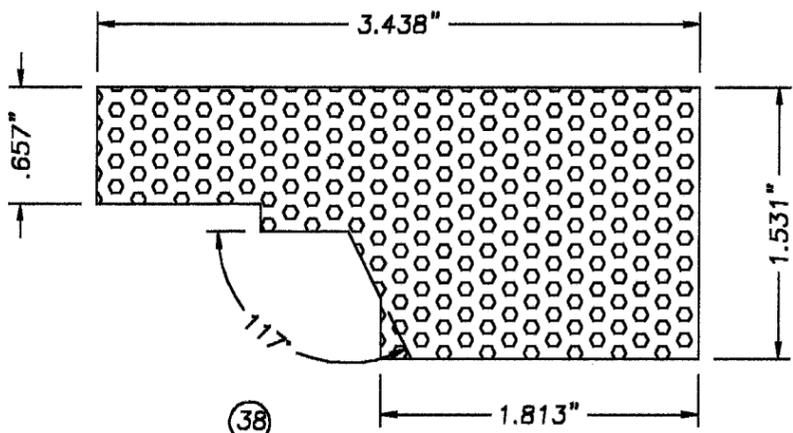


38 1/16" CLOSED CELL FOAM FRAME GASKET

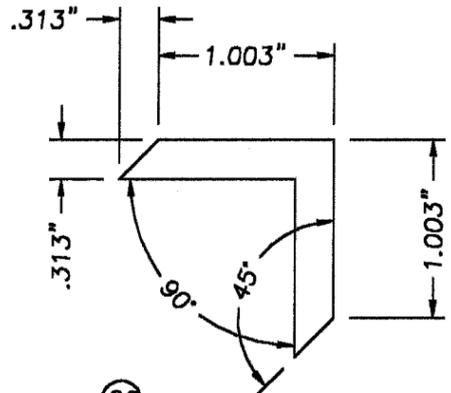


26 AC-74 FRAME CORNER KEY
ALUM. ALLOY 6061-T6511
.125" THK.



43 GLAZING BOOT
#FV-6032

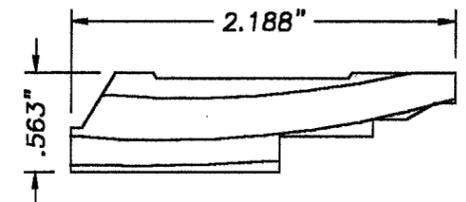

11 DC-17 STAT. HEAD & SILL
SCREEN STOP. CLEAR PINE



16 AB-200 1/4" VINYL
BULB WEATHERSTRIP

POZZI WINDOW COMPANY
62845 BOYD ACRES RD.
BEND, OREGON 97701
PH. 541.382.4411


PRODUCT: POZZI ALUMINUM CLAD WOOD MULLED CASEMENT WINDOWS W/HALF CIRCLE TRANSOM
PART OR ASSEMBLY: UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
2	06/19/01	GENERAL REVISION & CHANGE TJH	
1	01/11/99	GENERAL REVISION	


RW BUILDING CONSULTANTS, INC.
813.684.3831

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
DATE: **AUG 30 2004**
BY: *Manuel Sree*
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. *01-0802.03*


DATE: 11/12/98
SCALE: N.T.S.
DWG. BY: C.A.B.
CHK. BY:
DRAWING NO.: CC-1.5
SHEET 6 OF 7

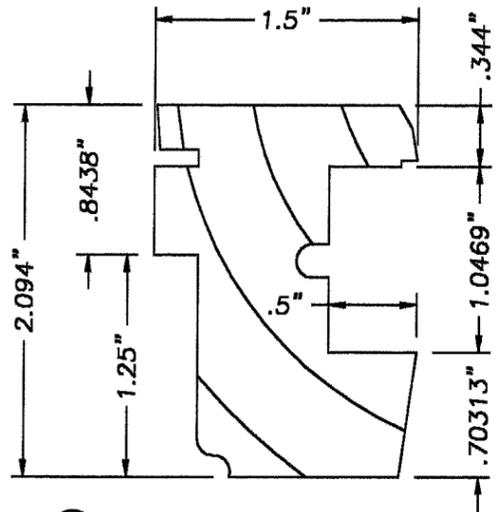


9 AC-20 SASH TOP & BOTTOM RAIL
 10 AC-21 SASH STILE
 CLEAR PINE

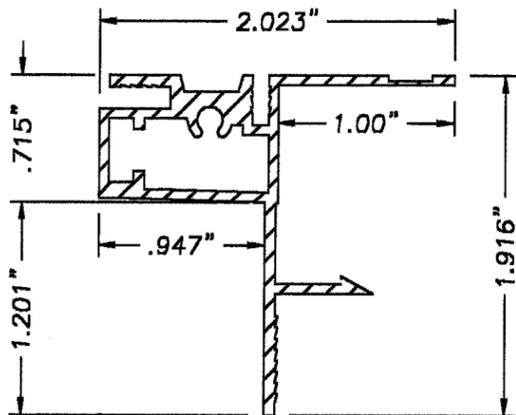


40 AC-88 ALUM. FRAME METAL CLADDING
 RAD. TOP, 6063-T5 .055" WALL

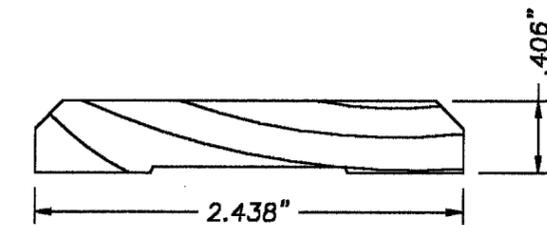


14 AC-6 INTERIOR MULL COVER
 CLEAR PINE

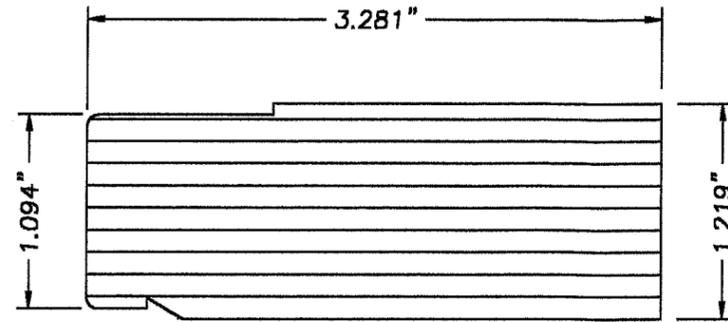


51 AC-151 HEAD WOOD FRAME RAD. TOP
 CLEAR LAM. PINE VEN.

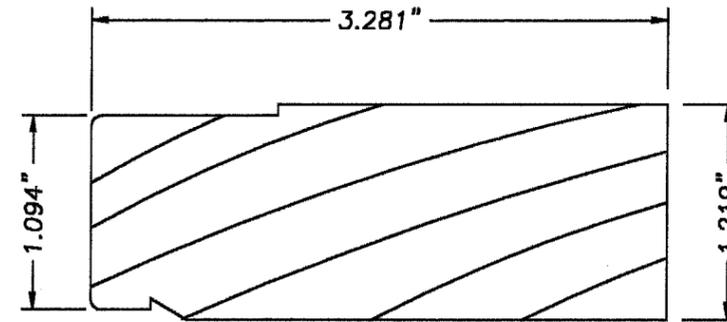


51A AC-151 SILL & SIDE WOOD FRAME RAD. TOP
 FINGER JOINTED PINE

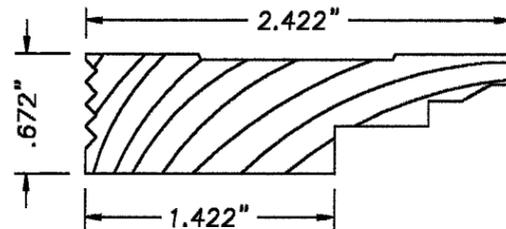


42 AC-147 SIDE & SILL GLASS STOP
 RAD. TOP, FINGER JOINTED PINE

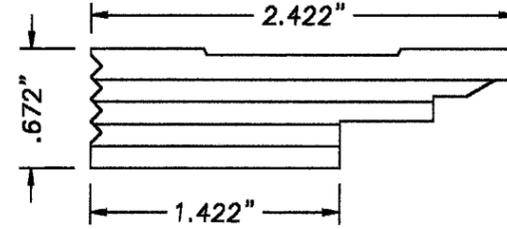


41 AC-147 HEAD GLASS STOP
 RAD. TOP, CLEAR LAM. PINE VEN.

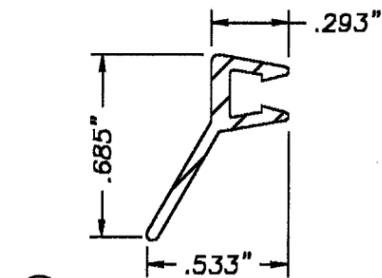

39 AC-65 ALUM. HORT. EXTERIOR
 MULL COVER, 6063-T5
 .072" WALL



24 AC-220 ALUM. VERT. EXTERIOR
 MULL COVER, 6063-T5
 .072" WALL

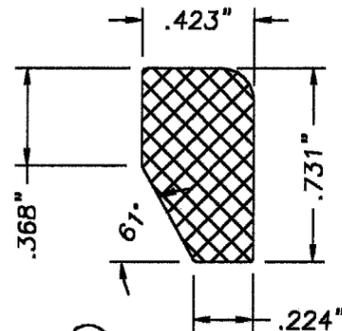

27 DC-209
 VINYL STAT. SETTING BLOCK

POZZI WINDOW COMPANY
 62845 BOYD ACRES RD.
 BEND, OREGON 97701
 PH. 541.382.4411

PRODUCT: POZZI ALUMINUM CLAD WOOD
 MULLED CASEMENT WINDOWS
 W/HALF CIRCLE TRANSOM
 PART OR ASSEMBLY:
 UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
2	06/19/01	GENERAL REVISION & CHANGE	TJH
1	01/11/99	GENERAL REVISION	-

RW BUILDING
 CONSULTANTS, INC.
 813.684.3831

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE **AUG 30 2001**
 BY *Manuel Serrano*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0862.03

DATE: 11/12/98
 SCALE: N.T.S.
 DWG. BY: C.A.B.
 CHK. BY:
 DRAWING NO.:
 CC-1.5
 SHEET 7 OF 7