



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**MBCI-Metals Building Components, Inc  
14031 West Hardy  
Houston, TX 770606**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by the BCCO and accepted by the Building Code and Product Review Committee to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The BCCO (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BCCO reserves the right to revoke this acceptance, if it is determined by BCCO that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County or Florida Building Code.

**DESCRIPTION: 5V Crimp Panel**

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 6.

The submitted documentation was reviewed by Frank Zuloaga, RRC



**NOA No.: 01-0828.04  
Expiration Date: 02/26/2006  
Approval Date: 11/08/01  
Page 1 of 6**

## ROOFING ASSEMBLY APPROVAL:

**Category:** Roofing  
**Sub-Category:** Non-Structural Metal Roofing  
**Materials:** Steel  
**Fire Classification:** See General Limitations #1  
**Maximum Design Pressure:** -90 psf.

## TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
5V Crimp Roof Panel	Length : various Width:26 1/8" (Coverage width : 24") Thickness : 0.0217	PA 125	Corrosion resistant, galvalume, performed, standing seam, coated, pre- finished, metal panels.

## EVIDENCE SUBMITTED:

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Underwriters Laboratories, Inc.	File R8116 Project 97RT4520	Standard Requirements for Metal Roofing Systems Miami-Dade County PA-125	June 1997
Center for Applied Engineering, Inc.	MTS Job No. 257829	Wind Driven Rain Miami-Dade County PA-100	Oct. 1996



## SYSTEM DESCRIPTION

**SYSTEM A-1S:** "5V-Crimp" 26 Ga. Metal Panel

**Deck Type:** Wood, Non-insulated

**Deck Description:**  $1^{9/32}$ " or greater plywood or wood plank.

**Slope Range:** 2":12" or greater

**Maximum Uplift Pressure:** The maximum allowable design pressure for the 24" wide panel shall be **-90 psf.**

**Deck Attachment:** In accordance with applicable Building Code, but in no case it shall be less than # 6 x 2" screws or 8d common annular ring shank nails spaced at 6" o. c. In re-roofing, where deck is less than  $1^{9/32}$ " thick (minimum  $1^{5/32}$ ") the above attachment method must be in addition to existing attachment.

**Underlayment:** Minimum underlayment shall be a ASTM D 226 Type II installed with a minimum 4" side-laps and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and  $1^{1/4}$ " annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll.

**Valleys:** Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with MBCI's current published installation instructions.

**Fire Barrier Board:** For class A or B fire rating, install minimum  $1/4$ " thick Georgia Pacific "Dens Deck" (with current NOA) or minimum 4mm thick of Tritex, RockRoof (with current NOA) or  $5/8$ " water resistant type X gypsum sheathing with treated core and facer.

**Metal Panels and Accessories:** Install the "5V-Crimp Panels" including flashings penetrations, valleys, and accessories in compliance MBCI's current, published installation instructions and in compliance with the minimum requirements detailed in Roofing Application Standard RAS 133.

MBCI's "5V-Crimp Panels" shall be installed with a minimum #14 S.D.S zinc coated sealing washer fastener of sufficient length (but not less than  $1^{1/2}$ ") to penetrate  $5/16$ " through the sheathing. #14 S.D.S zinc coated fastener shall be spaced at a maximum of 12" o.c. perpendicular to the slope, in rows spaced 36" o.c. running parallel to the slope of the roof.

#14 S.D.S zinc coated fastener shall be spaced a minimum of 4" o.c at the eaves and rakes, and at valleys, and sealed with triple-bead sealant tape. All perimeter attachment shall be in accordance with Roofing Application Standard RAS 111.





**GENERAL LIMITATIONS:**


1. Fire classification is not part of this acceptance, refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. The maximum uplift pressures listed herein should meet or exceed the design pressures for the field, areas of the roof as determined by applicable building code. Increased design pressures at perimeter and corner areas may be met through rational analysis by increasing the number of attachment points in these areas. All rational analysis computations shall be conducted signed and sealed by a Registered Architect, Professional Engineer, or Registered Roof Consultant.
3. All panels shall be permanently labeled with the manufacturer's name or logo, city, state and the following statement: "Miami Dade County Product Control Approved".




# 5V-Crimp Panel

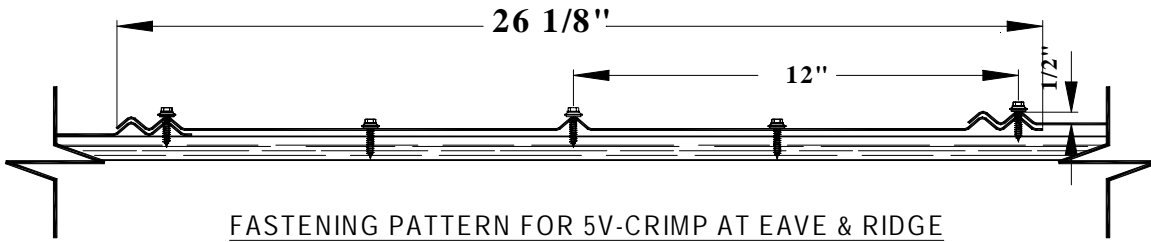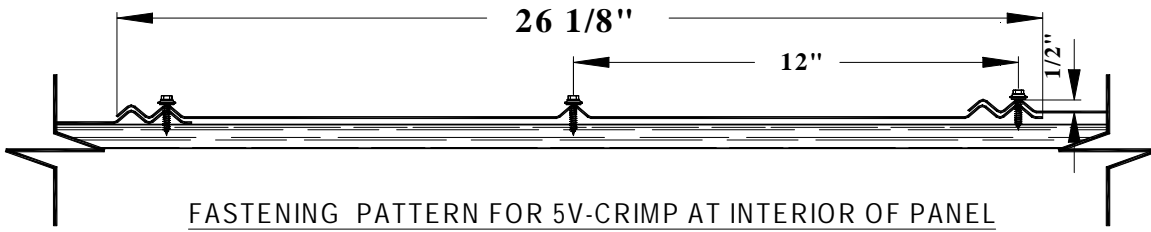


## 5V CRIMP CROSS SECTION

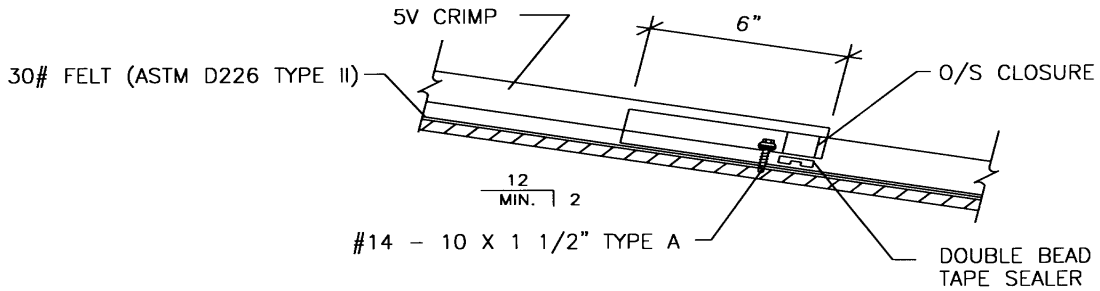

## TYPICAL DETAILS PANEL LAPS

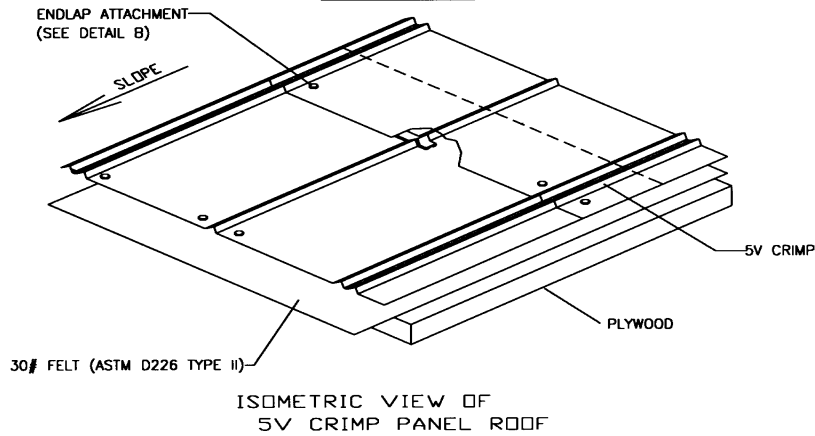

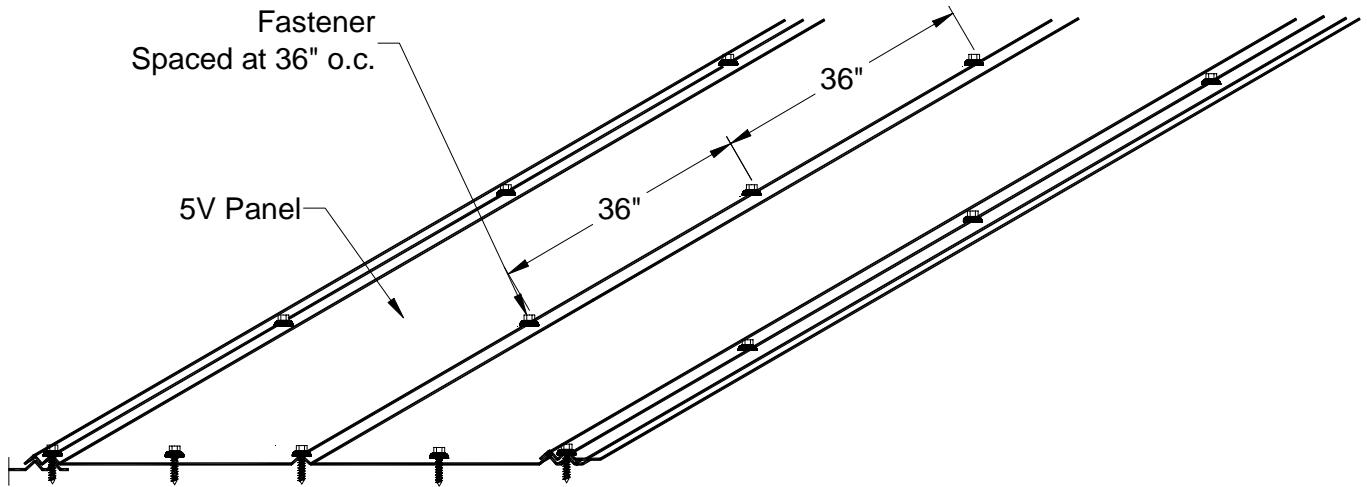

**END OF THIS ACCEPTANCE**



NOA No.: 01-0828.04  
Expiration Date: 02/26/2006  
Approval Date: 11/08/01  
Page 6 of 6