



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Therma-Tru Corp.  
1687 Woodlands Drive  
Maumee, OH 43537**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: "Construction Series" 6'8 Outswing Opaque Steel Door w & wo sidelites**

**APPROVAL DOCUMENT:** Drawing No. S-2110, titled "Construction Series" 6-8 Single & Double Out-swing Steel Door", sheets 1 through 8, prepared by RW Building Consultants, Inc., dated 03/28/01 with revision #1 dated 3/12/03, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P. E.**



**NOA No 01-0828.10  
Expiration Date: May 1, 2008  
Approval Date: May 1, 2003  
Page 1**

**Therma-Tru Corporation**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No **S-2110**, titled "Construction Series" 6-8 Single & Double Out-swing Steel Door", sheets 1 through 8, dated 6/12/02, with revision #1 dated 3/12/03, prepared by RW Building Consultants, Inc.

**B. TESTS**

1. Test reports on
  - 1) Air Infiltration Test, per SFBC, PA 202-94
  - 2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94
  - 3) Water Resistance Test, per SFBC, PA 202-94
  - 4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
  - 5) Large Missile Impact Test per SFBC, PA 201-94
  - 6) Cyclic Wind Pressure Loading per SFBC, PA 203-94

along with marked-up drawings and installation diagram of a double opaque door with sidelites, prepared by ETC Laboratories, Test Report No. **ETC-01-741-11004.0**, dated 7/6/01, signed and sealed by Joseph Dolden, P.E.

2. Test reports on
  - 1) Air Infiltration Test, per SFBC, PA 202-94
  - 2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94
  - 3) Water Resistance Test, per SFBC, PA 202-94
  - 4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94
  - 5) Large Missile Impact Test per SFBC, PA 201-94
  - 6) Cyclic Wind Pressure Loading per SFBC, PA 203-94


along with marked-up drawings and installation diagram of a double opaque door with sidelites, prepared by ETC Laboratories, Test Report No. **ETC-01-741-10622.0**, dated 3/23/01, signed and sealed by Joseph Dolden, P.E.

**C. CALCULATIONS**

1. Anchor Calculations and structural analysis, prepared by Lyndon Schmidt, P.E., dated 8/18/01, signed and sealed by Lyndon Schmidt, P.E.

**D. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **01-1120.08** issued to Therma-Tru Corporation for "Therma-Tru Series "BTS, TCM, PVC, SMC" Lite Frame" dated 1/18/02, expiring on 1/18/07.
2. Tensile Test of Constructon Series Steel Door Skin, prepared by ETC Laboratories, Test Report No. ETC-01-741-10622.0, dated 3/28/01, signed and sealed by Joseph Dolden, P.E., Tensile Test of Non Foam Plastic, prepared by ETC Laboratories, Test Report No. ETC-01-741-11075.0, dated 3/2/01, signed and sealed by Joseph Dolden, P.E., Surface Burning Characteristics of Building Materials, **ASTM E84-00a**, prepared by Omega Point Laboratories, Test Report No. 15427-107362, dated 8/28/00, signed and sealed by John Dougherty, P.E.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No 01-0828.10

Expiration Date: May 1, 2008

Approval Date: May 1, 2003

**Therma-Tru Corporation**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**E. STATEMENTS**

1. Statement letter of conformance, dated 8/23/01, signed and sealed by Lyndon Schmidt, P.E.
2. Statement letter of no financial interest, dated 8/18/01, signed and sealed by Lyndon Schmidt, P.E.
3. Statement letter naming Mr. Rick Wright as their representative and contact person, signed by Steve Kepler

**F. OTHER**

1. Letter for San Martin Associates, Inc.

  
Manuel Perez, P. E.  
Product Control Examiner

NOA No 01-0828.10

Expiration Date: May 1, 2008

Approval Date: May 1, 2003

# THERMA-TRU®

"CONSTRUCTION SERIES" OUTSWING 6-8 SINGLE AND DOUBLE W& W/OUT SIDELITES. INSULATED STEEL DOOR WITH WOOD FRAMES.

### GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS PRODUCT MEETS THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES" AREA WITH THE USE OF THE HIGH DAM BUMP THRESHOLD.
6. WHEN THIS PRODUCT IS USED IN AREAS REQUIRING WINDBORNE DEBRIS PROTECTION, FLORIDA BUILDING CODE APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED FOR THE SIDELITES ONLY.
7. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

### INSULATED STEEL DOOR

(Common to all frame conditions)

#### Door & Sidelite Panel Construction:



**Face sheets:** Door Panel is 25 ga.(0.018") minimum thickness  
Sidelite Panel face sheets are 24 ga.(0.021") minimum thickness  
Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength  $F_y(\text{min.})=27,830$  psi

**Core design:** Polyurethane foam core, with 1.9 lbs. density by BASF.

**Door Panel Construction:** Flush or embossed type. The vertical edges of the skin, rolled formed to provide a mechanical interlock with finger jointed pine stiles. Wood end rails are butt jointed and pressure fitted with contact cement to the wood stiles at the corners.

**Sidelite Panel Construction and Glazing:** The vertical edges of the skin are rolled formed to provide a mechanical interlock with finger jointed pine stiles. The end rails are butt jointed to the wood stiles at the corners. The sidelite panels are sandwich glazed using a two piece lite frame.

**Frame Construction:** The frame is constructed from finger jointed Ponderosa Pine measuring 4.656" wide x 1.25" thick. The header is joined to the side jambs with (3) 16ga. 1/2" crown x 2" long staples at each side. The threshold is joined to the side jambs with (2) 16ga. 1/2" crown x 2.5" long staples at each side. The mullions are secured together in a sidelite application using #8 x 2 1/2" long PFH Wood Screws (6) screws per each mullion. The unit uses an Outswing Bumpface threshold, either Low Profile or High Water Dam.

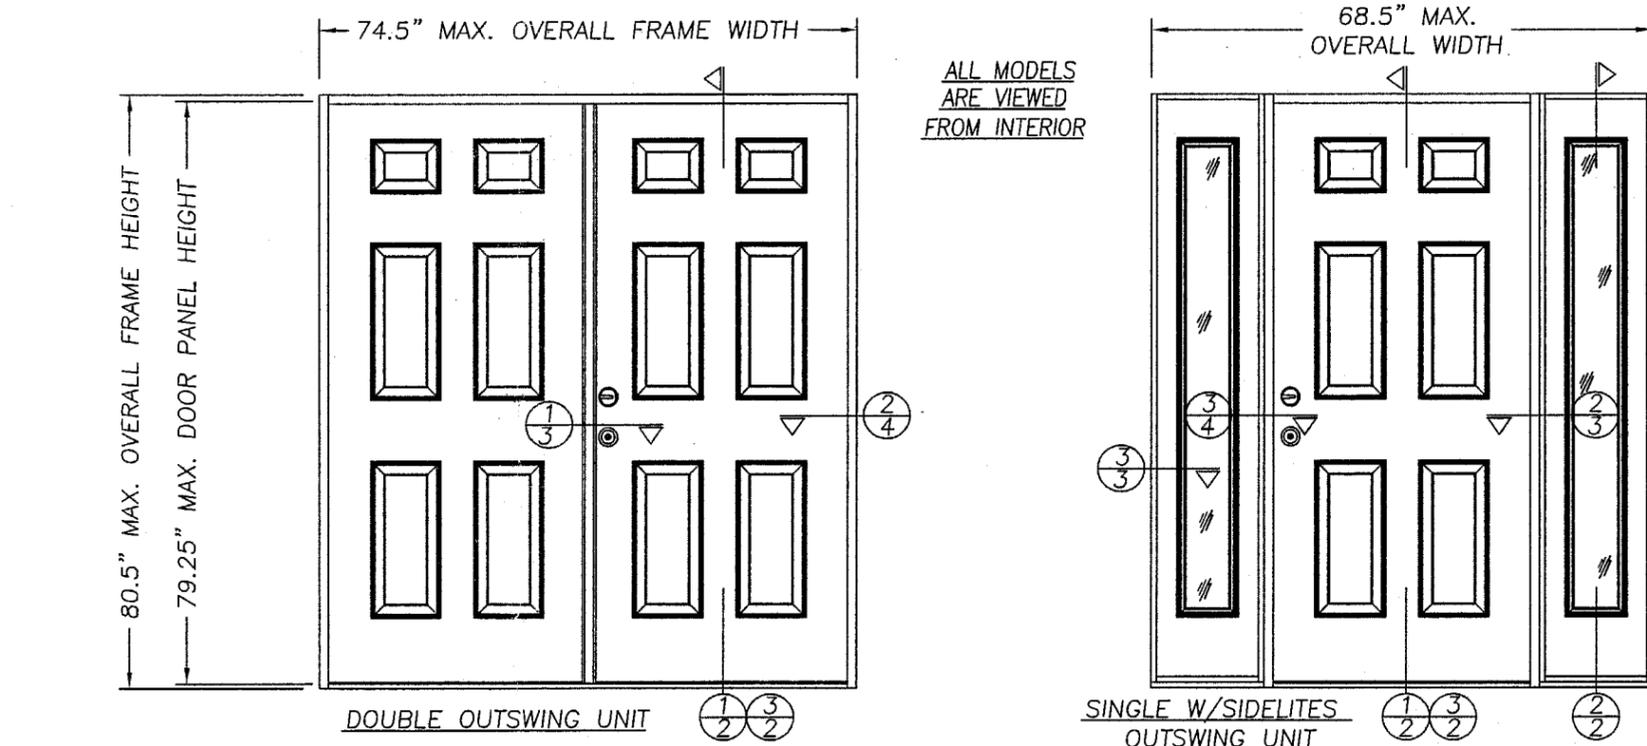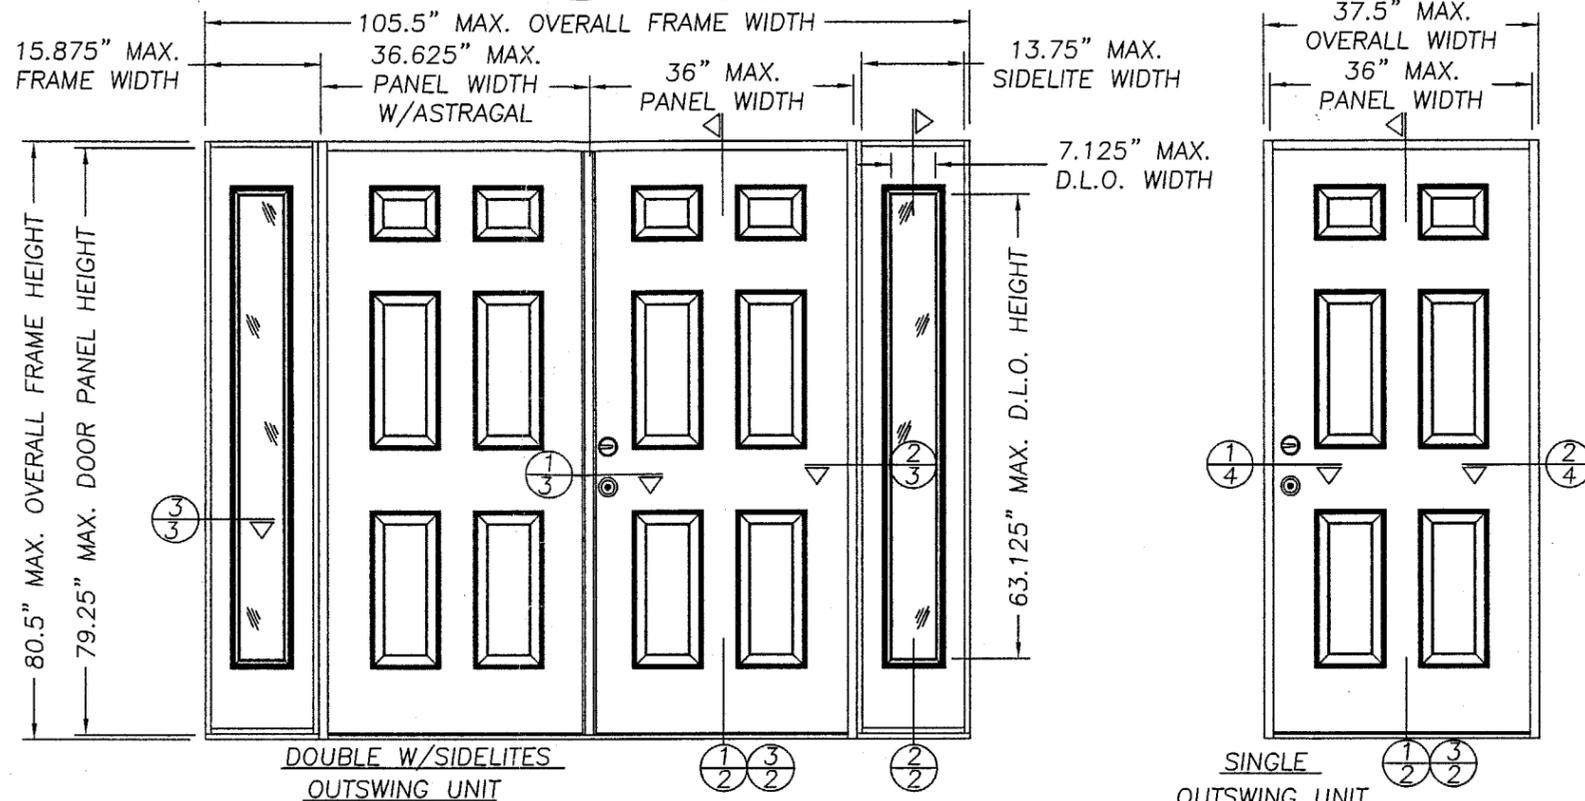

ALL MODELS ARE VIEWED FROM INTERIOR

TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	VERTICAL CROSS SECTIONS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS & NOTES
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & GLAZING DETAILS
7	UNIT COMPONENTS
8	BILL OF MATERIALS & UNIT COMPONENTS

DESIGN PRESSURE RATING		
UNIT TYPE	W/ HIGH DAM THRESHOLD	W/ LOW PROFILE THRESHOLD
SINGLE	+ 67.0 PSF - 67.0 PSF	+ 55.0 PSF - 67.0 PSF
SINGLE W/SIDELITES	+ 60.0 PSF - 60.0 PSF	+ 55.0 PSF - 60.0 PSF
DOUBLE	+ 60.0 PSF - 60.0 PSF	NOT APPROVED
DOUBLE W/SIDELITES	+ 60.0 PSF - 60.0 PSF	NOT APPROVED

DATE: 03/28/01  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2110  
SHEET 1 OF 8


Approved as complying with the Florida Building Code  
Date MAY 1, 2003  
NOA# 01-0828-10  
Miami Dade Product Control Division  
By *W. J. ...*

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO 43537  
PHONE 800.537.8827


PRODUCT: "CONSTRUCTION SERIES" 6-8 SINGLE & DOUBLE OUT-SWING STEEL DOOR  
PART OR ASSEMBLY:  
TYPICAL ELEVATIONS & GENERAL NOTES

NO.	DATE	GENERAL REVISION	BY
1	3/12/03		RW


RW BUILDING CONSULTANTS, INC.  
813.659.9197

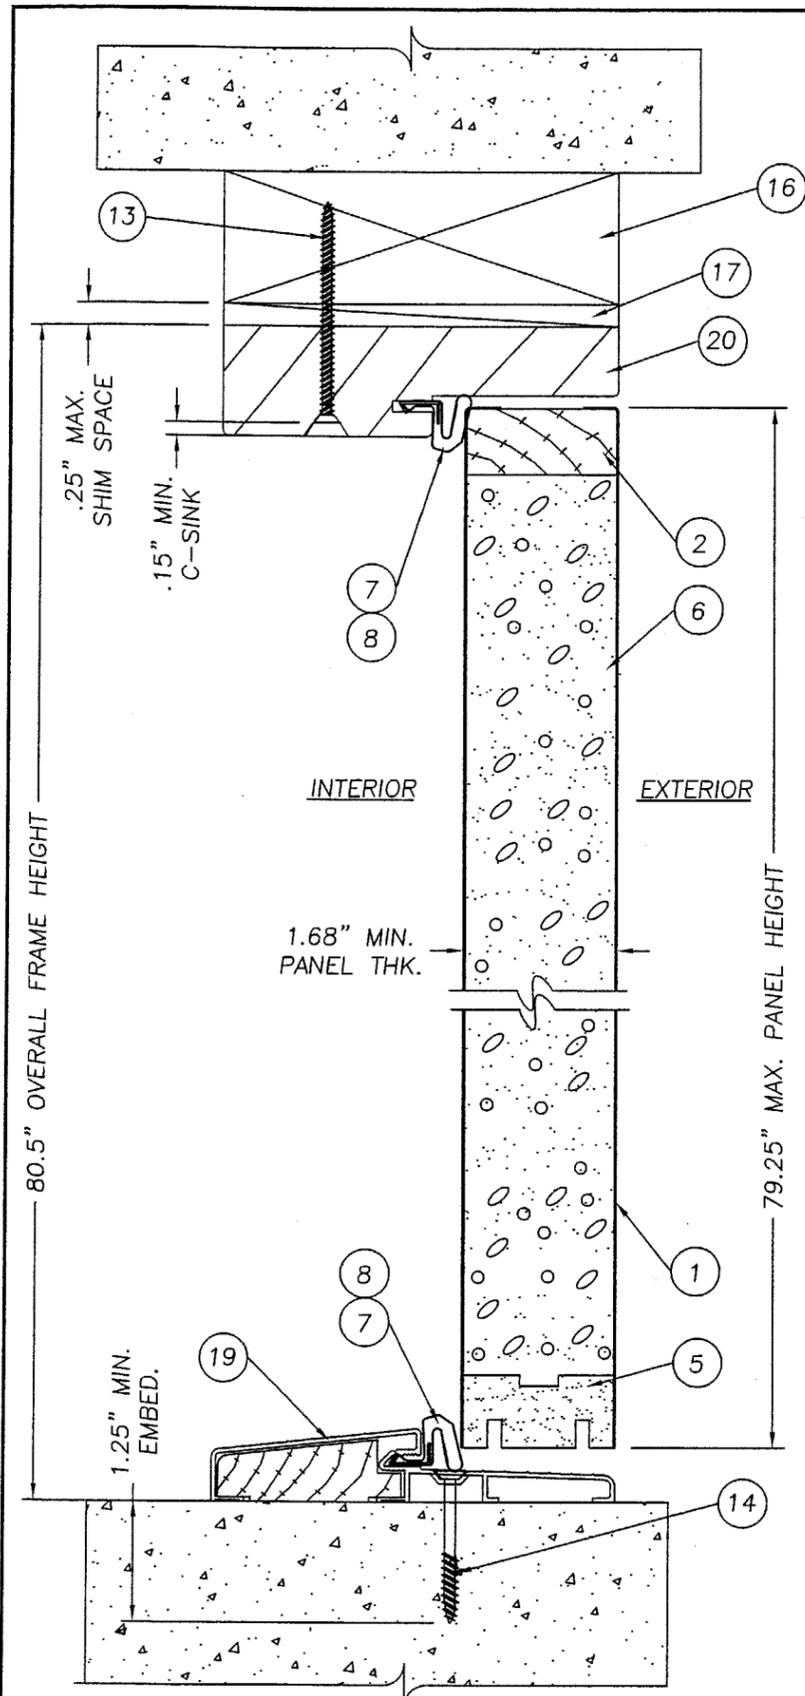

1 VERTICAL CROSS SECTION  
2 DOOR PANEL W/ LOW PROFILE THRESHOLD  
(SEE DESIGN PRESSURE TABLE SHEET 1)

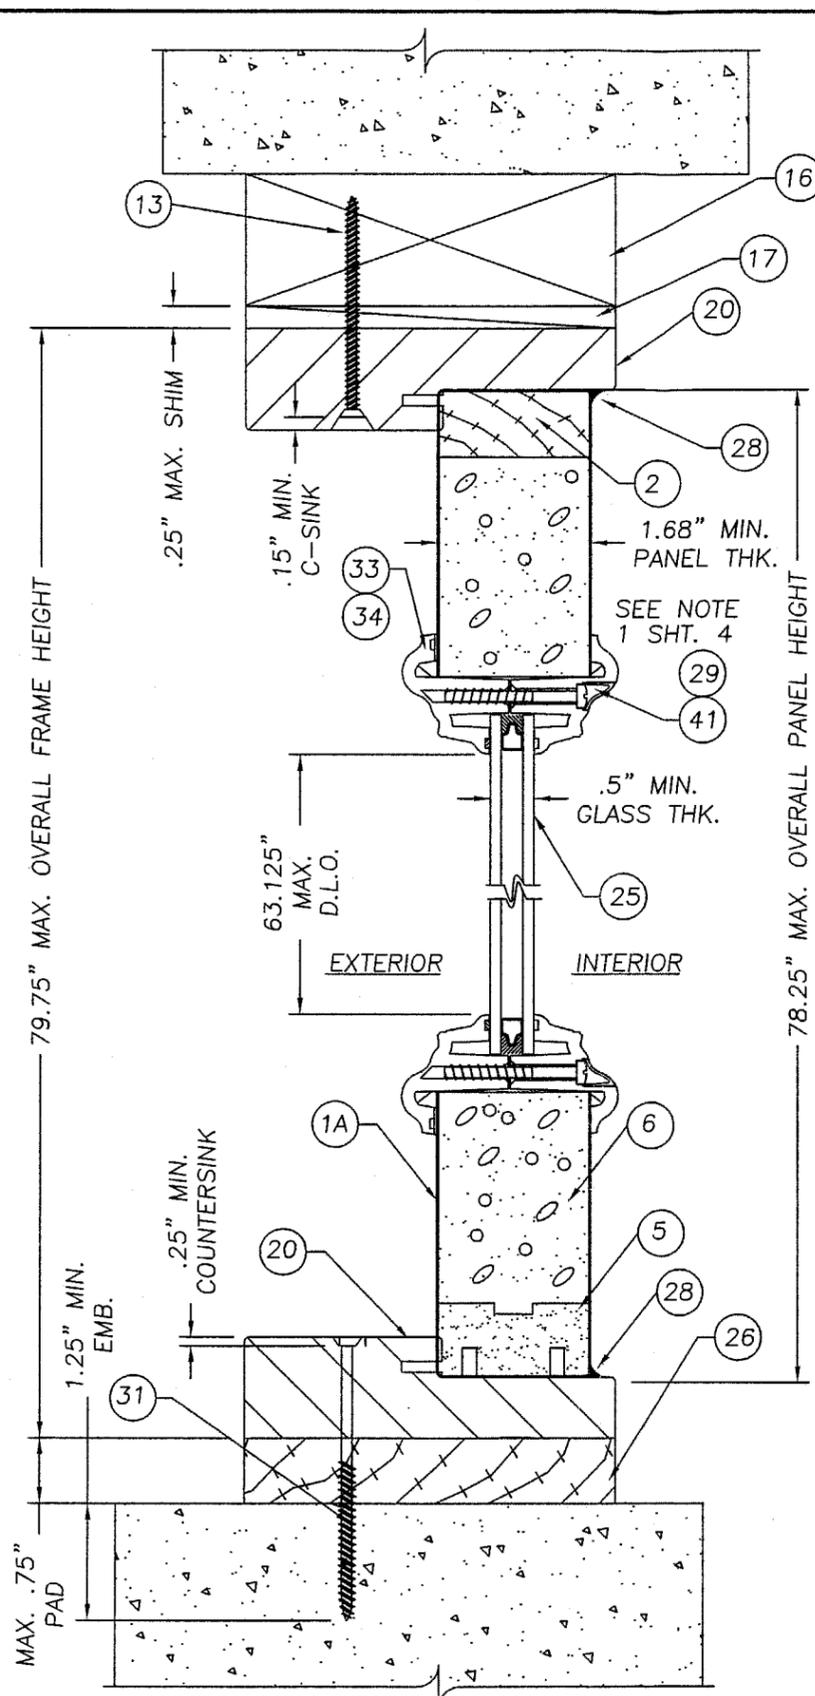

2 VERTICAL CROSS SECTION  
2 SIDELITE PANEL

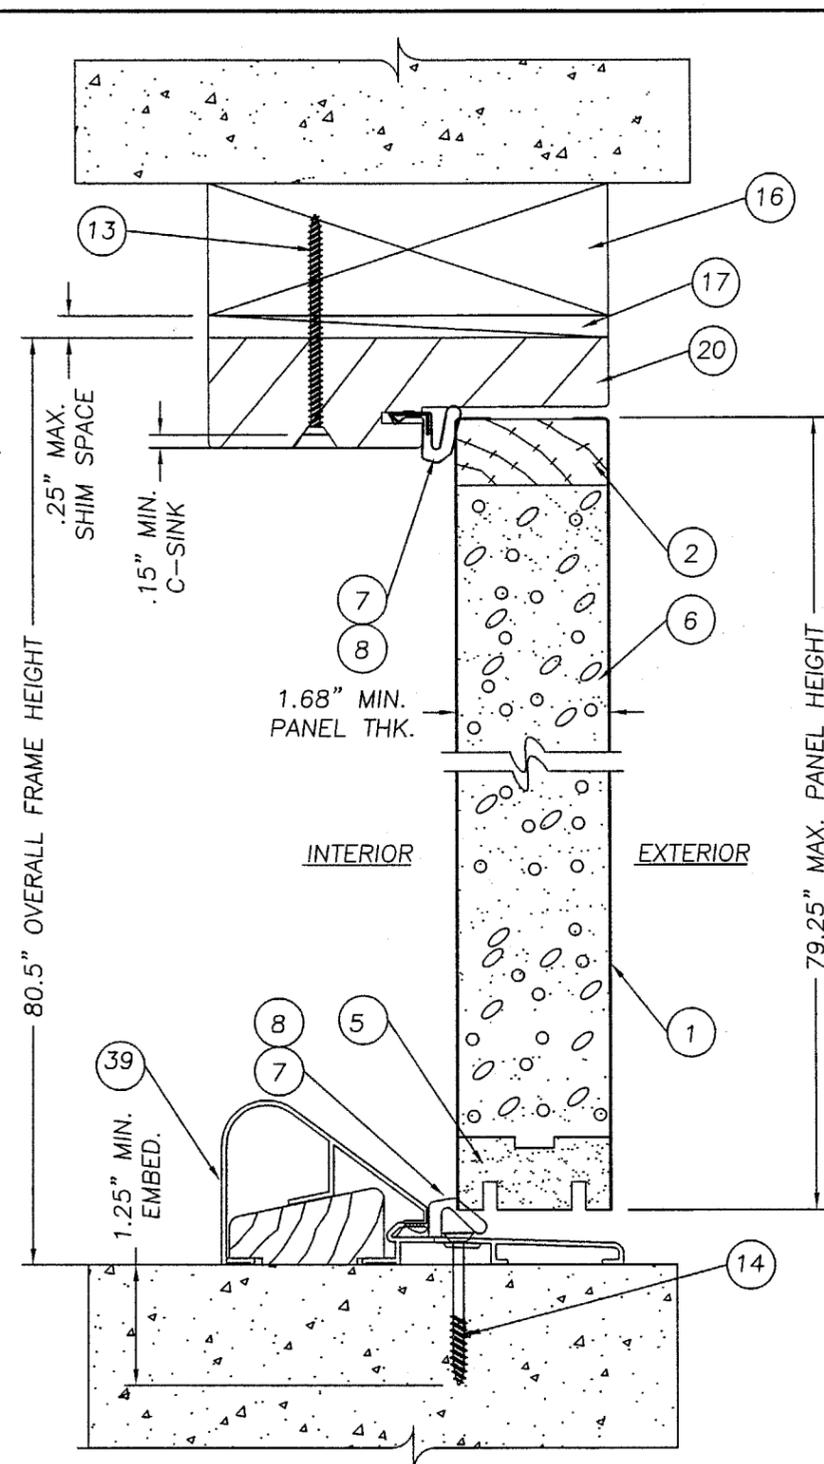

3 VERTICAL CROSS SECTION  
2 DOOR PANEL W/ HIGH DAM  
(SEE DESIGN PRESSURE TABLE SHEET 1)

Approved as complying with the  
Florida Building Code  
Date MAY 1, 2003  
NOA# 01-0828-10  
Miami Dade Product Control  
Division  
By Manuel Perez

**THERMA-TRU CORPORATION**  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO 43537  
PHONE 800.537.8827


PRODUCT: "CONSTRUCTION SERIES"  
6-8 SINGLE & DOUBLE  
OUT-SWING STEEL DOOR

PART OR ASSEMBLY:  
VERTICAL CROSS  
SECTIONS


NO.	DATE	REVISIONS	BY
1	3/12/03	GENERAL REVISION	RW

**RW** BUILDING  
CONSULTANTS, INC.  
813.659.9197


DATE: 03/28/01  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2110  
SHEET 2 OF 8

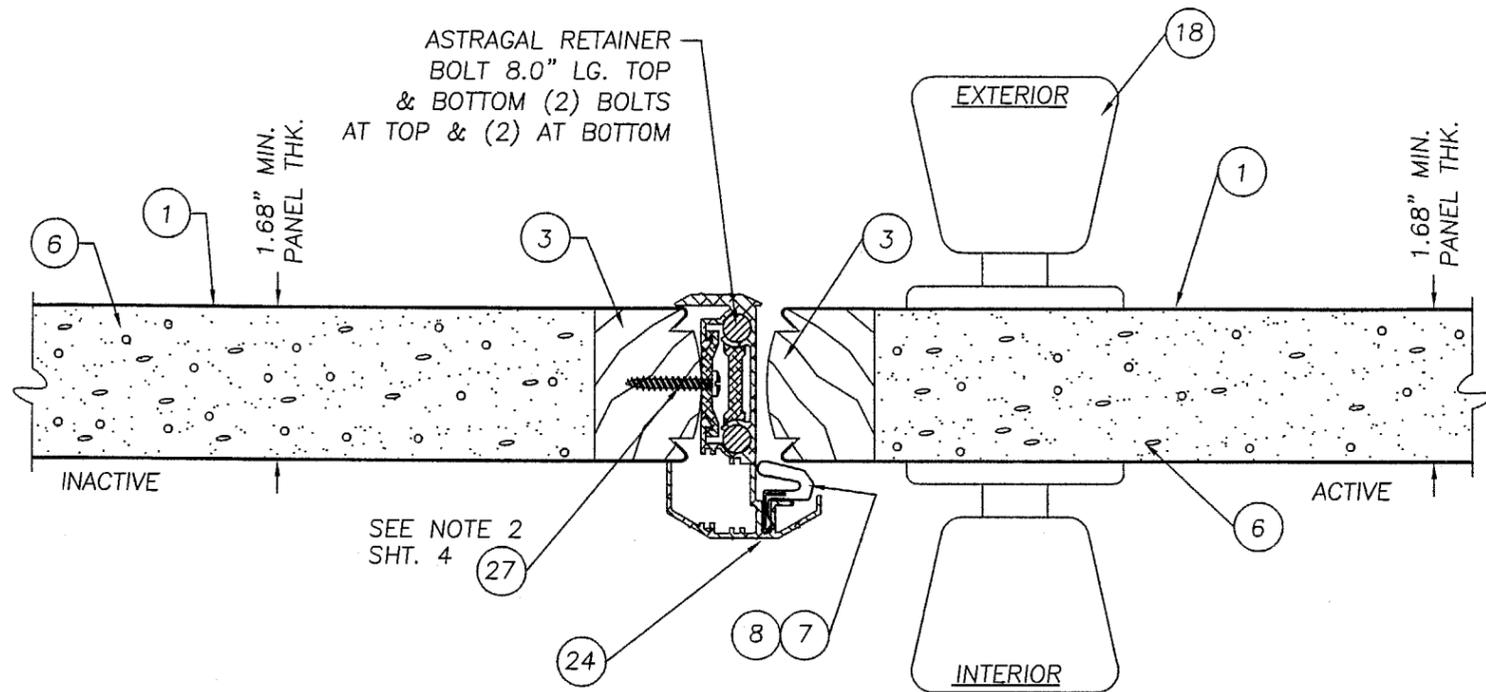

1 HORIZONTAL CROSS SECTION  
3 @ ASTRAGAL

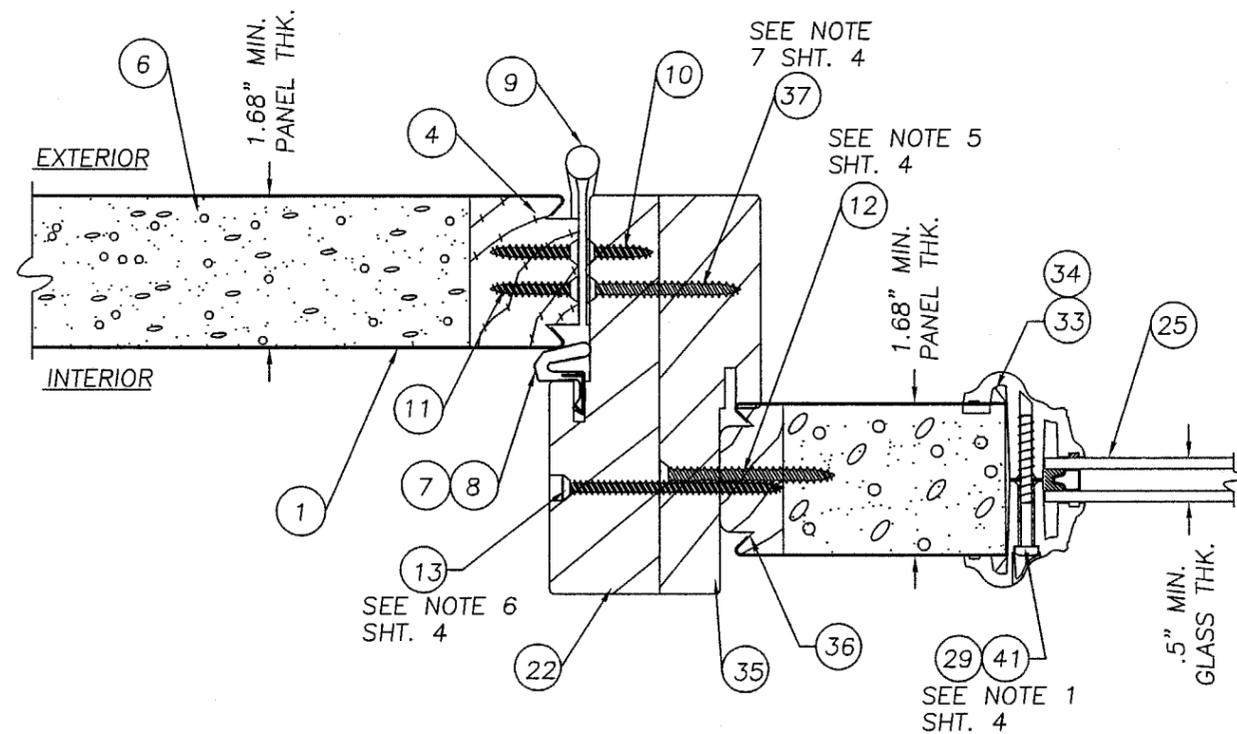

2 HORIZONTAL CROSS SECTION  
3 @ HINGE JAMB TO SIDELITE

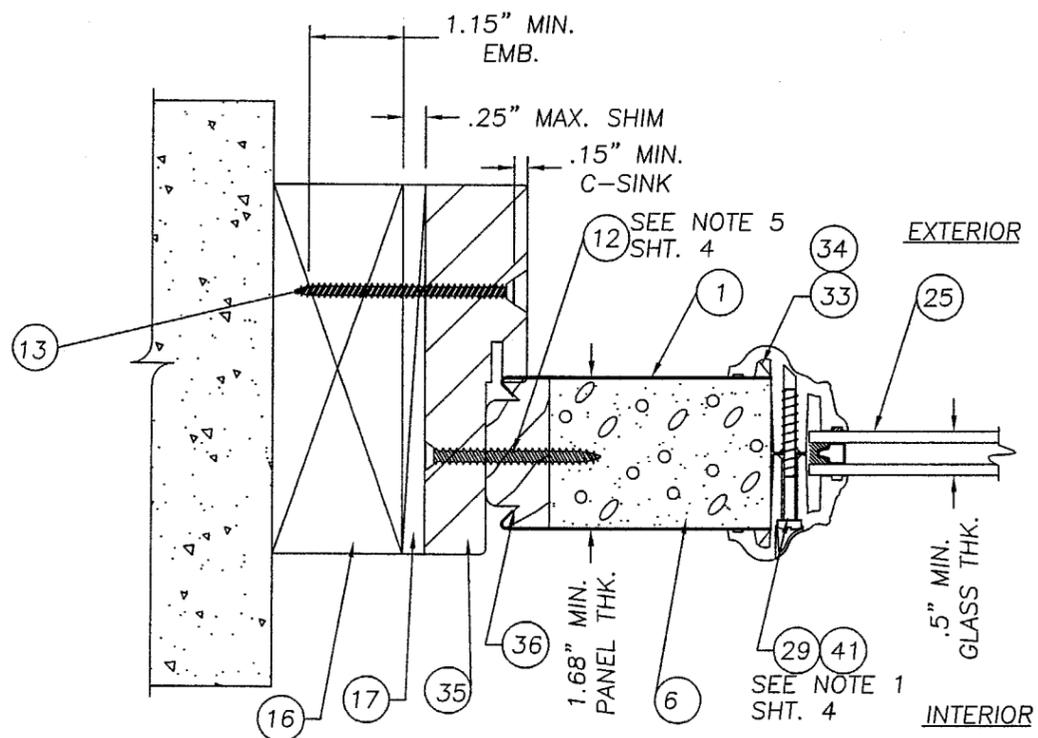

3 HORIZONTAL CROSS SECTION  
3 @ SIDELITE TO BUCK

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO 43537  
PHONE 800.537.8827


PRODUCT: "CONSTRUCTION SERIES"  
6-8 SINGLE & DOUBLE  
OUT-SWING STEEL DOOR  
PART OR ASSEMBLY:  
HORIZONTAL  
CROSS SECTIONS

NO.	DATE	GENERAL REVISION	RW	BY
1	3/12/03			


RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

DATE: 03/28/01  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2110  
SHEET 3 OF 8


Approved as complying with the  
Florida Building Code  
Date MAY 1 2003  
NOA# 01-0828.10  
Miami Dade Product Control  
Division  
By *[Signature]*

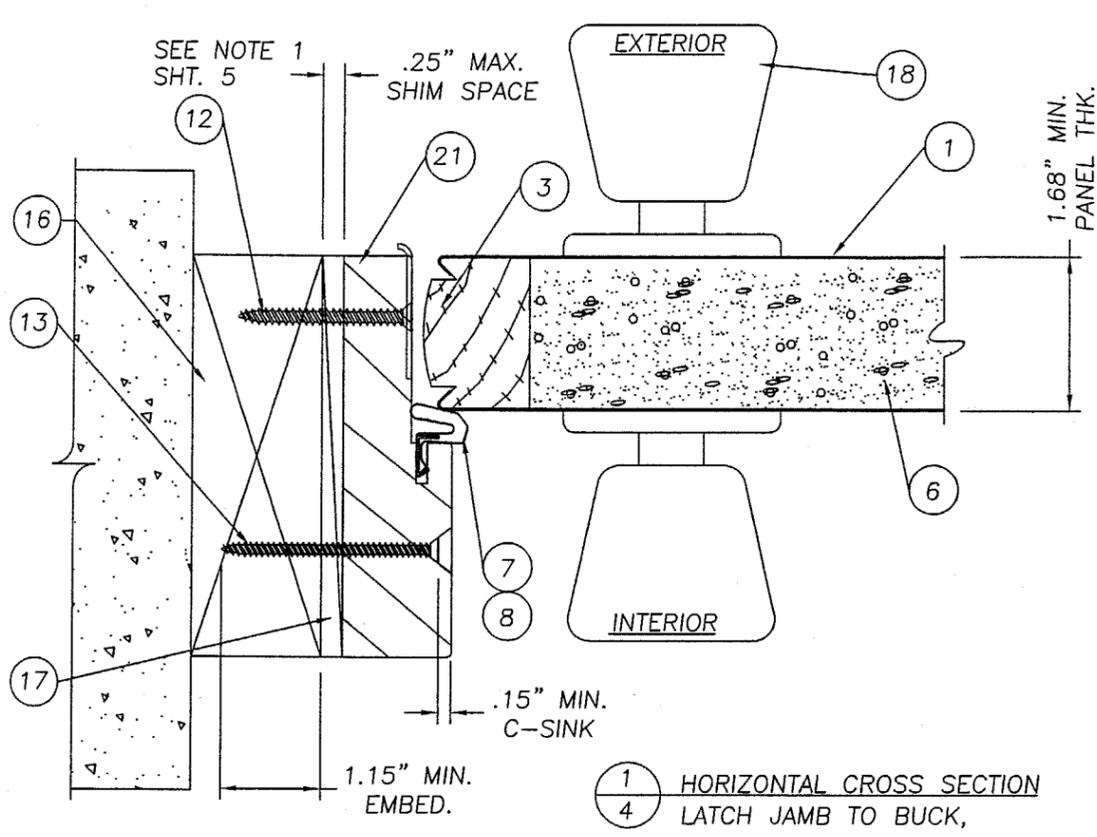

1  
4 HORIZONTAL CROSS SECTION  
LATCH JAMB TO BUCK,

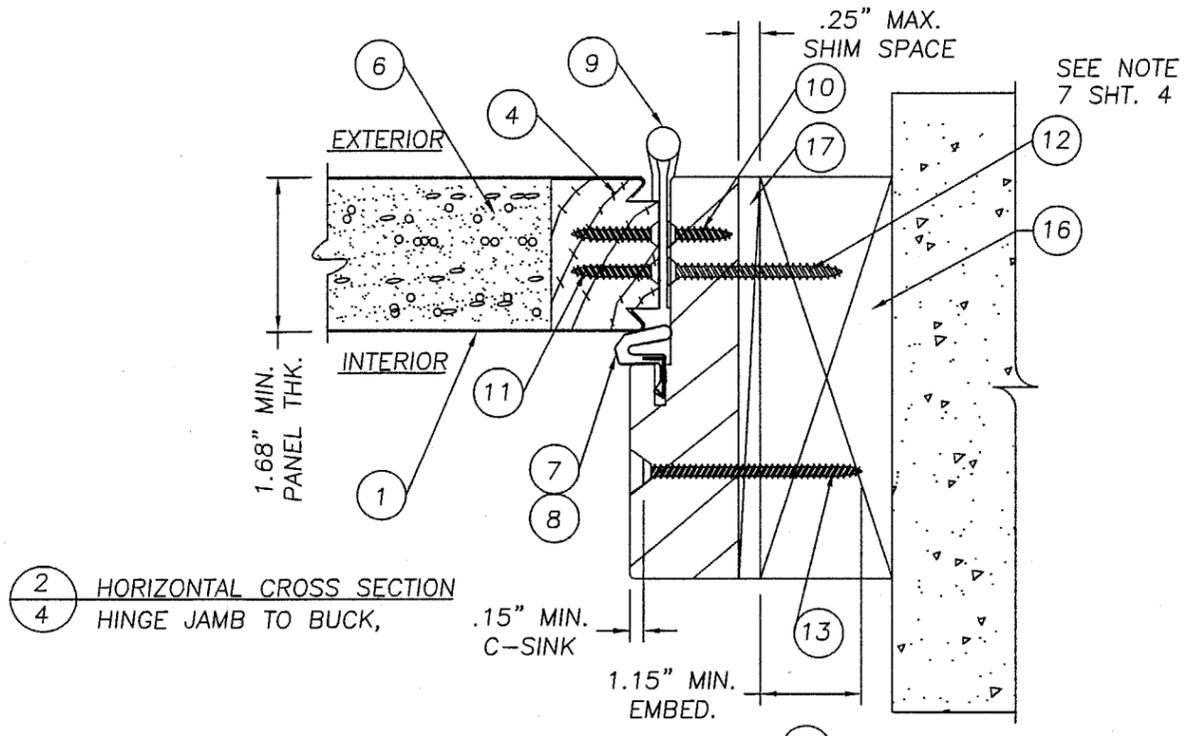

2  
4 HORIZONTAL CROSS SECTION  
HINGE JAMB TO BUCK,

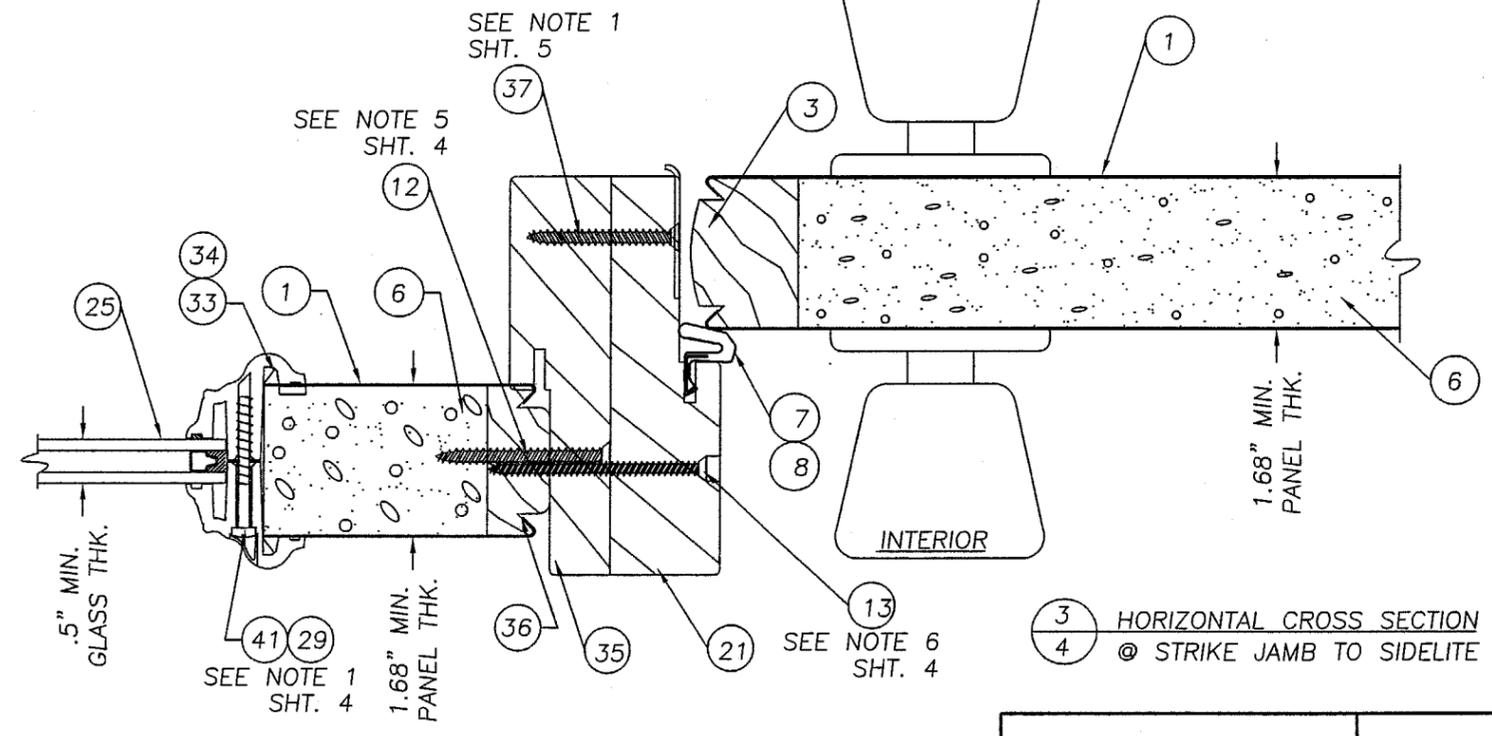

3  
4 HORIZONTAL CROSS SECTION  
@ STRIKE JAMB TO SIDELITE

NOTES:

1. SPACING FOR ITEM #29 & #41 (LITE FRAME SCREWS) IS AS FOLLOWS: FROM THE TOP DOWN ON SIDES; 3", 14.75", 26.5", 38.25", 50.5" & 62.25". THERE IS (1) SCREW BOTH TOP AND BOTTOM AT 4.25" IN FROM CORNER.
2. SPACING FOR ITEM #27 #8 x 1" PANHEAD SCREW ATTACHING THE ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FROM THE TOP DOWN 1", 3", 5", 18.25", 40.5", 59.25", 74.25", 76.25" AND 78.25".
3. THE HEAD JAMB IS ATTACHED TO THE SIDE JAMBS WITH (3) 16GA. x 1/2" CROWN x 2" STAPLES AT BOTH SIDE.
4. THE THRESHOLD IS ATTACHED TO THE SIDE JAMBS WITH (2) 16GA. x 1/2" CROWN x 2.5" STAPLES AT BOTH SIDE.
5. THE SIDELITE IS DIRECT SET INTO THE JAMB WITH ITEM #12 #10 x 2" PH.F.H. WOOD SCREW AT 6" DOWN FROM EACH CORNER AND A MAX. OF 12" O.C. ON THE SIDE JAMBS ONLY.
6. SPACING FOR ITEM #13, A #8 x 2 1/2" SCREW SECURING THE MULLIONS TOGETHER IS THE SAME AS THE PERIMETER ANCHORING SCREWS. 6" DOWN FROM THE TOP AND UP FROM THE BOTTOM WITH (4) MORE SPACED AT 13.7" O.C.
7. WHEN ATTACHING THE HINGE TO THE JAMB AND THE BUCK USE ITEM #12 A #10 x 2" SCREW. WHEN ATTACHING THE HINGE TO THE JAMB AND THE SIDELITE AT THE MULLION USE ITEM #37 A #10 x 1 3/4" SCREW.

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO 43537  
PHONE 800.537.8827





PRODUCT:  
"CONSTRUCTION SERIES"  
6-8 SINGLE & DOUBLE  
OUT-SWING STEEL DOOR  
PART OR ASSEMBLY:  
HORIZONTAL CROSS  
SECTIONS & NOTES

NO	DATE	REVISIONS	BY
1	3/12/03	GENERAL REVISION	RW

RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

DATE: 03/28/01  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2110  
SHEET 4 OF 8

Approved as complying with the  
Florida Building Code  
Date MAY 1, 2003  
NOA# 01-082810  
Miami Dade Product Control  
Division  
By Manuel Perez

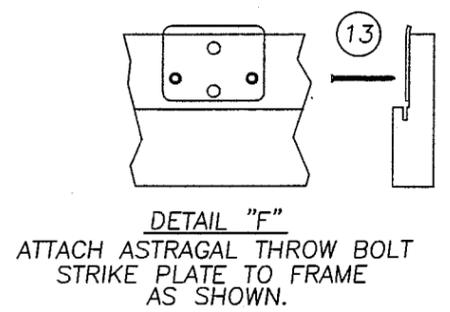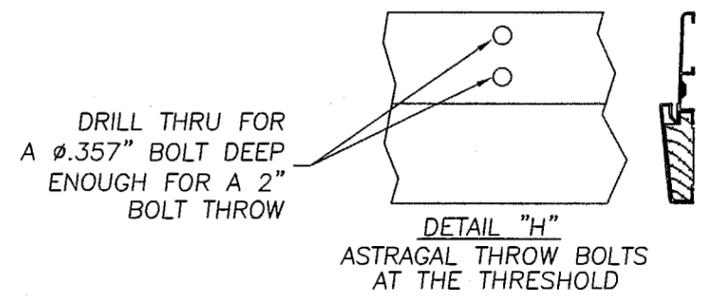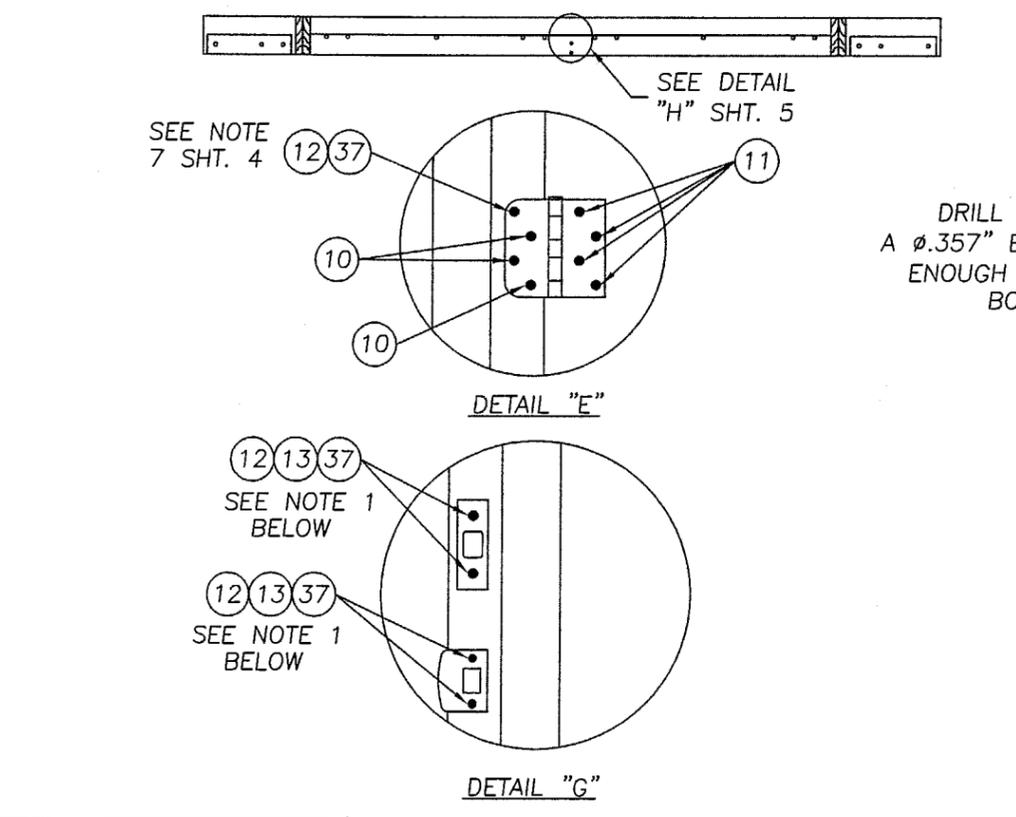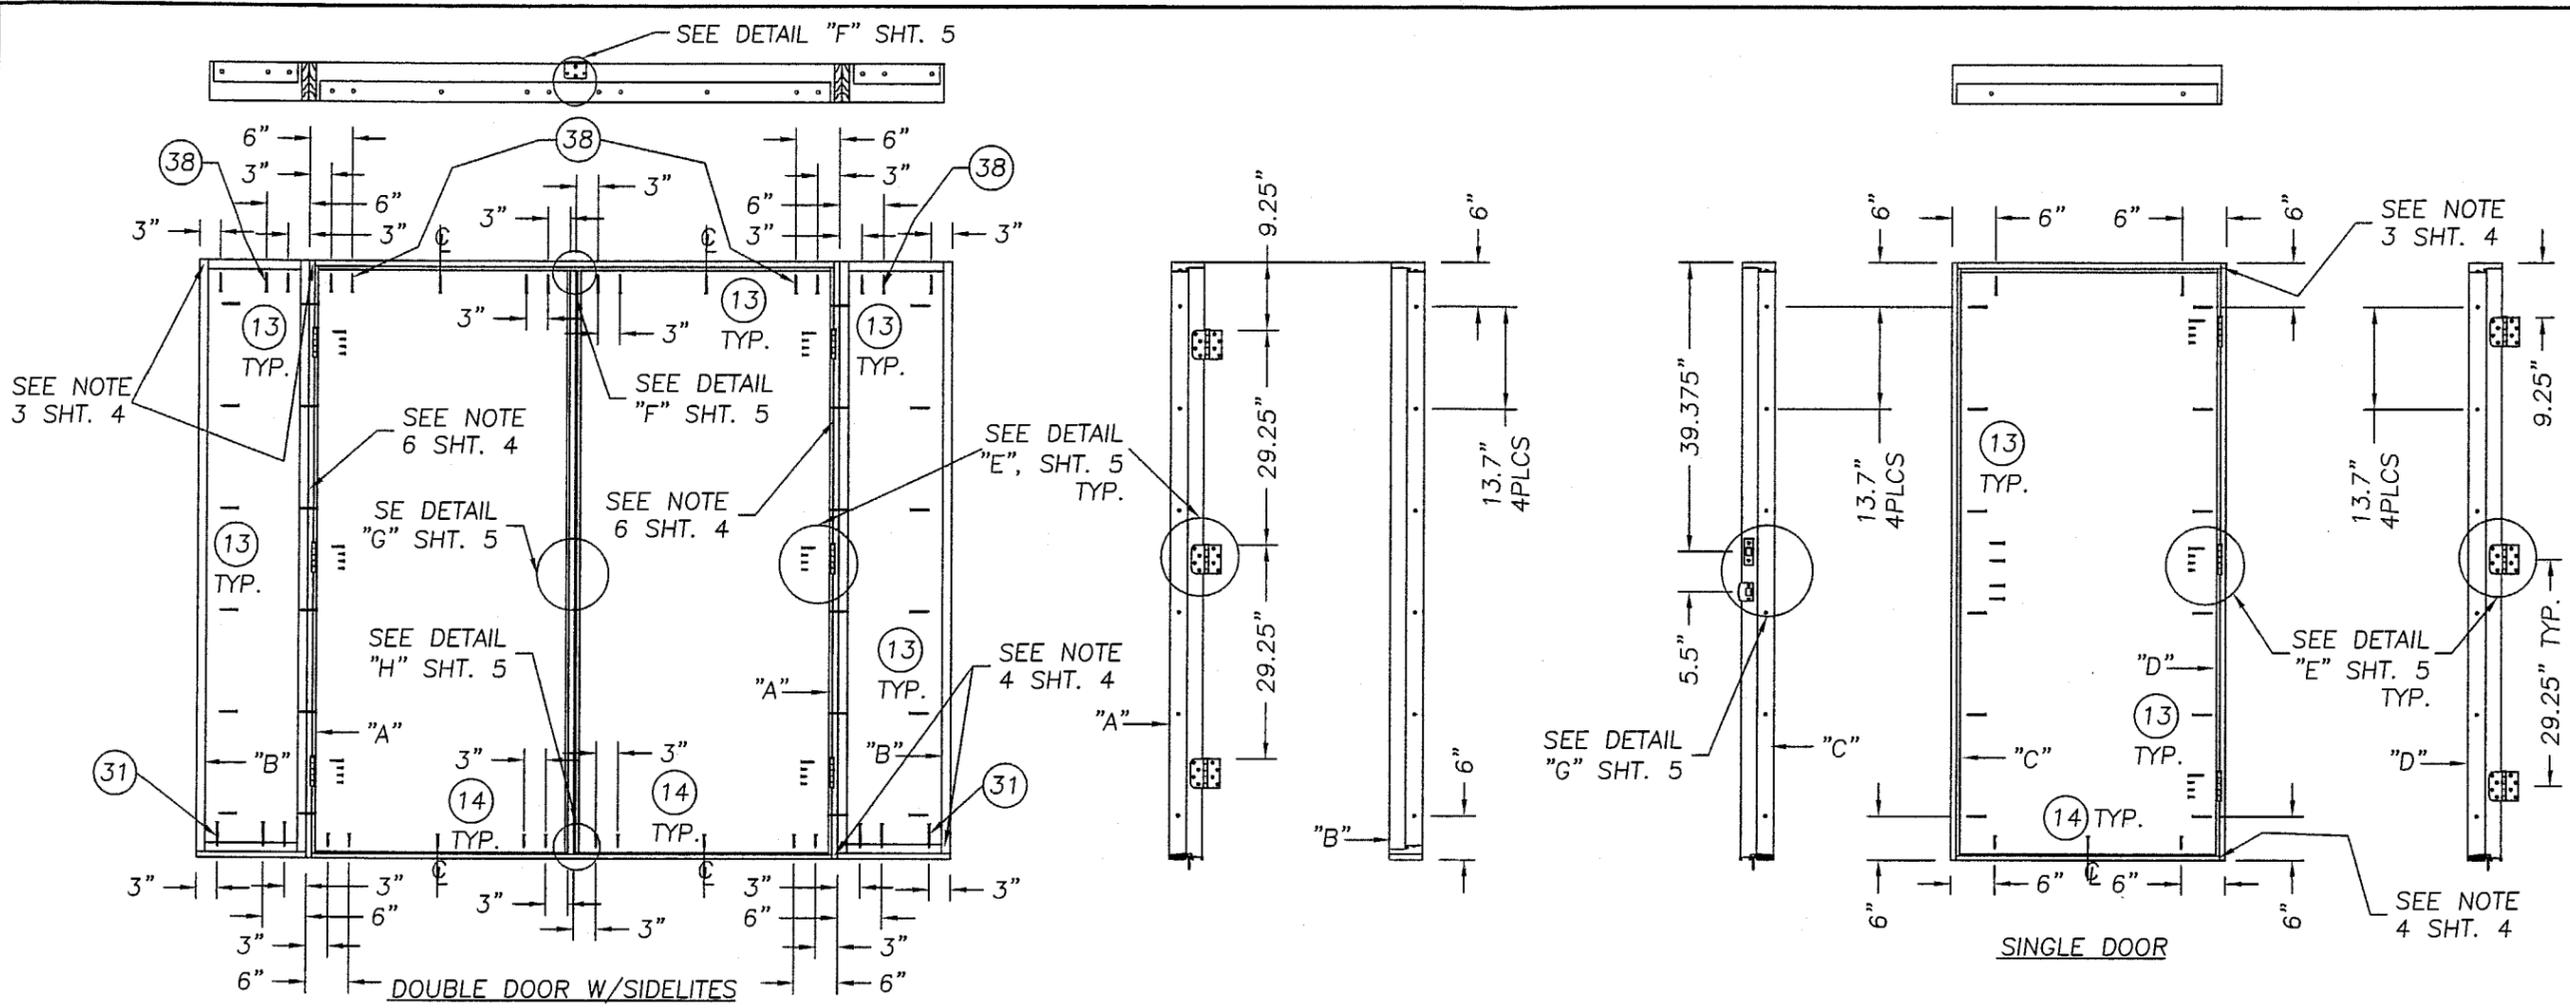

NOTE:  
 1. WHEN ATTACHING THE STRIKE & DEADBOLT PLATES TO THE STRIKE JAMB AND BUCK USE A #10 x 2" SCREW. WHEN ATTACHING THE STRIKE & DEADBOLT PLATES TO THE ASTRAGAL USE A #8 x 2 1/2" SCREW. WHEN ATTACHING THE STRIKE & DEADBOLT PLATES TO THE STRIKE JAMB AND SIDELITE JAMB USE A #10 x 1 3/4" SCREW.

**THERMA-TRU CORPORATION**  
 1687 WOODLANDS DRIVE  
 MAUMEE, OHIO 43537  
 PHONE 800.537.8827




PRODUCT: "CONSTRUCTION SERIES"  
 6-8 SINGLE & DOUBLE  
 OUT-SWING STEEL DOOR  
 PART OR ASSEMBLY:  
 ANCHORING LOCATIONS  
 & DETAILS

NO.	DATE	REVISIONS	RW	BY
1	3/12/03	GENERAL REVISION		

**RW** BUILDING  
 CONSULTANTS, INC.  
 813.659.9197

DATE: 03/28/01  
 SCALE: N.T.S.  
 DWG. BY: TJH  
 CHK. BY: RW  
 DRAWING NO.: S-2110  
 SHEET 5 OF 8

Approved as complying with the  
 Florida Building Code  
 Date MAY 1 2003  
 NOA# 01-0828-10  
 Miami Dade Product Control  
 Division  
 By *[Signature]*

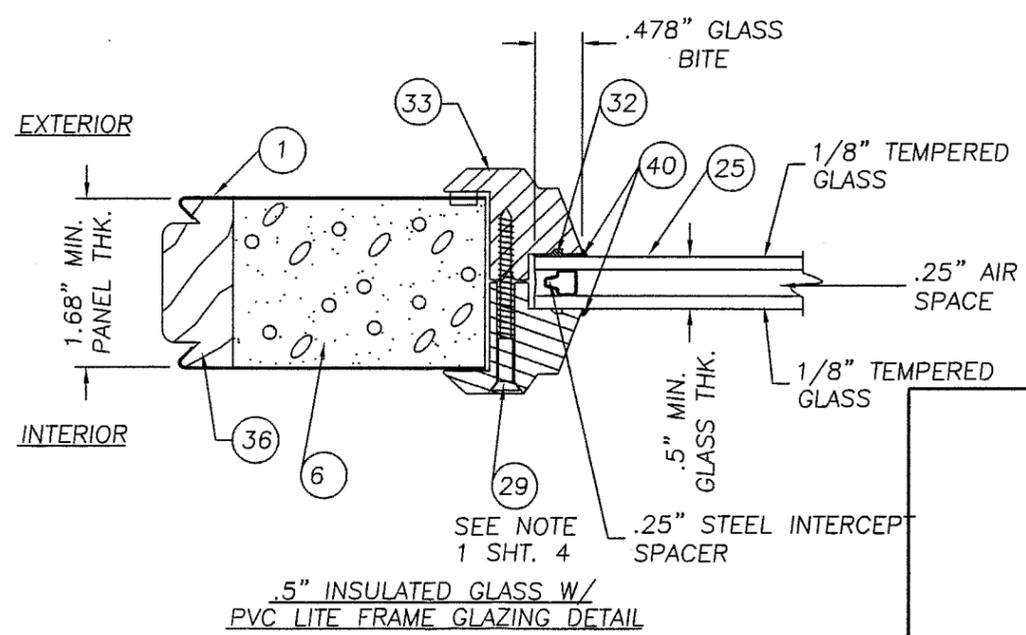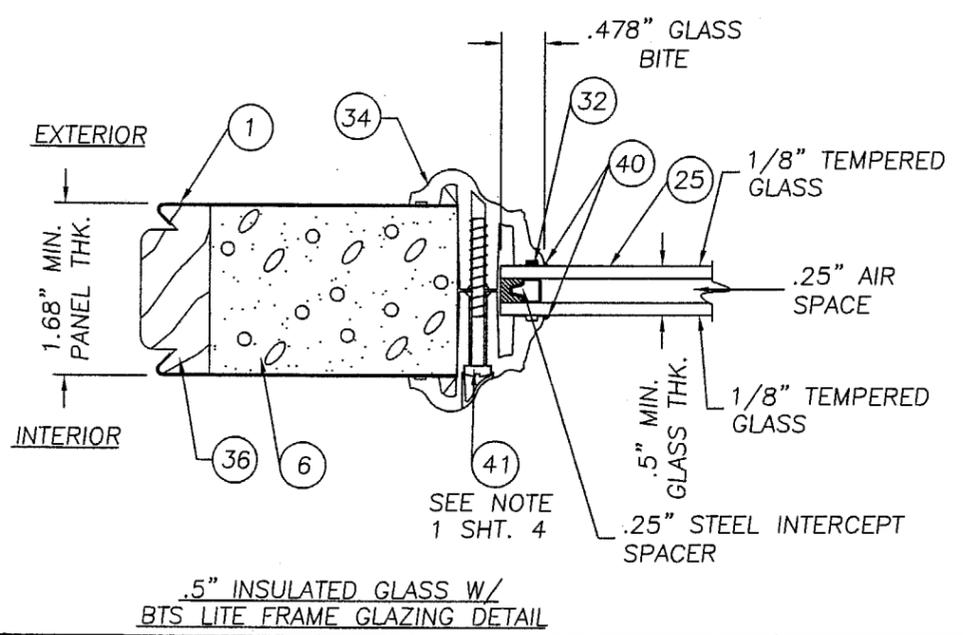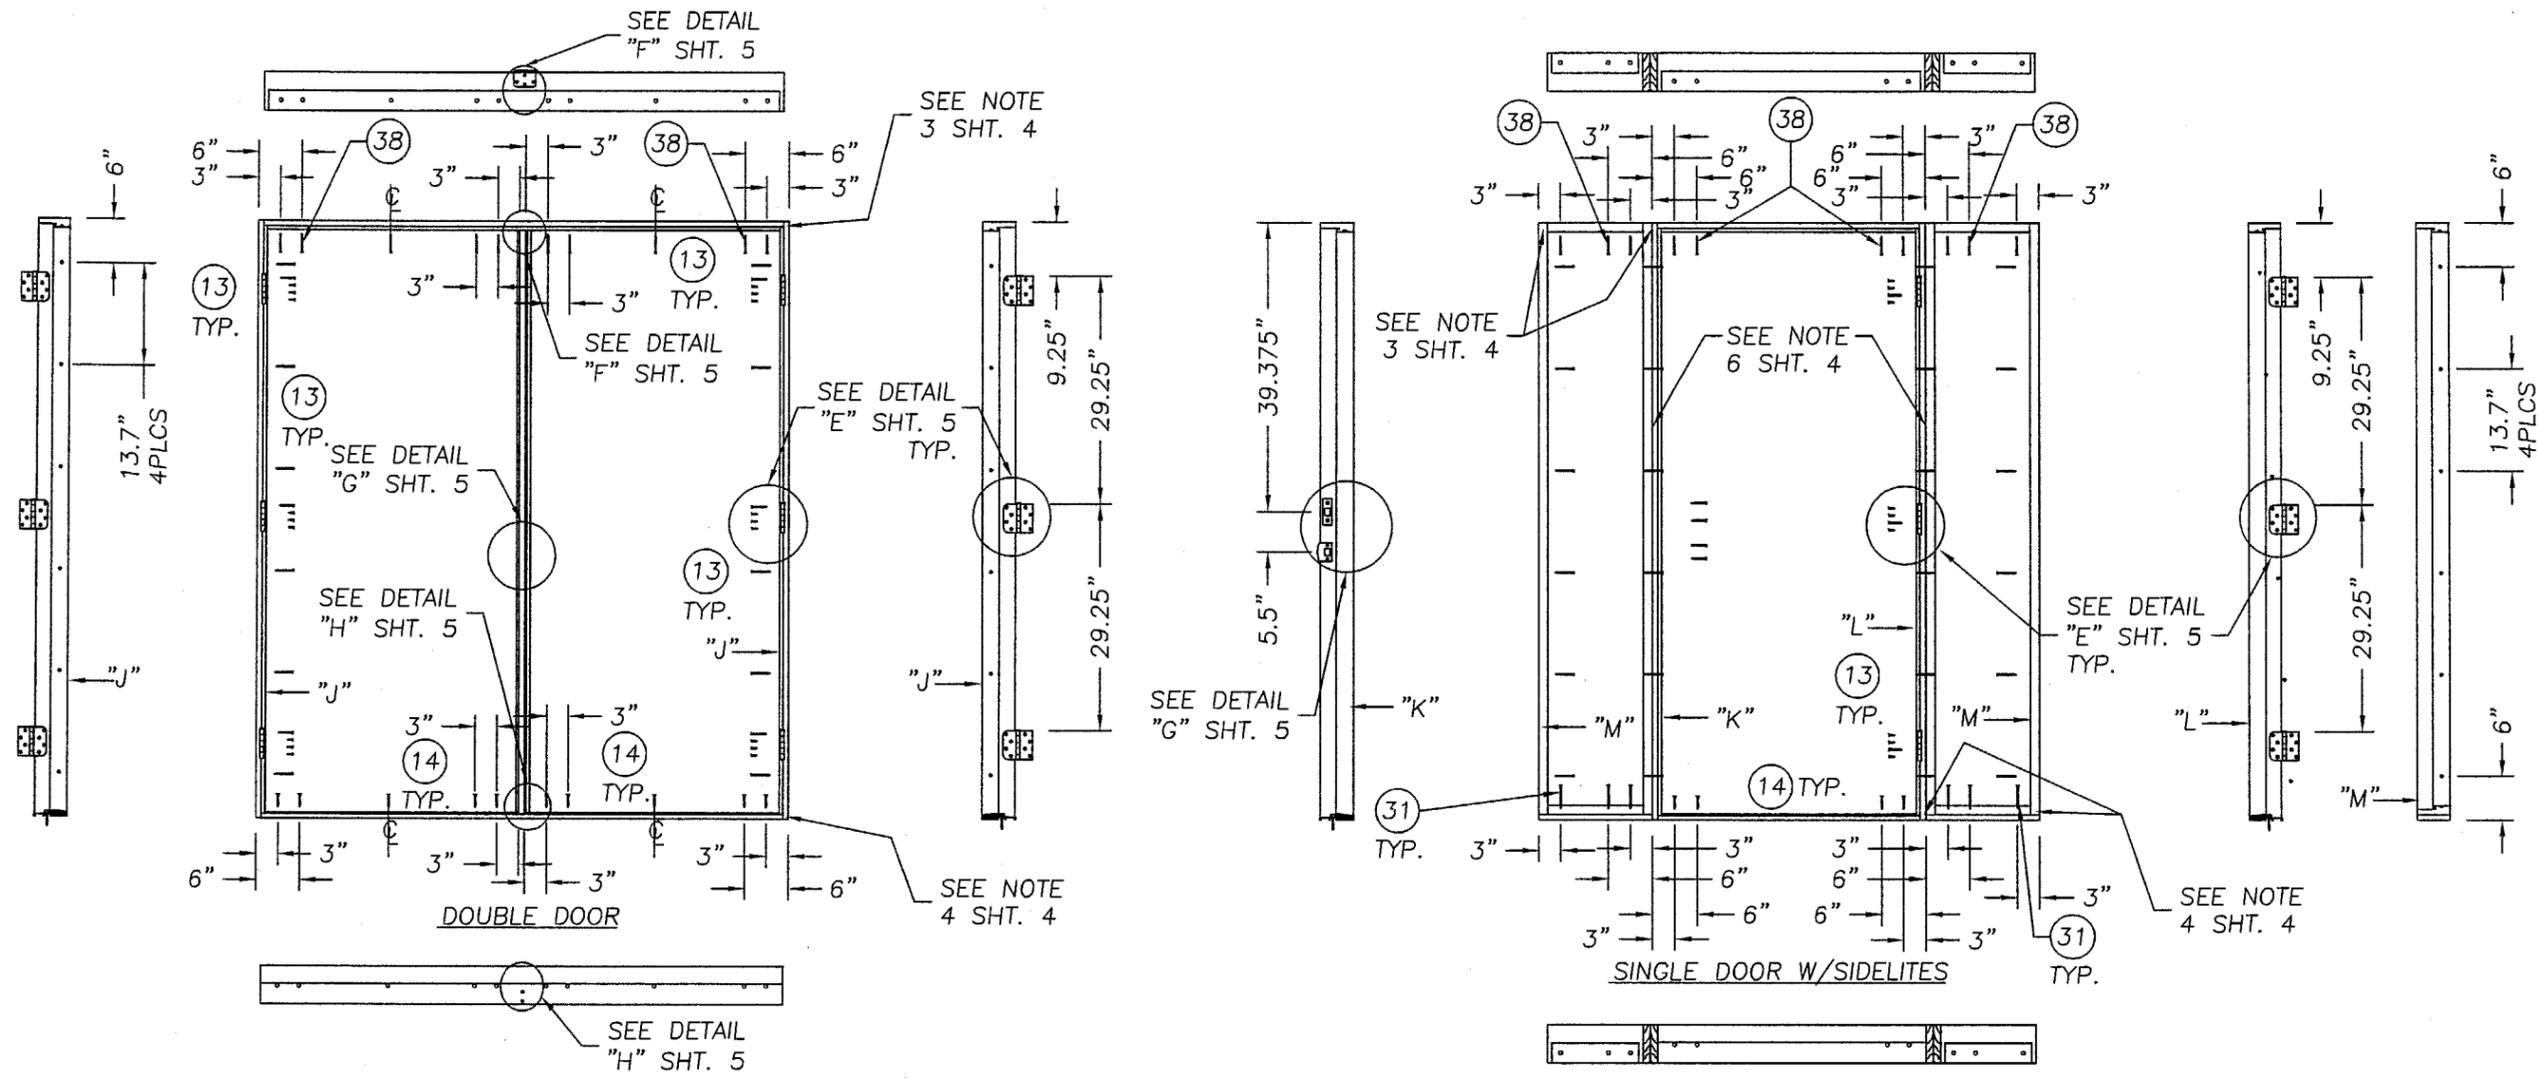

Approved as complying with the Florida Building Code  
 Date MAY 1, 2003  
 NOA# 01-0828.10  
 Miami Dade Product Control Division  
 By Mannulter

**THERMA-TRU CORPORATION**  
 1687 WOODLANDS DRIVE  
 MAUMEE, OHIO 43537  
 PHONE 800.537.8827


PRODUCT: "CONSTRUCTION SERIES"  
 6-8 SINGLE & DOUBLE  
 OUT-SWING STEEL DOOR  
 PART OR ASSEMBLY:  
 ANCHORING LOCATIONS  
 & GLAZING DETAILS

NO.	DATE	GENERAL REVISION	RW	BY
1	3/12/03			


REVISIONS

**RW** BUILDING  
 CONSULTANTS, INC.  
 813.659.9197


DATE: 03/28/01  
 SCALE: N.T.S.  
 DWG. BY: TJH  
 CHK. BY: RW  
 DRAWING NO.: S-2110  
 SHEET 6 OF 8

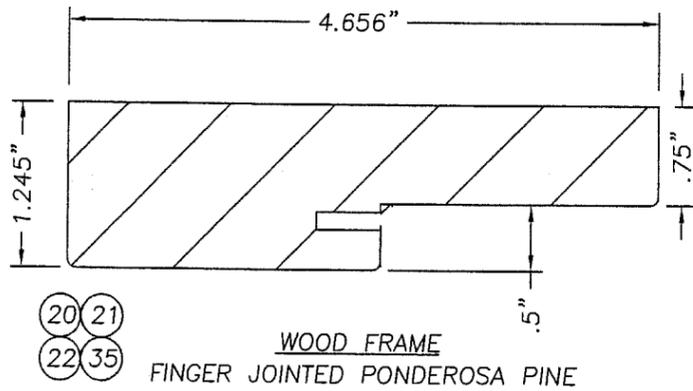


WOOD FRAME  
FINGER JOINTED PONDEROSA PINE

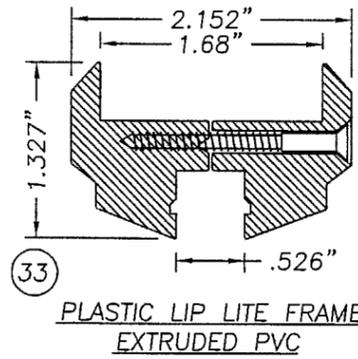


PLASTIC LIP LITE FRAME  
EXTRUDED PVC

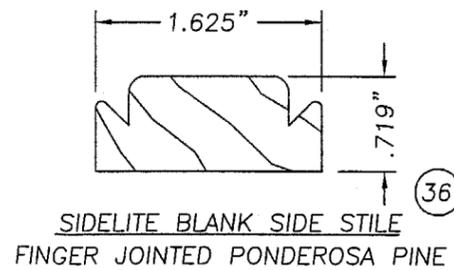


SIDELITE BLANK SIDE STILE  
FINGER JOINTED PONDEROSA PINE

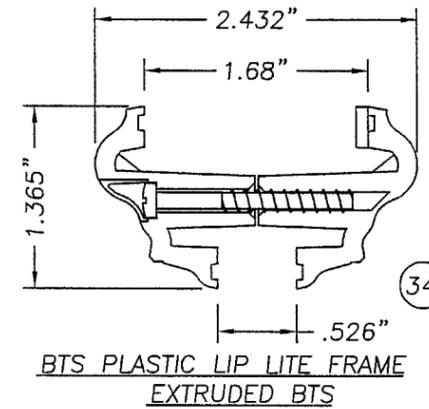


BTS PLASTIC LIP LITE FRAME  
EXTRUDED BTS

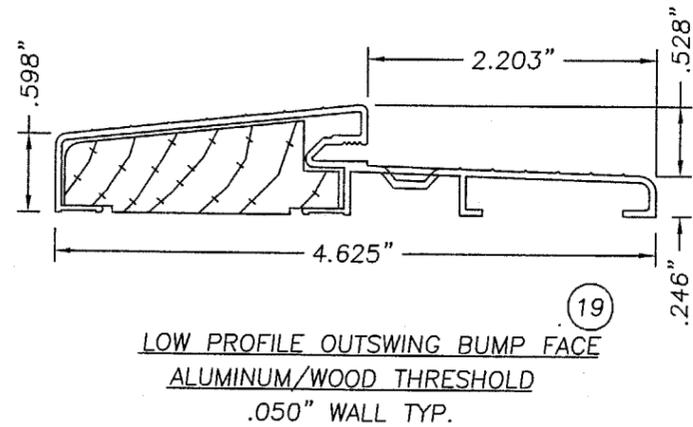


LOW PROFILE OUTSWING BUMP FACE  
ALUMINUM/WOOD THRESHOLD  
.050" WALL TYP.

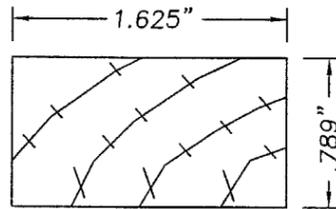


TOP RAIL  
FINGER JOINTED PONDEROSA PINE

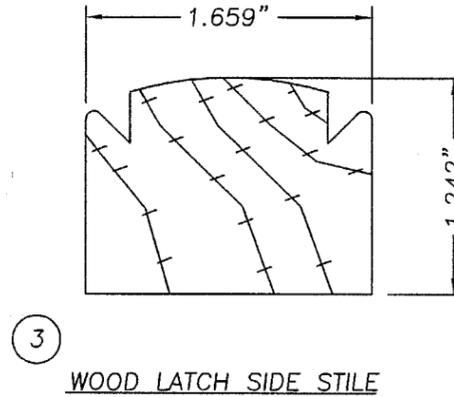


WOOD LATCH SIDE STILE

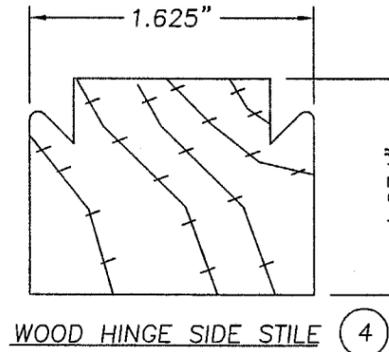


WOOD HINGE SIDE STILE

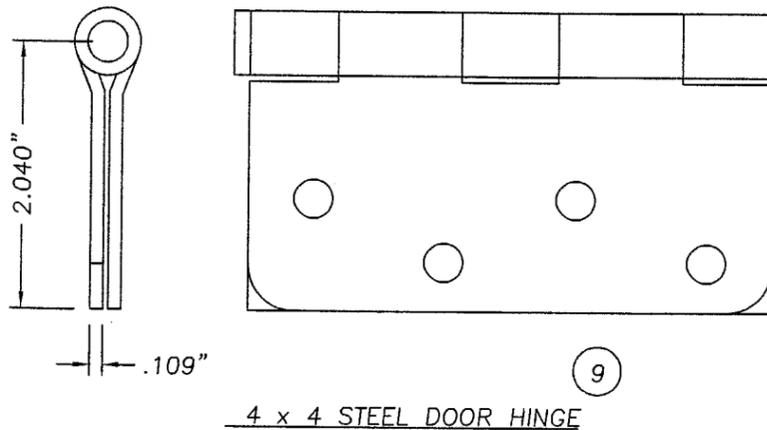

4 x 4 STEEL DOOR HINGE

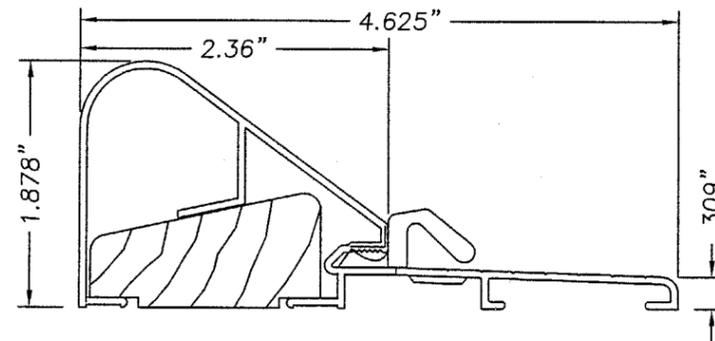

HIGH DAM THRESHOLD  
MIN. ALUMINUM WALL THICKNESS 0.050"

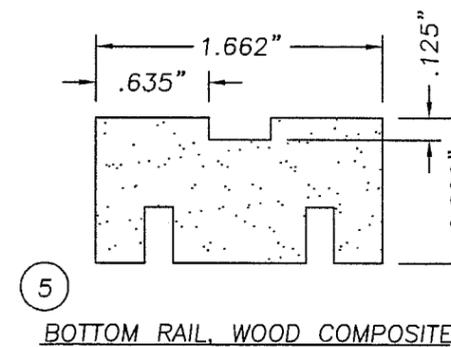

BOTTOM RAIL, WOOD COMPOSITE

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO 43537  
PHONE 800.537.8827

PRODUCT: "CONSTRUCTION SERIES"  
6-8 SINGLE & DOUBLE  
OUTS-WING STEEL DOOR  
PART OR ASSEMBLY:  
UNIT COMPONENTS


NO.	DATE	GENERAL REVISION	RW	BY
1	3/12/03			

RW BUILDING  
CONSULTANTS, INC.  
813.659.9197


DATE: 03/28/01  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2110  
SHEET 7 OF 8

Approved as complying with the  
Florida Building Code  
Date MAY 1, 2003  
NGA# 01-0828, 03  
Miami Dade Product Control  
Division  
By: *Mauricio*


Item	DESCRIPTION	Material
1	DOOR SKIN; CONSTRUCTION SERIES 25GA. (.018" MIN.)	STEEL
1A	SIDELITE SKIN; 24 GA. (.021" MIN.)	STEEL
2	TOP RAIL (1.628" x .851" THERMA-TRU PONDEROSA PINE)	WOOD
3	LATCH STILE (THERMA-TRU, PONDEROSA PINE 1.659" x 1.242")	WOOD
4	HINGE STILE (THERMA-TRU, PONDEROSA PINE 1.625" x 1.234")	WOOD
5	BOTTOM RAIL (1.662" x .892" THERMA-TRU WOOD COMPOSITE)	WOOD COMPOSITE
6	POLYURETHANE FOAM (BASF, 1.9lbs. DENSITY)	FOAM
7	SHORT REACH COMPRESSION WEATHERSTRIP (THERMA-TRU)	FOAM
8	LONG REACH COMPRESSION WEATHERSTRIP (THERMA-TRU)	FOAM
9	4" x 4" HINGE .097" THK. (THERMA-TRU)	STEEL
10	#10 x 3/4" Lg. PFH WOOD SCREW (Hinge to Frame)	STEEL
11	#10 x 1" LG. PFH WOOD SCREW	STEEL
12	#10 x 2" LG. PFH WOOD SCREW	STEEL
13	#8 x 2 1/2" LG. PFH WOOD SCREW	STEEL
14	3/16" TAPCON ANCHOR (ELCO, 1.75" MIN. LG.)	STEEL
15	NOT USED	-
16	2x WOOD BUCK	WOOD
17	MAX. 1/4" SHIM MATERIAL	WOOD
18	KWIKSET TITAN 700 SERIES PASSAGE LOCK	-
19	ONE PIECE BUMP FACE THRESHOLD LOW PROFILE (THERMA-TRU)	ALUM./WOOD
20	4.656" HEADER (THERMA-TRU, PONDEROSA PINE)	WOOD
21	4.656" STRIKE JAMB (THERMA-TRU, PONDEROSA PINE)	WOOD
22	4.656" HINGE JAMB (THERMA-TRU, PONDEROSA PINE)	WOOD
23	KWIKSET TITAN 700 SERIES DEADBOLT	-
24	ASTRAGAL WINDJAMBER II WR68T (.052" WALL)	ALUM.
25	GLAZING, 1/2" INSULATED TEMPERED GLASS	GLASS
26	3/4" THK. PRESSURE TREATED SIDELITE PAD	WOOD
27	#8 x 1" LG. PANHEAD SHEET METAL SCREW	STEEL
28	CAULKING	LATEX
29	#6-18 x 1 3/4" PHILLIPS FLATHEAD SCREW (FOR ITEM #33)	STEEL
30	NOT USED	-
31	3/16" TAPCON ANCHOR (ELCO, 3.25" MIN. LG.)	STEEL
32	1/8 THK. CELLULAR GLAZING TAPE (STIK-II TAPE)	-
33	PLASTIC LIP LITE FRAME (PVC, THERMA-TRU)	PVC
34	PLASTIC LIP LITE FRAME (BTS, THERMA-TRU)	BTS
35	4.656" BLANK JAMB (THERMA-TRU, PONDEROSA PINE)	WOOD
36	SIDELITE SIDE STILE (THERMA-TRU, 1.625" x .719" PONDEROSA PINE)	WOOD
37	#10 x 1 3/4" LG. PFH WOOD SCREW	STEEL
38	#10 x 3.0" LG PFH WOOD SCREW	STEEL
39	HIGH WATER DAM THRESHOLD (THERMA-TRU)	ALUM.
40	SILICONE CAULK	SILICONE
41	#8-10 x 1 1/2" PLASCREW (FOR ITEM #34)	STEEL

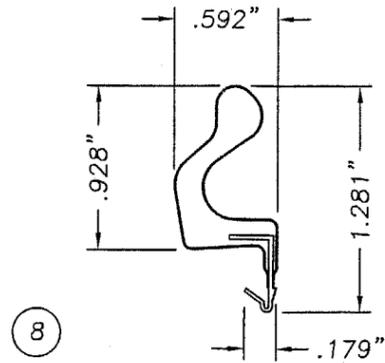


8 LONG REACH COMPRESSION WEATHERSTRIP  
FOAM CELL CORE W/VINYL JACKET

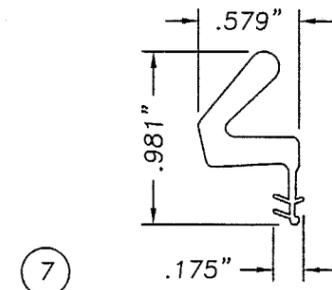


7 COMPRESSION WEATHERSTRIP  
BY THERMA-TRU  
FOAM CELL CORE W/VINYL JACKET

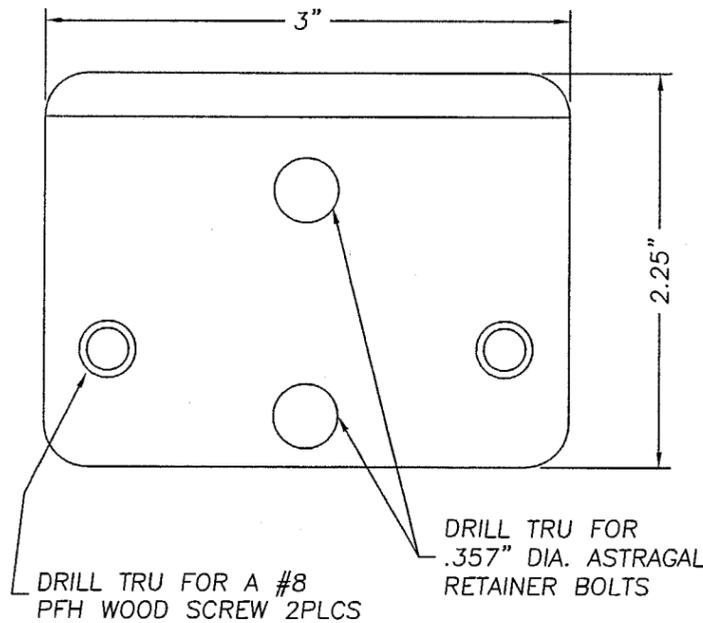

WINDJAMBER II WR68T STRIKE PLATE

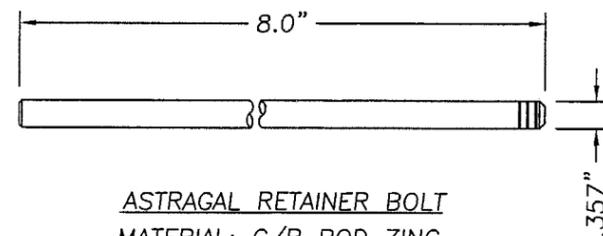

ASTRAGAL RETAINER BOLT  
MATERIAL: C/R ROD ZINC  
& YELLOW CHROMATE

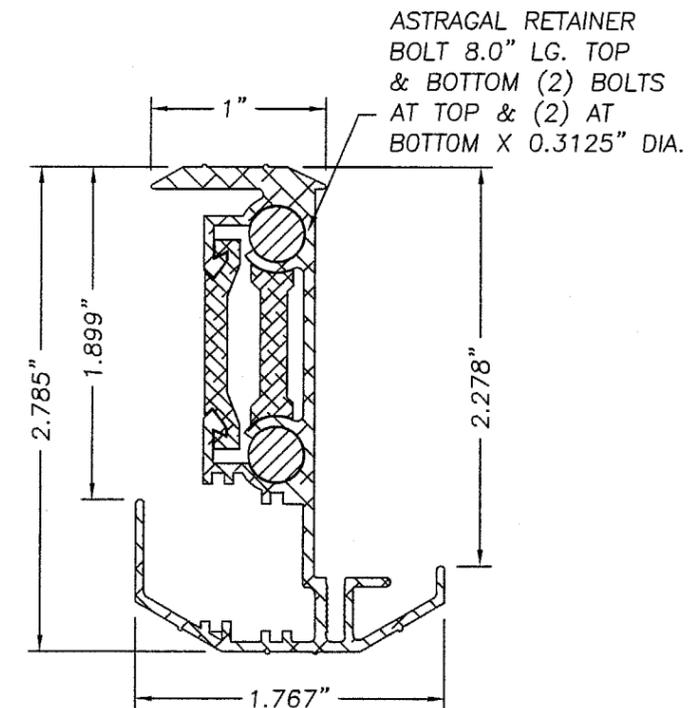

WINDJAMBER II WR68T  
ASTRAGAL (ALUMINUM .052" WALL TYP.)

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO 43537  
PHONE 800.537.8827

PRODUCT: "CONSTRUCTION SERIES"  
6-8 SINGLE & DOUBLE  
OUT-SWING STEEL DOOR  
PART OR ASSEMBLY:  
BILL OF MATERIALS &  
UNIT COMPONENTS

NO.	DATE	GENERAL REVISION	RW	BY
1	3/12/03			

RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

DATE: 03/28/01  
SCALE: N.T.S.  
DWG. BY: TJH  
CHK. BY: RW  
DRAWING NO.: S-2110  
SHEET 8 OF 8

Approved as complying with the  
Florida Building Code  
Date MAY 1, 2003  
NOA# 01-0828.10  
Miami Dade Product Control  
Division  
By *[Signature]*