



MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING

BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Curries Company
525 9th Street S.E., P.O. Box 1648
Mason City, IA 50401

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

Your application for Notice of Acceptance (NOA) of:

Series 8080 Model 707-F Full Louvered Outswing Commercial Steel Door

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-0904.08
EXPIRES: 03/17/2003

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE.**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 10/04/2001

Curries Company

ACCEPTANCE No.: 01-0904.08

APPROVED : October 04, 2001

EXPIRES : March 17, 2003

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1 This revises Notice of Acceptance (NOA) No. 99-1005.01, which was issued on March 17, 2000. It revises approval of a louvered commercial steel door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1 The **Series 8080 Model 707F Full Louvered Outswing Commercial Steel Doors** and its components shall be constructed in strict compliance with the following documents: Drawing No **RD0043**, Sheets 1, 1A, 2, 2A, 3, 3A, 4, 4A, 5, 5A and 6 through 11 of 11. Sheets 1 through 11 of 11, dated 08/17/99 and last revised on 02-25-00, signed and sealed by Richard Boyette, P.E. and sheets 1A through 5A, dated 08-29-01 all prepared by manufacturer, bearing the Miami-Dade County Product Control approval stamp with the NOA number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1 This approval applies to single unit applications of single and pair of doors, as shown in approved drawings.
- 3.2 Unit shall be installed only at locations protected by a canopy or overhang such that the angle between the edge of canopy or overhang to sill is less than 45 degrees. Unless unit is installed in non-habitable areas where the unit and the area are designed to accept water infiltration.
- 3.3 Thermal efficiency of this product is not part of this acceptance.

4. INSTALLATION

- 4.1 The commercial steel door and its components shall be installed in strict compliance with the approved drawings.
- 4.2 Hurricane protection system (shutters): the installation of this unit **will require** a hurricane protection system.

5. LABELING

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
- 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
- 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

Ishaq I. Chanda

Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

Curries Company

ACCEPTANCE No.: 01-0904.08

APPROVED : October 04, 2001

EXPIRES : March 17, 2003

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

END OF THIS ACCEPTANCE

Curries Company

ACCEPTANCE No.: 01-0904.08

APPROVED : October 04, 2001

EXPIRES : March 17, 2003

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's parts and sections drawings.
2. Drawing No **RD0043**, Sheets 1, 1A, 2, 2A, 3, 3A, 4, 4A, 5, 5A and 6 through 11 of 11. Sheets 1 through 11 of 11, dated 08/17/99 and last revised on 02-25-00, signed and sealed by Richard Boyette, P.E. and sheets 1A through 5A, dated 08-29-01 all prepared by manufacturer
(Note: This revision consist of addition of single door w/sheet 1A thru 5A added to existing Dwg set)

B. TESTS (Transferred from file#99-1005.01)

1. Test Report No. **J98032808-231-01**, prepared by Intertek Testing Services, dated May 13th, 1999, signed and sealed by Doug Tucker, P.E., for the following tests:
 - 1) Uniform Static Air Pressure Test, Loading per PA 202-94
(Excluding Air infiltration and water infiltration)
 - 2) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94Along with manufacturer's parts and section drawings marked by Intertek Testing Services.

C. CALCULATIONS(Transferred from file#99-1005.01)

1. Anchorage verification calculations dated September 08,199 and revised on 01-27-00.prepared, signed and sealed by Richard Boyette, P. E.
2. "T" Anchor Calculations, dated 11/11/97, prepared, signed and sealed by Allen N. Reeves, P.E.

D. MATERIAL CERTIFICATIONS(Transferred from file#99-1005.01)

1. Tensile Test prepared by Celotex Corporation., Job No. MTS52304, dated July 26, 1999, for steel samples, tested per ASTM E8-93a, signed and sealed by R. G. Miller, P.E.
2. Test report for "Surface burning characteristics of building material" per UL 723 by Underwriters Laboratory Inc. ref. No. R5817 & B5NK3820 dated June 04, 1985 issued to BASF Wyandotte Corporation. for Expanded Polystyrene (EPS).
3. Test report for "Self ignition temperature" for plastic materials per ASTM D-1929, report No. 092897 dated Nov. 28, 1988, issued to BASF Corporation for Expanded Polystyrene (EPS).

E. STATEMENTS (Transferred from file#99-1005.01)


1. Statement letter of conformance, dated September 18, 1999, revised on03-06-00, signed by Richard Boyette, P.E.
2. Statement letter of no financial interest, dated 03-08-00, signed by Richard Boyette, P.E.
3. Statement of compliance, as part of test report dated May 18,1999, signed and sealed by Doug Tucker, P.E.
4. Statement letter dated 02-03-1999 by Underwriter laboratories for "Surface burning characteristics of building materials"rating for Polystyrene core, signed by James J. Urban.
5. Addendum letter dated 01-12-00, issued by Intertek Testing Services for report no. J98032808-231-01, signed and sealed by Doug Tucker, P.E.
6. Request letter for revision and expedite review dated August 29, 2001, signed by Nelson Krashel.

F. OTHER

1. This approval revises and replaces Notice of acceptance No. 99-1005.01, which was issued on March 17, 2000 with expiration date of March 17, 2003.

Ishaq I. Chanda

Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

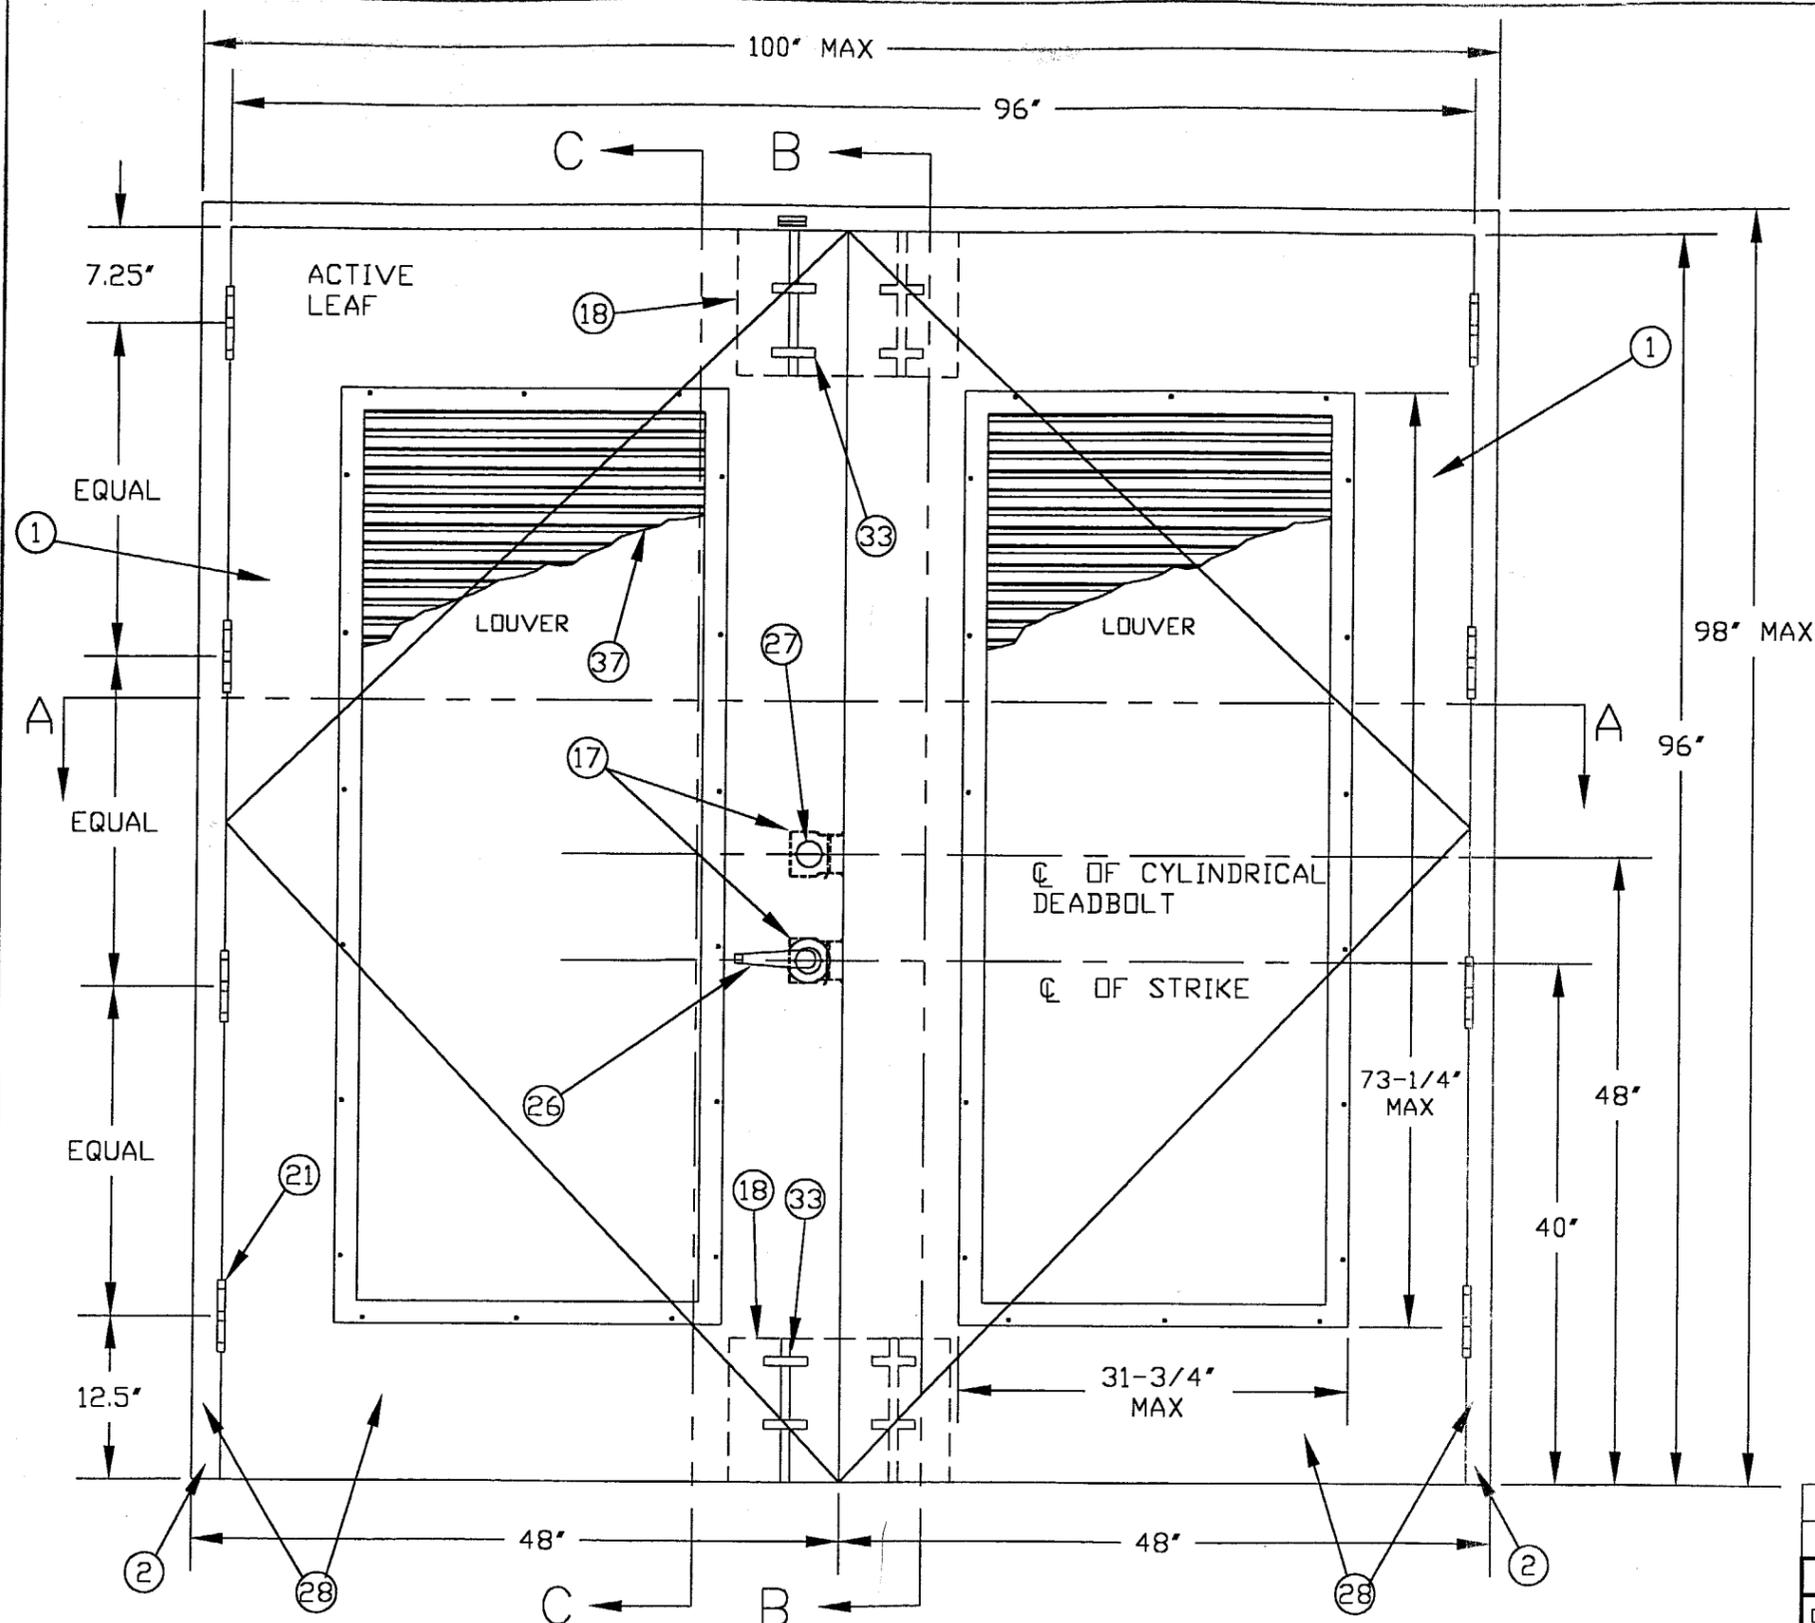

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCTOBER 04, 2001
 BY Iskag I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

RICHARD BOYETTE
 FL Civil PE #42485
 4031 Coconut Blvd
 Royal Palm Bch FL 33411
 561-990-5766 Voice /

Richard Boyette
 3/18/00

B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
REV	DATE	DESCRIPTION	DR	CK	SC
DR. L. SHERIFF					
CK. N. KRASCHEL					
SCAN					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031					
ANG± .5°					
FRAC± 1/32					
SH SZ: B	SH.NO. 1 OF 11	DWG.NO: RD0043			
SCALE: ----	DATE: 17-AUG-99				

CURRIES



MASON CITY, IOWA
 TITLE: 8'0 X 8'0 MODEL 707F
 OUTSWING DOORS WITH
 ANEMOSTAT FPL2 LOUVER,
 AND SARGENT CYLINDRICAL LOCK,
 AND CYLINDRICAL DEADBOLT.

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE March 17, 2000
 BY Iskag I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1005.01

EXTERIOR ELEVATION
 DESIGN PRESSURE RATING
 SARGENT 10 LINE OR 6500 CYLINDRICAL LOCK WITH SARGENT
 480 SERIES CYLINDRICAL DEADBOLT.

	WHERE WATER INFILTRATION REQUIREMENT IS REQUIRED	WHERE WATER INFILTRATION REQUIREMENT IS NOT REQUIRED
POSITIVE	NOT APPROVED	+50
NEGATIVE	NOT APPROVED	-50

NOTE: FOR ANCHOR LOCATIONS, SEE INTERIOR ELEVATIONS

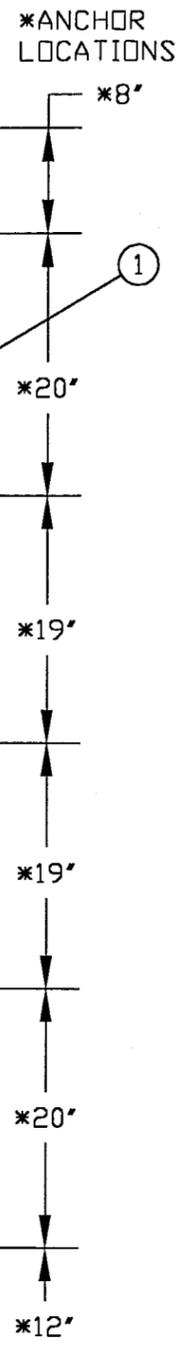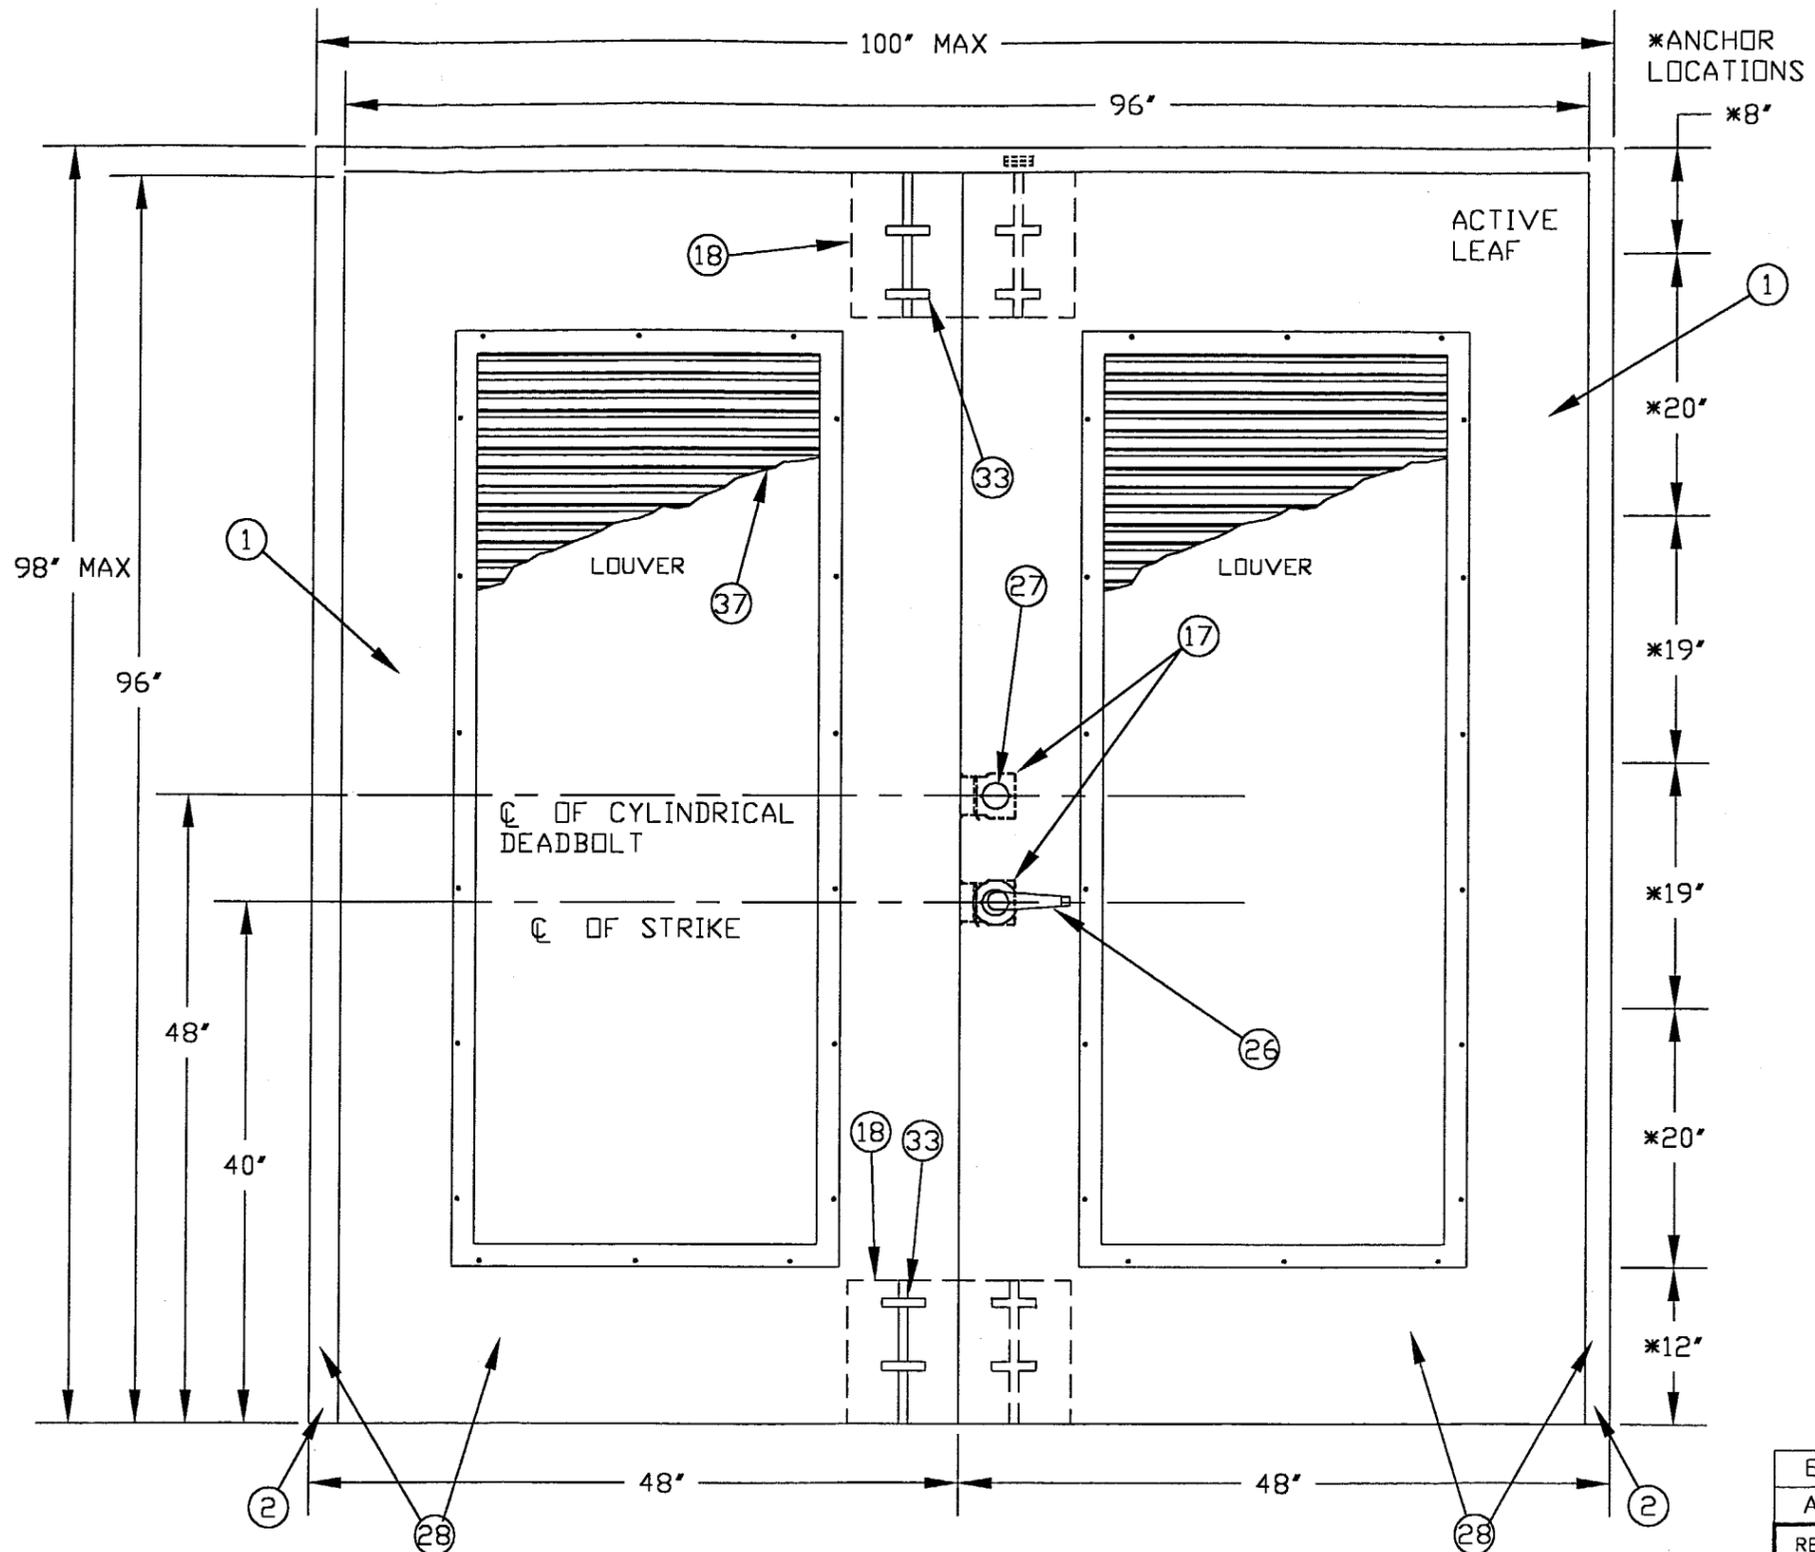

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT 04, 2001
 BY Isaac I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

RICHARD BOYETT
 FL Civil PE #42488
 4031 Coconut Blv.
 Royal Palm Bch FL 3
 (961) 790-5766 Voice
Richard Boyett
 3/8/00


B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<i>HLK</i>	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
REV	DATE	DESCRIPTION	DR	CK	SC
DR. L. SHERIFF			CURRIES MASON CITY, IOWA TITLE: 8'0 X 8'0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER. AND SARGENT CYLINDRICAL LOCK. AND CYLINDRICAL DEADBOLT.		
CK. N. KRASCHEL					
SCAN					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031					
ANG± .5°					
FRAC± 1/32					
SH SZ: B	SH.NO. 2 OF 11	DWG.NO:			
SCALE: - - - -	DATE: 17-AUG-99	RD0043			

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE March 17, 2000
 BY Isaac I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1005-01

INTERIOR ELEVATION
 DESIGN PRESSURE RATING
 SARGENT 10 LINE OR 6500 CYLINDRICAL LOCK WITH SARGENT 480 SERIES DEAD BOLT.

	WHERE WATER INFILTRATION REQUIREMENT IS REQUIRED	WHERE WATER INFILTRATION REQUIREMENT IS NOT REQUIRED
POSITIVE	NOT APPROVED	+50
NEGATIVE	NOT APPROVED	-50

NOTE: FOR ANCHOR LOCATIONS, SEE INTERIOR ELEVATIONS

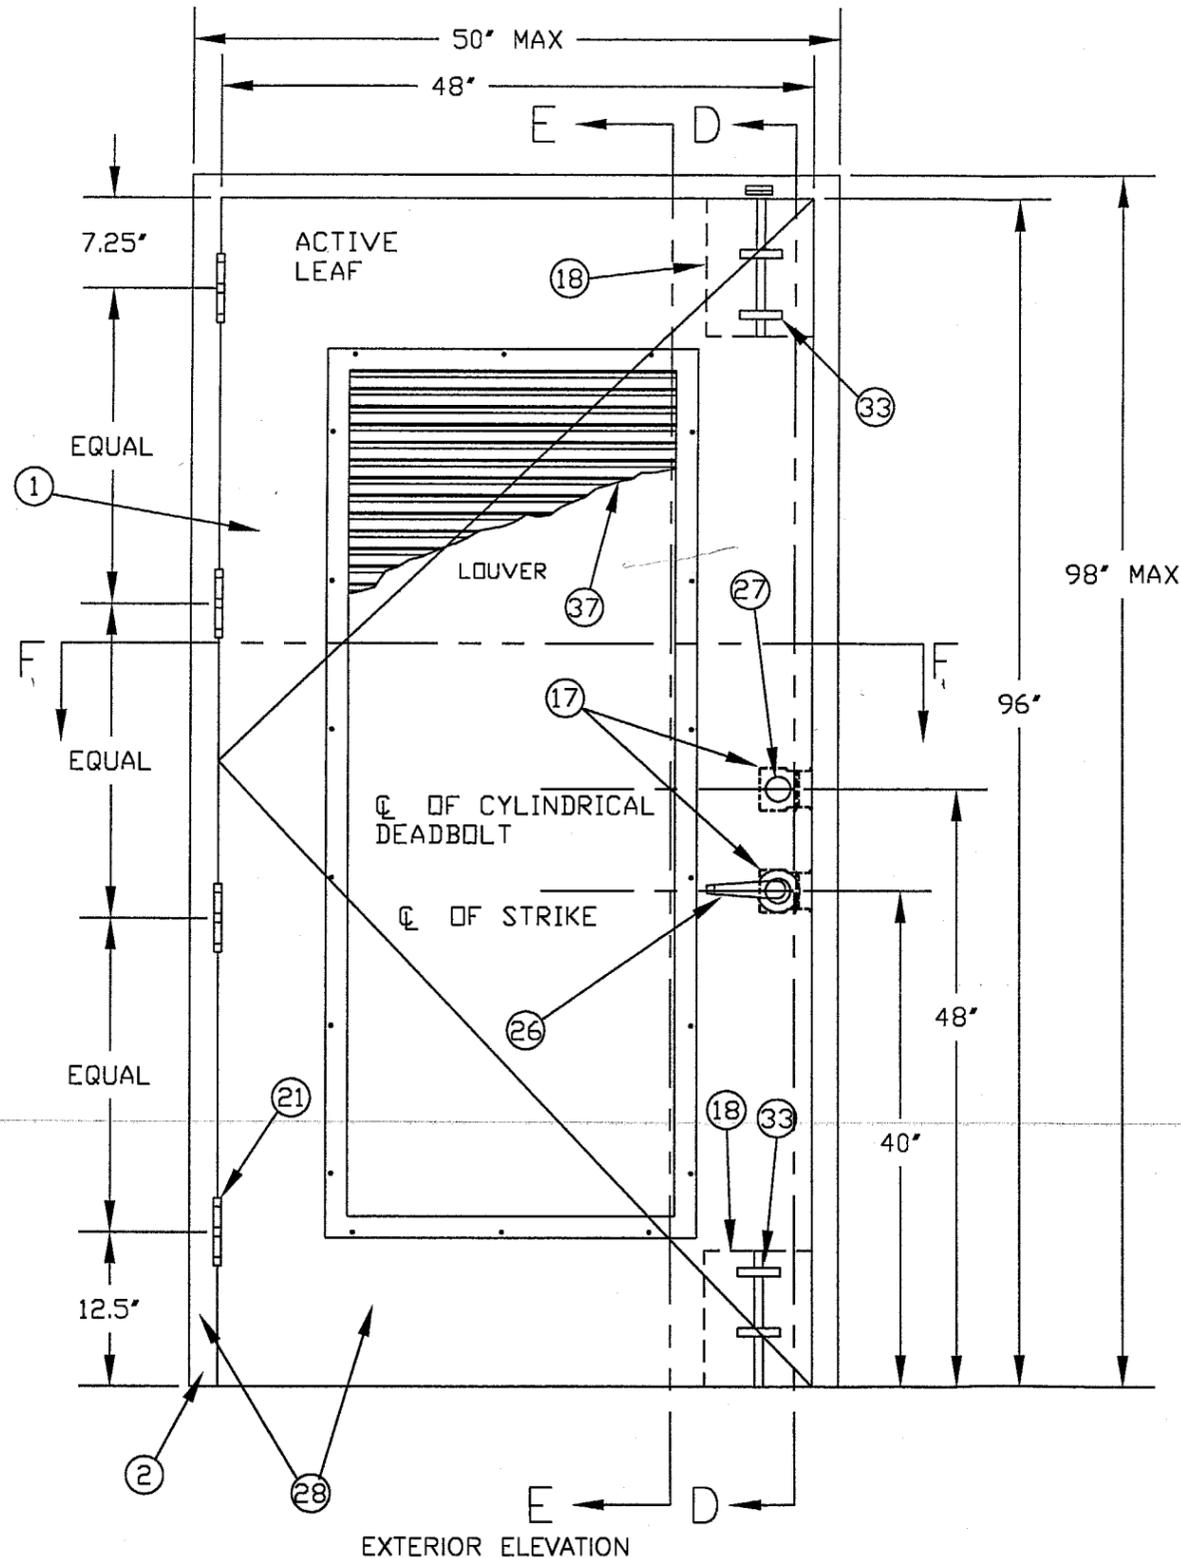


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT. 04, 2001
 BY Shag L. Chandra
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

DESIGN PRESSURE RATING
 SARGENT 10 LINE OR 6500 CYLINDRICAL LOCK WITH SARGENT
 480 SERIES CYLINDRICAL DEADBOLT.

	WHERE WATER INFILTRATION REQUIREMENT IS REQUIRED	WHERE WATER INFILTRATION REQUIREMENT IS NOT REQUIRED
POSITIVE	NOT APPROVED	+50
NEGATIVE	NOT APPROVED	-50

NOTE: FOR ANCHOR LOCATIONS, SEE INTERIOR ELEVATIONS

REV	DATE	DESCRIPTION	DR	CK	SC
		CURRIES			
		MASON CITY, IOWA			
TOLERANCE: UNLESS OTHERWISE SPECIFIED		TITLE:	4'-0 x 4'-0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER, SARGENT CYLINDRICAL LOCK, & CYLINDRICAL DEADBOLT		
DEC±	.031	SH. SZ:	B	SH. NO. 1A OF 11	DWG. NO. RD0043
ANG±	.5°	SCALE:	----	DATE: 29-AUG-01	
FRAC±	1/32				

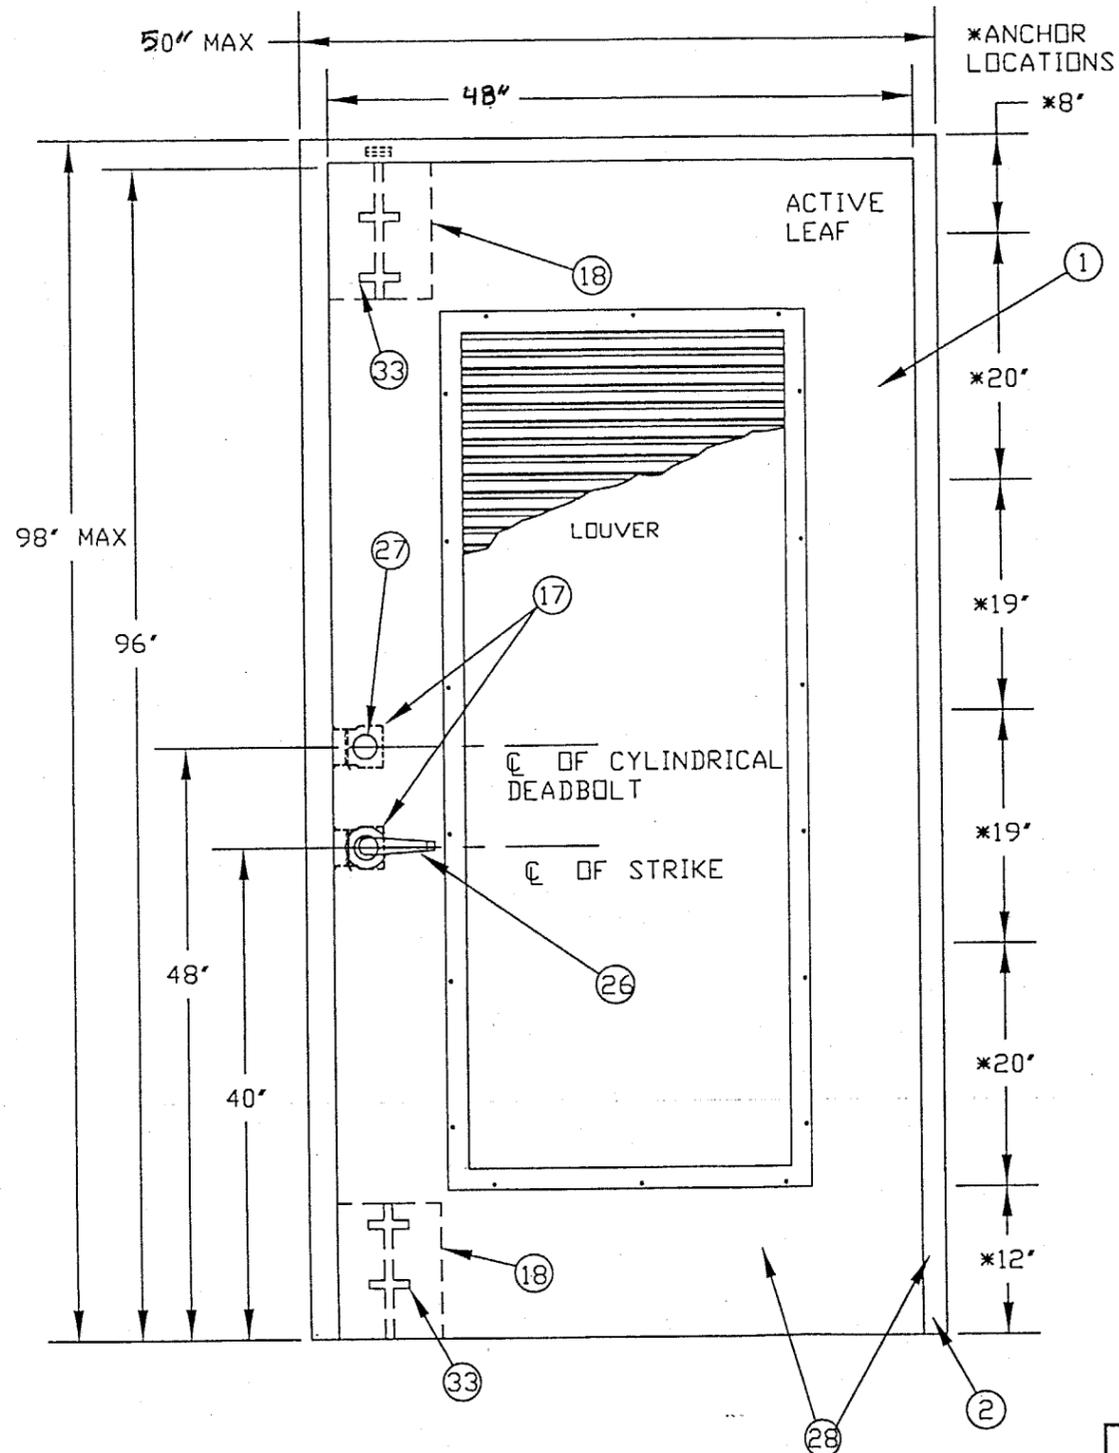


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT 04, 2001
 BY Shing I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

INTERIOR ELEVATION
 DESIGN PRESSURE RATING
 SARGENT 10 LINE OR 6500 CYLINDRICAL LOCK WITH SARGENT 480 SERIES DEAD BOLT.

	WHERE WATER INFILTRATION REQUIREMENT IS REQUIRED	WHERE WATER INFILTRATION REQUIREMENT IS NOT REQUIRED
POSITIVE	NOT APPROVED	+50
NEGATIVE	NOT APPROVED	-50

NOTE: FOR ANCHOR LOCATIONS, SEE INTERIOR ELEVATIONS

REV	DATE	DESCRIPTION	DR	CK	SC
		CURRIES			
		MASON CITY, IOWA			
		TITLE: 4'-0 x 8'-0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER, SARGENT CYLINDRICAL LOCK, & CYLINDRICAL DEADBOLT			
		DEC± .031			
		ANG± .5°			
		FRAC± 1/32			
		SH SZ: B	SH.NO. 2A OF 11	DWG.NO. RD0043	
		SCALE: ----	DATE: 29-AUG-01		

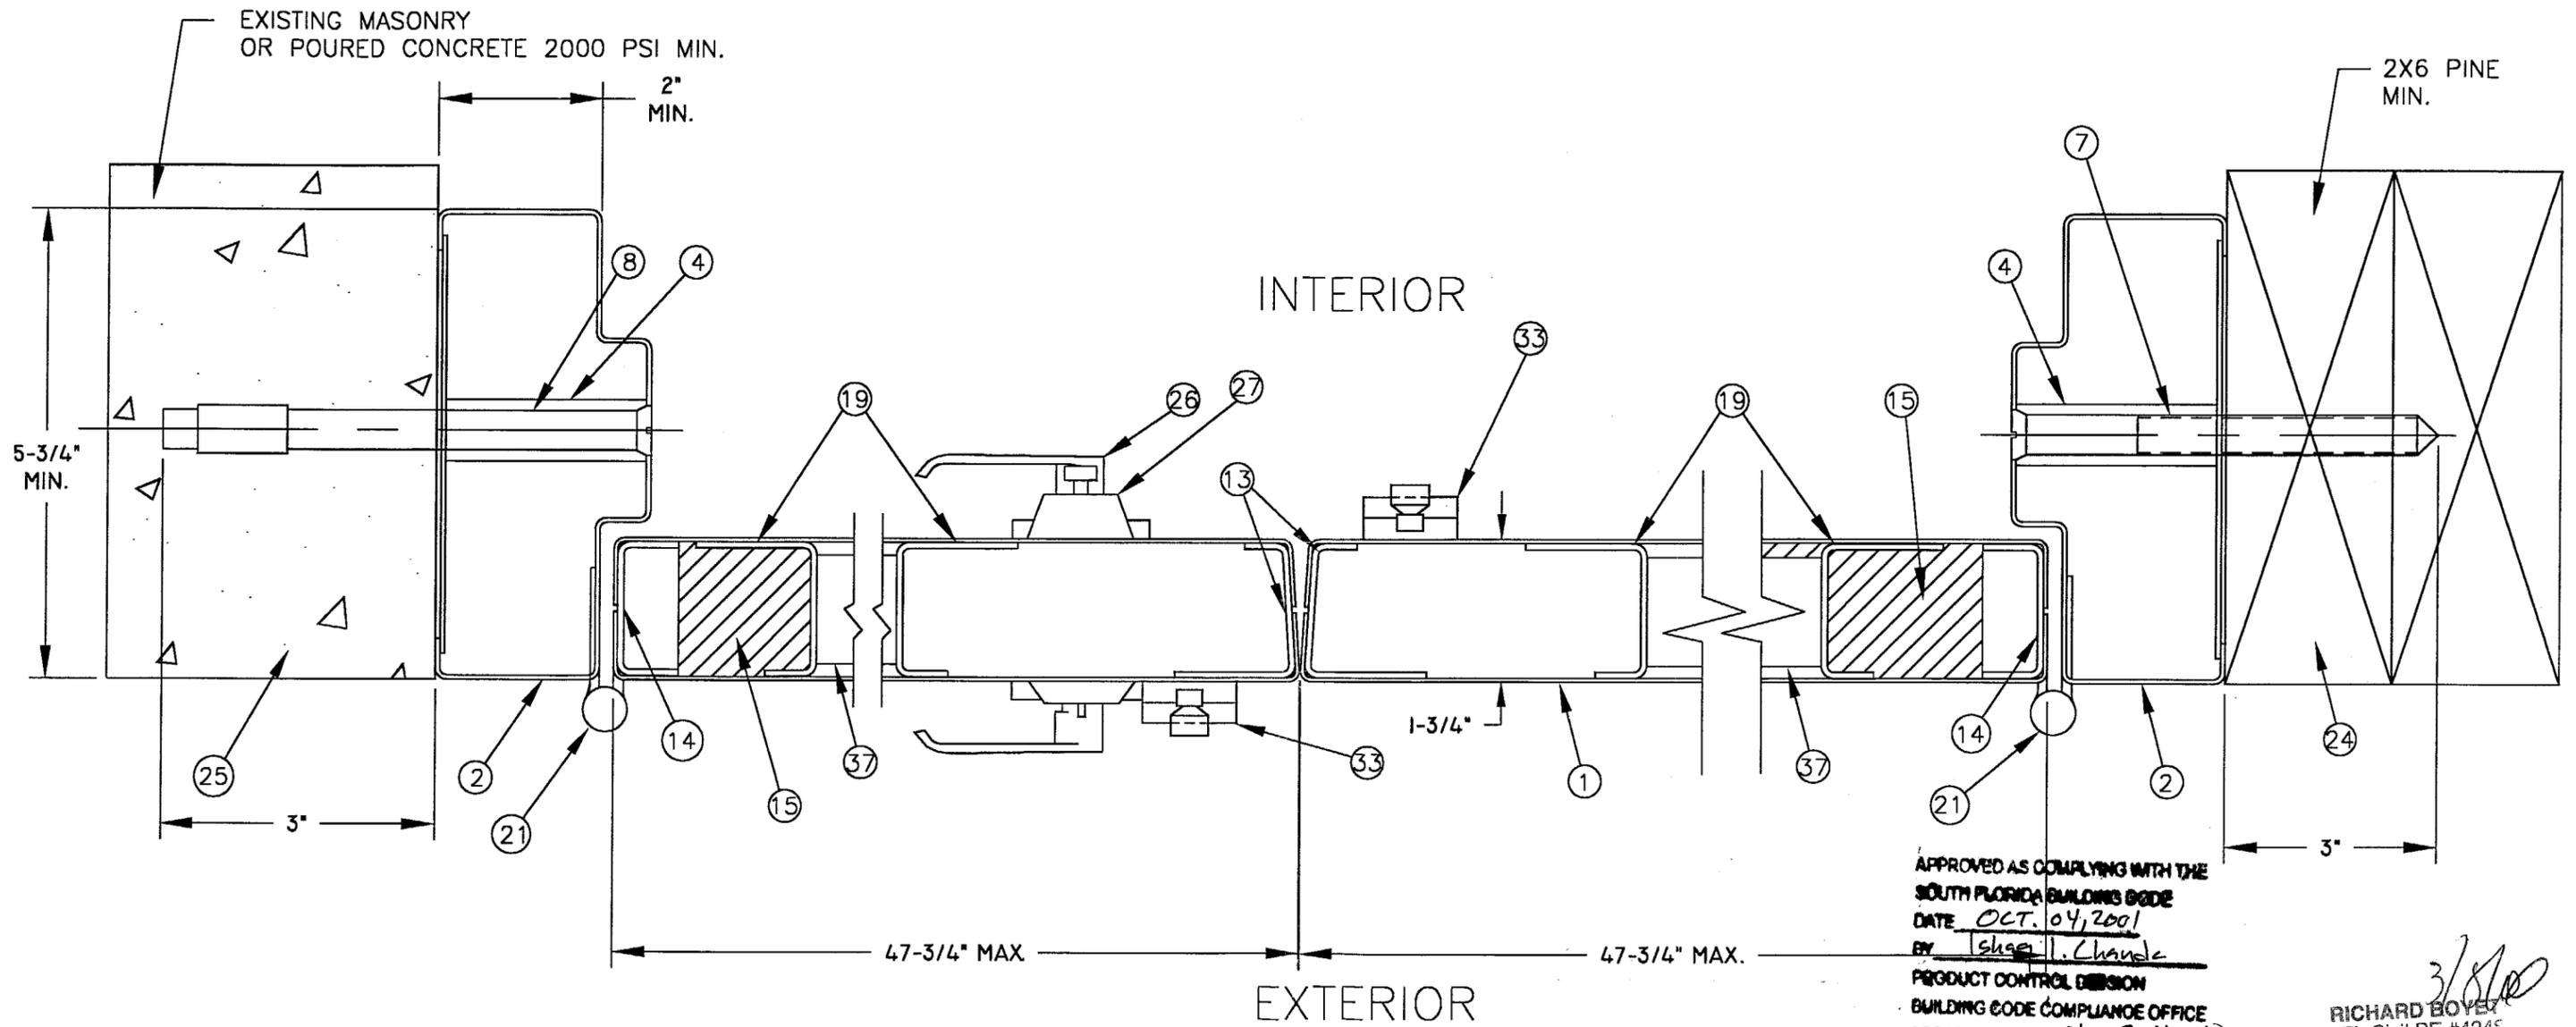

SECTION A-A

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT. 04, 2001
 BY Shree I. Chandra
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

3/8/00
 RICHARD BOYER
 FL Civil PE #424E
 4031 Coconut Bch
 Royal Palm Bch FL
 (561) 790-5766 Voice

Richard Boyer


B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<u>NTK</u>	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
REV	DATE	DESCRIPTION	DR	CK	SC
DR. L. SHERIFF					
CK. N. KRASCHEL					
SCAN					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031					
ANG± .5°					
FRAC± 1/32					
SH SZ: B			SH.NO. 3 OF 11		DWG.NO:
SCALE: - - - -			DATE: 17-AUG-99		RD0043

CURRIES

MASON CITY, IOWA

TITLE: 8'0 X 8'0 MODEL 707F
 OUTSWING DOORS WITH
 ANEMOSTAT FPL2 LOUVER.
 AND SARGENT CYLINDRICAL LOCK.
 AND CYLINDRICAL DEADBOLT.

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE March 17, 2000
 BY Shree I. Chandra
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1005.01

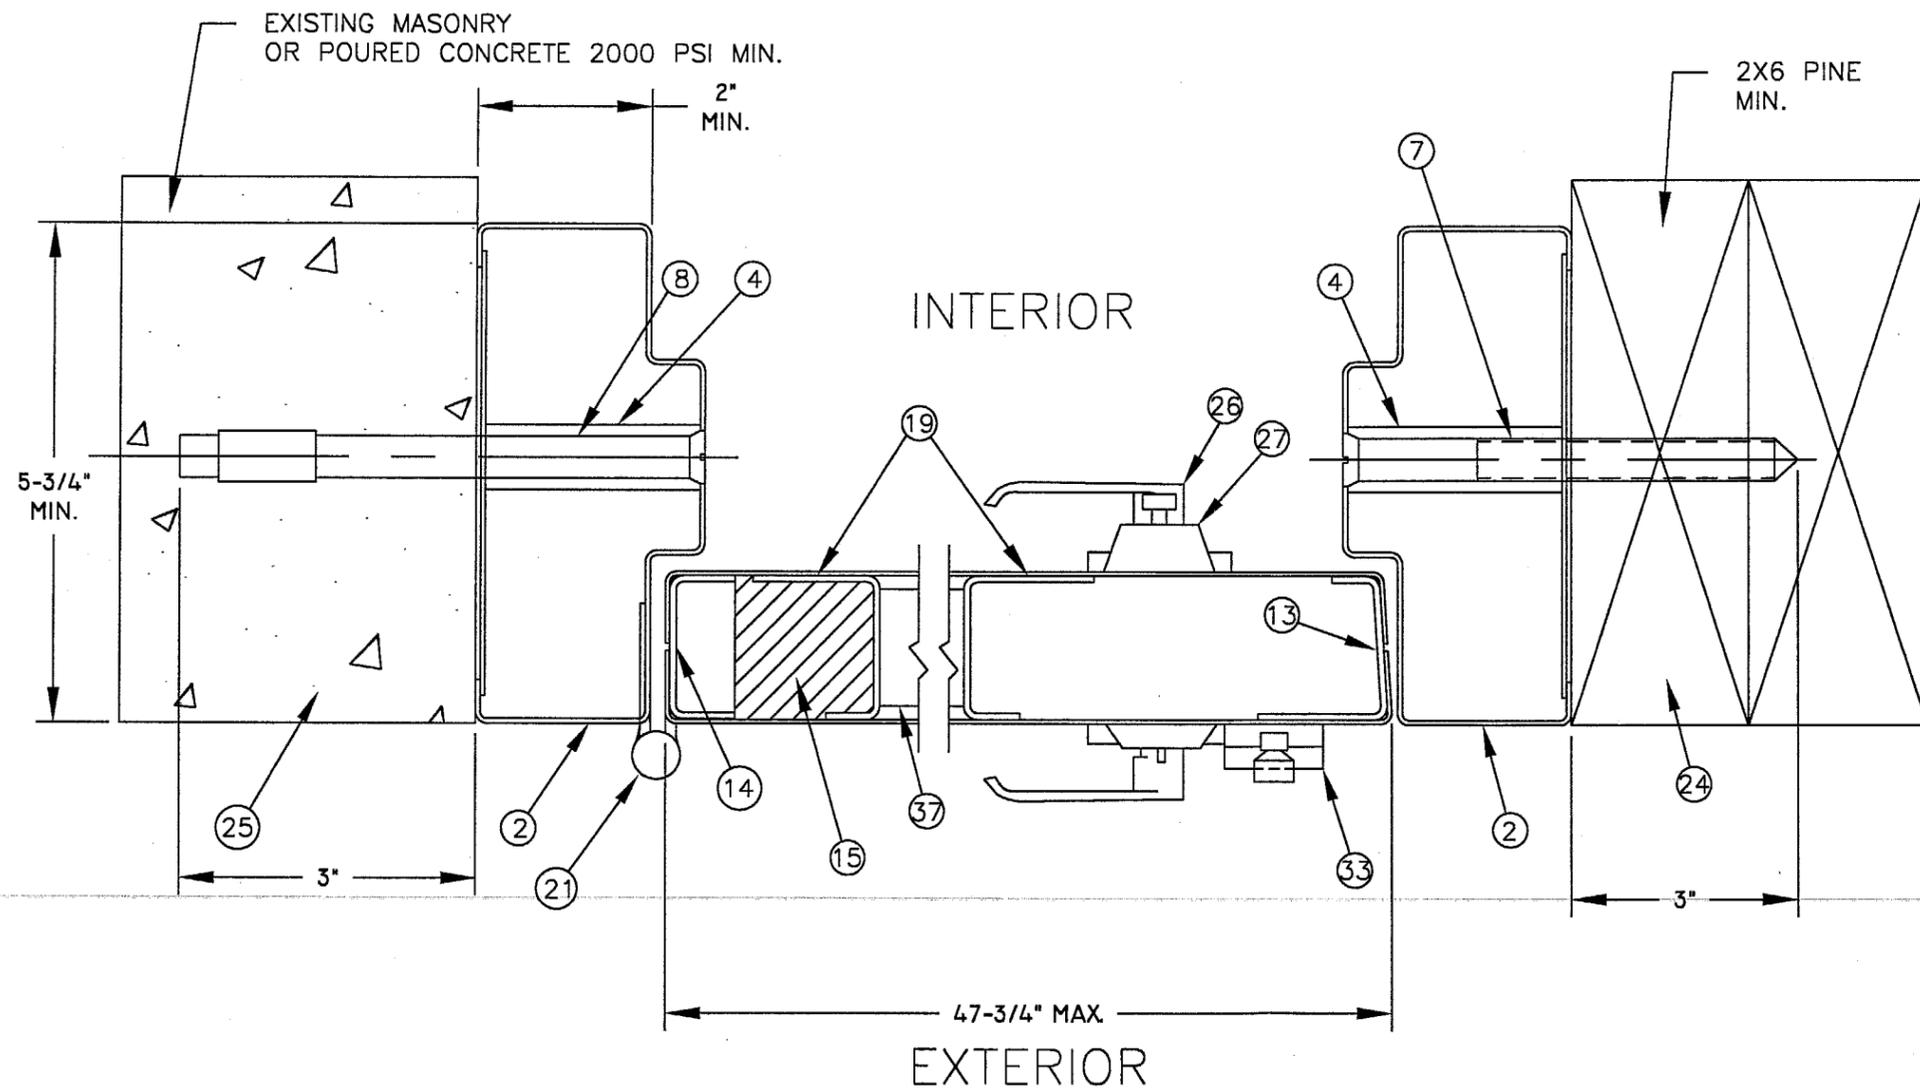


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE GCT04/2001
 BY Ishaq I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

SECTION F-F

SHOWN WITH PIPE SPACER ANCHORS
 IN POURED MASONRY WALL & WOOD STUD WALL


REV	DATE	DESCRIPTION	DR	CK	SC
DR. R	SCHMIDT	CURRIES			
CK.	<i>MSK</i>		MASON CITY, IOWA		
SCAN		TITLE:			
TOLERANCE: UNLESS OTHERWISE SPECIFIED		4'-0 x 8'-0 MODEL 707F			
DEC± .031		OUTSWING DOORS WITH			
ANG± .5°		ANEMOSTAT FPL2 LOUVER,			
FRAC± 1/32		SARGENT CYLINDRICAL LOCK,			
SH SZ: B		& CYLINDRICAL DEADBOLT.			
SCALE: - - - -		SH.NO. 3A OF 11	DWG.NO:		
		DATE: 29-AUG-01	RD0043		

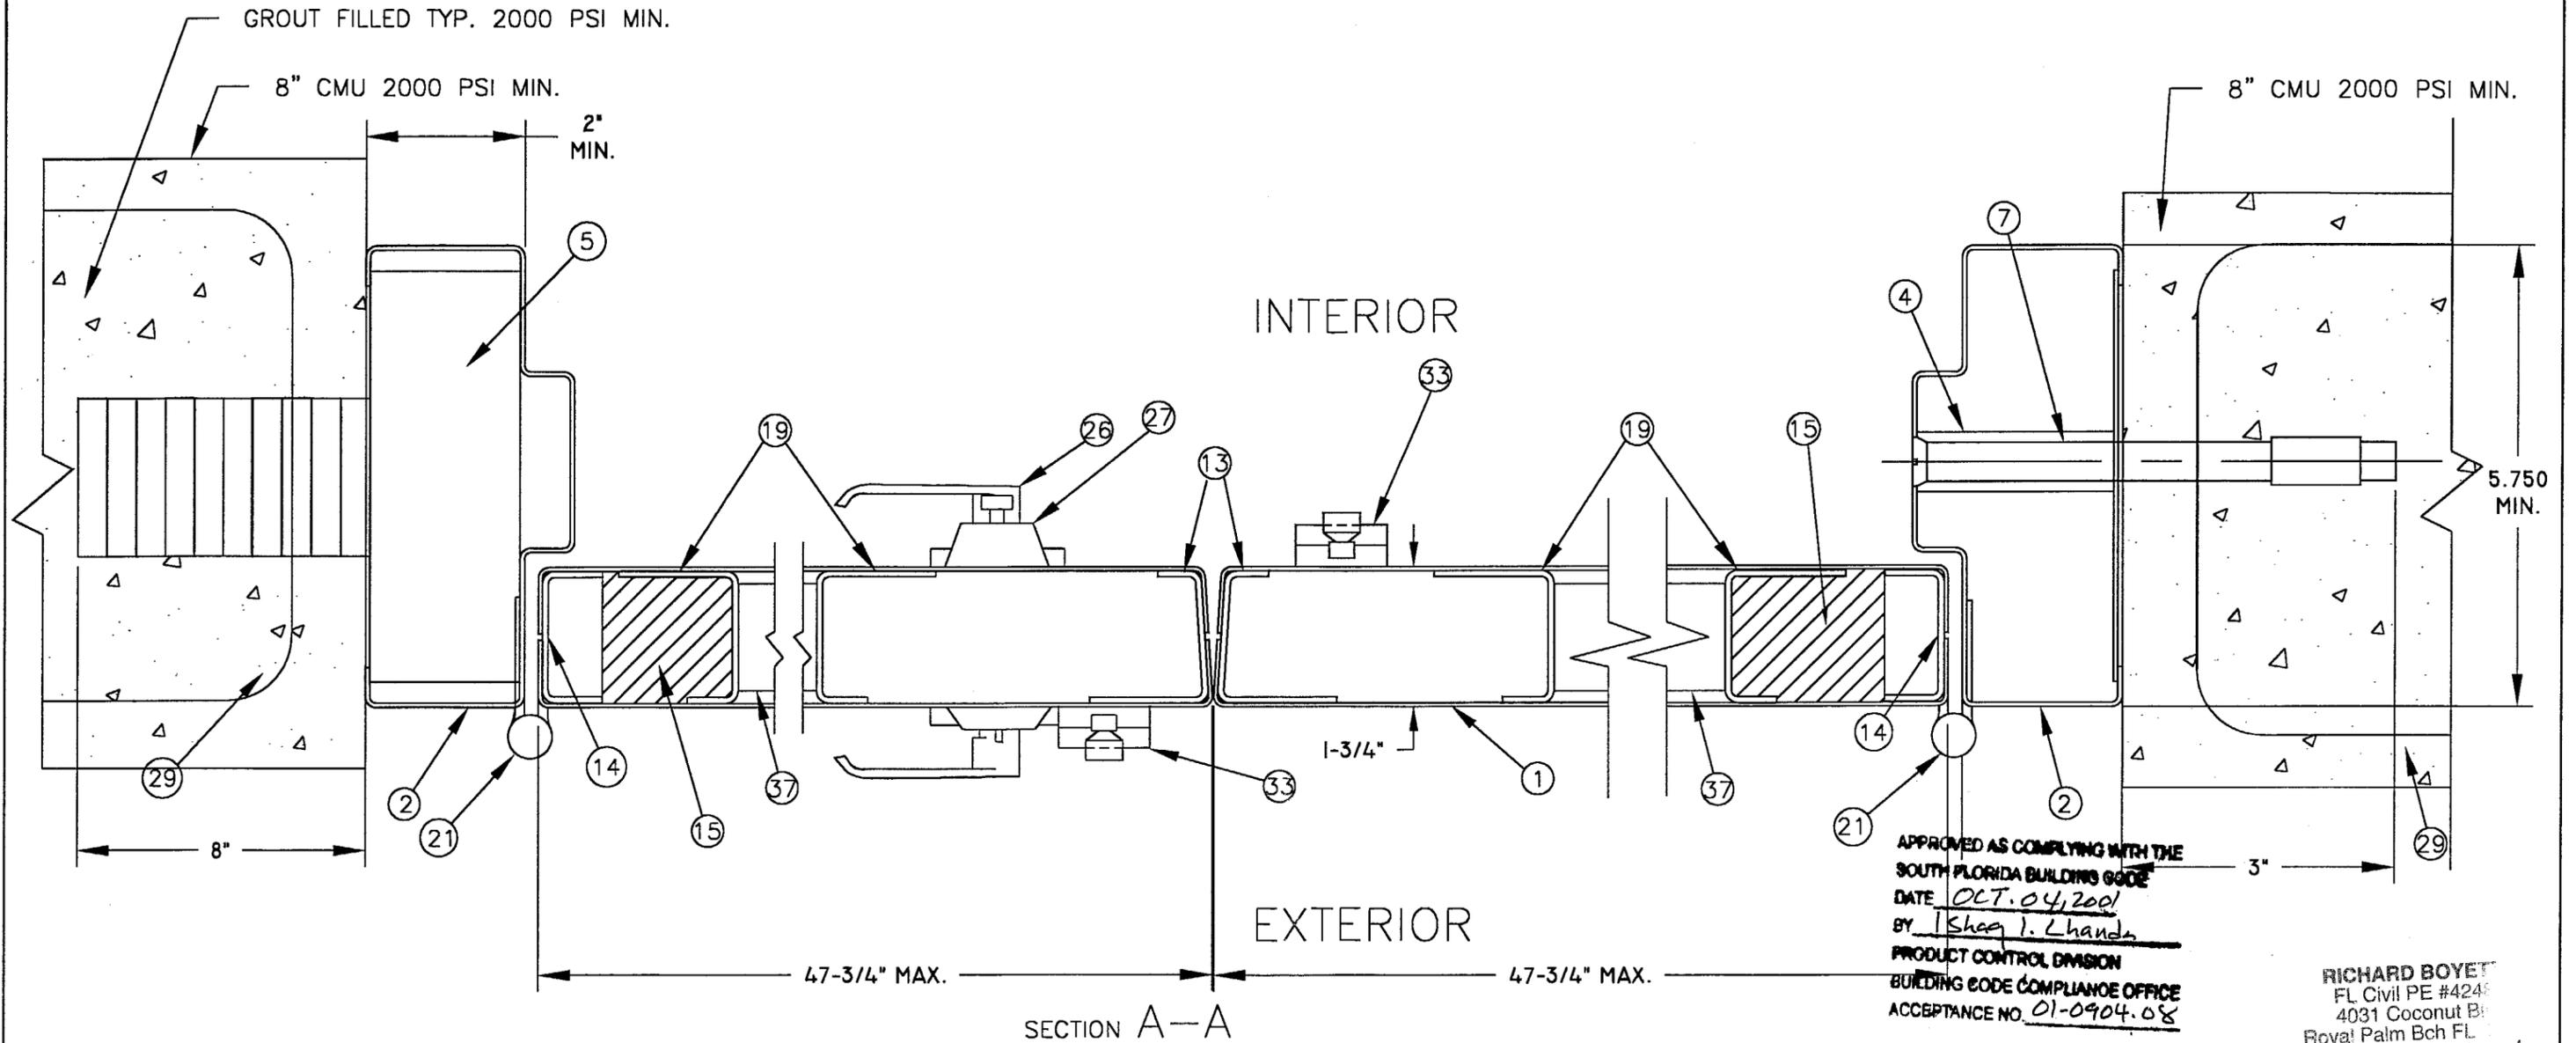

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT. 04, 2001
 BY Ishaq I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

RICHARD BOYET
 FL Civil PE #4246
 4031 Coconut Blvd.
 Royal Palm Bch FL
 (561) 790-5766 Voice
Richard Boyet
 3/8/00

REV	DATE	DESCRIPTION	DR	CK	SC
B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<i>NTK</i>	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
DR. L. SHERIFF		CURRIES MASON CITY, IOWA	APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE <u>March 17, 2000</u> BY <u>Ishaq I. Chanda</u> PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. <u>99-1005.01</u>		
CK. N. KRASCHEL					
SCAN					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031		TITLE: 8'0 X 8'0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER. AND SARGENT CYLINDRICAL LOCK. AND CYLINDRICAL DEADBOLT.			
ANG± .5°					
FRAC± 1/32					
SH SZ: B		SH.NO. 4 OF 11	DWG.NO: RD0043		
SCALE: ----		DATE: 17-AUG-99			



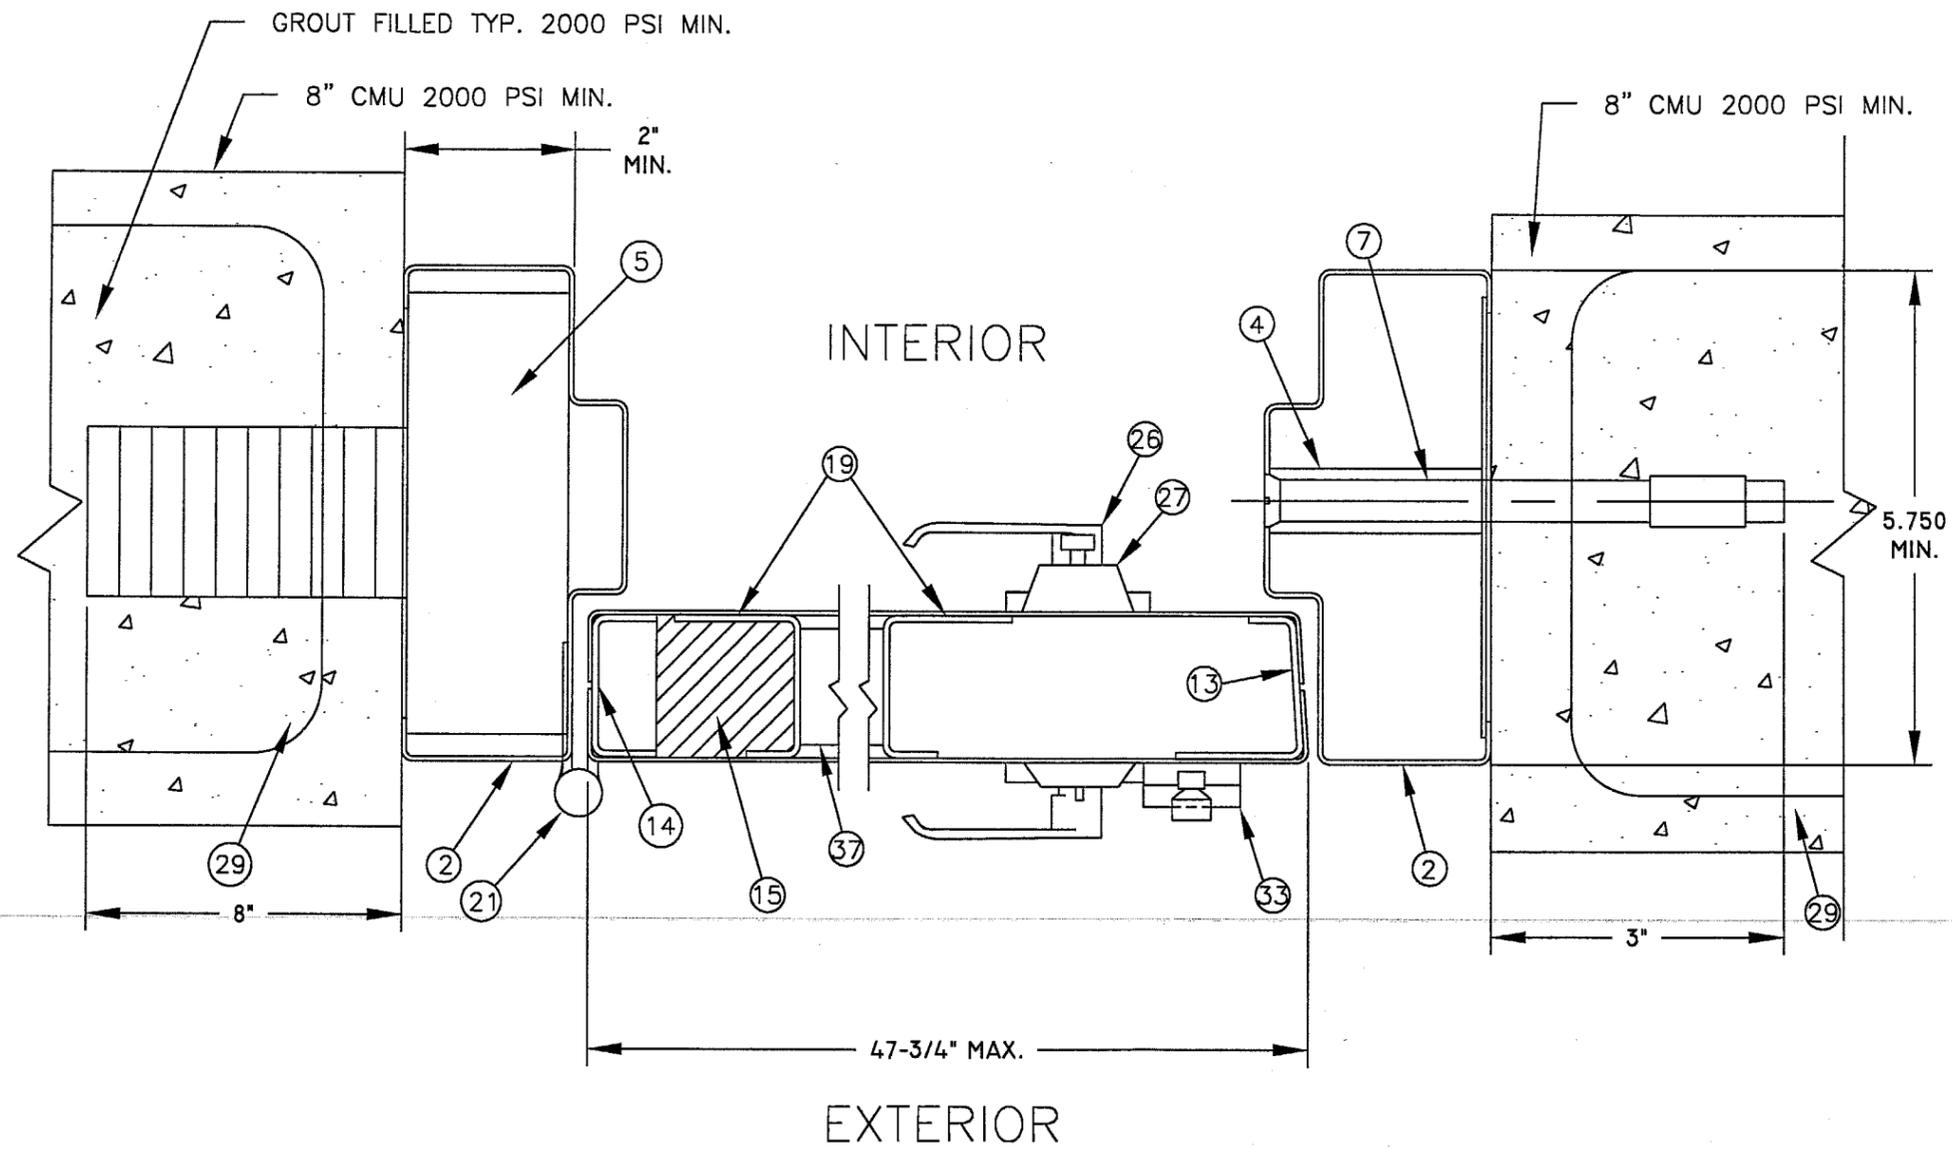


SECTION F-F

SHOWN WITH MASONRY "T" AND PIPE SPACER ANCHORS
IN GROUT FILLED MASONRY BLOCK WALL

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE OCT. 04, 2001
BY Ishaq I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0904.08

REV	DATE	DESCRIPTION	DR	CK	SC
DR. R SCHMIDT		CURRIES MASON CITY, IOWA			
CK. <i>RJR</i>					
SCAN		TITLE: 4'-0 x 8'-0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER, SARGENT CYLINDRICAL LOCK, & CYLINDRICAL DEADBOLT			
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031					
ANG± .5'					
FRAC± 1/32					
SH SZ: B	SH.NO. 4A OF 11	DWG.NO:			
SCALE: - - - -	DATE: 29-AUG-01	RD0043			

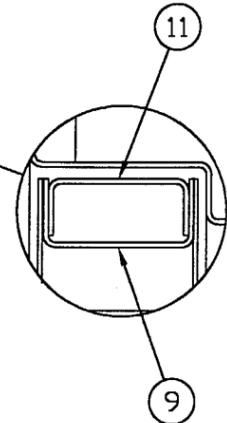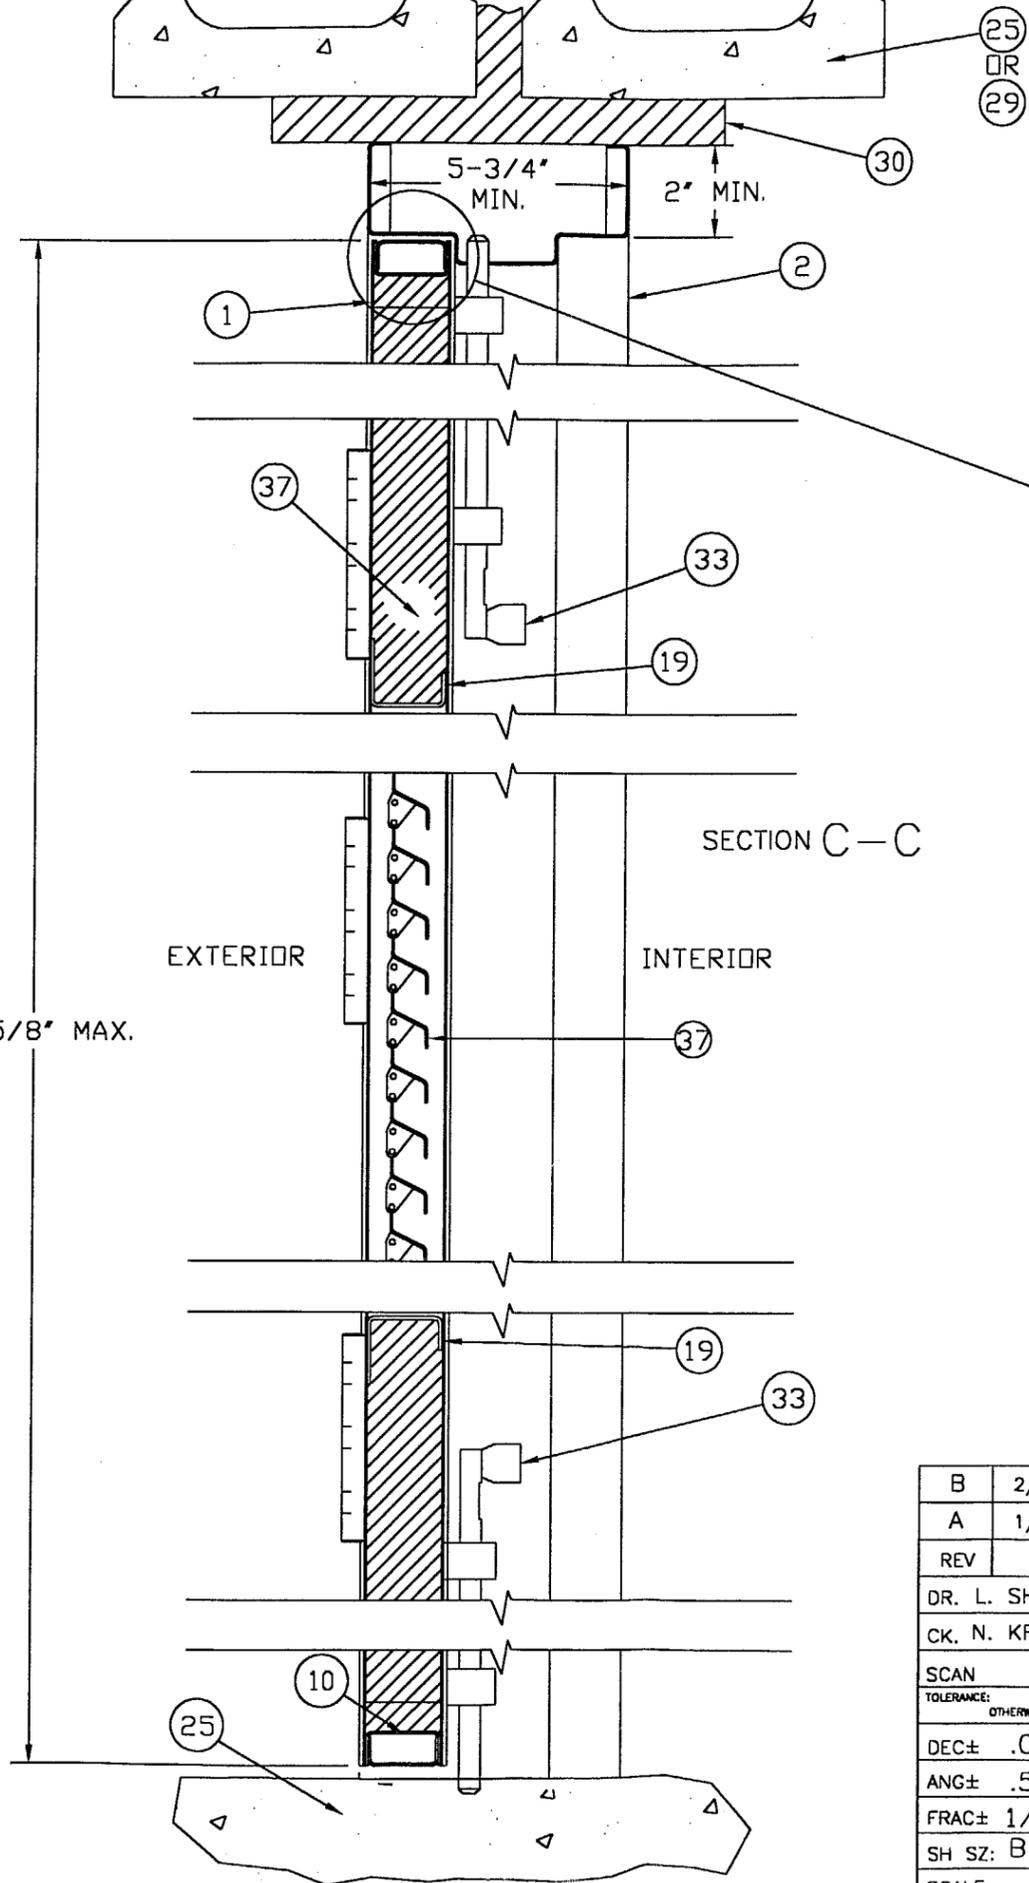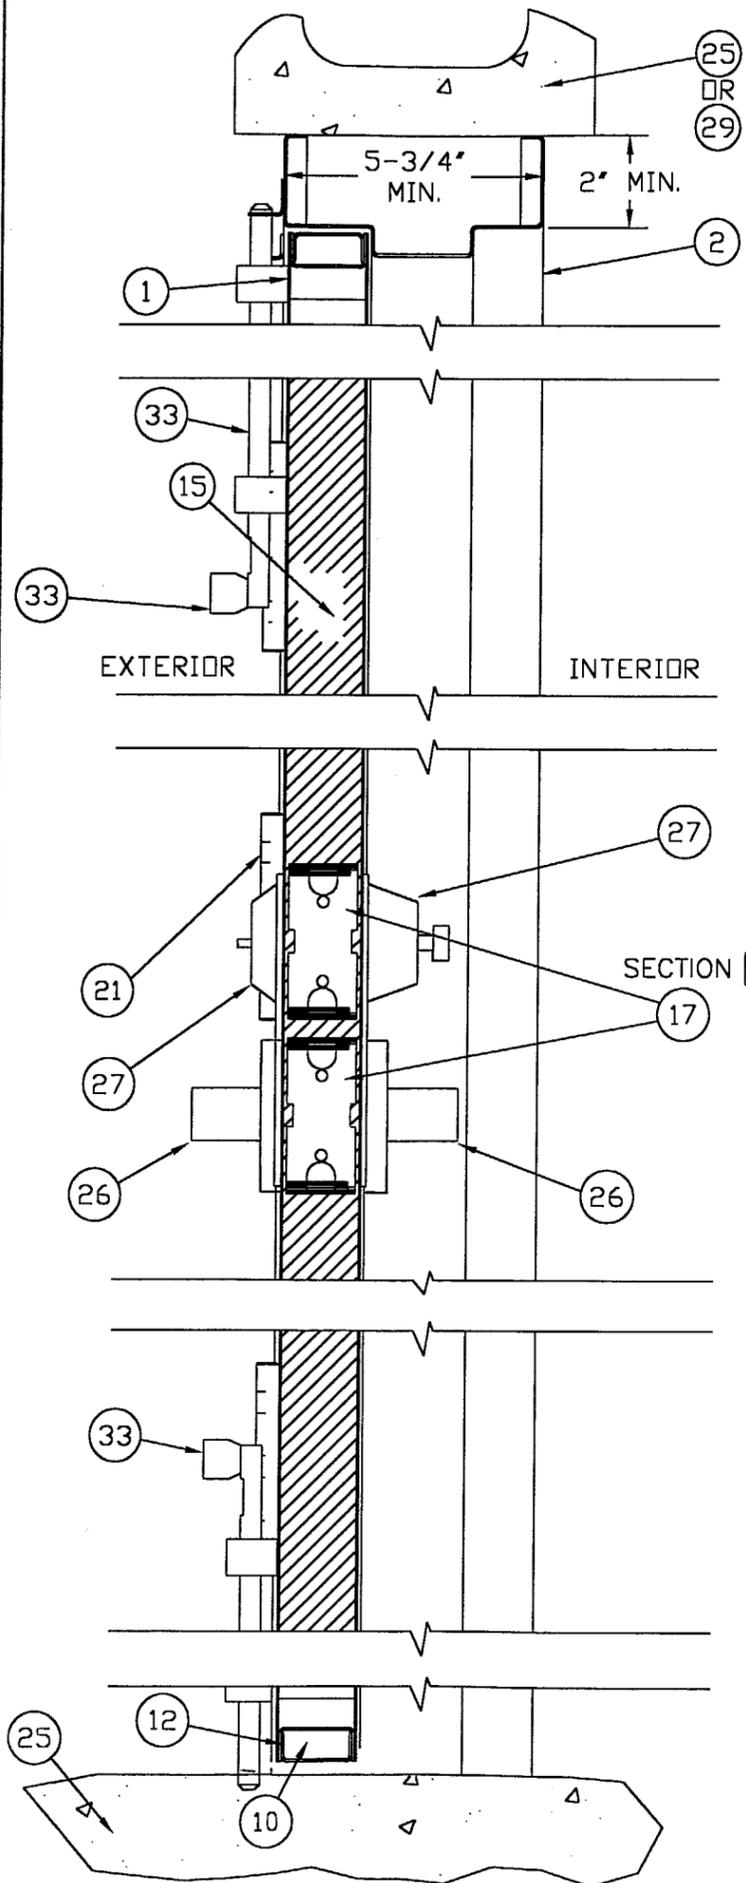

SCALE: 2-1



APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT. 04, 2001
 BY Ishaq I. Chaudhry
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904-08

RICHARD BOYETTE
 FL Civil PE #42485
 4031 Coconut Blvd
 Royal Palm Bch FL 33411
 (561) 790-5766 Voice /
Richard Boyette

B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<i>NSK</i>	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
REV	DATE	DESCRIPTION	DR	CK	SC
DR. L. SHERIFF					
CK. N. KRASCHEL					
SCAN					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031					
ANG± .5°					
FRAC± 1/32					
SH SZ: B			SH.NO. 5 OF 11		DWG.NO. RDO043
SCALE: -----			DATE: 17-AUG-99		

CURRIES
 MASON CITY, IOWA
 TITLE: 8'0 X 8'0 MODEL 707F
 OUTSWING DOORS WITH
 ANEMOSTAT FPL2 LOUVER,
 AND SARGENT CYLINDRICAL LOCK,
 AND CYLINDRICAL DEADBOLT.



APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE March 17, 2000
 BY Ishaq I. Chaudhry
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1005-01

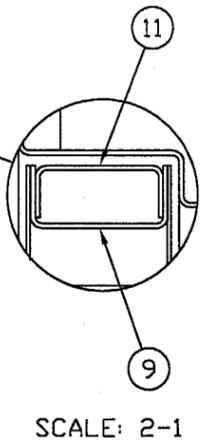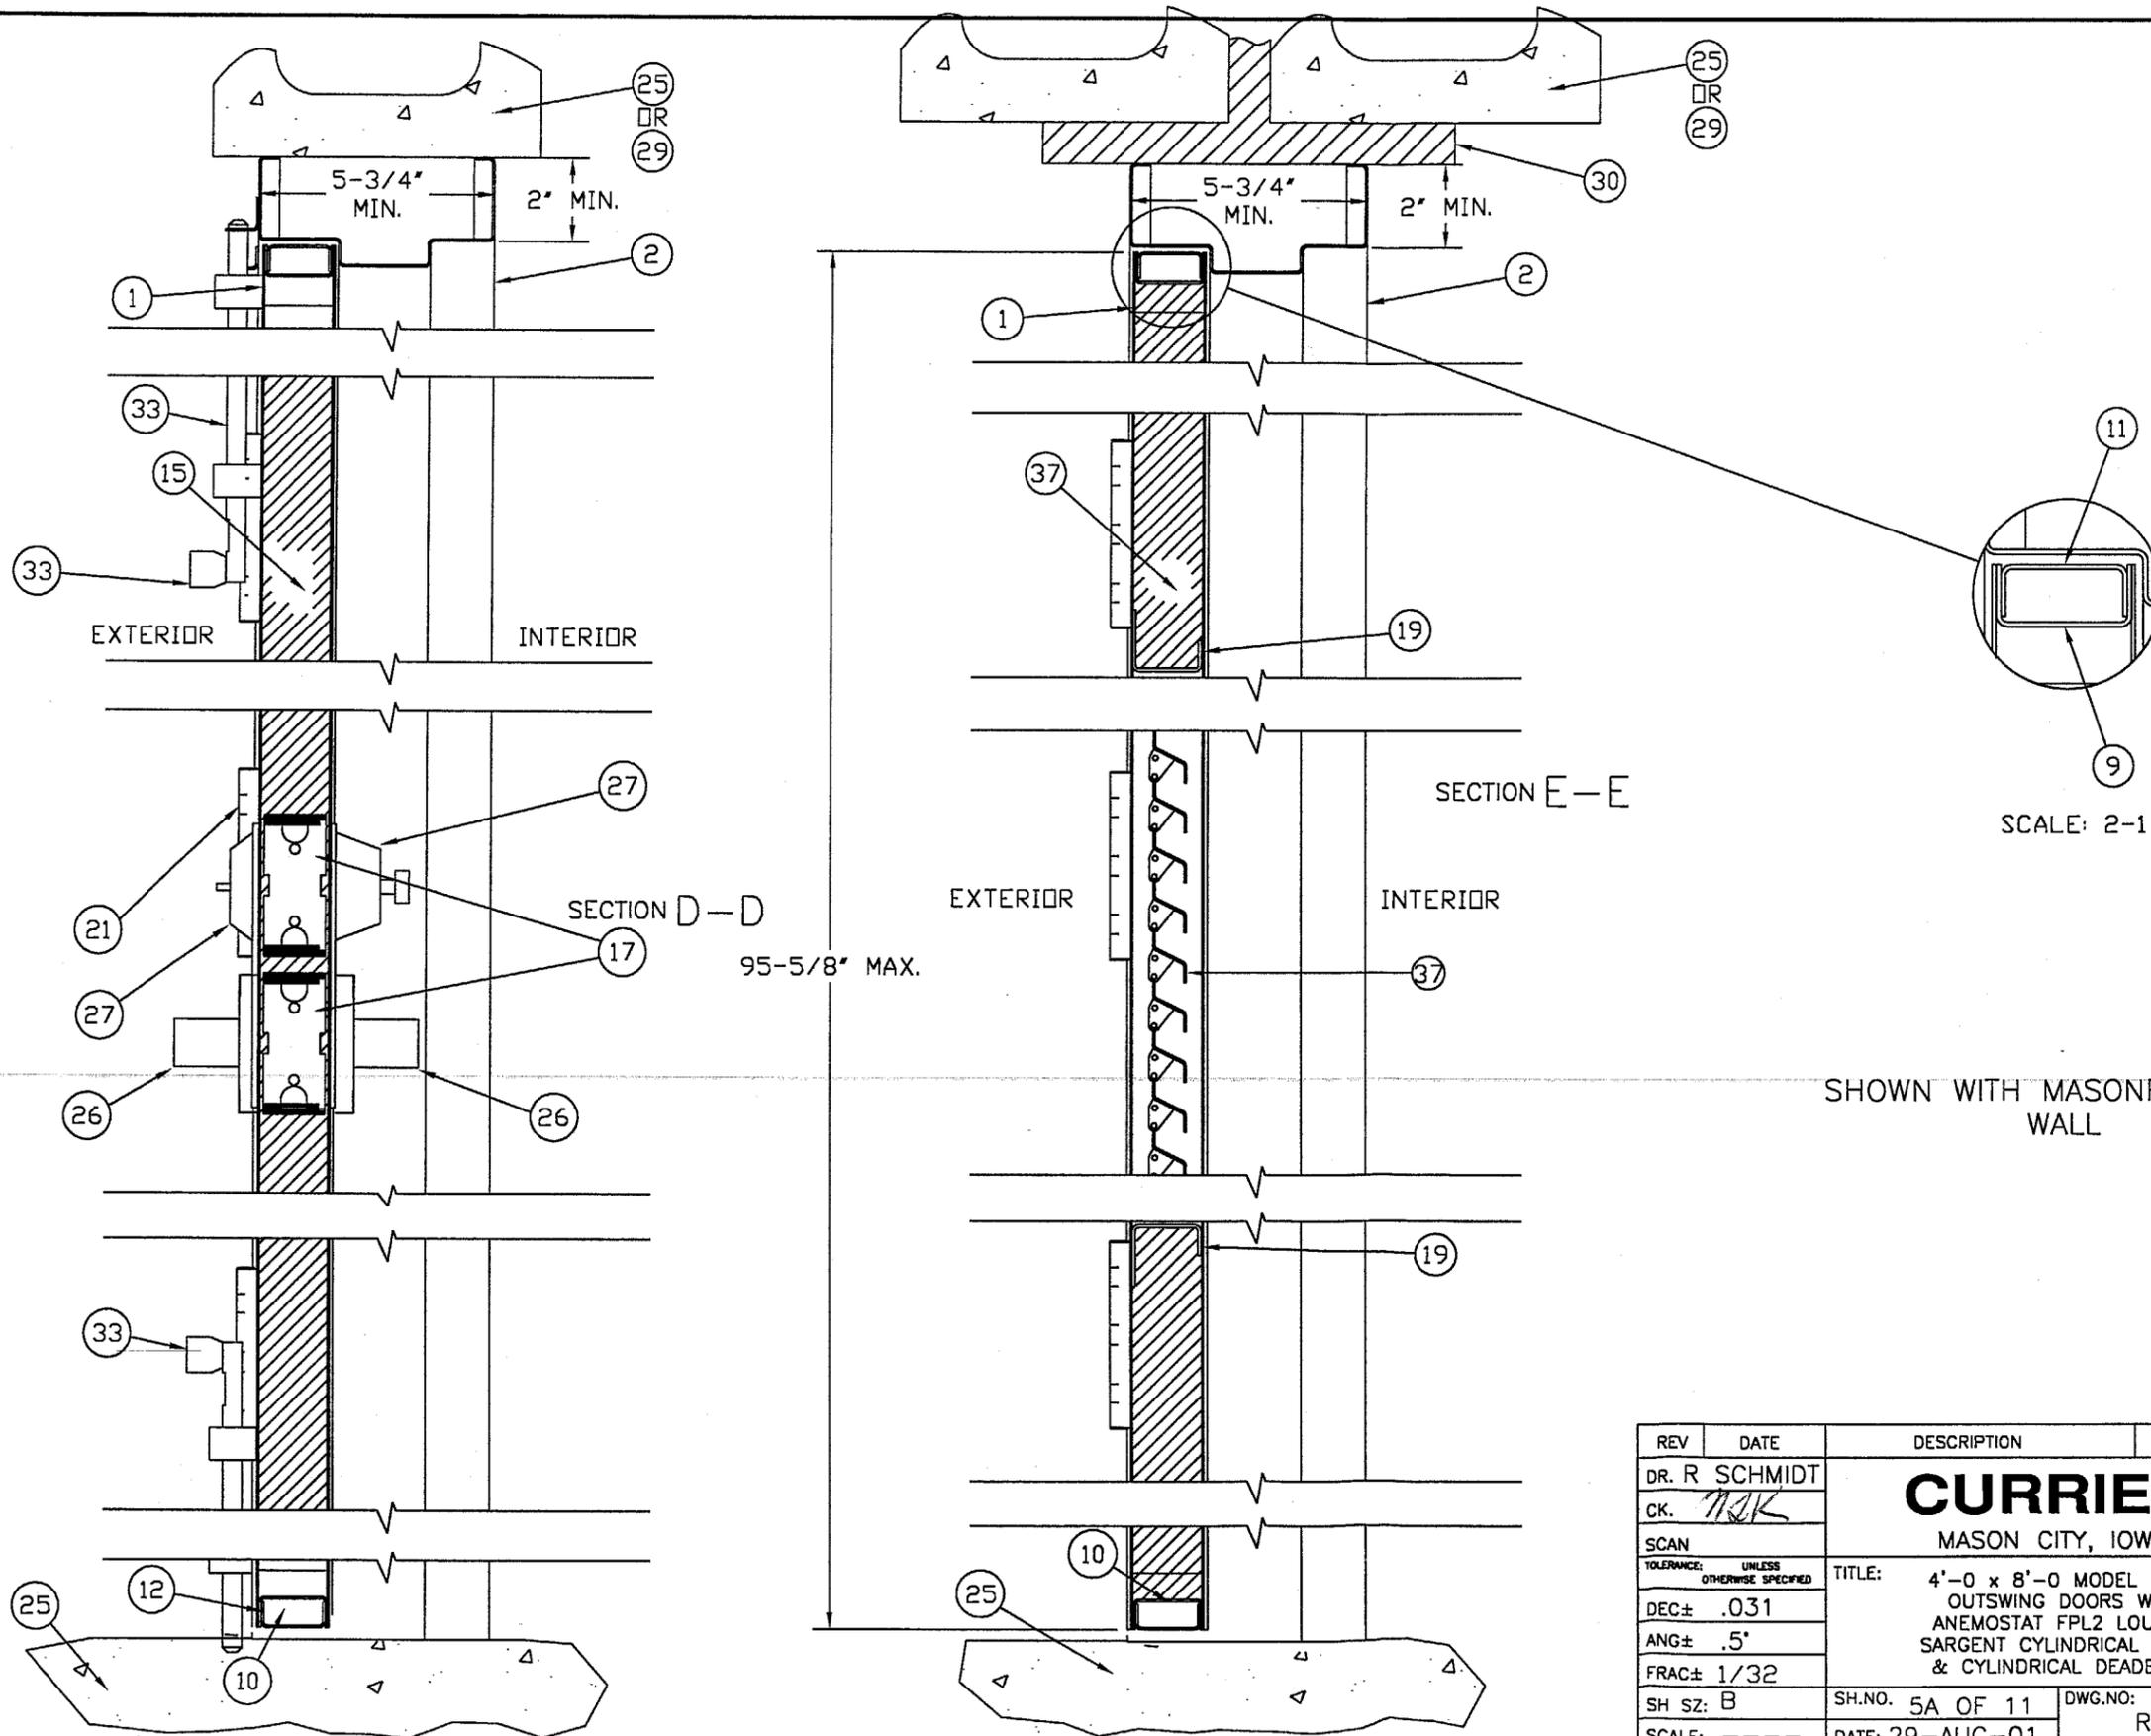

SHOWN WITH MASONRY BLOCK WALL

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT 04, 2001
 BY Ishaq J. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904-08

REV	DATE	DESCRIPTION	DR	CK	SC
DR. R SCHMIDT		CURRIES			
CK. <i>TRK</i>					
SCAN		MASON CITY, IOWA			
TOLERANCE: UNLESS OTHERWISE SPECIFIED		TITLE: 4'-0 x 8'-0 MODEL 707F			
DEC± .031		OUTSWING DOORS WITH			
ANG± .5°		ANEMOSTAT FPL2 LOUVER,			
FRAC± 1/32		SARGENT CYLINDRICAL LOCK,			
SH SZ: B		& CYLINDRICAL DEADBOLT.			
SCALE: ----		SH.NO. 5A OF 11	DWG.NO:		
		DATE: 29-AUG-01	RD0043		

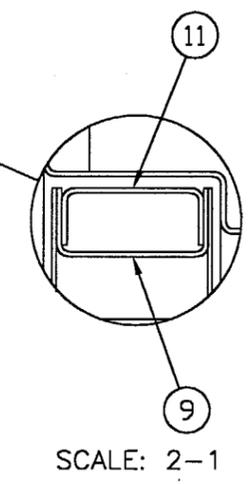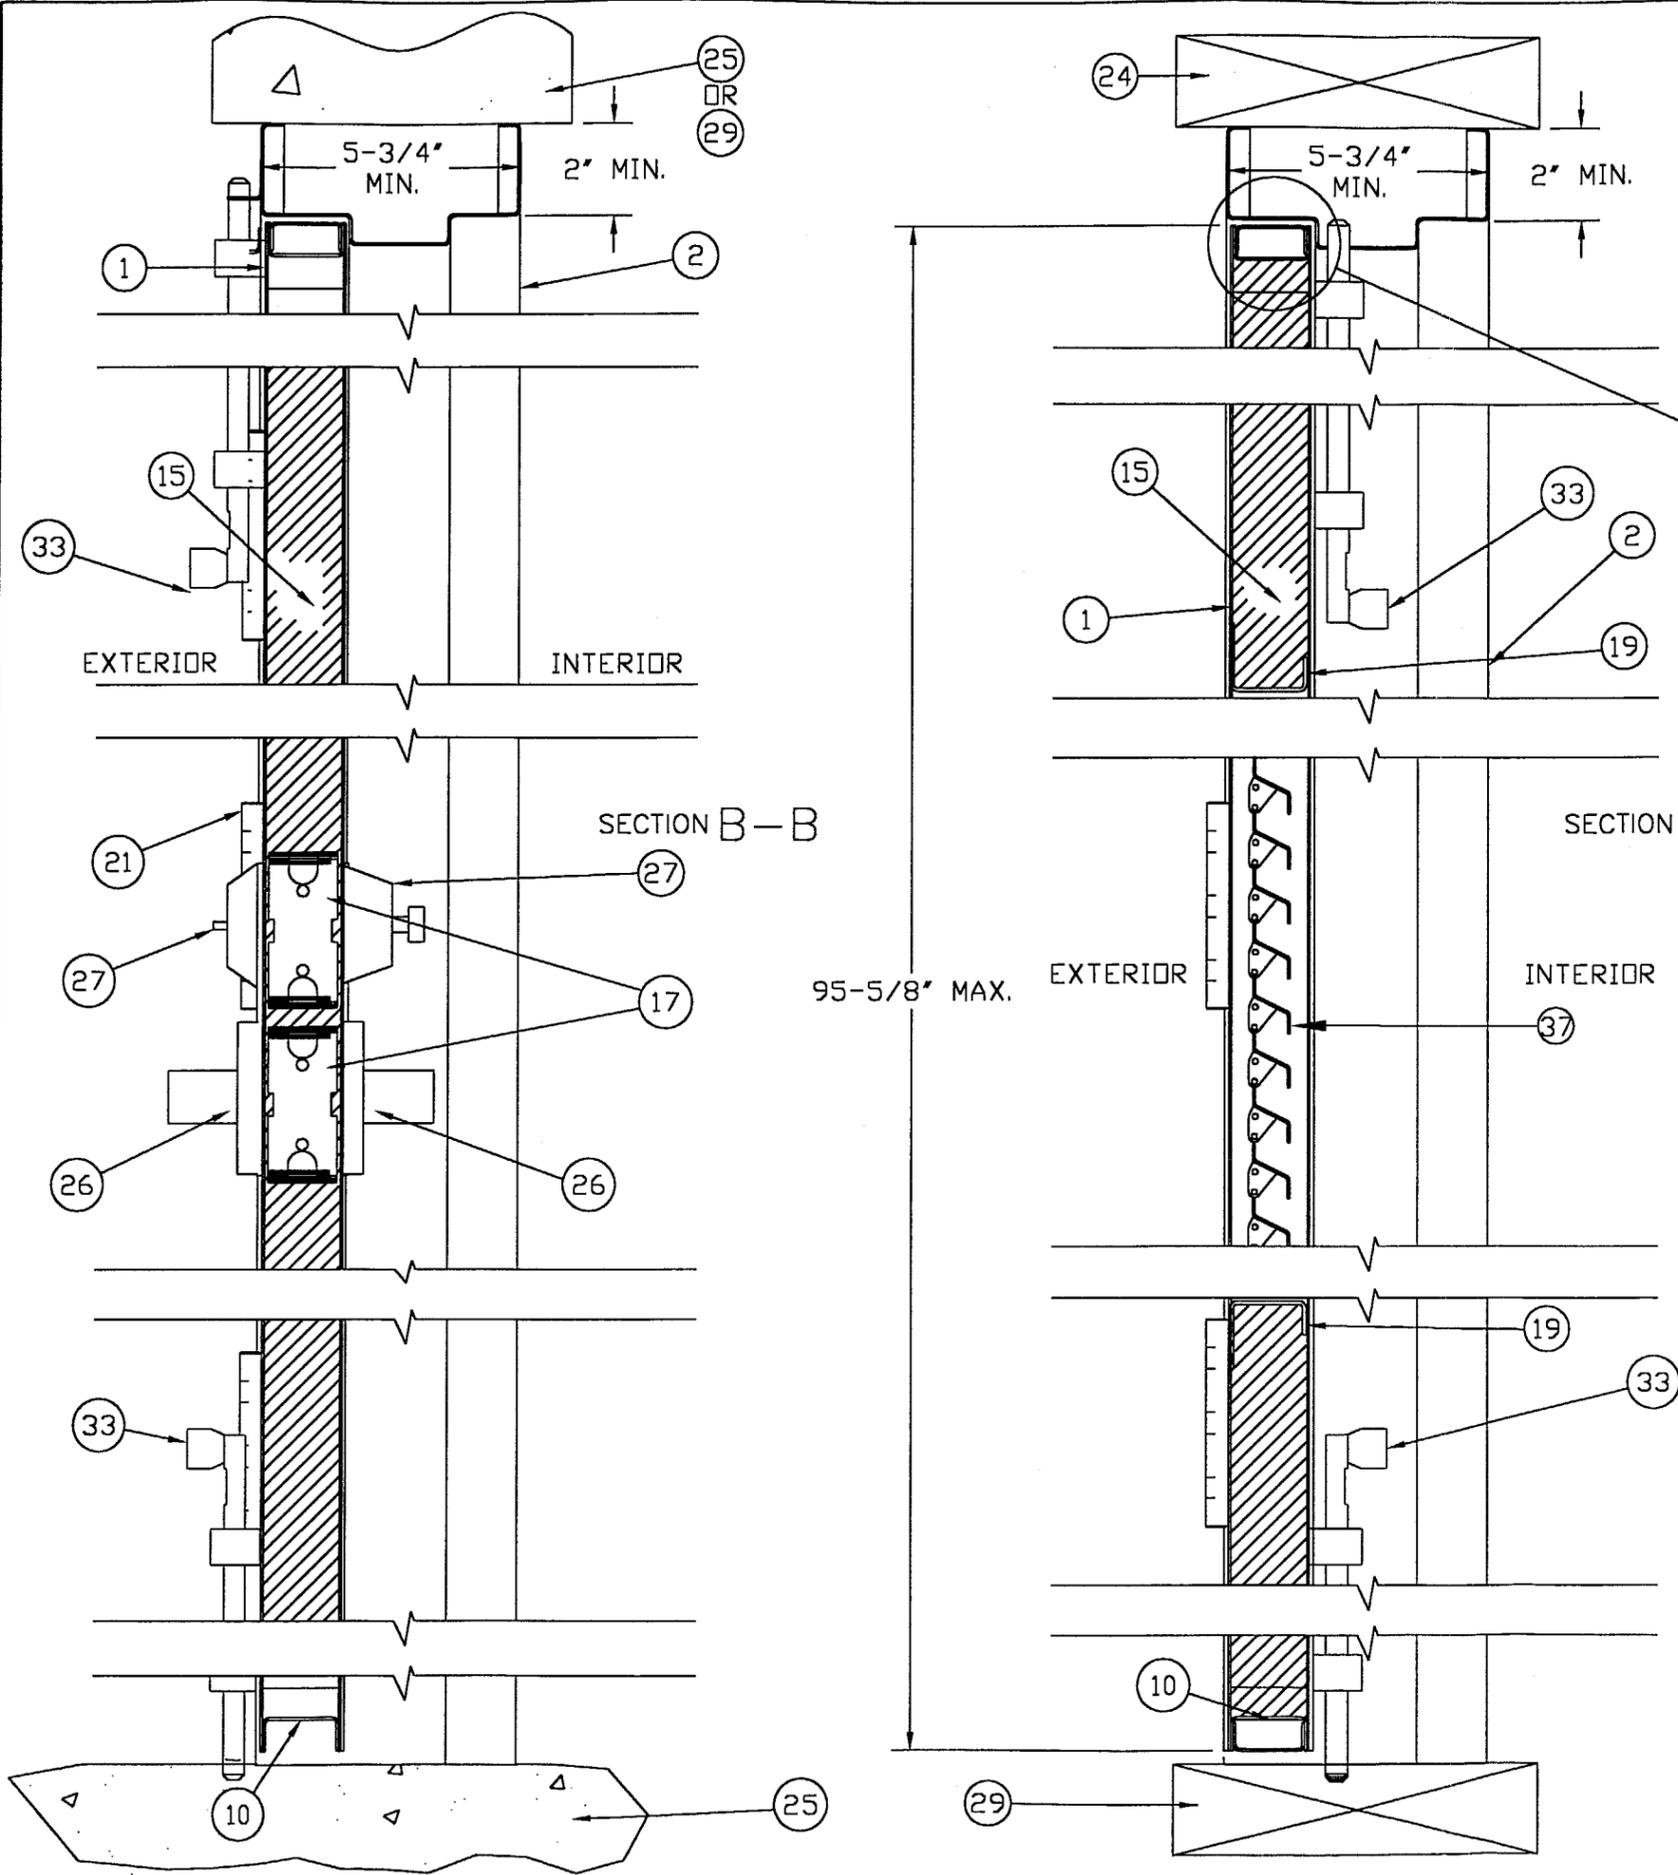


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT. 04, 2001
 BY Ishag J. Chaudh
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08


RICHARD BOYETTE
 FL Civil PE #42485
 4031 Coconut Blvd
 Royal Palm Bch FL 33411
 (561) 790-5766 Voice /
Richard Boyette
 3/8/00

B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<i>NTK</i>	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
REV	DATE	DESCRIPTION	DR	CK	SC
DR. L. SHERIFF			CURRIES		
CK. N. KRASCHEL					
SCAN			MASON CITY, IOWA		
TOLERANCE: UNLESS OTHERWISE SPECIFIED			TITLE: 8'0 X 8'0 MODEL 707F		
DEC± .031			OUTSWING DOORS WITH		
ANG± .5°			ANEMOSTAT FPL2 LOUVER.		
FRAC± 1/32			AND SARGENT CYLINDRICAL LOCK.		
SH SZ: B			AND CYLINDRICAL DEADBOLT.		
SCALE: - - - -			SH.NO. 6 OF 11		DWG.NO. RD0043
			DATE: 17-AUG-99		


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE March 17, 2000
 BY Ishag J. Chaudh
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1005-01

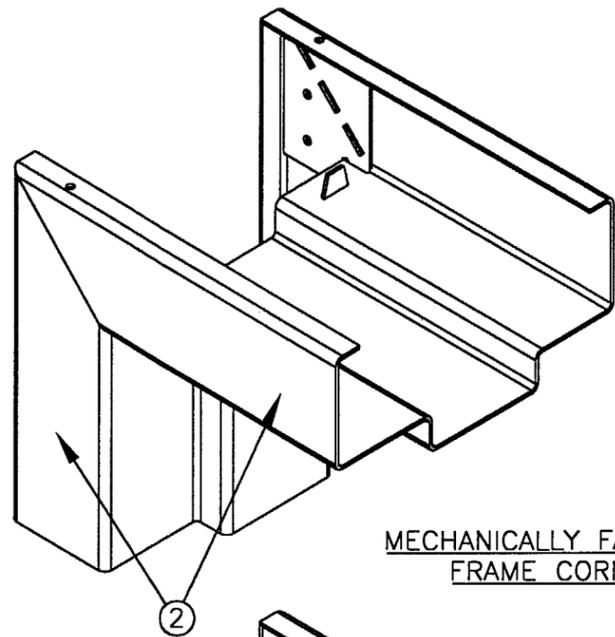


MECHANICALLY FASTENED
FRAME CORNER

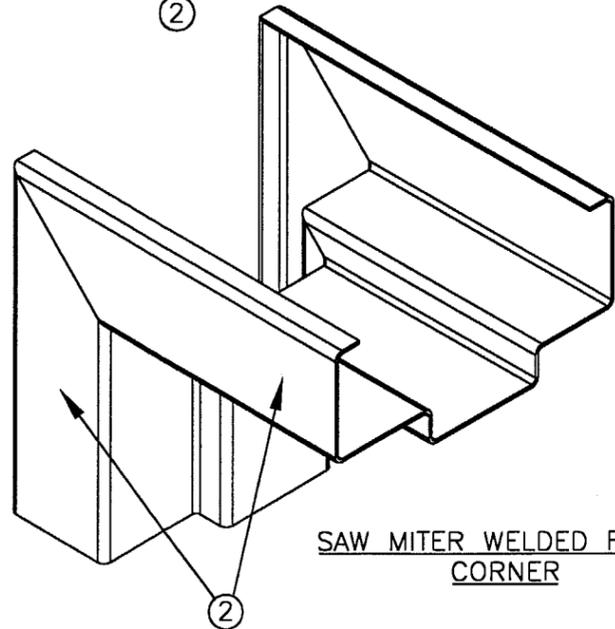


SAW MITER WELDED FRAME
CORNER

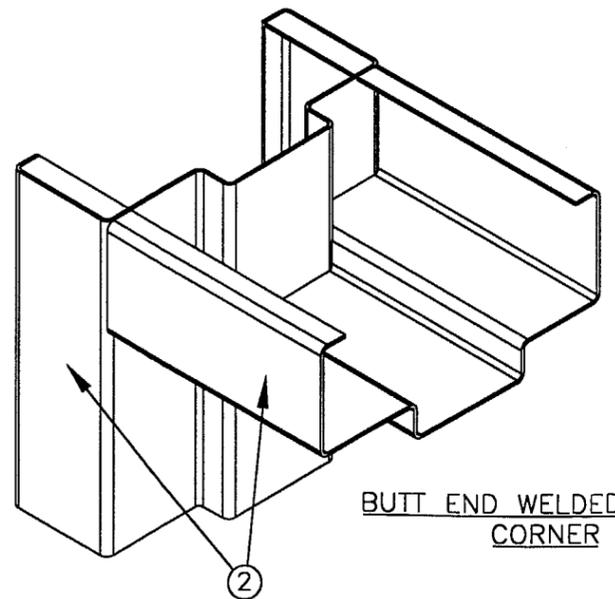


BUTT END WELDED FRAME
CORNER

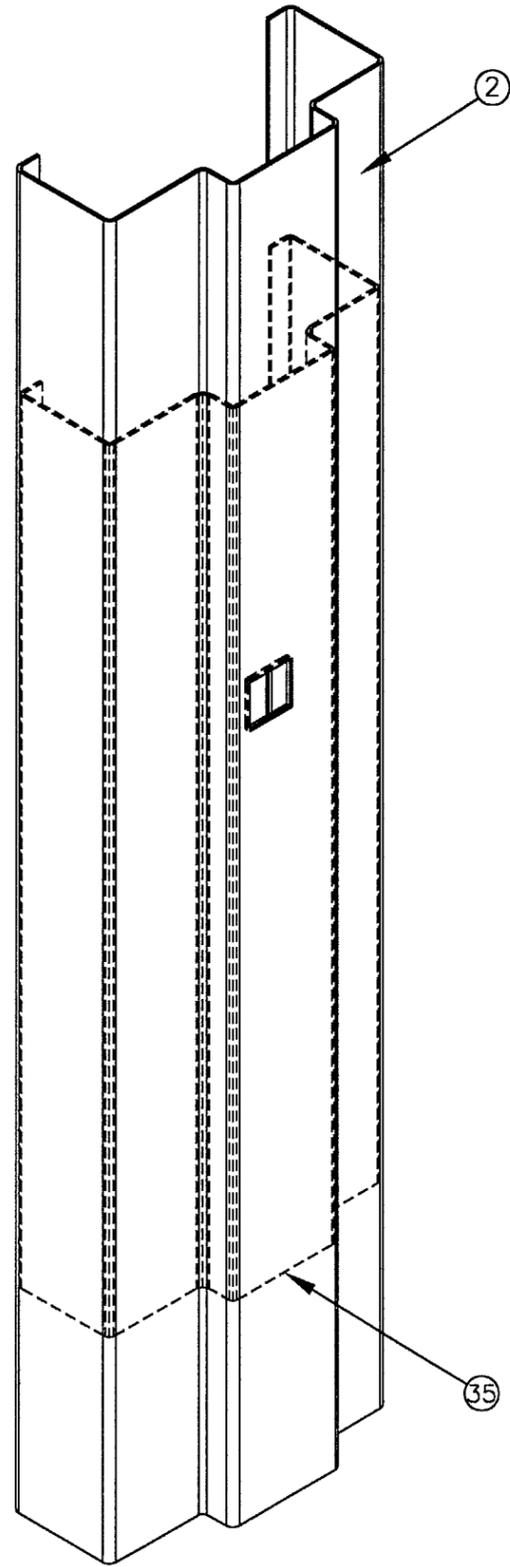


HEAD PREPARATION

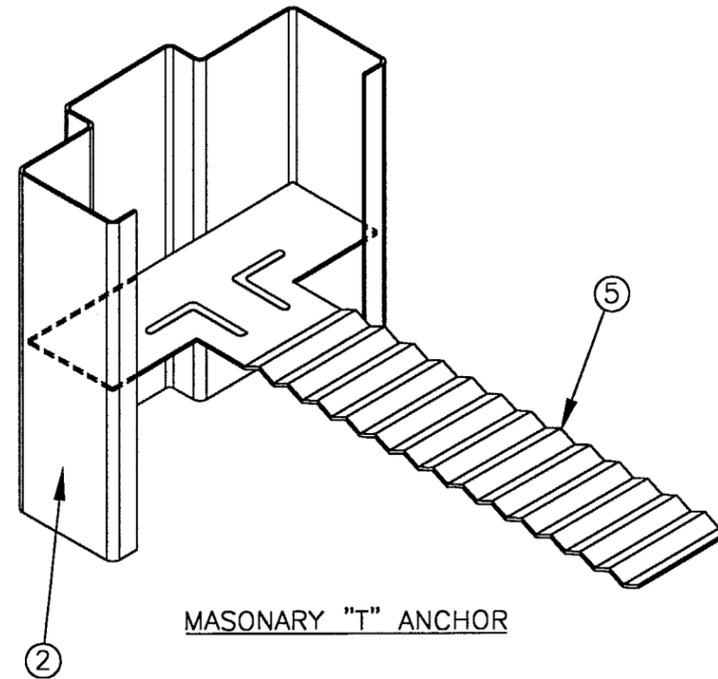

MASONRY "T" ANCHOR

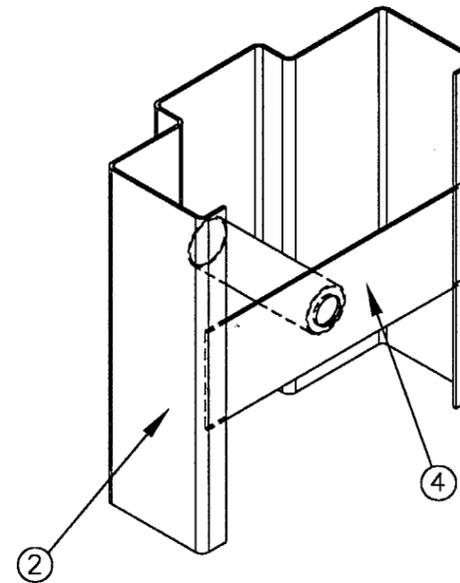

PIPE SPACER ANCHOR

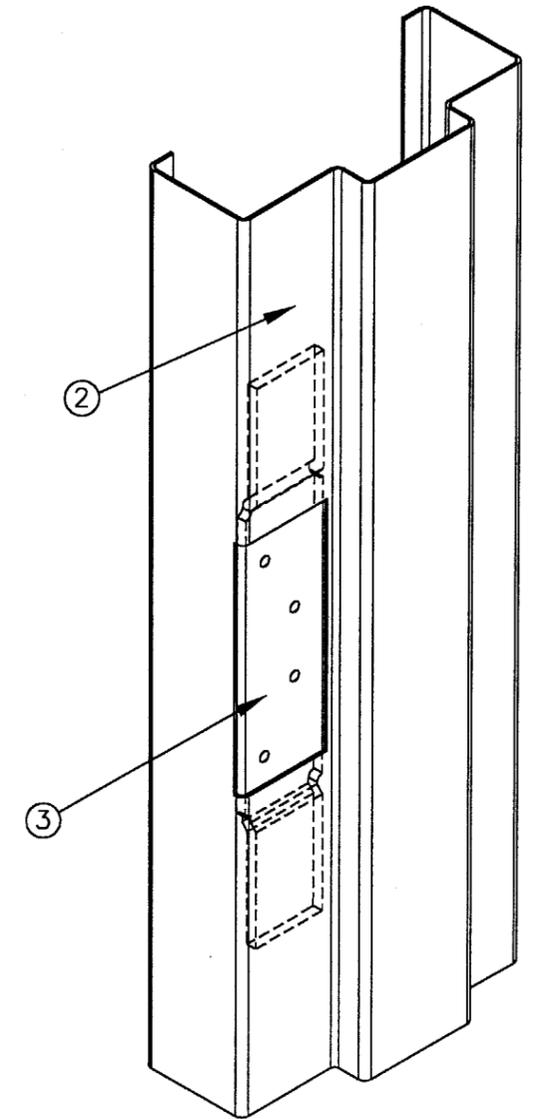

HINGE PREPARATION








APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE OCT. 04, 2001
BY Ishaq I. Chaudh
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0904.08

RICHARD BOYETT
FL Civil PE #4240
4031 Coconut Bly
Royal Palm Bch FL
(561) 790-5766 Voice

Richard Boyett 3/1/00

B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<i>JK</i>		
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK		
REV	DATE	DESCRIPTION	DR	CK	SC	
DR. L. SHERIFF			<p>CURRIES MASON CITY, IOWA</p> <p>TITLE: 8'0 X 8'0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER, AND SARGENT CYLINDRICAL LOCK, AND CYLINDRICAL DEADBOLT.</p>			
CK. N. KRASCHEL						
SCAN						
TOLERANCE: UNLESS OTHERWISE SPECIFIED						
DEC±	.031					
ANG±	.5°					
FRAC±	1/32					
SH SZ:	B	SH.NO. 7 OF 11	DWG.NO:			
SCALE:	----	DATE: 17-AUG-99	RD0043			

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE March 17, 2000
BY Ishaq I. Chaudh
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 99-1005-01

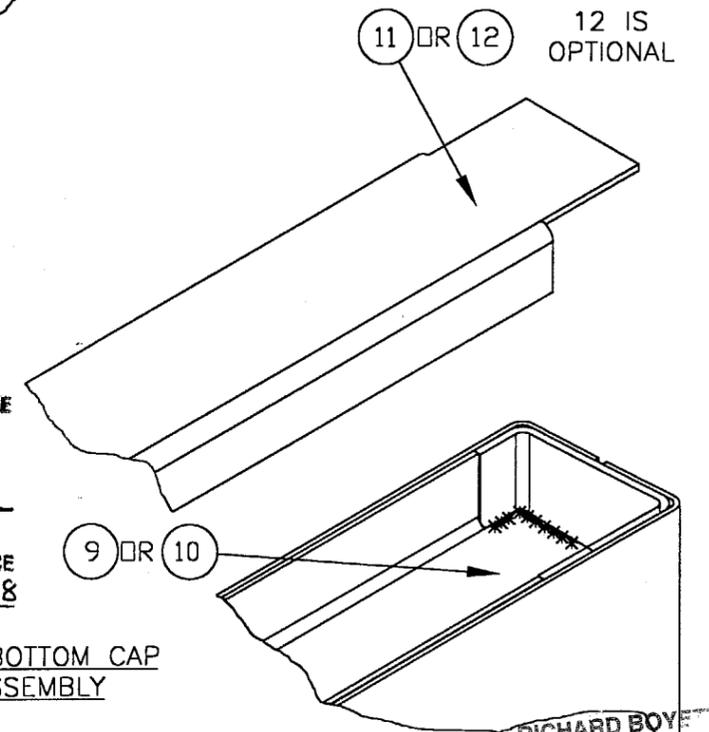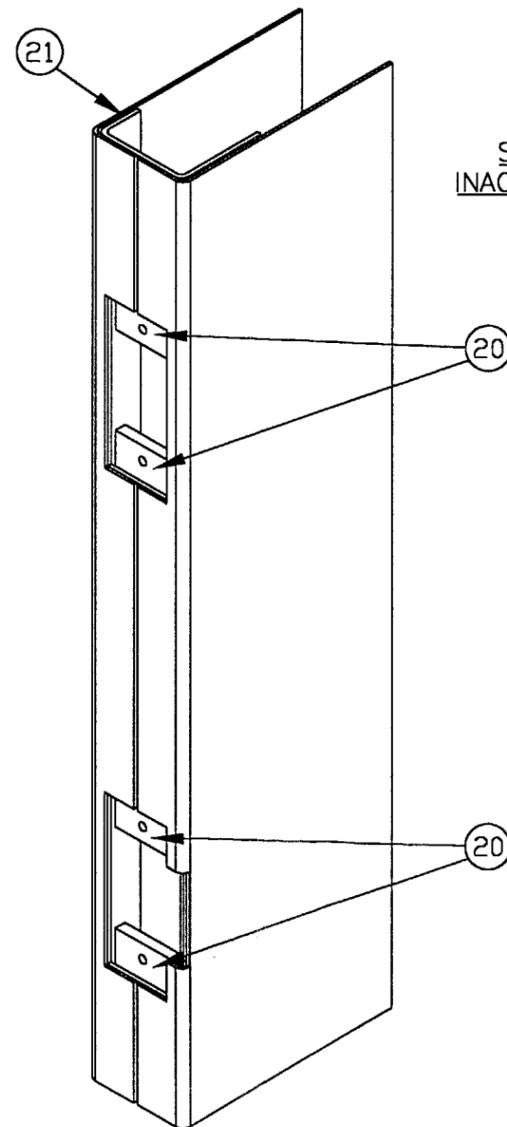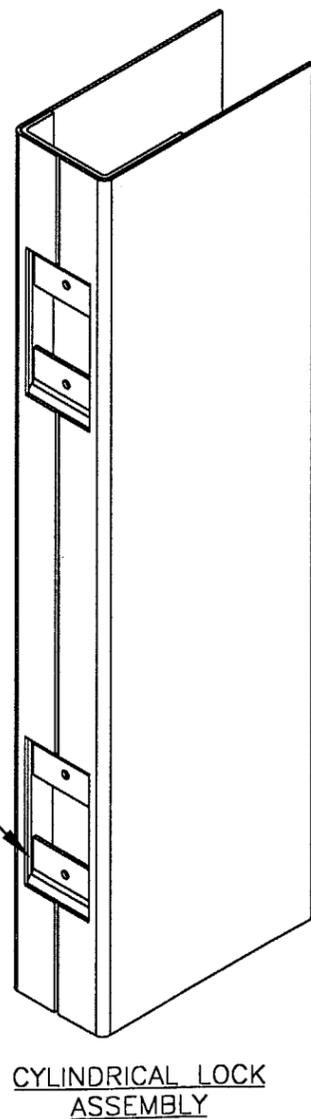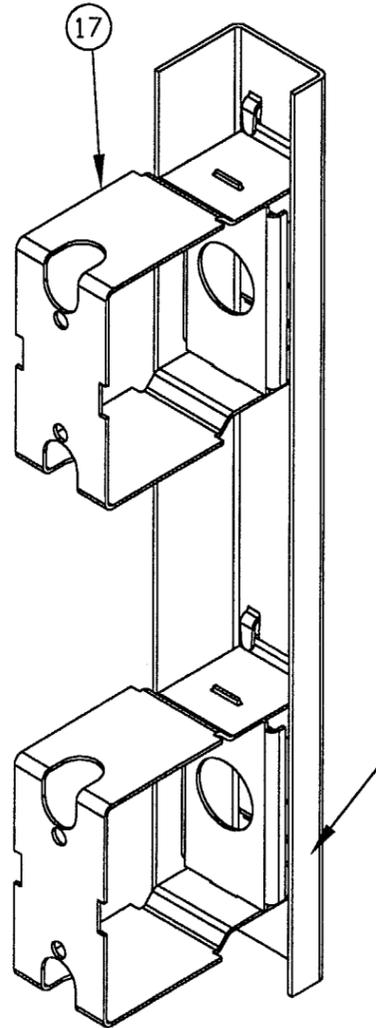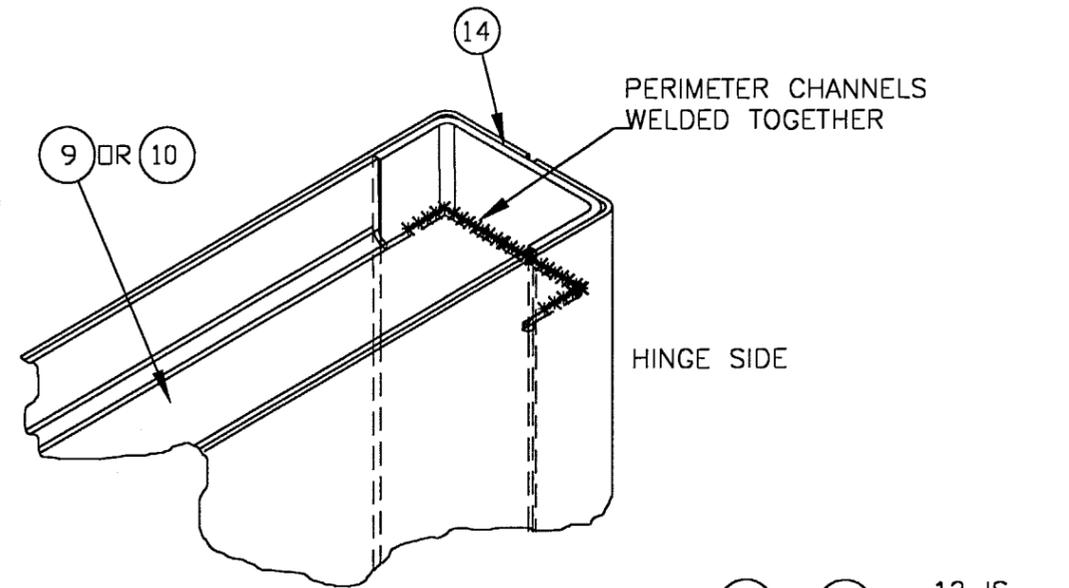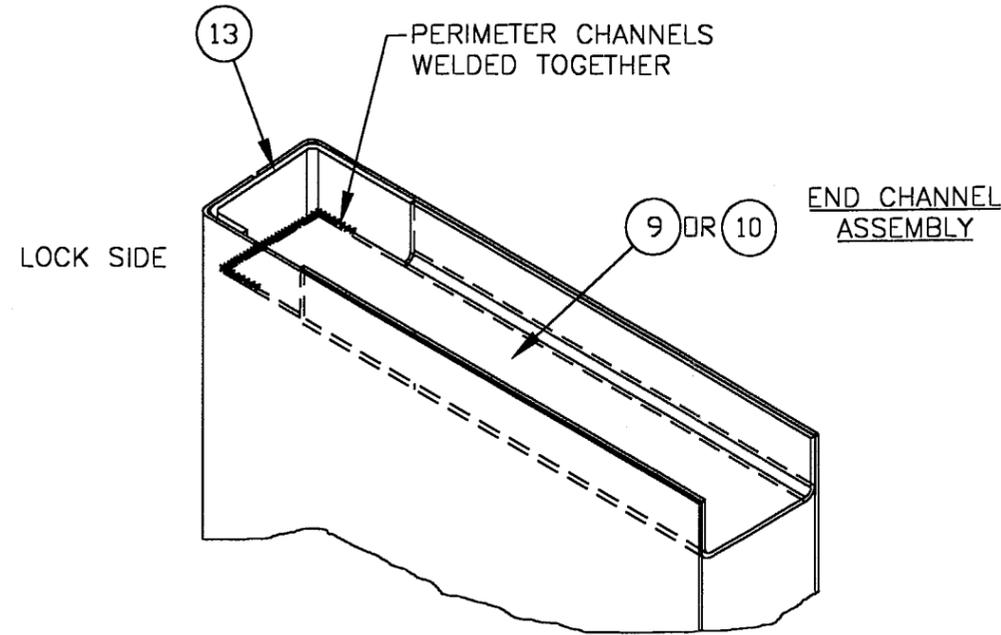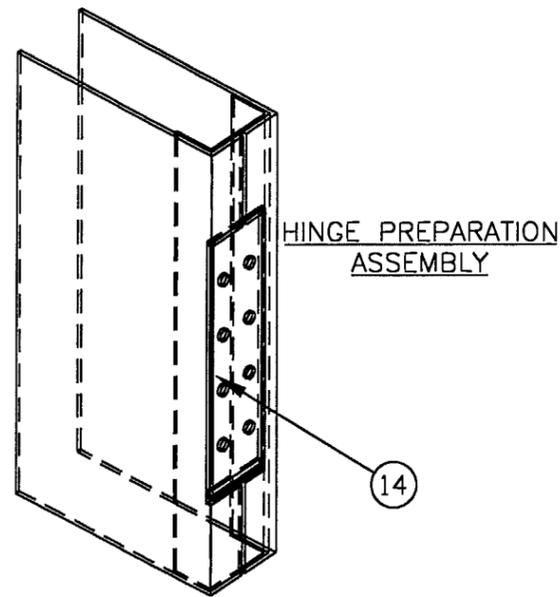

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE OCT 04, 2001
 BY Ishag I. Chaudh
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08


RICHARD BOYE
 FL Civil PE #42
 4031 Coconut
 Royal Palm Bch Fl
 (561) 790-5766

REV	DATE	DESCRIPTION	DR	CK	SC
B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<i>NTK</i>	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	



DR. L. SHERIFF	CURRIES MASON CITY, IOWA TITLE: 8'0 X 8'0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER, AND SARGENT CYLINDRICAL LOCK, AND CYLINDRICAL DEADBOLT.	SH.NO. 8 OF 11	DWG.NO:
CK. N. KRASCHEL		DATE: 17-AUG-99	RD0043
SCAN			
TOLERANCE: UNLESS OTHERWISE SPECIFIED			
DEC± .031			
ANG± .5°			
FRAC± 1/32			
SH SZ: B			
SCALE: - - - -			

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE March 17, 2000
 BY Ishag I. Chaudh
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1005-01


SHIM PLATE

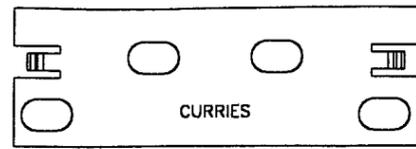


ULTIMA HINGE REINFORCEMENT

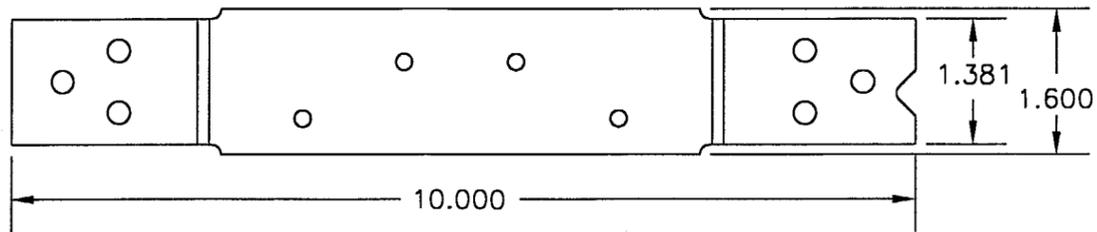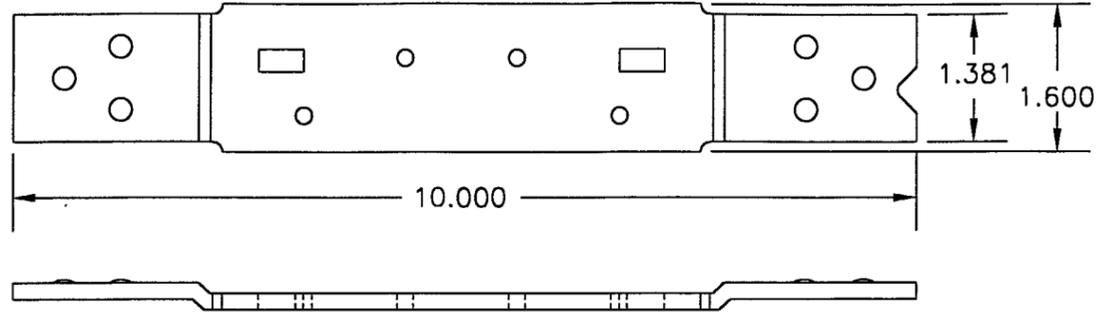


STANDARD HINGE REINFORCEMENT

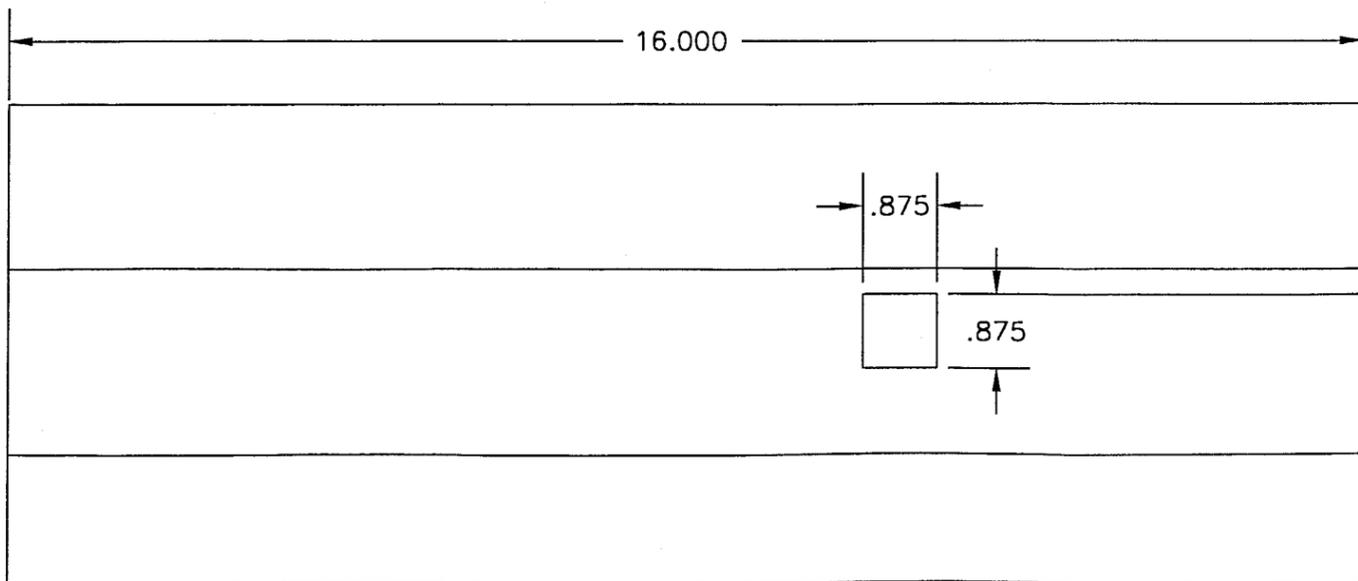



SURFACE BOLT STRIKE REINFORCING

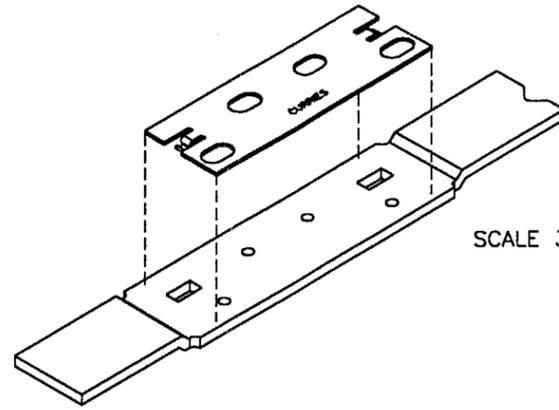


SCALE 3:8

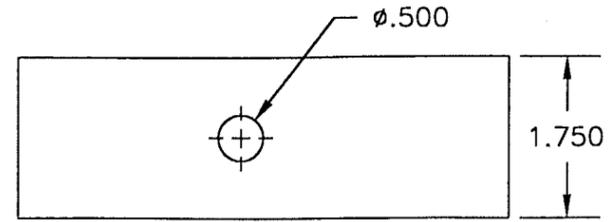

④




SCALE 3:8

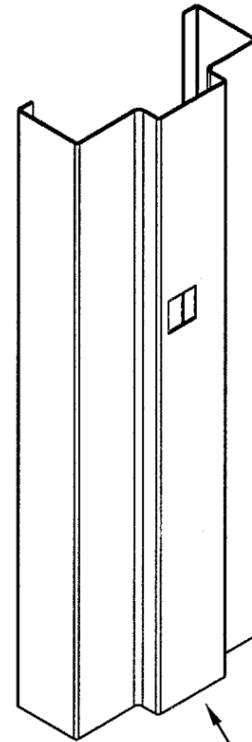


SCALE 1:4

③

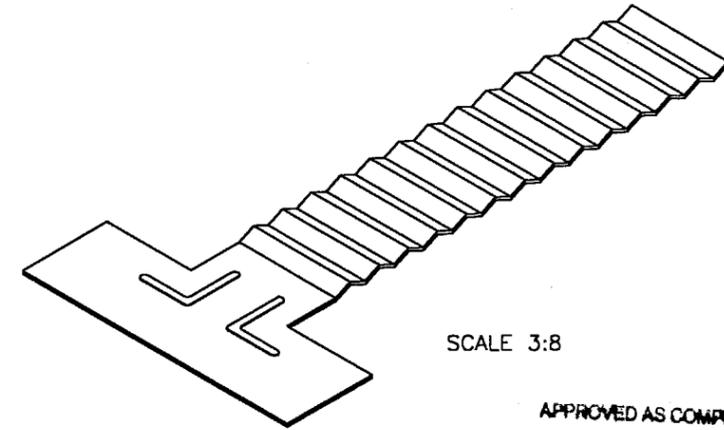

SCALE 3:8

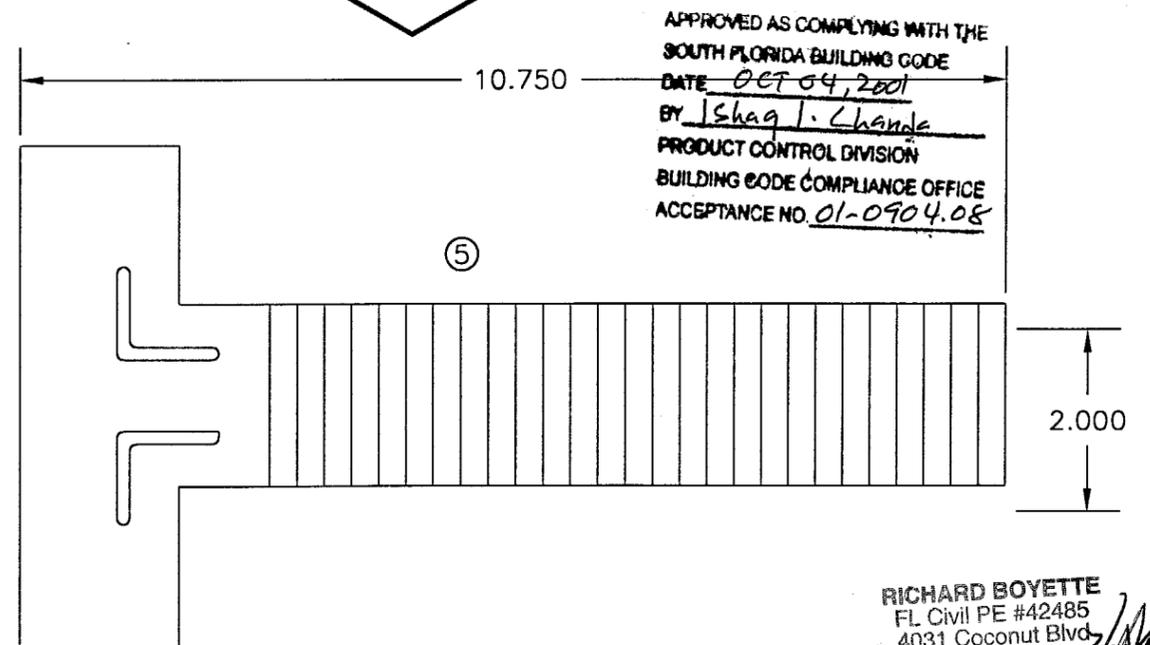

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE OCT 04, 2001
BY Ishag I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0904.08













⑤

RICHARD BOYETTE
FL Civil PE #42485
4031 Coconut Blvd.
Royal Palm Bch FL 33411
(561) 790-5766 Voice / Fax


Richard Boyette

B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<i>RLK</i>	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
REV	DATE	DESCRIPTION	DR	CK	SC
DR. L. SHERIFF		CURRIES MASON CITY, IOWA			
CK. N. KRASCHEL					
SCAN					
TOLERANCE: UNLESS OTHERWISE SPECIFIED			TITLE: 8'0 X 8'0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER, AND SARGENT CYLINDRICAL LOCK, AND CYLINDRICAL DEADBOLT.		
DEC±	.031				
ANG±	.5°				
FRAC±	1/32				
SH SZ:	B	SH.NO. 9 OF 11	DWG.NO:		
SCALE:	1:2	DATE: 17-AUG-99	RD0043		

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE March 17, 2000
BY Ishag I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 99-1005.01

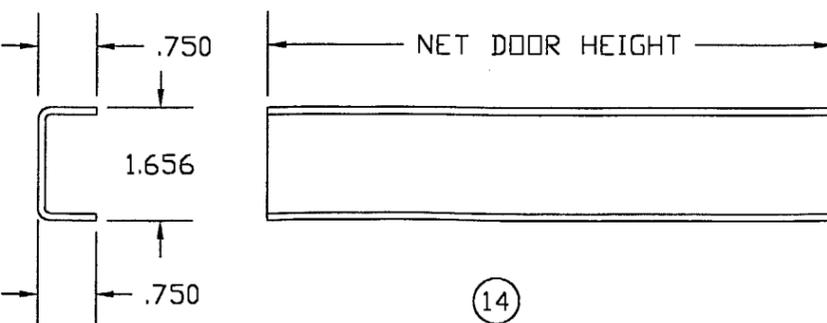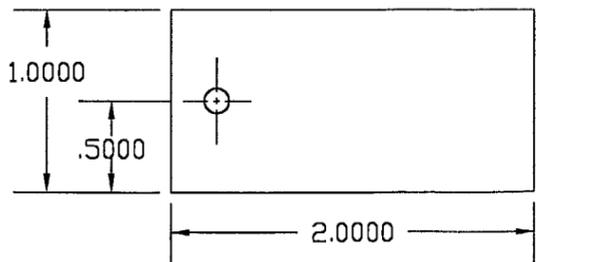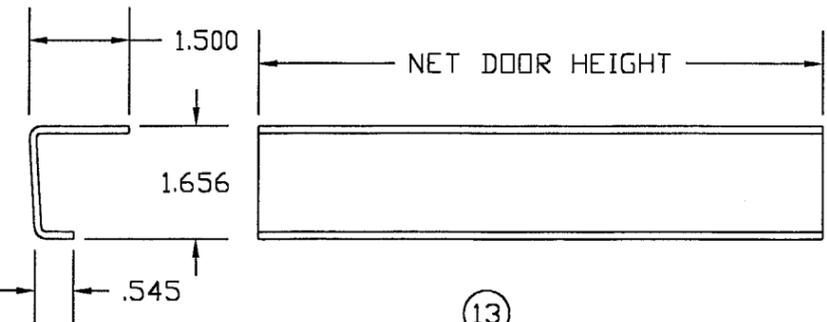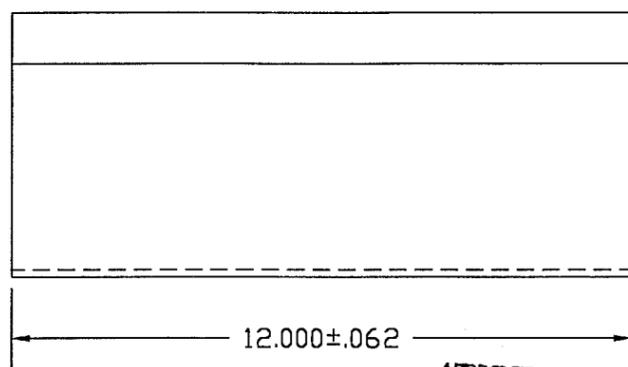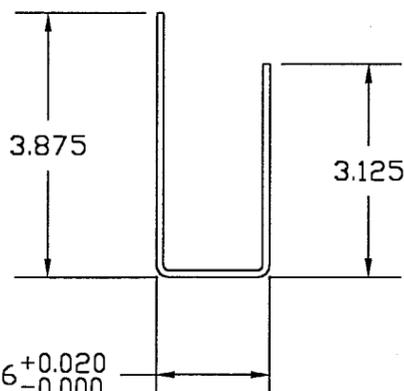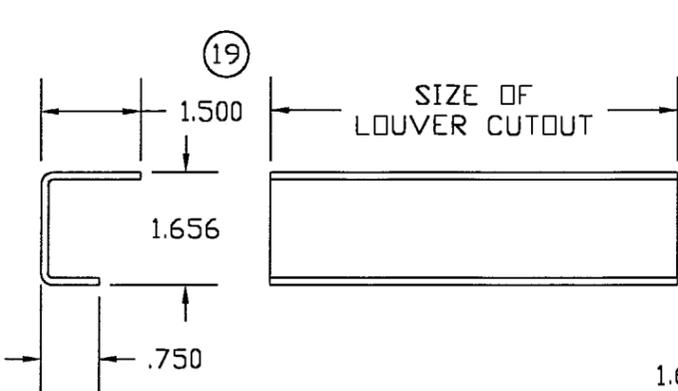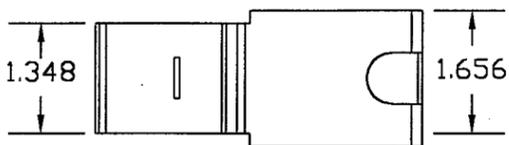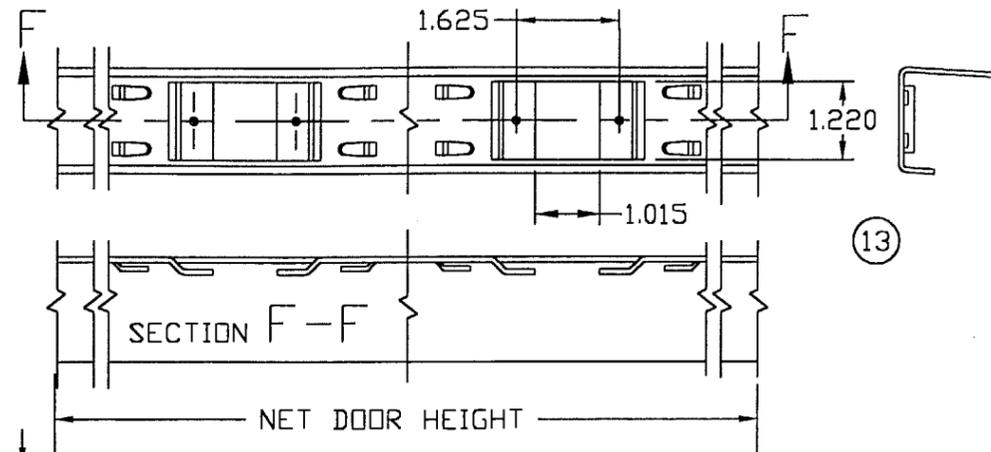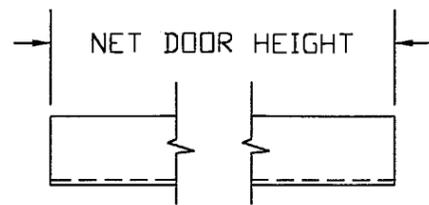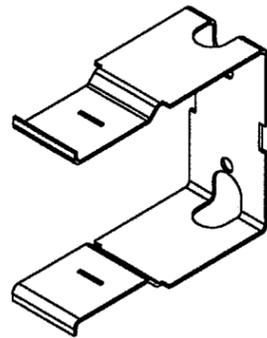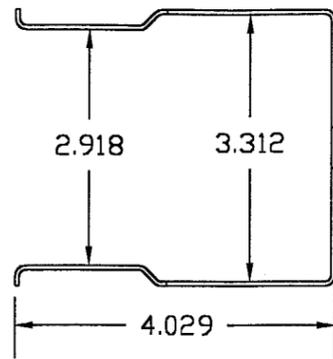

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCT 04, 2001
 BY Ishaq I. Chaudhry
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

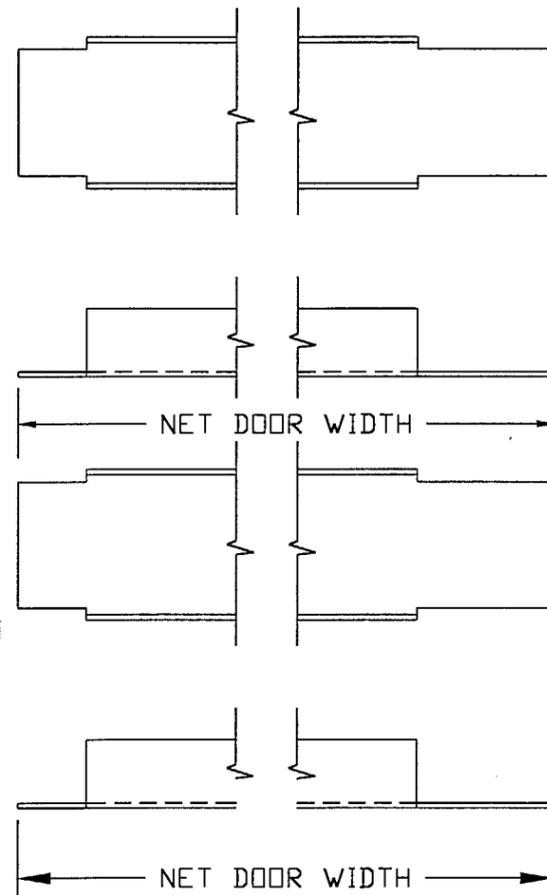

NOTCHED EACH END
 TO CLEAR HINGE
 AND LOCK CHANNEL

3/8/00
RICHARD BOYETTE
 FL CIVIL PE #12485
 4081 Coconut Blvd
 Royal Palm Bch FL 33411
 (561) 700-8766 Voice / FAX

B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	<i>NTK</i>	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
REV	DATE	DESCRIPTION	DR	CK	SC
DR. L. SHERIFF			CURRIES MASON CITY, IOWA TITLE: 8'0 X 8'0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER. AND SARGENT CYLINDRICAL LOCK. AND CYLINDRICAL DEADBOLT.		
CK. N. KRASCHEL					
SCAN					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC ± .031					
ANG ± .5°			SH.NO. 10 OF 11		
FRAC ± 1/32			DWG.NO. RD0043		
SH SZ: B			DATE: 17-AUG-99		
SCALE: - - - -					

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE March 17, 2000
 BY Ishaq I. Chaudhry
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1005-01

BILL OF MATERIALS

ITEM	QUANTITY	DESCRIPTION
1	2	16 GA. (.053") MIN., 14 GA. (.073") MAX. DOOR (COLD ROLLED, GALVANIZED, OR STAINLESS STEEL)
2	1	16 GA. (.053") MIN., 12 GA. (.105") MAX. WELDED OR KD FRAME (COLD ROLLED, GALVANIZED, OR STAINLESS STEEL)
3	6	7 GA. (.171") MIN., (.203") MAX. FRAME HINGE REINFORCEMENT
4	5	PIPE SPACER ANCHOR - PER JAMB - 16 GA. STRAP
5	5	16 GA. MASONRY T ANCHOR; MINIMUM YIELD STRENGTH = 33,000 PSI.
6	-	NOT USED
7	5	3/8" x 5" FLAT HEAD WOOD SCREW/LAG BOLT - PER JAMB
8	5	3/8" x 5" FLAT HEAD SLEEVE ANCHOR - PER JAMB - 16 GA. STRAP / .050 MIN WALL ON PIPE USED IN THE SLEEVE ANCHOR.
9	1	16 GA. (.053") MIN., 12 GA. (.105") MAX., TOP END CHANNEL
10	1	16 GA. (.053") MIN., 12 GA. (.105") MAX., BOTTOM END CHANNEL
11	1	16 GA. (.110") MIN., TOP CAP
12	1	12 GA. (.105") MIN., BOTTOM CAP - OPTIONAL
13	1	14 GA. (.073") MIN., 12 GA. (.105") MAX., LOCK CHANNEL
14	1	14 GA. (.073") MIN., 12 GA. (.105") MAX., HINGE CHANNEL
15	1	ONE POUND DENSITY POLYSTYRENE CORE - 1.656" NOMINAL THICKNESS (MANUFACTURED BY BSAF)
16	1	OPTIONAL 12 GA. (.105") MIN. CLOSER REINFORCING
17	2	16 GA. (.053") MIN. CYLINDRICAL LOCK REINFORCEMENT
18	2	12 GA. (.105") MIN SURFACE BOLT REINFORCING
19	1	14 GA. (.073") MIN SURROUND CHANNEL (4 PCS AROUND LOUVER CUTOUT).
20	4	12 GA. (.105") x 1" x 2" STRIKE TAB.
21	4	4-1/2 x 4-1/2 x .134 STEEL HINGES MCKINNEY T-2714 PER LEAF
22	-	NOT USED
23	-	NOT USED
24	1	2" x 6" MIN WOOD BUCK
25	1	EXISTING MASONRY OR POURED CONCRETE 2000 PSI MIN.
26	3	SARGENT 10 LINE OR 6500 SERIES LOCK
27	1	SARGENT 480 SERIES DEAD BOLT
28	1	FINISH PAINT - FACES OF DOOR OR FRAME
29	1	8" CMU BLOCK WITH 2000 PSI MIN. MORTAR
30	1	STEEL LINTEL
31	-	NOT USED
32	-	NOT USED
33	2	IVES 360 - 12" SURFACE BOLTS - PER LEAF
34	-	NOT USED
35	11	12 GA. (.105") MIN. HEAD REINFORCING 16" LONG
36	-	NOT USED
37	1	ANEMOSTAT FPL2 LOUVER PER DOOR LEAF

NOTES: 1. MINIMUM TENSILE STRENGTH 53,000
 2. MINIMUM YIELD STRENGTH 43,400 PSI

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE OCTOBER 04, 2001
 BY Ishag J. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0904.08

5/8/00
RICHARD BOYETTE
 FL Civil PE #42485
 4031 Coconut Blvd
 Royal Palm Bch FL 33411
 (305) 990-5766 Voice / Fax
Richard Boyette

B	2/25/00	CHANGES PER DADE CO. REQUEST	LJS	NKA	
A	1/13/00	CHANGES PER DADE CO. REQUEST	LJS	NTK	
REV	DATE	DESCRIPTION	DR	CK	SC
DR. L. SHERIFF		CURRIES MASON CITY, IOWA			
CK. N. KRASCHEL					
SCAN					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031		TITLE: 8'0 X 8'0 MODEL 707F OUTSWING DOORS WITH ANEMOSTAT FPL2 LOUVER, AND SARGENT CYLINDRICAL LOCK, AND CYLINDRICAL DEADBOLT.			
ANG± .5°					
FRAC± 1/32					
SH SZ:	B	SH.NO. 11 OF 11	DWG.NO: RD0043		
SCALE:	----	DATE: 17-AUG-99			

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE March 19, 2000
 BY Ishag J. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 99-1005.01