



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Certainteed Corporation (TX)
3000 W Commerce St.
Dallas, TX 75212**

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by the BCCO and accepted by the Building Code and Product Review Committee to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The BCCO (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BCCO reserves the right to revoke this acceptance, if it is determined by BCCO that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County or Florida Building Code.

DESCRIPTION: Certainteed Shingle Vent II-11, Shingle Vent II-9, and Shingle Vent II-7

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 5.
The submitted documentation was reviewed by Frank Zuloaga, RRC.



**NOA No. 01-0910.06
Expiration Date: 04/05/06
Approval Date: 10/18/01
Page 1 of 5**

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Roof Ventilators
Materials: Plastic

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
CertainTeed Shingle Vent™ II Ridge Vent	See detail drawing herein	PA 100	High density polypropylene low profile attic ridge vent for installation in shingle roof systems.
CertainTeed Shingle Vent™ II 7 Ridge Vent	See detail drawing herein	PA 100 A (95)	High density polypropylene low profile attic ridge vent for installation in shingle roof systems
CertainTeed Shingle Vent™ II 9 Ridge Vent	See detail drawing herein	PA 100 A (95)	High density polypropylene low profile attic ridge vent for installation in shingle roof systems

EVIDENCE SUBMITTED:

<u>Test Agency/Identifier</u>	<u>Name</u>	<u>Report</u>	<u>Date</u>
United States Testing Company, Inc.	ASTM D-2843-88	601269-1	07/28/94
United States Testing Company, Inc.	ASTM D-1929-91	601269-2	07/28/94
AGRA Earth and Enviromental	ASTM D-638	No.94-9905	11/07/94
Architectural Testing, Inc.	PA 100A(95) Wind Driven Rain	01-31464.01	5/27/98
Architectural Testing, Inc.	PA 100A(95) Wind Driven Rain	01-31463.02	06/1198



NOA No. 01-0910.06
Expiration Date: 04/05/06
Approval Date: 10/18/01
Page 2 of 5

APPROVED APPLICATIONS:

Slot: Cut a minimum 1½" slot along the apex of the roof by cutting ¾" on each side of the ridge. The slot shall terminate approximately 6" from the rake edge.

Installation: Place ridge vent section centered over the void at one end of the ridge. Plugged end should be flush with end wall of ventilated space under roof. Pre-fasten first section using roofing nails through pre-drilled nail bosses. Continue to pre-fasten remaining sections, making sure support walls are flat on roof and filter is secure between shingles and vent. Cut final section to length.

Ridge Shingle: Nail cap shingles in place using roofing nails long enough to penetrate through the roof sheathing a minimum of $\frac{3}{16}$ of an inch. Use nail lines provided on vent.

Net Free Area: Refer to manufacturers published literature


Minimum Slope: 2:12

LIMITATIONS:


1. Refer to applicable building codes for required ventilation.
2. Shall not be installed on roof mean heights greater than 33 feet



DETAIL DRAWING

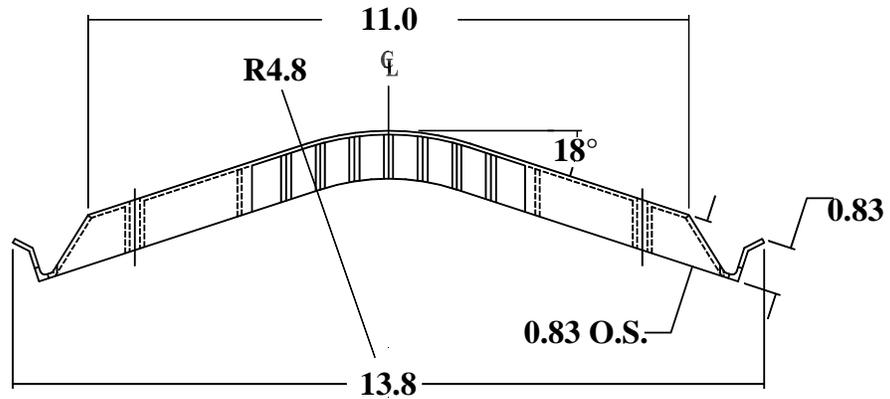


LOW PROFILE SHINGLE VENT II-11"

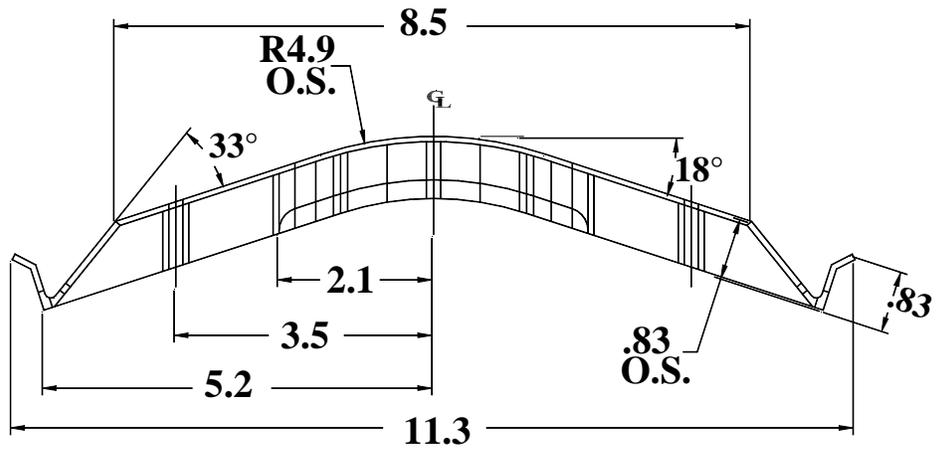

LOW PROFILE SHINGLE VENT II - 9"



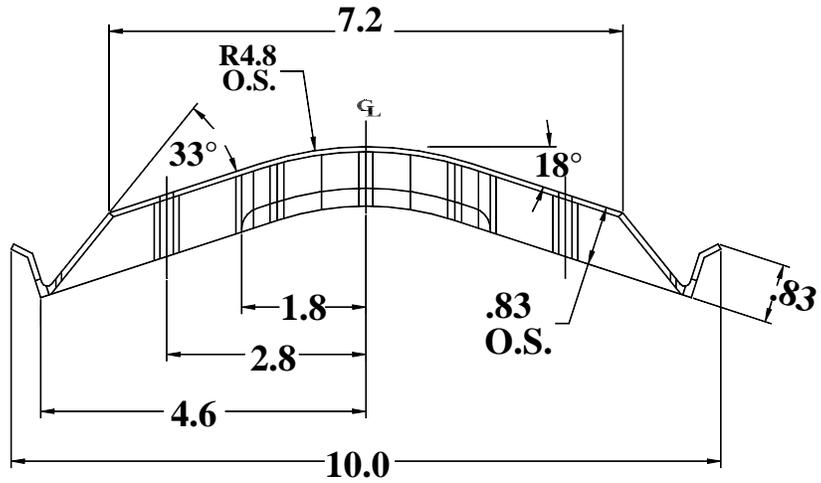

LOW PROFILE SHINGLE VENT II - 7"

END OF THIS ACCEPTANCE



NOA No. 01-0910.06
Expiration Date: 04/05/06
Approval Date: 10/18/01
Page 5 of 5