



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Florida Window System, Corp.
7040 NW 77 Terr
Medley, FL 33166

Your application for Notice of Acceptance (NOA) of:

Series 100 Outswing Aluminum Casement Window

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-0924.05
EXPIRES: 01/03/2007

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 01/03/2002

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1 This approves aluminum casement window, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1 The **Series 100 Outswing Aluminum Casement Window – Non-Impact Resistant** and its components shall be constructed in strict compliance with the following documents: Drawing No **W01-61**, Sheets 1 through 5 of 5, titled "Series-100 Alum. Outswing Casement Window," prepared by Al Farooq Corporation, dated 9/14/01 and last revision on 11-21-01, signed and sealed by Dr. Humayoun Farooq, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1 This approval applies to single unit applications only, as shown in approved drawings.
3.2 For Design Pressure Rating vs. Window Size, see Comparative Analysis Tables in approved drawings.

4. INSTALLATION

- 4.1 The aluminum casement window and its components shall be installed in strict compliance with the approved drawings.
4.2 Hurricane protection system (shutters): the installation of this unit **will require** a hurricane protection system.

5. LABELING

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
6.1.1 This Notice of Acceptance
6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

Florida Window System Corporation

ACCEPTANCE No.: 01-0924.05

APPROVED: January 03, 2002


EXPIRES: January 03, 2007

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a. There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b. The product is no longer the same product (identical) as the one originally approved.
 - c. If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d. The engineer, who originally prepared, signed and sealed the required documentation initially submitted, is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a. Unsatisfactory performance of this product or process;
 - b. Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all times. The engineer does not need to reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Acceptance contains pages 1, 2, and this last page 3.

END OF THIS ACCEPTANCE

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

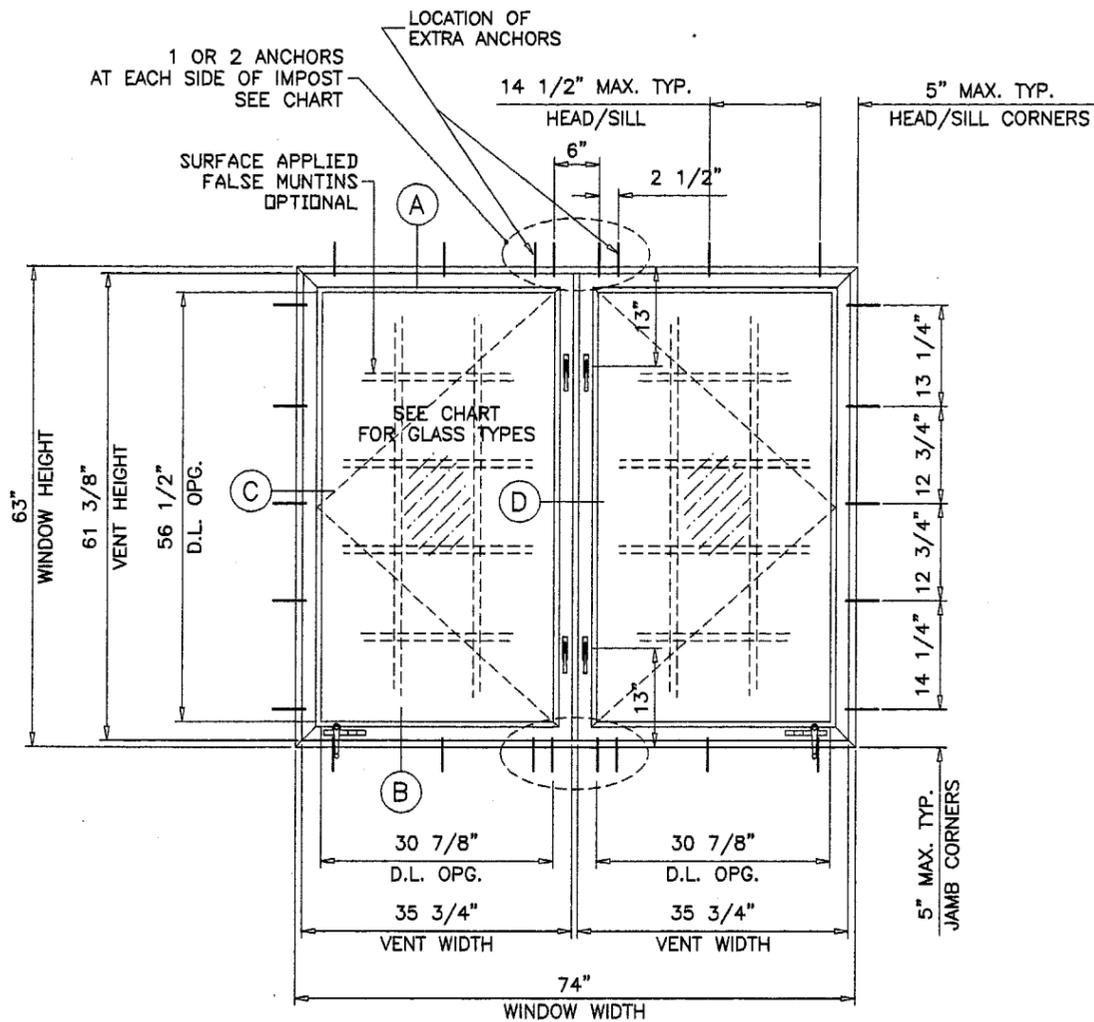

TYPICAL ELEVATION

TESTED UNIT

(SEE CHART ON SHEET 2 FOR MAX. APPROVED SIZES)

APPROVAL APPLIES TO SINGLE VENT OR DUAL VENT WINDOWS WITH X, XX, OX OR XO CONFIGURATIONS. ALSO COMBINATIONS OF TWO OR MORE WINDOWS USING APPROVED MULLIONS.

WINDOWS RATED FOR NON-IMPACT AND REQUIRE PROTECTION BY DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS. DESIGN LOAD RATING FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.


THIS PRODUCT IS DESIGNED AS PER THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR DADE COUNTY. ALSO FOR WIND LOADS AS PER ASCE 7 USING CORRESPONDING LOADS.

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.


ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE January 23, 2002
 BY Ishaq I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0924.05

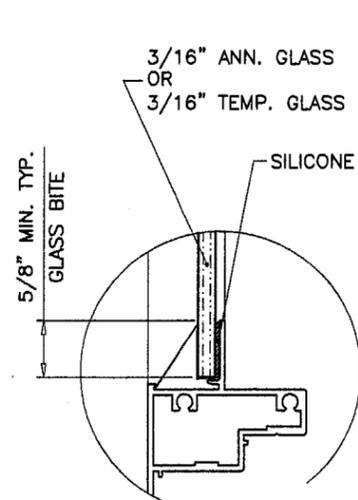

**3/16" ANN. GLASS
 3/16" TEMP. GLASS**

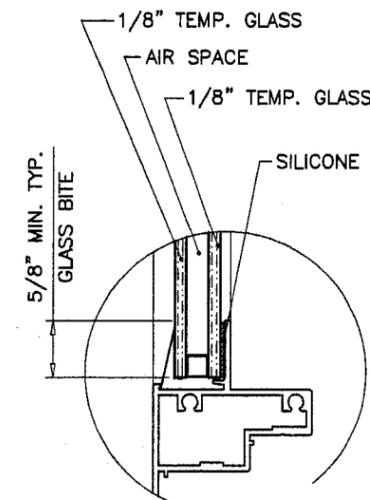

DSB INSUL. GLASS

MIAMI DADE COUNTY APPR'D IMPACT RESISTANT SHUTTERS REQD. FOR ALL INSTALLATIONS

GLAZING OPTIONS

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557

DEC 14 2001

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W01-61FWS

SERIES-100 ALUM OUTSWING CASEMENT WD.W.
FLORIDA WINDOW SYSTEMS
 7040 N.W. 77 TERRACE
 MEDLEY, FL. 33166
 TEL. (305) 805-9420 FAX (305) 805-9424

no	date	description
A	11.14.01	REV. PER BCCO COMMENTS
B	11.21.01	1/4" ANN. GLASS REMOVED

date: 09-14-01
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.

W01-61


sheet 1 of 5

DESIGN LOAD CAPACITY - PSF FOR (X) SIZES							
WINDOW DIMS.		3/16" ANN. GLASS		3/16" TEMP. GLASS		DSB INSUL. GLASS	
WIDTH	HEIGHT	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
19-1/8"	26" (3)	100.0	120.0	100.0	210.0	100.0	210.0
26-1/2"		100.0	120.0	100.0	210.0	100.0	210.0
37"		100.0	109.0	100.0	210.0	100.0	181.7
19-1/8"	38-3/8" (4)	100.0	120.0	100.0	210.0	100.0	210.0
26-1/2"		100.0	101.9	100.0	210.0	100.0	171.9
37"		71.7	71.7	100.0	156.6	100.0	123.1
19-1/8"	50-5/8" (5)	100.0	120.0	100.0	209.7	100.0	157.2
26-1/2"		76.1	76.1	100.0	166.2	100.0	124.7
37"		54.4	54.4	100.0	124.4	100.0	93.3
19-1/8"	63" (5)	100.0	120.0	100.0	161.1	100.0	120.8
26-1/2"		63.6	63.6	100.0	124.9	93.7	93.7
37"		41.7	41.7	100.0	100.0	75.0	75.0
19-1/8"	74-1/4" (6)	78.8	78.8	100.0	105.0	78.8	78.8
26-1/2"		58.3	58.3	77.7	77.7	58.3	58.3
18"	24" (3)	100.0	120.0	100.0	210.0	100.0	210.0
24"		100.0	120.0	100.0	210.0	100.0	210.0
30"		100.0	120.0	100.0	210.0	100.0	210.0
36"		100.0	120.0	100.0	210.0	100.0	202.3
18"	36" (3)	100.0	120.0	100.0	210.0	100.0	210.0
24"		100.0	120.0	100.0	193.0	100.0	193.0
30"		93.4	93.4	100.0	154.4	100.0	154.4
36"		78.1	78.1	100.0	128.7	100.0	128.7
18"	48" (4)	100.0	120.0	100.0	210.0	100.0	175.9
24"		94.7	94.7	100.0	190.6	100.0	142.9
30"		68.2	68.2	100.0	154.4	100.0	121.4
36"		58.8	58.8	100.0	128.7	100.0	101.2
18"	60" (5)	100.0	120.0	100.0	179.4	100.0	134.5
24"		85.0	85.0	100.0	142.9	100.0	107.2
30"		53.2	53.2	100.0	122.0	91.5	91.5
36"		44.7	44.7	100.0	107.9	81.7	80.9
18"	72" (6)	91.6	91.6	100.0	122.2	91.6	91.6
24"		70.1	70.1	93.5	93.5	70.1	70.1
30"		45.2	45.2	76.7	76.7	57.5	57.5

() = NO. OF ANCHORS PER JAMB

DESIGN LOAD CAPACITY - PSF FOR (XX, OX OR XO) SIZES											
WINDOW DIMS.		1 ANCHOR AT EACH SIDE OF IMPOST						2 ANCHORS AT EACH SIDE OF IMPOST			
		3/16" ANN. GLASS		3/16" TEMP. GLASS		DSB INSUL. GLASS		3/16" TEMP. GLASS		DSB INSUL. GLASS	
WIDTH	HEIGHT	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
26-1/2"	26" (3)	100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
37"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
53-1/8"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
74"	38-3/8" (4)	100.0	109.0	100.0	210.0	100.0	181.7	100.0	210.0	100.0	181.7
26-1/2"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
37"		100.0	120.0	100.0	206.3	100.0	206.3	100.0	210.0	100.0	210.0
53-1/8"	50-5/8" (5)	100.0	101.6	100.0	166.8	100.0	166.8	100.0	210.0	100.0	171.5
74"		71.7	71.7	100.0	151.2	100.0	123.1	100.0	156.6	100.0	123.1
26-1/2"	63" (5)	100.0	120.0	100.0	190.7	100.0	190.7	100.0	210.0	100.0	210.0
37"		100.0	120.0	100.0	145.2	100.0	145.2	100.0	210.0	100.0	161.3
53-1/8"		75.8	75.8	100.0	112.1	100.0	112.1	100.0	166.0	100.0	124.5
74"	74-1/4" (6)	54.4	54.4	93.5	93.5	93.3	93.3	100.0	124.4	100.0	93.3
26-1/2"		100.0	120.0	100.0	148.8	100.0	148.8	100.0	210.0	100.0	165.3
37"		100.0	120.0	100.0	111.8	100.0	111.8	100.0	165.6	100.0	124.2
53-1/8"	24" (3)	63.3	63.3	84.2	84.2	84.2	84.2	100.0	124.7	93.5	93.5
74"		41.7	41.7	67.5	67.5	67.5	67.5	100.0	100.0	75.0	75.0
26-1/2"	36" (3)	100.0	112.2	100.0	124.1	100.0	112.2	100.0	149.6	100.0	112.2
37"		81.3	81.3	92.4	92.4	81.3	81.3	100.0	108.4	81.3	81.3
53-1/8"		58.1	58.1	68.6	68.6	58.1	58.1	77.5	77.5	58.1	58.1
24"	48" (4)	100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
36"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
48"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
60"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
72"	60" (5)	100.0	120.0	100.0	210.0	100.0	202.3	100.0	210.0	100.0	202.3
24"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
36"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
48"		100.0	120.0	100.0	193.0	100.0	193.0	100.0	193.0	100.0	193.0
60"	72" (6)	93.4	93.4	100.0	154.4	100.0	154.4	100.0	154.4	100.0	154.4
72"		78.1	78.1	100.0	128.7	100.0	128.7	100.0	128.7	100.0	128.7
24"		100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
36"	48" (4)	100.0	120.0	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
48"		100.0	120.0	100.0	158.4	100.0	158.4	100.0	210.0	100.0	175.9
60"		94.7	94.7	100.0	128.7	100.0	128.7	100.0	190.6	100.0	142.9
72"		68.2	68.2	100.0	112.3	100.0	112.3	100.0	154.4	100.0	121.4
24"	60" (5)	58.8	58.8	100.0	102.9	100.0	101.2	100.0	128.7	100.0	101.2
36"		100.0	120.0	100.0	171.6	100.0	171.6	100.0	210.0	100.0	190.6
48"		100.0	120.0	100.0	121.1	100.0	121.1	100.0	179.4	100.0	134.5
60"		85.0	85.0	96.5	96.5	96.5	96.5	100.0	142.9	100.0	107.2
72"	72" (6)	53.2	53.2	82.3	82.3	82.3	82.3	100.0	122.0	91.5	91.5
24"		44.7	44.7	73.5	73.5	73.5	73.5	100.0	107.9	81.7	80.9
36"		100.0	120.0	100.0	140.4	100.0	135.6	100.0	180.8	100.0	135.6
48"	72" (6)	91.6	91.6	98.0	98.0	91.6	91.6	100.0	122.2	91.6	91.6
60"		70.1	70.1	77.2	77.2	70.1	70.1	93.5	93.5	70.1	70.1
72"		45.2	45.2	65.0	65.0	57.5	57.5	76.7	76.7	57.5	57.5

() = NO. OF ANCHORS PER JAMB

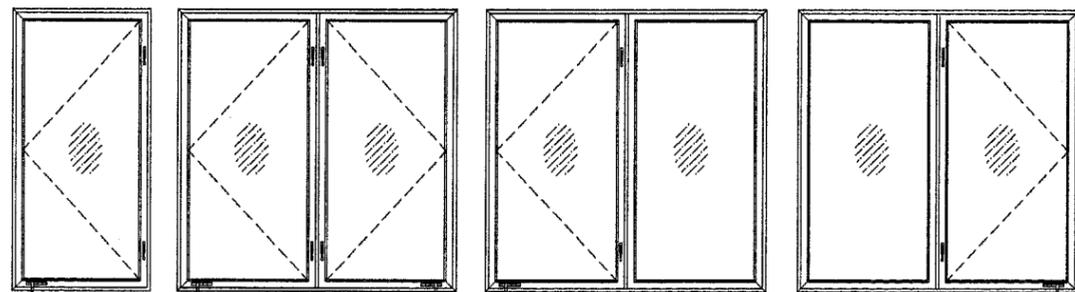

APPROVED CONFIGURATIONS

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE Jan 23, 2001
BY Ishaq J. Chande
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0924.05

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557

[Signature]
DEC 14 2001

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES-100 ALUM OUTSWING CASEMENT WDW.
FLORIDA WINDOW SYSTEMS
7040 N.W. 77 TERRACE
MEDLEY, FL. 33166
TEL. (305) 805-9420 FAX (305) 805-9424


revisions:	no	date	description

date: 09-14-01
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W01-61

sheet 2 of 5

COMP-ANL\W01-61FWS

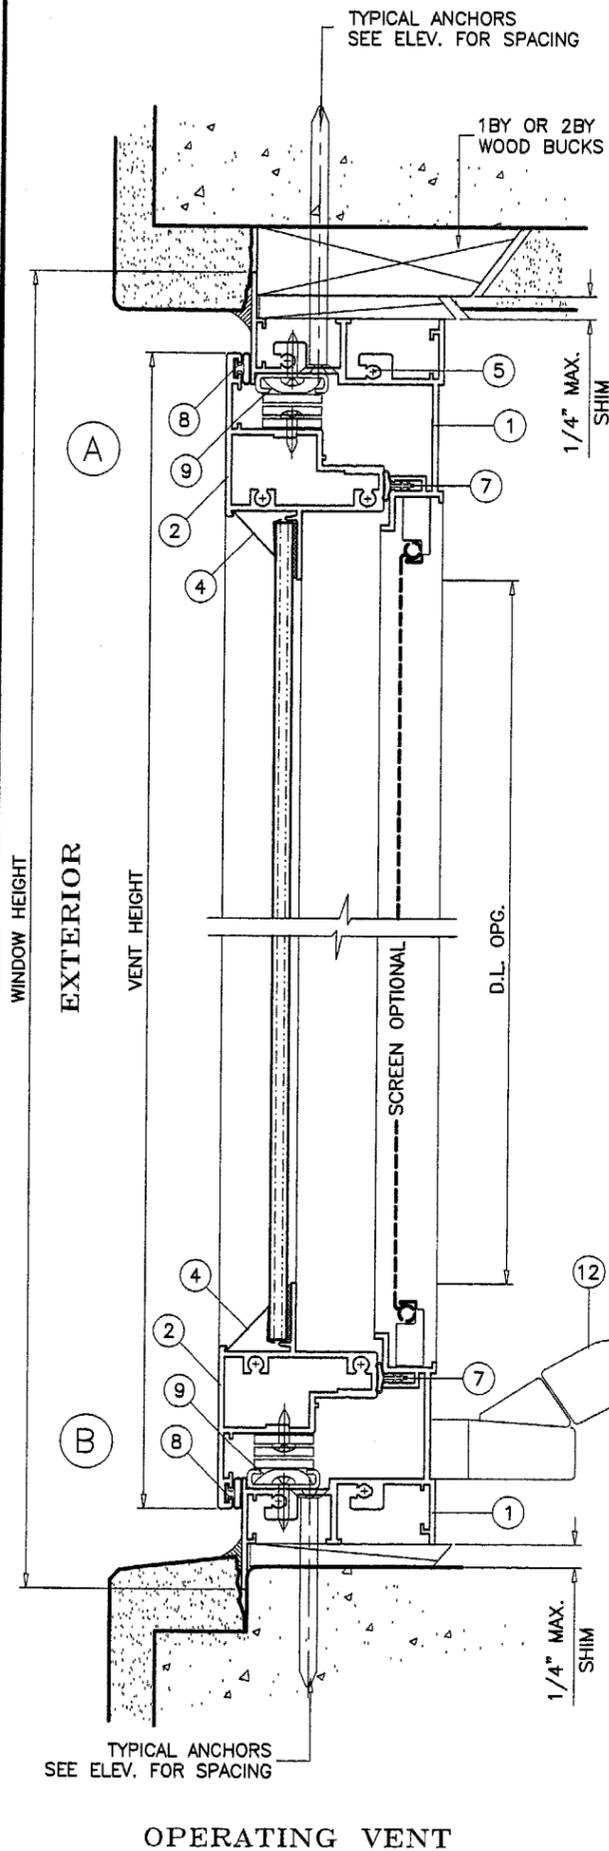


OPERATING VENT

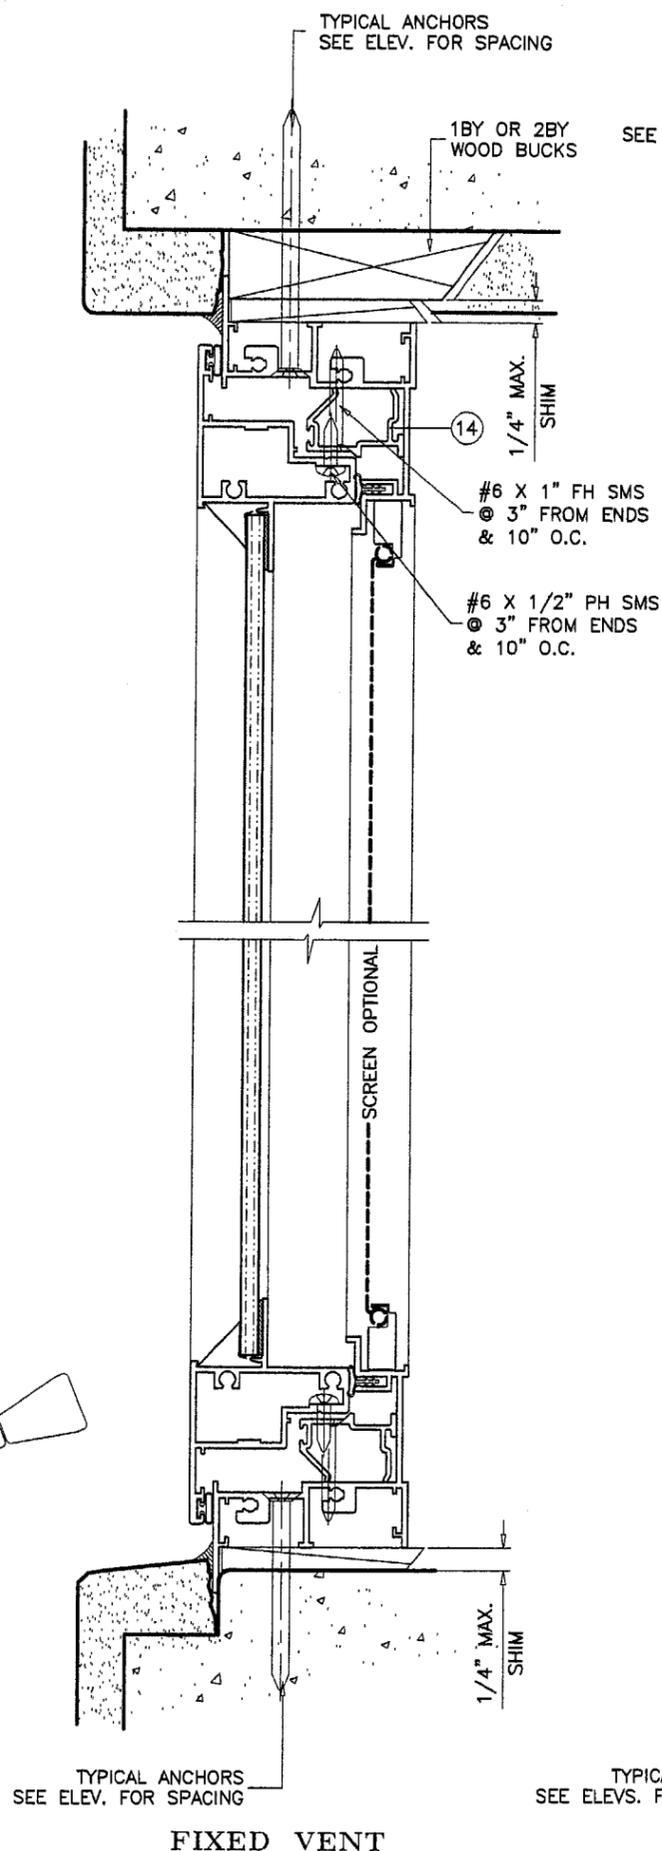

FIXED VENT

METAL STRUCTURES
(STEEL OR ALUM. 1/8" MIN. THICK)
STEEL : Fy = 36 KSI MIN.
ALUMINUM : 6063-T5 MIN.

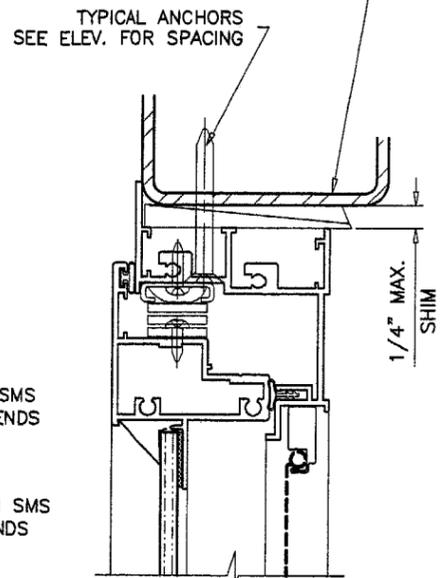

WOOD BUCKS NOT BY FLORIDA WINDOWS, MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

3/16" TAPCONS

INTO 2BY WOOD BUCKS OR WOOD STRUCTURE
1-3/8" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO MASONRY OR DIRECTLY INTO MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

3/16" TEKS OR SELF DRILLING SCREWS

INTO METAL STRUCTURES (1/8" MIN. THICKNESS)
(1/4" MAX. SHIM SPACE)

#10 SMS OR SELF DRILLING SCREWS

INTO DADE COUNTY APPROVED MULLIONS
(NO SHIM SPACE)

SEALANTS:

ALL FRAME AND VENT CORNERS AND INSTALLATION SCREWS
SEALED WITH CLEAR/ALUMINUM COLORED SEALANT.

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE Jan 03, 2001
BY Ishag I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0924.05

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557

DEC 14 2001

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W01-61FWS


SERIES-100 ALUM OUTSWING CASEMENT WDW.
FLORIDA WINDOW SYSTEMS
7040 N.W. 77 TERRACE
MEDLEY, FL. 33166
TEL (305) 805-9420 FAX (305) 805-9424

revisions:	no	date	by	description

date: 09-14-01
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W01-61


sheet 3 of 5

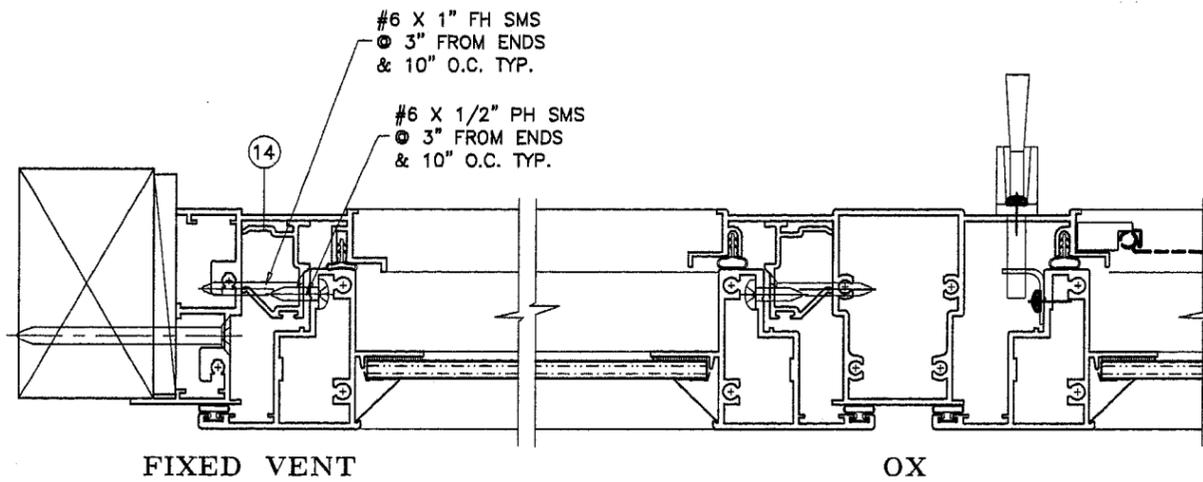


FIXED VENT

OX

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	PW-009	4	FRAME	6063-T6	-
2	PW-011	4	VENT	6063-T6	-
3	PW-010	1	CENTER POST	6063-T6	-
4	-	AS REQD.	GLAZING BEAD	ALUMINUM	ROLL FORMED
5	-	AS REQD.	FRAME ASSEMBLY SCREWS	ST. STEEL	#8 X 2-1/2" PH SMS
6	-	AS REQD.	VENT ASSEMBLY SCREWS	ST. STEEL	#10 X 1-1/2" PH SMS
7	E102	AS REQD.	FRAME WEATHERSTRIPPING (.078 X .300)	VINYL	ULTRAFAB
8	E206	AS REQD.	VENT WEATHERSTRIPPING (.187 X .350)	VINYL	ULTRAFAB
9	-	2/ VENT	4 BAR HINGE, AT TOP AND BOTTOM	STEEL	TRUTH, ATTACHED W/ (6) #8 X 3/8" SS SMS
10	30066	2/ VENT	LEVER TYPE FACE MOUNT LOCK	STEEL	TRUTH, AT 13" FROM TOP AND BOTTOM
11	-	2/ VENT	LOCK KEEPERS, AT FRAME JAMB FACING LOCK	STEEL	ATTACHED W/ (2) #10 X 3/8" SS SMS
12	40066	1	ROTO OPERATOR	STEEL	TRUTH, ATTACHED W/ (2) #8 X 3/8" SS SMS
13	-	-	.057 THICK CORNER KEY	ST. STEEL	-
14	-	AS REQD.	FIXED VENT FILLER CHANNEL	6063-T6	-

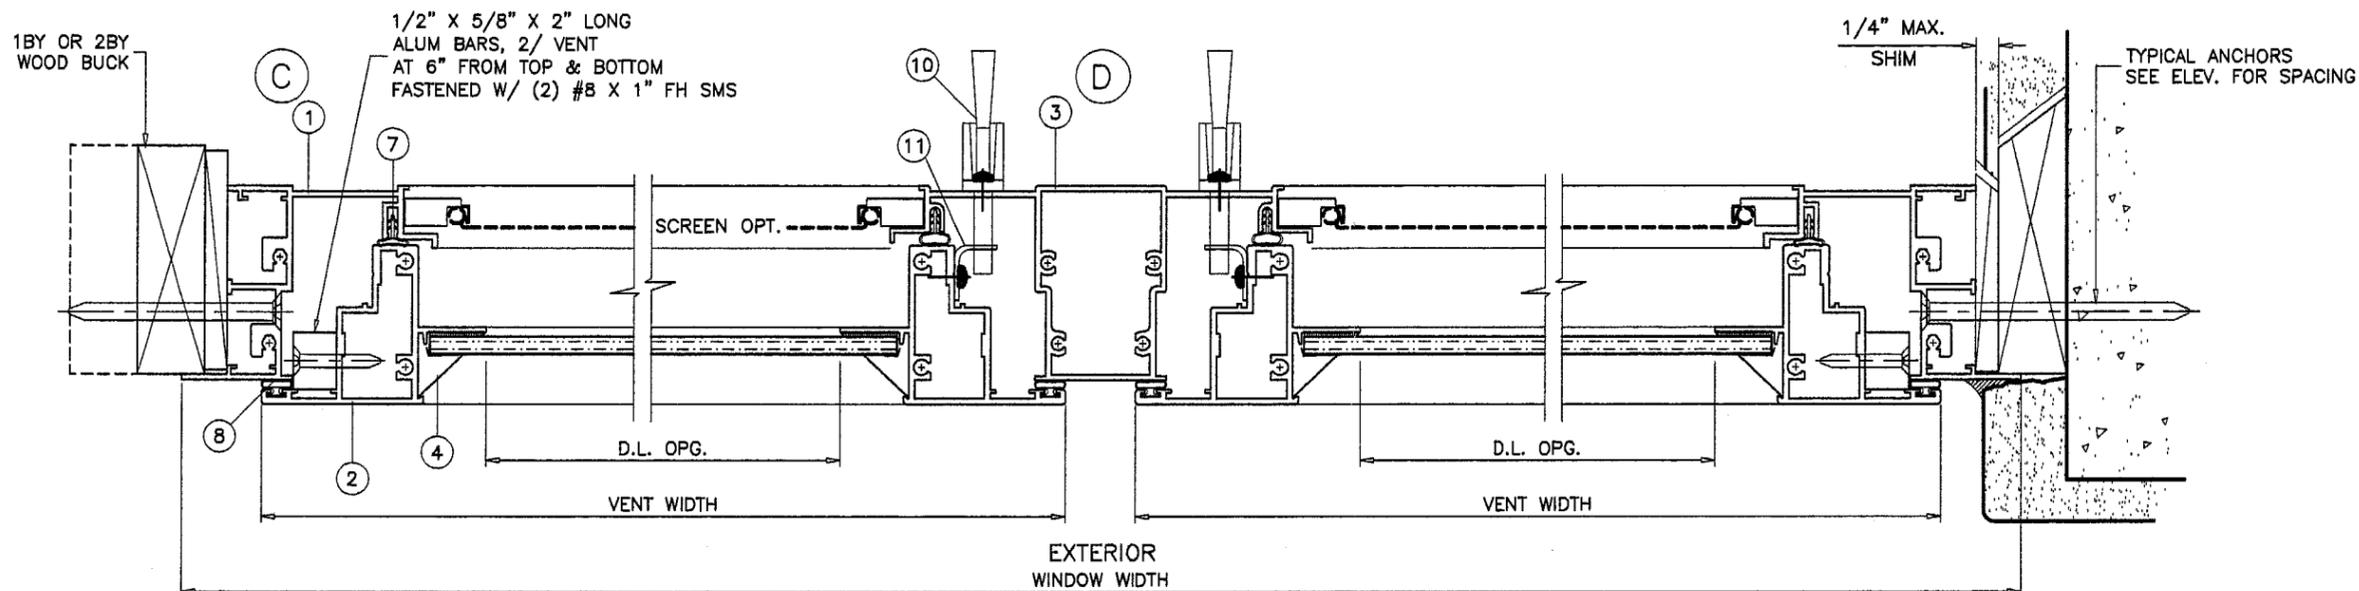

DUAL VENT WINDOWS

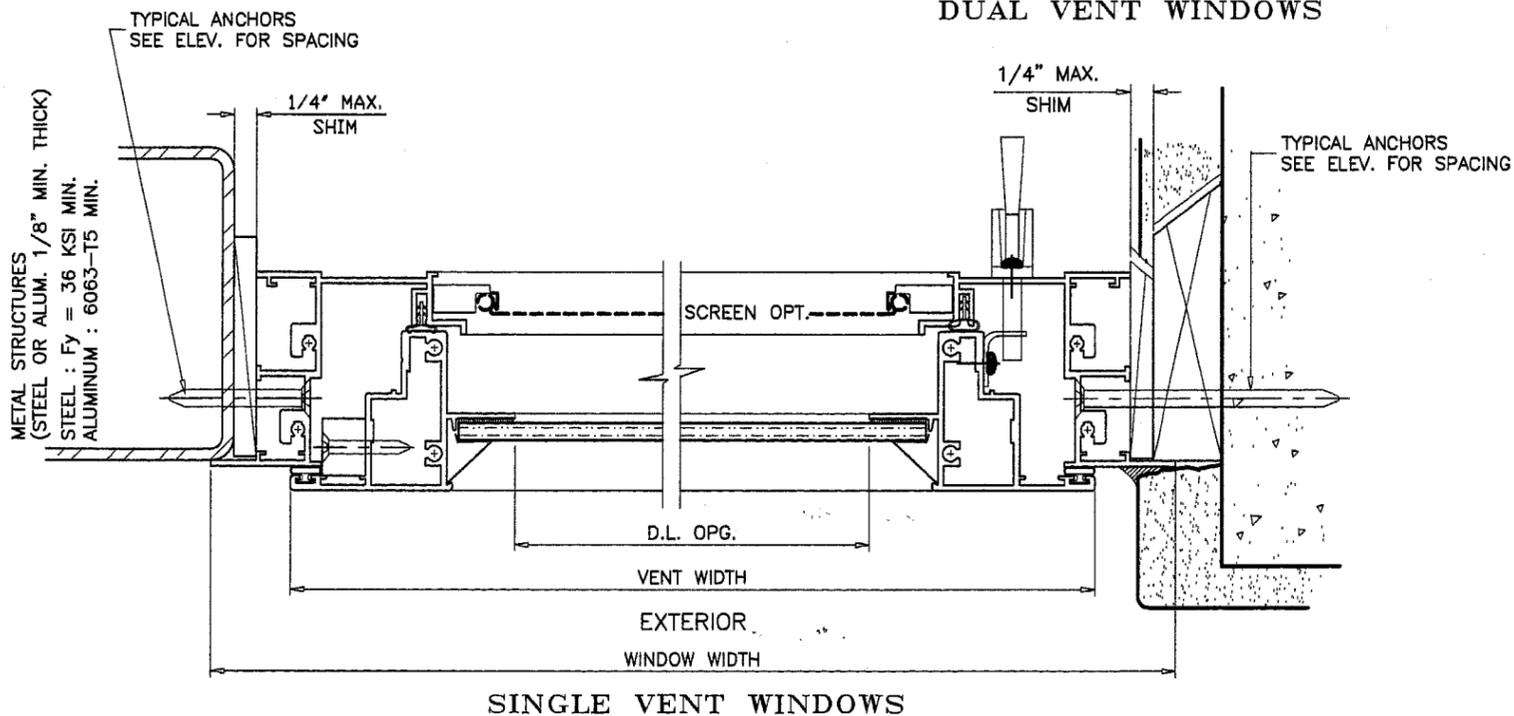

SINGLE VENT WINDOWS

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE
 DATE Jan 23, 2001
 BY Iskag I. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0924-05

Engr: DR. HUMAYOUN FAROOQ
 STRUCTURES
 FLA. PE # 16557

DEC 14 2001

AL-FAROOQ CORPORATION
 ENGINEERS, PLANNERS & PRODUCT DESIGN
 1235 SW 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W01-61FWS


SERIES-100 ALUM OUTSWING CASEMENT WDW.
FLORIDA WINDOW SYSTEMS
 7040 N.W. 77 TERRACE
 MEDLEY, FL. 33166
 TEL. (305) 805-9420 FAX (305) 805-9424

revisions:	no	date	by	description


date: 09-14-01
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W01-61


sheet 4 of 5

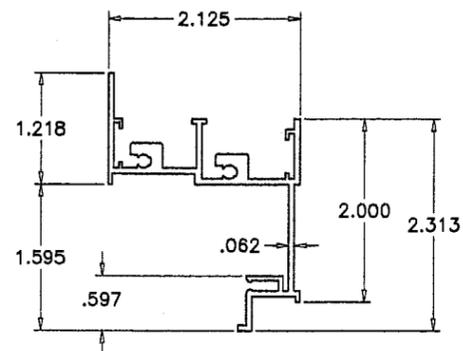


FRAME

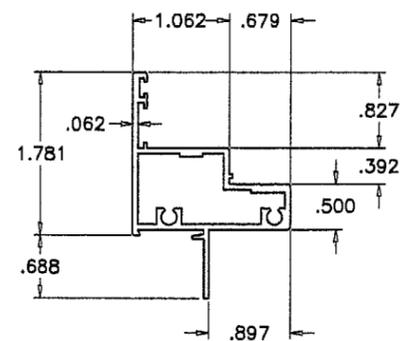


VENT

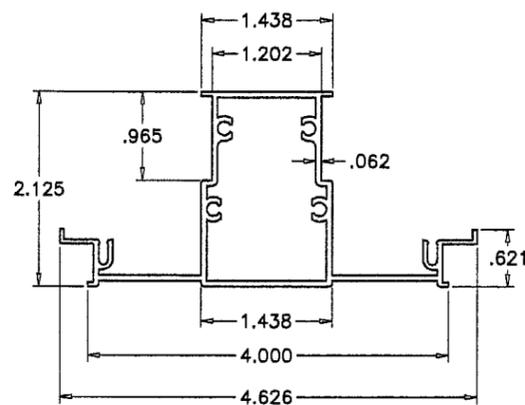


IMPOST



FILLER CHANNEL

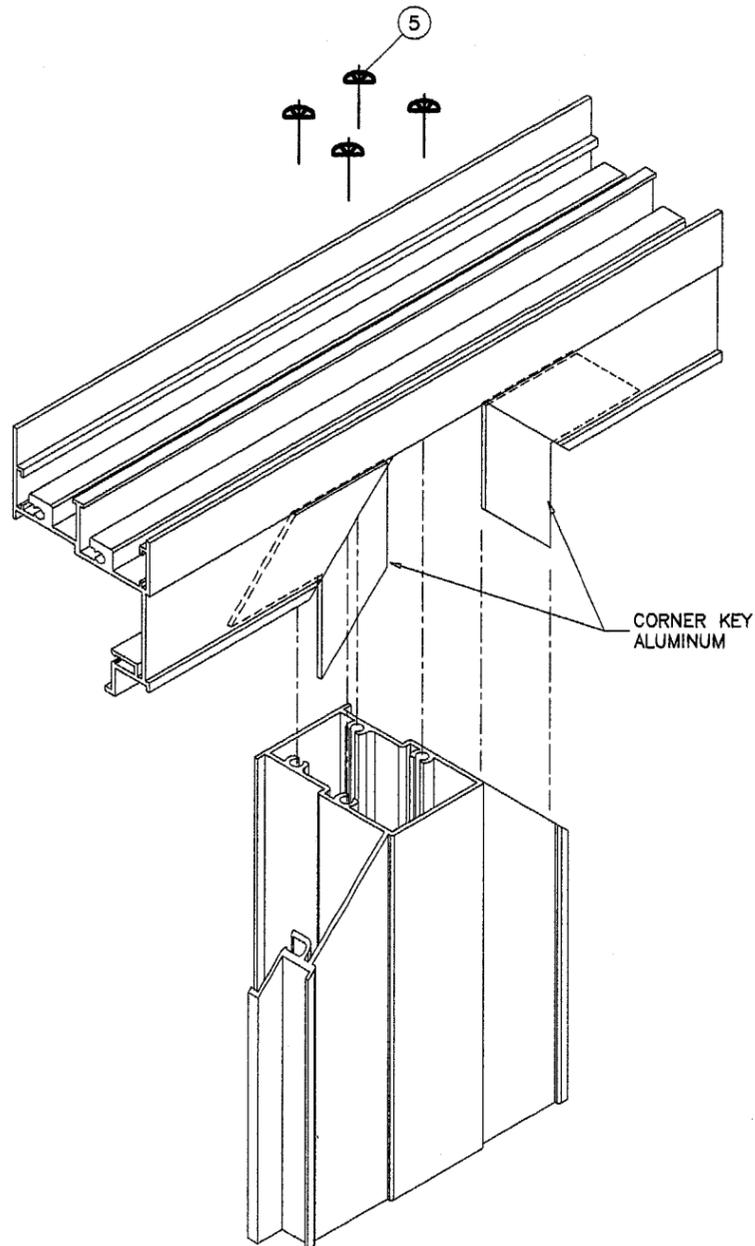


IMPOST CORNER

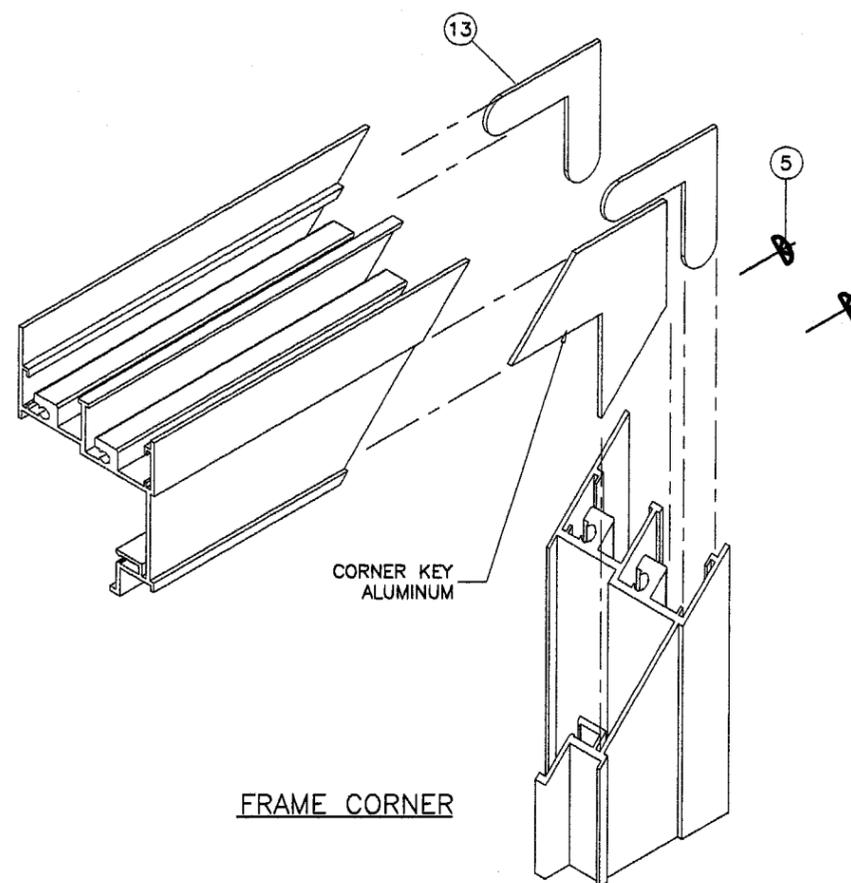

FRAME CORNER

ALL FRAME AND VENT CORNERS TO BE SEALED WITH WHITE/ALUM COLORED SEALANT.

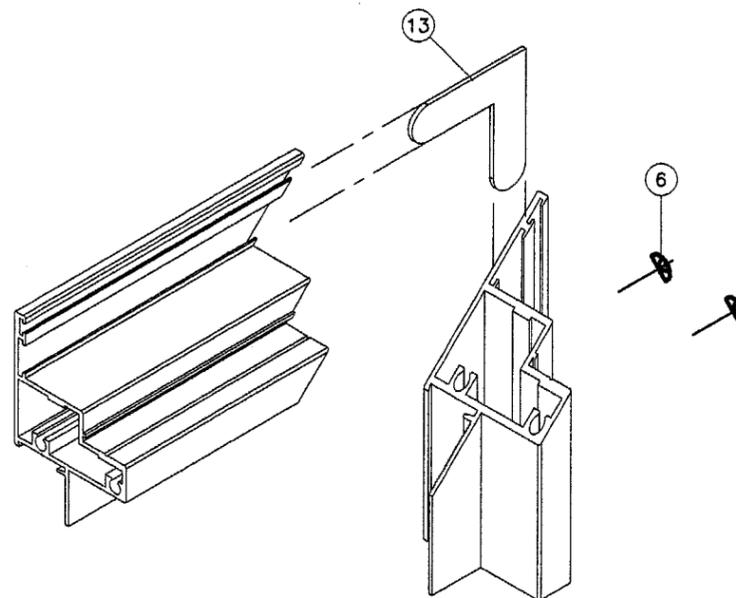

VENT CORNER

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE January 03, 2001
BY Ishaq I. Chaudhry
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0924.05

Engr: DR. HUMAYOON FAROOQ
STRUCTURES
FLA. PE # 16557

DEC 14 2001

afc

AL-FAROOQ CORPORATION
ENGINEERS, PLANNERS & PRODUCT DESIGN
1235 SW 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

SERIES-100 ALUM OUTSWING CASEMENT WDW.
FLORIDA WINDOW SYSTEMS
7040 N.W. 77 TERRACE
MEDLEY, FL. 33166
TEL. (305) 805-9420 FAX (305) 805-9424

no.	date	description

date: 09-14-01
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
WO1-61
sheet 5 of 5

COMP-ANL\WO1-61FWS