



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

Stanley Door Systems
7300 Reames Rd.
Charlotte, NC 28216

Your application for Notice of Acceptance (NOA) of:

"Sta-Tru" S/E 6'8 Out-swing Opaque Res. Ins. Steel Door-Impact w/wo Sidelites(Non-Impact)
under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-0928.05
EXPIRES: 11/01/2006

Raul Rodriguez
Chief Product Control Division

THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE □

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 11/01/2001

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

1.1 This **renews** the Notice of Acceptance No. **01-0129.21**, which was issued on May 10, 2001 It approves a residential insulated steel door, as described in Section 2 of this Notice of Acceptance, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

2.1 The Series **“Sta-Tru” S/E 6’ 8” Outswing Opaque Residential Insulated Steel Door w / wo Sidelites - Large Missile Impact Resistant Doors / Non –Impact Resistant Sidelites** and its components shall be constructed in strict compliance with the following documents: Drawing No. **43967** titled **“Stanley Outswing Opaque 11-4 x 6-8 Steel Edge Door W/ & W/O Sidelites”** Sheets 1 through 7 of 7, dated 12/26/00, prepared by R.W. Building Consultants, Inc., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division. These documents shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

3.1 This approval applies to single unit applications of pair of doors and single door with or without sidelites, as shown in approved drawings. Single door units shall include all components described in the active leaf of this approval.

4. INSTALLATION

4.1 The residential insulated steel door and its components shall be installed in strict compliance with the approved drawings.

4.2 Hurricane protection system (shutters):

4.2.1 Door: the installation of this unit **will not require** a hurricane protection system.

4.2.2 Sidelite: the installation of this unit **will require** a hurricane protection system.

5. LABELING

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

6.1 Application for building permit shall be accompanied by copies of the following:

6.1.1 This Notice of Acceptance

6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

Stanley Door Systems

ACCEPTANCE No.: 01-0928.05

APPROVED : November 01, 2001

EXPIRES : November 01, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

Ishaq I. Chanda
Ishaq I. Chanda, P.E. Product Control Examiner
Product Control Division

END OF THIS ACCEPTANCE

STANLEY DOOR SYSTEMS

STA-TRU STEEL EDGE OUTSWING 6-8 OPAQUE STEEL DOOR
W/AND W/O SIDELITES IN A WOOD FRAME

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE SOUTH FLORIDA BUILDING CODE 1994 EDITION FOR MIAMI-DADE COUNTY.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. MIAMI-DADE APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED FOR SIDELITES.
5. DESIGNED PRESSURE RATING SEE TABLES PAGE 1.
6. SIDELITES ARE AN OPTION AND CAN BE IN A SINGLE OR DOUBLE DOOR CONFIGURATION.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

Door Panel & Sidelite Construction:

Face sheets: 24 GA.(0.021") minimum thickness,
Galvanized steel A-525 commercial quality - AKDQ
per ASTM 620 with yield strength $F_y(\text{min.})=26,240$ psi

Core design: Polyurethane foam core,
with 1.7 pcf lbs. density by BASF.

Door Panel Construction: Flush or embossed type. The
perimeter stiles are a roll formed steel edge from .028" thk.
galvanized steel. The vertical edges of the face sheet are
crimped to form a mechanical lock with the hinge and latch
steel edge stiles. The top and bottom edges of the face
sheets are bent 90° over the steel edge top and bottom.



Sidelite Panel Construction: The vertical edges of the skin
are flush and glued to the top and bottom finger jointed
pine stiles. The horizontal edges of the panel skin are roll
roll formed over the finger jointed side stiles to form a
mechanical lock. Panels are sandwich glazed using a two
piece plastic lite frame with mitered & welded corners.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	COMMON (GENERAL NOTES & TYPICAL ELEVATION)
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS
5	ANCHORING LAYOUTS & DETAILS
6	ANCHORING LAYOUTS, DOOR MODELS & GLAZING DETAILS
7	UNIT COMPONENTS

DESIGN PRESSURE RATING

UNIT TYPE	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	
SINGLE	+70.0 PSF	-75.0 PSF
SINGLE W/SIDELITES	+50.0 PSF	-50.0 PSF
DOUBLE	+50.0 -44.0 PSF W/IMPERIAL AST.	+55.0 -60.0 PSF W/WINDJAMBER II AST.
DOUBLE W/SIDELITES	+50.0 -44.0 PSF W/IMPERIAL AST.	+50.0 -50.0 PSF W/WINDJAMBER II AST.

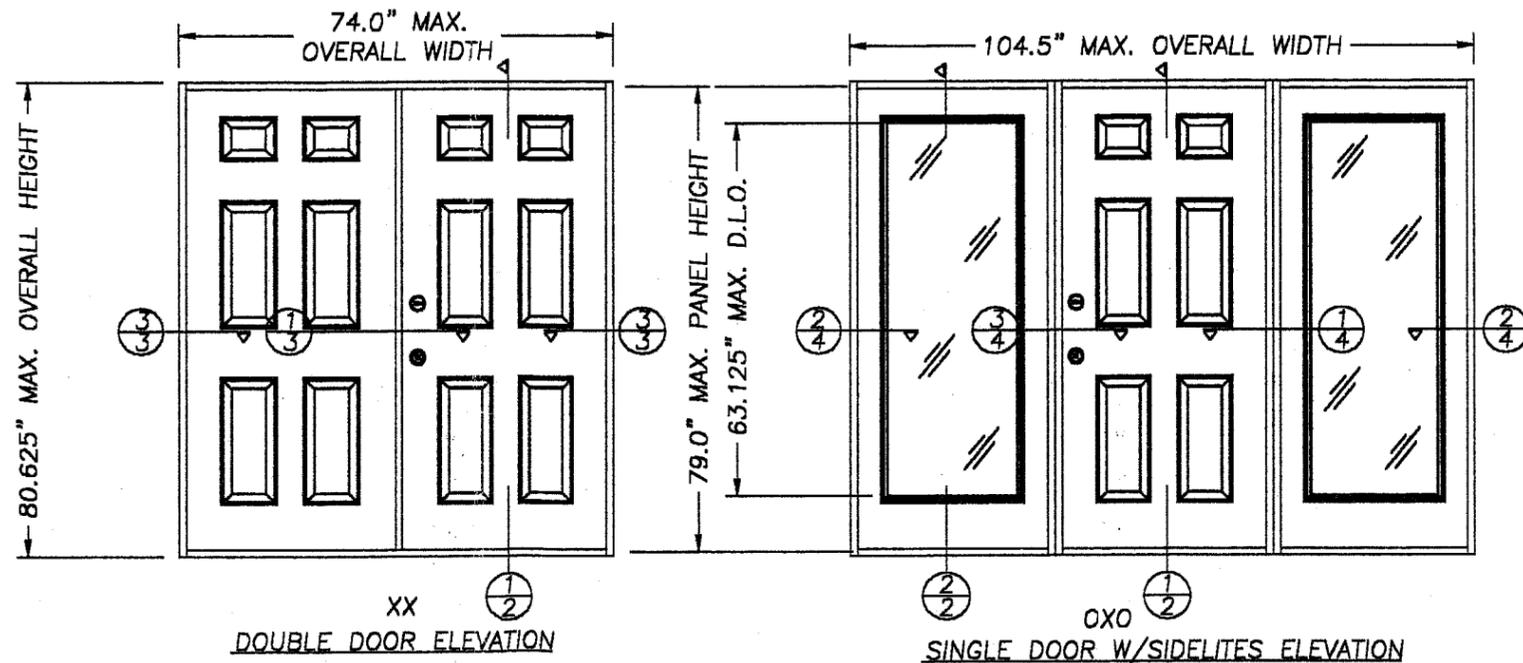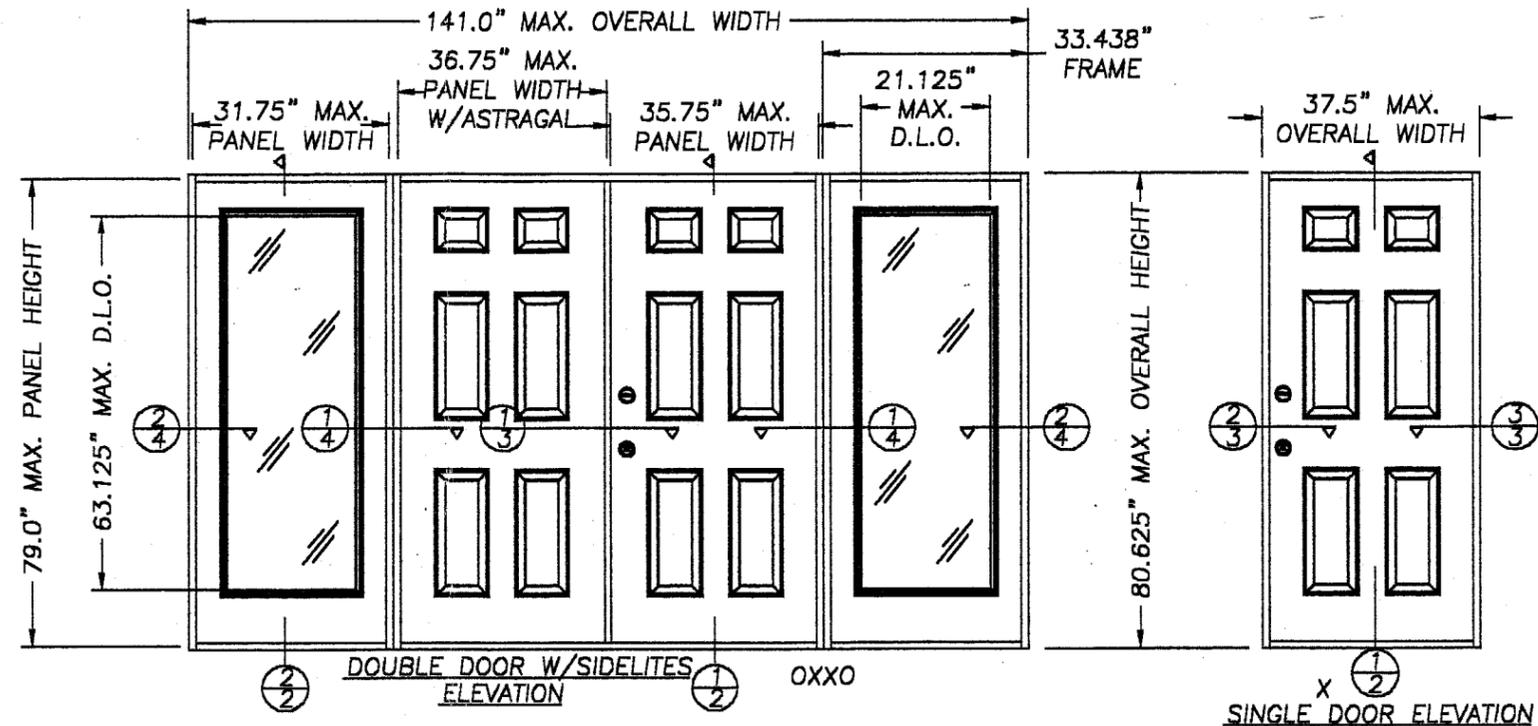

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT:
STANLEY OUTSWING OPAQUE
11-4 x 6-8 STEEL EDGE
DOOR W/& W/O SIDELITES

PART OR ASSEMBLY:
GENERAL NOTES AND
TYPICAL ELEVATIONS

NO.	DATE	BY	REVISIONS

RW BUILDING
CONSULTANTS, INC.
813.684.3831



ALL DOOR MODELS ARE VIEWED
FROM THE INTERIOR SIDE
(OUTSWING DOORS)

PRODUCT RENEWED

ACCEPTANCE NO. 01-0928.05
EXPIRATION DATE NOVEMBER 1, 2006
By Ishaq J. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE MAY 10 2001
BY Manuel Serrano
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0129.21

DATE: 12/26/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 43967
SHEET 1 OF 7

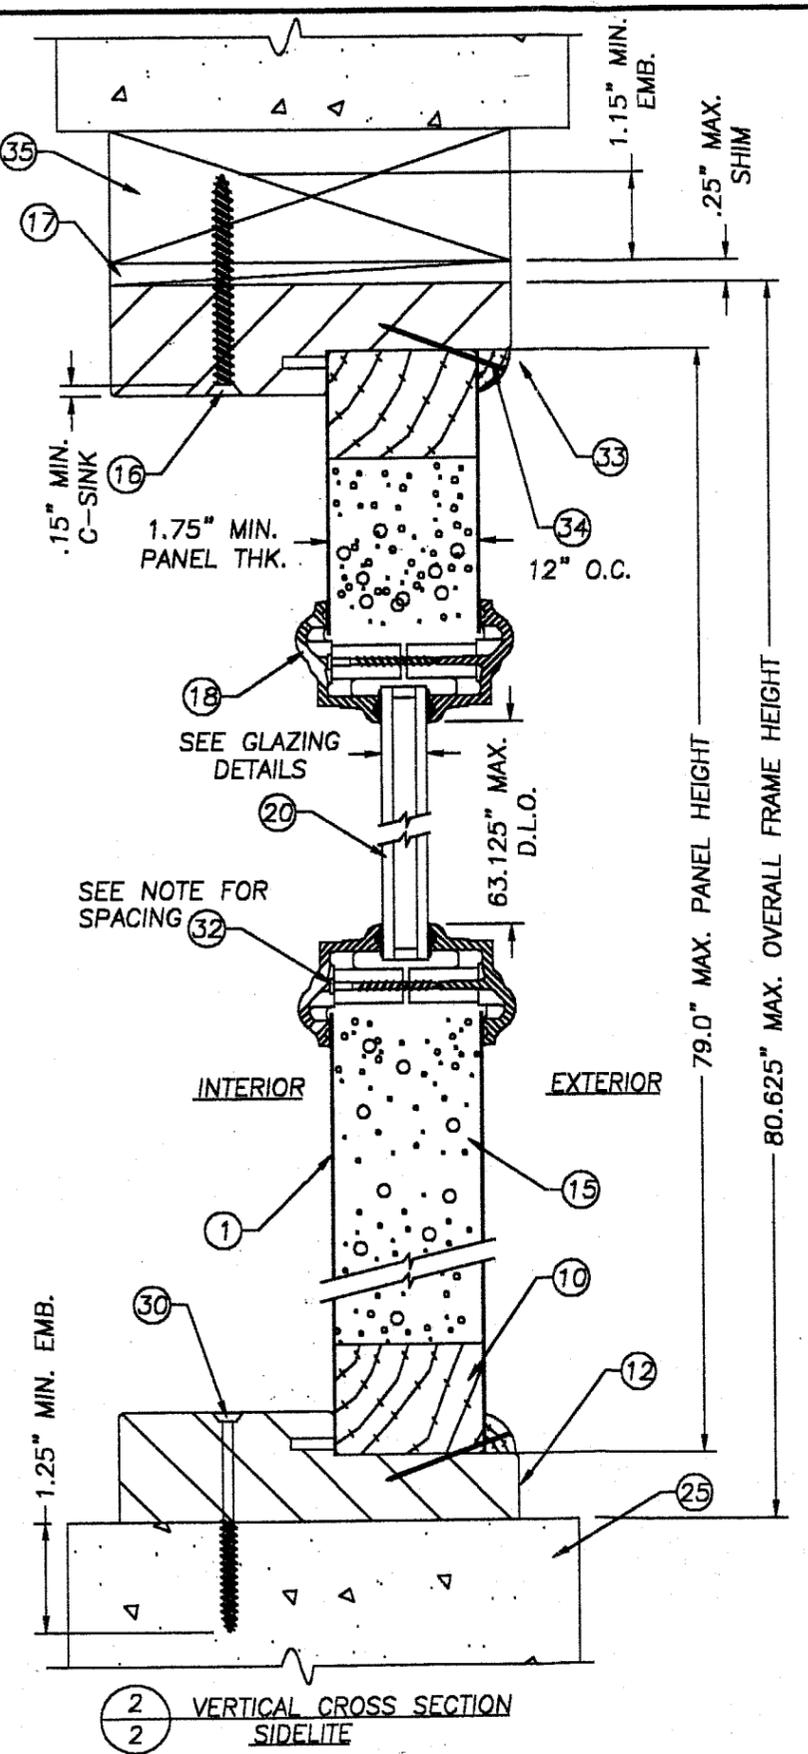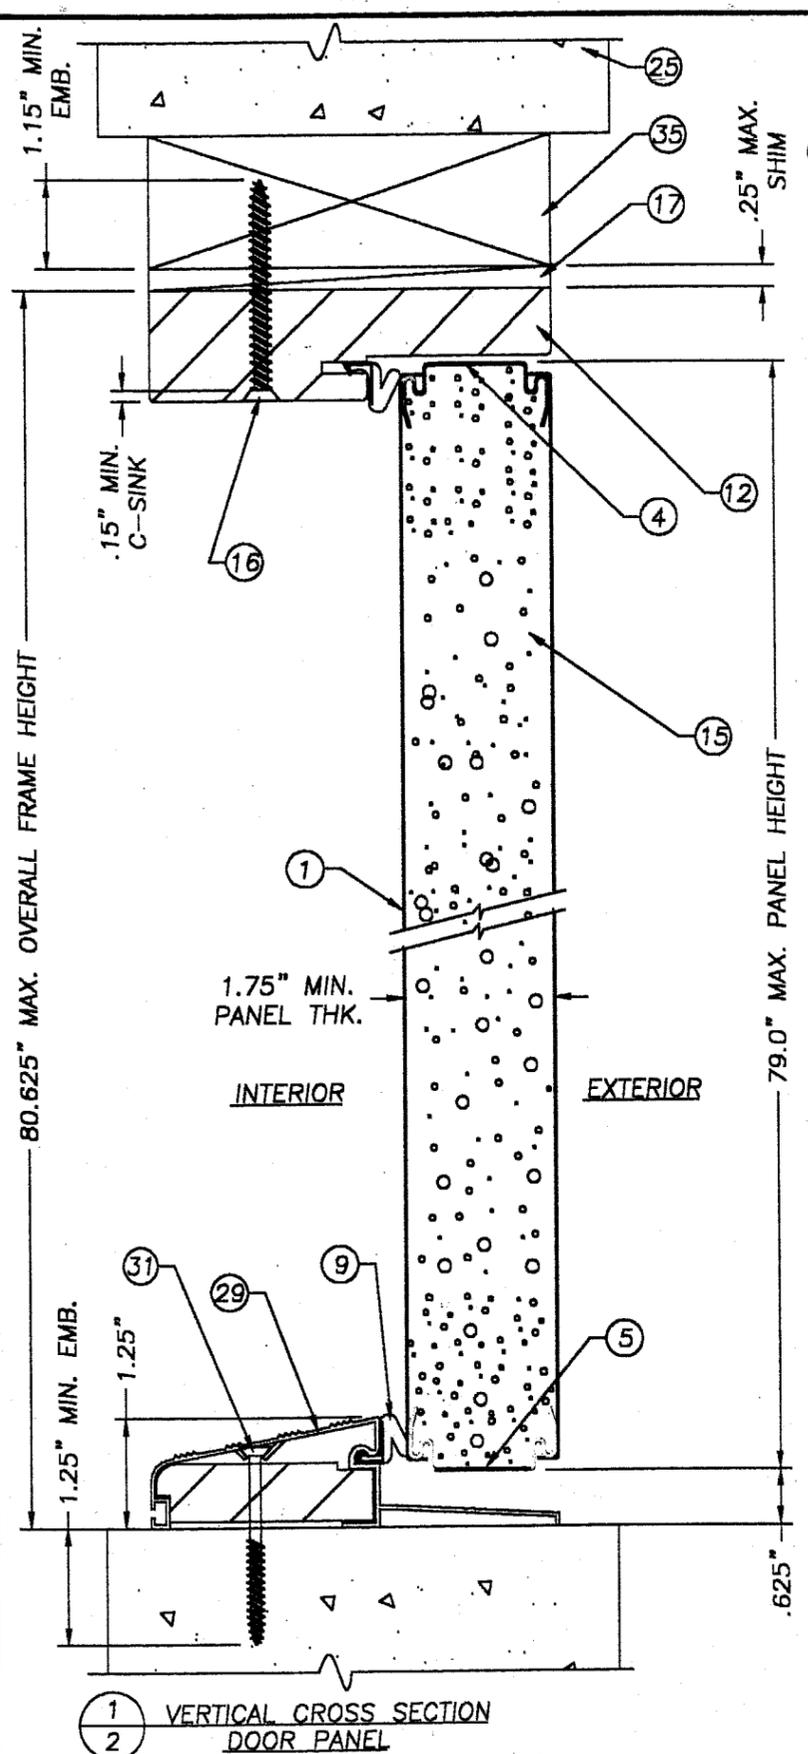

ITEM	DESCRIPTION	MATERIAL
1	DOOR SKIN (.021" MIN. STEEL)	STEEL
2	STEEL EDGE CAP, HINGE STILE (.028" THK.)	STEEL
3	STEEL EDGE CAP, LATCH STILE (.028" THK.)	STEEL
4	STEEL EDGE CAP, TOP (.028" THK.)	STEEL
5	STEEL EDGE CAP, BOTTOM (.028" THK.)	STEEL
6	WOOD LOCK BLOCK, DOOR PANEL 4" x 12" x 1.75"	WOOD
7	HINGES 4" x 4" x .088 WT. (STANLEY)	STEEL
8	#10 x 1/2" SHEET METAL SCREW	STEEL
9	COMPRESSION WEATHERSTRIP (SCHLEGAL QDS 650) MAGNETIC WEATHERSTRIP (HOLMES)	FOAM
10	SIDELITE TOP & BOTTOM RAIL (PONDEROSA PINE)	PINE
11	SIDELITE BLANK JAMB (PONDEROSA PINE)	PINE
12	HEAD JAMB (PONDEROSA PINE)	PINE
13	HINGE JAMB (PONDEROSA PINE)	PINE
14	LATCH JAMB (PONDEROSA PINE)	PINE
15	POLYURETHANE FOAM CORE (BASF) TYPE A. INFINITY: RESIN (P14120R) ISOCYANATE (P1001), CYCLOPENTANE. TYPE B. RETRO: RESIN (P12430R), ISOCYANATE (P1036).	
16	#8 x 2 1/2" PFH WS	STEEL
17	1/4" SHIM MATERIAL	-
18	LITE FRAME (ODL Spartech Polycor PP5530 C13) LITE FRAME (Trinity GE ASA Polycarbonate) (SEE GLAZING DETAILS SHEET 6 OF 7)	POLYPROP. ASA
19	GLAZING COMPOUNDS - SILICONE CAULK (GE WINDOW DOOR, NOVAGUARD) - LATEX SEALANT LIQUID NAIL	SILICONE LATEX
20	GLASS (1/2" BY ODL SEE GLAZING DETAIL) GLASS (1" BY ODL SEE GLAZING DETAIL)	
21	KWIKSET TITAN 700 SERIES DEADBOLT	-
22	KWIKSET TITAN 700 SERIES KNOB	-
23	#10 x 2" PFH WOOD SCREW	STEEL
24	#8 x 2" PFH WOOD SCREW	STEEL
25	MASONRY	CONCRETE
26	GLAZING TAPE (VENTURE TAPE .30" W. x .037" THK.) GLAZING COMPOUND LIQUID NAIL LATEX SEALANT GLAZING COMPOUND SILICONE CAULK (NOVAGARD)	FOAM LATEX SILICONE
27	#9 x 1.00 F.H. WD SCREWS	STEEL
28	#8 x 2" PANH WD SCREWS	STEEL
29	BUMP THRESHOLD	ALUMINUM
30	3/16" TAPCON (ITW) OR 3/16" (ELCO) 2 1/2" LG.	STEEL
31	3/16" TAPCON (ITW) OR 3/16" (ELCO) 2 1/4" LG.	STEEL
32	#8-1 1/4" TEK SCREW (LITE FRAME SCREW)	STEEL
33	GLAZING STOP QUARTER ROUND (1/2" x 1/2")	PINE
34	BRAD TRIM NAIL 2" LG.	STEEL
35	2X BUCK	WOOD
36	OPTIONAL EXTRUDED ALUMINUM ASTRAGAL (IMPERIAL)	ALUM.
37	1.68"x1.22" BLANK STILE (PONDEROSA PINE)	PINE
38	ASTRAGAL EXTRUDED ALUM. (WR68S WINDJAMBER II)	ALUM.
39	COMPRESSION WEATHERSTRIP (HOLMS, SEE NOTE 3 SHT. 3)	FOAM

STANLEY
 STANLEY DOOR SYSTEMS
 7300 REAMES ROAD
 CHARLOTTE, NC 28216
 PH. (704) 921-3470

PRODUCT: STANLEY OUTSWING OPAQUE 11-4 x 6-8 STEEL EDGE DOOR W/ & W/O SIDELITES
 PART OR ASSEMBLY: VERTICAL CROSS SECTIONS & BILL OF MATERIALS

NO.	DATE	REVISIONS	BY


RW BUILDING CONSULTANTS, INC.
 813.684.3831

DATE: 12/26/00
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: 43967
 SHEET 2 OF 7


PRODUCT RENEWED
 ACCEPTANCE No. 01-0928.05
 EXPIRATION DATE NOV 1, 2006
 By Ishag L. Chanda
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE MAY 10 2001
 BY Manuel Perry
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0129.21


NOTE: SPACING FOR ITEM #32; TOP & BOTTOM (1) 3 1/2" IN FROM CORNERS & (1) IN THE CENTER. SIDES; (6) SCREWS 3 1/4", 13 3/4", 26 1/2", 39 3/8", 52" & 62 5/8".

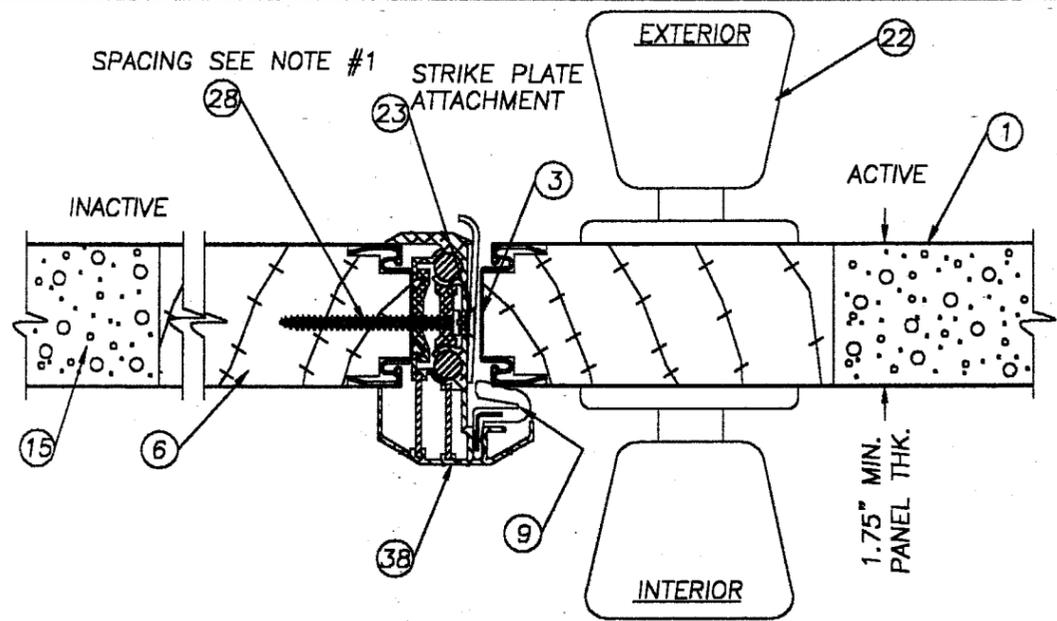


1 HORIZONTAL CROSS SECTION
3 AT ASTRAGAL TYP. (W/ITEM #38 WR68S)

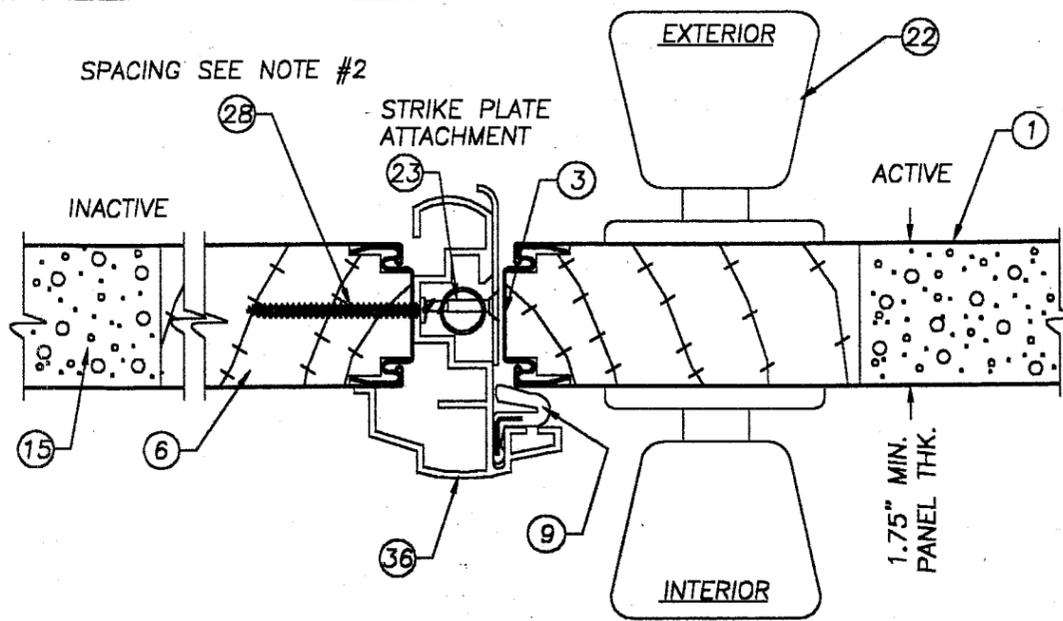

1 OPTIONAL HORIZONTAL CROSS SECTION
3 AT ASTRAGAL TYP. (W/ITEM #36 IMPERIAL)

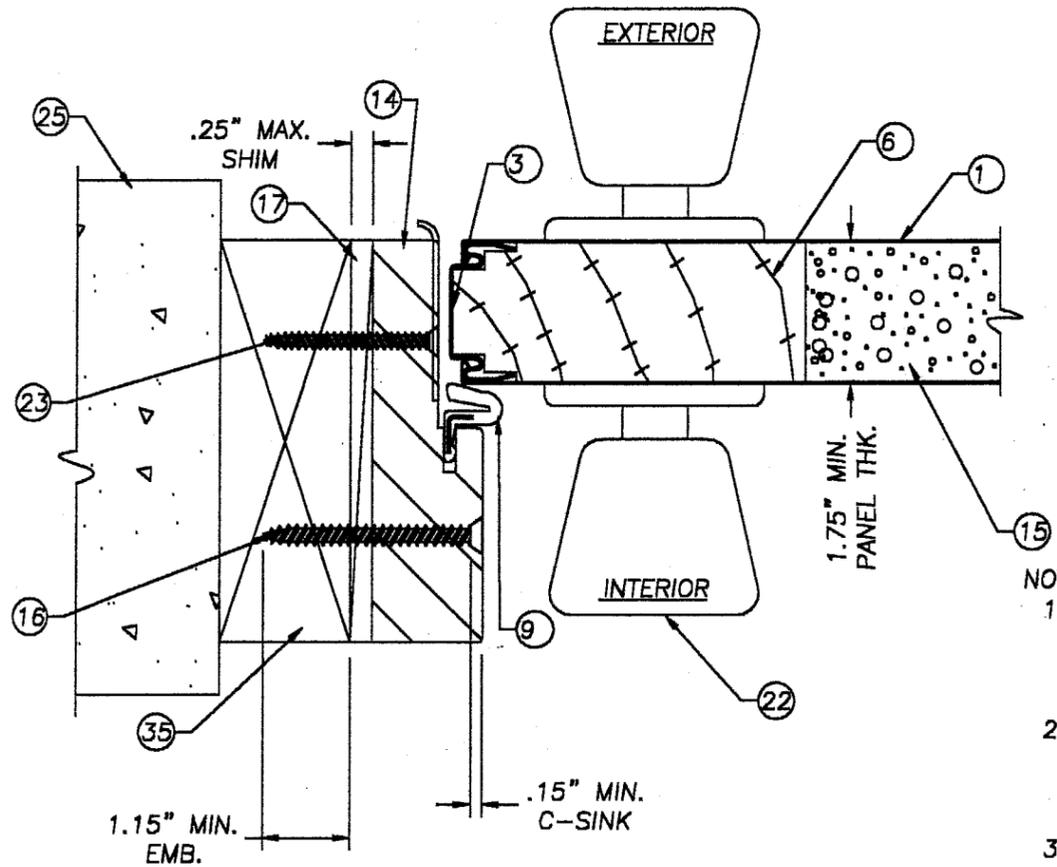

2 HORIZONTAL CROSS SECTION
3 AT LATCH JAMB TO BUCK, TYP.

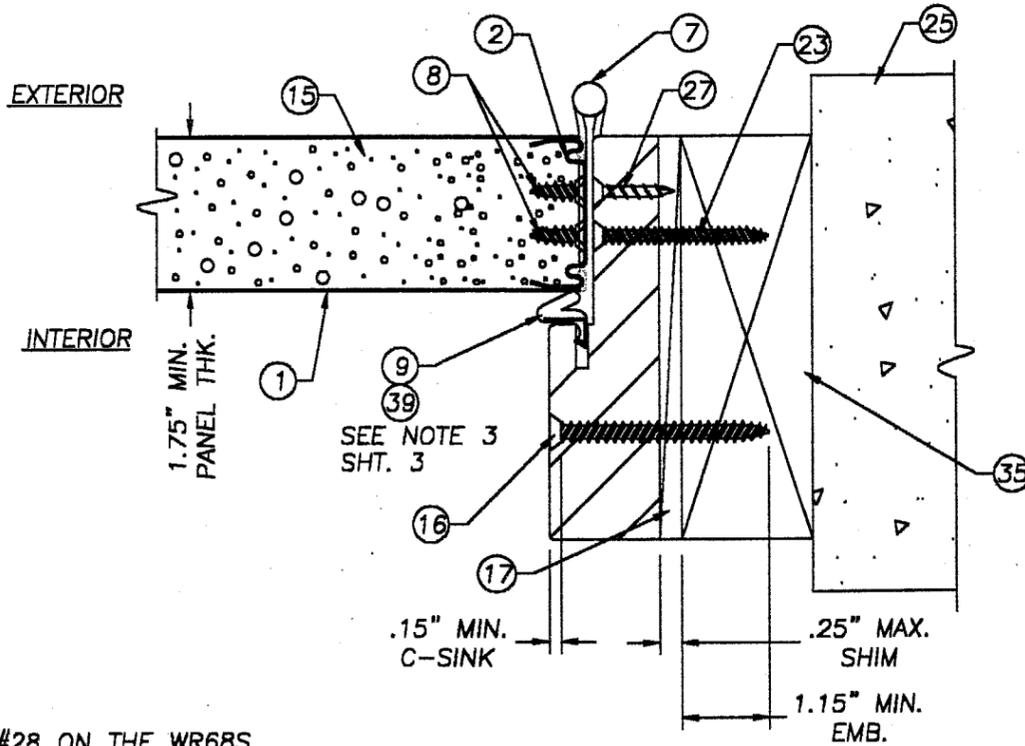

3 HORIZONTAL CROSS SECTION
3 AT HINGE JAMB TO BUCK, TYP.

- NOTES:
1. SPACING FOR ITEM #28 ON THE WR68S ASTRAGAL IS AS FOLLOWS: TOP DOWN & BOTTOM UP; 1", 3", 5", 26", & (1) 4" UP FROM THE STRIKE.
 2. SPACING FOR ITEM #28 ON THE IMPERIAL ASTRAGAL IS AS FOLLOWS: TOP DOWN & BOTTOM UP; 1", 2 1/2", 4", 5 1/2", 13", 18" & 26".
 3. WHEN USING HOLMES MAGNETIC TYPE WEATHERSTRIP ON THE FRAME USE ITEM #39, HOLMES COMPRESSION TYPE WEATHERSTRIP, ON THE HINGE JAMB.

PRODUCT RENEWED
 ACCEPTANCE NO. 01-0928.05
 EXPIRATION DATE Nov 1, 2006
 BY Isaac L. Chaudh
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE MAY 10 2001
 BY [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 01-0129.21


STANLEY
 STANLEY DOOR SYSTEMS
 7300 REAMES ROAD
 CHARLOTTE, NC 28216
 PH. (704) 921-3470

PRODUCT: STANLEY OUTSWING OPAQUE
 11-4 x 6-8 STEEL EDGE
 DOOR W/ & W/O SIDELITES
 PART OR ASSEMBLY:
 HORIZONTAL
 CROSS SECTIONS

NO.	DATE	REVISIONS	BY


RW BUILDING
 CONSULTANTS, INC.
 813.684.3831

DATE: 12/26/00
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: 43967
 SHEET 3 OF 7

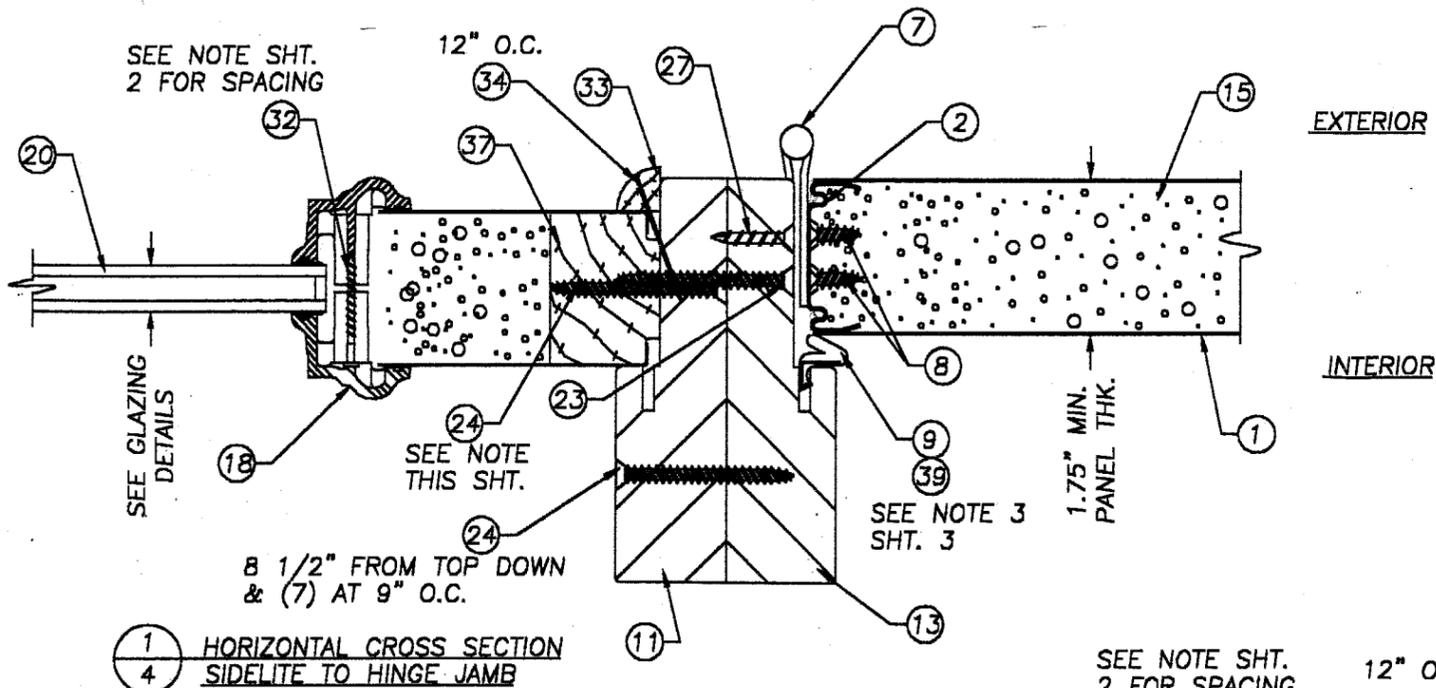


1 HORIZONTAL CROSS SECTION
4 SIDELITE TO HINGE JAMB

NOTE:
THE SIDELITE IS FASTENED INTO THE
JAMB WITH ITEM #24 (#8 x 2" PH.
FH SCREW) SPACED AS FOLLOWS:
6" DOWN FROM TOP AND 6" UP
FROM BOTTOM WITH (2) MORE EVENLY
SPACED, A TOTAL OF (4) SCREWS.

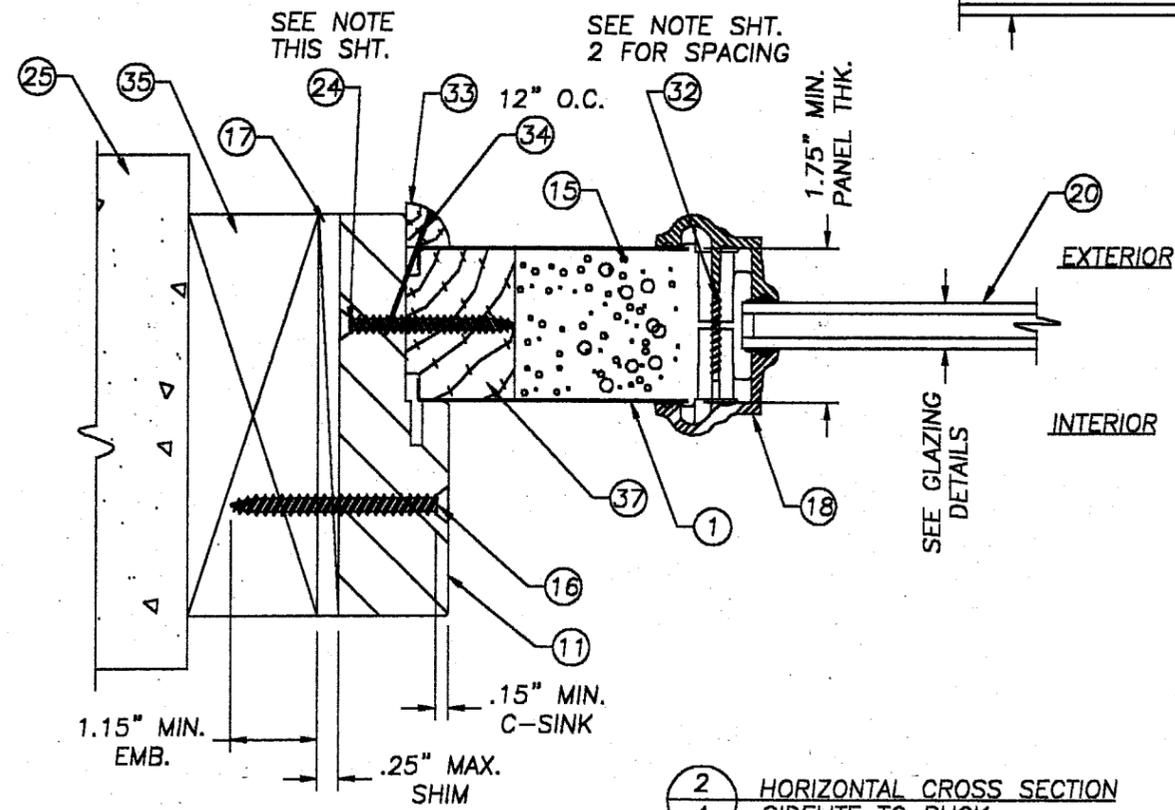

2 HORIZONTAL CROSS SECTION
4 SIDELITE TO BUCK

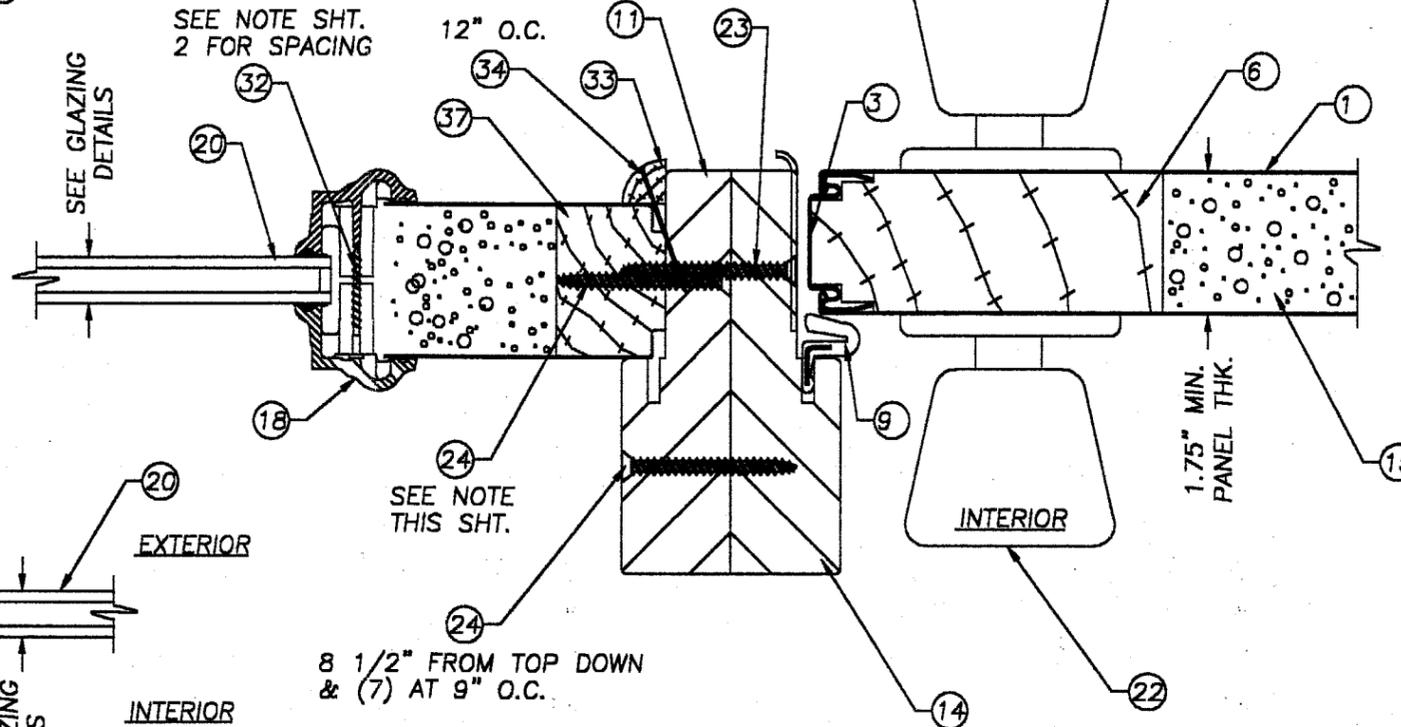

3 HORIZONTAL CROSS SECTION
4 SIDELITE TO LATCH JAMB

STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT: STANLEY OUTSWING OPAQUE
11-4 x 6-8 STEEL EDGE
DOOR W/& W/O SIDELITES
PART OR ASSEMBLY:
HORIZONTAL
CROSS SECTIONS

NO.	DATE	REVISIONS	BY









RW BUILDING
CONSULTANTS, INC.
813.684.3831

PRODUCT RENEWED

ACCEPTANCE No. 01-0928.05
EXPIRATION DATE Nov 1, 2006
By Ishag I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE MAY 10 2001
BY Mmanuel
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0129.21

DATE: 12/26/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 43967
SHEET 4 OF 7

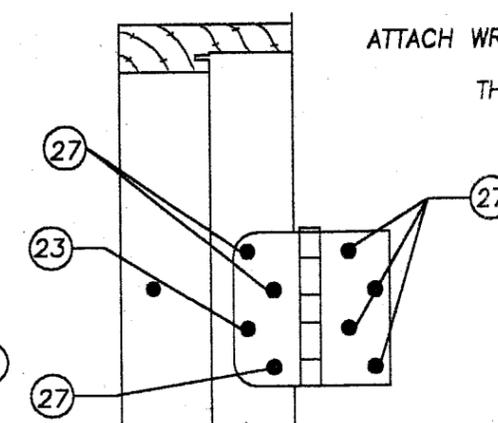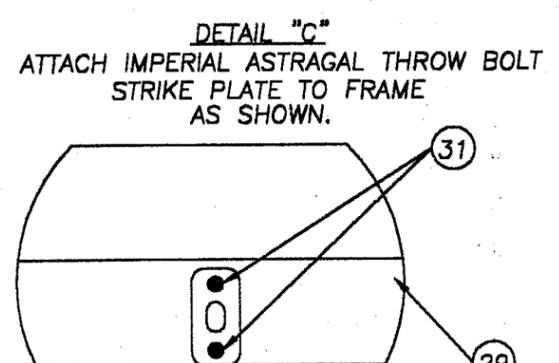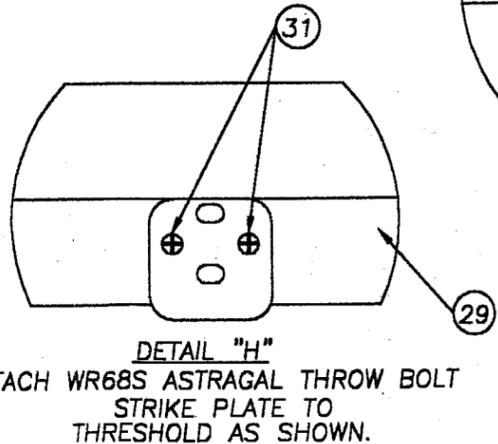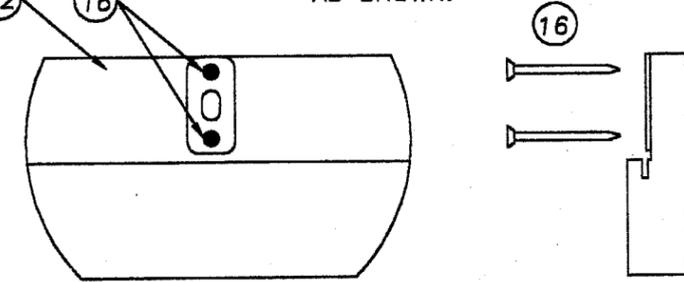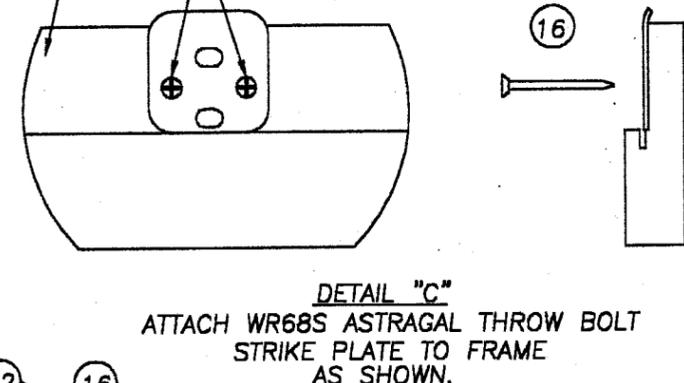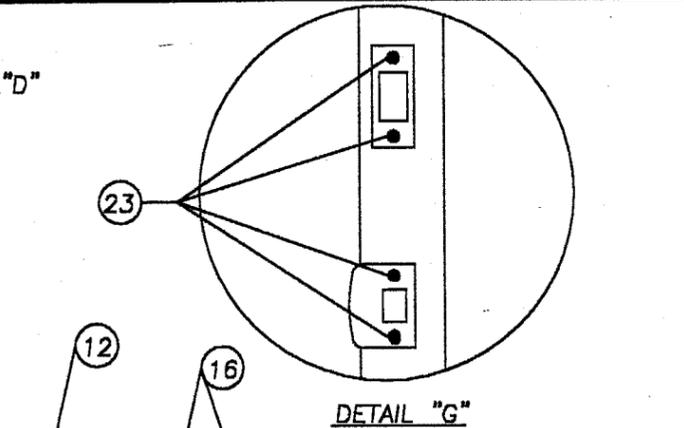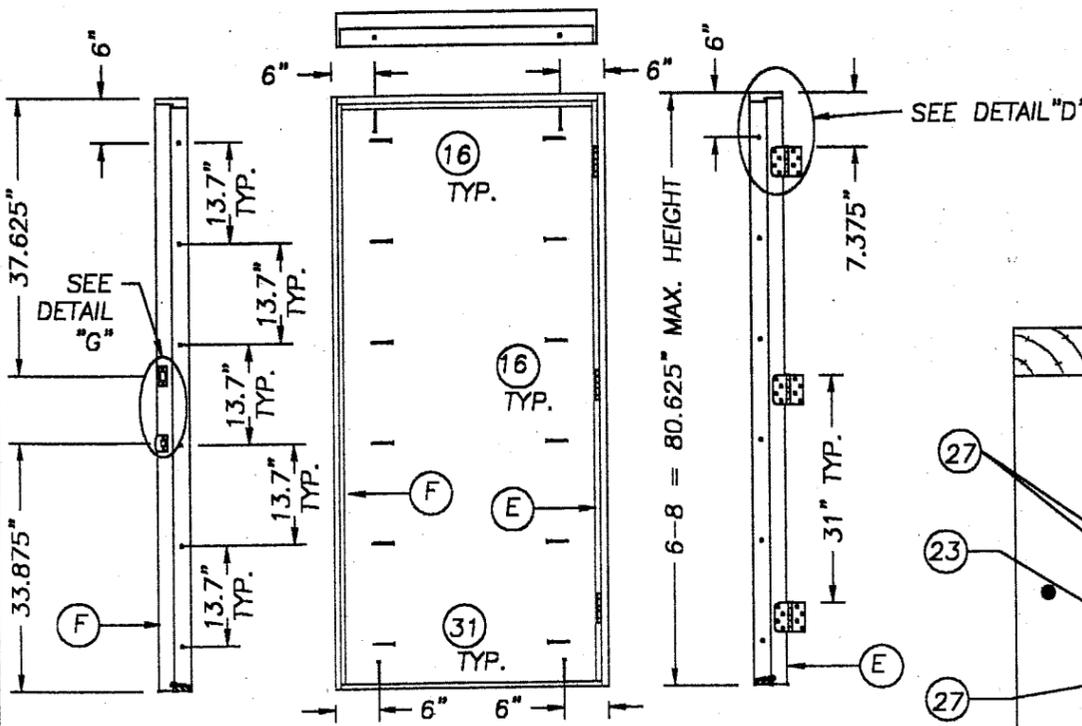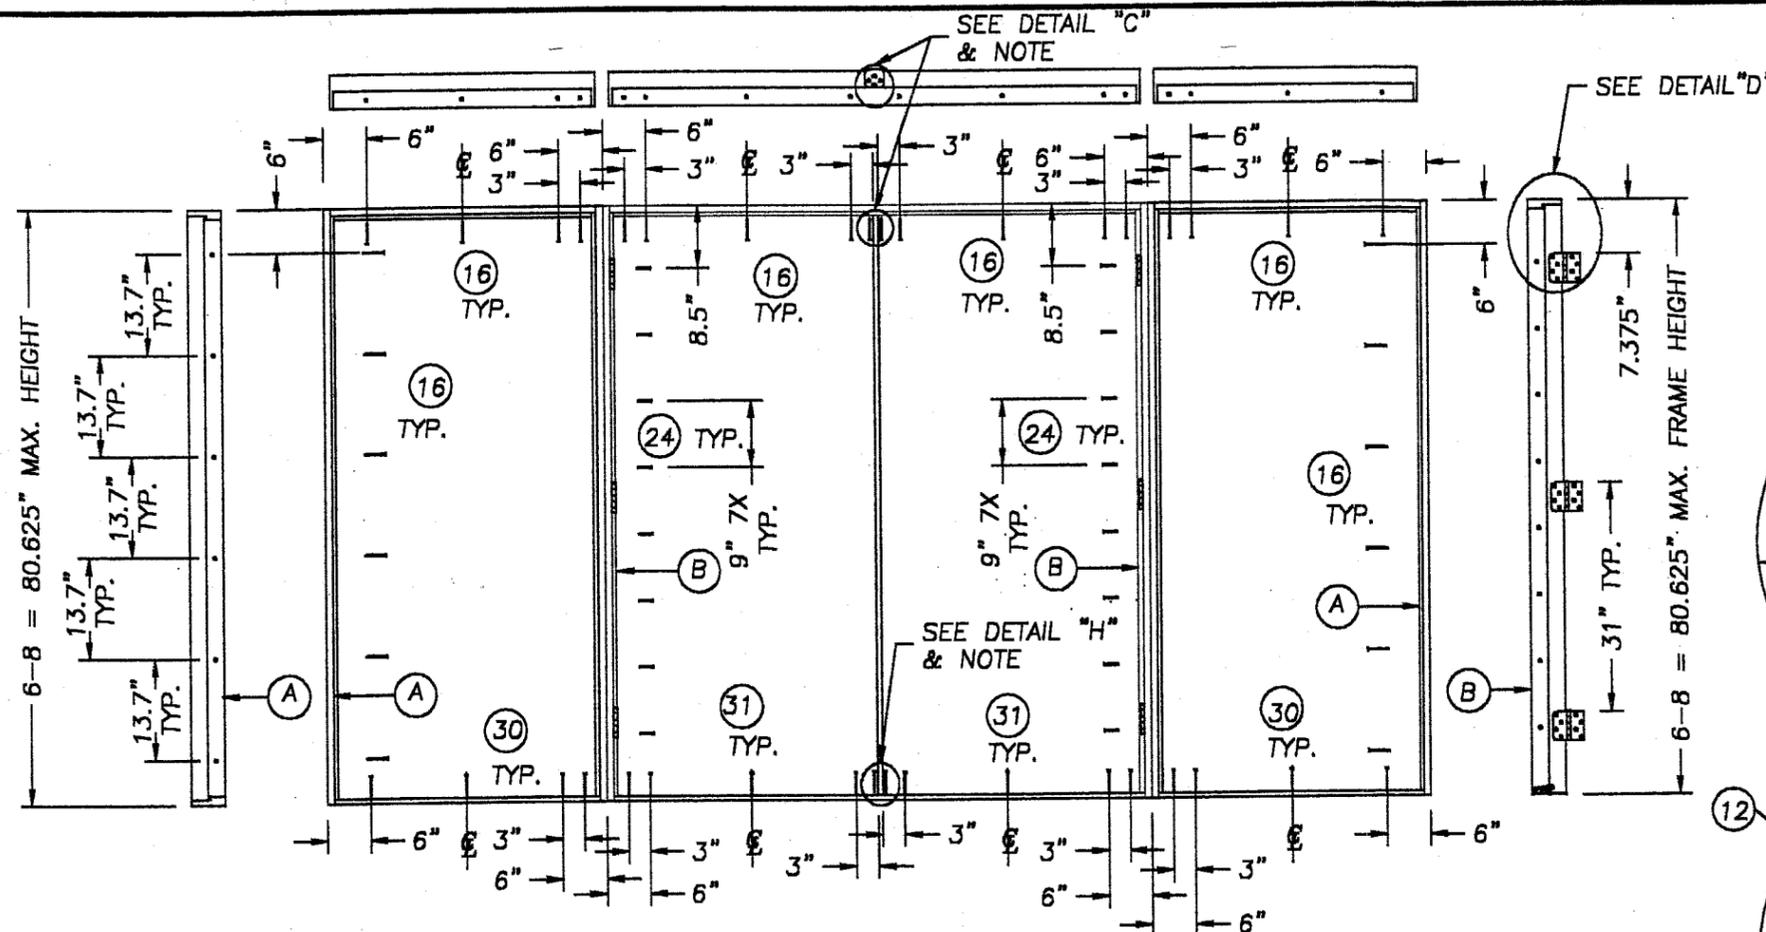

DETAIL "D"
HINGE DETAIL

NOTE: ANCHORING
ASTRAGAL STRIKE PLATE SCREWS
AT THE HEADER & THRESHOLD
MUST BE USED TO ACHIEVE
FULL ANCHORING LOAD.

DOOR PANELS NOT SHOWN FOR
CLARITY OF ANCHORING LAYOUTS

PRODUCT RENEWED

ACCEPTANCE NO. 01-0928-05
EXPIRATION DATE NOV 1, 2006
By Sheq I. Chanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE MAY 10 2001
BY Manuel Serrano
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0129.21


DATE:	12/26/00
SCALE:	N.T.S.
DWG. BY:	TJH
CHK. BY:	RW
DRAWING NO.:	43967
SHEET	5 OF 7

PRODUCT:
STANLEY OUTSWING OPAQUE
11-4 x 6-8 STEEL EDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
ANCHORING LAYOUTS
& DETAILS



NO.	DATE	REVISIONS	BY

RW BUILDING
CONSULTANTS, INC.
813.684.3831


STANLEY
STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

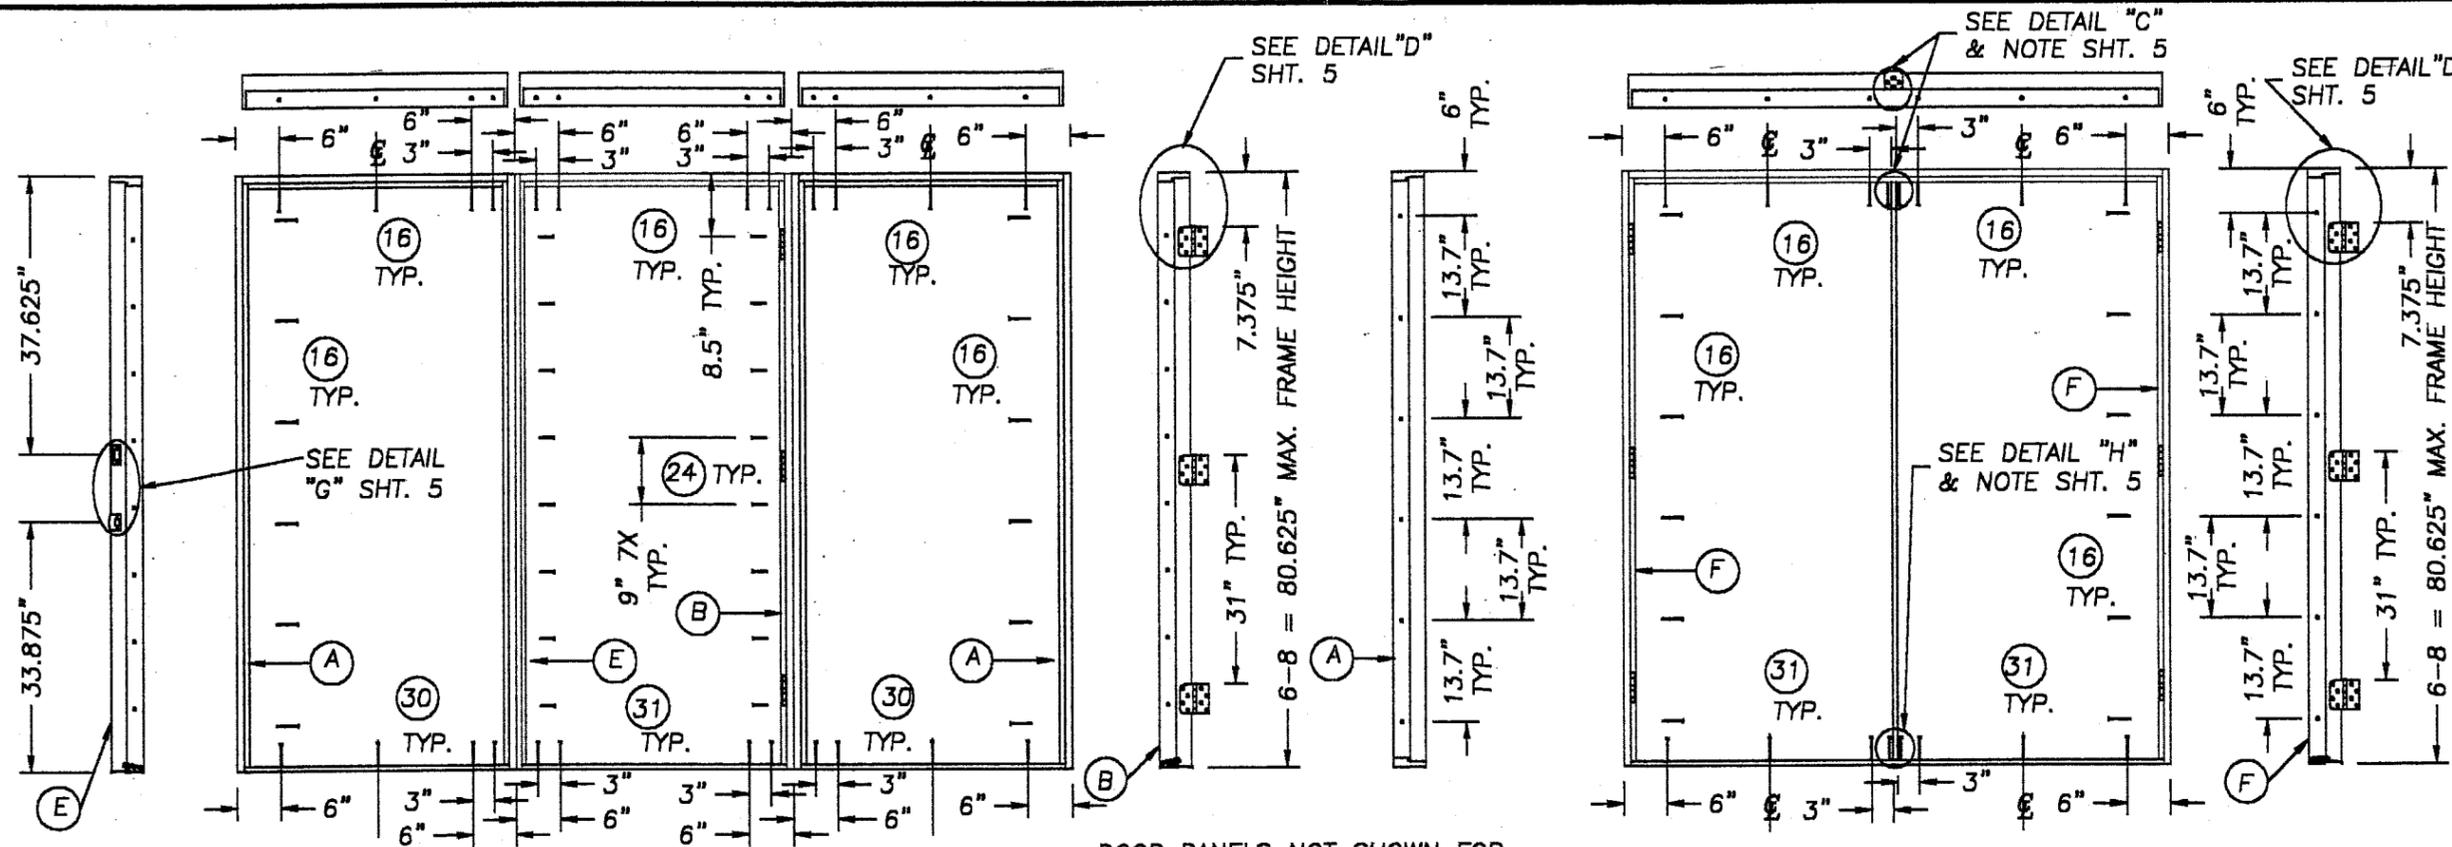


DOOR PANELS NOT SHOWN FOR CLARITY OF ANCHORING LAYOUTS

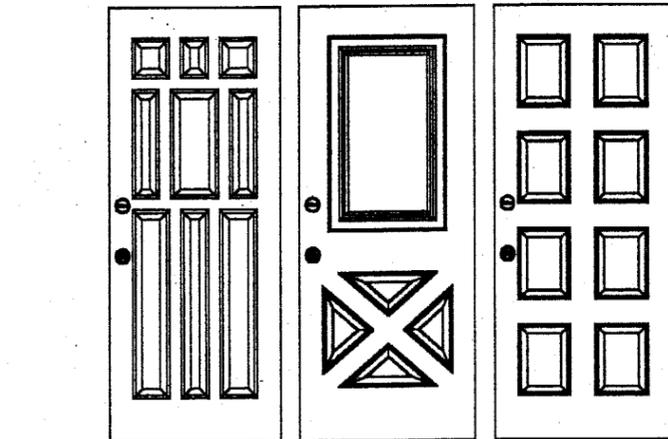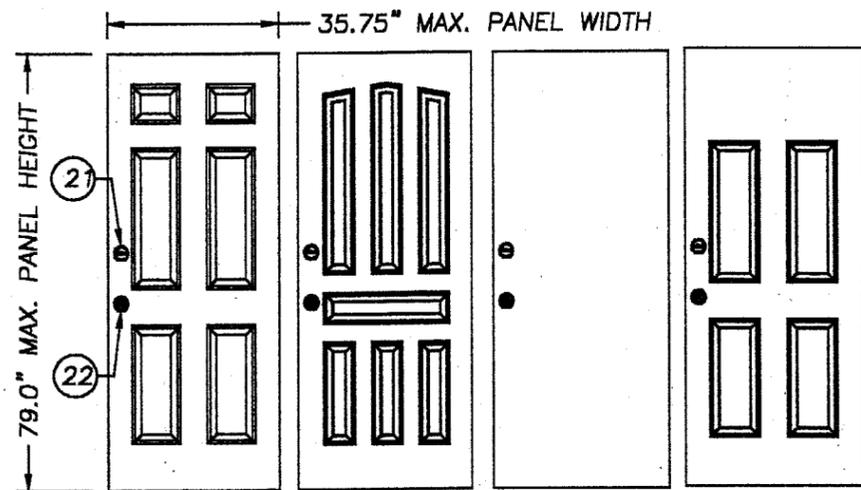

OPAQUE DOOR MODELS

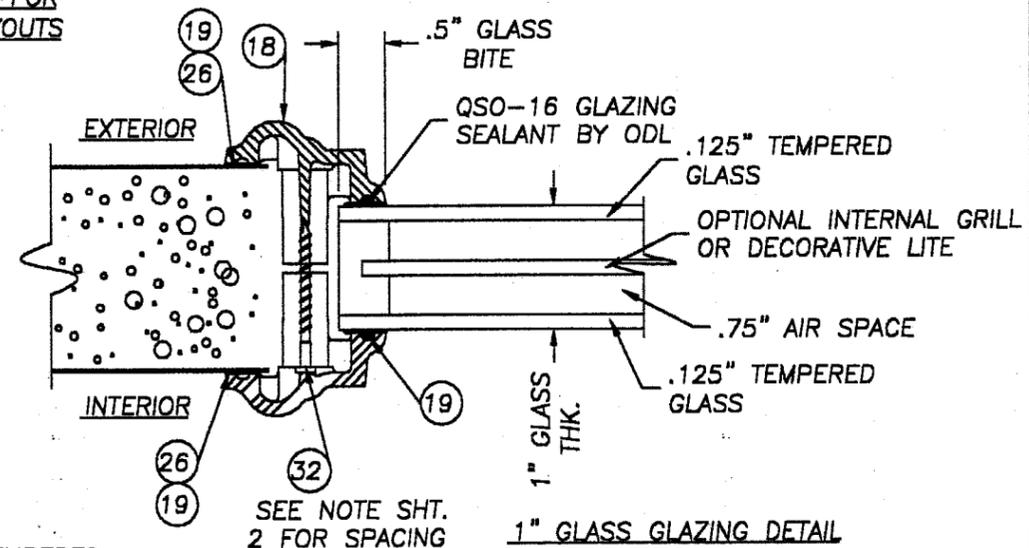

NOTE: GLASS LITE FRAME SURROUNDS
ODL Spartech Polycorn PP5530 C13
Trinity GE ASA Polycarbonate

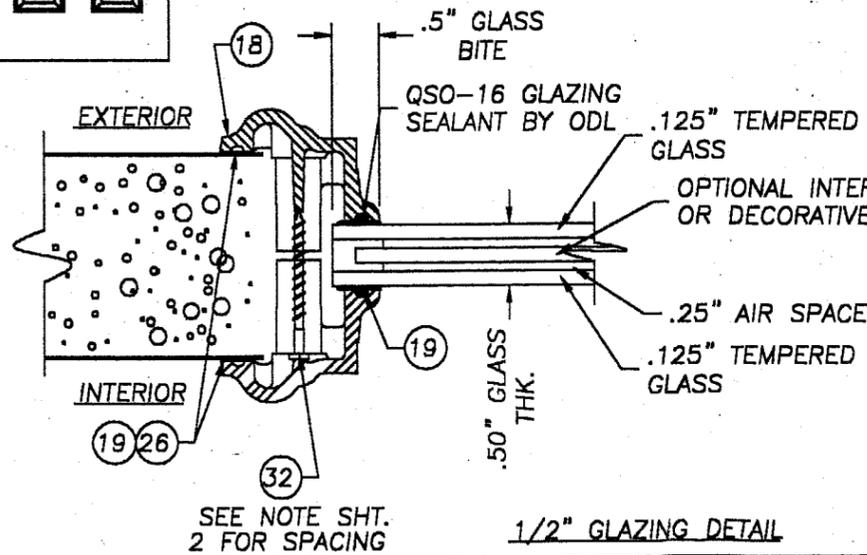

SEE NOTE SHT. 2 FOR SPACING

1/2" GLAZING DETAIL

STANLEY

STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

PRODUCT: STANLEY OUTSWING OPAQUE
11-4 x 6-8 STEEL EDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
ANCHORING LAYOUTS, DOOR
MODELS & GLAZING DETAILS

NO.	DATE	REVISIONS	BY


RW BUILDING
CONSULTANTS, INC.
813.684.3831

PRODUCT RENEWED


ACCEPTANCE NO. 01-0928.05
EXPIRATION DATE NOV 1, 2006
By Ishag L-Lhanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE MAY 10 2001
BY Manuel Perry
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0129.21


DATE: 12/26/00
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: 43967
SHEET 6 OF 7

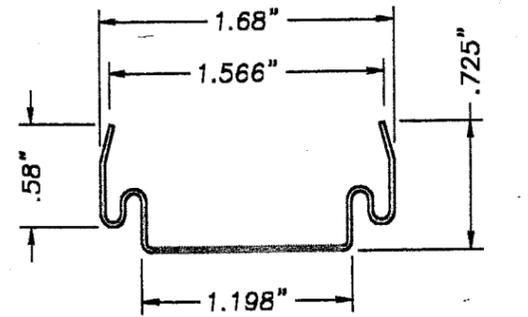


DOOR PANEL STEEL EDGE CAP
TOP, BOTTOM & SIDE .028" THK. STEEL

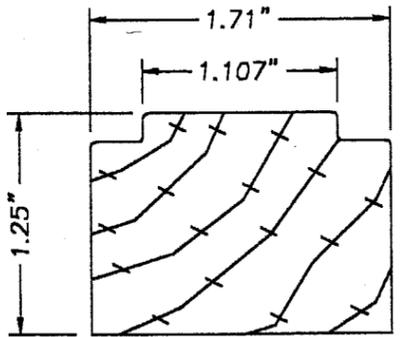


WOOD SIDELITE SIDE STYLE

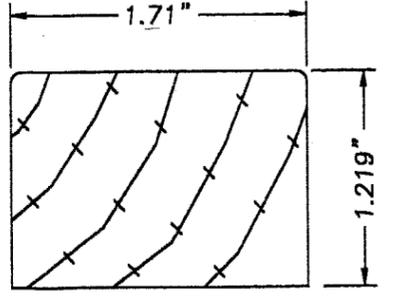


SIDELITE TOP & BOTTOM WOOD STYLE

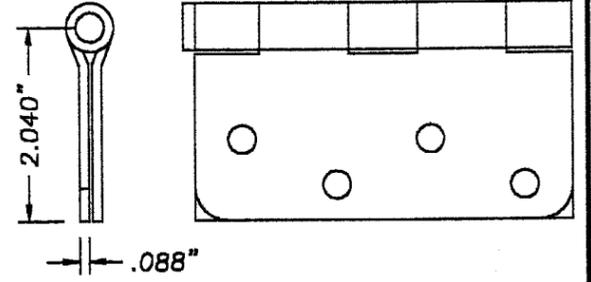


4 x 4 DOOR HINGE

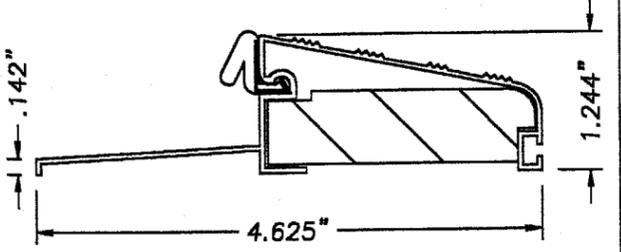

OUTSWING BUMP FACE ALUMINUM THRESHOLD
.045" WALL THK.

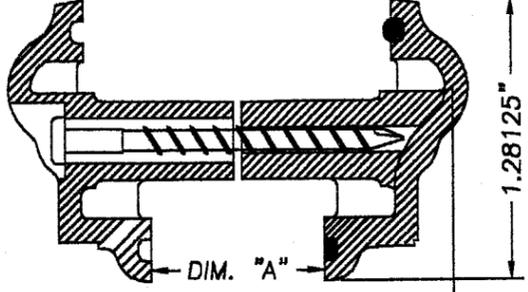


DIM "A"
.5" GLASS = .58"
1" GLASS = 1.08"
ODL Spartech Polycrom PP5530 C13
Trinity GE ASA Polycarbonate Lite Frame

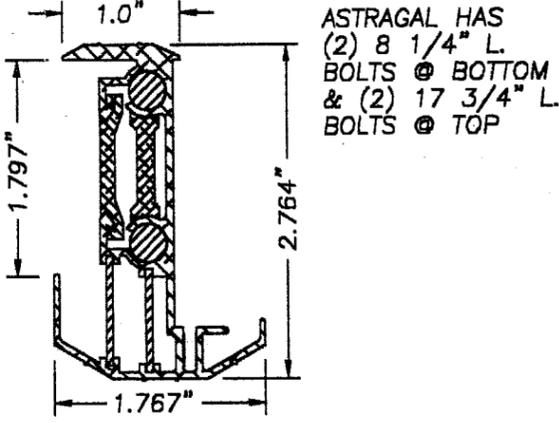


ASTRAGAL WINDJAMBER II
(WR68S) T-6063 EXTRUDED ALUMINUM


ASTRAGAL HAS
(2) 8 1/4" L.
BOLTS @ BOTTOM
& (2) 17 3/4" L.
BOLTS @ TOP

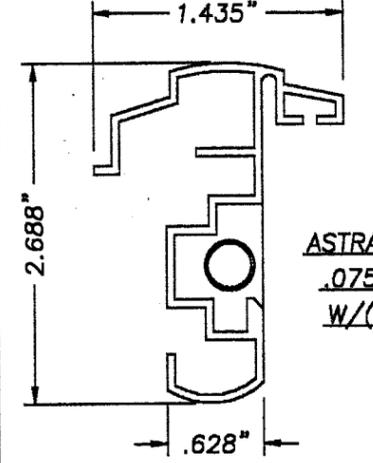


OPTIONAL ASTRAGAL (IMPERIAL)
.075" WALL ALUM.
W/(2) 12" BOLTS

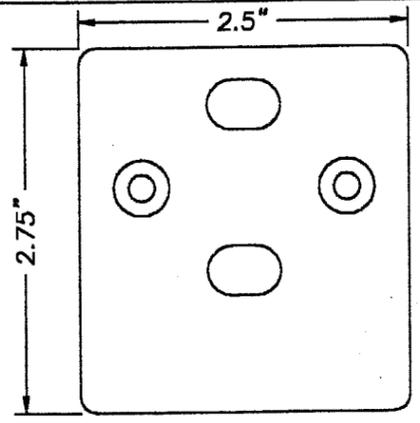


ASTRAGAL THRESHOLD STRIKE PLATE
WR68S .50" ALUM.

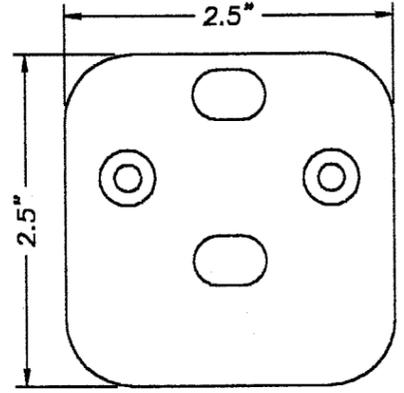


ASTRAGAL HEADER STRIKE PLATE
WR68S .066" STEEL

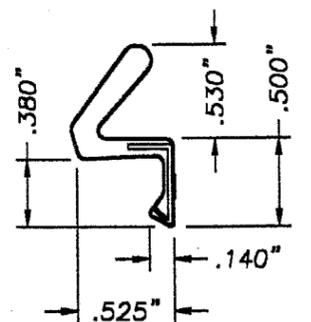


SCHLEGEL Q-LON QDS650

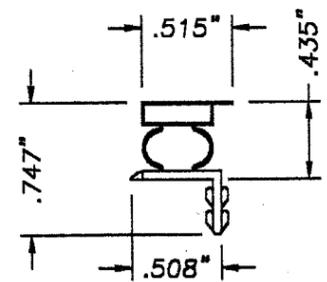

HOLMES MAGNETIC WEATHERSTRIP

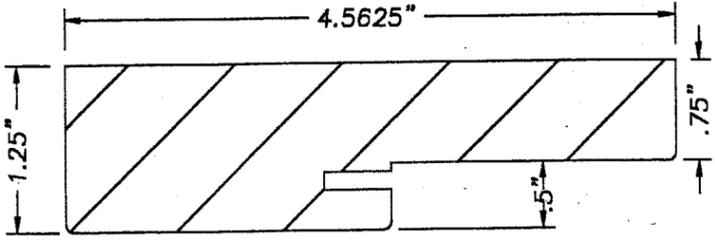

WOOD FRAME



HOLMES COMPRESSION WEATHERSTRIP

PRODUCT RENEWED

ACCEPTANCE NO. 01-0928-05
EXPIRATION DATE NOVEMBER 01, 2006
By Ishag L. Lhanda
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
SOUTH FLORIDA BUILDING CODE
DATE MAY 10 2001
BY Maurice Sney
PRODUCT CONTROL DIVISION
BUILDING CODE COMPLIANCE OFFICE
ACCEPTANCE NO. 01-0129-21

DATE:	12/26/00
SCALE:	N.T.S.
DWG. BY:	TJH
CHK. BY:	RW
DRAWING NO.:	43967
SHEET	7 OF 7

RW BUILDING
CONSULTANTS, INC.
813.684.3831

PRODUCT: STANLEY OUTSWING OPAQUE
11-4 x 6-8 STEEL EDGE
DOOR W/ & W/O SIDELITES
PART OR ASSEMBLY:
UNIT COMPONENTS

STANLEY

STANLEY DOOR SYSTEMS
7300 REAMES ROAD
CHARLOTTE, NC 28216
PH. (704) 921-3470

NO.	DATE	REVISIONS	BY