



BUILDING CODE COMPLIANCE OFFICE
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908

CONTRACTOR LICENSING SECTION
(305) 375-2527 FAX (305) 375-2558

CONTRACTOR ENFORCEMENT DIVISION
(305) 375-2966 FAX (305) 375-2908

PRODUCT CONTROL DIVISION
(305) 375-2902 FAX (305) 372-6339

PRODUCT CONTROL NOTICE OF ACCEPTANCE

KMT Refrigeration, Inc.
715 St. Croix Street P.O. Box 137
River Falls ,WY 54022

Your application for Notice of Acceptance (NOA) of:

Walk- In Coolers/Freezer

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

ACCEPTANCE NO.: 01-1017.03
EXPIRES: 09/24/2006

Raul Rodriguez
Chief Product Control Division

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL
CONDITIONS
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.
Director
Miami-Dade County
Building Code Compliance Office

APPROVED: 01/10/2002

APPROVED: January 10, 2002

EXPIRES: September 24, 2006

NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS

1. SCOPE

- 1.1 This **renews** Notice of Acceptance (NOA) No. **97-1215.03**, which was issued on September 24, 1998. It renews the approval of a walk-in cooler/freezer, as described in Section 2 of this NOA, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

2. PRODUCT DESCRIPTION

- 2.1 The **Metal Sheathed Urethane Foam Filled Modular Panel Walk-in Cooler/Freezer** and its components shall be constructed in strict compliance with the following document: Drawing No **96-260**, Sheets 1 through 6 of 6, titled "Walk-in Cooler/Freezer," prepared by Knezevich & Associates, Inc., dated 12/12/97 and revised on 7/31/98, signed and sealed by V.J. Knezevich, P.E., bearing the Miami-Dade County Product Control renewal stamp with the NOA number and expiration date by the Miami-Dade County Product Control Division. This document shall hereinafter be referred to as the approved drawings.

3. LIMITATIONS

- 3.1 All permanent set components must be protected against corrosion, contamination and damage at all times.

4. INSTALLATION


- 4.1 The Metal Sheathed Urethane Foam Filled Modular Panel Walk-in Cooler/Freezer must be installed in strict compliance with the approved drawings.

5. LABELING

- 5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

6. BUILDING PERMIT REQUIREMENTS

- 6.1 Application for building permit shall be accompanied by copies of the following:
- 6.1.1 This Notice of Acceptance
 - 6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.
 - 6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

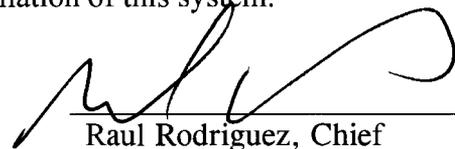

Raul Rodriguez, Chief
Product Control Division

APPROVED: January 10, 2002

EXPIRES: September 24, 2006

NOTICE OF ACCEPTANCE: STANDARD CONDITIONS

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
 - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
 - b) The product is no longer the same product (identical) as the one originally approved;
 - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
 - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
 - a) Unsatisfactory performance of this product or process.
 - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

END OF THIS ACCEPTANCE



Raul Rodriguez, Chief
Product Control Division

GENERAL NOTES:

- THESE UNITS ARE DESIGNED IN ACCORDANCE WITH THE SOUTH FLORIDA BUILDING CODE (S.F.B.C.) 1994 EDITION.
- DESIGN IS BASED ON TESTING IN ACCORDANCE WITH DADE COUNTY REQUIREMENTS, INCLUDING LARGE MISSILE IMPACT REQUIREMENTS. DESIGN IS BASED ON THE FOLLOWING TEST REPORT. CTC REPORT NUMBER 97-010.
- WIND FORCES ARE IN ACCORDANCE WITH ASCE 7-88 WITH A BASIC WIND VELOCITY OF 110 MPH AND 1.05 IMPORTANCE FACTOR, AND EXPOSURE "C" INSTALLATION.
- DESIGN LOADS:
 - ROOF:
 - DEAD LOAD - PANEL TYPE 1 3.16 P.S.F.
PANEL TYPE 2 4.25 P.S.F.
 - LIVE LOAD 30 P.S.F.
 - WIND LOADS ARE CALCULATED IN ACCORDANCE WITH THE ASCE 7-88 USING CRITERIA FOR "BUILDINGS" TABLE 4 AND INTERNAL PRESSURE COEFFICIENT OF ±0.25 FROM TABLE 9.
 - MAXIMUM WEIGHT OF MECHANICAL EQUIPMENT IS 330 # PER CONDENSING UNIT. SPACE UNITS AT LEAST 4'-0" O.C.
 - WALLS:

WIND LOADS ARE IN ACCORDANCE WITH ASCE 7-88 USING THE CRITERIA FOR "BUILDINGS" TABLE 4 AND INTERNAL PRESSURE COEFFICIENT OF ±0.25 FROM TABLE 9.

 - DEAD LOAD - PANEL TYPE 1 1.55 P.S.F.
PANEL TYPE 2 3.40 P.S.F.
 - FLOOR:
 - DEAD LOAD:
FLOOR PANEL 5.0 PSF
 - LIVE LOAD - INSULATED FLOOR 250 P.S.F.
- "FLOORLESS" 250 P.S.F.
- DEFLECTIONS:
 - ROOF L/240
 - WALL L/180
 - FLOOR L/360
- ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY, U.O.N.
- ALL BOLTS AND SCREWS SHALL BE 2024-T4 ALUMINUM ALLOY, ELECTRO-GALVANIZED STEEL, HOT DIPPED GALVANIZED STEEL OR 300 SERIES STAINLESS STEEL WITH A MIN. TENSILE STRENGTH OF 60 KSI.
- ALL CONCRETE ANCHORS SHALL BE AS SPECIFIED ON THE DRAWINGS EMBEDMENT LENGTHS NOTED ON THE DRAWINGS SHALL NOT INCLUDE FINISH MATERIAL.
- DISSIMILAR METALS IN CONTACT WITH EACH OTHER SHALL BE PROTECTED IN ACCORDANCE WITH THE S.F.B.C. CHAPTER 30, SECTION 3004.4.

RIGID URETHANE FOAM SANDWICH PANEL SPECIFICATIONS

- WALL & ROOF COMPOSITE SANDWICH PANELS ARE COMPRISED OF ALUMINUM OR STEEL FACINGS WITH Poured URETHANE PLASTIC CORES. THICKNESS AND MATERIAL OF FACINGS SHALL BE AS SHOWN ON THE DRAWINGS.
- ALUMINUM FACINGS SHALL BE 3105-H154 ALLOY UNPAINTED FOR INTERIOR AND EXTERIOR USE. STEEL FACINGS SHALL BE ASTM A653 HSLA TYPE I GRADE 50 STEEL WITH A G90 GALVANIZED COATING.
- MINIMAL DENSITY OF URETHANE PANEL CORE SHALL BE 2.2 P.C.F.
- URETHANE FOAM CORE SHALL HAVE A FLAME SPREAD RATING OF NOT MORE THAN 75 AND SHALL HAVE A SMOKE-DEVELOPED RATING OF NOT MORE THAN 450 IN ACCORDANCE WITH S.F.B.C. 3505.3 (a) (1).
- FOR SPECIFIC REQUIREMENTS OF WALK-IN COOLERS SEE S.F.B.C. 3505.3 (b)(2).

WALK-IN COOLER COMPONENTS DESCRIPTION

1. ROOF PANEL TYPE 1 - 6" THICKNESS

COMPOSITE SANDWICH PANEL CONSISTED OF ONE (TOP) 20 GAGE, t=0.034", GALVANIZED STEEL AND ONE (BOTTOM) 0.040" ALUMINUM FACINGS FILLED WITH 2.2 PCF URETHANE FOAM.

2. ROOF PANEL TYPE 2 - 6" THICKNESS

COMPOSITE SANDWICH PANEL CONSISTED OF TWO (TOP & BOTTOM) 20 GAGE, t=0.034", GALVANIZED STEEL FACINGS FILLED WITH 2.2 PCF URETHANE FOAM.

3. WALL PANEL TYPE 1 - 4" THICKNESS

COMPOSITE SANDWICH PANEL WITH TWO (EXTERIOR & INTERIOR) 0.032" ALUMINUM FACINGS FILLED WITH 2.2 PCF URETHANE FOAM.

4. WALL PANEL TYPE 2 - 4" THICKNESS


COMPOSITE SANDWICH PANEL WITH TWO (EXTERIOR & INTERIOR) 20 GAGE, t=0.034", GALVANIZED STEEL FACINGS FILLED WITH 2.2 PCF URETHANE FOAM.

5. FLOOR PANEL - 3-5/8" THICKNESS

COMPOSITE SANDWICH PANEL WITH ONE (TOP) 14 GA, t=0.076", GALVANIZED STEEL, 16 GA, t=0.061", 304 STAINLESS STEEL OR 0.100" ALUMINUM AND ONE (BOTTOM) 26 GA, t=0.019", GALVANIZED STEEL FACING FILLED WITH 2.2 PCF URETHANE FOAM.

FOUNDATION NOTE:


- EACH EXTERIOR INSTALLATION SHALL HAVE A FOUNDATION DESIGN BY A FLORIDA REGISTERED PROFESSIONAL ENGINEER. SEE TABLE 1 ON SHEET 3, FOR LOADS.

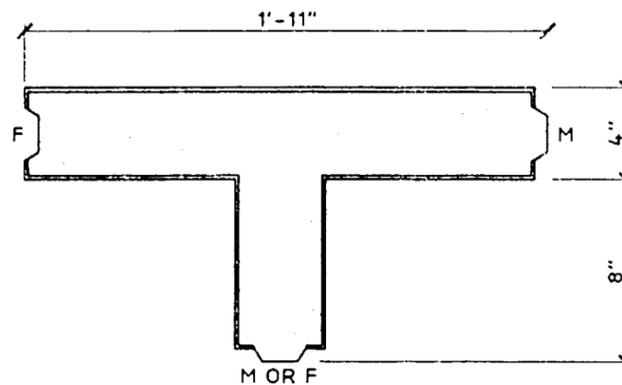

TYPE 1, TYPE 2 (SEE WALK-IN COOLER COMPONENTS DESCRIPTION NOTES 3 OR 4)

4 WALL PANEL (TEE SECTION)


SCALE: 1-1/2" = 1'-0"

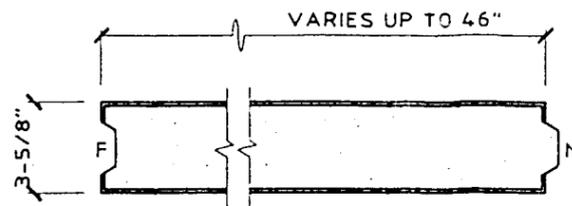

SEE WALK-IN COOLER COMPONENTS DESCRIPTION NOTE 5

5 FLOOR PANEL


SCALE: 1-1/2" = 1'-0"

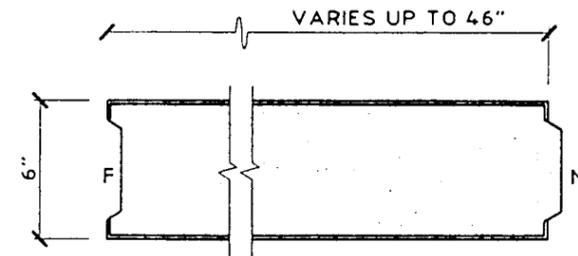

TYPE 1, TYPE 2 (SEE WALK-IN COOLER COMPONENTS DESCRIPTION NOTES 1 OR 2)

1 ROOF PANEL


SCALE: 1-1/2" = 1'-0"

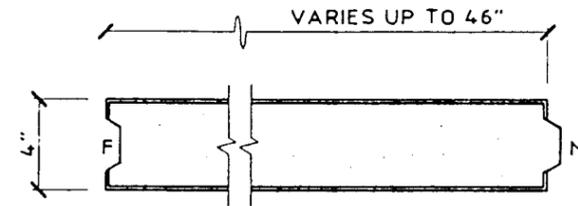

TYPE 1, TYPE 2 (SEE WALK-IN COOLER COMPONENTS DESCRIPTION NOTES 3 OR 4)

2 WALL PANEL

SCALE: 1-1/2" = 1'-0"

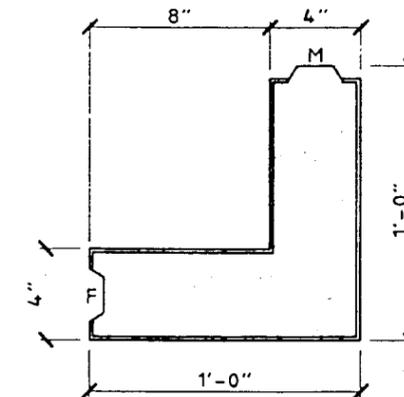

TYPE 1, TYPE 2 (SEE WALK-IN COOLER COMPONENTS DESCRIPTION NOTES 3 OR 4)


3 WALL PANEL (CORNER SECTION)

SCALE: 1-1/2" = 1'-0"

PRODUCT RENEWED

ACCEPTANCE No. 01-1017-03
 EXPIRATION DATE September 24, 2006
 By [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE September 24, 1998
 BY [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE No. 99-1215-03



KNEZEVICH & ASSOCIATES, INC.
 CONSULTING ENGINEERS - PRODUCT TESTING
 641 HOKENA DRIVE - MIAMI SPRINGS, FLORIDA 33166
 MIAMI (305) 883-9571 FT. LAUDERDALE (954) 677-9500
 FAX: (305) 883-9572
 COPYRIGHT 1997 KNEZEVICH & ASSOCIATES, INC.
 FOR: K.M.T. REFRIGERATION INC.

WALK-IN COOLER/FREEZER
K.M.T. REFRIGERATION INC.
KOLPAK
 WALK-INS
 715 ST. CROIX STREET
 P.O. Box 137
 RIVER FALLS, WI 54022
 (715) 425-0741

NO.	DATE	BY	DESCRIPTION	COUNTY COMMENTS
1	7/31/98	JW		

V.J. KNEZEVICH
 PROFESSIONAL ENGINEER
 FL License No. FE 0719983
 JUL 31 1998
 date 12/12/97
 scale AS NOTED drawn by GG
 design by ZS checked by VJK
 drawing no 96-260
 sheet 1 of 6




KNEZEVICH & ASSOCIATES, INC.
 CONSULTING ENGINEERS - PRODUCT TESTING
 641 MOKENA DRIVE-MIAMI SPRINGS, FLORIDA 33166
 MIAMI (305) 883-9571 FT. LAUDERDALE (954) 677-9500
 FAX: (305) 883-9572
 COPYRIGHT 1997 KNEZEVICH & ASSOCIATES, INC.
 FOR: K.M.T. REFRIGERATION INC.


WALK-IN COOLER/FREEZER
K.M.T. REFRIGERATION INC.
 715 ST. CROIX STREET
 P.O. Box 137
 RIVER FALLS, WI 54022
KOLPAK
 WALK-INS
 (715) 425-6741

NO.	DATE	BY	DESCRIPTION	COUNTY COMMENTS
1	7/31/98	JW		


V.J. KNEZEVICH
 PROFESSIONAL ENGINEER
 FL License No.
 PE 030983
 JUL 31 1998
 date 12/12/97
 AS NOTED drawn by GG
 design by ZS checked by VJK
 drawing no
96-260
 sheet 2 of 6

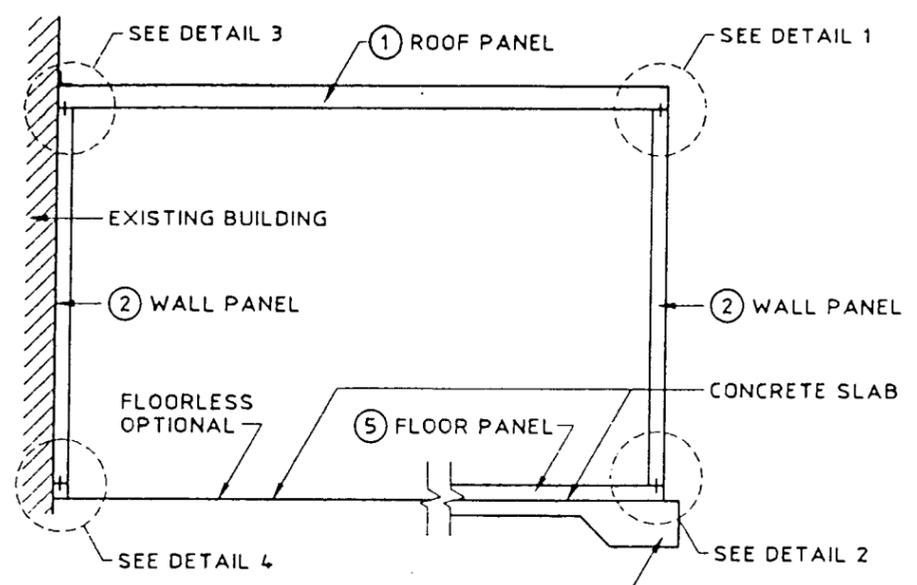


SECTION A (TYP.)
 SCALE: 1/4" = 1'-0"

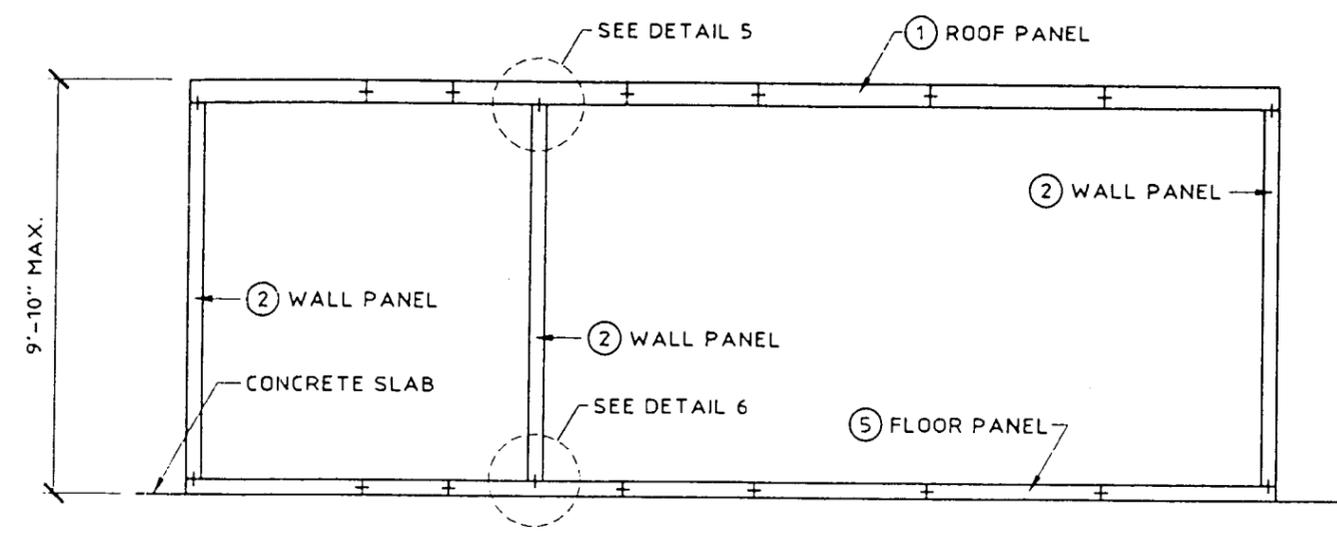

SECTION B (TYP.)
 SCALE: 1/4" = 1'-0"

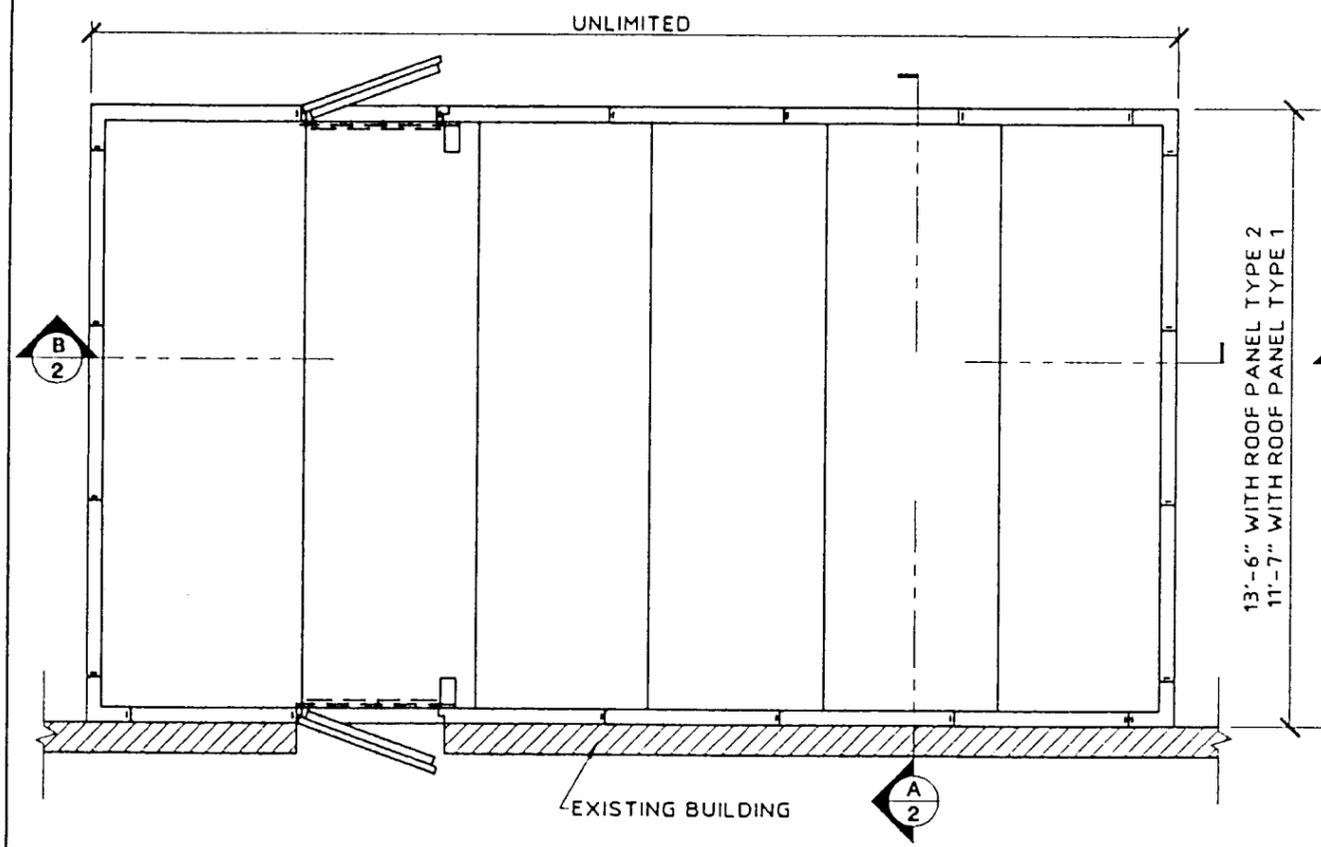

SINGLE COMPARTMENT BUILDING - PLAN
 SCALE: 1/4" = 1'-0"

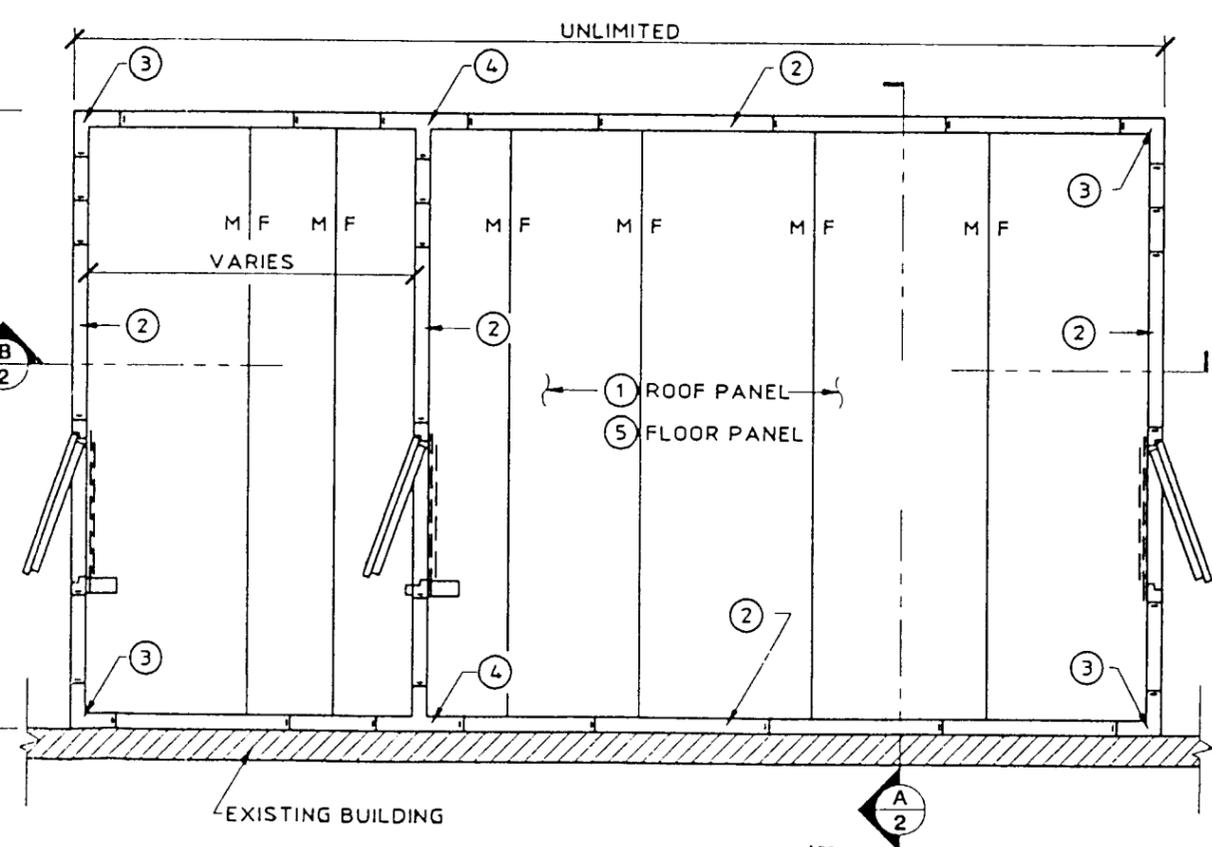

MULTIPLE COMPARTMENT BUILDING - PLAN
 SCALE: 1/4" = 1'-0"

PRODUCT RENEWED
 ACCEPTANCE No. 01-1017-03
 EXPIRATION DATE September 24, 2006
 By [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE September 24, 1998
 BY [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 97-1215-03




KNEZEVICH & ASSOCIATES, INC.
 CONSULTING ENGINEERS - PRODUCT TESTING
 641 MOKENA DRIVE-MIAMI SPRINGS, FLORIDA 33166
 MIAMI (305) 883-9571 FT. LAUDERDALE (954) 677-9500
 FAX: (305) 883-9572
 COPY RIGHT 1997 KNEZEVICH & ASSOCIATES, INC.
 FOR: K.M.T. REFRIGERATION INC.


WALK-IN COOLER/FREEZER
K.M.T. REFRIGERATION INC.
 715 ST. CROSS STREET
 P.O. Box 137
 RIVER FALLS, WI 54022
KOLPAK
 WALK-INS (715) 425-6741

no.	date	description	COUNTY COMMENTS
1	7/31/98	JW	


V.J. KNEZEVICH
 PROFESSIONAL ENGINEER
 FL License No.
 PE 0110483
 JUL 31 1998
 date 12/12/97
 scale AS NOTED
 drawn by GG
 design by ZS
 checked by VJK
 drawing no.
96-260
 sheet 3 of 6

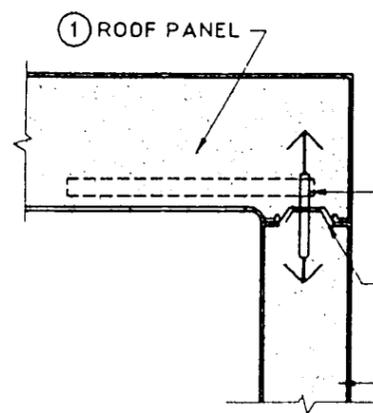

DETAIL 1
 SCALE: 1-1/2" = 1'-0"

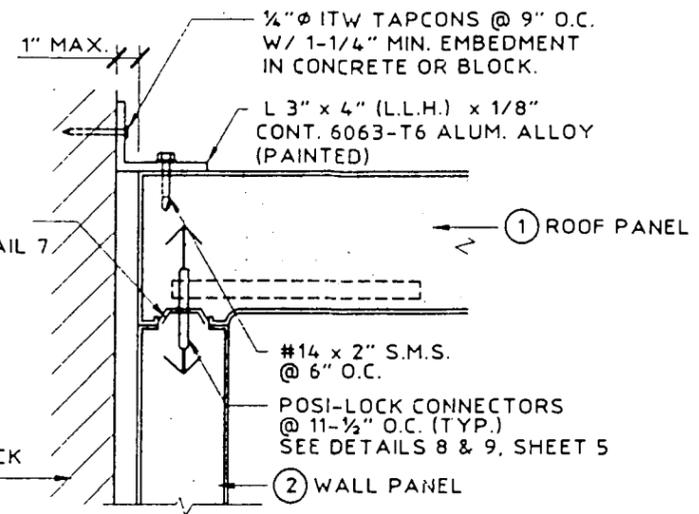


DETAIL 3
 SCALE: 1-1/2" = 1'-0"

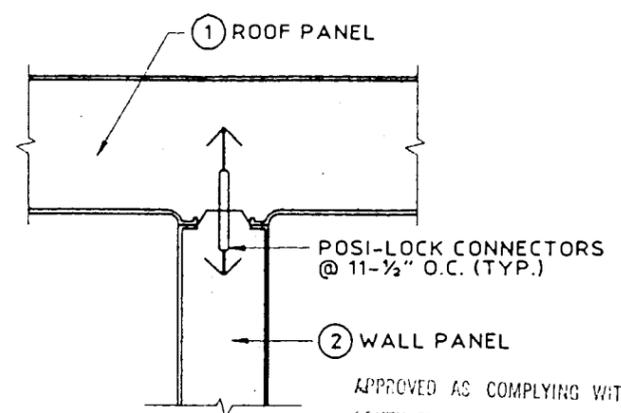


DETAIL 5
 SCALE: 1-1/2" = 1'-0"


APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE September 24, 1998
 BY Helmut A. Mark
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 97-1215.03

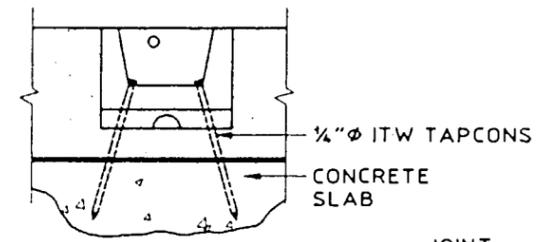


SECTION C
 SCALE: 1-1/2" = 1'-0"

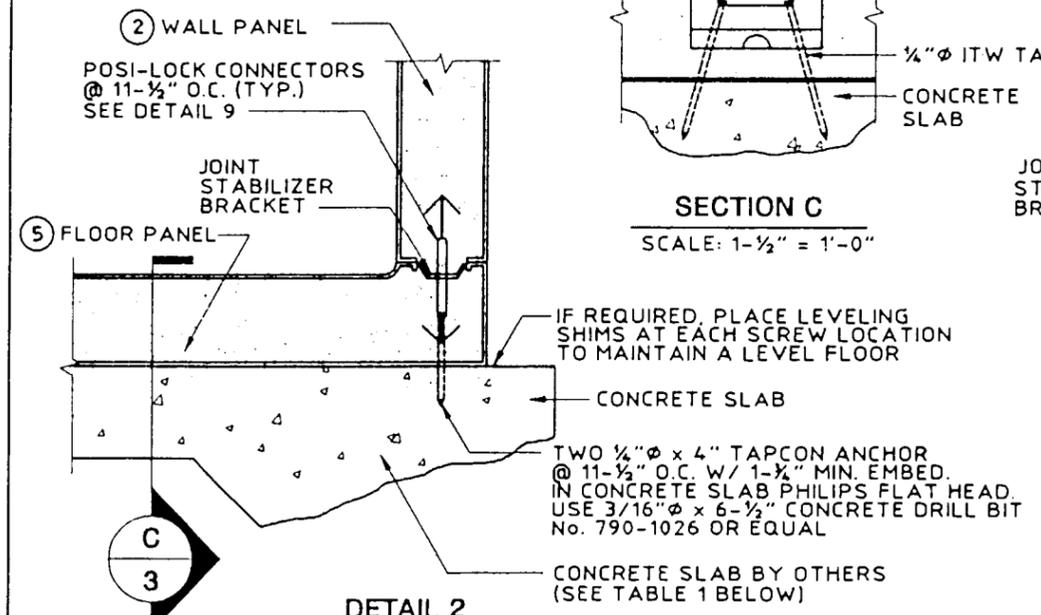


DETAIL 2
 SCALE: 1-1/2" = 1'-0"

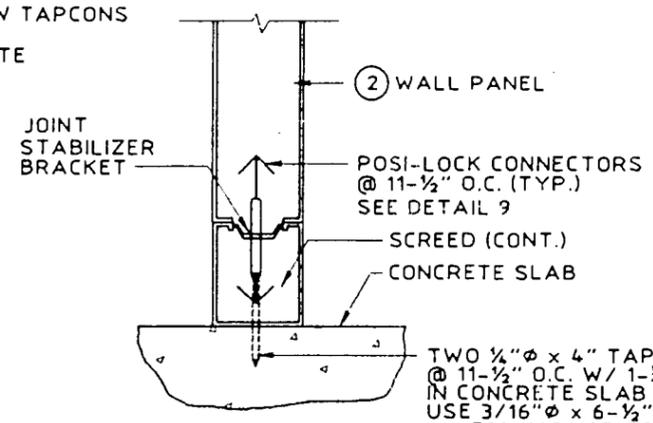

DETAIL 4
 SCALE: 1-1/2" = 1'-0"

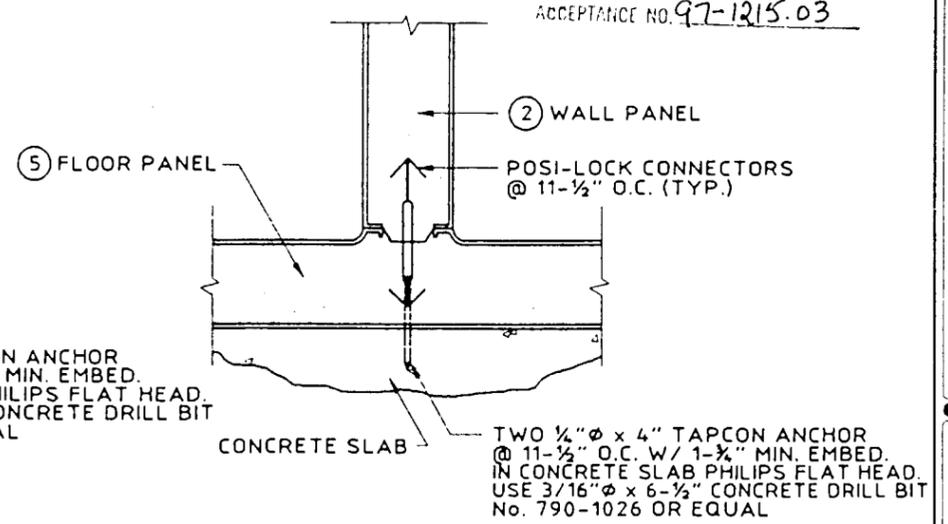

DETAIL 6
 SCALE: 1-1/2" = 1'-0"

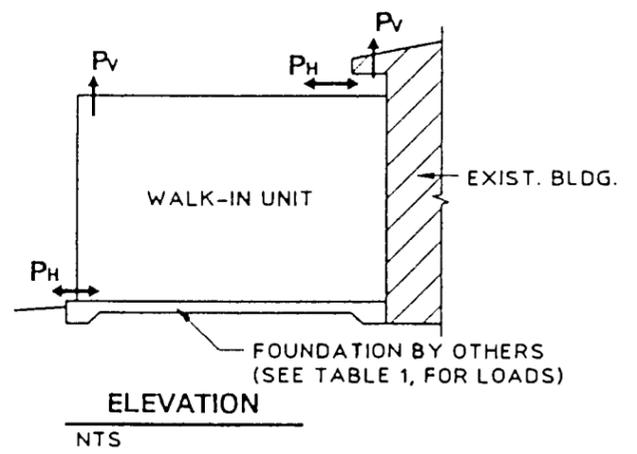

PRODUCT RENEWED
 ACCEPTANCE No. 01-1017.03
 EXPIRATION DATE September 24, 2006
 By [Signature]
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

TABLE 1 FOR FOUNDATION DESIGN	NET WIND UPLIFT (P _v) AND SHEAR (P _h) FORCES WITH TYPE OF ROOF PANEL USED	
	TYPE 1 MAXIMUM SPAN 11'-7"	TYPE 2 MAXIMUM SPAN 13'-6"
P _v	-186 # / FT	-217 # / FT
P _h	± 242 # / FT	± 242 # / FT




KNEZEVICH & ASSOCIATES, INC.
 CONSULTING ENGINEERS - PRODUCT TESTING
 641 MOKENA DRIVE-MIAMI SPRINGS, FLORIDA 33166
 MIAMI (305) 883-9571 FT. LAUDERDALE (954) 677-9500
 FAX: (305) 883-9572
 COPYRIGHT 1997 KNEZEVICH & ASSOCIATES, INC.
 FOR: K.M.T. REFRIGERATION INC.

WALK-IN COOLER/FREEZER
K.M.T. REFRIGERATION INC.
 715 ST. CROIX STREET
 P.O. Box 137
 RIVER FALLS, WI 54022
 (715) 425-6741
KOLPAK
 WALK-INS

no.	date	by	description	COUNTY COMMENTS
1	7/31/98	JW		


V.J. KNEZEVICH
 PROFESSIONAL ENGINEER
 FL License No
 PE 0010213
 Date: Jul 31 1998
 Date: 12/12/97
 Scale: AS NOTED
 AS NOTED
 design by: ZS
 checked by: VJK
 drawing no: **96-260**
 sheet 4 of 6

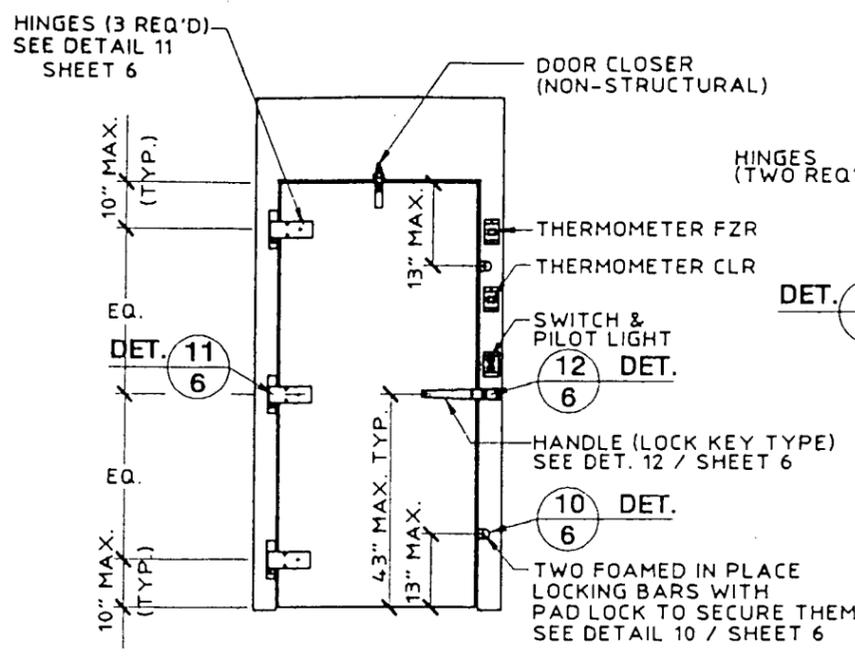

(ELEVATION)

ENTRANCE DOOR


N.T.S.
 57.5" x 9'-0" MAX DS 36" x 78" DR
 TYPE 1 OR 2

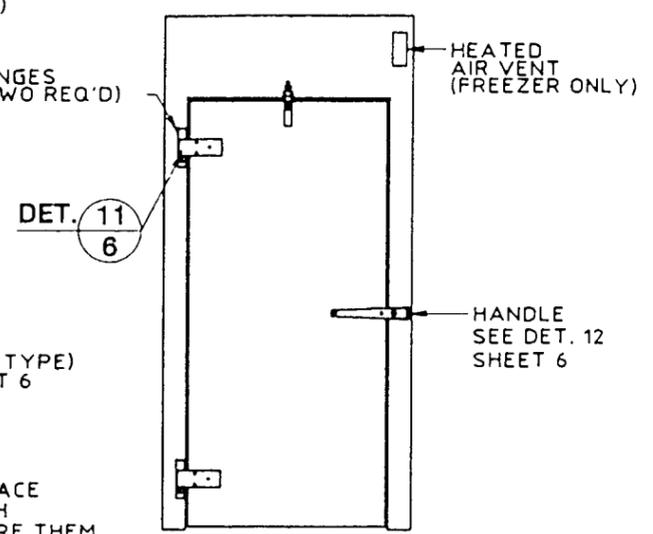

(ELEVATION)


PARTITION DOOR (INTERIOR)

N.T.S.
 46" x 9'-0" MAX DS 36" x 78" DR
 TYPE 1 OR 2

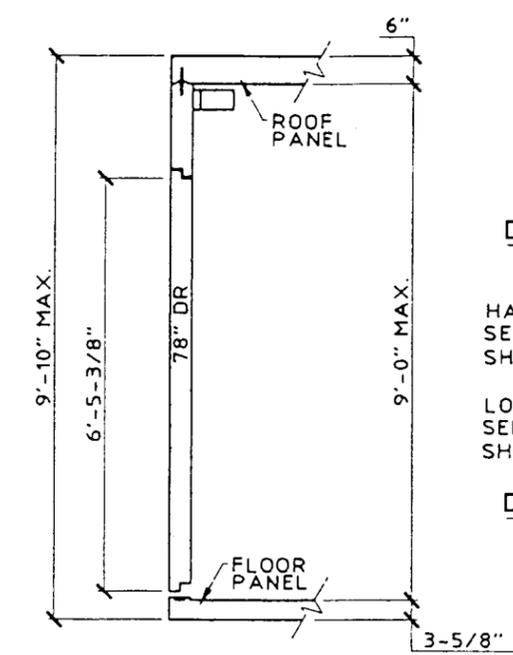

SECTION THROUGH ENTRANCE OR PARTITION DOOR


N.T.S.

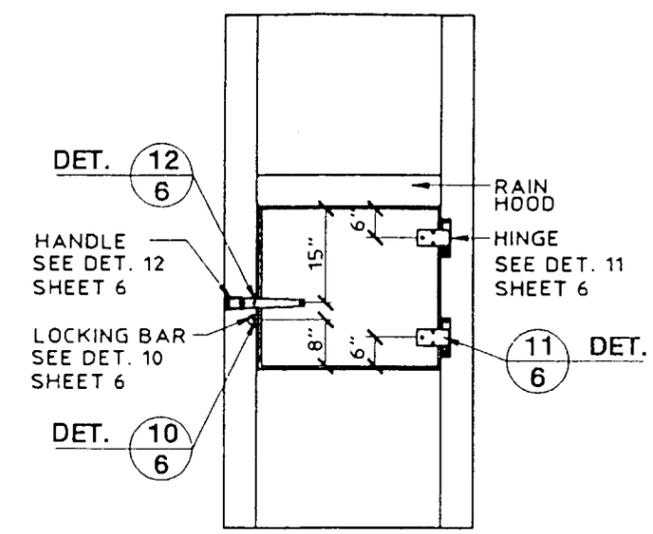

(ELEVATION)


REACH-IN DOOR

N.T.S.
 46" x 9'-0" MAX R/IN 30" x 30" DR
 TYPE 1 OR 2

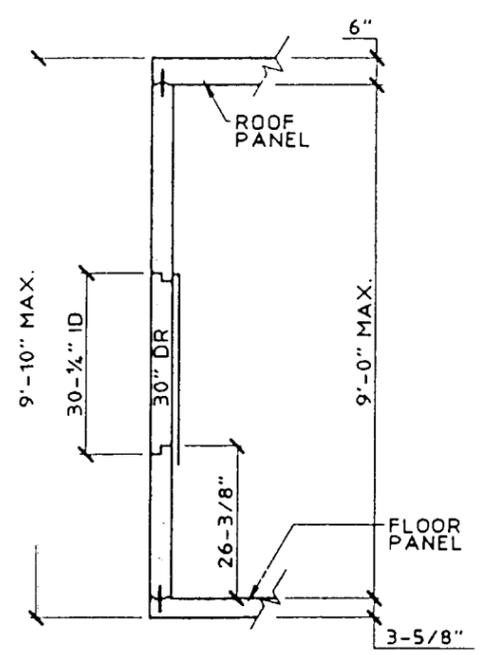


SECTION THROUGH REACH-IN DOOR

N.T.S.

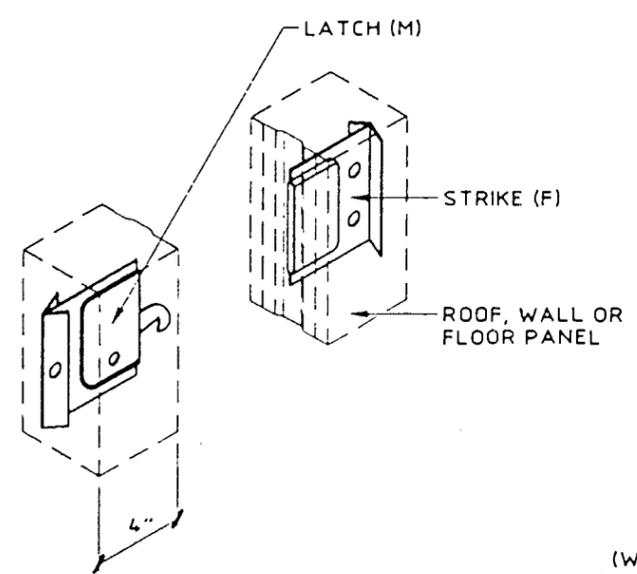


LOCKING DEVICE (POSI-LOCK)

SCALE: 1-1/2" = 1'-0"
 (SEE DETAILS ON SHEET 3 & 5)

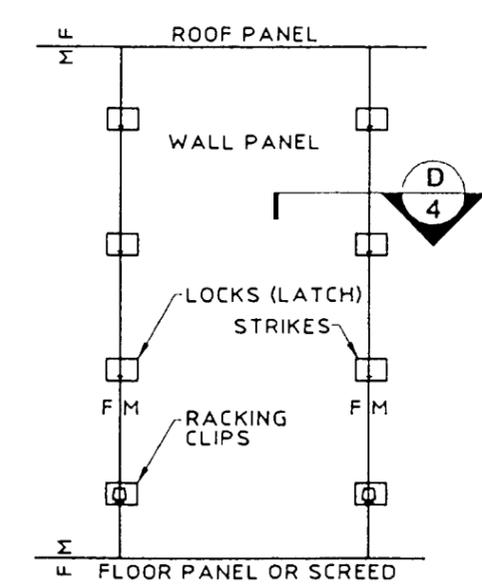

RACKING CLIP DETAIL


N.T.S.

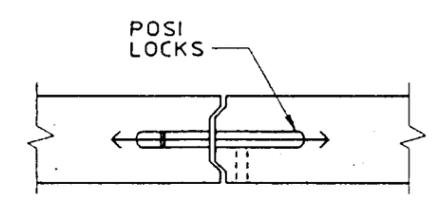

SECTION D

N.T.S.

APPROVED AS COMPLYING WITH THE
 FLORIDA BUILDING CODE
 (WALL PANEL ELEVATION, POSI-LOCKS @ 3'-0" O.C. AS TESTED
 (ROOF PANEL PLAN SIMILAR, POSI-LOCKS @ 3'-0" O.C. AS TESTED)
 DATE: September 24, 1998
 BY: Heung A. Mak
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO 97-1215.03




KNEZEVICH & ASSOCIATES, INC.
 CONSULTING ENGINEERS - PRODUCT TESTING
 641 MOKENA DRIVE-MIAMI SPRINGS, FLORIDA 33166
 MIAMI (305) 883-9571 FT. LAUDERDALE (954) 677-9500
 FAX: (305) 883-9572
 COPYRIGHT 1997 KNEZEVICH & ASSOCIATES, INC.
 FOR: K.M.T. REFRIGERATION INC.



WALK-IN COOLER/FREEZER
K.M.T. REFRIGERATION INC.
 715 ST. CROIX STREET
 P.O. Box 137
 RIVER FALLS, WI 54022
KOLPAK
 WALK-INS

REV	DATE	DESCRIPTION	COUNTY COMMENTS
1	7/31/98	JW	

V.J. KNEZEVICH
 PROFESSIONAL ENGINEER
 FL License No
 PE 0070983
 JUL 31 1998
 date 12/12/97
 scale AS NOTED
 drawn by GG
 design by ZS
 checked by VJK
 drawing no
96-260
 sheet 5 of 6

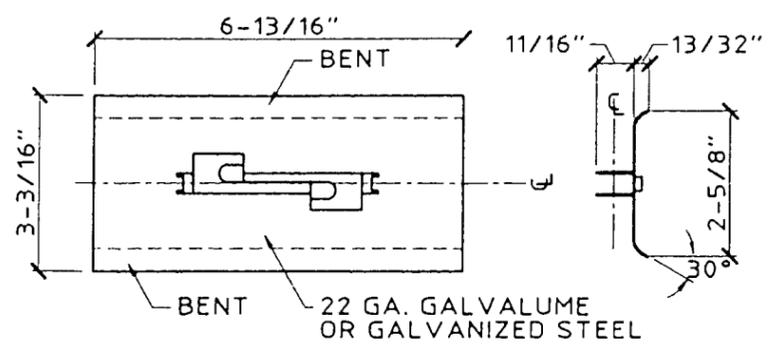


DETAIL 7 - JOINT STABILIZER BRACKET
 N.T.S.

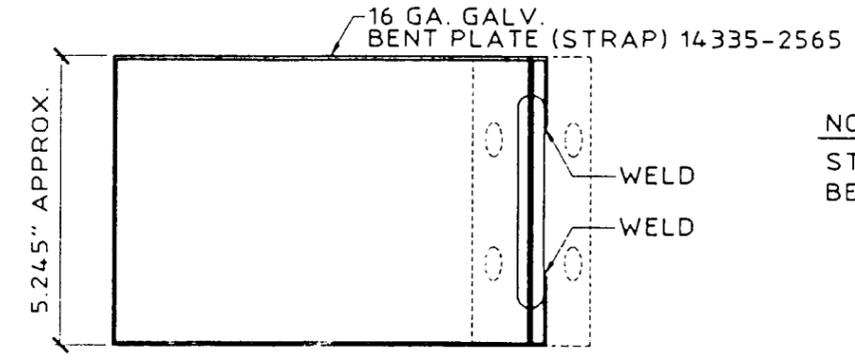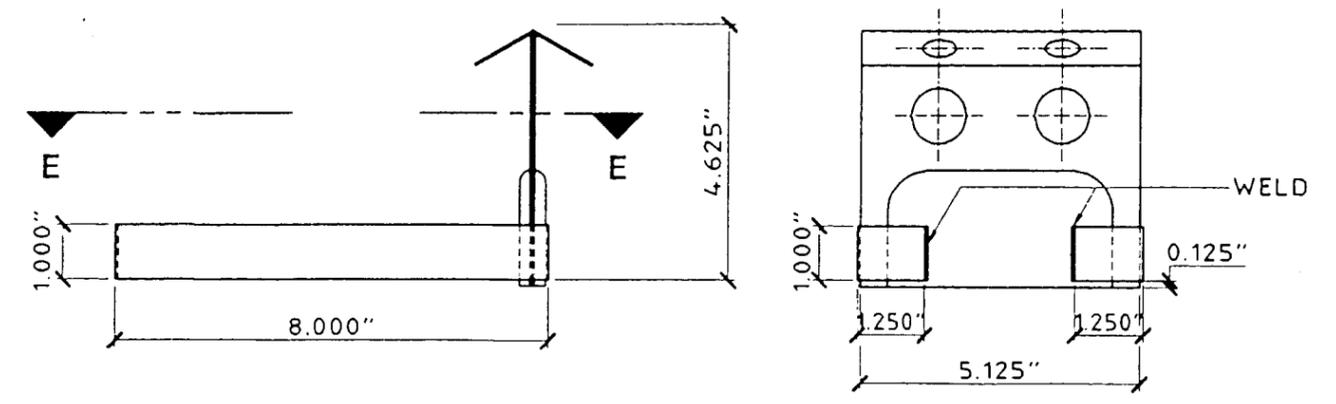


SECTION E-E - PLAN

NOTE:
 STRAP AND STRIKE MUST
 BE SPRAYED WITH ADHESIVE

DETAIL 8 - STRIKE (F) WITH STRAP
 N.T.S.

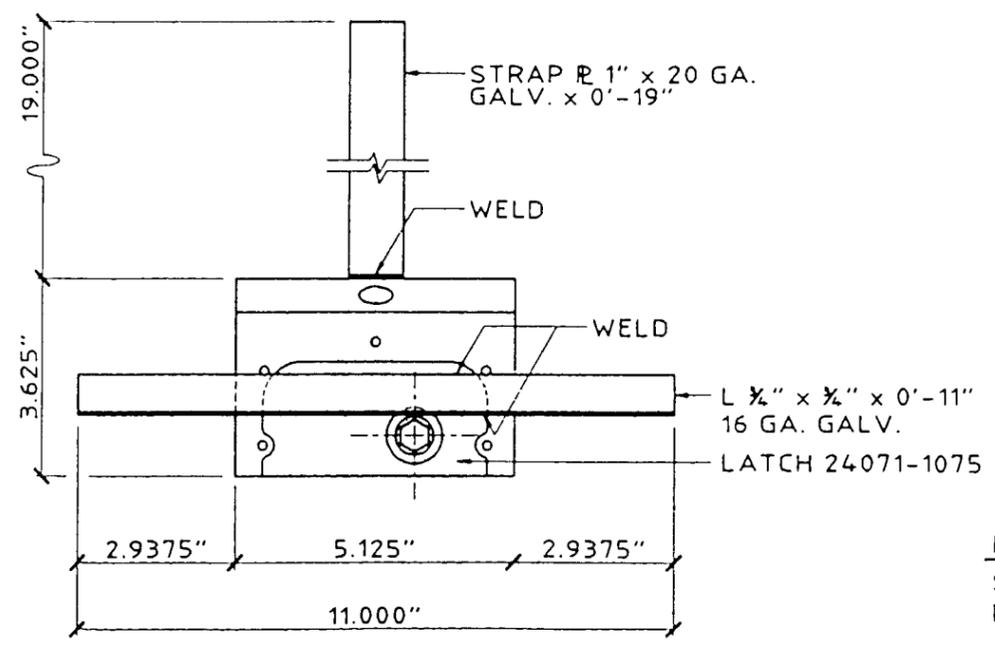

DETAIL 9 - LATCH (M) WITH STRAP
 N.T.S.

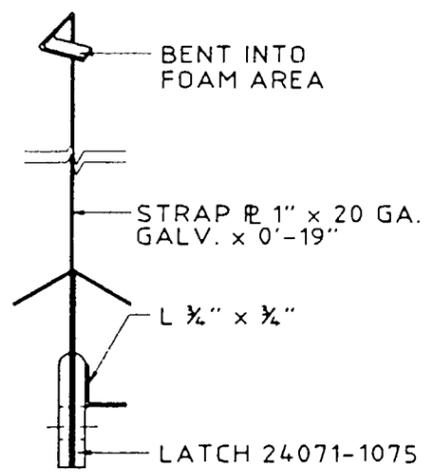

NOTE:
 STRAP AND LATCH MUST
 BE SPRAYED WITH ADHESIVE

PRODUCT RENEWED

ACCEPTANCE No. 01-107.03

EXPIRATION DATE September 28, 2006

By *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE

DATE September 24, 1998

By *[Signature]*
 PRODUCT CONTROL DIVISION

BUILDING CODE COMPLIANCE OFFICE


ACCEPTANCE No. 97-1215-03




KNEZEVICH & ASSOCIATES, INC.
 CONSULTING ENGINEERS - PRODUCT TESTING
 641 MOKENA DRIVE-MIAMI SPRINGS, FLORIDA 33166
 MIAMI (305) 883-9571 FT. LAUDERDALE (954) 677-9500
 FAX: (305) 883-9572
 COPYRIGHT 1997 KNEZEVICH & ASSOCIATES, INC.
 FOR: K.M.T. REFRIGERATION INC.

WALK-IN COOLER/FREEZER
K.M.T. REFRIGERATION INC.
 715 ST. CROIX STREET
 P.O. Box 137
 RIVER FALLS, WI 54022
KOLPAK
 WALK-INS (715) 425-6741


1. ALL DIMENSIONS ARE IN INCHES.
2. CORNERS AND FILLETS ARE 0.015 R OR AS NOTED.
3. ALL THICKNESSES TO BE 0.125 OR AS NOTED.
4. REFER TO MANUFACTURER'S DRAWINGS FOR HANDLE MECHANISM.
5. MATERIAL USED IS TO BE 6061-T6 ALUMINUM ALLOY EXCEPT FOR ITEMS 9 & 10 WHERE FIBERGLASS PULTRUSION IS TO BE USED.

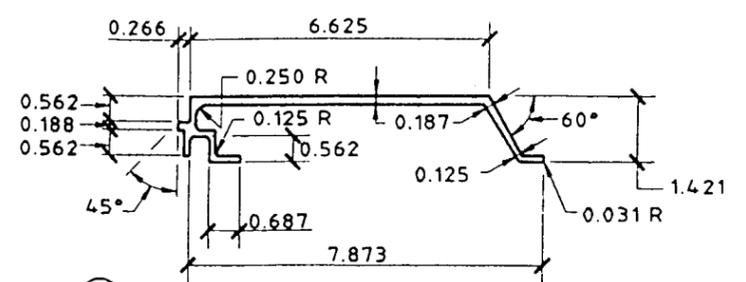


6 EMBEDDED PLATE FOR HINGE & LOCKING BAR
 SCALE: 3" = 1'-0"

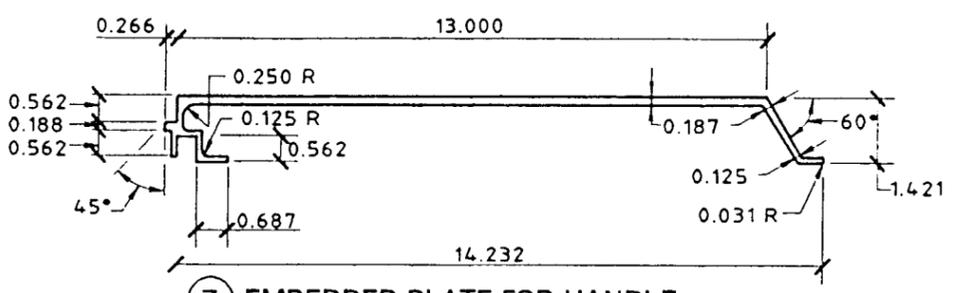


7 EMBEDDED PLATE FOR HANDLE
 SCALE: 3" = 1'-0"

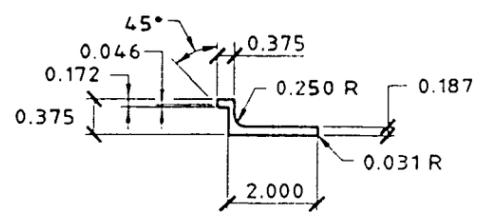


8 WALL PANEL TAPPING PLATE
 SCALE: 3" = 1'-0"

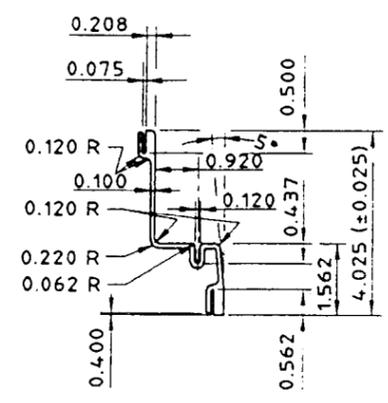


9 DOOR PANEL CLOSURE SEALER
 SCALE: 3" = 1'-0"

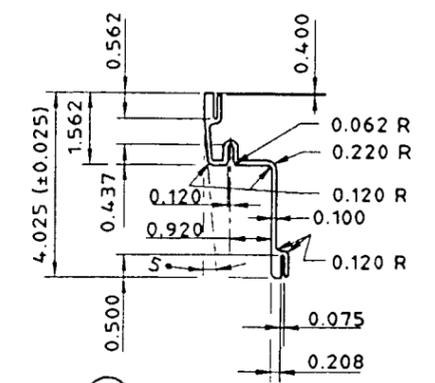


10 WALL PANEL CLOSURE SEALER
 SCALE: 3" = 1'-0"

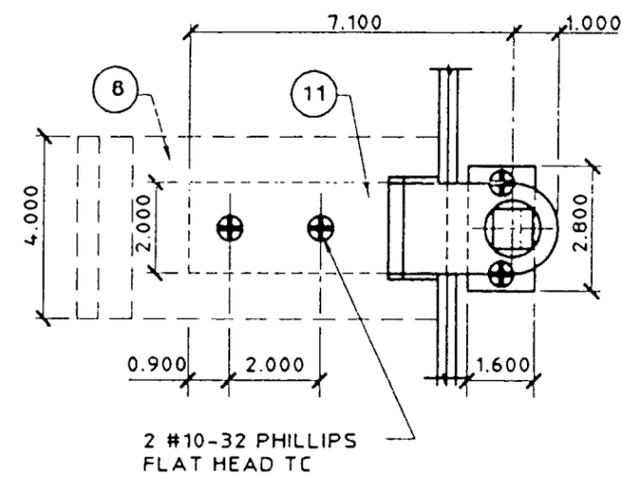


ELEVATION
 SCALE: 3" = 1'-0"

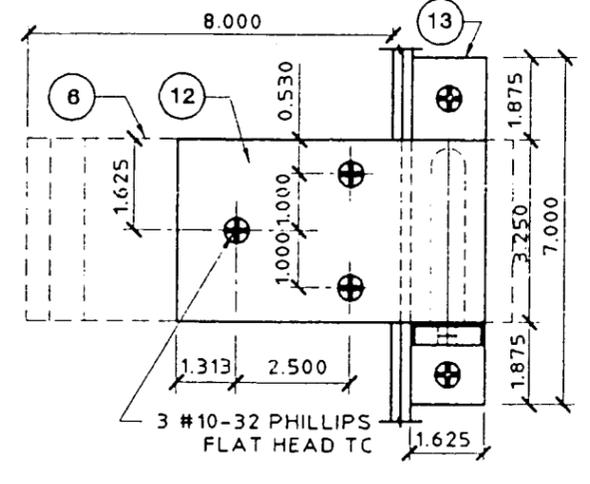


ELEVATION
 SCALE: 3" = 1'-0"

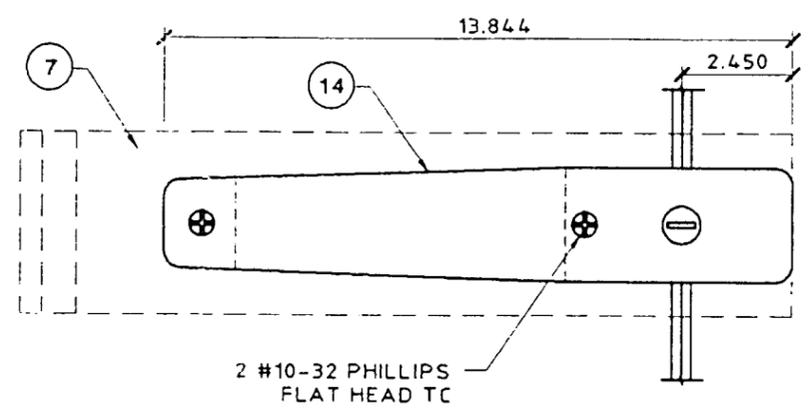


ELEVATION
 SCALE: 3" = 1'-0"

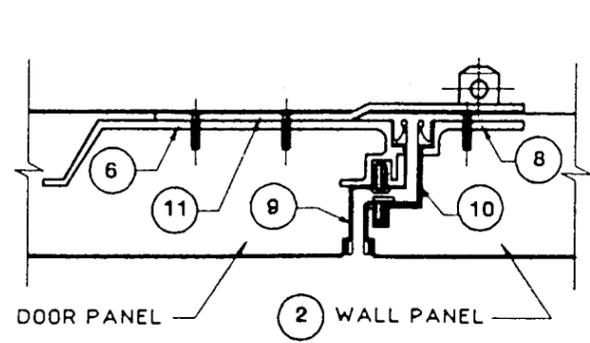

DETAIL 10
 LOCK BAR ASSEMBLY
 SCALE: 3" = 1'-0"

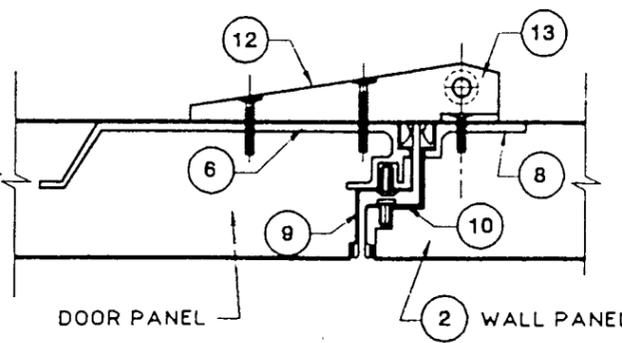

DETAIL 11
 HINGE ASSEMBLY
 SCALE: 3" = 1'-0"

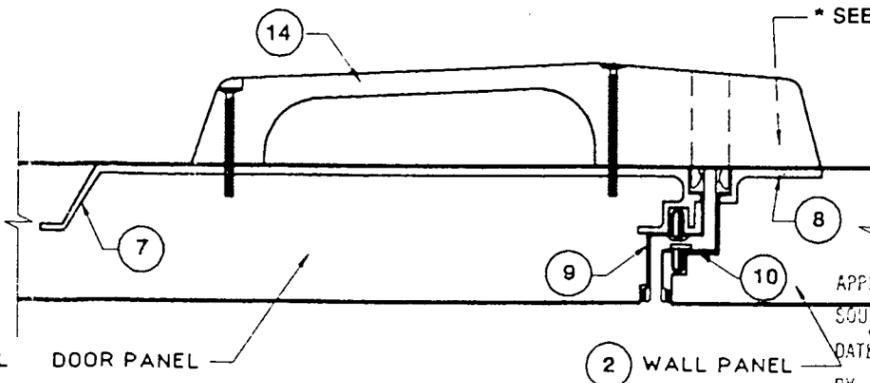

DETAIL 12
 HANDLE ASSEMBLY
 SCALE: 3" = 1'-0"

* SEE NOTE 4.

PRODUCT RENEWED
 ACCEPTANCE No. 014017.03
 EXPIRATION DATE September 24, 1998
 By *[Signature]* J. KNEZEVICH, PROFESSIONAL ENGINEER
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 APPROVED AS COMPLYING WITH THE
 SOUTH FLORIDA BUILDING CODE
 DATE September 24, 1998
 BY *[Signature]*
 PRODUCT CONTROL DIVISION
 BUILDING CODE COMPLIANCE OFFICE
 ACCEPTANCE NO. 97-1215-03

NO.	DATE	DESCRIPTION	COUNTY COMMENTS
1	7/23/98	JW	

FL License No. PE 000993
 JUL 31 1998
 date 07/20/98
 scale AS NOTED
 design by ZS
 checked by VJK
 drawing no 96-260
 sheet 6 of 6