



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Curries Division of ASSA Abloy Door Group, LLC**  
**525 9th Street SE**  
**Mason City ,IA 50401**

Your application for Notice of Acceptance (NOA) of:

**Series 707F 18ga Flush Outswing Commercial Steel Door-Impact Resistant**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez  
Chief Product Control Division

**ACCEPTANCE NO.: 01-1102.02**  
**EXPIRES: 01/31/2007**

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL  
CONDITIONS  
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.


Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 12/06/2001**

**NOTICE OF ACCEPTANCE: STANDARD CONDITIONS**

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process.
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

**END OF THIS ACCEPTANCE**

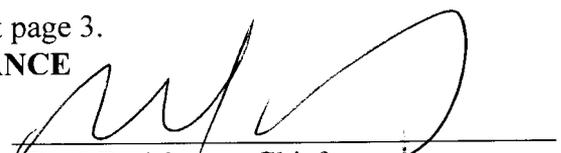  
\_\_\_\_\_  
Raul Rodriguez, Chief  
Product Control Division

**NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS**

**1. SCOPE**

1.1 This **renews** Notice of Acceptance (NOA) No. **99-0507.02**, which was issued on June 10, 1999. It renews the approval of a commercial steel door, as described in Section 2 of this NOA, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

**2. PRODUCT DESCRIPTION**

2.1 The **Series "707F-18ga" Flush Outswing Commercial Steel Door - Impact Resistant** and its components shall be constructed in strict compliance with the following document: Drawing No **95-0809.03**, Sheets 1 through 11 of 11, titled "Curries Series 707 F-18 GA. Flush Commercial Steel Door with Sargent 6500 Series Lock," prepared by manufacturer, dated 3/23/99 and revised on 3/24/99, bearing the Miami-Dade County Product Control renewal stamp with the NOA number and expiration date by the Miami-Dade County Product Control Division. This document shall hereinafter be referred to as the approved drawings.

**3. LIMITATIONS**

3.1 This approval applies to single unit applications of single door only, as shown in approved drawing.  
3.2 Unit shall be installed only at locations protected by a canopy or overhang such that the angle between the edge of canopy or overhang to sill is less than 45 degrees. Unless unit is installed in non-habitable areas where the unit and the area are designed to accept water infiltration.

**4. INSTALLATION**


4.1 The commercial steel door and its components shall be installed in strict compliance with the approved drawings.  
4.2 Hurricane protection system (shutters): the installation of this unit **will not require** a hurricane protection system.


**5. LABELING**

5.1 Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".

**6. BUILDING PERMIT REQUIREMENTS**

6.1 Application for building permit shall be accompanied by copies of the following:  
6.1.1 This Notice of Acceptance  
6.1.2 Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.  
6.1.3 Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

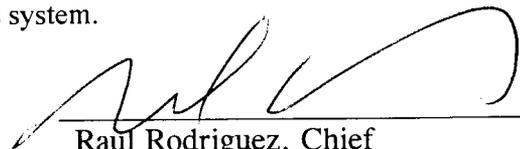  
\_\_\_\_\_  
Raul Rodriguez, Chief  
Product Control Division

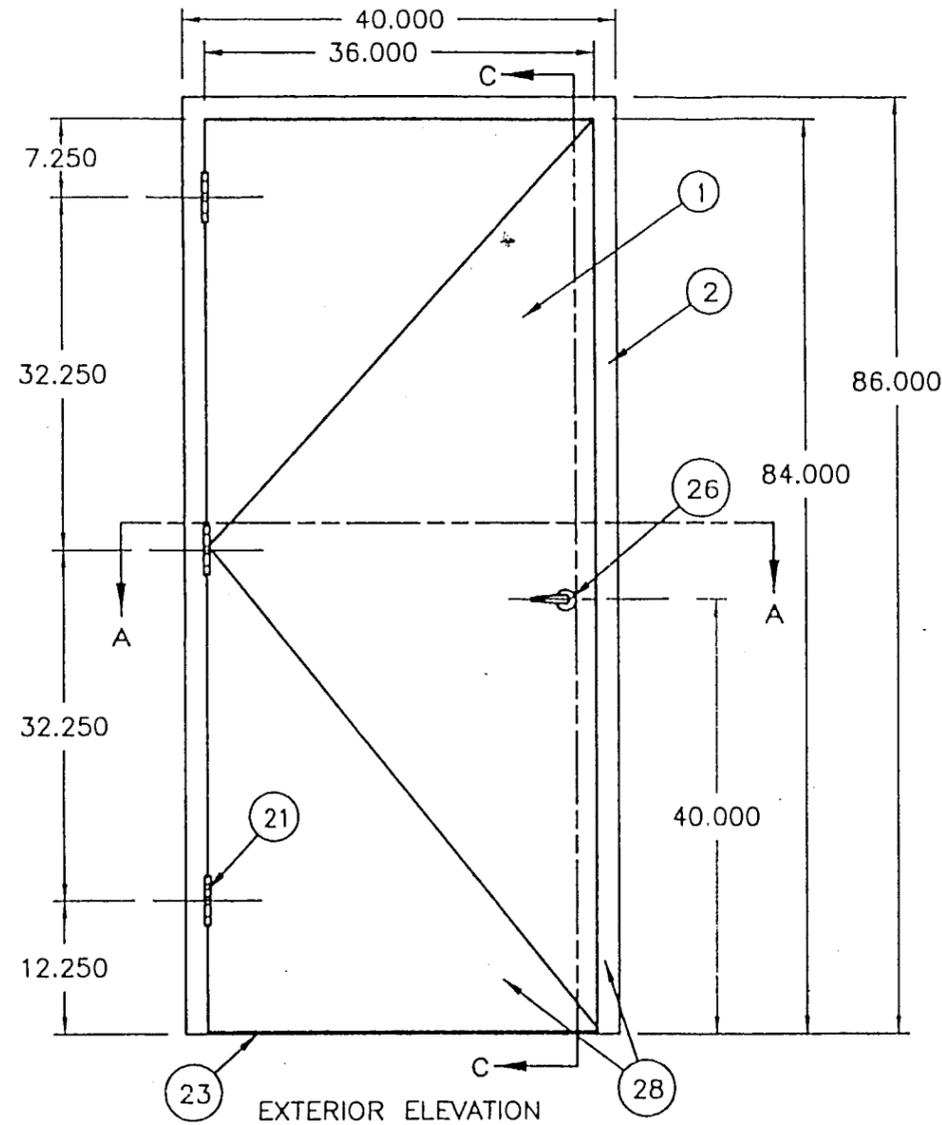

DESIGN PRESSURE RATING  
SARGENT 6500 CYLINDRICAL LOCK

	WHERE WATER INFILTRATION REQUIREMENT IS REQUIRED	WHERE WATER INFILTRATION REQUIREMENT IS NOT REQUIRED
POSITIVE	NOT APPROVED	+85
NEGATIVE	NOT APPROVED	-85

NOTE: FOR ANCHOR LOCATIONS, SEE INTERIOR ELEVATIONS

**PRODUCT RENEWED**


ACCEPTANCE No. 01-1102.02

EXPIRATION DATE January 31, 2007

By [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE

REV	DATE	DESCRIPTION	JAA	DR	CK	SC
1	24-MAR-99	REVISED FOR RENEWAL	JAA			
DR: J AVERY		<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA	APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE <u>June 10</u> 19 <u>99</u> BY <u>Isaac I. Chanda</u> PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. <u>99-0507.02</u>			
CK:						
SCAN:						
TOLERANCE: UNLESS OTHERWISE SPECIFIED						
DEC ± .031						
ANG ± .5°						
FRAC ± 1/32						
SH SZ: B		SH. NO. 1 OF 11	DWG. NO.			
SCALE: 1:16		DATE: 23-MAR-99	95-0809-03			

99-0507.02

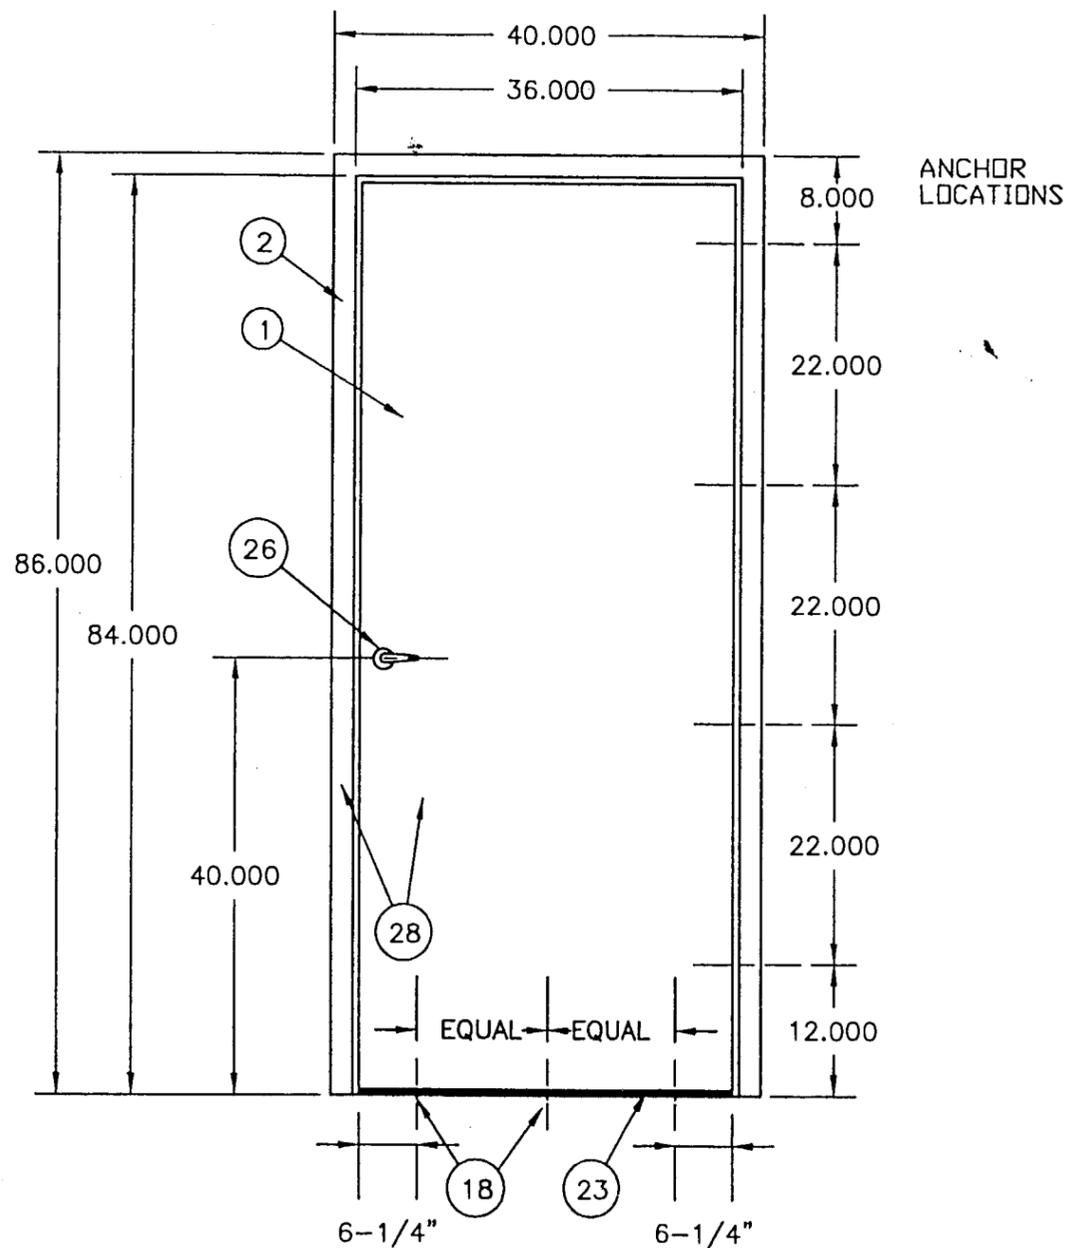

INTERIOR ELEVATION

**PRODUCT RENEWED**


ACCEPTANCE No. 01-1102.02

EXPIRATION DATE January 31, 2007

By [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE

1	24-MAR-99	REVISED FOR RENEWAL	JAA		
REV	DATE	DESCRIPTION	DR	CK	SC
DR: J AVERY		<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA			
CK:					
SCAN:		TITLE:			
TOLERANCE: UNLESS OTHERWISE SPECIFIED		CURRIES SERIES 707 F			
DEC± .031		18 GA FLUSH COMMERCIAL DOOR			
ANG± .5°		WITH SARGENT 6500 SERIES LOCK			
FRAC± 1/32		INTERIOR ELEVATIONS			
SH SZ: B	SH.NO. 2 OF 11	DWG.NO.			
SCALE: 1:16	DATE: 23-MAR-99	95-0809-03			


APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE June 10 1999  
 BY Iskag I. Chanda  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 99-0507.02

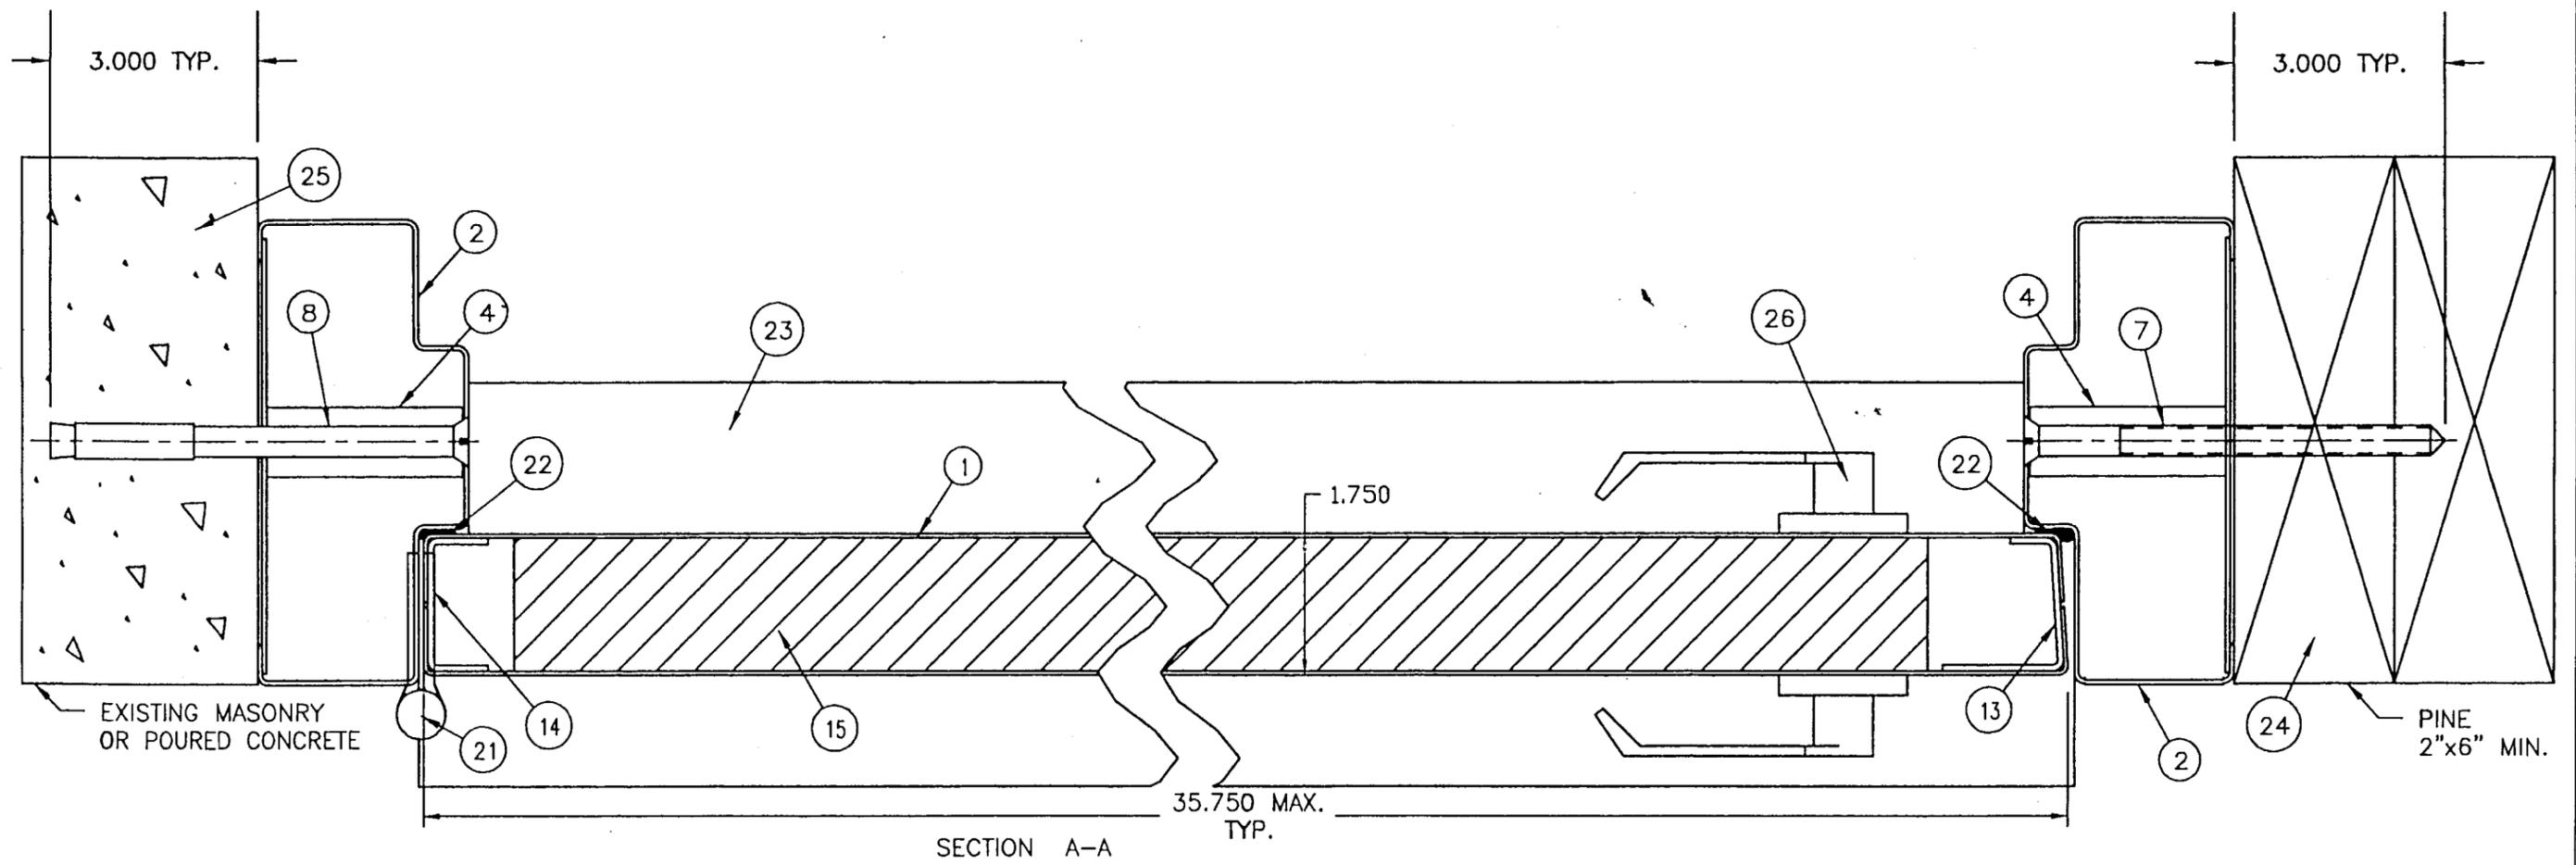

**PRODUCT RENEWED**  
 ACCEPTANCE No. 01-1102.02  
 EXPIRATION DATE January 31, 2007  
 By [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE

REV	DATE	DESCRIPTION	JAA	DR	CK	SC
1	24-MAR-99	REVISED FOR RENEWAL	JAA			
DR:	J AVERY	<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA TITLE: CURRIES SERIES 707 F 18 GA. FLUSH COMMERCIAL DOOR WITH SARGENT 6500 SERIES LOCK HORIZONTAL CROSS SECTION				
CK:						
SCAN:						
TOLERANCE: UNLESS OTHERWISE SPECIFIED						
DEC±	.031					
ANG±	.5°					
FRAC±	1/32					
SH SZ:	B	SH.NO. 3 OF 11	DWG.NO.			
SCALE:	1:2	DATE: 23-MAR-99	95-0809-03			

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE June 10 1999  
 BY Isaac I. Chanda  
 PRODUCT CONTROL DIV'S ON  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 99-050702

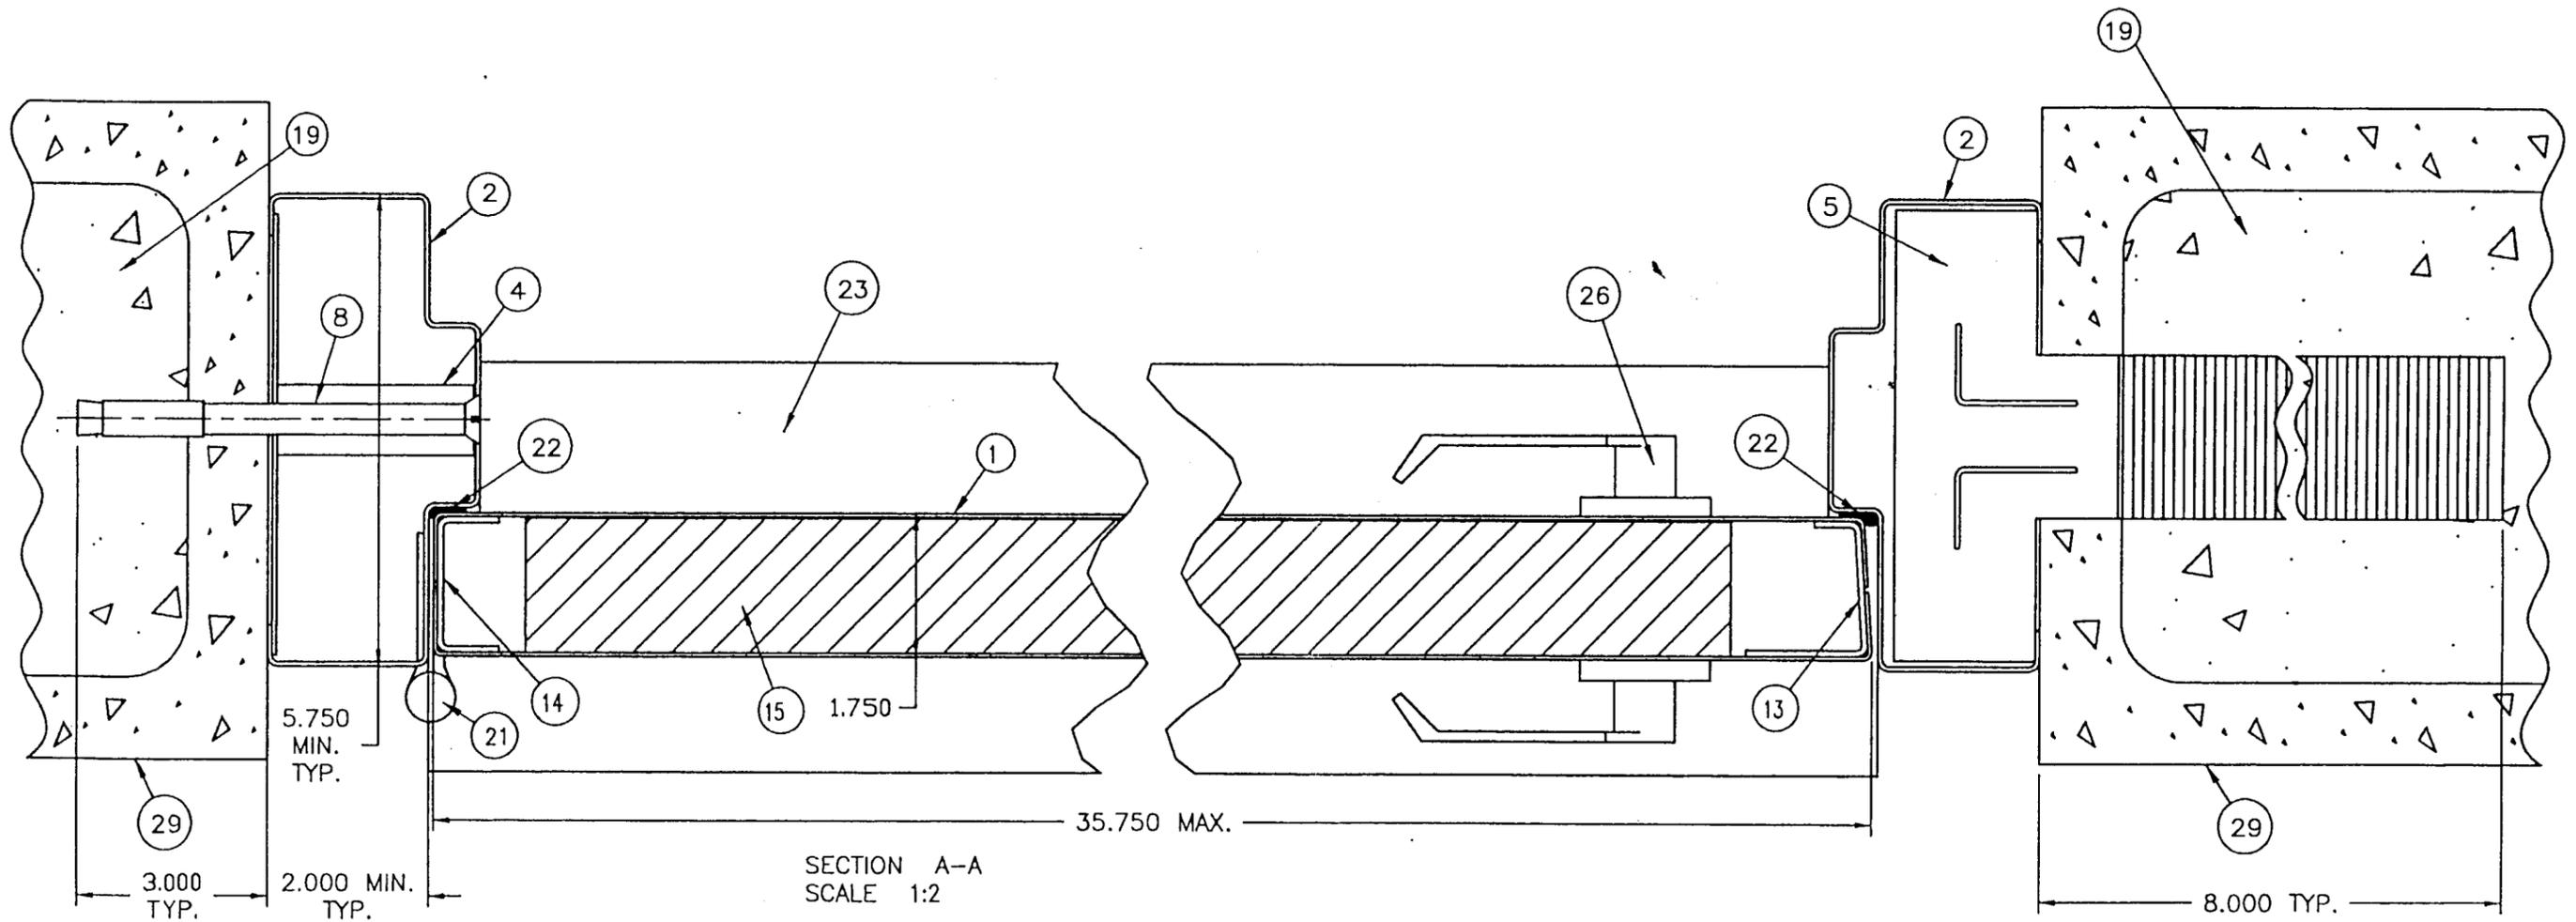


SECTION A-A  
SCALE 1:2

**PRODUCT RENEWED**

ACCEPTANCE No. 01-1102.02  
 EXPIRATION DATE January 31, 2007  
 By [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE

REV	DATE	DESCRIPTION	JAA	DR	CK	SC
1	24-MAR-99	REVISED FOR RENEWAL	JAA			
DR: J AVERY		<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA TITLE: CURRIES 707 F 18 GA FLUSH COMMERCIAL DOOR WITH SARGENT 6500 SERIES LOCK HORIZONTAL CROSS SECTION				
CK:						
SCAN:						
TOLERANCE: UNLESS OTHERWISE SPECIFIED						
DEC ± .031						
ANG ± .5°						
FRAC ± 1/32						
SH SZ: B		SH. NO. 4 OF 11	DWG. NO.			
SCALE: 1:16		DATE: 24-MAR-99	95-0809-03			

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE June 10 1999  
 BY [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 99-0507.02

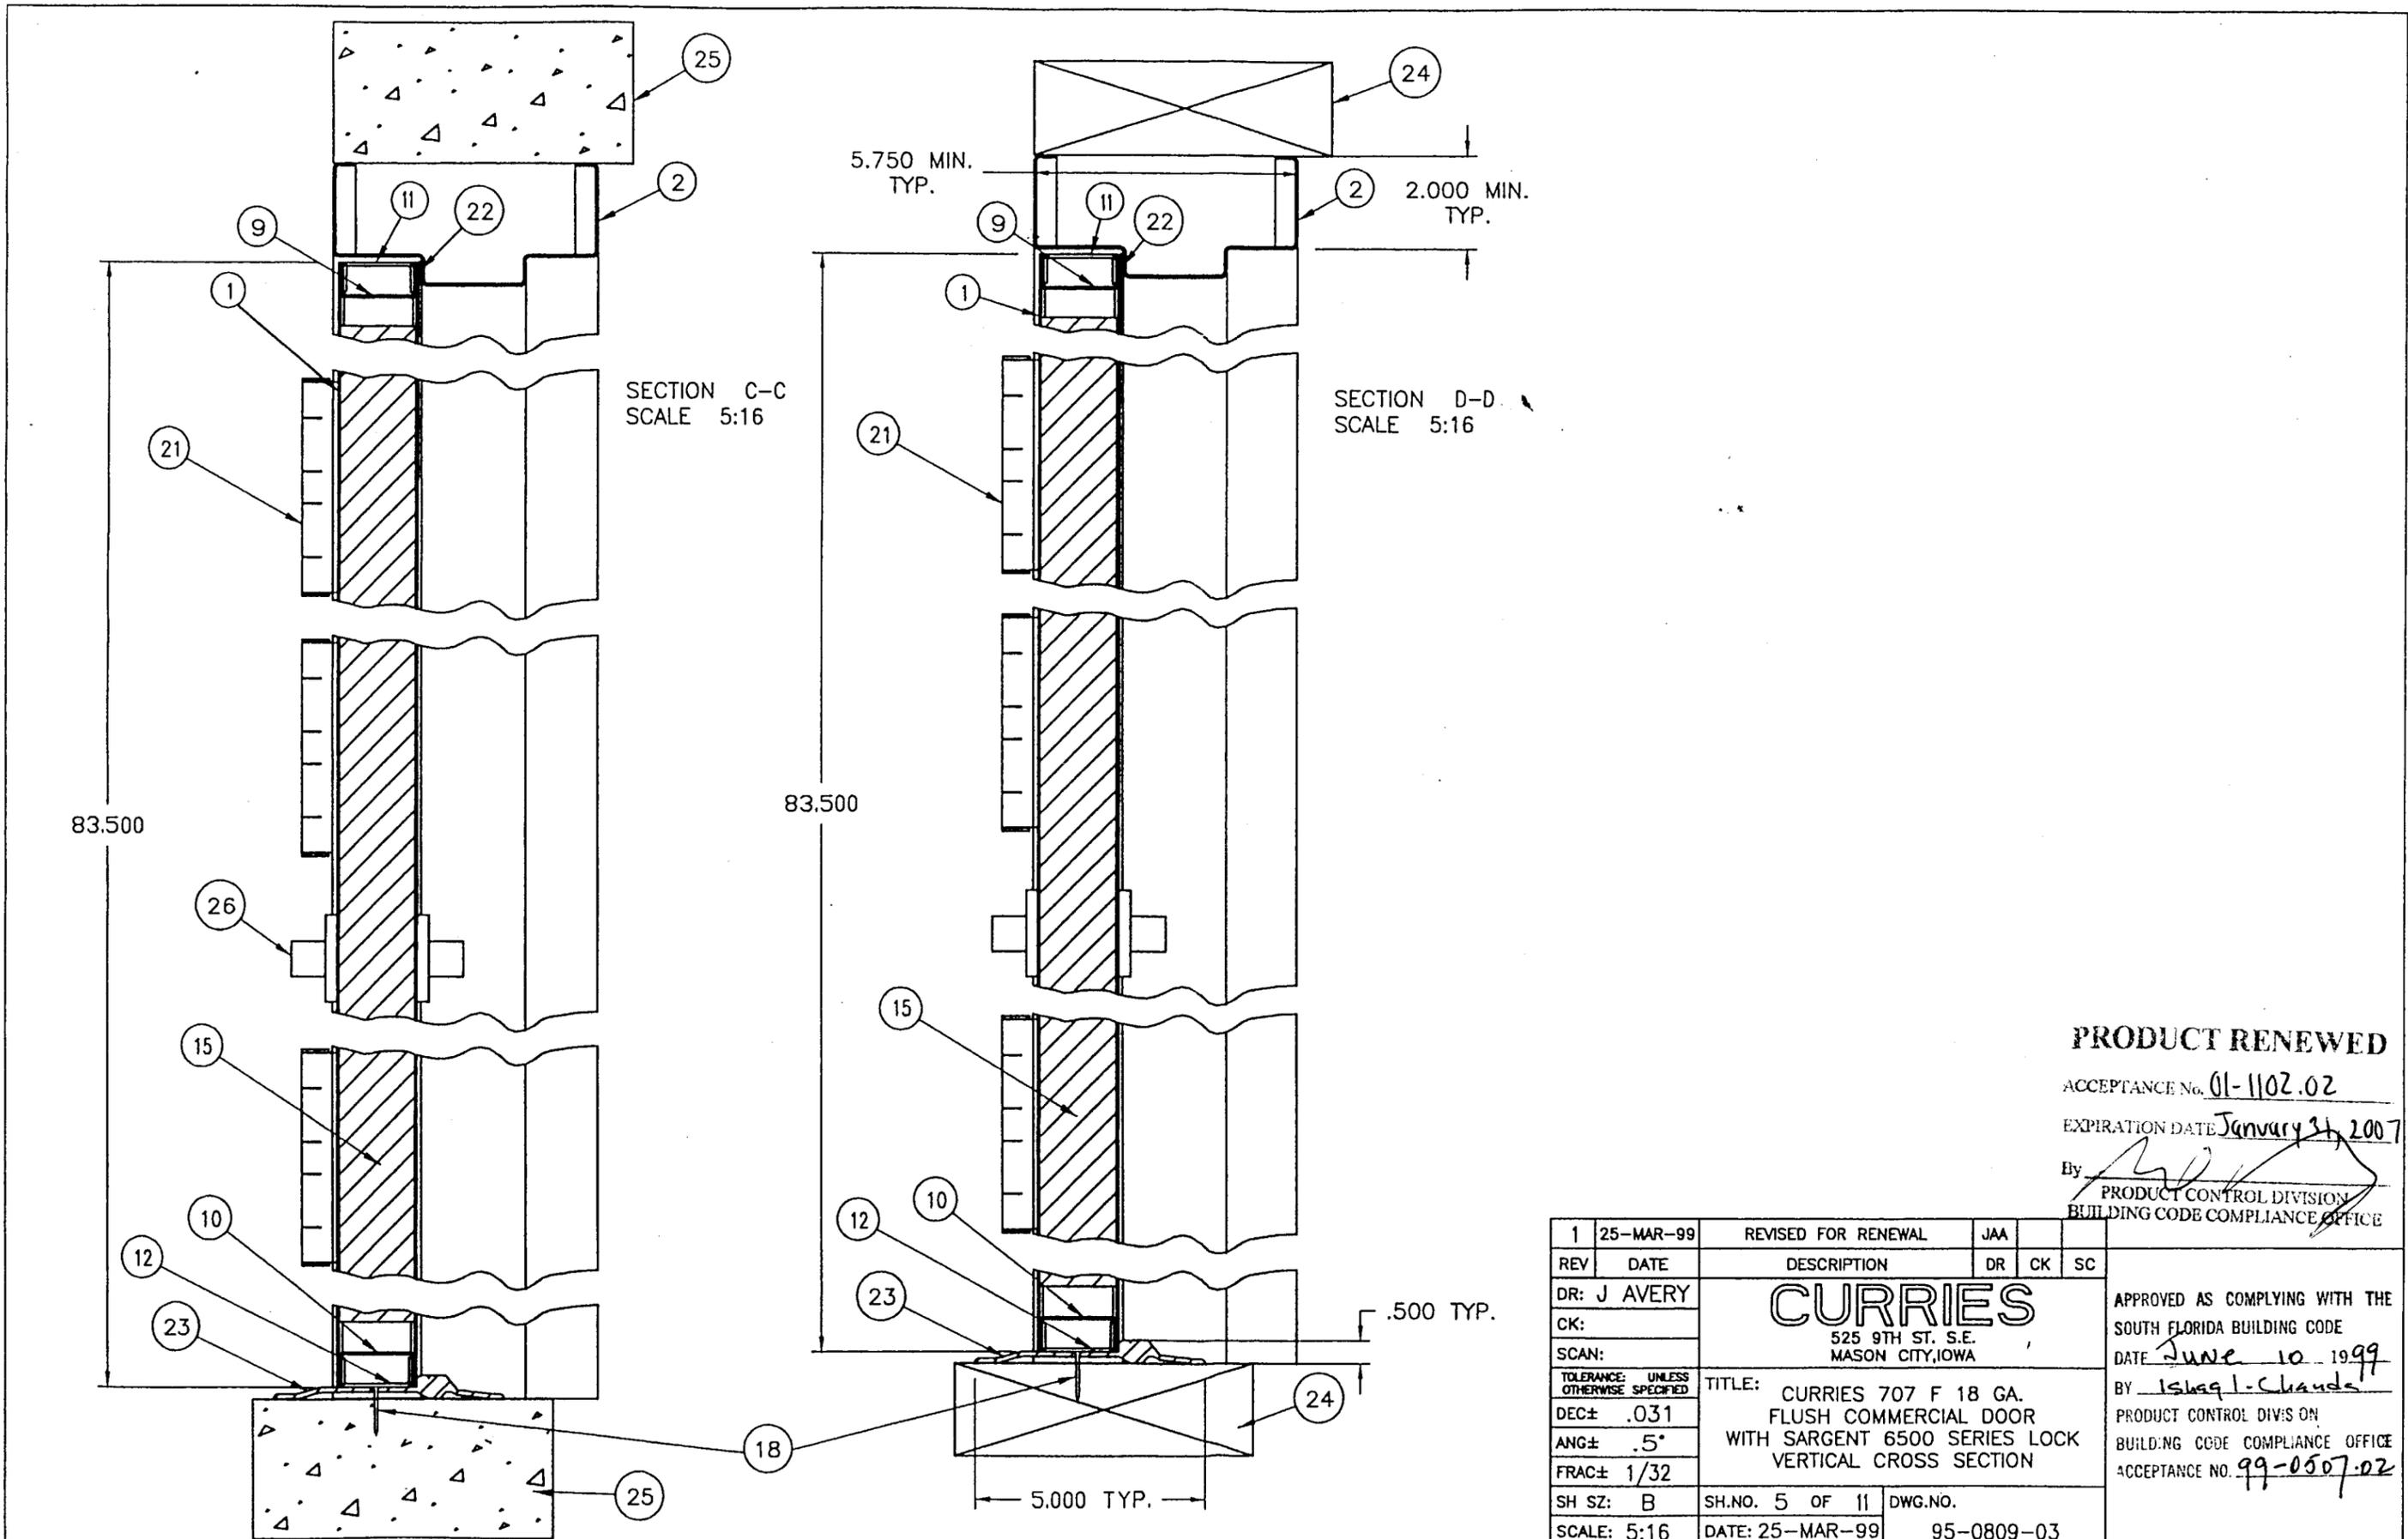

SECTION C-C  
SCALE 5:16

SECTION D-D  
SCALE 5:16

**PRODUCT RENEWED**


ACCEPTANCE No. 01-1102.02

EXPIRATION DATE January 31, 2007


By [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE

1	25-MAR-99	REVISED FOR RENEWAL	JAA		
REV	DATE	DESCRIPTION	DR	CK	SC
DR: J AVERY		<p><b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA</p> <p>TITLE: CURRIES 707 F 18 GA. FLUSH COMMERCIAL DOOR WITH SARGENT 6500 SERIES LOCK VERTICAL CROSS SECTION</p>			
CK:					
SCAN:					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031					
ANG± .5°					
FRAC± 1/32					
SH SZ: B	SH.NO. 5 OF 11	DWG.NO.			
SCALE: 5:16	DATE: 25-MAR-99	95-0809-03			

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE June 10, 1999  
BY Ishag I-Chanda  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 99-0507.02

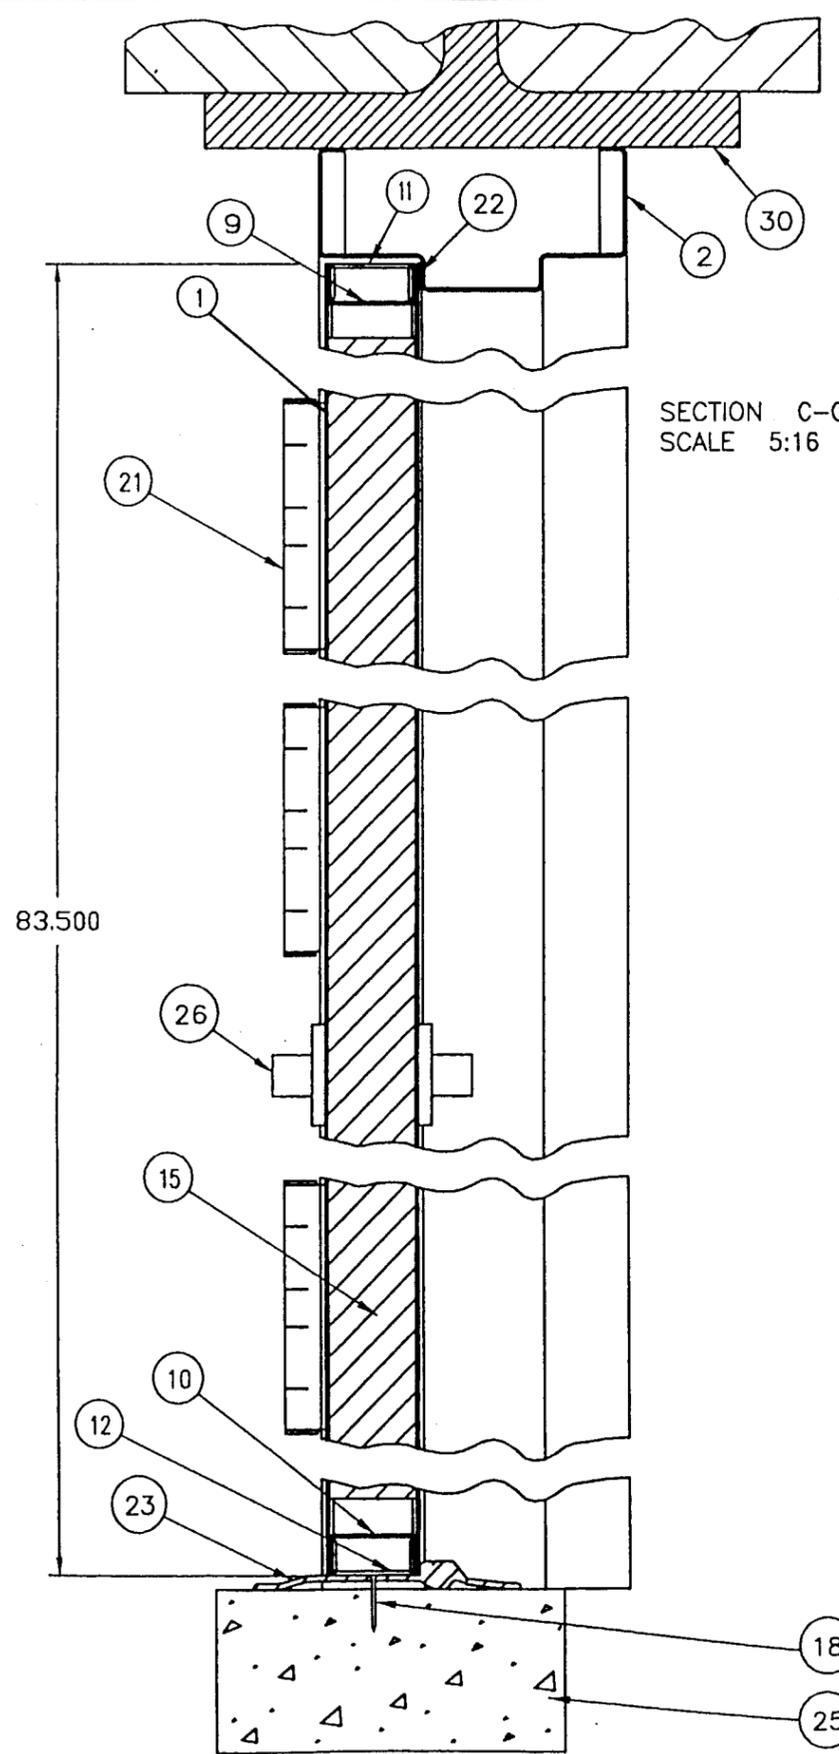

SECTION C-C  
SCALE 5:16

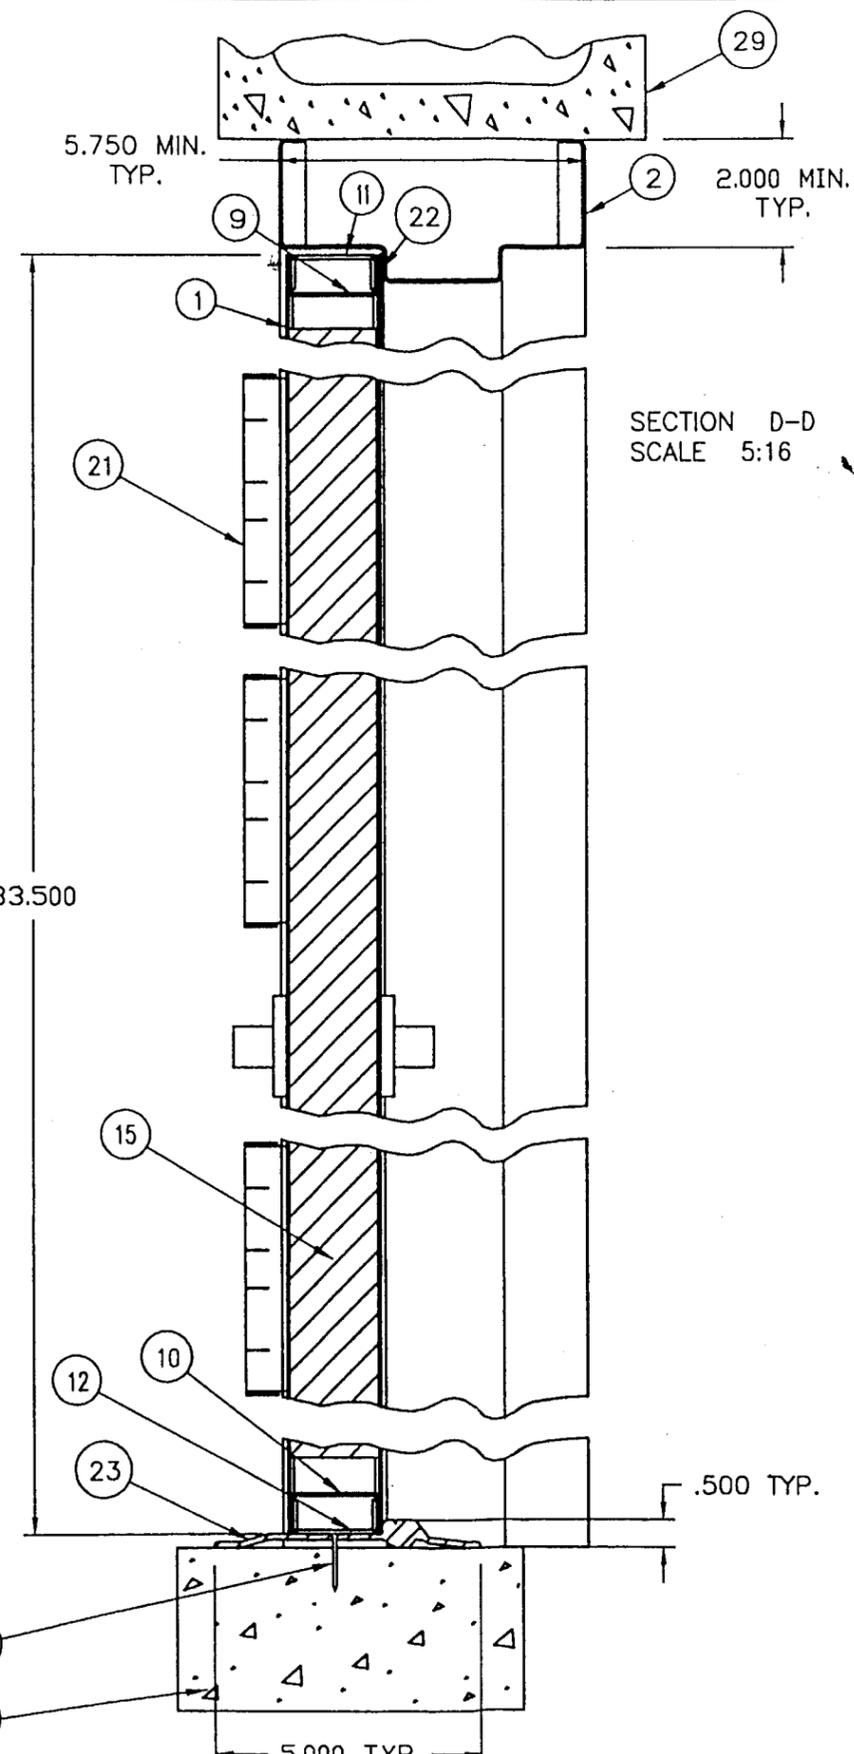

SECTION D-D  
SCALE 5:16

**PRODUCT RENEWED**


ACCEPTANCE No. 01-1102-02

EXPIRATION DATE January 31, 2007


By [Signature]

PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE


REV	DATE	DESCRIPTION	JAA	DR	CK	SC
1	25-MAR-99	REVISED FOR RENEWAL				
DR: J AVERY		<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA	APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE DATE <u>June 10, 1999</u> BY <u>Isaac L. Chauda</u> PRODUCT CONTROL DIVISION BUILDING CODE COMPLIANCE OFFICE ACCEPTANCE NO. <u>99-0507-02</u>			
CK:						
SCAN:						
TOLERANCE: UNLESS OTHERWISE SPECIFIED						
DEC± .031						
ANG± .5°		TITLE: CURRIES 707 F 18 GA. FLUSH COMMERCIAL DOOR WITH SARGENT 6500 SERIES LOCK VERTICAL CROSS SECTION				
FRAC± 1/32		SH.NO. 6 OF 11	DWG.NO.			
SH SZ: B		DATE: 25-MAR-99	95-0809-03			
SCALE: 5:16						

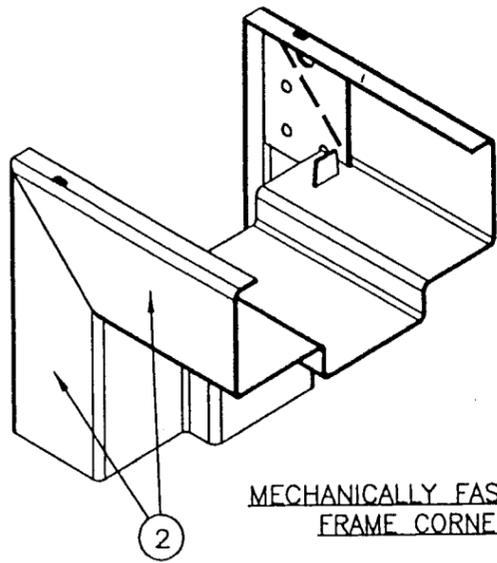


MECHANICALLY FASTENED  
FRAME CORNER

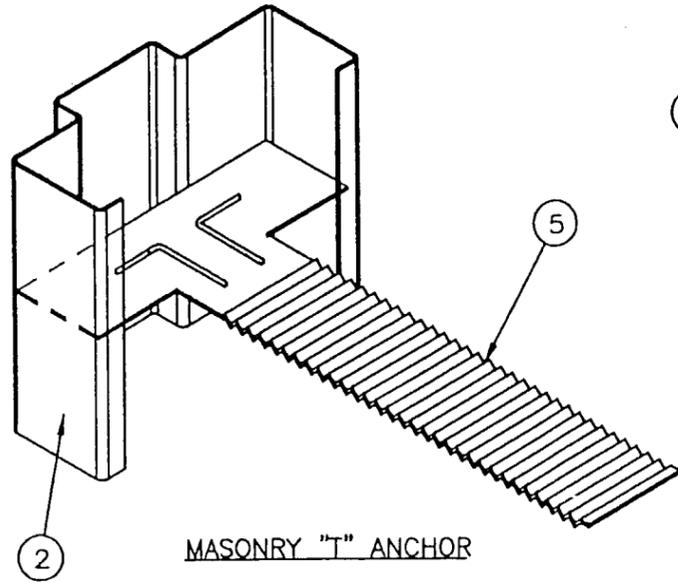


MASONRY "T" ANCHOR

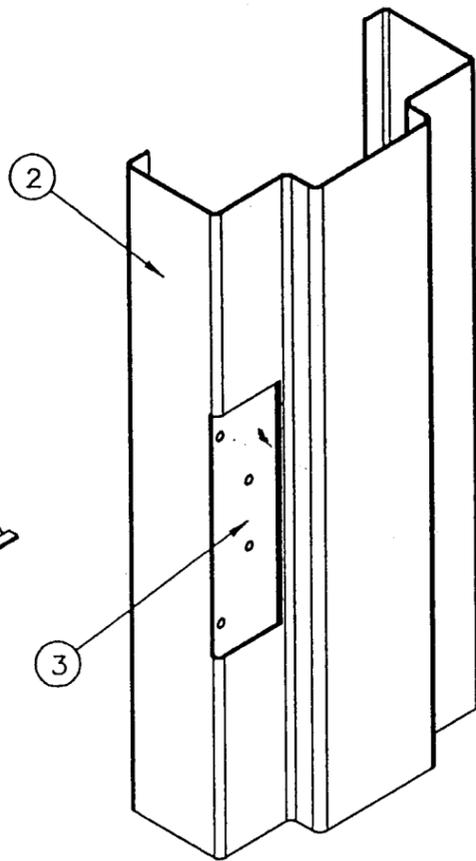


HINGE PREPARATION

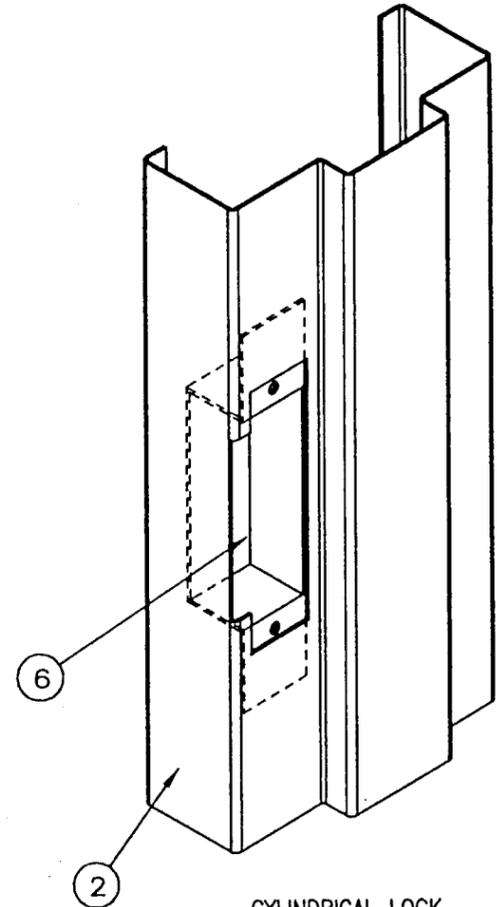


CYLINDRICAL LOCK  
STRIKE PREPARATION

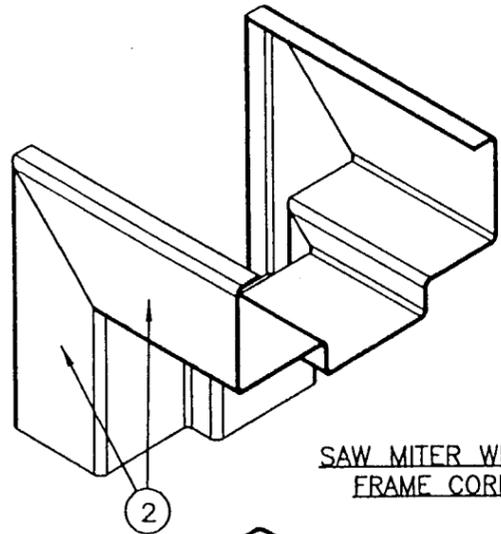

SAW MITER WELDED  
FRAME CORNER

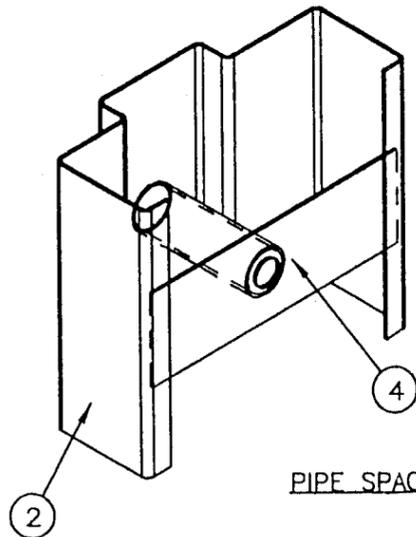

PIPE SPACER ANCHOR

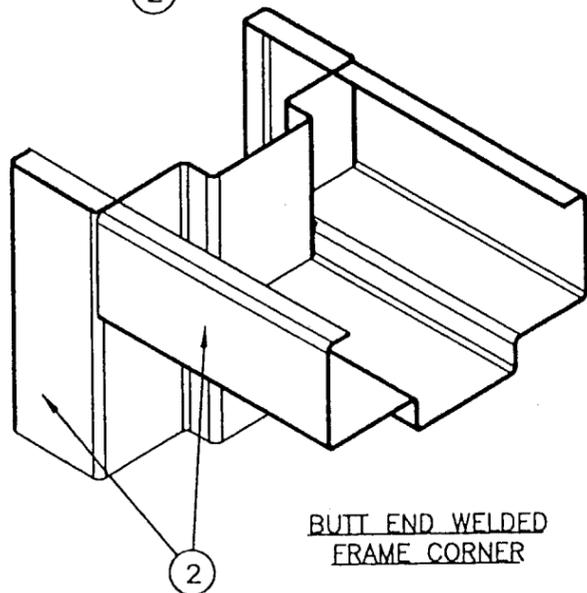


BUTT END WELDED  
FRAME CORNER

**PRODUCT RENEWED**

ACCEPTANCE No. 01-1102.02  
 EXPIRATION DATE January 31, 2007  
 By [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE


1	25-MAR-99	REVISED FOR RENEWAL	JAA		
REV	DATE	DESCRIPTION	DR	CK	SC
DR: J AVERY		<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA			
CK:					
SCAN:		TITLE: CURRIES 707 F 18 GA. FLUSH COMMERCIAL STEEL DOOR WITH SARGENT 6500 SERIES LOCK FRAME ASSEMBLY DETAILS			
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031					
ANG± .5°					
FRAC± 1/32					
SH SZ: B		SH.NO. 7 OF 11	DWG.NO.		
SCALE: 3:8		DATE: 26-MAR-99	95-0809-03		

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE June 10 1999  
 BY Ishtaq I. Chauda  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 99-0507.02

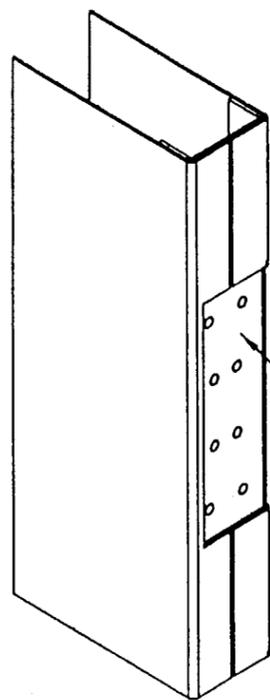


HINGE PREPARATION ASSEMBLY


14

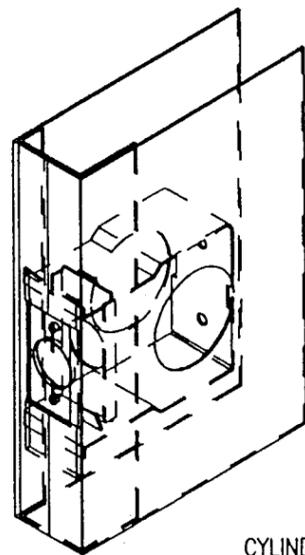

CYLINDRICAL LOCK ASSEMBLY

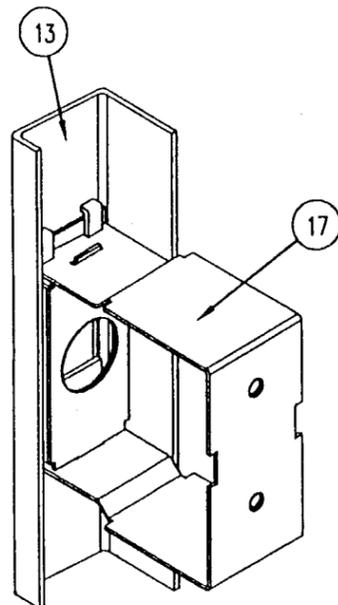


CYLINDRICAL LOCK REINFORCING ASSEMBLY

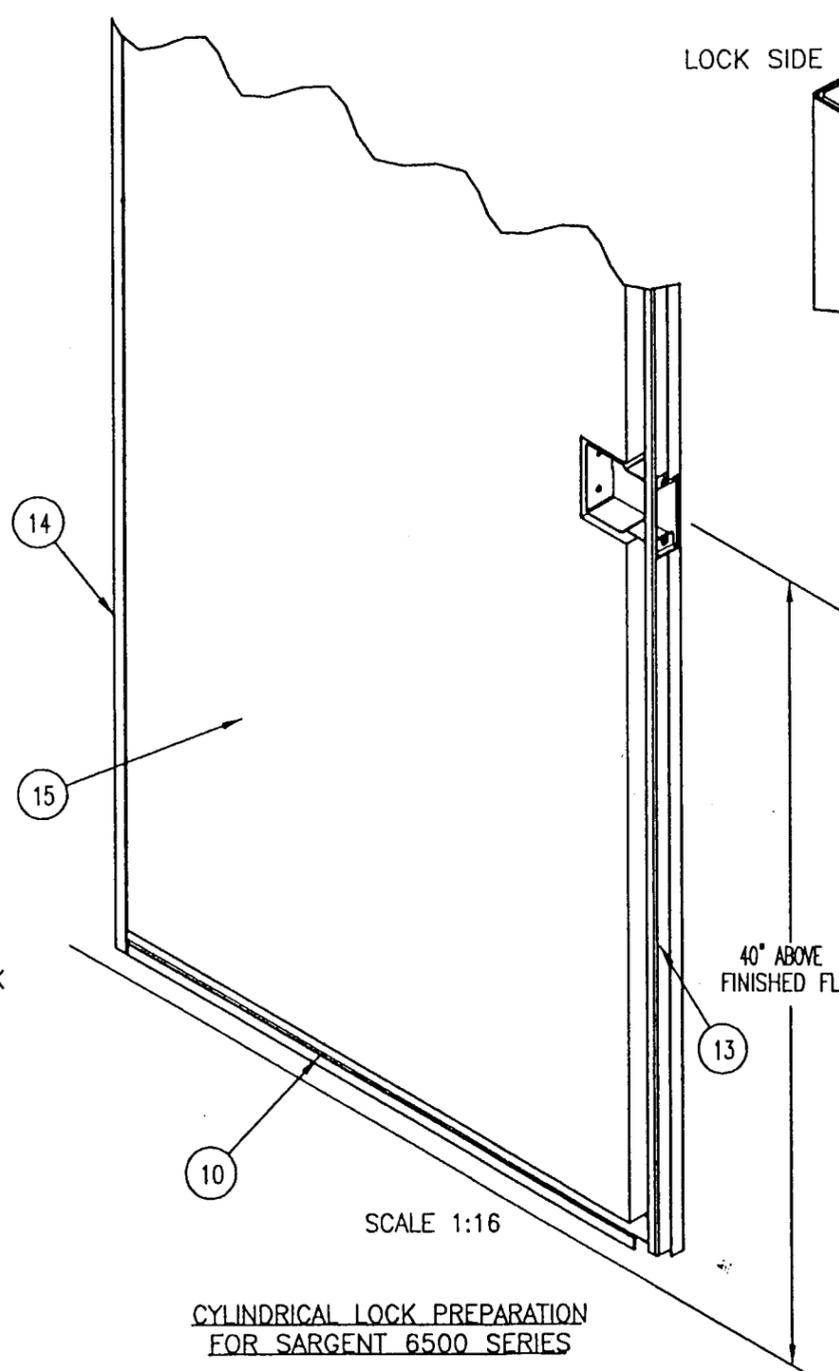


SCALE 1:16

CYLINDRICAL LOCK PREPARATION FOR SARGENT 6500 SERIES

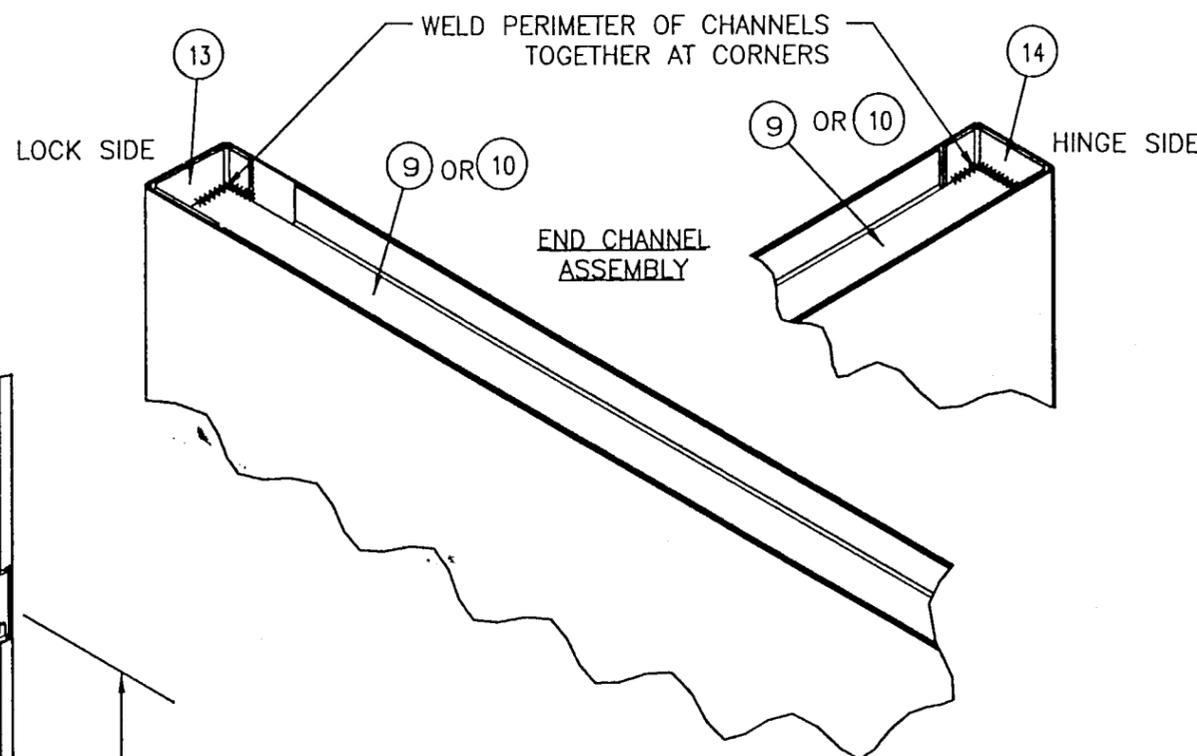

END CHANNEL ASSEMBLY

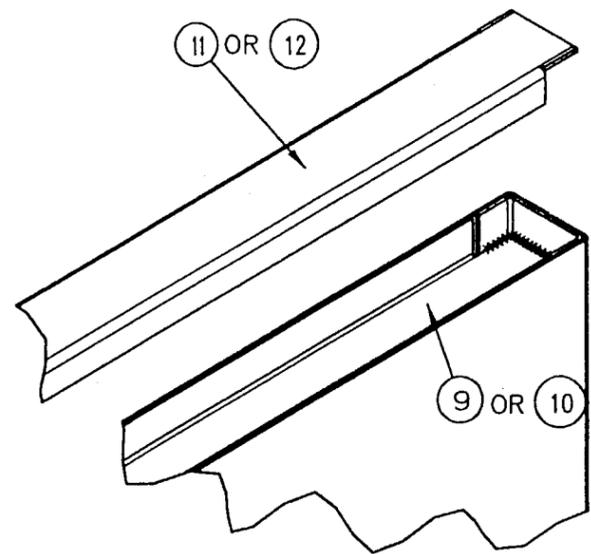

OPTIONAL TOP/BOTTOM CAP ASSEMBLY

**PRODUCT RENEWED**

ACCEPTANCE No. 01-1102.02


EXPIRATION DATE: January 31, 2007

By *[Signature]*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE



1	27-MAR-99	REVISED FOR RENEWAL	JAA		
REV	DATE	DESCRIPTION	DR	CK	SC
DR: J AVERY		<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA			
CK:					
SCAN:		TITLE:			
TOLERANCE: UNLESS OTHERWISE SPECIFIED		CURRIES SERIES 707 F 18 GA. FLUSH COMMERCIAL STEEL DOOR WITH SARGENT 6500 SERIES LOCK DOOR ASSEMBLY DETAILS			
DEC± .031		SH. NO. 8 OF 11	DWG. NO.		
ANG± .5°		DATE: 27-MAR-99	95-0809-03		
FRAC± 1/32					
SH SZ: B					
SCALE:					

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE June 10 1999  
BY Ishtaq I. Chaudhry  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 99-0507.02



SHIM PLATE

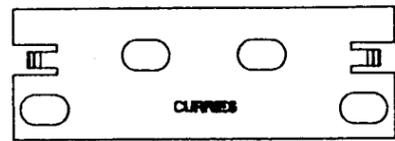

ULTIMA HINGE REINFORCEMENT

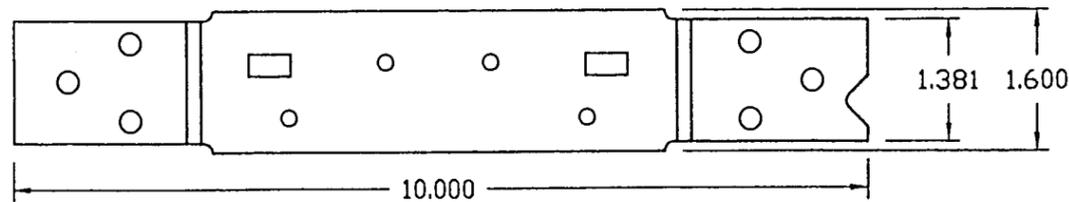


3

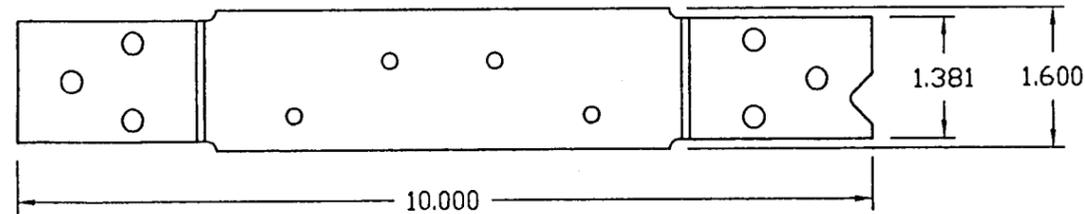


STANDARD HINGE REINFORCEMENT



FRAME STRIKE REINFORCEMENT

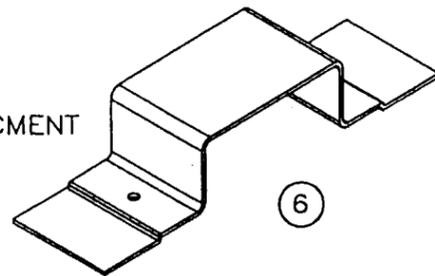


6

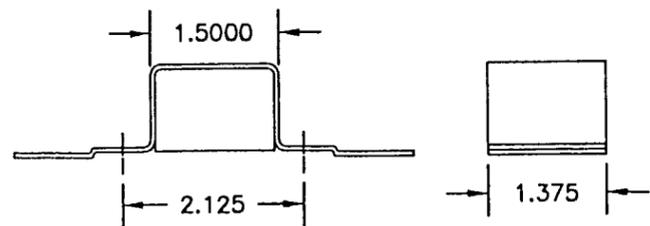


DR

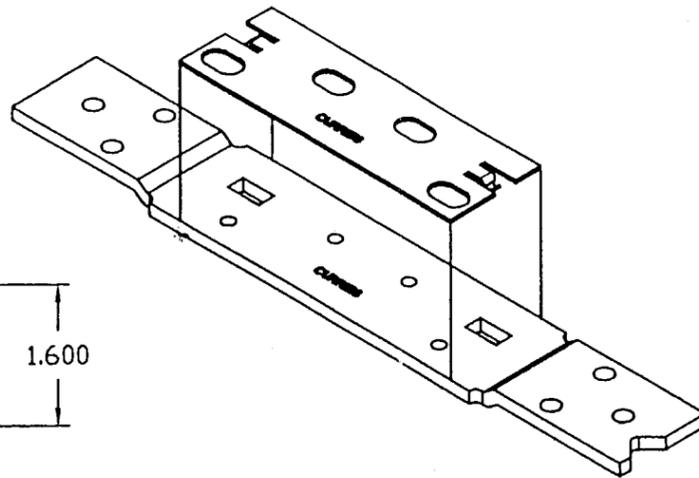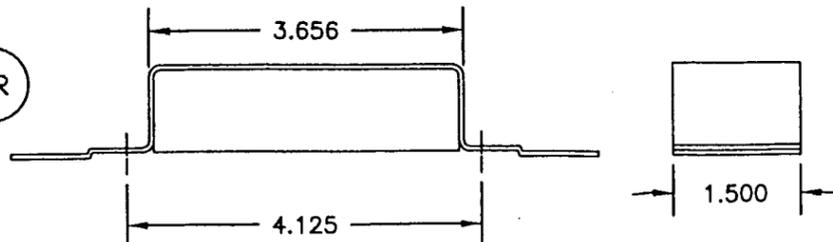



ø.500

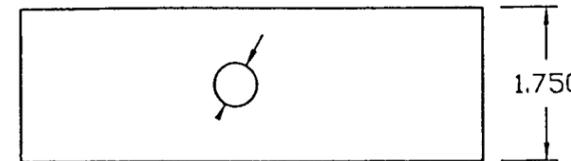


4



ø.750

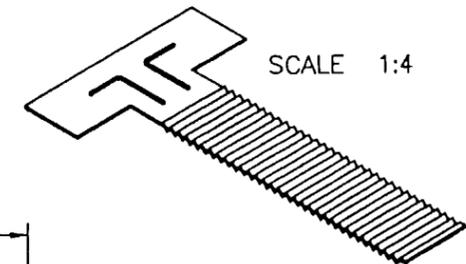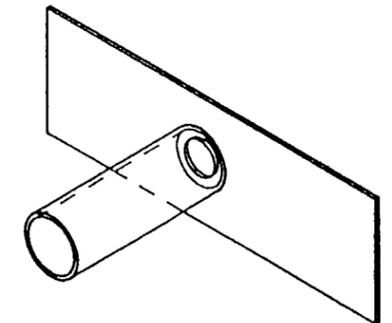

SCALE 1:4

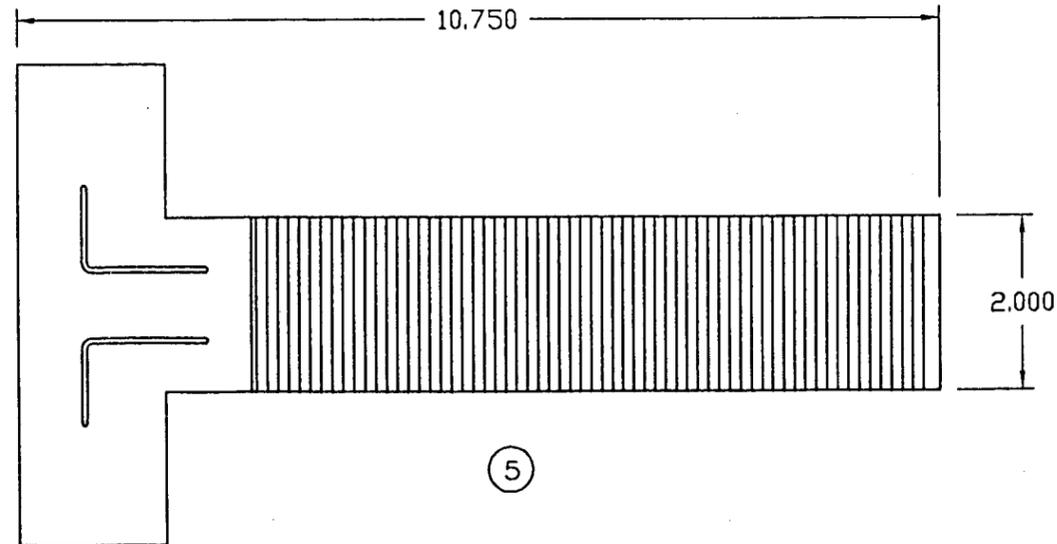

5

**PRODUCT RENEWED**





ACCEPTANCE No. 01-1102.02

EXPIRATION DATE January 31, 2007

By *[Signature]*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE

1	29-MAR-99	REVISED FOR RENEWAL	JAA		
REV	DATE	DESCRIPTION	DR	CK	SC
DR: J AVERY		<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA			
CK:					
SCAN:					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC± .031		TITLE:			
ANG± .5°		CURRIES SERIES 707 F 18 GA. FLUSH COMMERCIAL STEEL DOOR WITH 6500 SERIES LOCK			
FRAC± 1/32		FRAME PARTS DETAILS			
SH SZ: B		SH.NO. 9 OF 11	DWG.NO.		
SCALE: 1:2		DATE: 29-MAR-99	95 0809-03		

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE June 10, 1999  
BY *[Signature]*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 99-0507.02

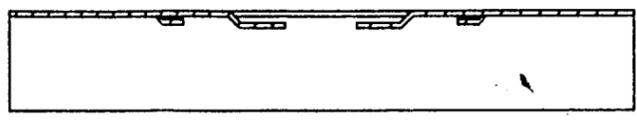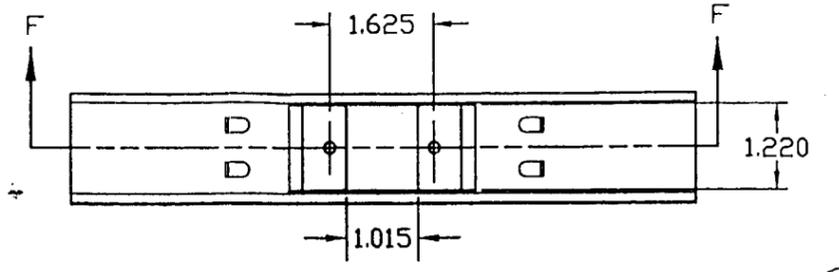
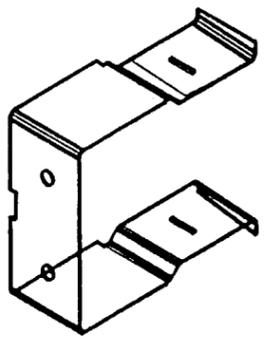
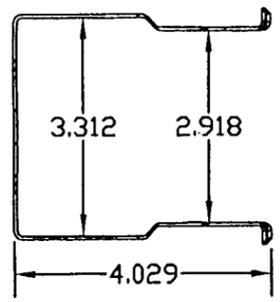


SECTION F-F


13

OPTIONAL NOTCHED EACH END TO CLEAR HINGE AND LOCK CHANNEL

11 & 12

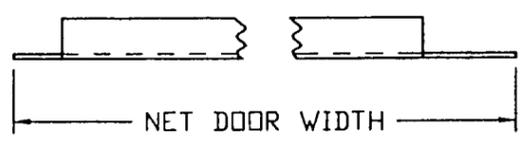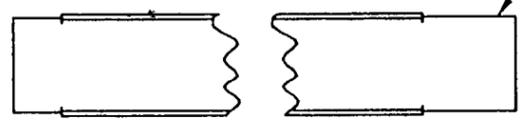

17





14

NOTCHED EACH END TO CLEAR HINGE AND LOCK CHANNEL



9 & 10

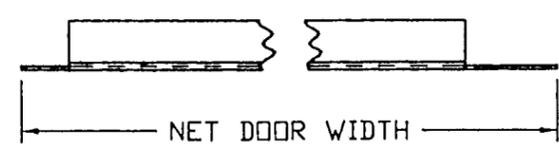



PRODUCT RENEWED

ACCEPTANCE No. 01-1102.02

EXPIRATION DATE January 31, 2007

By *[Signature]*

PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE

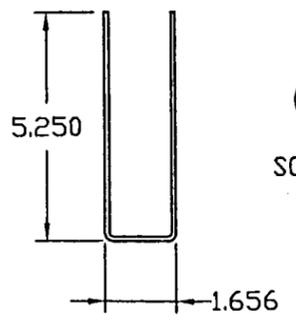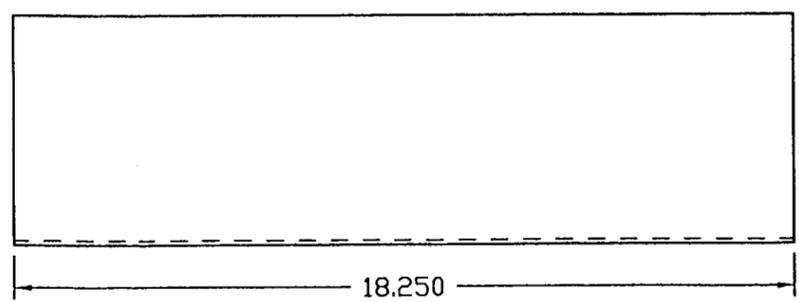

16

SCALE 1/4

1	30-MAR-99	REVISED FOR REVISION	JAA		
REV	DATE	DESCRIPTION	DR	CK	SC
DR: J AVERY		<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA			
CK:					
SCAN:					
TOLERANCE UNLESS OTHERWISE SPECIFIED					
DEC± .031		TITLE:			
ANG± .5°		CURRIES SERIES 707 F 18 GA. FLUSH COMMERCIAL DOOR WITH SARGENT 6500 SERIES LOCK DOOR PARTS DETAILS			
FRAC± 1/32					
SH SZ: B	SH.NO. 10 OF 11	DWG.NO.			
SCALE: 3/8	DATE: 30-MAR-99	95-0809-03			

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE June 10 1999  
BY Isaac I. Claude  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 99-0507-02

# BILL OF MATERIALS

ITEM	QUANTITY	DESCRIPTION
1	1	18 GA. (.041") MIN., 14 GA. (.080) MAX. FLUSH DOOR (COLD ROLLED, GALVANIZED, OR STAINLESS STEEL)
2	1	16 GA. (.053") MIN., 12 GA. (.110") MAX. WELDED OR KD FRAME (COLD ROLLED, GALVANIZED, OR STAINLESS STEEL)
3	3	7 GA. (.171") MIN., (.203") MAX. FRAME HINGE REINFORCEMENT - PER HINGE JAMB
4	4	16 GA. (.053") MIN. PIPE SPACER ANCHOR - PER JAMB
5	4	16 GA. (.053") MIN. MASONRY T ANCHOR - PER JAMB
6	1	16 GA. (.171") MIN. STRIKE REINFORCEMENT
7	4	3/8" x 5" FLAT HEAD WOOD SCREW/LAG BOLT - PER JAMB
8	4	3/8" x 5" FLAT HEAD SLEEVE ANCHOR - PER JAMB
9	1	16 GA. (.053") MIN., 12 GA. (.110") MAX., TOP END CHANNEL
10	1	16 GA. (.053") MIN., 12 GA. (.110") MAX., BOTTOM END CHANNEL
11	1	OPTIONAL 16 GA. (.053") MIN., 12 GA. (.110") MAX., TOP CAP
12	1	OPTIONAL 16 GA. (.053") MIN., 12 GA. (.110") MAX., BOTTOM CAP
13	1	14 GA. (.080") MIN., LOCK CHANNEL
14	1	14 GA. (.080") MIN., 12 GA. (.110") MAX. HINGE CHANNEL
15	1	ONE POUND DENSITY POLYSTYRENE CORE - 1.656" NOMINAL THICKNESS - MANUFACTURED BY BASF
16	1	OPTIONAL 12 GA. (.110") MIN. CLOSER REINFORCING
17	1	16 GA. (.053") MIN. CYLINDRICAL LOCK REINFORCEMENT
18	3	#10 WOOD OR MACHINE SCREW x 1" LONG MIN OR 3/16" x 1-1/4" LONG TAP CON.
19	1	2000 PSI MIN. MORTOR OR CONCRETE
20		NOT USED
21	3	4-1/2" x 4-1/2" X .134" STEEL HINGES - MCKINNEY T-2714
22	1	ONE ROW OF PEMKO S88 WEATHERSTRIP PER FRAME MEMBER
23	1	PEMKO ALUMINUM SILL 2005AS - 1/2" TALL x 5" x NOMINAL DOOR WIDTH
24	1	2' x 12" WOOD BUCK
25	1	EXISTING MASONRY OR POURED CONCRETE - 2000 PSI. MIN.
26	1	SARGENT 6500 SERIES CYLINDRICAL LOCK
27		NOT USED
28	-	FINISH PAINT - FACES OF DOOR AND FRAME
29	1	8" CMU BLOCK
30	1	STEEL LINTLE

**PRODUCT RENEWED**

ACCEPTANCE No. 01-1102.02

EXPIRATION DATE January 31, 2007

By [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE

**NOTES:**

1. AVERAGE TENSILE STRENGTH = 51,778 PSI
2. AVERAGE YIELD STRENGTH = 27,000 PSI.

1	29-MAR-99	REVISED FOR REVISION	DR	CK	SC
REV	DATE	DESCRIPTION			
DR:	J AVERY	<b>CURRIES</b> 525 9TH ST. S.E. MASON CITY, IOWA			
CK:					
SCAN:					
TOLERANCE: UNLESS OTHERWISE SPECIFIED					
DEC±	.031	TITLE:	CURRIES SERIES 707 F 18 GA. FLUSH COMMERCIAL DOOR WITH SARGENT 6500 SERIES LOCK BILL OF MATERIALS		
ANG±	.5°				
FRAC±	1/32				
SH SZ:	B	SH.NO. 11 OF 11			
SCALE:	-	DATE: 29-MAR-99	95-0809-03		

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE June 10 1999  
 BY [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 99-0507.02