



**BUILDING CODE COMPLIANCE OFFICE**  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908

**CONTRACTOR LICENSING SECTION**  
(305) 375-2527 FAX (305) 375-2558

**CONTRACTOR ENFORCEMENT DIVISION**  
(305) 375-2966 FAX (305) 375-2908

**PRODUCT CONTROL DIVISION**  
(305) 375-2902 FAX (305) 372-6339

**PRODUCT CONTROL NOTICE OF ACCEPTANCE**

**Miami Wall Systems, Inc.**  
**701 West 25 Street**  
**Hialeah ,FL 33010**

Your application for Notice of Acceptance (NOA) of:

**SGD Small Missile (1/4 Glass)**

under Chapter 8 of the Code of Miami-Dade County governing the use of Alternate Materials and Types of Construction, and completely described herein, has been recommended for acceptance by the Miami-Dade County Building Code Compliance Office (BCCO) under the conditions specified herein.

This NOA shall not be valid after the expiration date stated below. BCCO reserves the right to secure this product or material at any time from a jobsite or manufacturer's plant for quality control testing. If this product or material fails to perform in the approved manner, BCCO may revoke, modify, or suspend the use of such product or material immediately. BCCO reserves the right to revoke this approval, if it is determined by BCCO that this product or material fails to meet the requirements of the South Florida Building Code.

The expense of such testing will be incurred by the manufacturer.

Raul Rodriguez  
Chief Product Control Division

**ACCEPTANCE NO.: 01-1108.02**  
**EXPIRES: 12/10/2006**

**THIS IS THE COVERSHEET, SEE ADDITIONAL PAGES FOR SPECIFIC AND GENERAL  
CONDITIONS  
BUILDING CODE & PRODUCT REVIEW COMMITTEE**

This application for Product Approval has been reviewed by the BCCO and approved by the Building Code and Product Review Committee to be used in Miami-Dade County, Florida under the conditions set forth above.

Francisco J. Quintana, R.A.  
Director  
Miami-Dade County  
Building Code Compliance Office

**APPROVED: 12/27/2001**



**NOTICE OF ACCEPTANCE: SPECIFIC CONDITIONS**

**1. SCOPE**

**1.1** This **renews** Notice of Acceptance (NOA) No. **97-1027.05**, which was issued on November 19, 1998. It renews the approval of an aluminum sliding glass door, as described in Section 2 of this NOA, designed to comply with the South Florida Building Code (SFBC), 1994 Edition for Miami-Dade County, for the locations where the pressure requirements, as determined by SFBC Chapter 23, do not exceed the Design Pressure Rating values indicated in the approved drawings.

**2. PRODUCT DESCRIPTION**

**2.1** The **Series "100" Aluminum Sliding Glass Door – Small Missile Impact Resistant** and its components shall be constructed in strict compliance with the following document: Drawing No **M.W.S.-100**, Sheets 1 through 8 of 8, titled "SGD Series 100," prepared by manufacturer, dated 09/22/98, bearing the Miami-Dade County Product Control renewal stamp with the NOA number and expiration date by the Miami-Dade County Product Control Division. This document shall hereinafter be referred to as the approved drawings.

**3. LIMITATIONS**

**3.1** This approval applies to single unit applications only, as shown in approved drawings.

**4. INSTALLATION**

**4.1** The aluminum sliding glass door and its components shall be installed in strict compliance with the approved drawings.

**4.2** Hurricane protection system (shutters): The installation of this unit up to 30 feet above grade, **will require** a hurricane protection system, but for installations above 30 feet above grade **will not require** a hurricane protection system.

**5. LABELING**

**5.1** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved".


**6. BUILDING PERMIT REQUIREMENTS**

**6.1** Application for building permit shall be accompanied by copies of the following:

**6.1.1** This Notice of Acceptance

**6.1.2** Duplicate copies of the approved drawings, as identified in Section 2 of this Notice of Acceptance, clearly marked to show the components selected for the proposed installation.

**6.1.3** Any other documents required by the Building Official or the South Florida Building Code (SFBC) in order to properly evaluate the installation of this system.

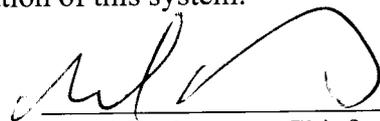

Raul Rodriguez, Chief  
Product Control Division


**NOTICE OF ACCEPTANCE: STANDARD CONDITIONS**

1. Renewal of this Acceptance (approval) shall be considered after a renewal application has been filed and the original submitted documentation, including test supporting data, engineering documents, are no older than eight (8) years.
2. Any and all approved products shall be permanently labeled with the manufacturer's name, city, state, and the following statement: "Miami-Dade County Product Control Approved", or as specifically stated in the specific conditions of this Acceptance.
3. Renewals of Acceptance will not be considered if:
  - a) There has been a change in the South Florida Building Code affecting the evaluation of this product and the product is not in compliance with the code changes;
  - b) The product is no longer the same product (identical) as the one originally approved;
  - c) If the Acceptance holder has not complied with all the requirements of this acceptance, including the correct installation of the product;
  - d) The engineer who originally prepared, signed and sealed the required documentation initially submitted is no longer practicing the engineering profession.
4. Any revision or change in the materials, use, and/or manufacture of the product or process shall automatically be cause for termination of this Acceptance, unless prior written approval has been requested (through the filing of a revision application with appropriate fee) and granted by this office.
5. Any of the following shall also be grounds for removal of this Acceptance:
  - a) Unsatisfactory performance of this product or process.
  - b) Misuse of this Acceptance as an endorsement of any product, for sales, advertising or any other purpose.
6. The Notice of Acceptance number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the Notice of Acceptance is displayed, then it shall be done in its entirety.
7. A copy of this Acceptance as well as approved drawings and other documents, where it applies, shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at all time. The engineer need not reseal the copies.
8. Failure to comply with any section of this Acceptance shall be cause for termination and removal of Acceptance.
9. This Notice of Acceptance consists of pages 1, 2 and this last page 3.

**END OF THIS ACCEPTANCE**








Raul Rodriguez, Chief  
Product Control Division

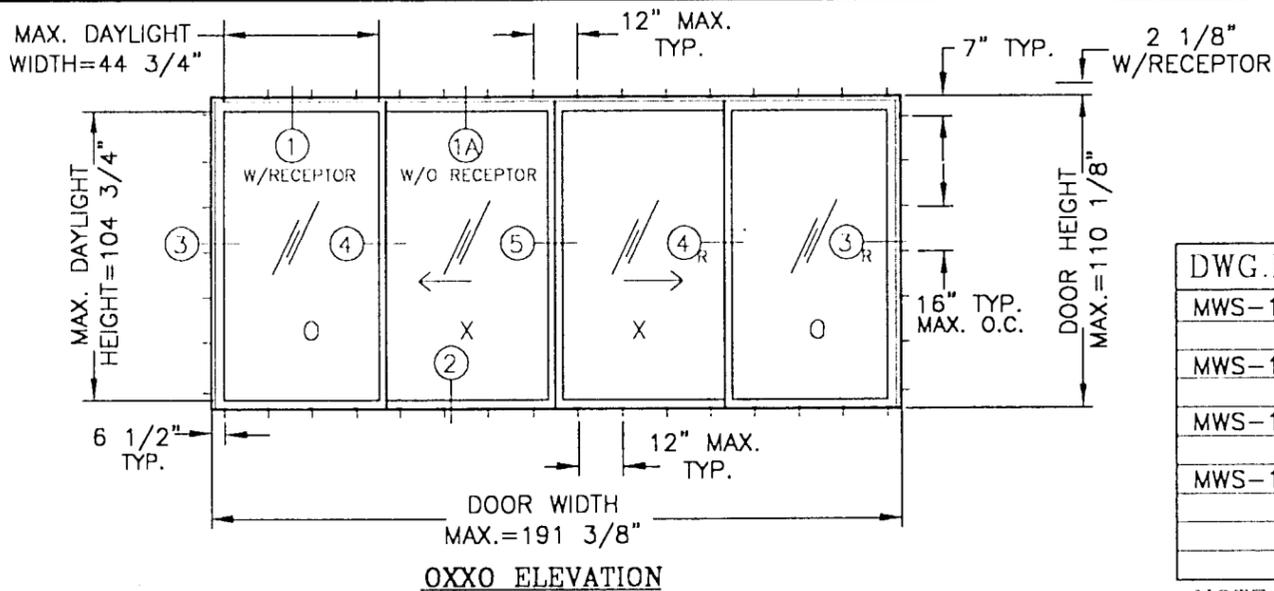

MIAMI WALL SYSTEMS, INC.  
 SERIES 100  
 ALUMINUM SLIDING GLASS DOOR  
 BASED ON FTL #1797,1782,1776,& 1743 (SMALL MISSILE IMPACT TESTS )  
 GLASS: 1/4" TEMPERED  
 D.P. 63.3; 73.0; 85.3; 105.5,110 PSF (POSITIVE & NEGATIVE)  
 W.T.P. 16.00 PSF

DWG.No.	DESIGNATION	REINFORCEMENT	LOCATION
MWS-100,2	NO REINFORCEMENT	NONE	NONE
MWS-100,3	LIGHT REINFORCEMENT	1/4" STEEL BAR	EACH INTERLOCK
MWS-100,4	MEDIUM REINFORCEMENT	3/8" STEEL BAR	EACH INTERLOCK
MWS-100,5	HEAVY REINFORCEMENT	1/4 & 3/8" STEEL BARS 3"x4.1# STEEL STRUCT.CHANNEL 7/8x3/4x7/8x1/8" ALUM. CHANNEL 3/4x1" STEEL BAR	EACH INTERLOCK FEM. ASTRAGAL TOP RAILS MOV. BOTTOM RAILS

NOTE: FOR DESIGN PRESSURE RATINGS OF REINF'T PACKAGES SEE SEE TABLE ON SHEET #6.

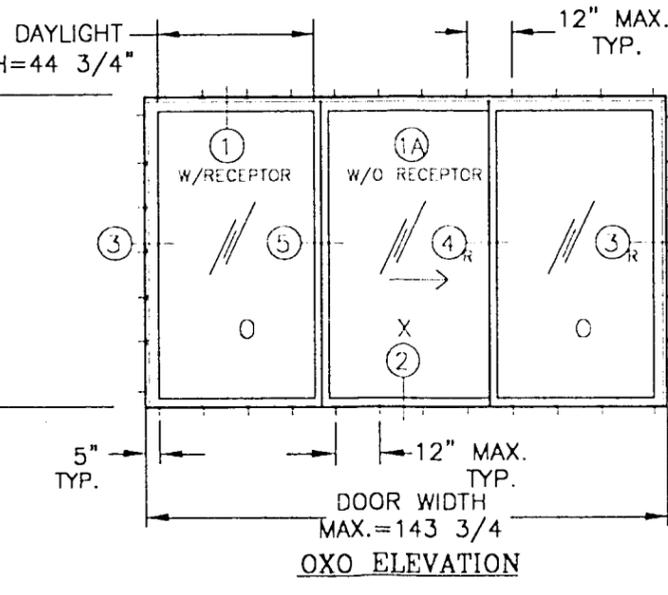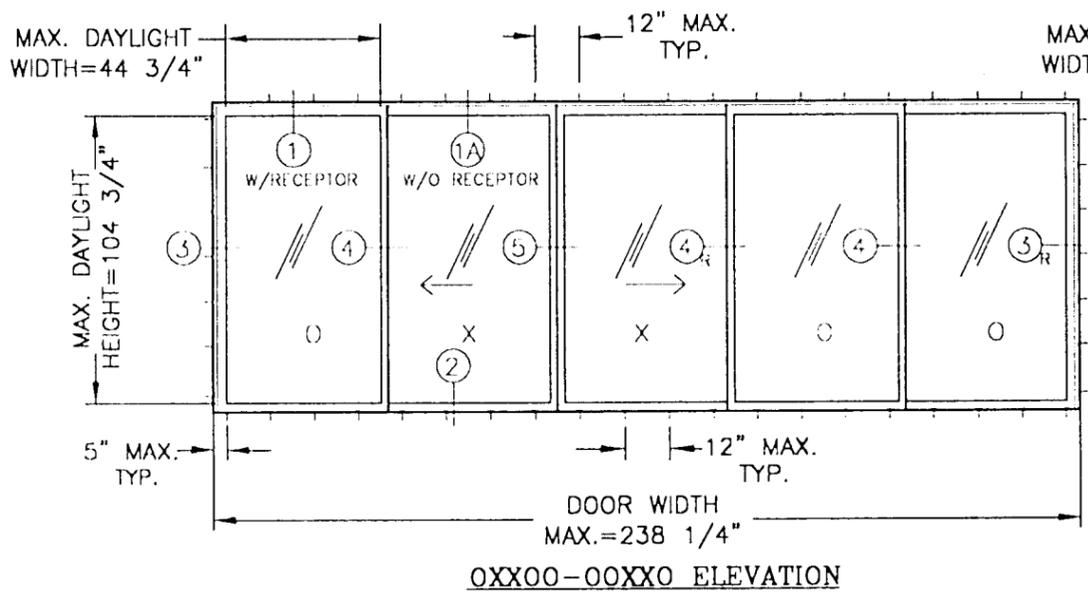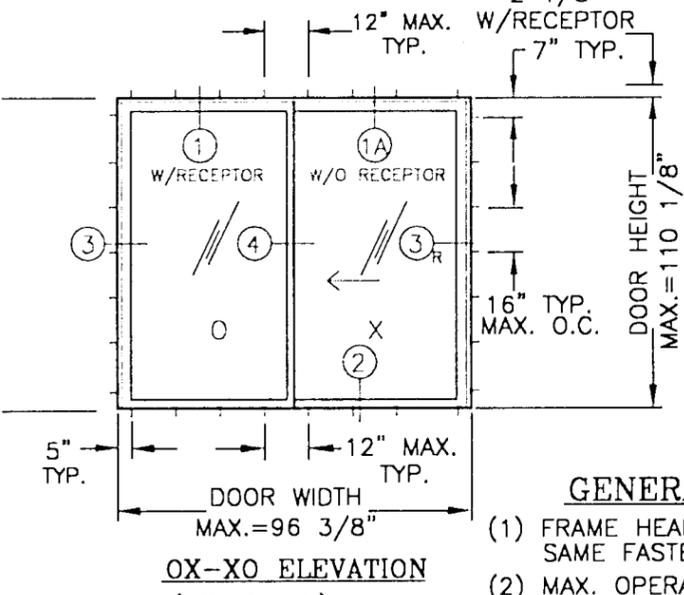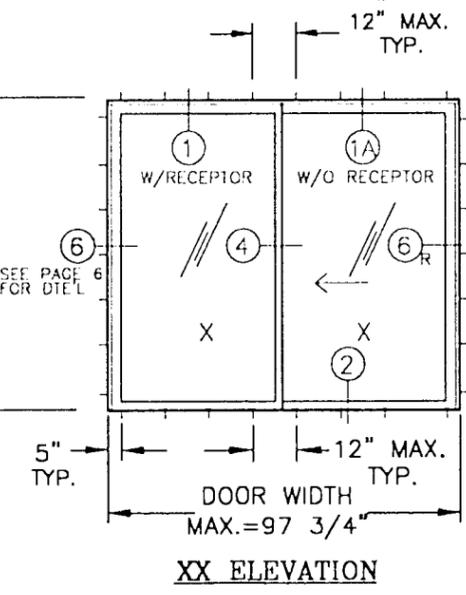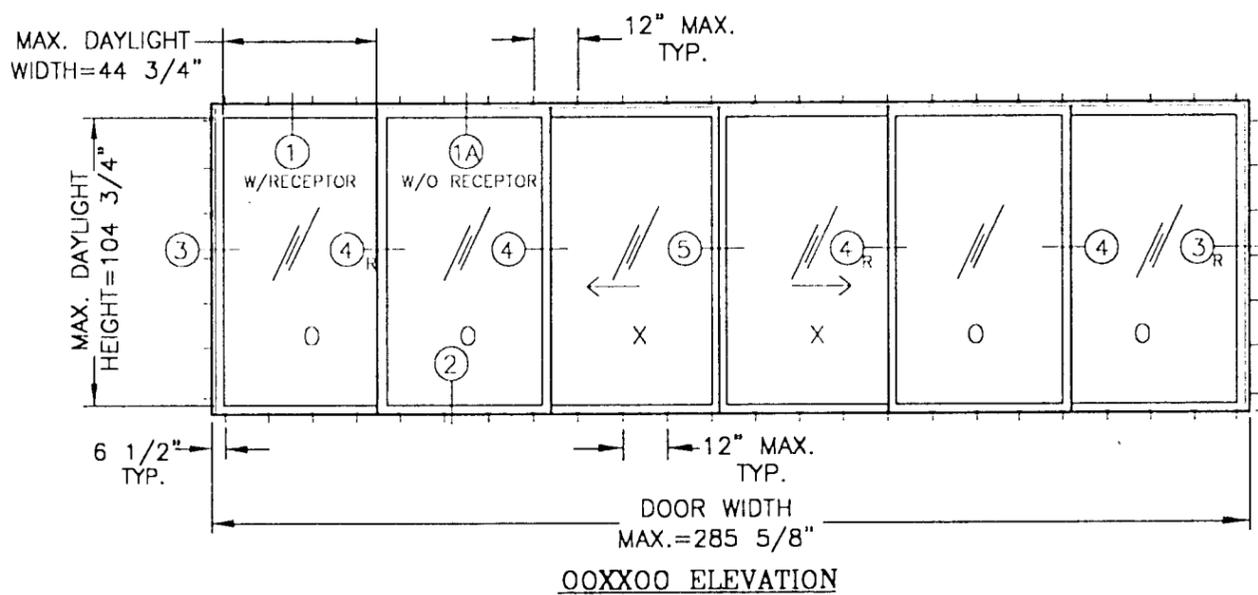

- GENERAL NOTES:**
- (1) FRAME HEAD AND SILL USE SAME FASTENER SPACING.
  - (2) MAX. OPERATING PANEL SIZE: 49 7/8"x109 1/8"  
MAX. FIXED PANEL SIZE: 49 5/16"x109 1/8"
  - (3) ALL ANCHORS AT JAMBS ARE DOUBLE ROW.
  - (4) FOR DESIGN PRESSURE RATINGS OF REINF'T PACKAGES SEE TABLE ON SHEET #6

**PRODUCT RENEWED**

ACCEPTANCE No. 01-1108.02  
 EXPIRATION DATE December 10, 2006  
 By *[Signature]*  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
 DATE December 10, 1998  
 BY *[Signature]*  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 97-1027-25

Miami Wall Systems, Inc.  
 701 West 25th Street  
 Hialeah, Florida, 33010  
 Phone: (305) 888-2300 Fax: (305) 888-3058

SGD SERIES 100  
 DOOR ELEVATIONS  
 REINFORCEMENT SUMMARY  
 CHART


REV'S	DATE	DESCRIPTION

APPROVED BY: *[Signature]*  
 DATE: 09/22/98  
 DESIGN BY: L.G.  
 CHECKED BY: F.C.  
 drawing no. MWS-100  
 sheet 1 of 8








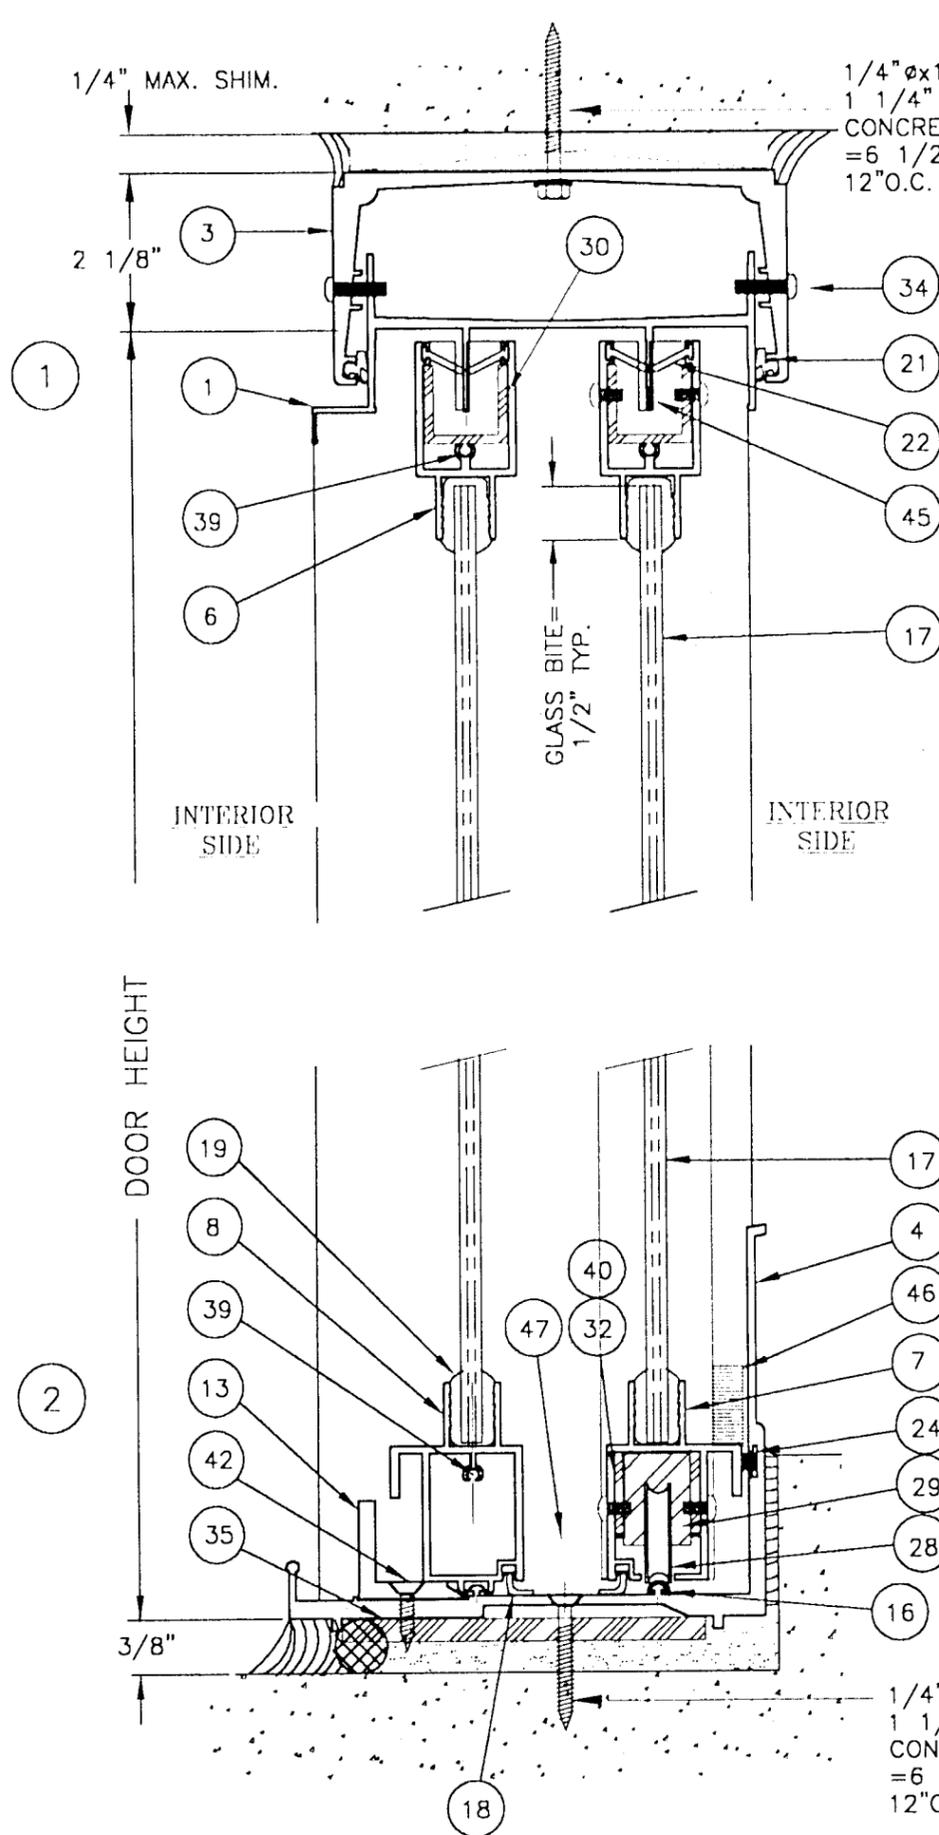

1/4" MAX. SHIM.  
1/4"  $\phi$  x 1 3/4" TAPCON,  
1 1/4" MIN. EMBEDMENT INTO  
CONCRETE, MAX.SPACING  
= 6 1/2" FROM ENDS &  
12" O.C.


1/4"  $\phi$  x 1 3/4" TAP-CON,  
1 1/4" MIN. EMBEDMENT INTO  
CONCRETE, MAX. SPACING=  
7" FROM ENDS & 16" O.C.

1/4"  $\phi$  x 2 1/4" TAPCON,  
1 1/4" MIN. EMBEDMENT INTO  
CONCRETE, MAX.SPACING  
= 6 1/2" FROM ENDS &  
12" O.C.

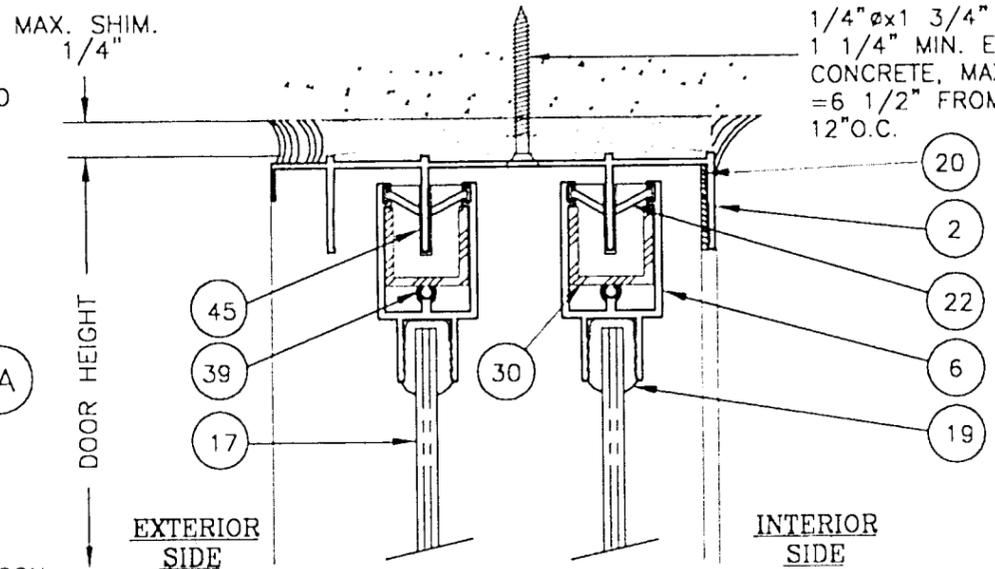

1/4"  $\phi$  x 1 3/4" TAPCON,  
1 1/4" MIN. EMBEDMENT INTO  
CONCRETE, MAX.SPACING  
= 6 1/2" FROM ENDS &  
12" O.C.

**PRODUCT RENEWED**  
ACCEPTANCE No. 0-1108.02  
EXPIRATION DATE December 10, 2006  
By [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE

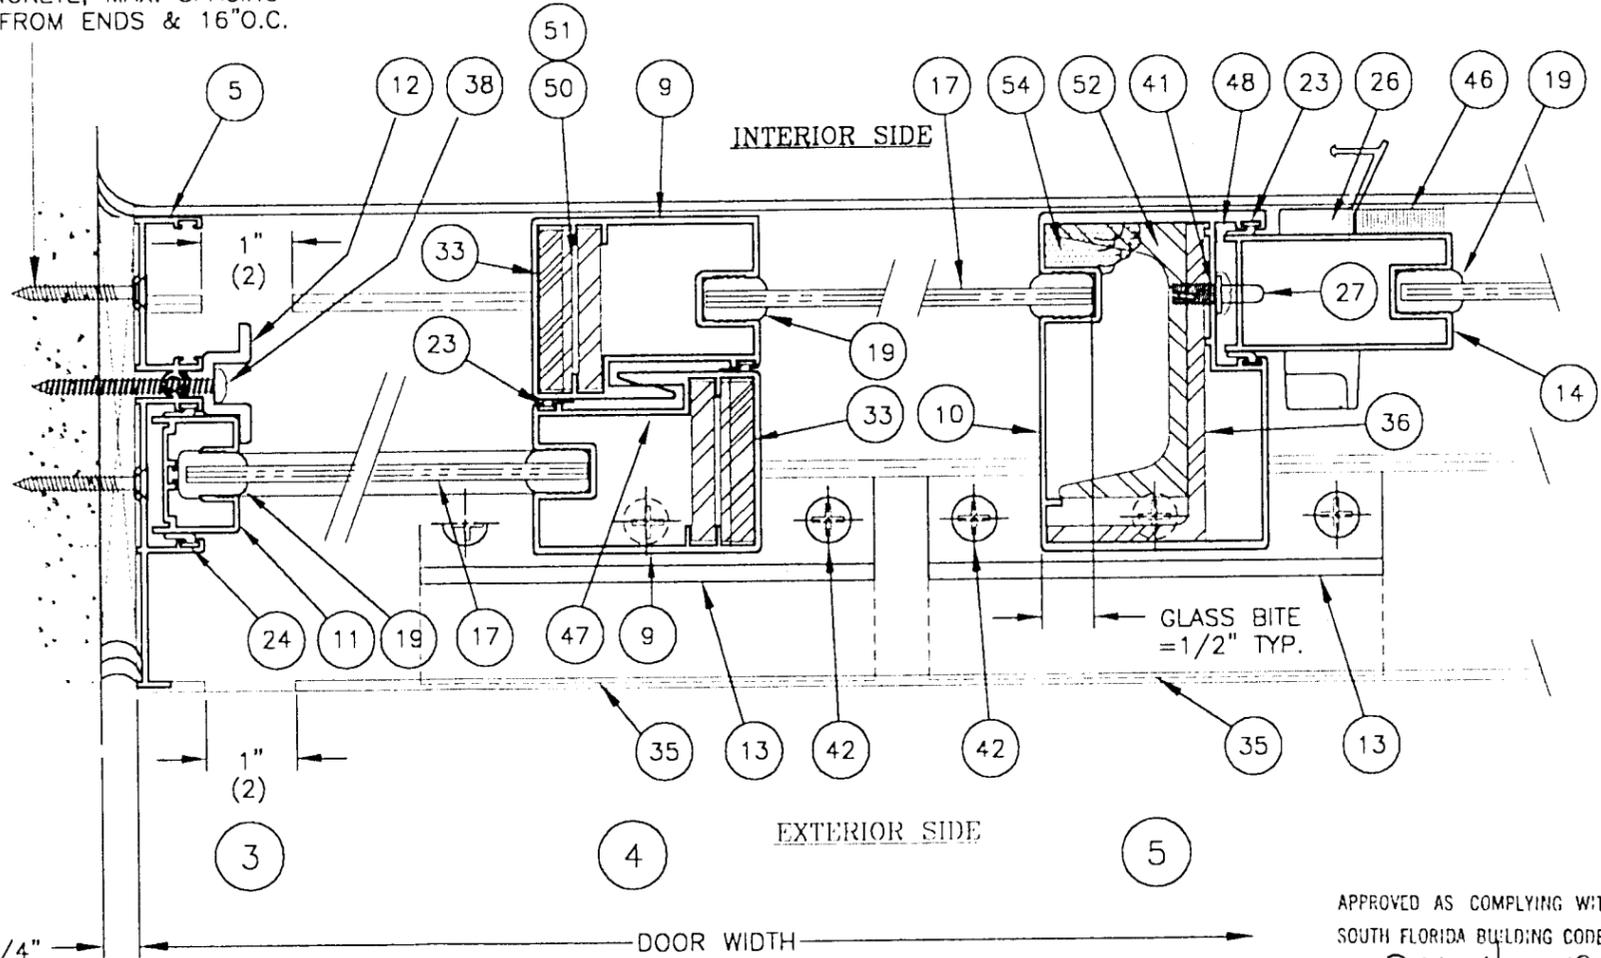

GLASS BITE  
= 1/2" TYP.

TEST #	DESIGNATION	D.P. (PSF)	W.T.P.
FTL# 1743	HEAVY REINFORCEMENT	+110.0 - 110.0	16.0 PSF


APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE December 10, 1998  
BY [Signature]  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 97-1027.05

Miami Wall Systems, Inc.  
701 West 26th Street  
Miami, Florida 33135  
Phone: (305) 888-2870 Fax: (305) 888-3058


SGD SERIES 100  
STANDARD INSTALLATION  
DETAILS  
HEAVY REINFORCEMENT

REV. NO.	DATE	DESCRIPTION


drawing no.  
**MWS-100**  
sheet 1 of 8

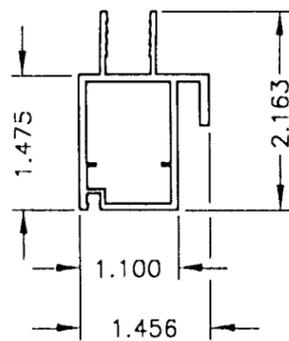


**MOV. BOTTOM RAIL**  
DIE# 100-017  
MATERIAL: ALUMINUM  
ALLOY: 6063-T6  
TYPICAL WALL:.062

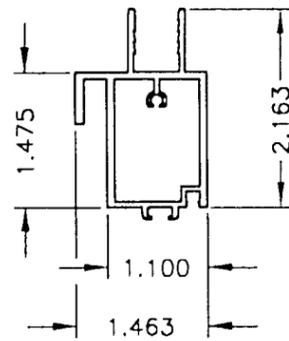

**FXD. BOTTOM RAIL**  
DIE# 100-025  
MATERIAL: ALUMINUM  
ALLOY: 6063-T6  
TYPICAL WALL:.062




**TRACK ANCHOR**  
DIE# 100-028  
MATERIAL: ALUMINUM  
ALLOY: 6005-T5  
TYPICAL WALL:  
.178-.188

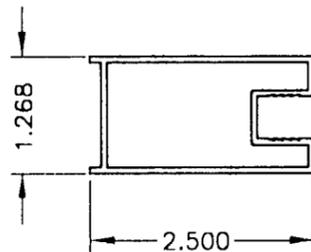

**LOCK STILE**  
DIE #100-007  
MATERIAL: ALUMINUM  
ALLOY: 6063-T6  
TYPICAL WALL:.062

1/4"Øx1 3/4" TAP-CON,  
1 1/4" MIN. EMBEDMENT INTO  
CONCRETE, MAX. SPACING=  
7" FROM ENDS & 16"O.C.

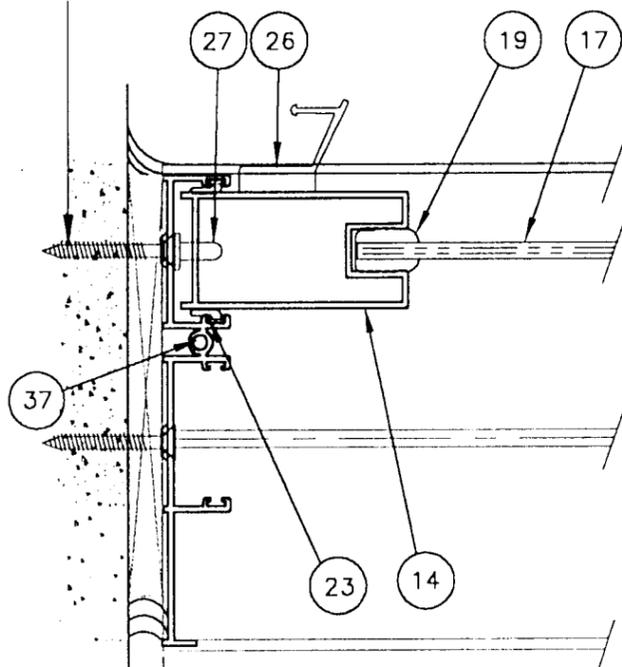

6

NOTE:  
DETAIL #6 IS COMMON TO ALL  
LEVELS OF REINFORCEMENT

MAX.  
SHIM=  
1/4" → DOOR WIDTH →

PANEL SIZE INCHES	DESIGN PRESSURE PSF	NO. OF ANCHOR SCREWS IN FRAME							ALL JAMBS DBL.ROWS
				HEAD AND SILL					
WIDTH/HEIGHT	EXTERIOR	INTERIOR	OX/XO	XX	OXO	OXO	OOXXO	OOXXO	
<b>TEST REPORT#1797 NO REINFORCEMENT</b>									
30 x 79 1/8	63.3	63.3	5	5	8	10	13	16	12
36 x 79 1/8	63.3	63.3	6	6	9	12	16	19	12
48 x 79 1/8	63.3	63.3	8	8	12	16	20	24	12
30 x 95 1/8	63.3	63.3	5	5	8	10	13	16	14
36 x 95 1/8	63.3	63.3	6	6	9	12	16	19	14
48 x 95 1/8	63.3	63.3	8	8	12	16	20	24	14
30 x 109 1/8	63.3	63.3	5	5	8	10	13	16	16
36 x 109 1/8	63.3	63.3	6	6	9	12	16	19	16
48 x 109 1/8	63.3	63.3	8	8	12	16	20	24	16
<b>TEST REPORT#1782 LIGHT REINFORCEMENT</b>									
30 x 79 1/8	73.0	73.0	5	5	8	10	13	16	12
36 x 79 1/8	73.0	73.0	6	6	9	12	16	19	12
48 x 79 1/8	73.0	73.0	8	8	12	16	20	24	12
30 x 95 1/8	73.0	73.0	5	5	8	10	13	16	14
36 x 95 1/8	73.0	73.0	6	6	9	12	16	19	14
48 x 95 1/8	73.0	73.0	8	8	12	16	20	24	14
30 x 109 1/8	73.0	73.0	5	5	8	10	13	16	16
36 x 109 1/8	73.0	73.0	6	6	9	12	16	19	16
48 x 109 1/8	73.0	73.0	8	8	12	16	20	24	16
<b>TEST REPORT#1776 MEDIUM REINFORCEMENT</b>									
30 x 79 1/8	85.3	85.3	5	5	8	10	13	16	12
36 x 79 1/8	85.3	85.3	6	6	9	12	16	19	12
48 x 79 1/8	85.3	85.3	8	8	12	16	20	24	12
30 x 95 1/8	85.3	85.3	5	5	8	10	13	16	14
36 x 95 1/8	85.3	85.3	6	6	9	12	16	19	14
48 x 95 1/8	85.3	85.3	8	8	12	16	20	24	14
30 x 109 1/8	85.3	85.3	5	5	8	10	13	16	16
36 x 109 1/8	85.3	85.3	6	6	9	12	16	19	16
48 x 109 1/8	85.3	85.3	8	8	12	16	20	24	16
<b>TEST REPORT#1743 HEAVY REINFORCEMENT</b>									
30 x 79 1/8	106.7	110.0	5	5	8	10	13	16	12
36 x 79 1/8	106.7	110.0	6	6	9	12	16	19	12
48 x 79 1/8	106.7	110.0	8	8	12	16	20	24	12
30 x 95 1/8	106.7	110.0	5	5	8	10	13	16	14
36 x 95 1/8	106.7	110.0	6	6	9	12	16	19	14
48 x 95 1/8	106.7	110.0	8	8	12	16	20	24	14
30 x 109 1/8	106.7	110.0	5	5	8	10	13	16	16
36 x 109 1/8	106.7	110.0	6	6	9	12	16	19	16
48 x 109 1/8	106.7	110.0	8	8	12	16*	20*	24*	16

NOTES:

- 1) POSITIVE DESIGN PRESSURE LIMITED BY WATER INFILTRATION TEST AT 16.0 PSF.
- 2) NUMBER OF ANCHOR CALCULATED NOT TO EXCEED AVERAGE SPACING ON TEST UNIT.
- 3) CALCULATION ARE BASE ON NOMINAL PANEL WIDTH AND ACTUAL PANEL HEIGHT.
- 4) \* WHEN USING WOOD SCREWS: ADD (2) MORE ANCHORS

\*SEE NOTE 4

**PRODUCT RENEWED**

ACCEPTANCE No. 61-1108-02

EXPIRATION DATE December 10, 2006

By *[Signature]*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE  
SOUTH FLORIDA BUILDING CODE  
DATE December 10, 1998  
BY *[Signature]*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 97-1027-25

Miami Wall Systems, Inc.  
701 West 25th Street  
Ft. Lauderdale, Florida 33304  
Phone: (305) 888-2300 Fax: (305) 888-3058

SGD SERIES 100  
STANDARD INSTALLATION  
DETAIL  
INSTAL. FASTENER CHART


REV'S	DATE	DESCRIPTION

date: 09/22/98  
checked by: NONE  
design by: J.S.  
drawn by: J.S.  
created by: F.C.

drawing no.  
**MWS 100**  
sheet 6 of 8

ITEM NO.	PART NO.	REQ'D	PART NAME	REMARKS
1	100-021	1	FRAME HEAD FOR RECEPTOR	FRAME
2	100-018	1	FRAME HEAD W/SCREEN	FRAME (ALTERNATE)
3	100-010	1	FRAME RECEPTOR	FRAME
4	100-016	1	FRAME SILL	FRAME
5	100-019	2	FRAME JAMB	FRAME
6	100-002	4	TOP RAIL	PANEL
7	100-017	2	BOTTOM RAIL, MOVING	PANEL
8	100-025	2	BOTTOM RAIL, FIXED	PANEL
9	100-008	4	INTERLOCK STILE	PANEL
10	100-012	1	FEMALE ASTRAGAL	PANEL
11	100-009	2	FIXED JAMB STILE	FIXED PANEL
12	100-020	2 PER JAMB	JAMB STILE RETAINER CLIP, 3" LG.	FXD. JAMB Ø3 1/2" FROM ENDS
13	100-028	SEE NOTE #4	TRACK ANCHOR, 6 1/2" LG.	ASTRAGAL & INTRLK'S
14	100-007	1	LOCK STILE	PANEL
15				
16	TYPE 1	1	JOHSON BROS., S.S. TRACK CAP	FRAME SILL
17		4	1/4" TEMP. GLASS	PANELS
18	G-131	SINGLE ROW	PROTOTYPE, PLS. VINYL FLAP	BOT. RAIL PANELS
19	G-116	AS REQ'D	PROTOTYPE, GLAZING VINYL	PANELS/GLASS
20	GE 1200	AS REQ'D	SEALANT	PANELS & FR. CORNERS
21	G-117	DOUBLE ROW	BULB VINYL, PROTOTYPE PLAST.	HD RECEPTOR
22	G-127	DOUBLE ROW	DS. BROWN, VINYL FLAP	TOP RAILS
23	G-115A	SINGLE ROW	PROTOTYPE PLS., FLAP VINYL	INTERLOCK STILES
24	G-115A	DOUBLE ROW	PROTOTYPE PLS., FLAP VINYL	FRAME JAMB
25	7450-6011-4	SINGLE ROW	FIN SEAL PILE SCHELEDEL	FRAME SILL
26	1A-003B-01	1	DNS LOCK\HANDEL ASSY	CRESTLINE
27		1	DNS STEEL KEEPER	FEMALE ASTG. STILE
28	#4284	4	DELMAR TANDEM WHEELS	MOV. BOT. RAILS
29		2	STL BAR, 3/4"x1"x FULL WIDTH	MOV. BOTOM RAILS(H. REINF'T)
30		4	AL. CHANEL, 7/8"x1"x7/8"x1/8"	TOP RAIL, PANELS.(H. REINF'T)
31		2	AL. CHN'L, 3/4"x1"x3/4"x1/8"x4"LG.	LCKST'L, TOP RAIL END(M. REINF'T)
32		4	AL. PLATE, 15/16x.108x2 1/8"LG.	LCKST'L ENDS, PANELS.**
33		4	AL. BAR, 1.844x1/4"x4"LG.	TOP INTRLCK'S, PANELS.**
34				
35		SEE NOTE #3	AL. PLATE 1/4"x4"x6 1/2"LG.	FR. SILL AT INTRL'K/ASTRG'L
36		1	AL. ANGLE 1 5/8x3 9/16x3/16x12"	BOT. OF FEM. ASTRAGAL
37		4	#10x1" PH SMS SS	FRAME CORNERS (ASSY SCRW)
38		4	#10x2 1/2" PH SMS	FX'D JAMB, W/ITEM#12
39		16	#10x1" PH SMS SS	PANEL CORNERS (ASSY SCRW)
40		4	#10-32x1/2" PH SMS SS	BOT. LCKST'L W/ITEM#32(H REINF'T)
41		2	1/4"-20x3/4" PH MS	BOT END ASTRAGAL(INTERIOR)
42		3 PER ANG.	1/4"-20x1/2" PH SMS SS	FR SILL W/ITEM#13
43		SEE NOTE #3	#14x1" PH SMS SS	HD. RECEPTOR @ EA, INT'K/ASTG'L
44				
45	#100-5	8	PLASTIC GUIDE	M+M PLASTICS, TOP RAIL
46		1	PAD PILE, 1/2x1 3/4x2 1/2"	ULTRA-PLUG,FR. SILL LOCK STILE
47		1 EA.	PAD PILE, 7/8x2 1/2x5/8"	SILL, BELOW INTERLOK
48		1	CLS'D CELL PAD, 1/2x8 1/2x1/4"	AT SILL UNDER FEM. ASTRAGAL
49				
50		4	STL BAR, 1/4'x1 3/4"xP. HGT.	AT INT'K STILE*
51		4	STL BAR, 3/8'x1 3/4"xP HGT	AT INT'K STILE(FULL LGTH) **
52		1	STL STR'L CHN'L, 3"x4.1#xP HGT	AT ASTR'L STILE9FULL LGTH)
53				
54		AS REQ'D	EXP. FOAM, GREAT-STUFF	AT TOP & BOT. OF ASTRAGALS
55				

NOTES: (1) \*\* BOTH REINFORCEMENTS MEDIUM & HEAVY. (4) ONE AT EA SET OF INTLK'S AND EA. ASTRAGAL  
(2) \* BOTH REINFORCEMENTS LIGHT & HEAVY.  
(3) TWO AT EA. SET OF INTLK'S AND EA. ASTRAGAL

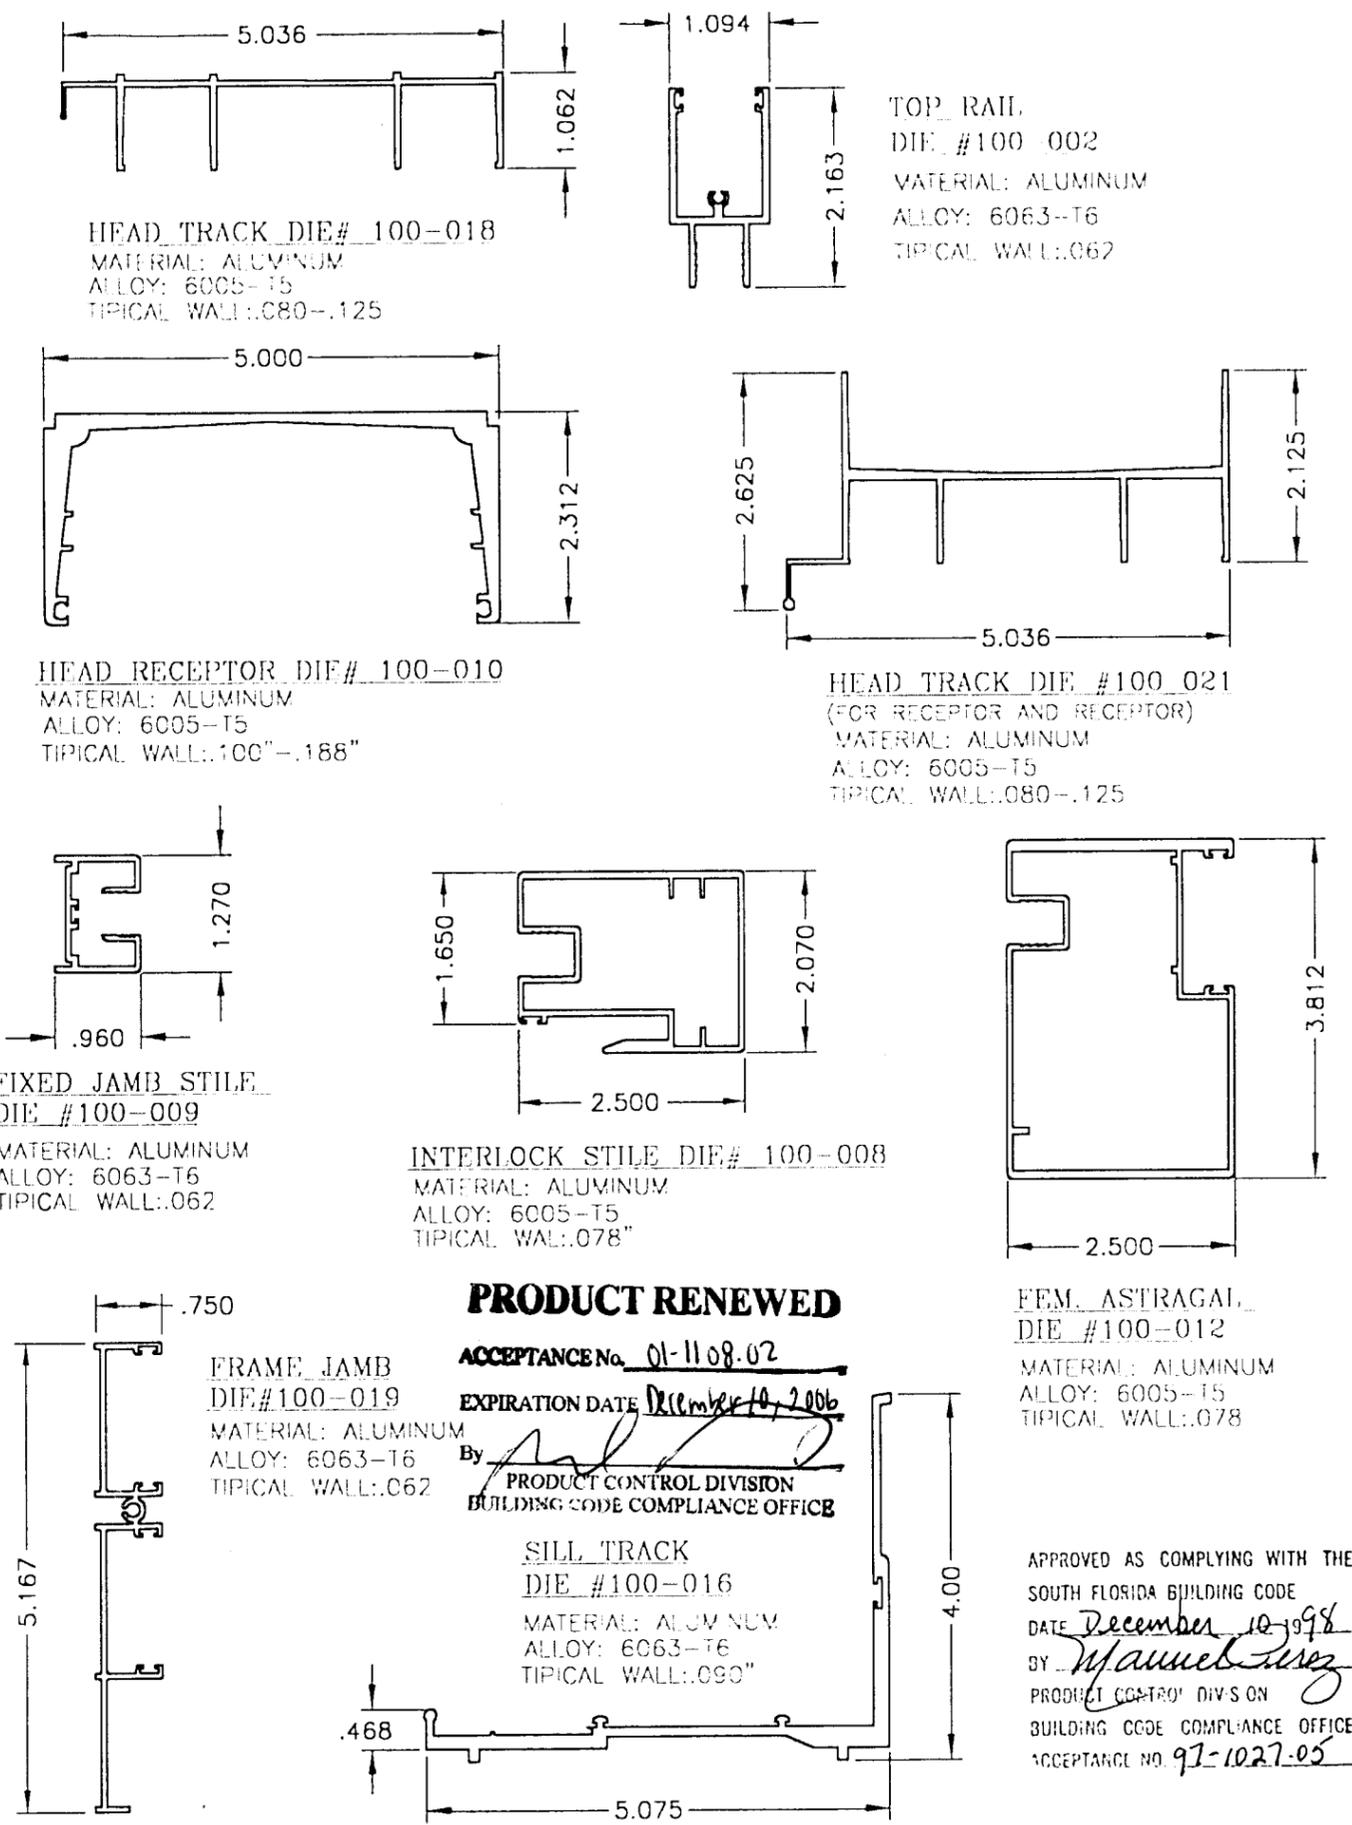

**PRODUCT RENEWED**  
ACCEPTANCE No. 01-1108-02  
EXPIRATION DATE December 10, 2006  
By *[Signature]*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE



APPROVED AS COMPLYING WITH THE SOUTH FLORIDA BUILDING CODE  
DATE December 10, 1998  
BY *[Signature]*  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
ACCEPTANCE NO. 97-1027-05

Miami Wall Systems, Inc.  
701 West 25th Street  
Miami, Florida 33135  
Phone: (305) 555-2150 Fax: (305) 555-2152

SGD SERIES 100  
BILL OF MATERIAL  
EXTRUSION SUMMARY

REV'S	DATE	DESCRIPTION

DATE: 05/27/98  
DRAWN BY: MWS  
CHECKED BY: MWS  
DRAWING NO. MWS 100  
SHEET 7 OF 8

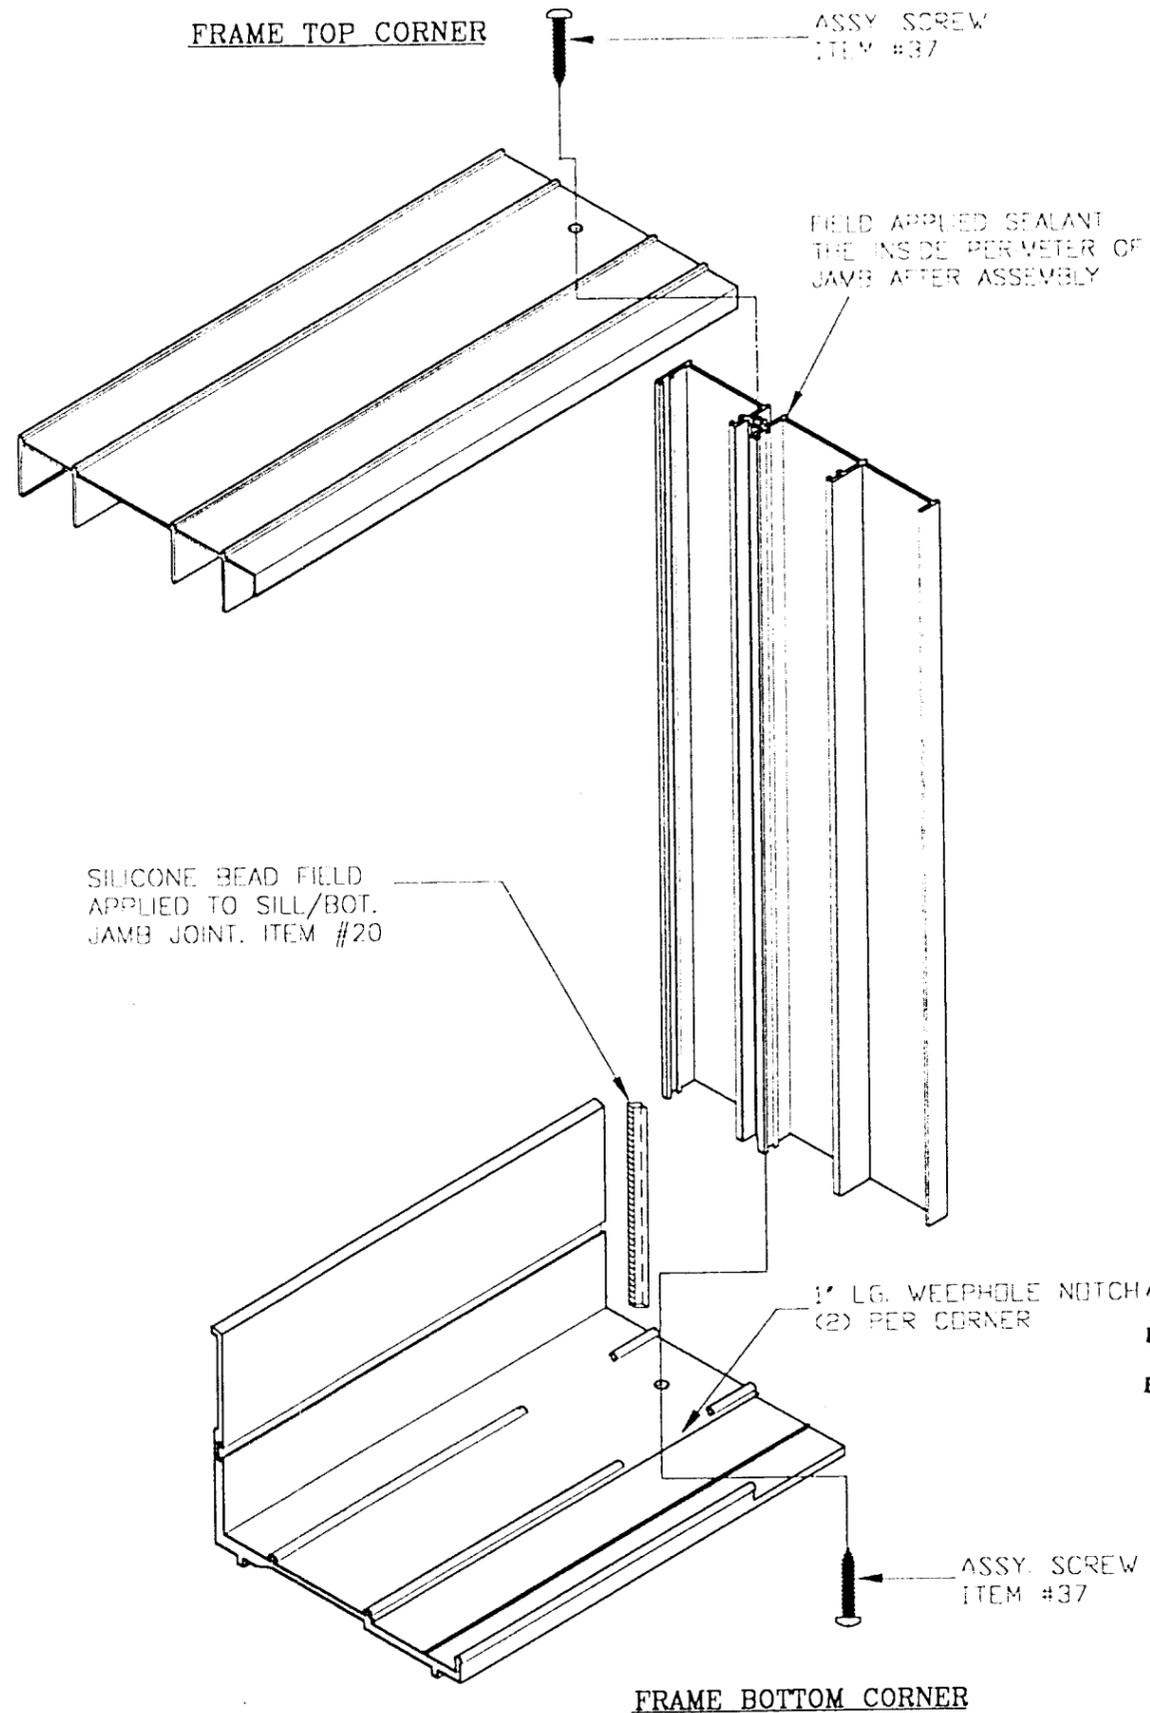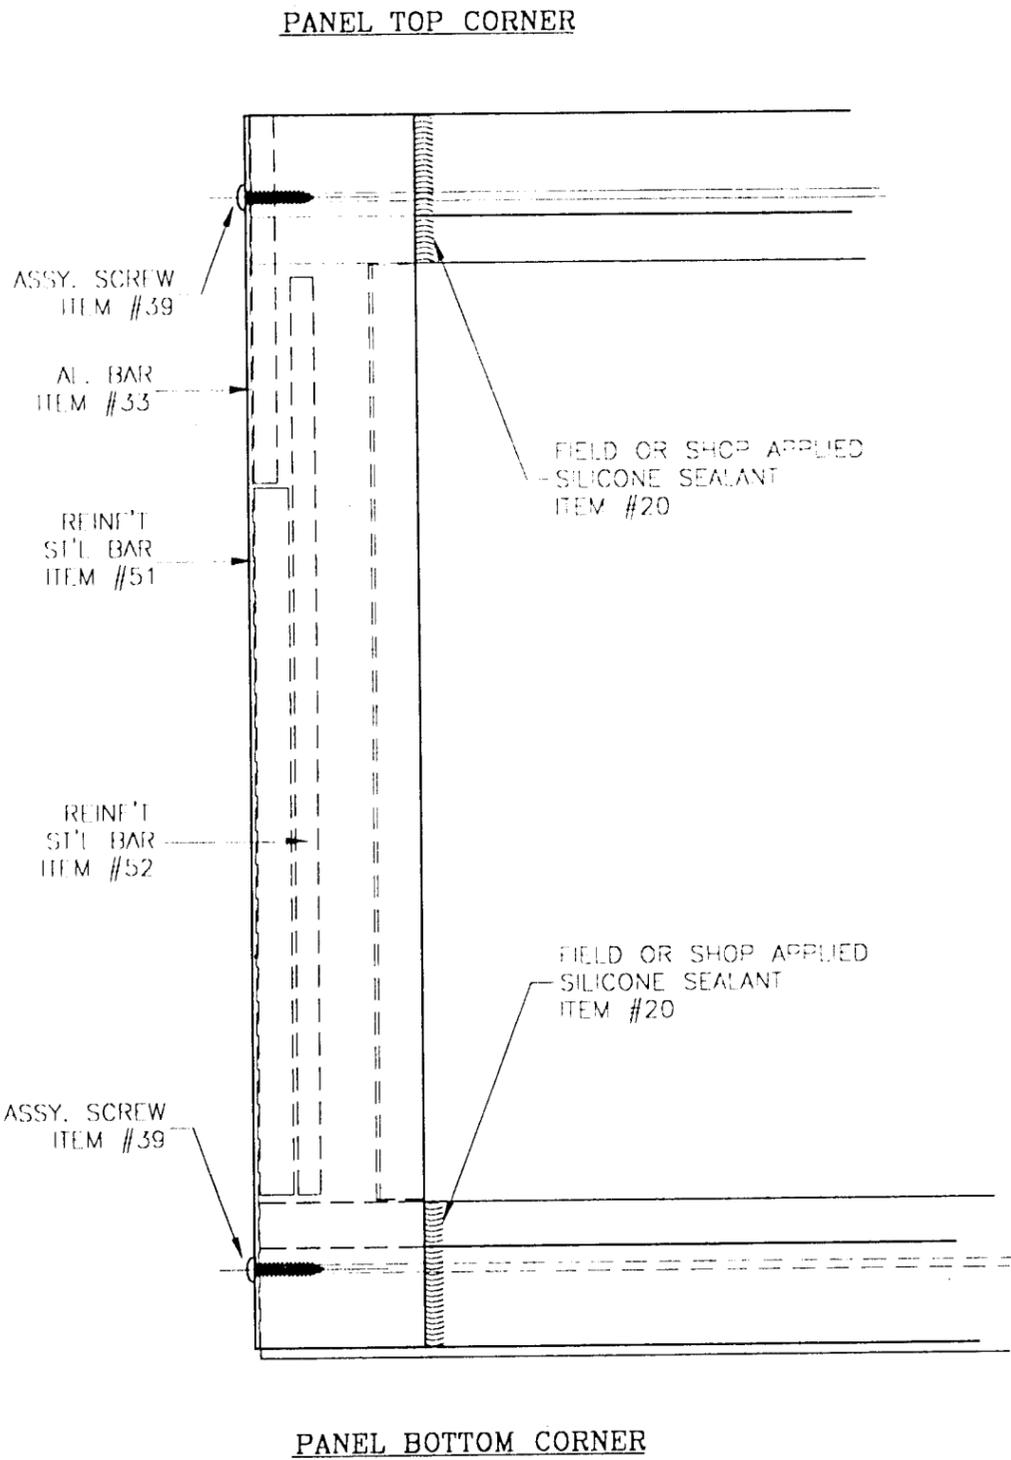

**PRODUCT RENEWED**  
 ACCEPTANCE No. 01-1108-02  
 EXPIRATION DATE December 10, 2006  
 By [Signature]  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE

APPROVED AS COMPLYING WITH THE  
 SOUTH FLORIDA BUILDING CODE  
 DATE December 10 1998  
 BY Manuel Perez  
 PRODUCT CONTROL DIVISION  
 BUILDING CODE COMPLIANCE OFFICE  
 ACCEPTANCE NO. 97-1027-05

Miami Wall Systems, Inc.  
 701 West 25th Street  
 Miami, Florida 33130  
 Phone: (305) 888-2100 Fax: (305) 888-3033

SGD SERIES 100  
 STANDARD CORNER  
 DETAILS

rev's	no.	date	description

date: 03/22/98  
 sec:  
 design by:  
 order by: G.  
 created by: F.C.  
 drawing no.  
 MWS-100  
 sheet 8 of 8