



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

**Jeld-Wen, Inc.  
31725 Highway 97 N.  
Chiloquin, OR 97624**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series "DoorCraft@" 6'8" W/E Inswing Opaque Insulated Steel Door w/wo Sidelites-Impact Resistant**

**APPROVAL DOCUMENT:** Drawing No. S-2166, dated 11/15/01, with revision 1 dated 03/14/02, titled "Inswing Opaque Wood Edge Steel Door up to 107" x 6-8 Unit", sheets 1 through 7, prepared by R. W. Building Consultants, Inc., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 01-1218.06  
Expiration Date: August 22, 2007  
Approval Date: August 22, 2002  
Page 1**

# DoorCraft® WOOD EDGE

WOOD EDGE OPAQUE INSULATED STEEL DOOR  
INSWING 6-8 UNITS W/AND W/OUT SIDELITES

### GENERAL NOTES

- THIS PRODUCT IS DESIGNED TO COMPLY WITH FLORIDA BUILDING CODE.
- WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
- PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
- THIS PRODUCT DOES NOT MEETS THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES"
- THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE FOR SIDELITES ONLY.
- SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

### RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

#### Door Leaf Construction:

**Face sheets:** 24 ga. (0.020") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength  $F_y(\text{ave.})=25,675$  psi.  
**Core design:** Expanded polystyrene with 1.0 to 1.25 lbs. density, by Jeld-Wen, Inc.



**Panel Construction:** The active and inactive panels are constructed from 24GA. (0.020" min.) galvanized steel. The face sheet top and bottoms are bent 90° over the top and bottom rails. The top rail consists of LVL measuring 1.67" x 1.042". The bottom rail is roll formed 0.021" galvanized steel measuring 1.67" x 1.21" with a 1.645" x 3.0" x 0.831" piece of pressed fiber board at each corner attached w/0.5" x 2.0" wire staples. The sides of the face sheet are roll formed into the LVL latch stile and Ponderosa Pine hinge stile which measure 1.67" x 1.0". The interior cavity is filled with polystyrene. The face sheet is glued to the polystyrene.

**Sash Construction:** The sash is constructed from 24GA. (0.020" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and and glued to it. The sashes are routed to receive the ODL (HP Polypropylene Thermofil-P6-30FM0391) lite frame. The units are glazed with .125" tempered glass. The lite frames are sealed with QSD glazing compound on the exterior.

**Frame Construction:** The frames are constructed from Ponderosa Pine jambs measuring 4.563" x 1.25". The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units use a slope adjustable aluminum threshold measuring 4.562" x 1.173". The threshold is attached to the frame with (3) 16GA. 2" x 7/16" crown wire staples.

### TABLE OF CONTENTS

| SHEET # | DESCRIPTION                                 |
|---------|---|
| 1       | GENERAL NOTES AND TYPICAL ELEVATIONS        |
| 2       | VERTICAL CROSS SECTIONS & BILL OF MATERIALS |
| 3       | HORIZONTAL CROSS SECTIONS                   |
| 4       | HORIZONTAL CROSS SECTIONS & NOTES           |
| 5       | ANCHORING LOCATIONS & DETAILS               |
| 6       | ANCHORING LOCATIONS & GLAZING DETAIL        |
| 7       | UNIT COMPONENTS                             |

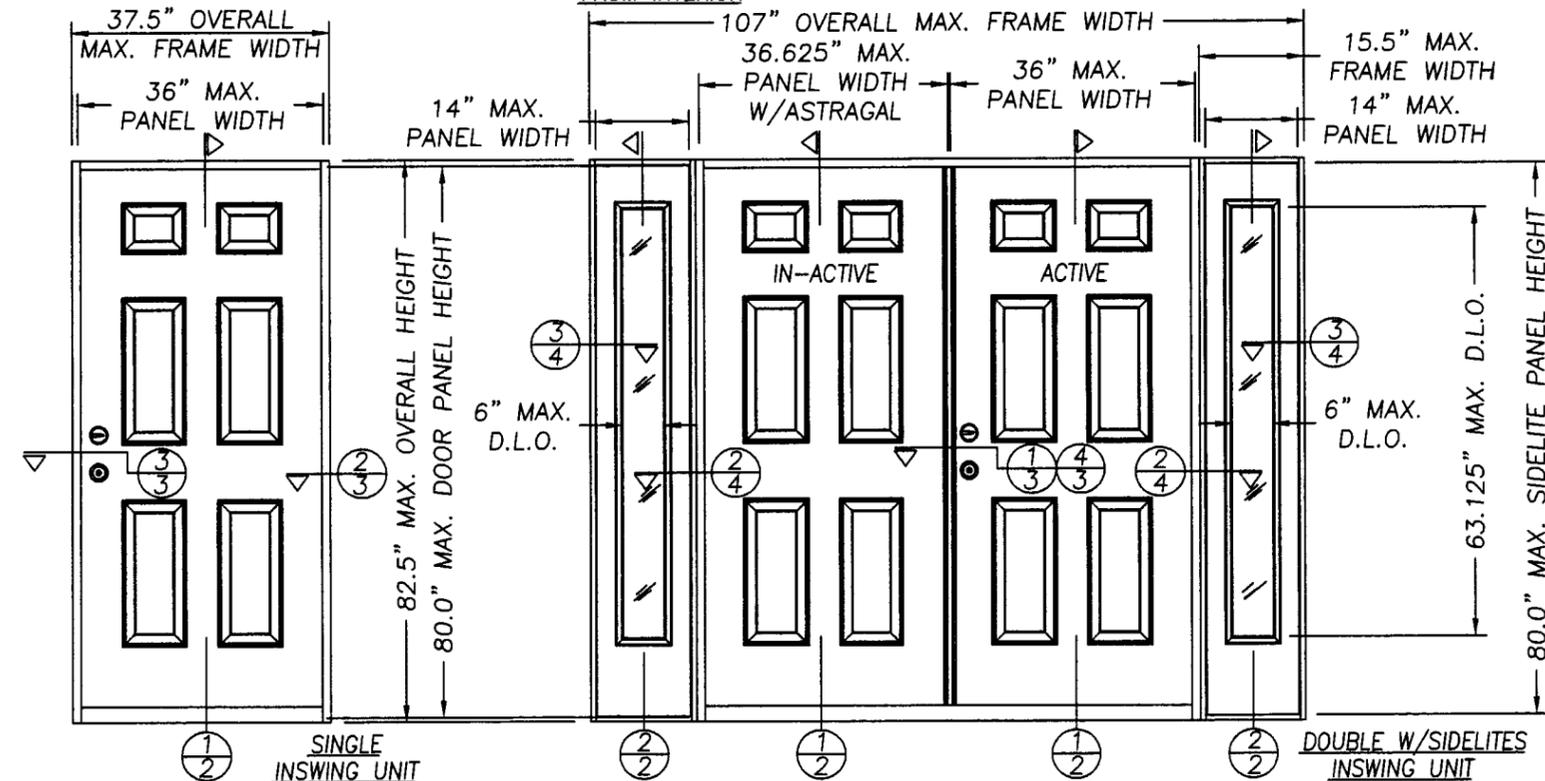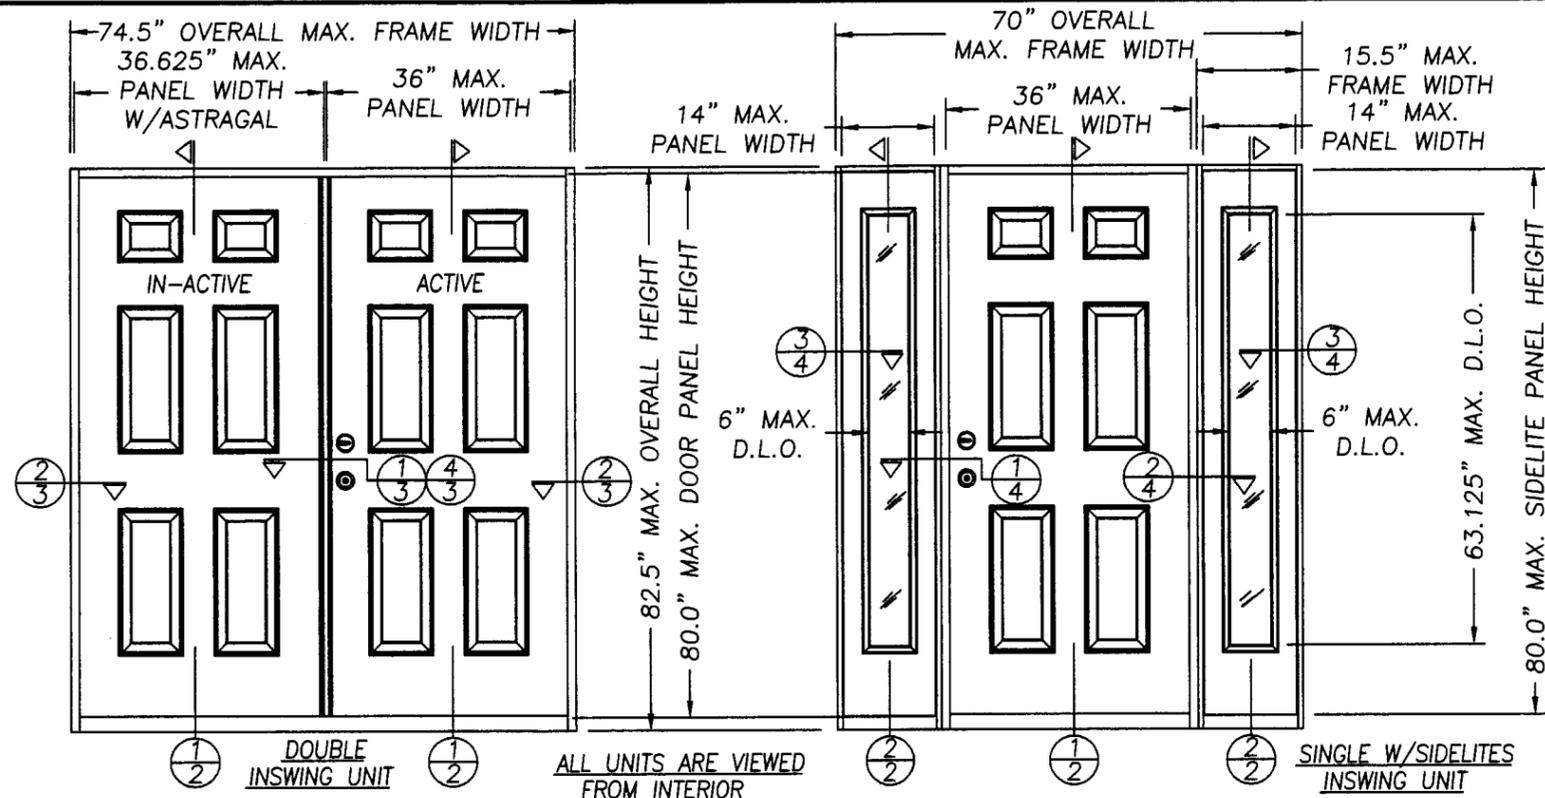

| DESIGN PRESSURE RATING<br>WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED |                                |          |                           |
|--|--------------------------------|----------|---------------------------|
| UNIT TYPE  | WITH WINDJAMBER II<br>ASTRAGAL |          | WITH IMPERIAL<br>ASTRAGAL |
| SINGLE & DOUBLE  | +70.0psf                       | -70.0psf | +57.0psf -57.0psf         |
| SINGLE & DOUBLE W/SIDELITES  | +70.0psf                       | -70.0psf | +57.0psf -57.0psf         |

Approved as complying with the Florida Building Code  
Date **AUG. 22, 2002**  
NOAH **01-1218.06**  
Miami Dade Product Control  
Division  
By *[Signature]*

DATE: 11/15/01

SCALE: N.T.S.

DWG. BY: WLN

CHK. BY: RW

DRAWING NO.: S-2166

SHEET 1 OF 7

PRODUCT:  
INSWING OPAQUE WOOD  
EDGE STEEL DOOR UP TO  
107" x 6-8 UNIT

PART OR ASSEMBLY:


GENERAL NOTES &  
TYPICAL ELEVATIONS

| NO. | DATE     | GENERAL REVISION | TJH | BY |
|-----|----------|------------------|-----|----|
| 1   | 03/14/02 |                  |     |    |


**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

DATE: 11/15/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2166  
SHEET 1 OF 7

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

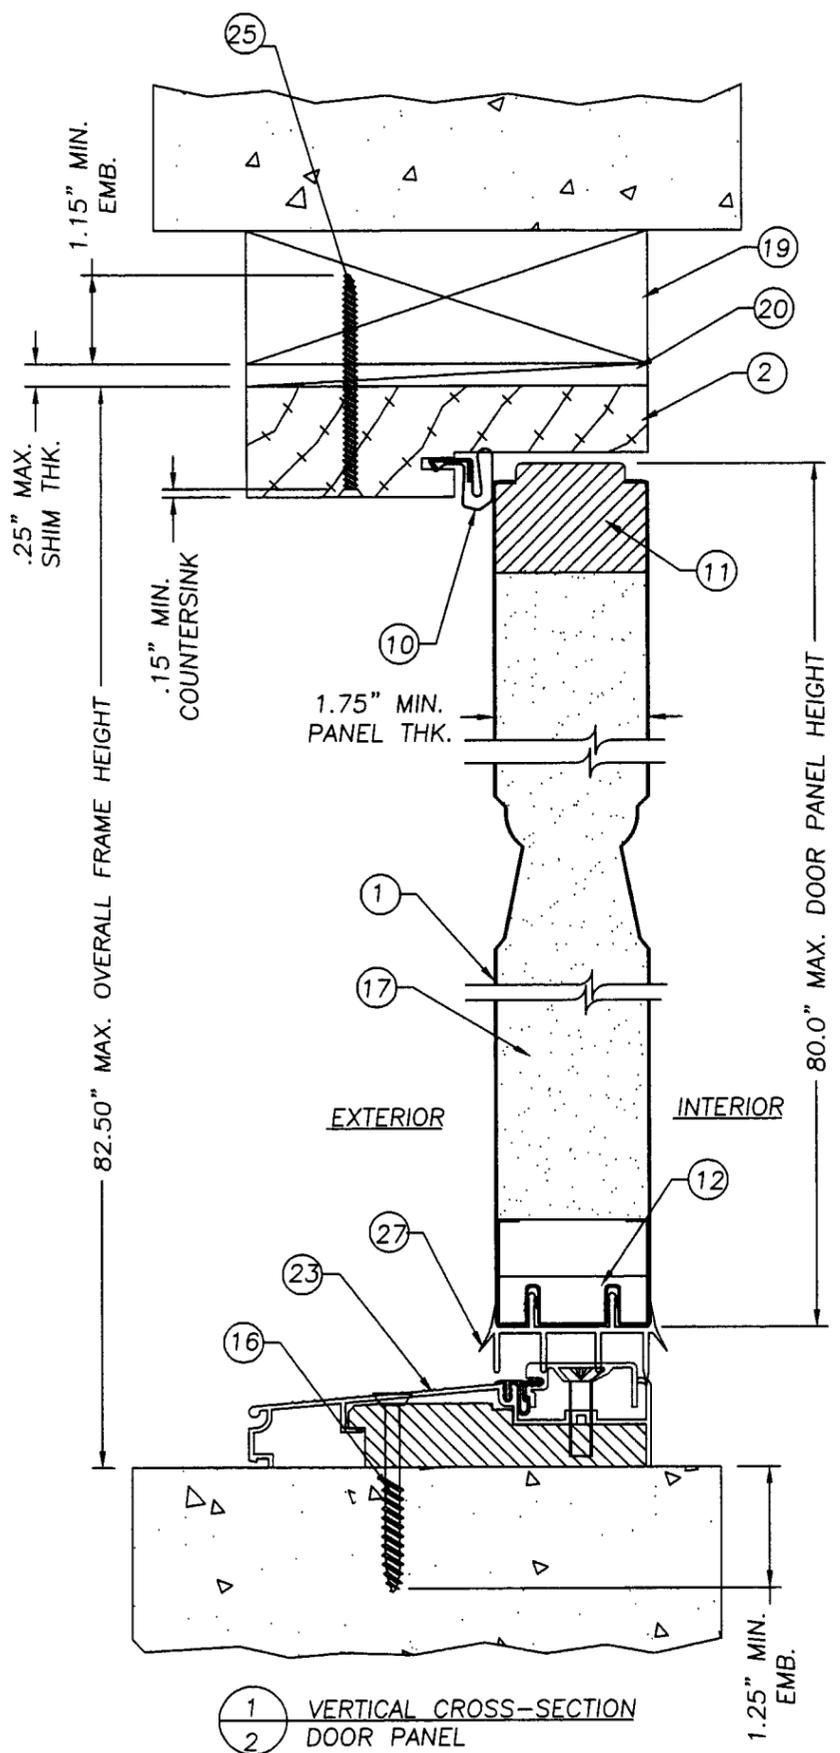

1 VERTICAL CROSS-SECTION DOOR PANEL  
2

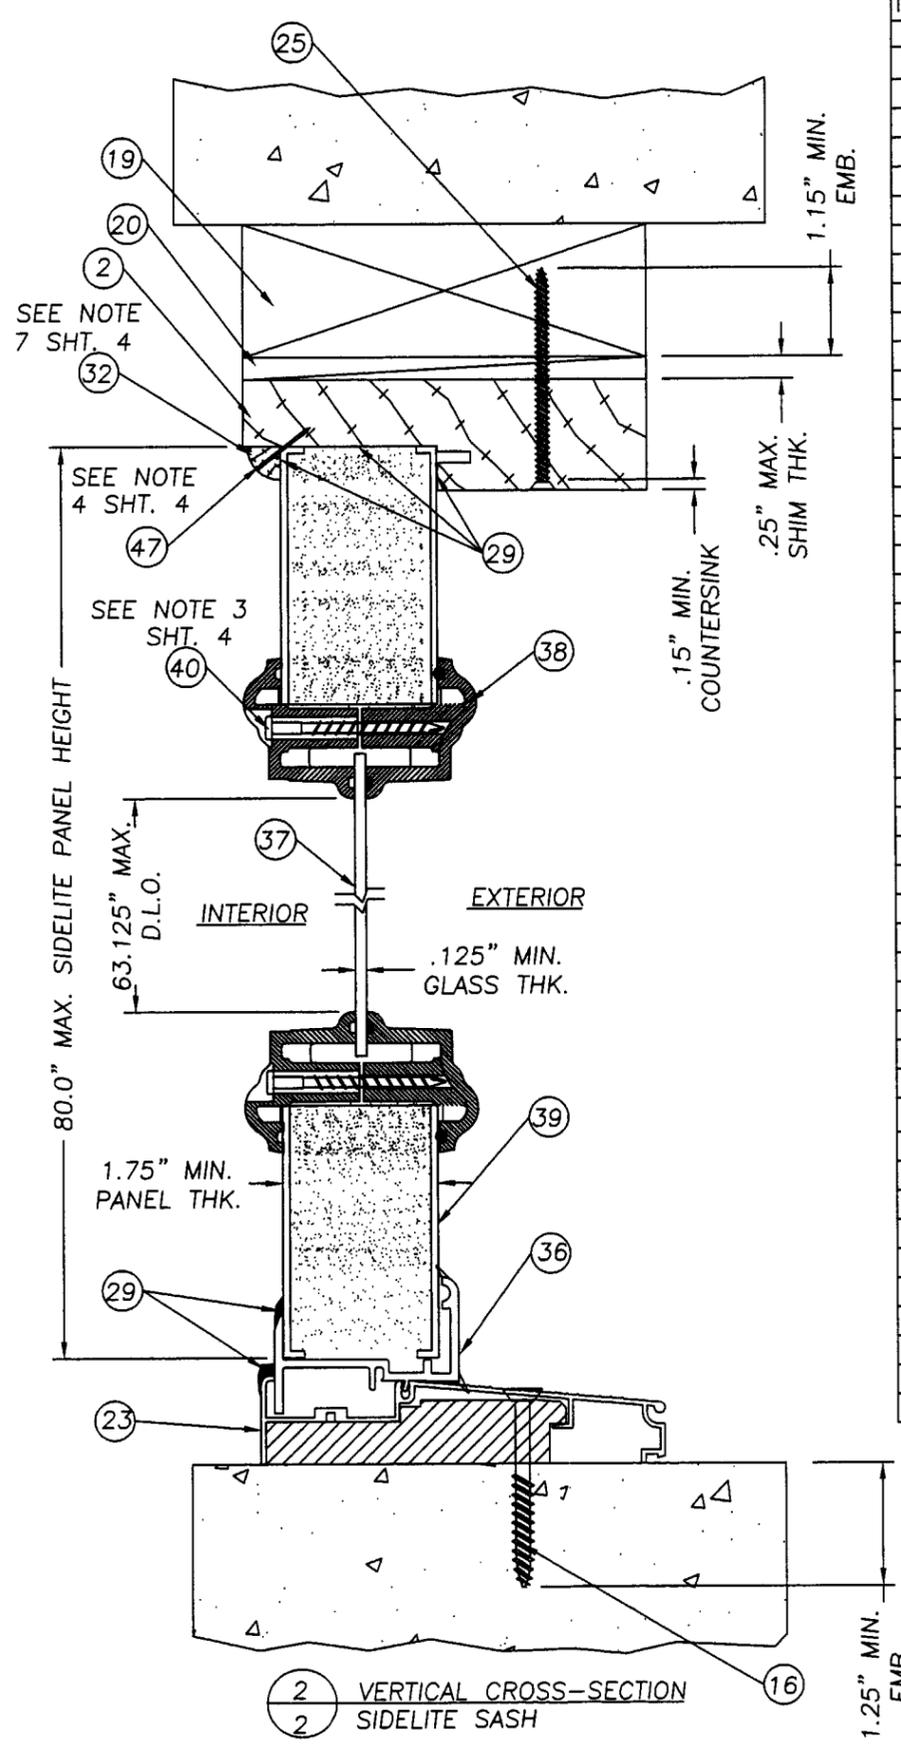

2 VERTICAL CROSS-SECTION SIDELITE SASH  
2

| ITEM | DESCRIPTION  | MATERIAL  |
|------|--|-----------|
| 1    | DOOR, WOOD EDGE 1.75" THK. 24GA. (.021" MIN.)                        | STEEL     |
| 2    | HEAD JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)           | PINE      |
| 3    | HINGE JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)          | PINE      |
| 4    | SIDELITE BLANK JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE) | PINE      |
| 5    | 4" x 4" BUTT HINGE 12ga. (.097" HAGER)                               | STEEL     |
| 6    | #10 x 1" PFH WOOD SCREW (HINGE TO DOOR)                              | STEEL     |
| 7    | LVL LATCH SIDE STILE (1.67 x 1.0")                                   | -         |
| 8    | LATCH JAMB (1 1/4" x 4 9/16" PONDEROSA FINGER JOINTED PINE)          | PINE      |
| 9    | 1/4" x 1 3/8" WOOD MULLION CAP                                       | WOOD      |
| 10   | COMPRESSION WEATHERSTRIP (SCHLEGEL Q-LON QDS 650)                    | FOAM      |
| 11   | TOP RAIL (1.67" x 1.0")  | WOOD      |
| 12   | BOTTOM RAIL (1.73" x 1.21" x 0.021" THK. MIN. 24GA.)                 | STEEL     |
| 13   | DOOR SIDE STILE (1.67" x 1.0")                                       | WOOD      |
| 14   | #10 x 1 3/4" PFH WOOD SCREW  | STEEL     |
| 15   | WOOD LOCK BLOCK (1.71" x 4.0" x 11.875")                             | WOOD      |
| 16   | 1/4" x 2 1/4" TAPCON   | STEEL     |
| 17   | EXPANDED POLYSTYRENE (1.0 to 1.25 lb. DENSITY) BY JELD-WEN           | FOAM      |
| 18   | OPTIONAL EXTRUDED ALUM. ASTRAGAL (.050" WALL IMPERIAL)               | ALUM.     |
| 19   | 2x WOOD SUB BUCK   | WOOD      |
| 20   | SHIM MATERIAL (.25" MAX. THK.)                                       | -         |
| 21   | KWIKSET TITAN 700 SERIES KNOB  | -         |
| 22   | KWIKSET TITAN 700 SERIES DEADBOLT                                    | -         |
| 23   | INSWING ADJUSTABLE THRESHOLD (.051" WALL BY PEMKO)                   | ALUMINUM  |
| 24   | # 8 x 2" PHILL. FLATHEAD WOOD SCREW                                  | STEEL     |
| 25   | # 8 x 2 1/2" PHILL. FLATHEAD WOOD SCREW                              | STEEL     |
| 26   | ASTRAGAL EXTRUDED ALUM. (WR68J WINDJAMBER II)                        | ALUM.     |
| 27   | INSWING VINYL DOOR BOTTOM SWEEP                                      | VINYL     |
| 28   | 16GA. BRAD TRIM NAIL 1" L.   | STEEL     |
| 29   | SILICONE CAULK (CR LAWRENCE 33C)                                     | SILICONE  |
| 30   | GLAZING COMPOUND (QSD BY ODL)  | SILICONE  |
| 31   | #8 x 1" PHILLIPS PANHEAD WOOD SCREW (ASTRAGAL WR68J TO DOOR)         | STEEL     |
| 32   | 3/8" x 3/8" 1/4" ROUND SIDELITE STOP                                 | WOOD      |
| 33   | GLAZING COMPOUND DOW 1199 SILICONE                                   | SILICONE  |
| 34   | SCHLAGE KNOB SET #F51  | -         |
| 35   | SCHLAGE DEADBOLT #B360   | -         |
| 36   | INSWING SIDELITE BOTTOM SEAL   | VINYL     |
| 37   | 1/8" TEMPERED GLASS (BY PPG)   | GLASS     |
| 38   | LITE FRAME (ODL HP POLY. THERMOFIL-P6-30FM0391)                      | POLYPROP. |
| 39   | STEEL SIDELITE PANEL 24GA. (.021" MIN. STEEL)                        | STEEL     |
| 40   | #8 x 1 1/2" PLASCREW SCREW (LITE FRAME)                              | STEEL     |
| 41   | #10 x 1" PFH WOOD SCREW (IMPERIAL ASTRAGAL TO DOOR)                  | STEEL     |
| 42   | YALE KNOB HERITAGE SERIES (NOT RATED ABOVE ±57 psf)                  | -         |
| 43   | YALE DEADBOLT HERITAGE SERIES NOT RATED ABOVE ±57 psf)               | -         |
| 44   | NOT USED   | -         |
| 45   | #10 x 2" PHILLIPS FLATHEAD WOOD SCREW                                | STEEL     |
| 46   | NOT USED   | -         |
| 47   | BRAD TRIM NAIL 3/4" L.   | STEEL     |
| 48   | 3/4" THK. x 4 9/16" DEEP x 82.5" PRESSURE TREATED REINFORCEMENT      | WOOD      |

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: INSWING OPAQUE WOOD EDGE STEEL DOOR UP TO 107" x 6-8 UNIT  
PART OR ASSEMBLY: VERTICAL CROSS SECTIONS & BILL OF MATERIALS

| NO. | DATE     | GENERAL REVISION | TJH | BY |
|-----|----------|------------------|-----|----|
| 1   | 03/14/02 |                  |     |    |

RW BUILDING CONSULTANTS, INC.  
813.684.3831


DATE: 10/15/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2166  
SHEET 2 OF 7

Approved as complying with the Florida Building Code  
Date AUG 22 2002  
NOA# 01-1218.06  
Miami Dade Product Control  
Division  
By [Signature]

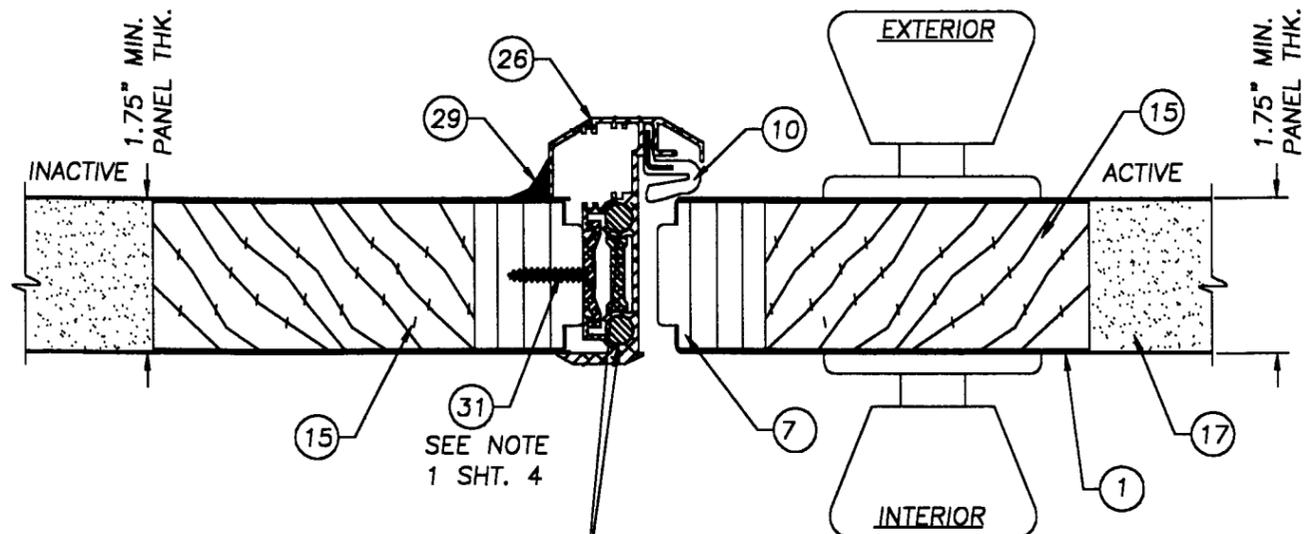


ASTRAGAL RETAINER BOLTS (4)  
 BOLTS TOTAL, (2) 8.0" L. x  
 .312" DIA. @ TOP & (2) 8.0" L.  
 x .312" DIA. @ BOTTOM

① HORIZONTAL CROSS SECTION  
 ③ AT ASTRAGAL W/ITEM #26  
 WINDJAMBER II WR68J  
 SEE DESIGN PRESSURE RATING  
 CHART SHEET 1

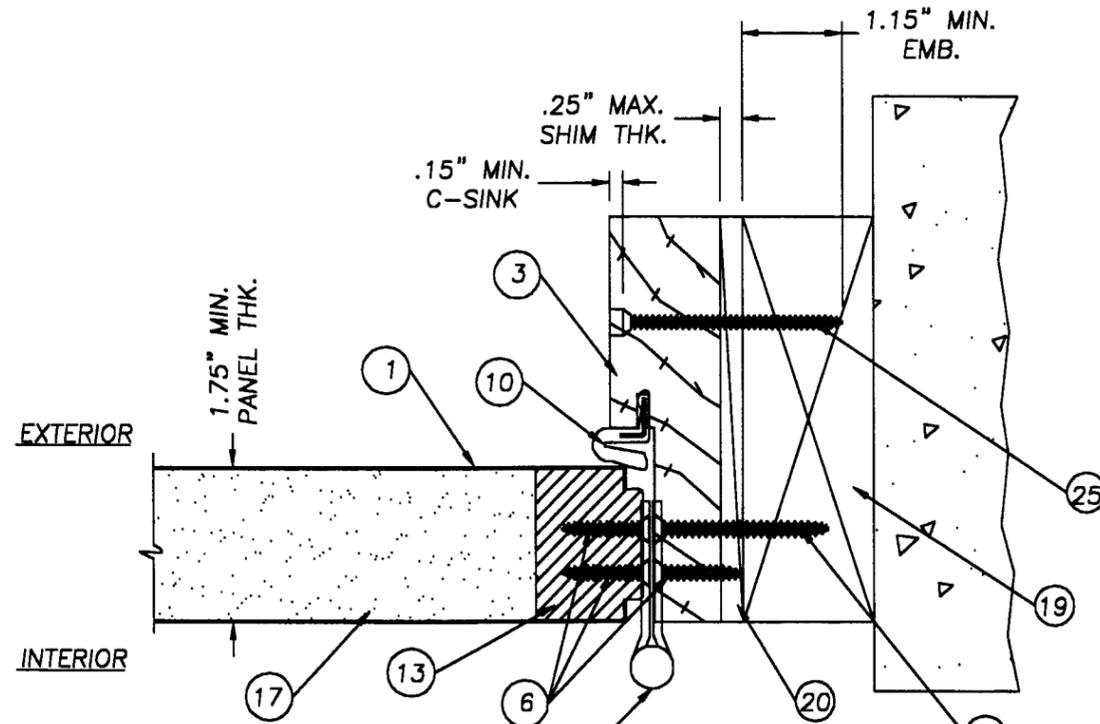


② HORIZONTAL CROSS SECTION  
 ③ HINGE JAMB TO BUCK

SEE NOTE  
 8 SHT. 4

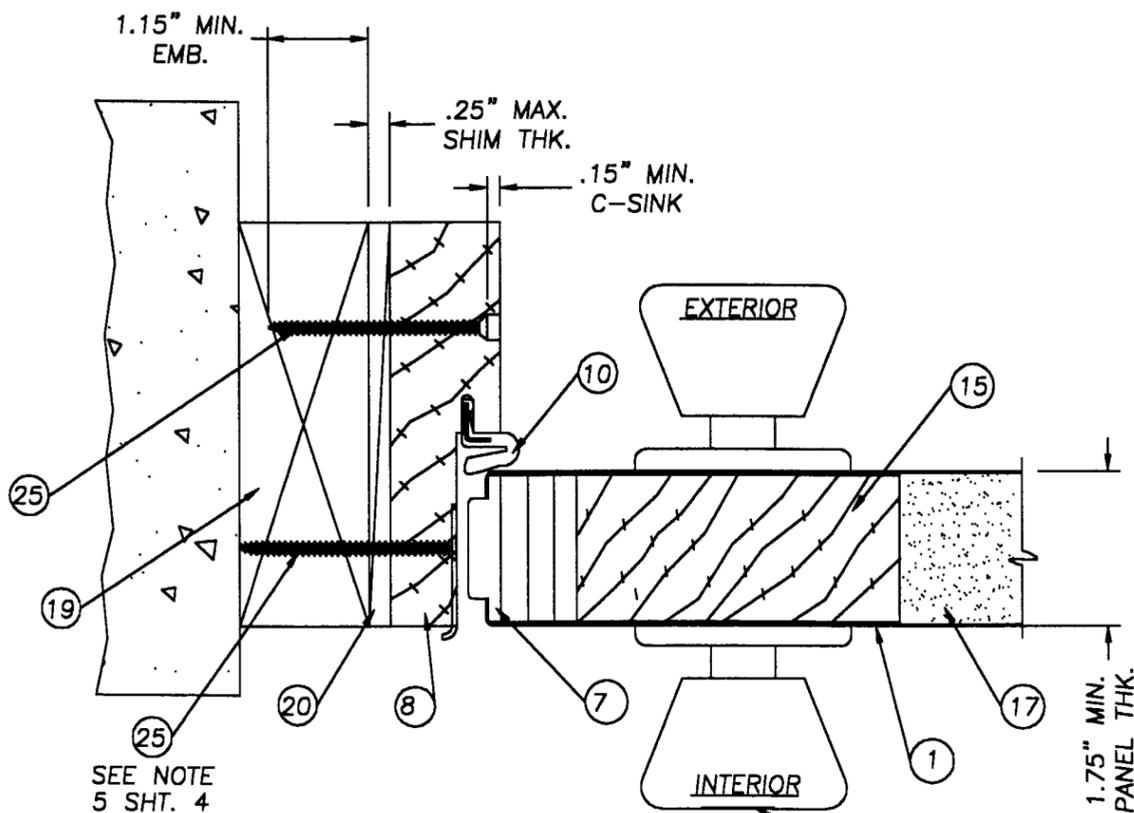

SEE NOTE  
 5 SHT. 4

③ HORIZONTAL CROSS SECTION  
 ③ LATCH JAMB TO BUCK

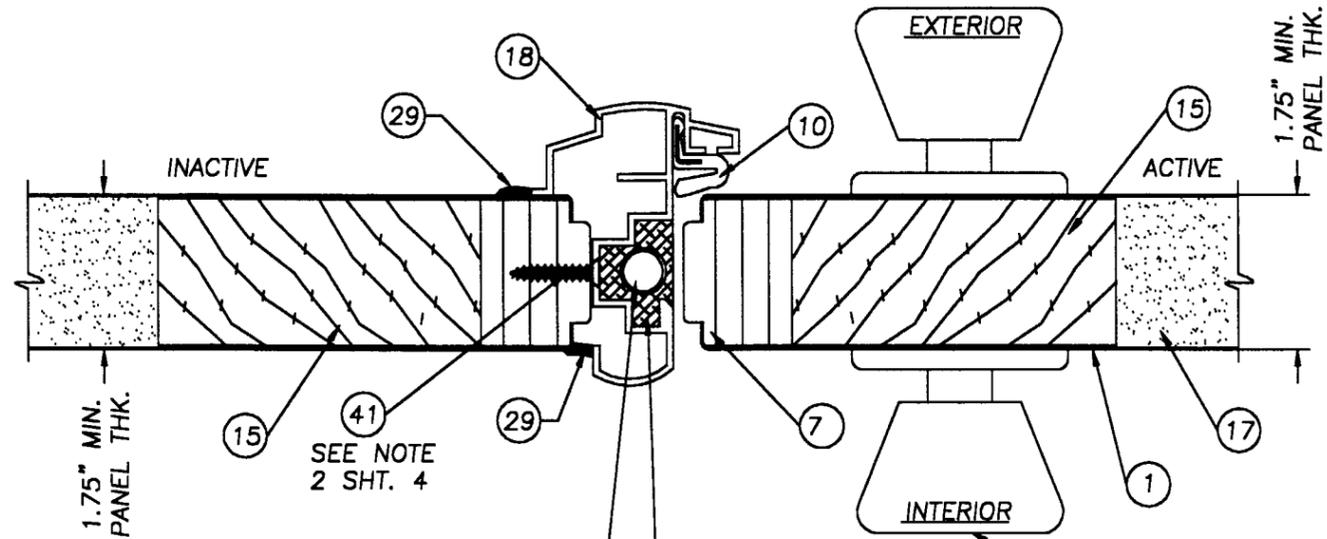

ASTRAGAL RETAINER BOLTS (2)  
 TOTAL, (1) 9.0" L. x  
 .312" DIA. @ TOP & (1)  
 9.0" L. x .312" DIA. @ BOTTOM

④ HORIZONTAL CROSS SECTION  
 ③ AT ASTRAGAL W/ITEM #18  
 IMPERIAL ASTRAGAL  
 SEE DESIGN PRESSURE RATING  
 CHART SHEET 1

ALUM. RETAINING SLIDE  
 (3) 1.0" x 4.5" x 0.565"

JELD-WEN, INC.  
 31725 HIGHWAY 97 NORTH  
 CHILOQUIN, OR. 97624  
 PH. 541.783.2057


PRODUCT:  
 INSWING OPAQUE WOOD  
 EDGE STEEL DOOR UP TO  
 107" x 6-8 UNIT  
 PART OR ASSEMBLY:  
 HORIZONTAL CROSS  
 SECTIONS

| NO. | DATE     | GENERAL REVISION | TJH | BY |
|-----|----------|------------------|-----|----|
| 1   | 03/14/02 |                  |     |    |


**RW** BUILDING  
 CONSULTANTS, INC.  
 813.684.3831

DATE: 11/15/01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2166  
 SHEET 3 OF 7


Approved as complying with the  
 Florida Building Code  
 Date AUG. 22, 2007  
 NOA# 01-1218-06  
 Miami Dade Product Control  
 Division  
 By [Signature]

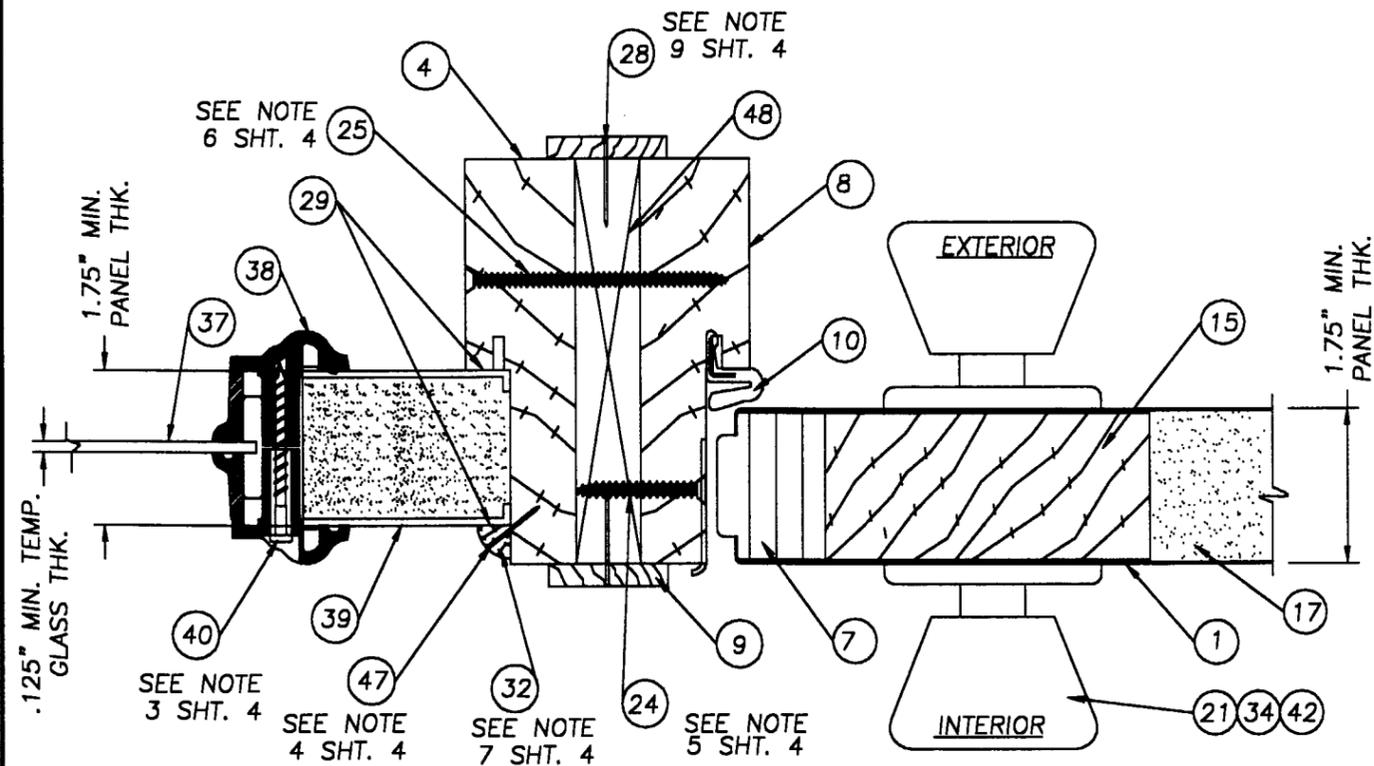

① HORIZONTAL CROSS SECTION AT SIDELITE TO LATCH JAMB, TYP.

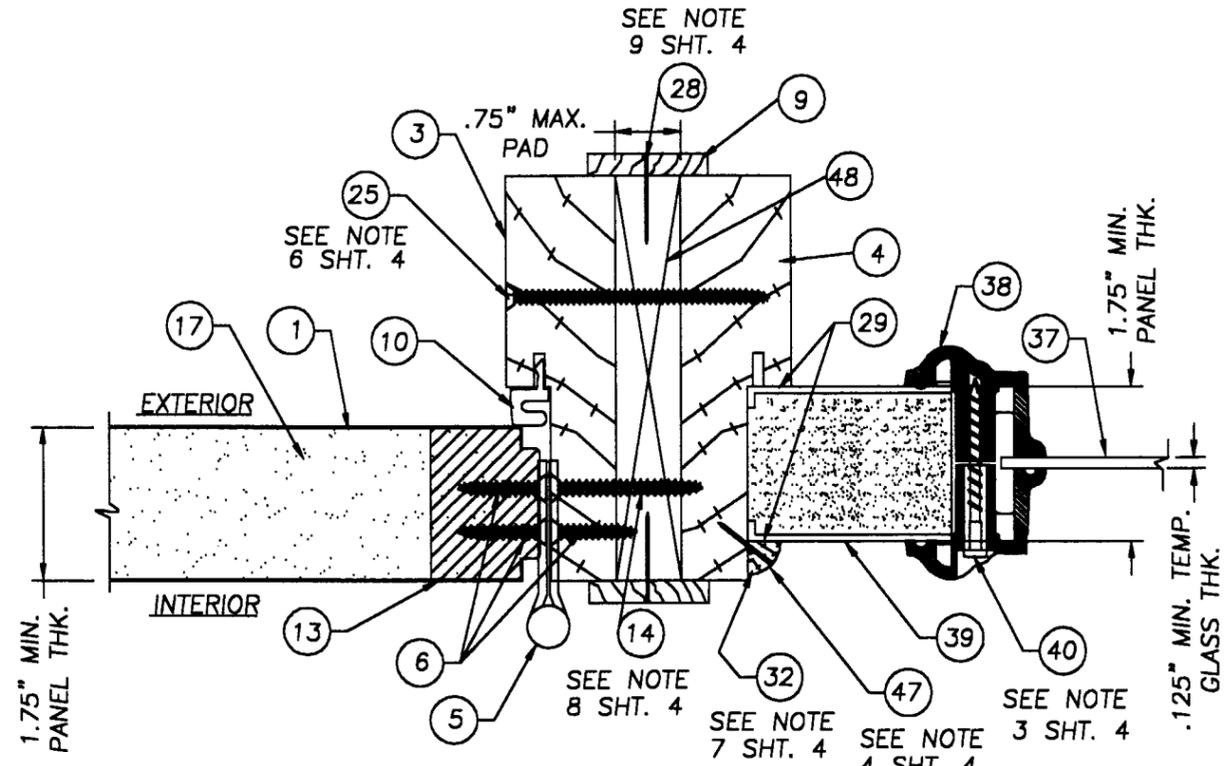

② HORIZONTAL CROSS SECTION AT SIDELITE TO HINGE JAMB, TYP.

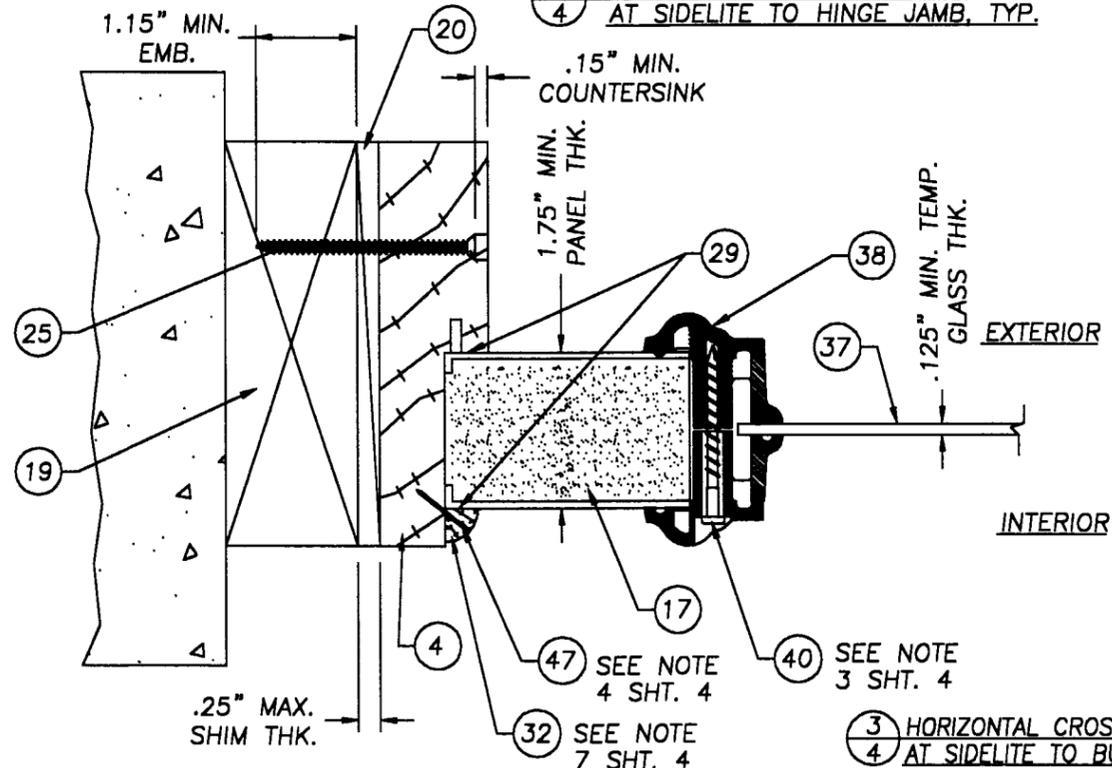

③ HORIZONTAL CROSS SECTION AT SIDELITE TO BUCK, TYP.

NOTES:

1. SPACING FOR #8 x 1" PFH SCREW ATTACHING THE WINDJAMBER ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: TOP DOWN; 1.0", 3.0" & 5.0". FROM THE BOTTOM UP; 1.0", 3.0", 5.0", 20.0" & 38.75".
2. SPACING FOR ITEM 41 #10 x 1" PFH SCREW ATTACHING THE IMPERIAL ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FROM THE TOP DOWN & BOTTOM UP; 1.0", 2.5", 4.0", 5.5", 13.0", 18.0" & 26.0".
3. SPACING FOR #8 x 1 1/2" PLASCEW IS AS FOLLOWS; TOP & BOTTOM; (2) SCREWS 3.0" IN FROM EACH HORIZONTAL CORNER. FROM THE TOP OF THE FRAME DOWN ON THE SIDES; 3.0", 13.0", 26.0", 39.0", 52.0" & 63.0".
4. SPACING FOR BRAD TRIM NAIL 3/4" L. ATTACHING THE QUARTER ROUND TO THE SIDELITE IS AS FOLLOWS; TOP & BOTTOM; 1.25" IN FROM EACH HORIZONTAL CORNER WITH (1) MORE NAIL IN THE MIDDLE. SIDES; 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
5. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND BUCK USE A #8 x 2 1/2" PFH WOOD SCREW. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE A #8 x 2" PFH WOOD SCREW.
6. SPACING FOR #8 x 2.5" PFH WOOD SCREW ATTACHING THE MULLIONS TOGETHER IS AS FOLLOWS; 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE SCREWS EQUALLY SPACED, A TOTAL OF (6) SCREWS PER EACH VERTICAL MULLION.
7. THE SIDELITE IS SECURED INTO THE SIDELITE JAMB WITH SILICONE CAULK ON THREE SIDES & 3/8" x 3/8" 1/4 ROUND & BRAD TRIM NAIL x 3/4" L..
8. WHEN ATTACHING THE HINGE TO THE JAMB AND BUCK USE A #10 x 2" PFH WOOD SCREW. WHEN ATTACHING THE HINGE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE #10 x 1 3/4" PFH WOOD SCREW.
9. THE MULLION CAP IS ATTACHED TO THE PRESSURE TREATED REINFORCEMENT WITH ITEM #28 A 1" TRIM NAIL SPACED A MAX. OF 12" ON CENTER.

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: INSWING OPAQUE WOOD EDGE STEEL DOOR UP TO 107" x 6'-8" UNIT  
PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS & NOTES

| NO. | DATE     | GENERAL REVISION | TJH | BY |
|-----|----------|------------------|-----|----|
| 1   | 03/14/02 |                  |     |    |


RW BUILDING CONSULTANTS, INC.  
813.684.3831

Approved as complying with the Florida Building Code  
Date AUG. 22, 2002  
NOA# 01-1218-06  
Miami Dade Product Control Division  
By Manuel Sery


DATE: 11/15/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2166  
SHEET 4 OF 7

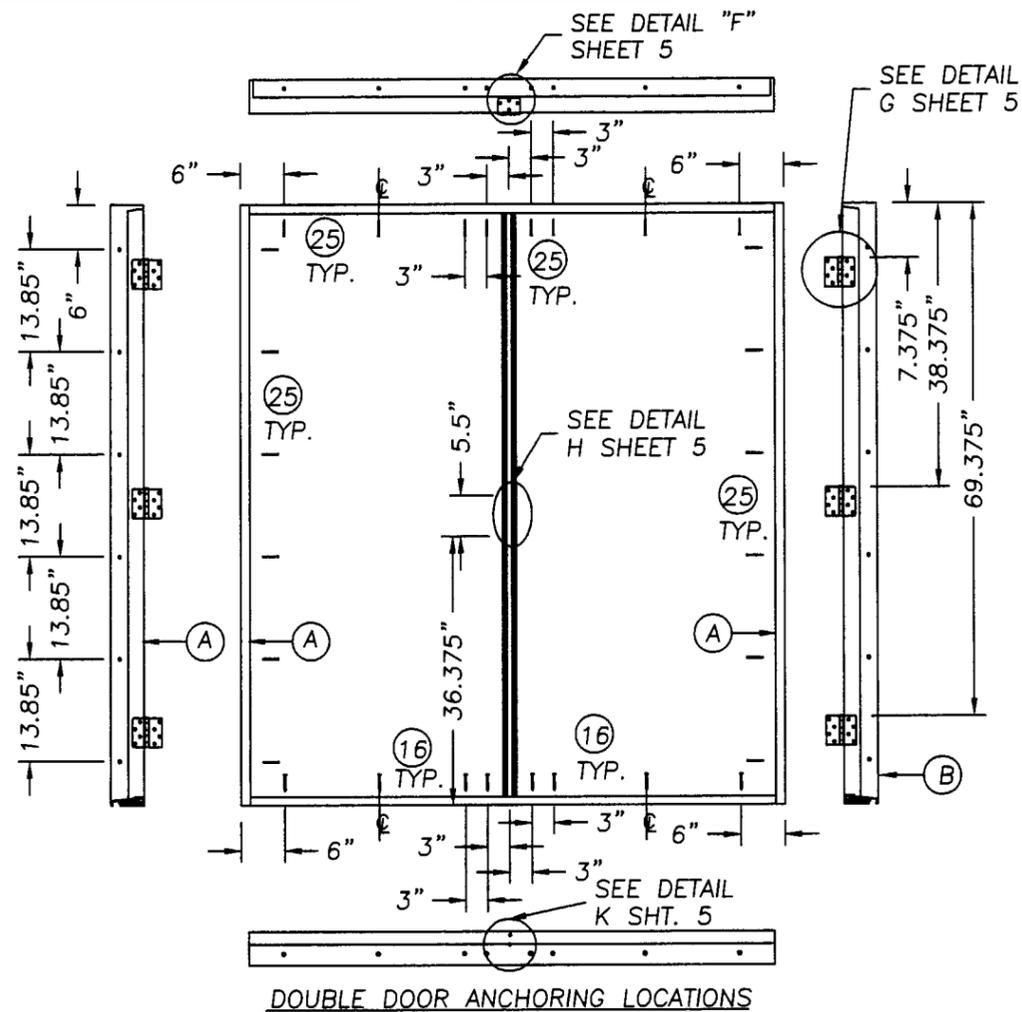


DOUBLE DOOR ANCHORING LOCATIONS

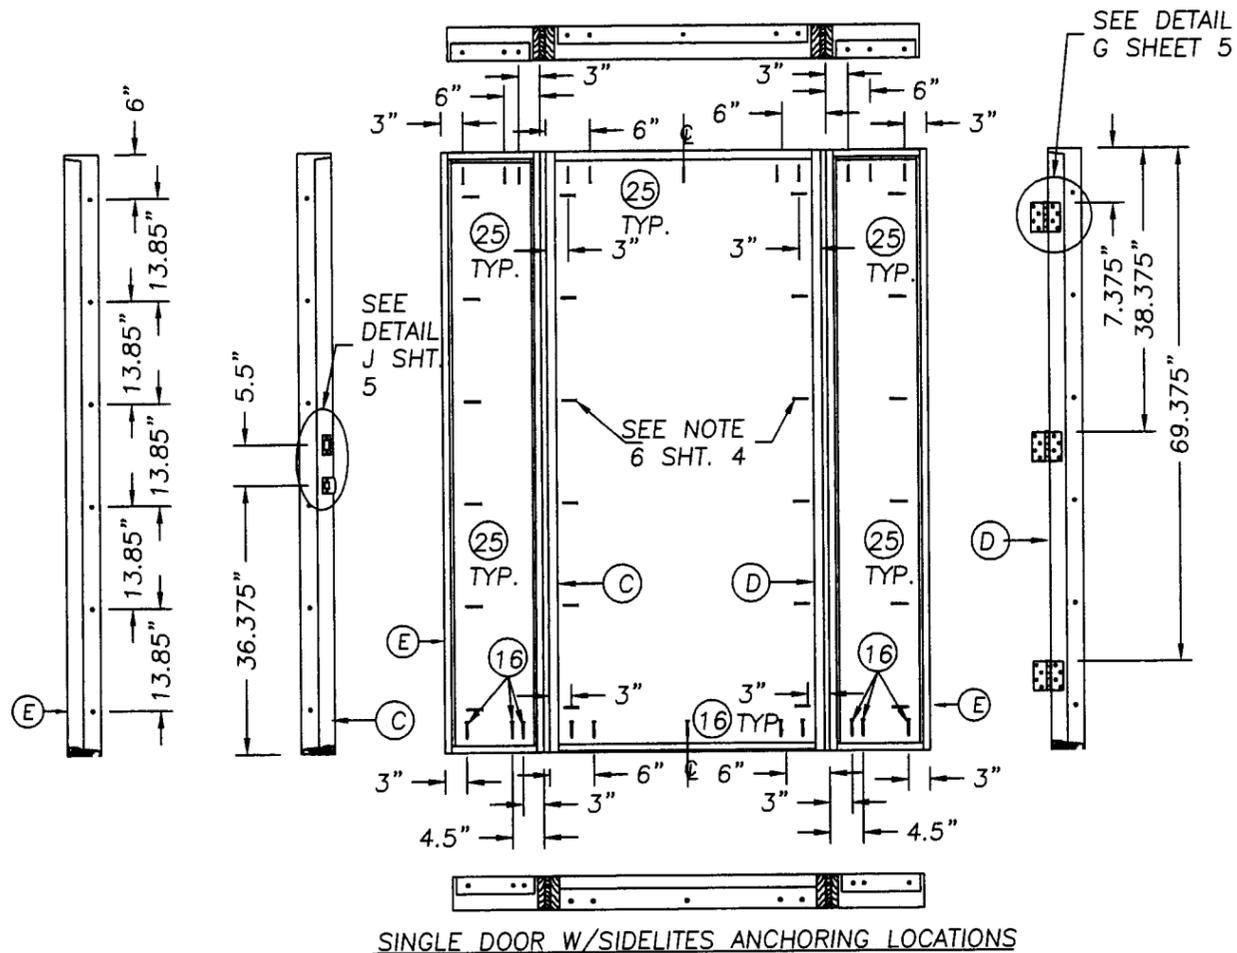


SINGLE DOOR W/SIDELITES ANCHORING LOCATIONS

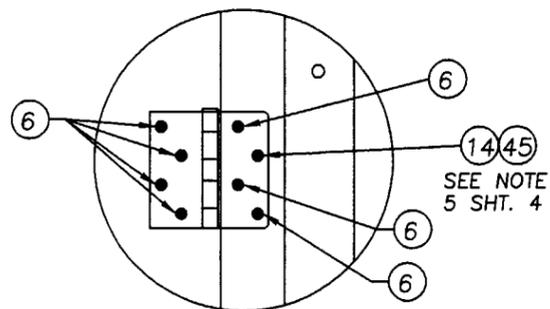


DETAIL G HINGE TO JAMBS & DOOR SEE NOTE 5 SHT. 4




DETAIL F HEADER WINDJAMBER ASTRAGAL RETAINER BOLTS HEADER STRIKE PLATE




OPTIONAL DETAIL F HEADER IMPERIAL ASTRAGAL RETAINER BOLT HEADER STRIKE PLATE

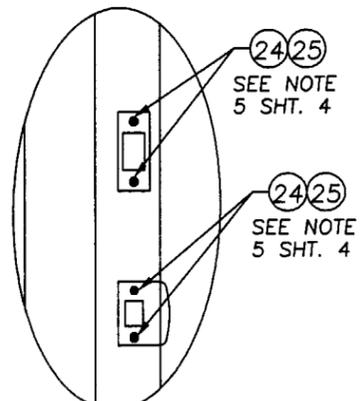

DETAIL J STRIKE PLATES TO JAMBS SEE NOTE 5 SHT. 4

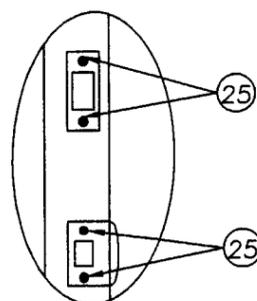

DETAIL H STRIKE PLATES TO WINDJAMER ASTRAGAL

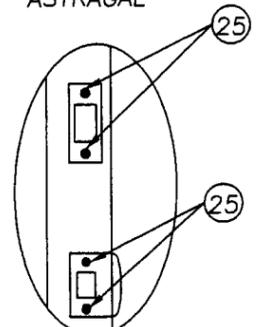


OPTIONAL DETAIL H STRIKE PLATES TO IMPERIAL ASTRAGAL

ASTRAGAL RETAINER BOLT HOLES MUST BE DRILLED THROUGH THE THRESHOLD & INTO THE MASONRY DEEP ENOUGH FOR A 2" THROW



DETAIL K SILL WINDJAMBER ASTRAGAL RETAINER BOLT HOLES



OPTIONAL DETAIL K SILL IMPERIAL ASTRAGAL RETAINER BOLT THRESHOLD STRIKE PLATE

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: INSWING OPAQUE WOOD EDGE STEEL DOOR UP TO 107" x 6-8 UNIT  
PART OR ASSEMBLY: ANCHORING LOCATIONS & DETAILS

| NO. | DATE     | GENERAL REVISION | T/JH | BY |
|-----|----------|------------------|------|----|
| 1   | 03/14/02 |                  |      |    |


**RW** BUILDING CONSULTANTS, INC.  
813.684.3831

Approved as complying with the Florida Building Code  
Date Aug. 22, 2007  
NOA# 01-1218-06  
Miami Dade Product Control Division  
By: *[Signature]*


DATE: 11/15/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2166  
SHEET 5 OF 7

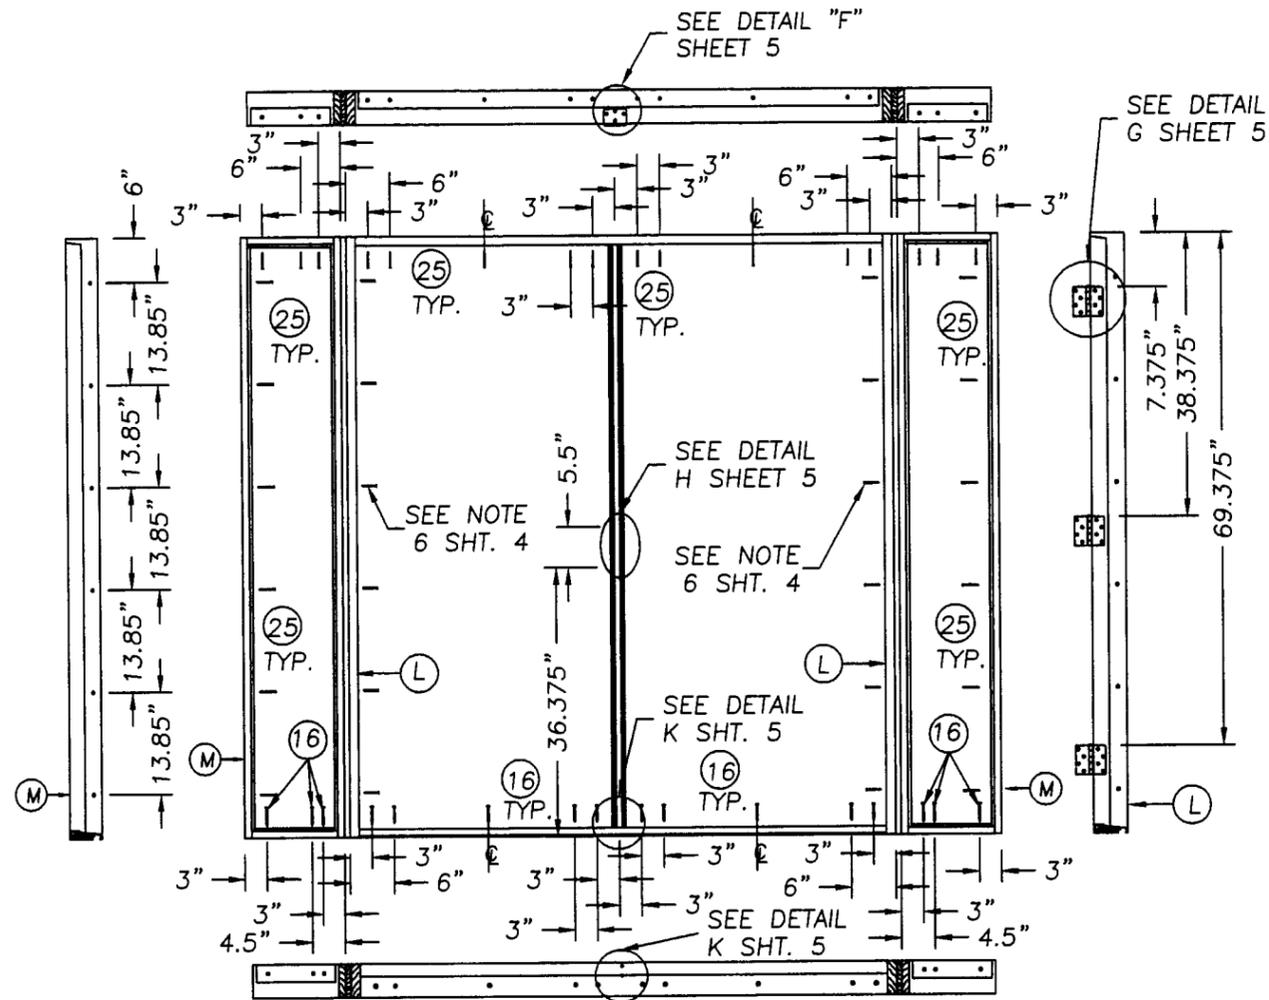

DOUBLE DOOR W/SIDELITES ANCHORING LOCATIONS

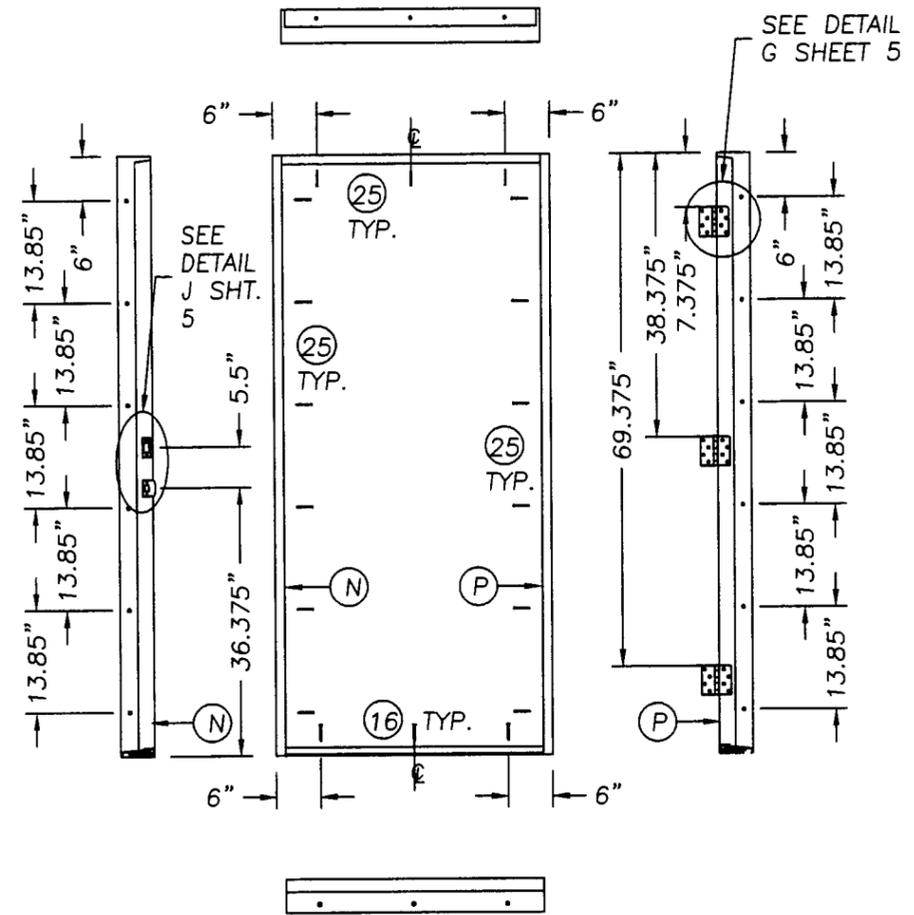

SINGLE DOOR ANCHORING LOCATIONS

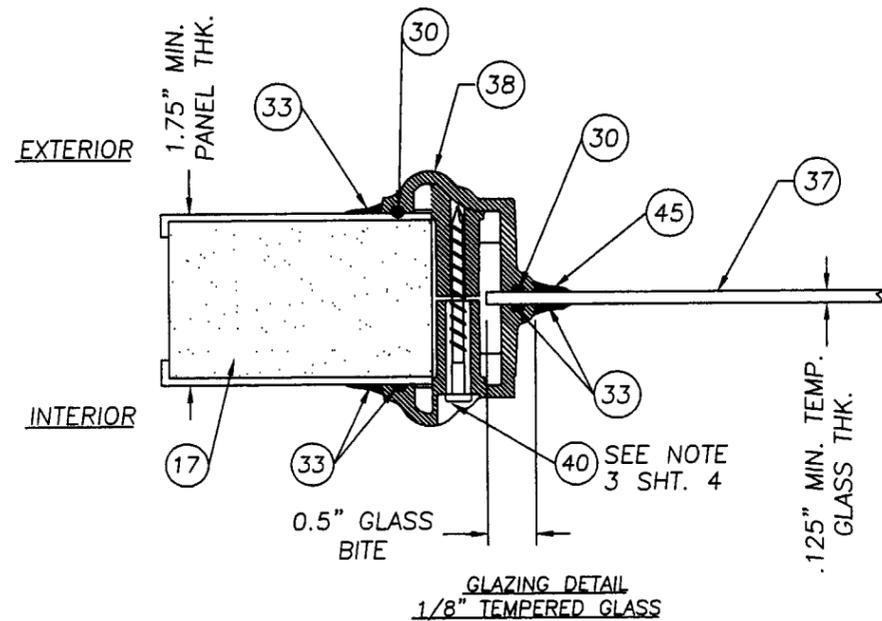

GLAZING DETAIL  
1/8" TEMPERED GLASS

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT:  
INSWING OPAQUE WOOD  
EDGE STEEL DOOR UP TO  
107" x 6-8 UNIT

PART OR ASSEMBLY:  
ANCHORING LOCATIONS  
& GLAZING DETAILS

| NO. | DATE     | GENERAL REVISION | T/JH | BY |
|-----|----------|------------------|------|----|
| 1   | 03/14/02 |                  |      |    |

**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

DATE: 11/15/01

SCALE: N.T.S.


DWG. BY: WLN

CHK. BY: RW

DRAWING NO.:  
S-2166


SHEET 6 OF 7

Approved as complying with the  
Florida Building Code  
Date AUG. 22, 2002  
NOA# 01-121B.06  
Miami Dade Product Control  
Division  
By Manuel Perez

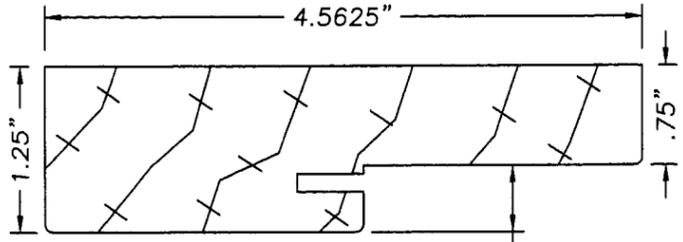


2 4  
3 8


WOOD FRAME

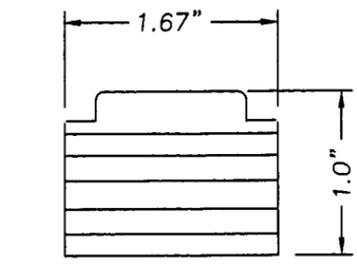


7 LVL LATCH STILE

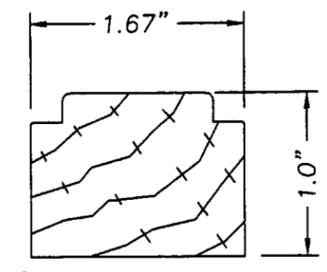


11 DOOR TOP & HINGE STILE

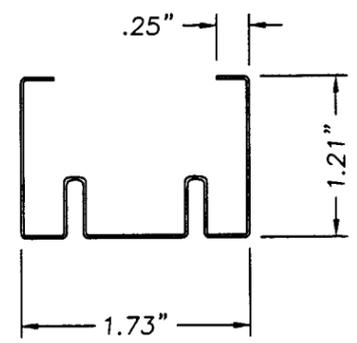


DOOR STEEL EDGE CAP, BOTTOM  
.021\"/>

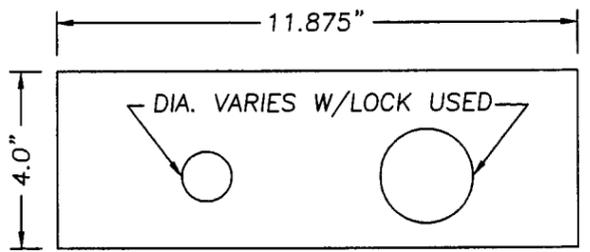


WOOD LOCK BLOCK, 1.71\"/>

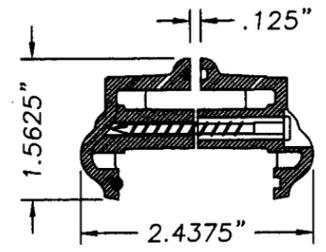


LITE FRAME ODL  
HP POLYPROPYLENE  
(THERMOFIL-P6-30FM0391)

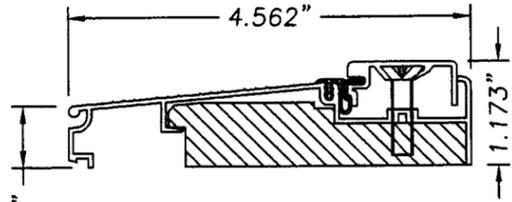


ADJUSTABLE INSWING THRESHOLD  
W/ADJUSTABLE CAP  
BY IMPERIAL .051\"/>

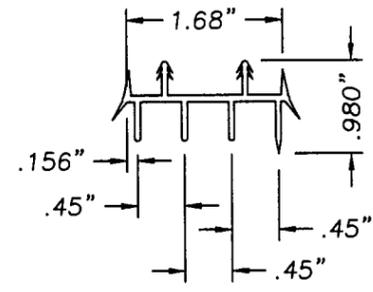


27 INSWING DOOR BOTTOM  
SWEEP, EXTRUDED VINYL  
.060\"/>

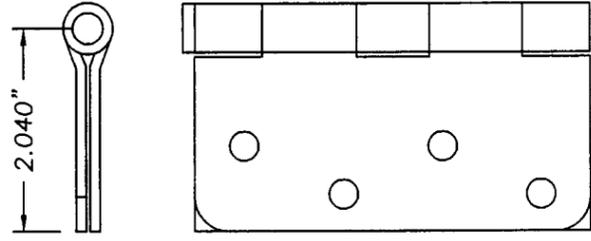


4 x 4 STEEL DOOR HINGE  
.097\"/>

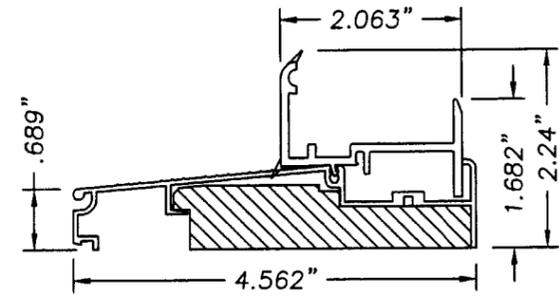

ADJUSTABLE INSWING THRESHOLD  
W/SIDELITE BOTTOM SEAL  
BY IMPERIAL .051\"/>

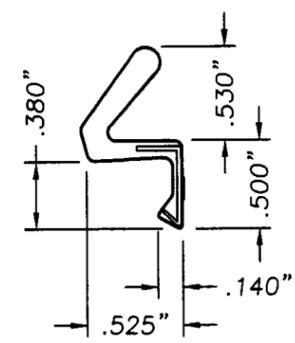


10 COMPRESSION WEATHERSRTIP  
SCHLEGEL Q-LON QDS 650

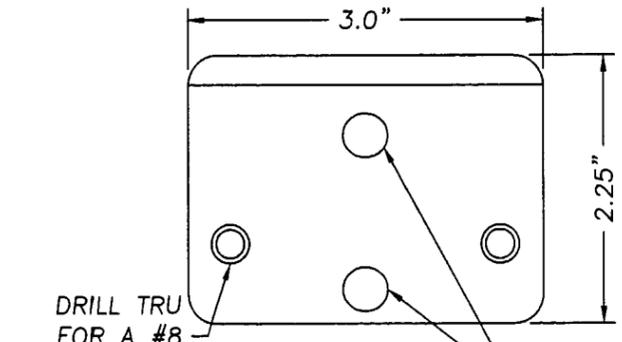


DRILL TRU FOR A #8  
PFH WOOD  
SCREW 2PLCS

DRILL TRU FOR  
.357\"/>

WINDJAMBER II WR68J STRIKE PLATE  
STEEL PLATE

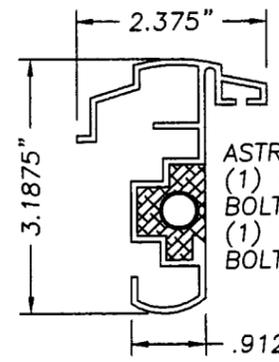

OPTIONAL  
IMPERIAL ASTRAGAL  
EXTRUDED ALUMINUM .075\"/>

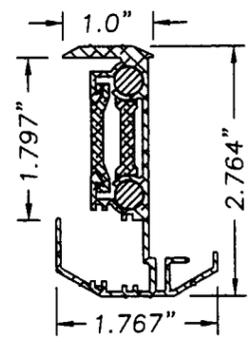

26 ASTRAGAL WINDJAMBER II  
(WR68J T-6063 EXTRUDED ALUMINUM)

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT:  
INSWING OPAQUE WOOD  
EDGE STEEL DOOR UP TO  
107\"/>

| NO. | DATE     | GENERAL REVISION | TJH | BY |
|-----|----------|------------------|-----|----|
| 1   | 03/14/02 |                  |     |    |

RW BUILDING  
CONSULTANTS, INC.  
813.684.3831

DATE: 11/15/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2166  
SHEET 7 OF 7

Approved as complying with the  
Florida Building Code  
Date AUG. 22, 2002  
NOA# 01-1218.06  
Miami Dade Product Control  
Division  
By Manuel Perez