



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Parrett Manufacturing
810 Second Avenue East
Dorchester, WI 54425-0440**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: "Direct Set" Aluminum Clad Wood Fixed Window

APPROVAL DOCUMENT: Drawing No. S-2169, titled "Parrett Windows, Aluminum Clad Direct Set Sash Fixed Frame Windows", sheets 1 through 6, prepared by R.W. Building Consultants, Inc., dated 3/5/02, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

The submitted documentation was reviewed by **Raul Rodriguez**



**NOA No 01-1220.03
Expiration Date: April 18, 2007
Approval Date: April 18, 2002
Page 1**

PARRETT WINDOWS

ALUMINUM CLAD WOOD FIXED FRAME DIRECT SET
WINDOWS W/ & W/OUT SASH

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. PRODUCT MEETS LARGE MISSILE IMPACT RESISTANT CODE.
5. THIS PRODUCT MEETS THE WATER REQUIREMENT FOR THE FLORIDA BUILDING CODE.
6. FOR DESIGN PRESSURE RATINGS SEE CHART ON SHEET 2.

ALUMINUM CLAD WOOD FIXED FRAME WINDOWS W/ & W/OUT SASH

(Common to all conditions)

Wood Main Frame: Finger Jointed Pine, 0.625" thk. x 4.5625" deep.

Aluminum Cladding: .055" extruded aluminum, 2.076" wide x 1.25" high.

Aluminum Nailing Fin: .050" extruded aluminum, 1.455" wide x 1.297" high.

Wood Sash: Finger Jointed Pine, 2.375" wide x 1.125" high.

Wood Glass Stop W/out sash: Finger Jointed Pine 1.8125" high x 1.125" wide.

Wood Glass Stop W/sash: Finger Jointed Pine 1.8125" high x .875" wide.

WINDOW CONSTRUCTION:

The Wood Main Frame corners are butted and secured with (3) #8 x 2 1/4" square head zinc plated screws at each corner joint. The aluminum cladding has mitered and butted corners. The corners are secured together with (1) #8 x 1 1/2" Philips flat head screw. The cladding is attached to the Wood Main Frame with 1/2" long wire staples at 8.0" O.C. The aluminum Nailing Fin is secured to the aluminum cladding with (2) #8 x 1/2" screws in each corner and 1/2" wire staples at 6.0" O.C.

SASH CONSTRUCTION: The wood sash has butted corners which are secured with (2) #8 x 2 1/4" square head zinc plated screws at each corner joint. The sash is attached to the Wood Main Frame with #8 x 1 1/2" Philips flathead wood screws at a max. of 12" O.C.




GLAZING; Without Sash: The .5625" Laminated glass is captured on the interior by the .8125" x 1.125" wood glass stop and on the exterior by the aluminum cladding. The unit is wet glazed with Dow Corning 995 Structural Silicone.

GLAZING; With Sash: The .5625" Laminated glass is captured on the interior and exterior by the .8125" x .875" wood glass stop. The unit is wet glazed with Dow Corning 995 Structural Silicone.


Both glass stops are secured to with #6 x 1 1/4" Philips flathead wood screws at 4.0" from all corners and a maximum of 12" O.C.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	DESIGN PRESSURE RATING & GLASS SIZE CHART
3	VERTICAL CROSS SECTIONS & GLAZING DETAILS
4	HORIZONTAL CROSS SECTIONS
5	ANCHORING LOCATIONS
6	BILL OF MATERIALS & UNIT COMPONENTS

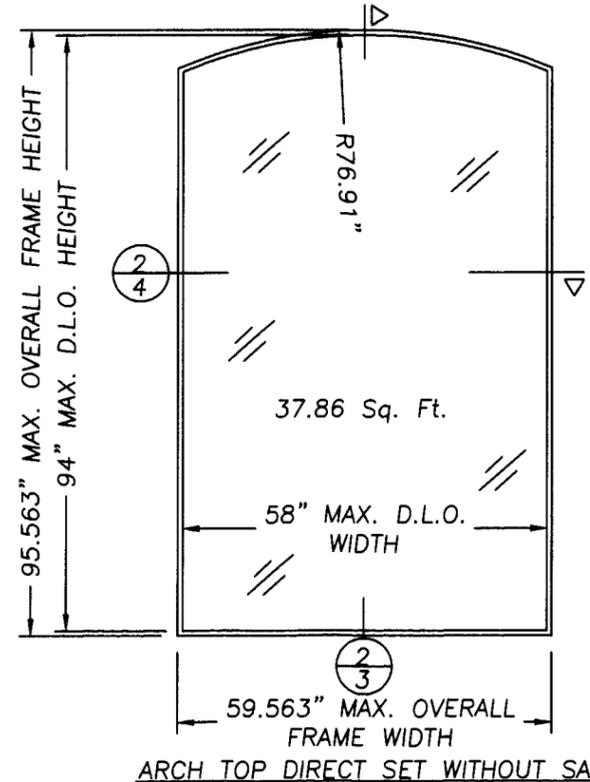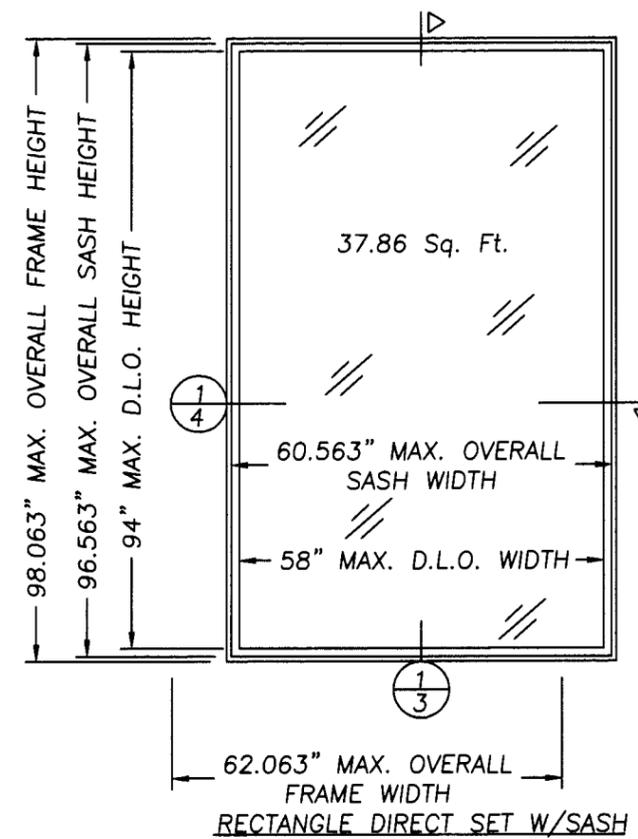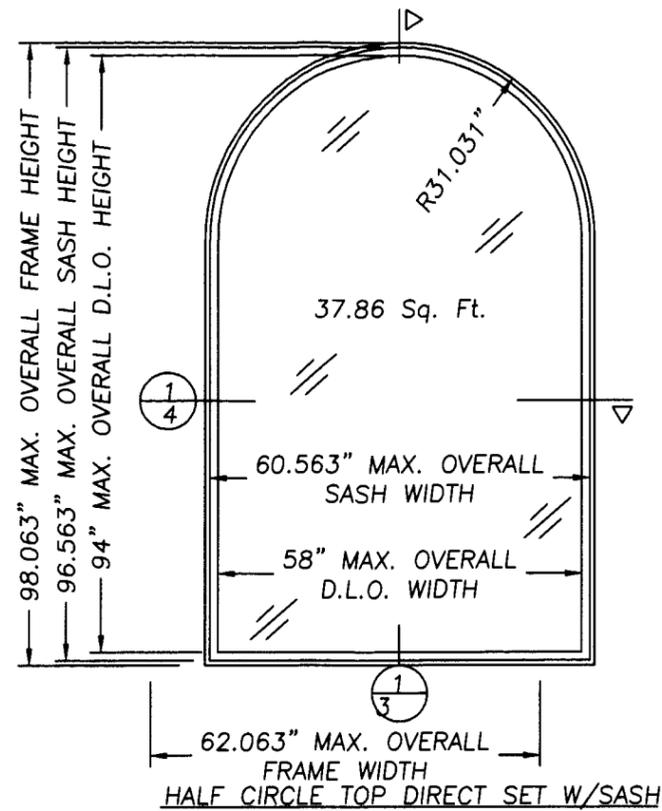

ALL WINDOW UNITS ARE VIEWED FROM THE EXTERIOR

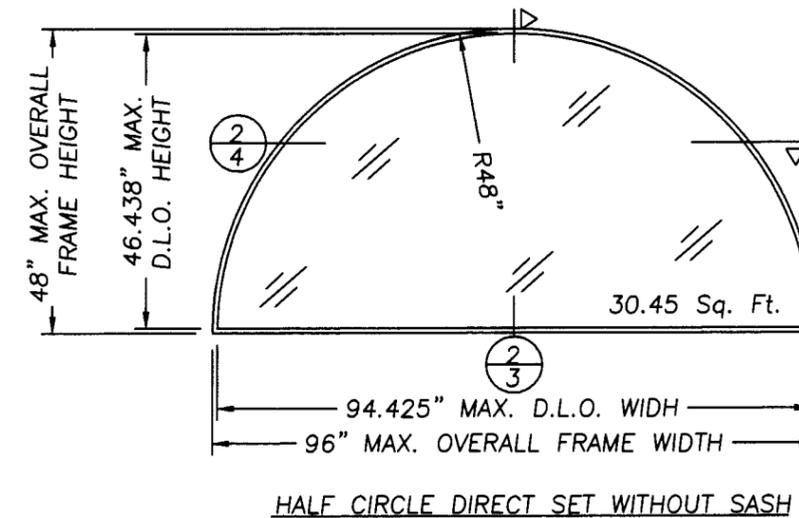

Approved as complying with the Florida Building Code
Date April 18, 2002
NOA# 01-1220-03
Miami Dade Product Control
Division
By: *[Signature]*


PRODUCT:
PARRETT WINDOWS, ALUMINUM CLAD DIRECT SET/DIRECT SET SASH FIXED FRAME WINDOWS
PART OR ASSEMBLY:
GENERAL NOTES & TYPICAL ELEVATIONS

NO.	DATE	REVISIONS	BY
2	3/05/02	ANCHORING DETAIL	RW
1	2/01/02	GENERAL	RW

RW BUILDING CONSULTANTS, INC.
813.684.3831


DATE: 09/24/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2169
SHEET 1 OF 6

Parrett Windows
Quality Crafted Specialty Windows
PARRETT MFG., INC. 810 2nd Ave. East
P.O. Box 440, Dorchester, WI 54425
Phone (715)678-2125 FAX (715)678-2155



DESIGN PRESSURE RATE & GLASS SIZE CHART				
UNIT D.L.O. SIZE		UNIT Sq. Ft OF GLASS	UNIT DESIGN PRESSURE RATING	
D.L.O. WIDTH	D.L.O. HEIGHT			
58.0"	94.0"	37.86	+45.5	-45.5
57.0"	93.0"	36.81	+47.1	-47.1
56.0"	92.0"	35.78	+48.8	-48.8
55.0"	91.0"	34.76	+50.4	-50.4
54.0"	90.0"	33.75	+52.0	-52.0
53.0"	89.0"	32.76	+53.6	-53.6
52.0"	88.0"	31.78	+55.3	-55.3
51.0"	87.0"	30.81	+57.0	-57.0
50.0"	86.0"	29.86	+58.6	-58.6
49.0"	85.0"	28.92	+60.5	-60.5
48.0"	84.0"	28.00	+63.3	-63.3
47.0"	83.0"	27.09	+66.2	-66.2
46.0"	82.0"	26.19	+69.0	-69.0
45.0"	81.0"	25.31	+71.8	-71.8
44.0"	80.0"	24.44	+74.6	-74.6
43.0"	79.0"	23.59	+78.4	-78.4
42.0"	78.0"	22.75	+82.5	-82.5
41.0"	77.0"	21.92	+86.6	-86.6
40.0"	76.0"	21.11	+90.7	-90.7
39.0"	75.0"	20.31	+94.7	-94.7
38.75"	74.0"	19.91	+96.3	-96.3

Parrett Windows
 Quality Crafted Specialty Windows
 PARRETT MFG., INC. 810 2nd Ave. East
 P.O. Box 440, Rochester, WI 54425
 Phone (715)678-2125 FAX (715)678-2155







PRODUCT:
 PARRETT WINDOWS, ALUMINUM
 CLAD DIRECT SET/DIRECT SET
 SASH FIXED FRAME WINDOWS
 PART OR ASSEMBLY:
 DESIGN PRESSURE RATING
 & GLASS SIZE CHART

NO.	DATE	REVISIONS	
		ANCHORING DETAIL	BY
2	3/05/02	RW	RW
1	2/01/02	GENERAL	RW

RW BUILDING
 CONSULTANTS, INC.
 813.684.3831

Approved as complying with the
 Florida Building Code
 Date April 18, 2002
 NOA# 01-1320-03
 Miami Dade Product Control
 Division
 By [Signature]

DATE: 09/24/01
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.:
 S-2169
 SHEET 2 OF 6

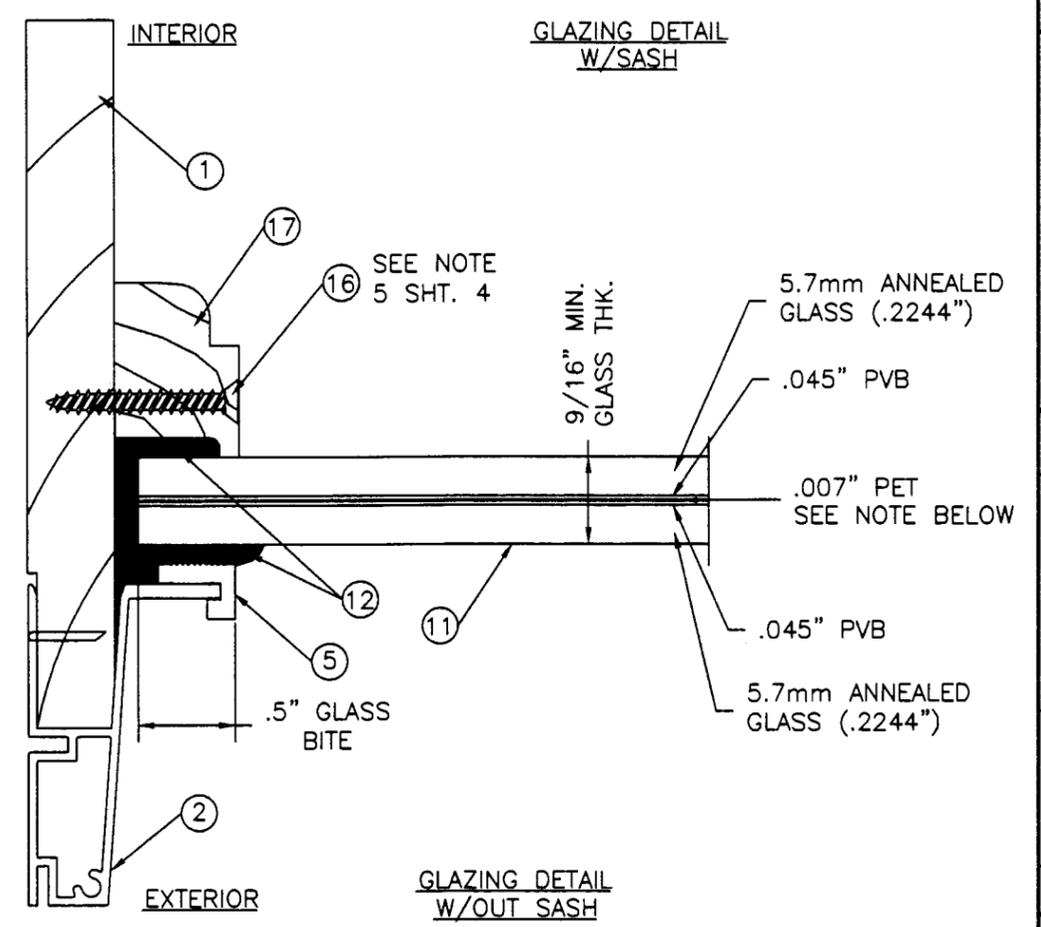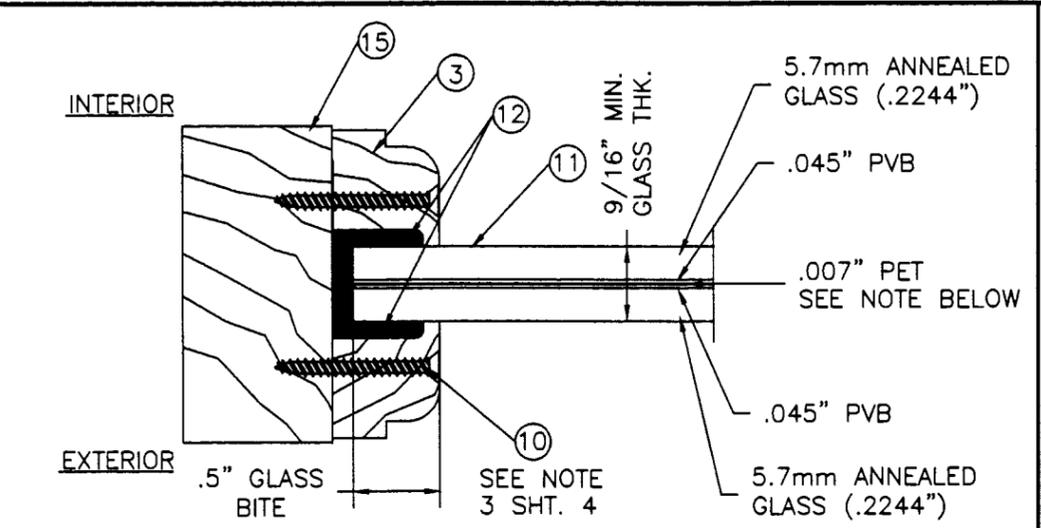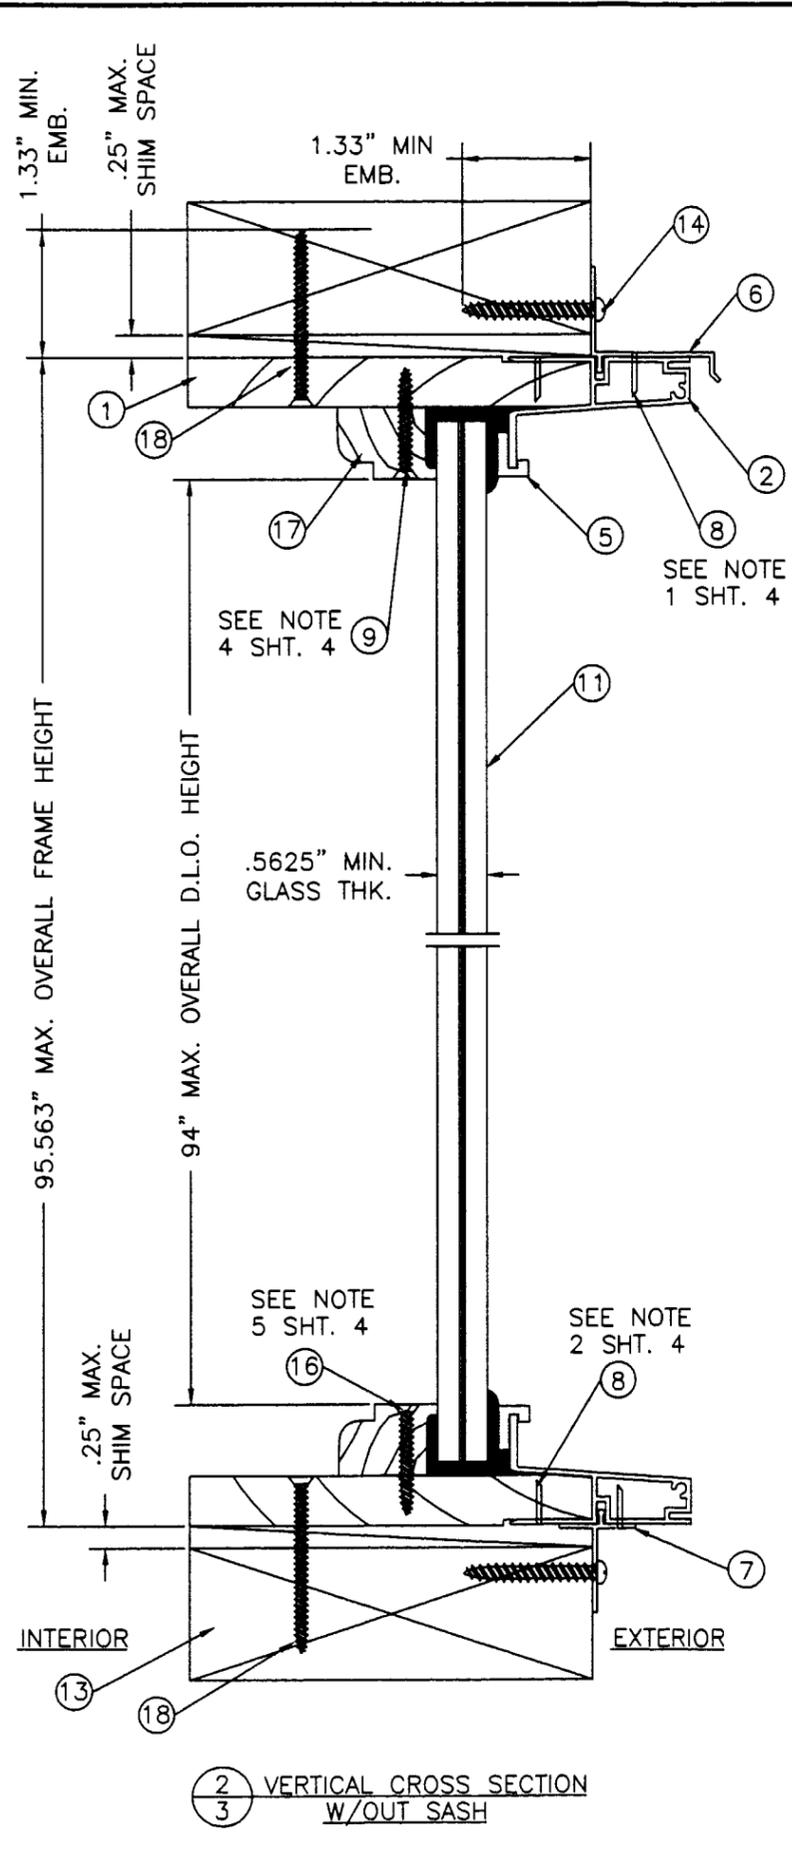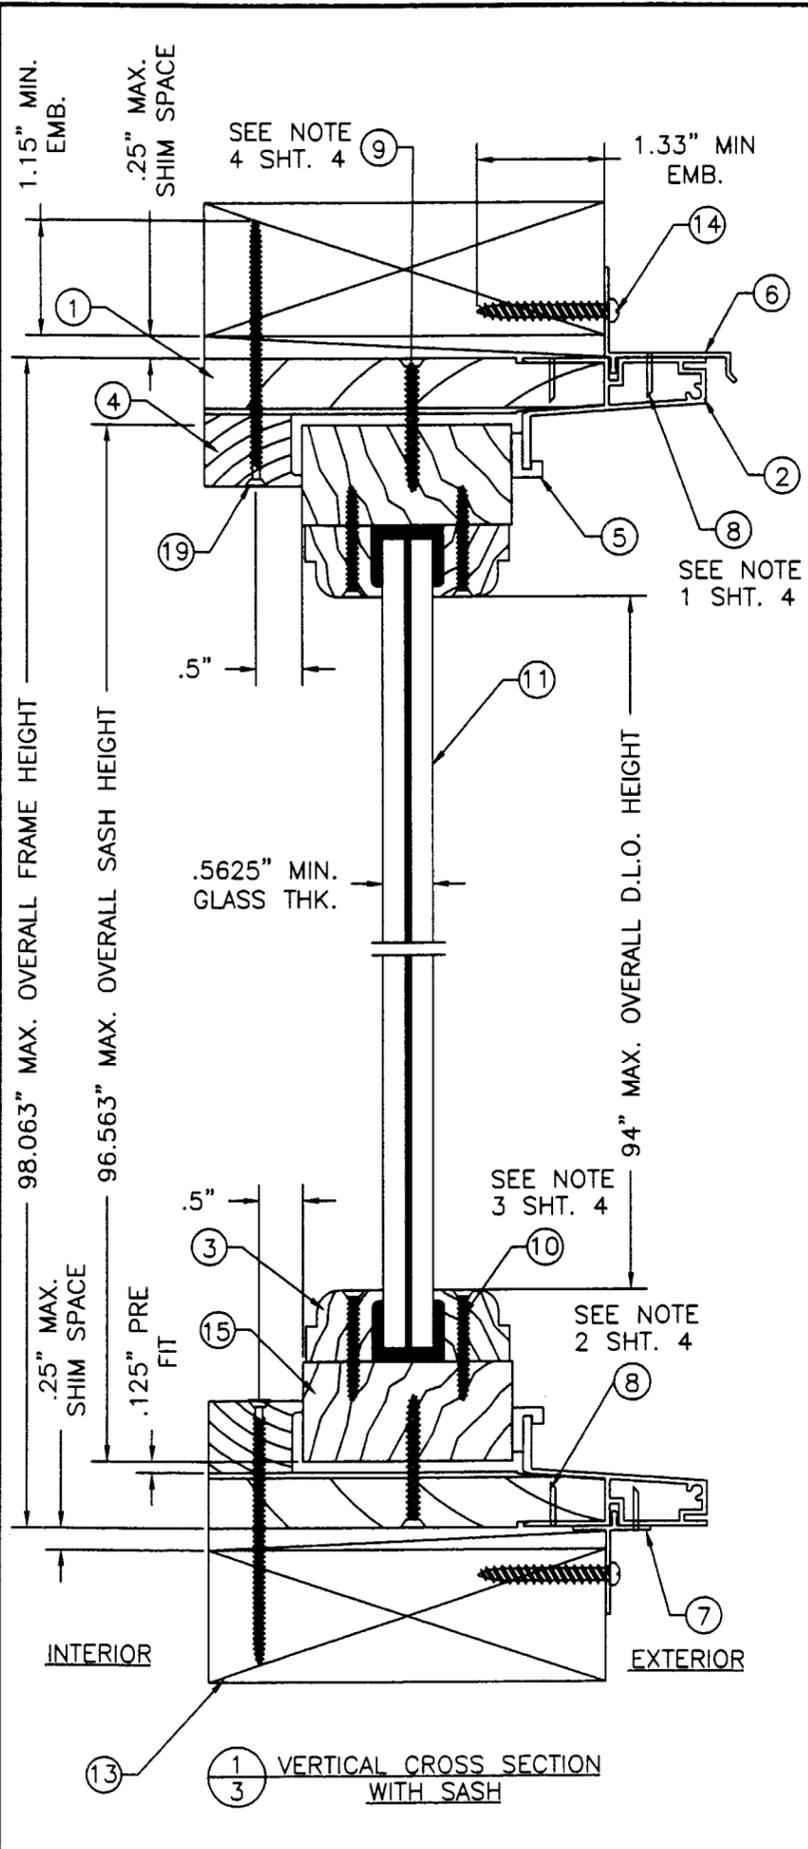

NOTE:
 THE .007" PET TAIL IS 1.0" LONG AND IS MECHANICALLY FASTENED TO THE SASH OR FRAME BY THE GLAZING STOP.

Approved as complying with the
 Florida Building Code
 Date April 18, 2002
 NOAH# 01-1226-03
 Miami Dade Product Control
 Division
 By *[Signature]*


Parrett Windows
 Quality Crafted Specialty Windows
 PARRETT MFG., INC. 810 2nd Ave. East
 P.O. Box 440, Dorchester, WI 54425
 Phone (715)678-2125 FAX (715)678-2155

PRODUCT: PARRETT WINDOWS ALUMINUM CLAD DIRECT SET/DIRECT SET SASH FIXED FRAME WINDOWS
 PART OR ASSEMBLY: VERTICAL CROSS SECTIONS & GLAZING DETAILS


NO.	DATE	REVISIONS	BY
2	3/05/02	ANCHORING DETAIL	RW
1	2/01/02	GENERAL	RW
NO.			

RW BUILDING CONSULTANTS, INC.
 813.684.3831

DATE: 09/24/01
 SCALE: 1/2" = 1"
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: S-2169
 SHEET 3 OF 6

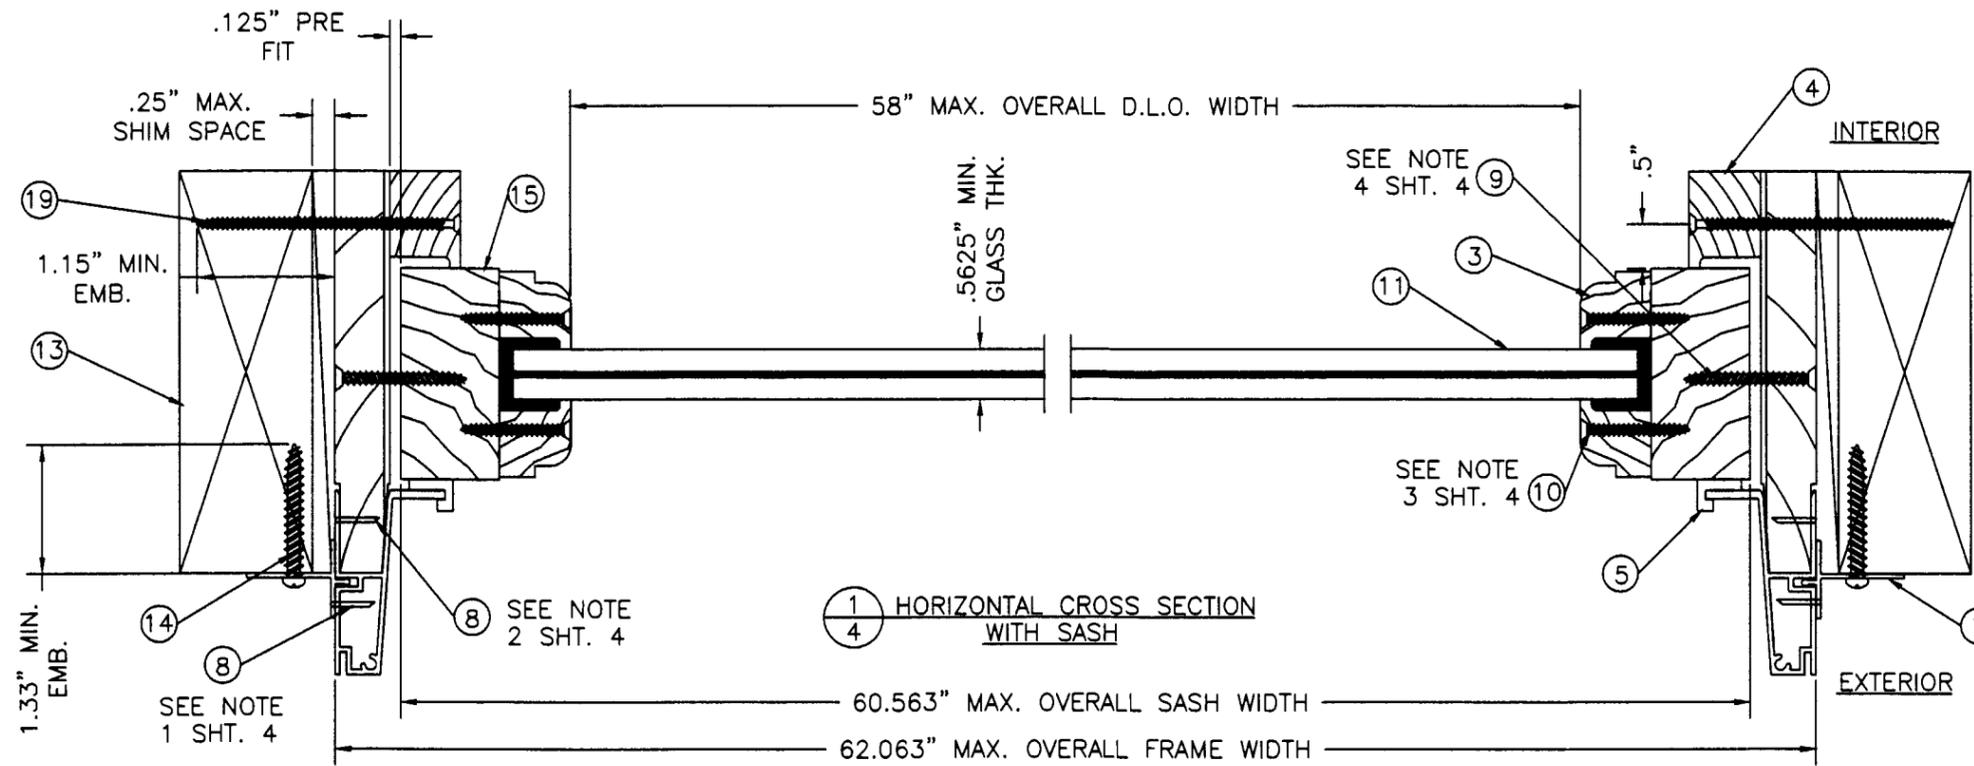

1 HORIZONTAL CROSS SECTION
4 WITH SASH

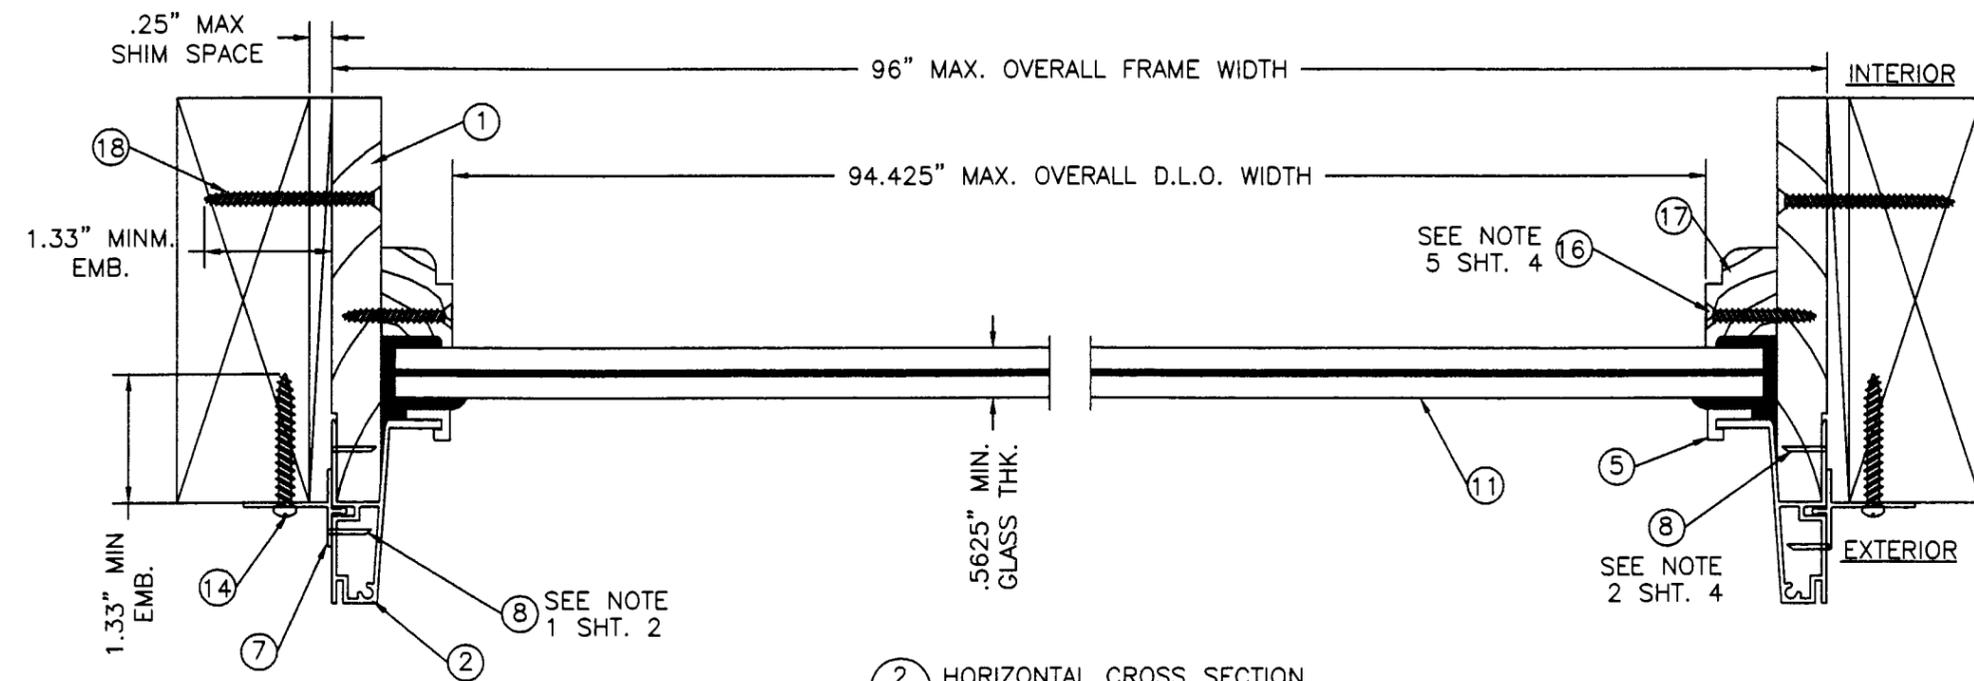


2 HORIZONTAL CROSS SECTION
4 W/OUT SASH

NOTES:

1. SPACING FOR ITEM #8 ATTACHING THE NAILING FIN TO THE CLADDING IS AS FOLLOWS; A MAX. OF 6" O.C.
2. SPACING FOR ITEM #8 ATTACHING THE CLADDING TO THE WOOD FRAME IS AS FOLLOWS; A MAX. OF 8" O.C.
3. SPACING FOR ITEM #10 ATTACHING THE GLAZING STOP TO THE SASH IS AS FOLLOWS; 4.0" FROM ALL CORNERS AND A MAX. OF 12.0" O.C.
4. SPACING FOR ITEM #9 ATTACHING THE SASH TO THE WOOD FRAME IS AS FOLLOWS; A MAX. OF 12" O.C.
5. SPACING FOR ITEM #16 ATTACHING THE GLAZING STOP TO THE WOOD FRAME IS AS FOLLOWS; A MAX. OF 12" O.C.

Approved as complying with the
Florida Building Code
Date April 14, 2002
NOA# 01-1220-03
Miami Dade Product Control
Division
By *[Signature]*

Parrett Windows
Quality Crafted Specialty Windows
PARRETT MFG., INC. 810 2nd Ave. East
P.O. Box 440, Dorchester, WI 54425
Phone (715) 678-2125 FAX (715) 678-2155




PRODUCT:
PARRETT WINDOWS, ALUMINUM
CLAD DIRECT SET/DIRECT SET
SASH FIXED FRAME WINDOWS
PART OR ASSEMBLY:
HORIZONTAL CROSS
SECTION

NO	DATE	REVISIONS	BY
2	3/05/02	ANCHORING DETAIL	RW
1	2/01/02	GENERAL	RW


RW BUILDING
CONSULTANTS, INC.
813.684.3831

DATE: 09/24/01
SCALE: 1/2" = 1"
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2169
SHEET 4 OF 6

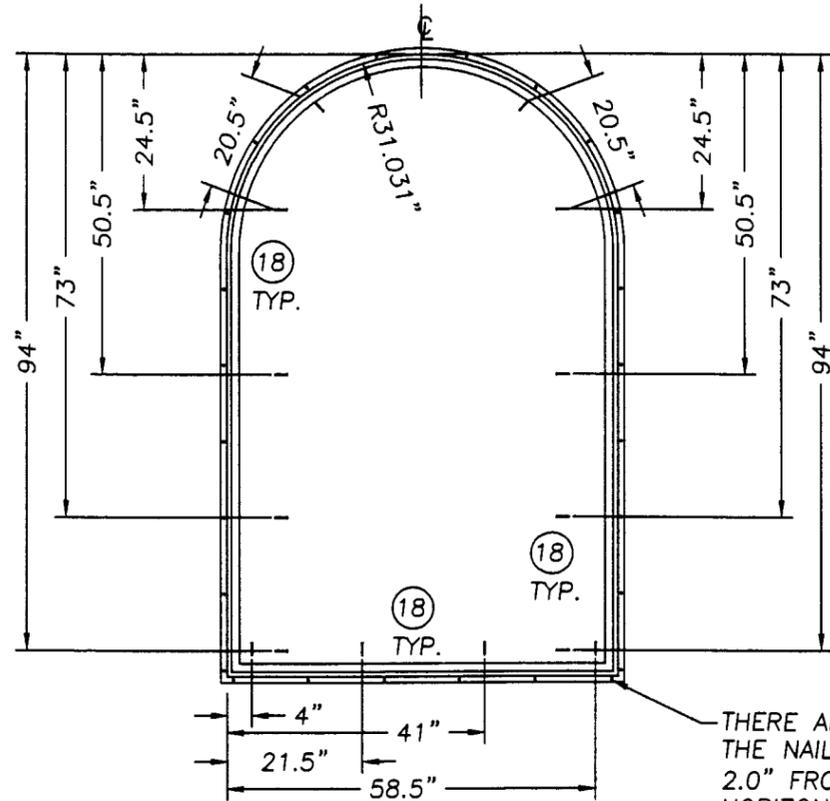


HALF CIRCLE TOP DIRECT SET W/SASH

THERE ARE 26 ITEM #14 IN THE NAILING FIN SPACED AT: 2.0" FROM ALL SILL HORIZONTAL AND VERTICAL CORNERS AND 12.0" ON CENTER BETWEEN SCREWS.

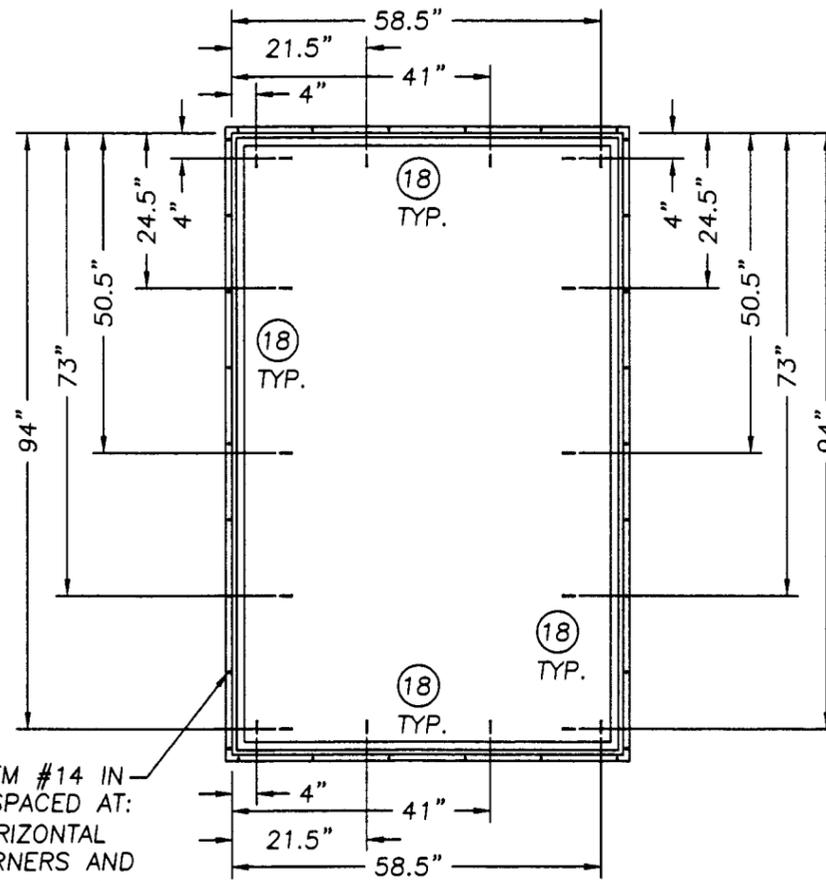


RECTANGLE DIRECT SET W/SASH

THERE ARE 30 ITEM #14 IN THE NAILING FIN SPACED AT: 2.0" FROM ALL HORIZONTAL AND VERTICAL CORNERS AND 12.0" ON CENTER BETWEEN SCREWS.

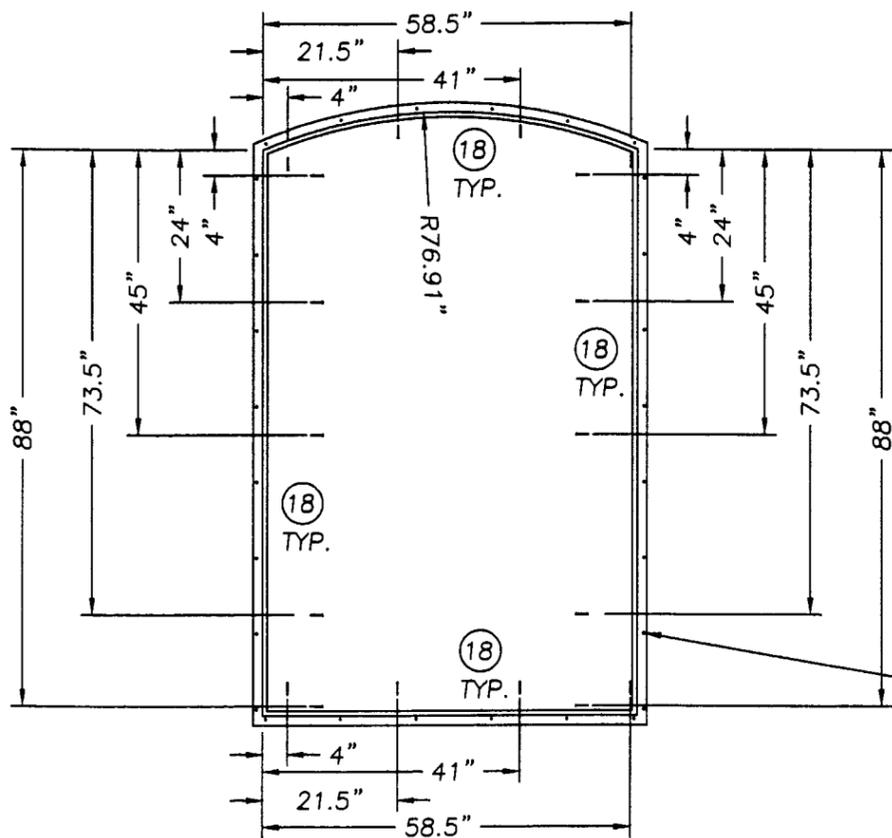

ARCH TOP DIRECT SET WITHOUT SASH

THERE ARE 28 ITEM #14 IN THE NAILING FIN SPACED AT: 2.0" FROM ALL SILL HORIZONTAL AND VERTICAL CORNERS AND 12.0" ON CENTER BETWEEN SCREWS. 2.0" FROM HEAD HORIZONTAL CORNERS AND 12.0" ON CENTER BETWEEN SCREWS.

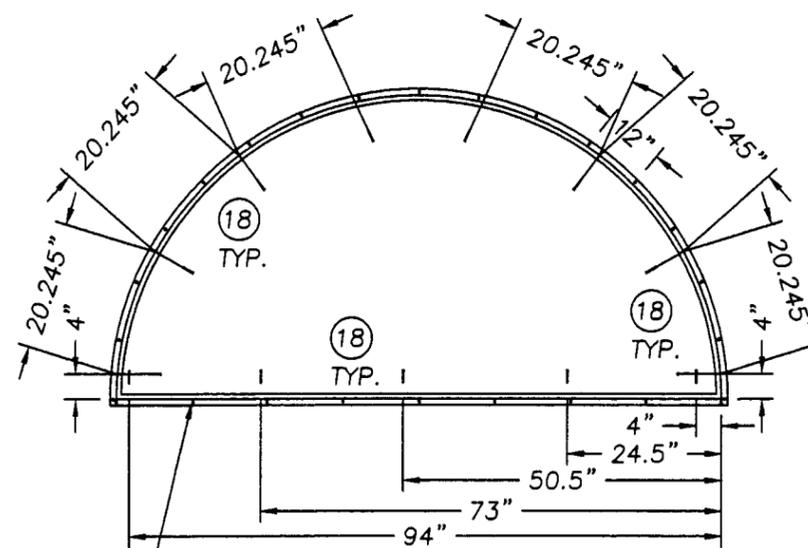


HALF CIRCLE DIRECT SET WITHOUT SASH

THERE ARE 26 ITEM #14 IN THE NAILING FIN SPACED AT: 1.0" FROM BOTH HORIZONTAL CORNERS AND 12.0" ON CENTER BETWEEN SCREWS. 1.0" FROM BOTH VERTICAL CORNERS AND 12.0" ON CENTER GOING AROUND THE RADIUS.

Approved as complying with the Florida Building Code
 Date April 10, 2007
 NOA# 01-1220-03
 Miami Dade Product Control Division
 By *[Signature]*

Parrett Windows
 Quality Crafted Specialty Windows
 PARRETT MFG., INC. 810 2nd Ave. East
 P.O. Box 440, Dorchester, WI 54425
 Phone (715)678-2125 FAX (715)678-2155




PRODUCT: PARRETT WINDOWS, ALUMINUM CLAD DIRECT SET/DIRECT SET SASH FIXED FRAME WINDOWS
 PART OR ASSEMBLY:
 ANCHORING LOCATIONS

NO.	DATE	REVISIONS
2	3/05/02	ANCHORING DETAIL RW
1	2/01/02	GENERAL RW
		BY


RW BUILDING CONSULTANTS, INC.
 813.684.3831

DATE: 09/24/01
 SCALE: N.T.S.
 DWG. BY: TJH
 CHK. BY: RW
 DRAWING NO.: S-2169
 SHEET 5 OF 6


ITEM	DESCRIPTION	MATERIAL
1	MAIN FRAME, F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
2	MAIN FRAME CLADDING, .055" EXTRUDED ALUM. (GORDON ALUMINUM)	ALUM.
3	GLAZING STOP (UNIT W/SASH) F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
4	SASH STOP F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
5	MAIN FRAME CLADDING RETAINER, .093" EXTRUDED ALUM. (GORDON ALUMINUM)	ALUM.
6	HEADER NAILING FIN/DRIP CAP .050" EXTRUDED ALUM. (GORDON ALUMINUM)	ALUM.
7	SIDE & SILL NAILING FIN .050" EXTRUDED ALUM. (GORDON ALUMINUM)	ALUM.
8	1/2" L. WIRE STAPLE	STEEL
9	#8 x 1 1/2" PFH WOOD SCREW (S & G FASTENERS)	STEEL
10	#6 x 1 1/4" PFH WOOD SCREW (S & G FASTENERS)	STEEL
11	GLAZING .5625" MIN. LAMINATED ANNEALED GLASS BY CARDINAL GLASS (SEA-STORM TYPE B)	-
12	GLAZING COMPOUND DOW 995 STRUCTURAL SILICONE	SILICONE
13	2X WOOD BUCK	WOOD
14	#10 x 1 1/2" PPH WOOD SCREW (S & G FASTENERS)	STEEL
15	WOOD SASH F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
16	#8 x 1 1/4" PFH WOOD SCREW (S & G FASTENERS)	STEEL
17	GLAZING STOP (UNIT W/OUT SASH) F. J. PONDEROSA PINE (PARRETT WINDOWS)	PINE
18	#10 x 2" PFH WOOD SCREW (S & G FASTENERS)	STEEL
19	#8 x 3" PFH WOOD SCREW (S & G FASTENERS)	STEEL

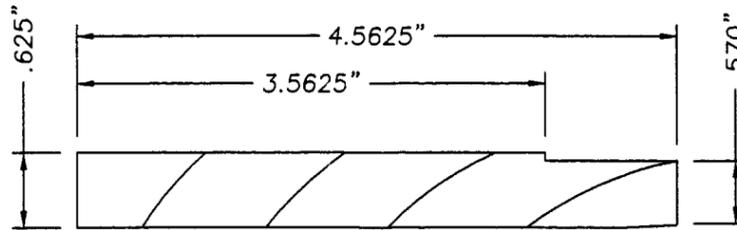


① MAIN FRAME, F. J. PONDEROSA PINE

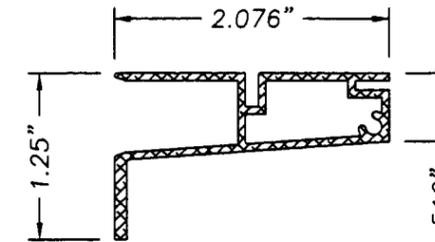


② MAIN FRAME CLADDING
.055" EXTRUDED ALUM.
GORDON ALUMINUM

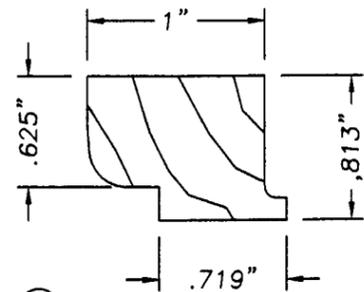


③ GLAZING STOP (UNIT W/OUT SASH)
F. J. PONDEROSA PINE
PARRETT WINDOWS

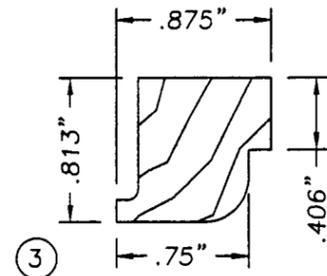


④ GLAZING STOP (UNIT W/SASH)
F. J. PONDEROSA PINE
PARRETT WINDOWS

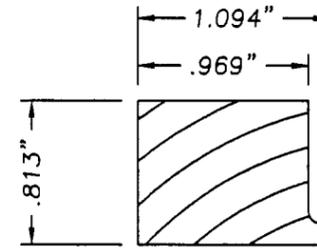


⑤ SASH STOP
F. J. PONDEROSA PINE
PARRETT WINDOWS

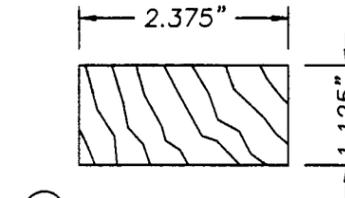


⑥ WOOD SASH
F. J. PONDEROSA PINE
PARRETT WINDOWS

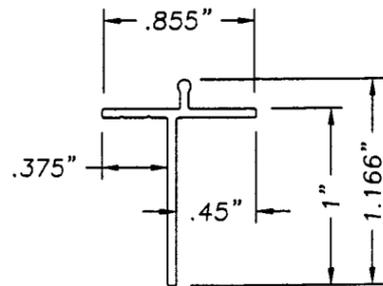

⑦ SIDE & SILL NAILING FIN
.050" EXTRUDED ALUM.
GORDON ALUMINUM

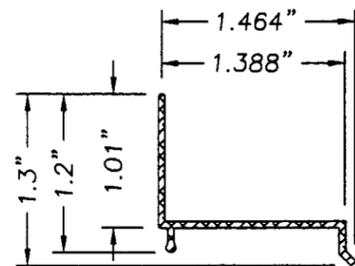

⑧ HEADER NAILING FIN/DRIP CAP
.050" EXTRUDED ALUM.
GORDON ALUMINUM



⑨ MAIN FRAME CLADDING RETAINER
.093" EXTRUDED ALUM.
GORDON ALUMINUM

Approved as complying with the
Florida Bidding Code
Date Apr 18, 2007
NOA# 01-1220-03
Miami Dade Product Control
Division
By *[Signature]*

Parrett Windows
Quality Crafted Specialty Windows
PARRETT MFG., INC. 810 2nd Ave. East
P.O. Box 440, Dorchester, WI 54425
Phone (715)678-2125 FAX (715)678-2155

PRODUCT:
PARRETT WINDOWS ALUMINUM
CLAD DIRECT SET/DIRECT SET
SASH FIXED FRAME WINDOWS
PART OR ASSEMBLY:
BILL OF MATERIALS
& UNIT COMPONENTS

NO	DATE	REVISIONS	BY
2	3/05/02	ANCHORING DETAIL	RW
1	2/01/02	GENERAL	RW
NO			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

DATE: 09/24/01
SCALE: N.T.S.
DWG. BY: TJH
CHK. BY: RW
DRAWING NO.: S-2169
SHEET 6 OF 6