



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Premdor Exterior Door Product  
1955 Powis Road  
West Chicago, IL 60185**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: 6'8" Outswing Opaque Insulated Fiberglass Door w & w/o Sidelites**

**APPROVAL DOCUMENT:** Drawing No. S-2181, dated 12/14/01, with revision #2 dated 06/30/02, titled "Exterior Door Product" Single & Double Outswing 6'8 Fiberglass Door, sheets 1 through 8, prepared by R. W. Building Consultants, Inc., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: None**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.  
The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 02-0109.09  
Expiration Date: August 22, 2007  
Approval Date: August 22, 2002  
Page 1**

# PREMDOR® "EXTERIOR DOOR PRODUCTS"

## OUT-SWING FIBERGLASS 6'8" OPAQUE SWING DOOR WITH & WITHOUT SIDELITES

### GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF FLORIDA BUILDING CODE.
6. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

### RESIDENTIAL INSULATED FIBERGLASS DOOR (Common to all frame conditions)

#### Door & Sidelite Leaf Construction:

**Face sheets:** Tan fiberglass facing wood grain 0.095" minimum thickness, White fiberglass facing smooth surface 0.075" minimum thickness, with yield strength  $F_y(\text{min.}) = 2,950$  psi by Applied Composites.

**Core design:** Polyurethane foam core, with 2.0 to 2.5 lbs.

density by BASF.

**Door Panel Construction:** The panel facing is constructed from 0.095" thick or 0.075" thick molded fiberglass. The wood stiles are laminated lumber with a pine cap. The top rail is constructed from Virola. The bottom rail is of a molded wood composite, kerfed to receive weatherstripping. The laminated lumber portion of the side stiles are notched back so that the top and bottom rails butt to the pine cap. The latch side stile is reinforced with a pine lock block measuring 1.581" x 2.0" high. The lock block is glued to the back of the latch stile. The fiberglass facings are then glued to the stiles & rails with an exterior grade structural adhesive. The interior cavity is filled with a polyurethane foam by BASF.

**Sidelite Panel Construction:** The sidelite panel is constructed the same as the door panel except that all the stiles and rails are constructed from virola.

**Frame Construction:** The single door frame is constructed from finger jointed pine. The double door frame is constructed from laminated lumber. In the continues header & threshold system a 1piece laminated lumber mullion is used. In the split header & threshold system the mullion is a 2piece jamb of laminated lumber. The header is attached to the side jambs with (3) 2.0" long x 1/2" crown wire staples. The units utilize a high dam bump face threshold measuring 5.25" deep x 1.75" high. The thresholds are attached to the side jambs with (2) #8 x 1 3/4" long phillips flat head screws.

**Sidelite Glazing:** The side lite panels are glazed with 1" & 0.50" insulated tempered glass with 0.50" glass bite. The sidelite panels are sandwich glazed using a two piece lip lite frame. The frames are wet glazed on the exterior and interior side with Dow #995 silicone. The frames are held together with #6 x 1 1/2" pan head lite frame screws.

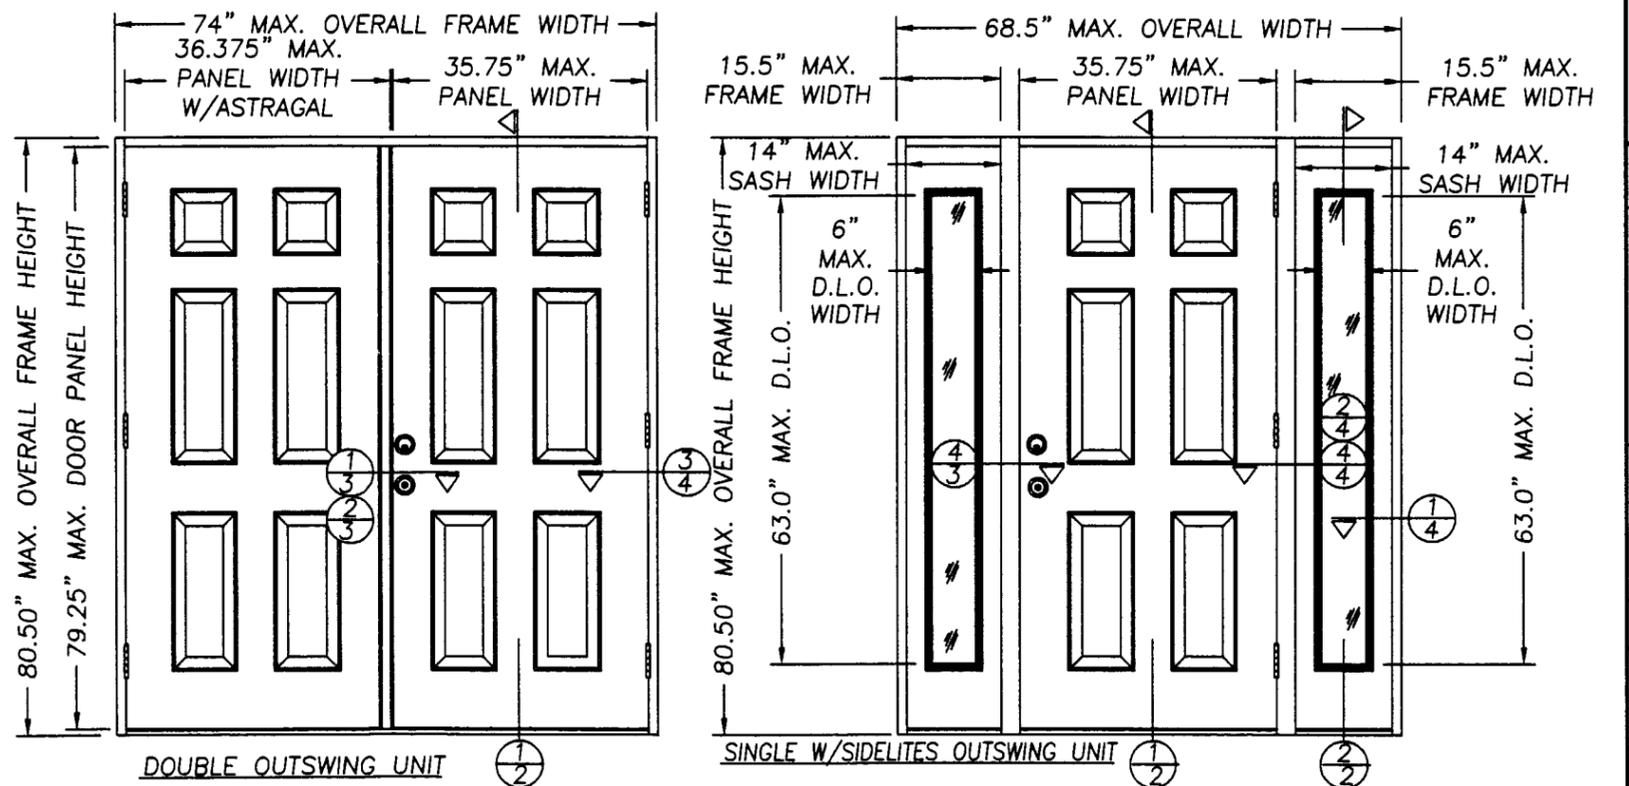
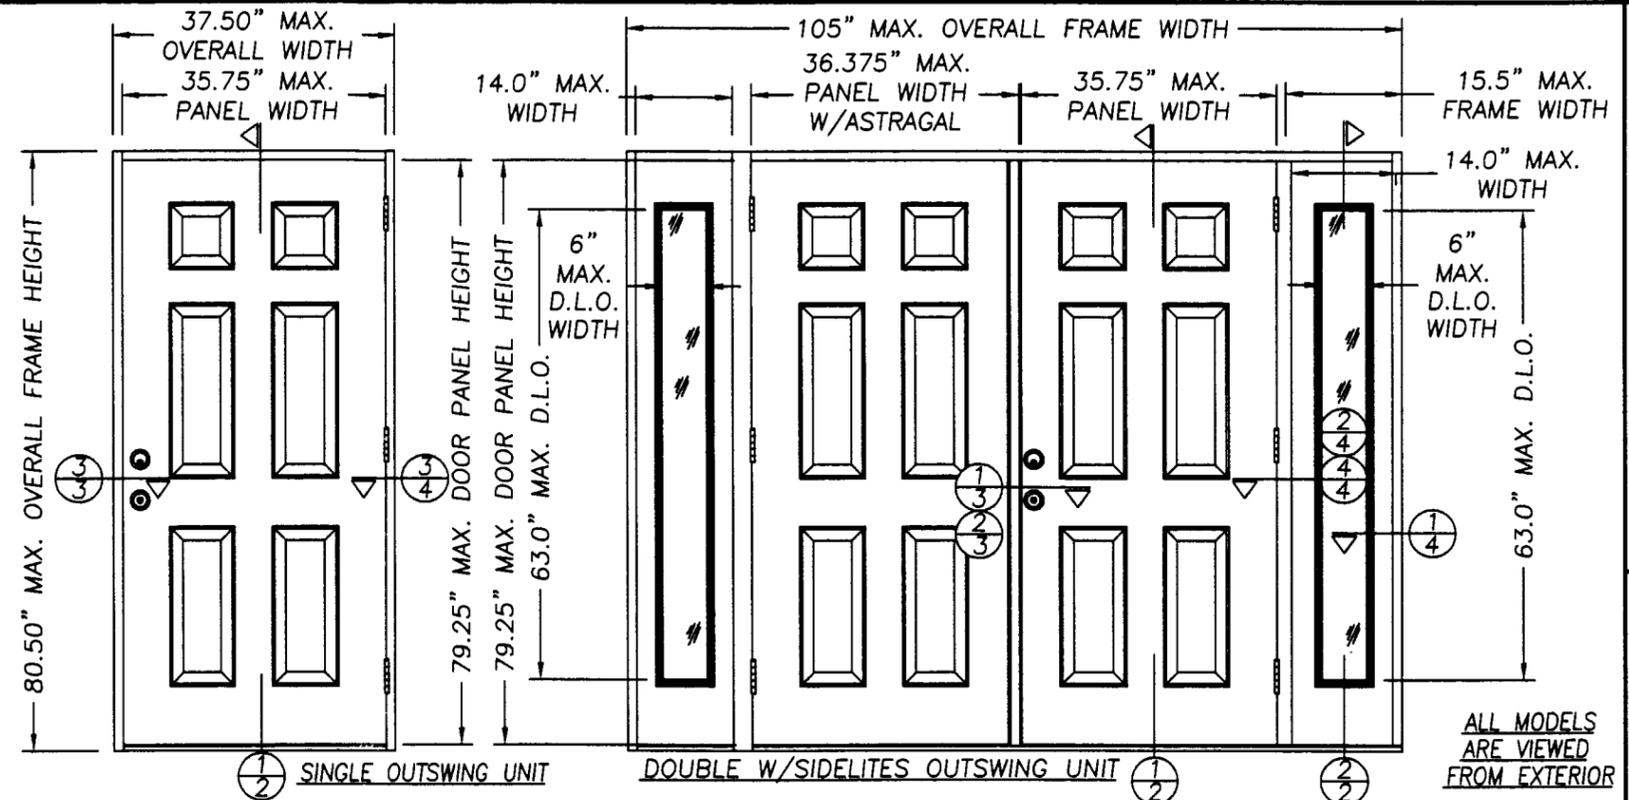


TABLE OF CONTENTS	
SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & DETAILS
7	GLAZING DETAILS & NOTES
8	UNIT COMPONENTS

DESIGN PRESSURE RATING	
UNIT TYPE	WHERE WATER INFILTRATION IS NEEDED
SINGLE	+ 70.0 PSF - 70.0 PSF
DOUBLE	+ 60.0 PSF - 60.0 PSF
SINGLE & DOUBLE WITH SIDELITES	+ 60.0 PSF - 60.0 PSF

Approved as complying with the Florida Building Code  
 Date Aug. 22, 2002  
 NOA# 02-0109-09  
 Miami Dade Product Control Division  
 By [Signature]


PREMDOR EXTERIOR DOOR PRODUCTS  
 1955 POWIS ROAD  
 WEST CHICAGO, IL. 60185  
 PH. (630) 584-6330

PRODUCT: "EXTERIOR DOOR PRODUCT" SINGLE & DOUBLE OUTSWING 6'8" FIBERGLASS DOOR  
 PART OR ASSEMBLY:  
 TYPICAL ELEVATIONS & GENERAL NOTES


NO.	DATE	REVISIONS	BY
2	6/30/02	CORRECT B.O.M.	RW
1	03/05/02	GENERAL REVISION	WLN

**RW** BUILDING CONSULTANTS, INC.  
 813.684.3831

DATE: 12/14/01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2181  
 SHEET 1 OF 8

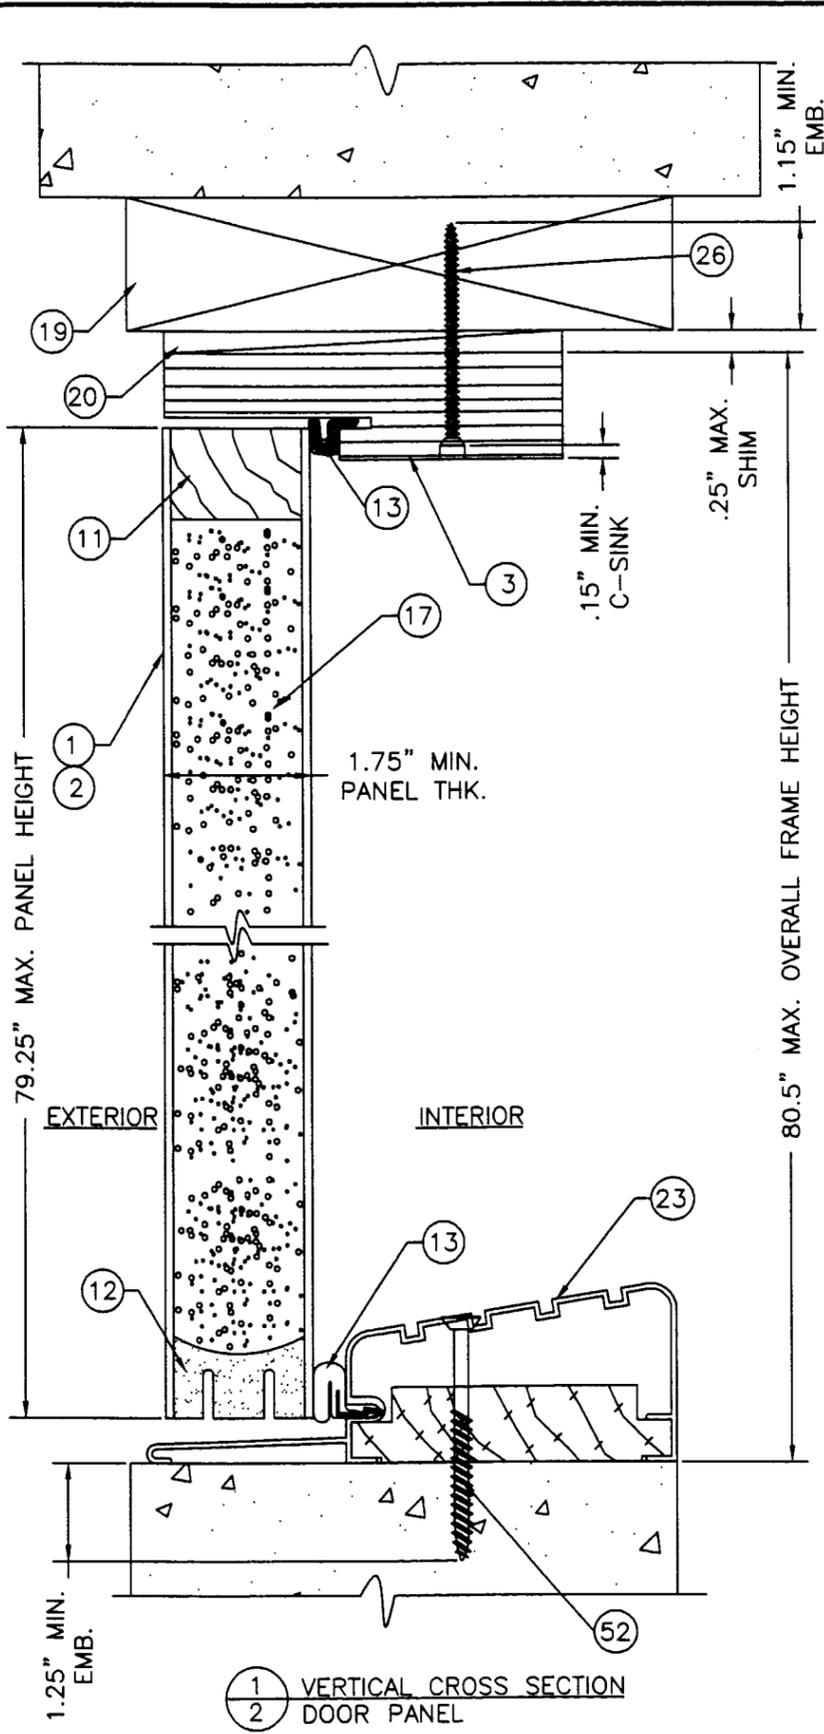

1 VERTICAL CROSS SECTION DOOR PANEL  
2 VERTICAL CROSS SECTION SIDELITE PANEL

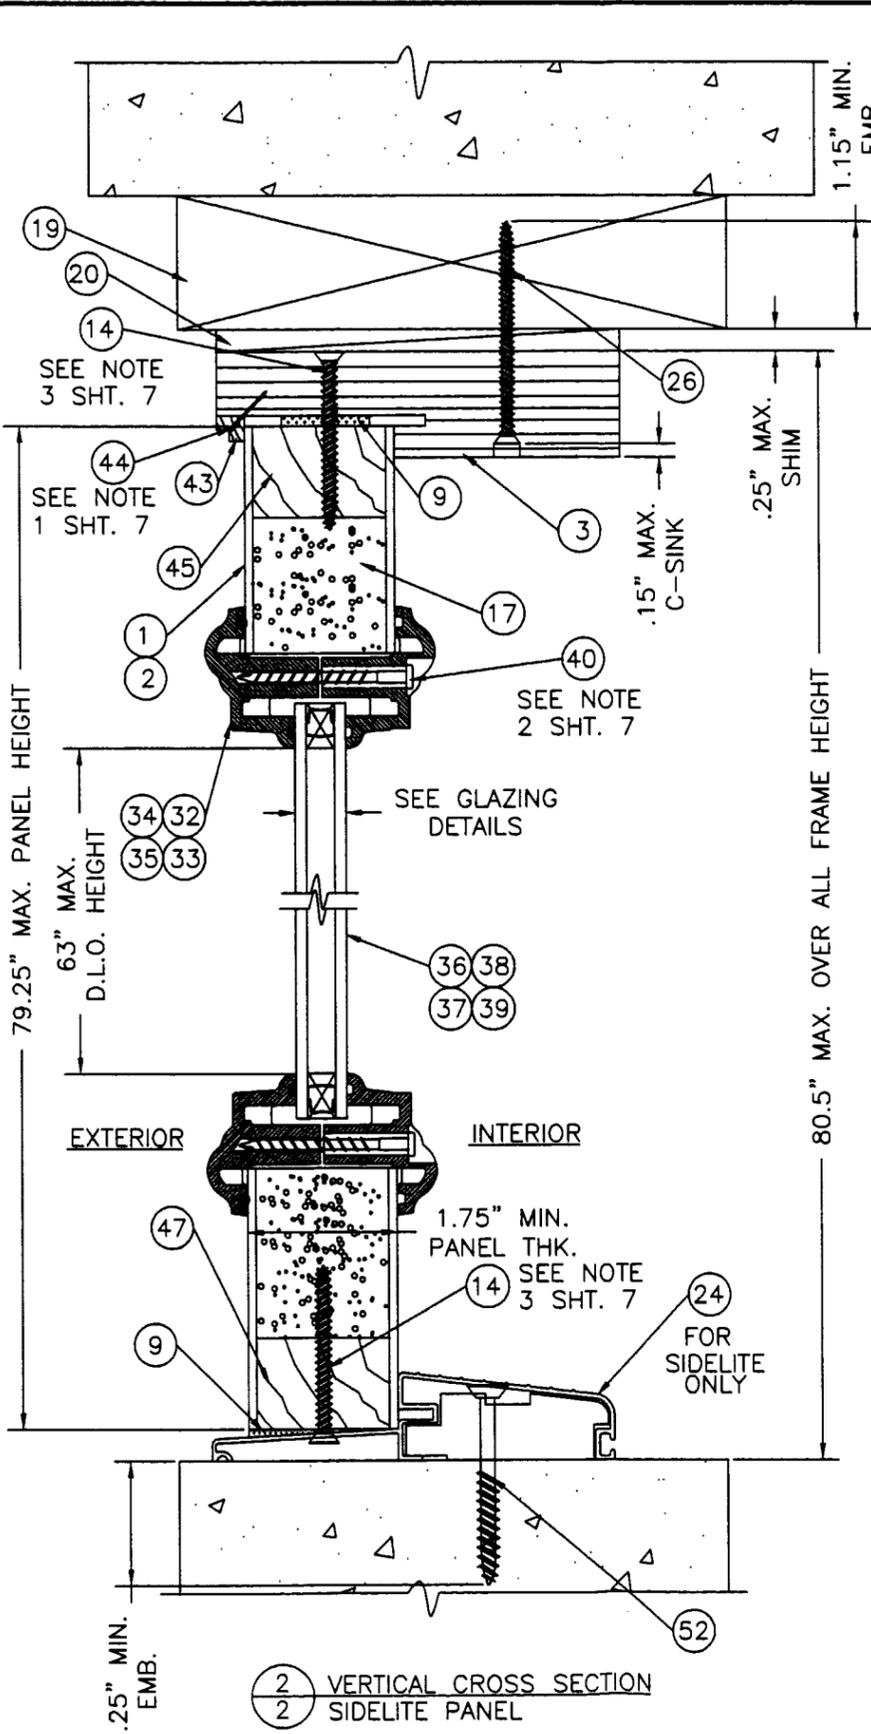

2 VERTICAL CROSS SECTION SIDELITE PANEL

ITEM	DESCRIPTION	MATERIAL
1	FIBERGLASS DOOR FACING 0.095" THK. TAN WOOD GRAIN BY APPLIED COMPOSITES	FIBERGLASS
2	FIBERGLASS DOOR FACING 0.075" THK. WHITE SMOOTH BY APPLIED COMPOSITES	FIBERGLASS
3	HEAD JAMB	LAM. LUMBER
4	HINGE JAMB	LAM. LUMBER
5	SIDELITE BLANK JAMB	LAM. LUMBER
6	4" x 4" BUTT HINGE 12ga. (.097" HAGER)	STEEL
7	#10 x 3/4" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
8	DOOR LATCH & HINGE SIDE STILE (LVL W/FJ PINE FACE)	LAM. LUMBER
9	PAK WIK SPACER	-
10	LATCH JAMB	LAM. LUMBER
11	DOOR TOP RAIL	VIROLA
12	DOOR BOTTOM RAIL (WOOD COMPOSITE)	COMPOSITE
13	COMPRESSION WEATHERSTRIP (LOXSCREEN LOXSEAL V-9650)	FOAM
14	#10 x 2" PFH WOOD SCREW	STEEL
15	LOCK BLOCK (1.581" W x 2.0" H x 21" L)	WOOD
16	#8 x 1 3/4" PFH WOOD SCREW	STEEL
17	POLYURETHANE FOAM CORE (BASF 2.0 TO 2.5lbs./sq. ft)	FOAM
18	SIDELITE BLANK JAMB (FINGERJOINT PINE)	WOOD
19	2x INNER WOOD SUB BUCK	WOOD
20	SHIM MATERIAL (.25" MAX. THK.)	-
21	KWIKSET 400 SERIES KNOB	-
22	KWIKSET TITAN 700 SERIES DEADBOLT	-
23	OUTSWING HIGH DAM BUMP THRESHOLD BY IMPERIAL .051" ALUM.	ALUM.
24	OUTSWING BUMP THRESHOLD BY WORLD WIDE .050" ALUM.	ALUM.
25	SILICONE CAULK DOW SILICONE #995	SILICONE
26	#8 x 2 1/2" PFH WOOD SCREW	STEEL
27	NOT USED	-
28	1PIECE MULLION (2 1/2" x 4 3/8" LAMINATED LUMBER)	LAM. LUMBER
29	ASTRAGAL EXTRUDED ALUM. (WR68P WINDJAMBER II)	ALUM.
30	ASTRAGAL EXTRUDED ALUM. (ULTIMATE ASTRAGAL BY ENDURA)	ALUM.
31	NOT USED	-
32	LIP LITE FRAME .5" GLASS (BY TRINITY/AMPAC)	POLYPROP.
33	LIP LITE FRAME .5" GLASS (ODL HP POLYPROP.THERMOFIL-P6-30FM0391)	POLYPROP.
34	LIP LITE FRAME .5" GLASS (BY RSL)	PVC
35	LIP LITE FRAME .5" GLASS (BY SPECIALTY/BAYLITE)	POLYPROP.
36	.5" INSULATED TEMP. GLASS (BY TRINITY)	-
37	.5" INSULATED TEMP. GLASS (BY WESTERN REFLECTIONS)	-
38	.5" INSULATED TEMP. GLASS (BY RSL)	-
39	1" INSULATED TEMP. GLASS (BY BAYLITE)	-
40	#6 x 1 1/2" PANHEAD SCREW (LITE FRAME)	STEEL
41	#8 x 1" PFH WOOD SCREW	STEEL
42	#10 x 2 1/2" PFH WOOD SCREW	STEEL
43	WOOD SIDELITE TRIM 5/16" x 1/2"	PINE
44	16GA. PIN NAIL x 3/4" LONG	STEEL
45	SIDELITE TOP RAIL (1.581" W x 1.027"H) VIROLA	VIROLA
46	SIDELITE SIDE STILE (1.581" W x 1.027"H) VIROLA	VIROLA
47	SIDELITE BOTTOM RAIL (1.581" W x 1.027"H) VIROLA	VIROLA
48	HEAD JAMB (FINGERJOINT PINE)	WOOD
49	HINGE JAMB (FINGERJOINT PINE)	WOOD
50	NOT USED	-
51	LATCH JAMB (FINGERJOINT PINE)	WOOD
52	1/4" TAPCON	STEEL
53	#10 x 3" PFH WOOD SCREW	STEEL

Approved as complying with the Florida Building Code  
Date Aug. 22, 2002  
NOA# 02-0109.09  
Miami Dade Product Control  
Division  
By [Signature]


**PREMDOR EXTERIOR DOOR PRODUCTS**  
1955 POWIS ROAD  
WEST CHICAGO, IL. 60185  
PH. (630) 584-6330

PRODUCT: "EXTERIOR DOOR PRODUCT" SINGLE & DOUBLE OUTSWING 6'8" FIBERGLASS DOOR  
PART OR ASSEMBLY: VERTICAL CROSS SECTIONS


NO.	DATE	REVISIONS
2	6/30/02	CORRECT B.O.M.
1	03/05/02	GENERAL REVISION

DATE: 12/14/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2181  
SHEET 2 OF 8


RW BUILDING CONSULTANTS, INC.  
813.684.3831

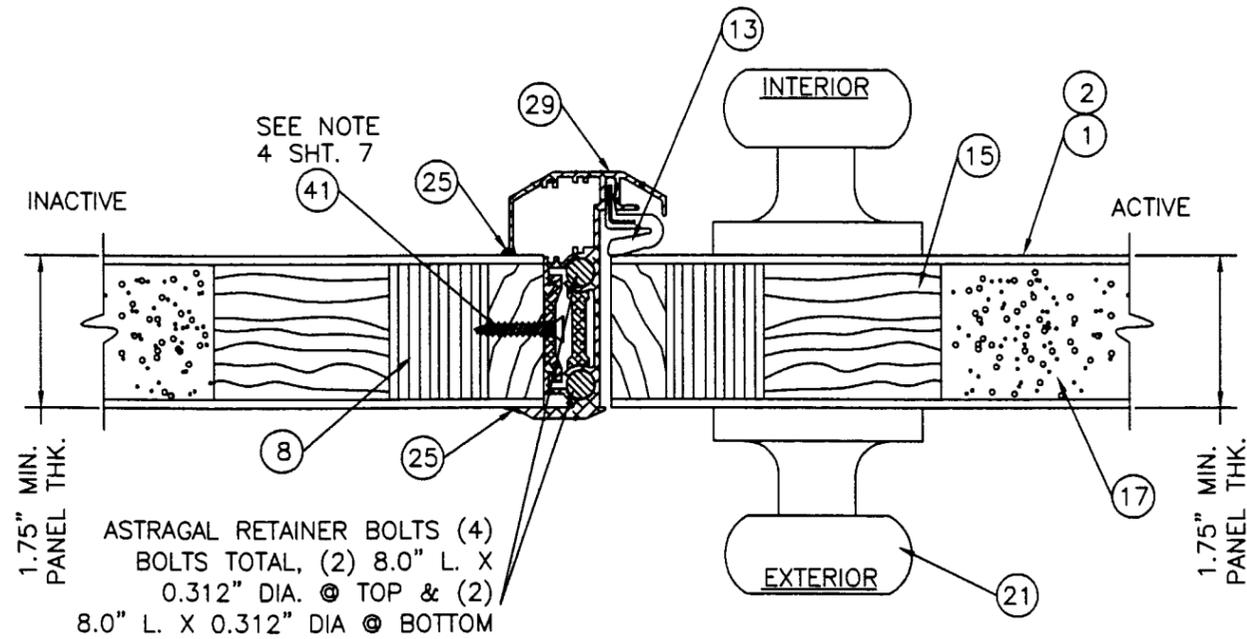


1 HORIZONTAL CROSS SECTION  
 3 OUTSWING UNIT  
 W/WINDJAMBER II ASTRAGAL MFG BY  
 GENESIS ARCHITECTURAL PRODUCTS

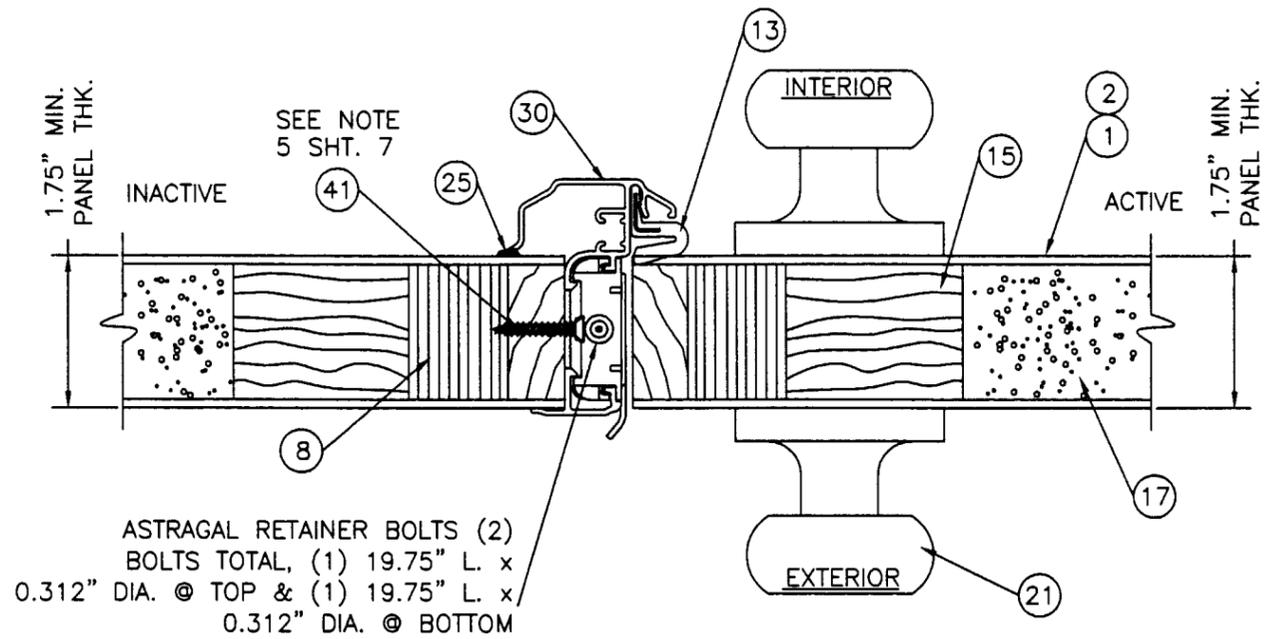

2 HORIZONTAL CROSS SECTION  
 3 OUTSWING UNIT  
 ULTIMATE ASTRAGAL MFG BY  
 ENDURA PRODUCTS

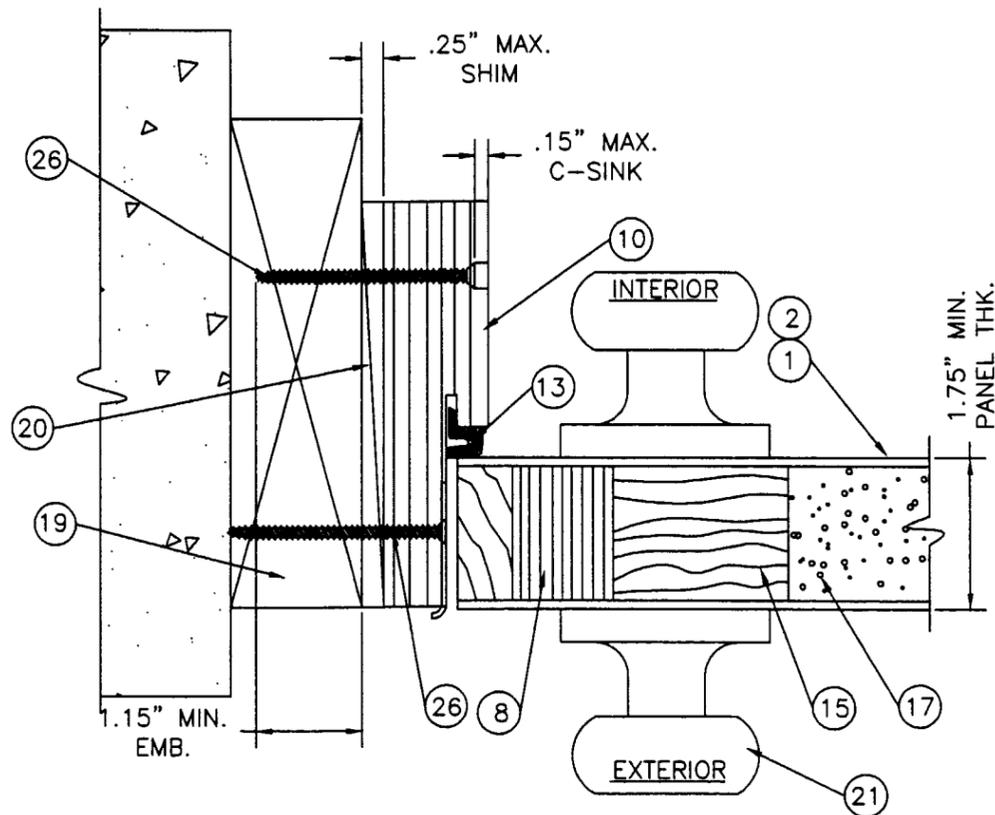

3 HORIZONTAL CROSS SECTION  
 3 LATCH JAMB TO BUCK

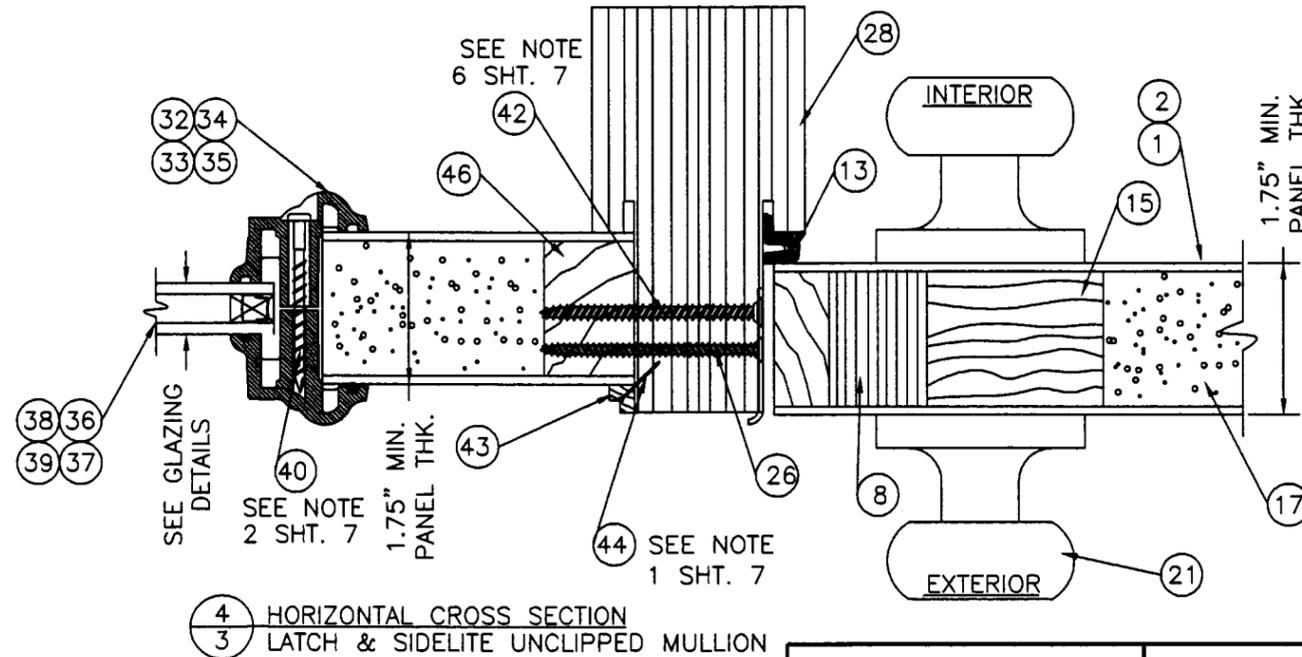

4 HORIZONTAL CROSS SECTION  
 3 LATCH & SIDELITE UNCLIPPED MULLION

PREMDOR EXTERIOR DOOR PRODUCTS  
 1955 POWIS ROAD  
 WEST CHICAGO, IL. 60185  
 PH. (630) 584-6330


PRODUCT: "EXTERIOR DOOR PRODUCT"  
 SINGLE & DOUBLE OUTSWING  
 6.8 FIBERGLASS DOOR  
 PART OR ASSEMBLY:  
 HORIZONTAL CROSS  
 SECTIONS

NO.	DATE	REVISIONS	BY
2	6/30/02	CORRECT B.O.M.	RW
1	03/05/02	GENERAL REVISION	WLN


RW BUILDING  
 CONSULTANTS, INC.  
 813.684.3831

DATE: 12/14/01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2181  
 SHEET 3 OF 8


Approved as complying with the  
 Florida Building Code  
 Date Aug. 22, 2002  
 NOA# 02-0109.09  
 Miami Dade Product Control  
 Division  
 By Manuel Perez

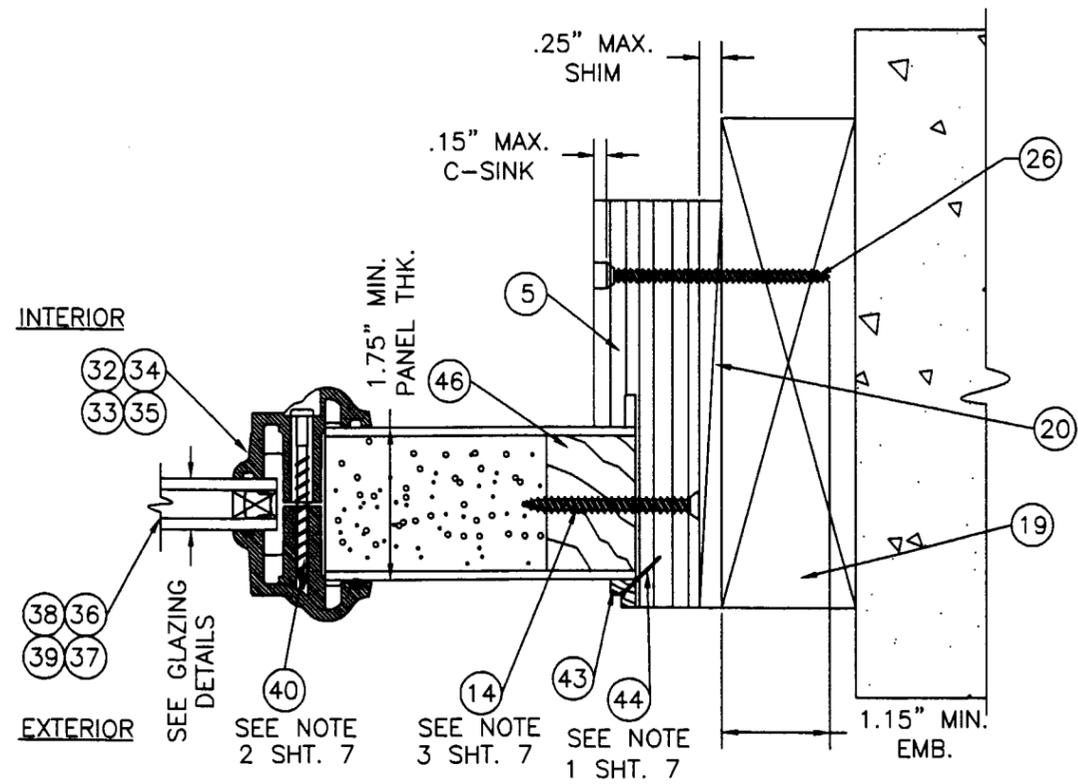


1 HORIZONTAL CROSS SECTION  
4 SIDELITE TO BUCK

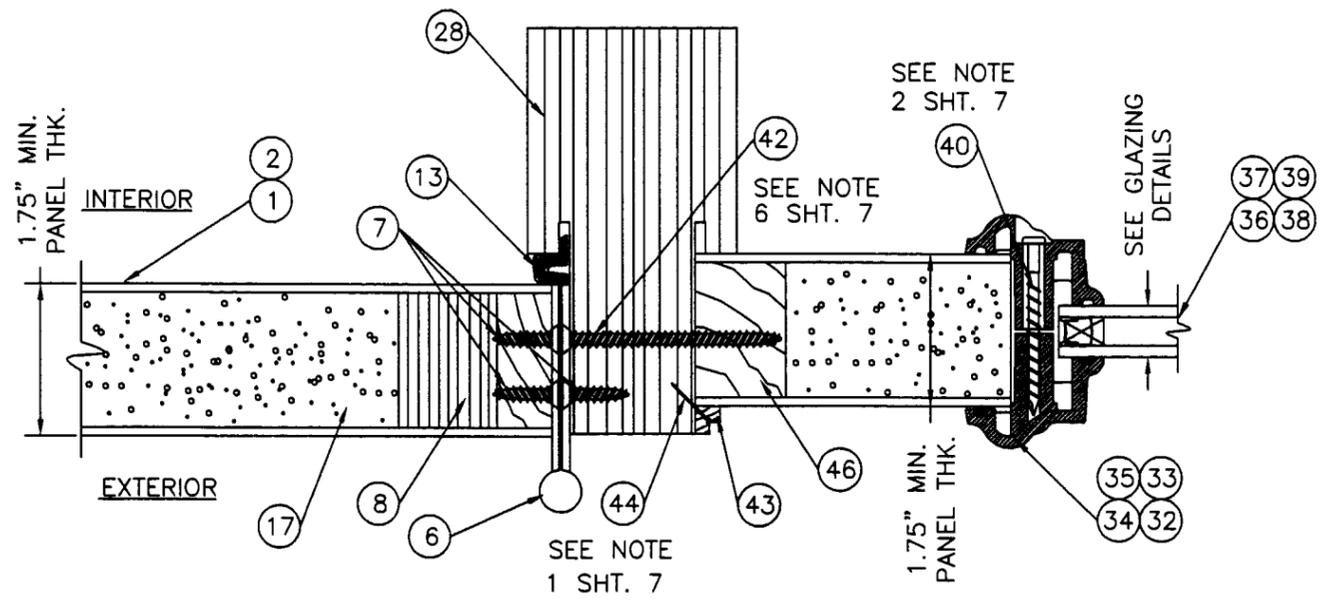

2 HORIZONTAL CROSS SECTION  
4 HINGE TO SIDELITE  
NOTE: UNCLIPPED LAMINATED MULLION USED WITH CONTINUOUS HEAD & THRESHOLD

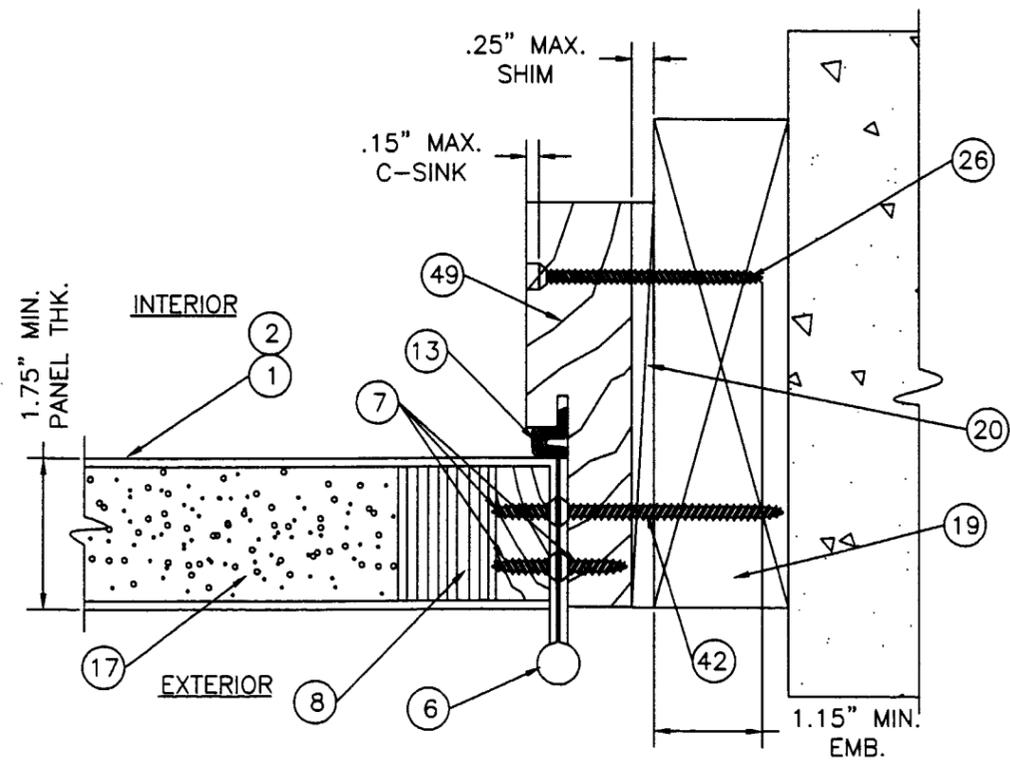

3 HORIZONTAL CROSS SECTION  
4 HINGE JAMB TO BUCK  
(FINGER JOINT PINE SHOWN THIS CROSS SECTION)

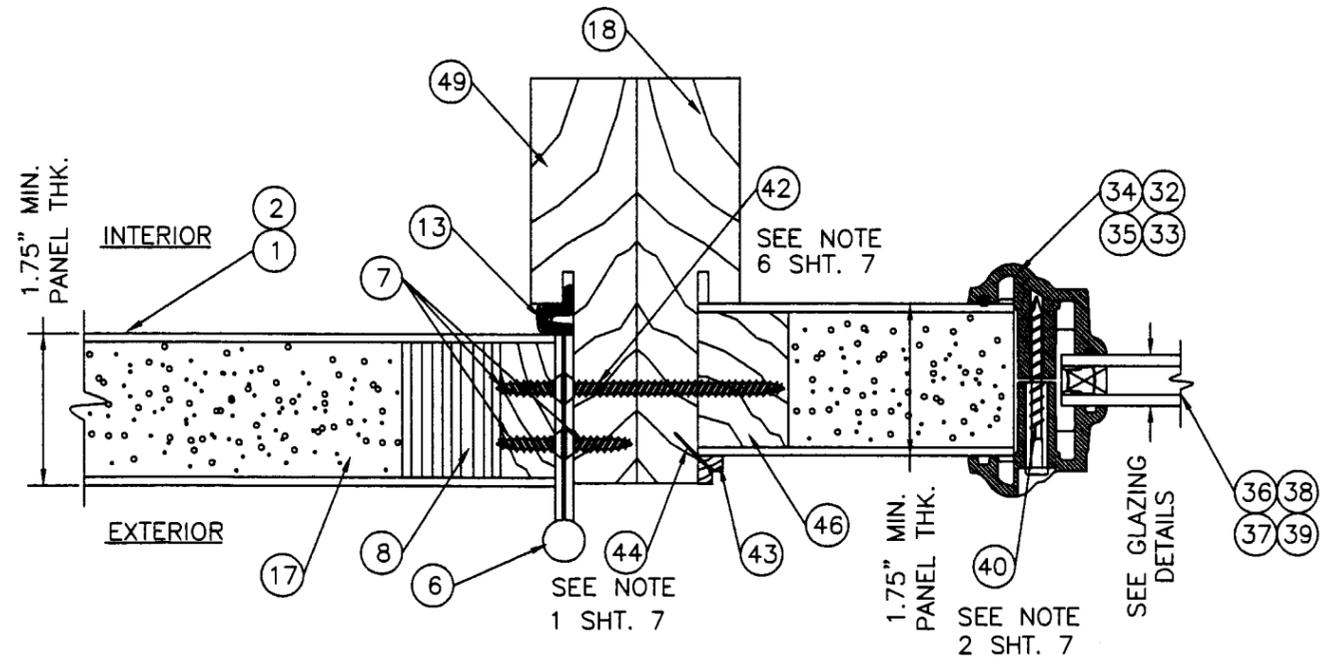

4 HORIZONTAL CROSS SECTION  
4 HINGE TO SIDELITE  
NOTE: DOOR & SIDELITE JAMB FORMS UNCLIPPED MULLION WHEN NOT USING CONTINUOUS HEAD & THRESHOLD (FINGER JOINT PINE SHOWN THIS CROSS SECTION)

NOTE: VERTICAL JAMBS ARE JOINED WITH CONSTRUCTION ADHESIVE (PL-P739)

Approved as complying with the Florida Building Code  
Date: Aug. 22, 2002  
NOA# 02-0109.09  
Miami Dade Product Control  
Division  
By: *Manuel Perez*




PREMDOR EXTERIOR DOOR PRODUCTS  
1955 POWIS ROAD  
WEST CHICAGO, IL. 60185  
PH. (630) 584-6330

PRODUCT: "EXTERIOR DOOR PRODUCT" SINGLE & DOUBLE OUTSWING 6/8 FIBERGLASS DOOR  
PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS


NO	DATE	REVISIONS	BY
2	6/30/02	CORRECT B.O.M.	RW
1	03/05/02	GENERAL REVISION	WLN

**RW** BUILDING CONSULTANTS, INC.  
813.684.3831

DATE: 12/14/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2181  
SHEET 4 OF 8

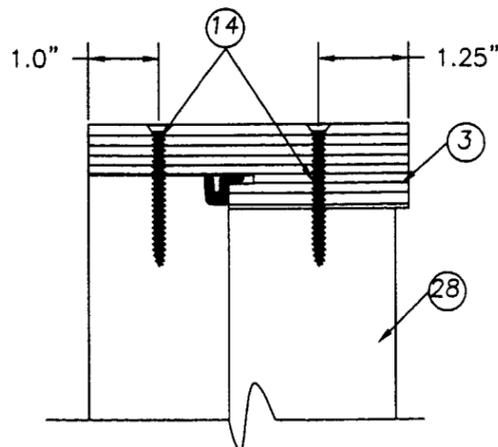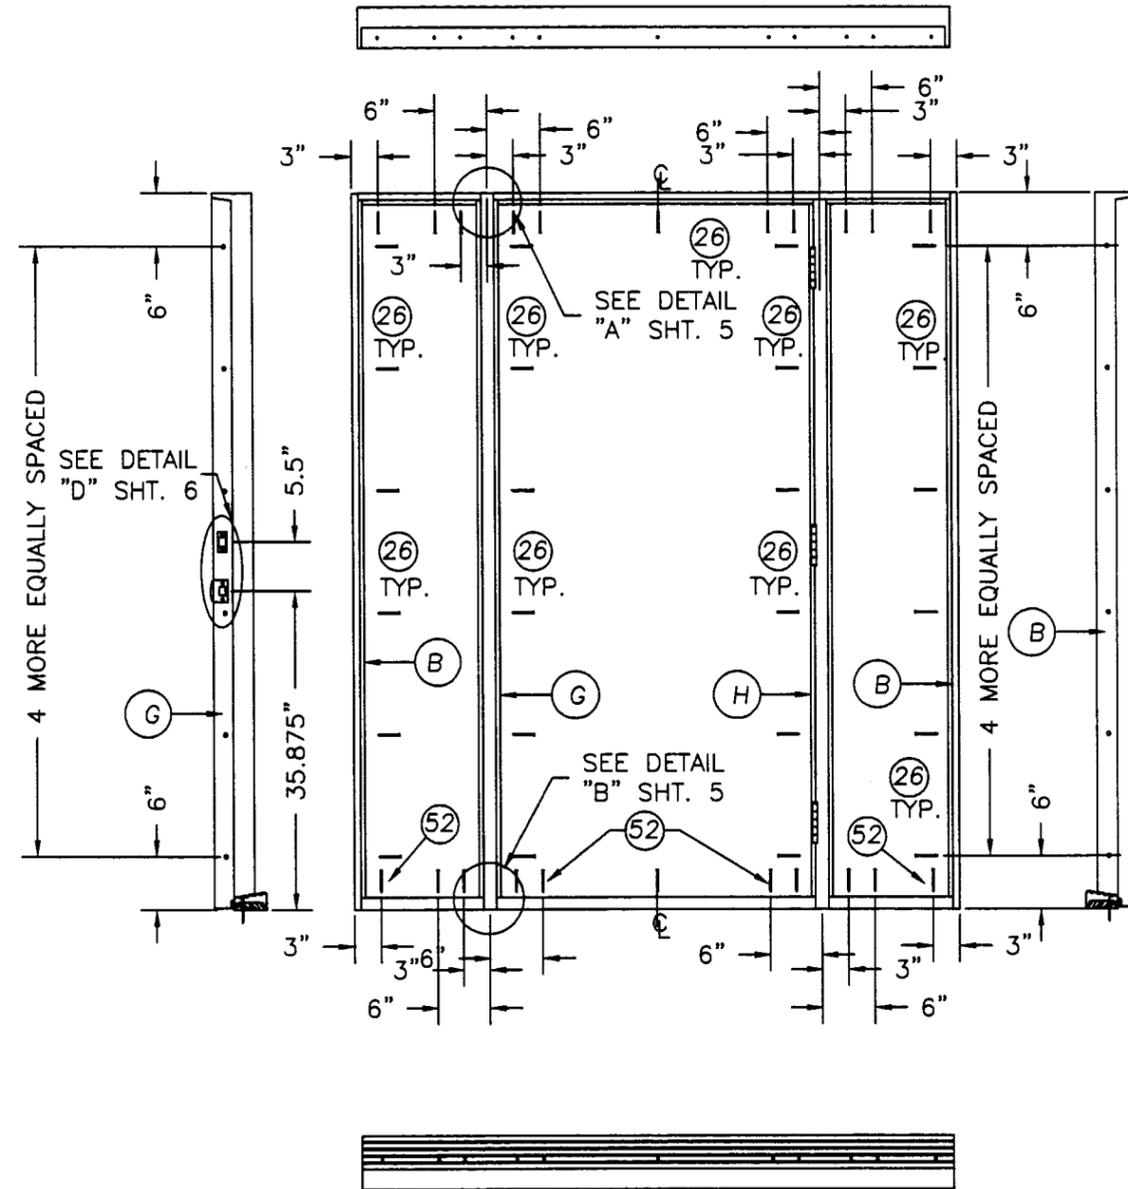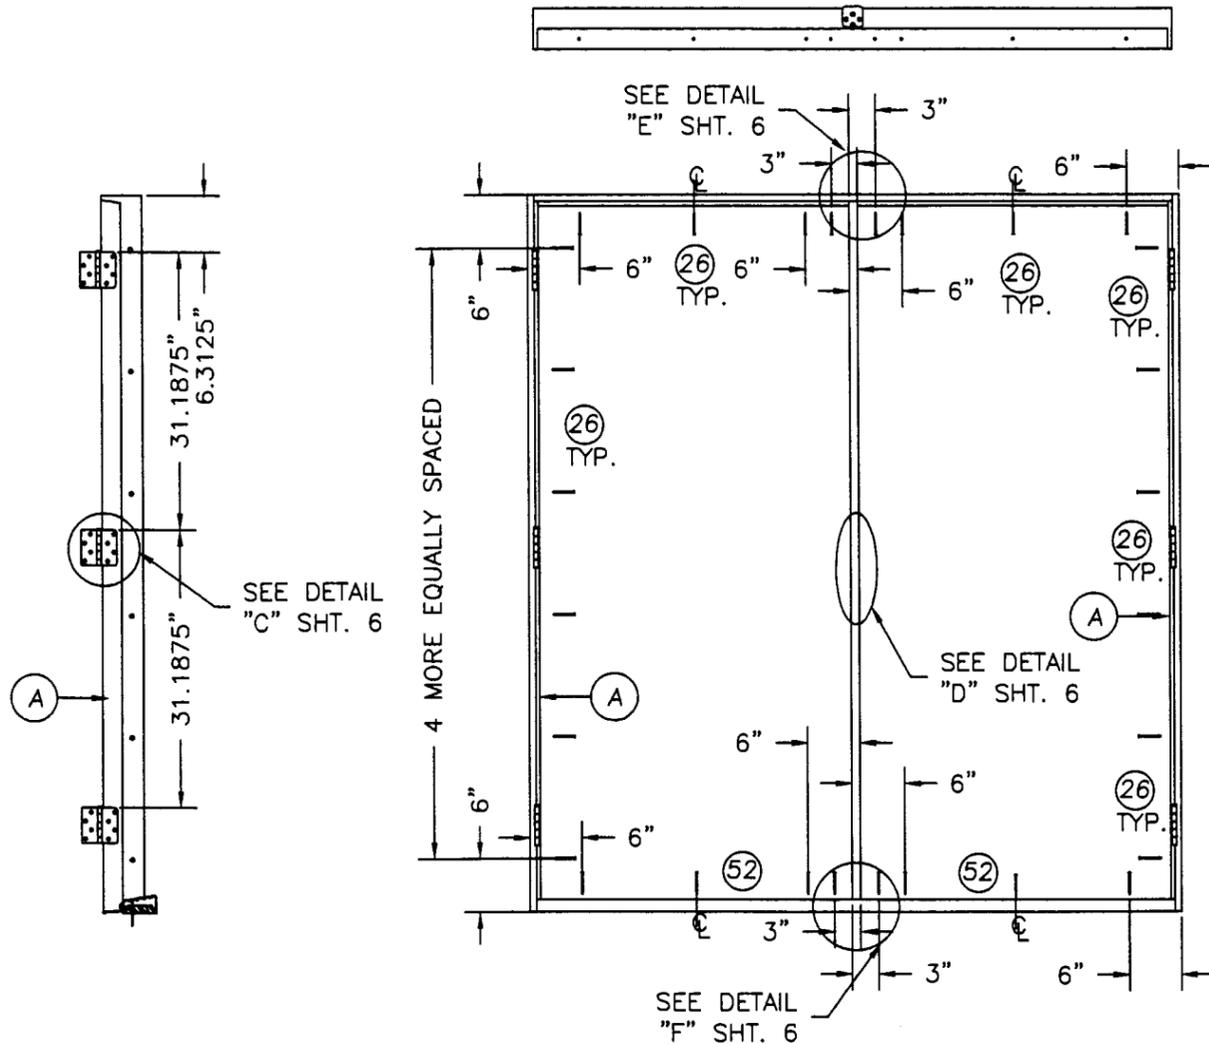

DETAIL "A" UNCLIPPED LAMINATED MULLION ATTACHED TO CONTINUOUS HEADER

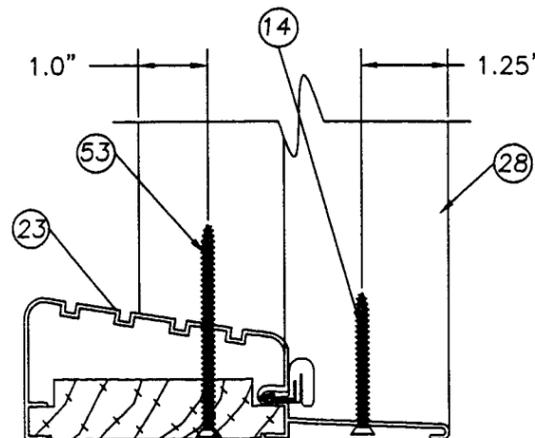

DETAIL "B" UNCLIPPED LAMINATED MULLION ATTACHMENT TO CONTINUOUS THRESHOLD

**PREMDOR EXTERIOR DOOR PRODUCTS**  
 1955 POWIS ROAD  
 WEST CHICAGO, IL. 60185  
 PH. (630) 584-6330



PRODUCT: "EXTERIOR DOOR PRODUCT"  
 SINGLE & DOUBLE OUTSWING  
 6 8 FIBERGLASS DOOR  
 PART OR ASSEMBLY:  
 ANCHORING LOCATIONS

NO.	DATE	REVISIONS	BY
2	6/30/02	CORRECT B.O.M.	RW
1	03/05/02	GENERAL REVISION	WLN

**RW** BUILDING CONSULTANTS, INC.  
 813.684.3831

DATE: 12/14/01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2181  
 SHEET 5 OF 8

Approved as complying with the Florida Building Code  
 Date AUG. 26, 2002  
 NOA# 02-0109-09  
 Miami Dade Product Control  
 Division  
 By Mauro J...

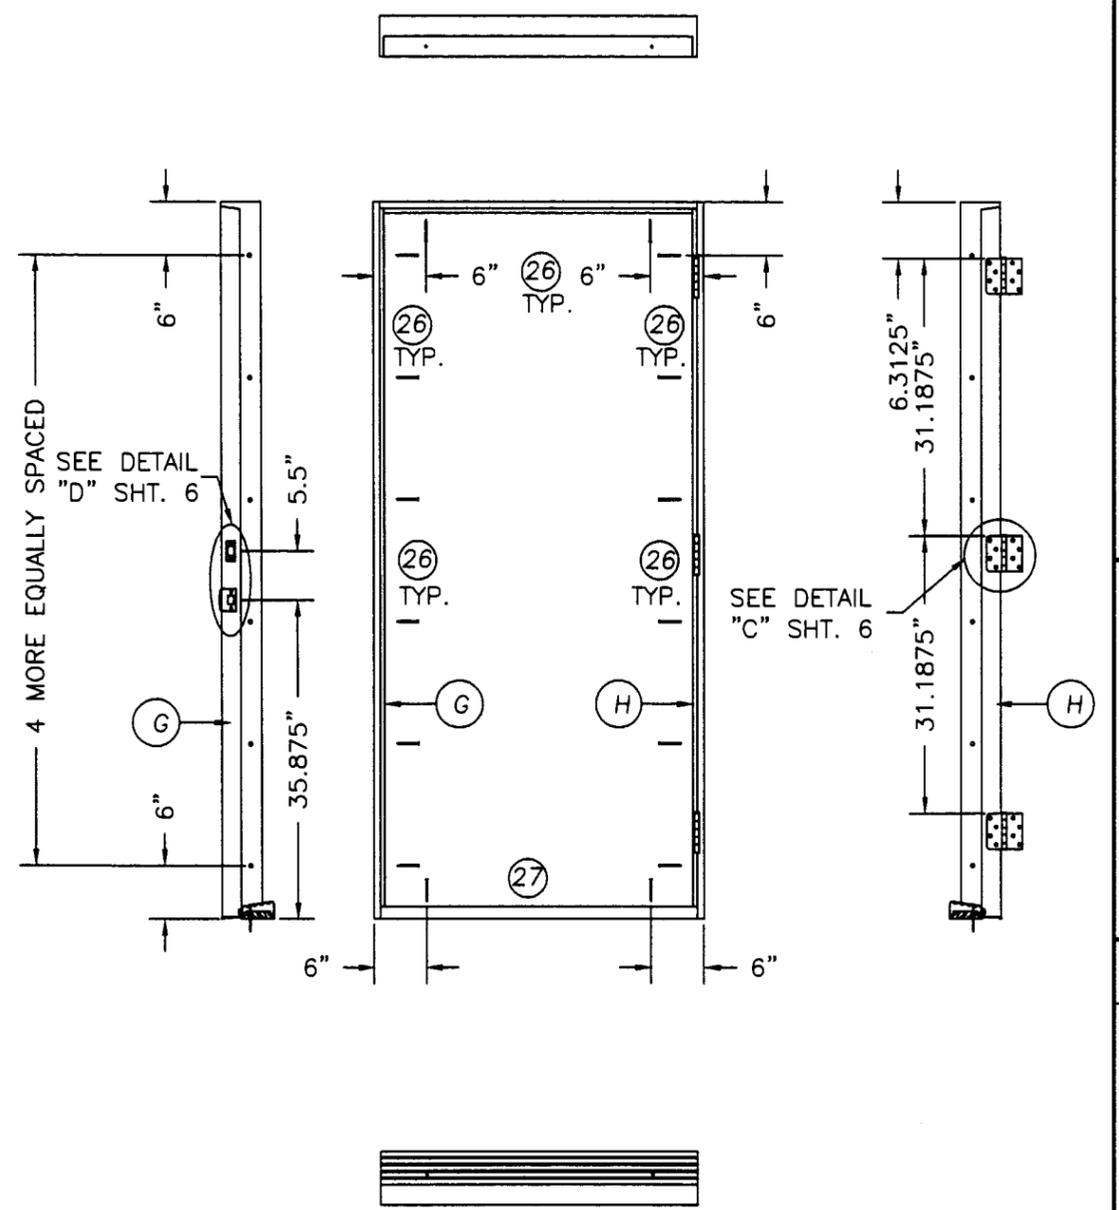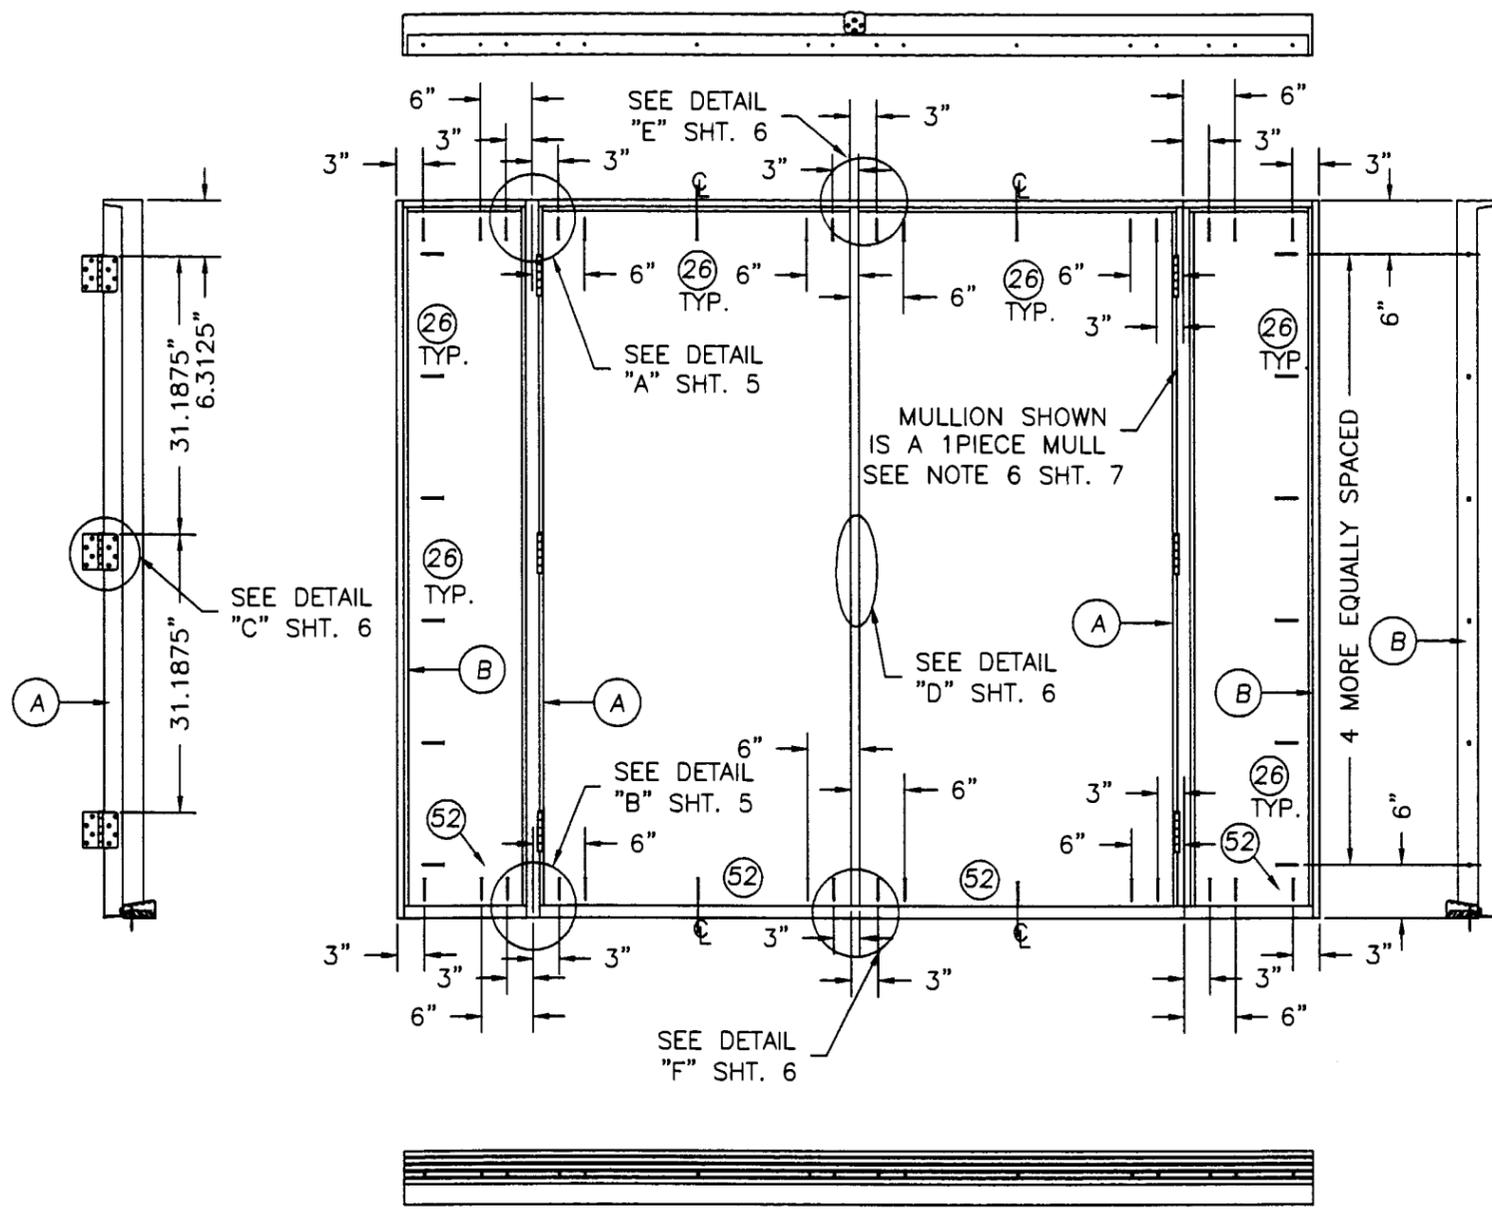


**PREMDOR EXTERIOR DOOR PRODUCTS**  
 1955 POWIS ROAD  
 WEST CHICAGO, IL. 60185  
 PH. (630) 584-6330


PRODUCT: "EXTERIOR DOOR PRODUCT"  
 SINGLE & DOUBLE OUTSWING  
 6"8 FIBERGLASS DOOR  
 PART OR ASSEMBLY:  
 ANCHORING LOCATIONS  
 & DETAILS

NO	DATE	REVISIONS	BY
2	6/30/02	CORRECT B.O.M.	RW
1	03/05/02	GENERAL REVISION	WLN


**RW** BUILDING  
 CONSULTANTS, INC.  
 813.684.3831

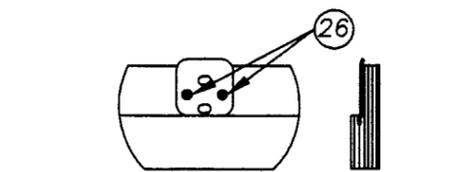


**DETAIL "E" WINDJAMBER ASTRAGAL**  
 ATTACH ASTRAGAL RETAINER BOLT  
 STRIKE PLATE TO FRAME  
 AS SHOWN AT HEADER




**DETAIL "E" ENDURA ASTRAGAL**  
 ATTACH ASTRAGAL RETAINER BOLT  
 STRIKE PLATE TO FRAME  
 AS SHOWN AT HEADER

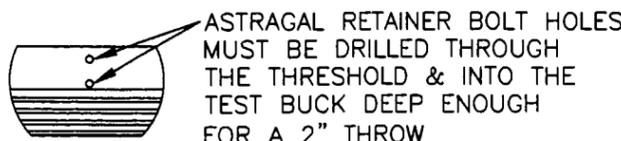


**DETAIL "F" WINDJAMBER ASTRAGAL AT SILL**

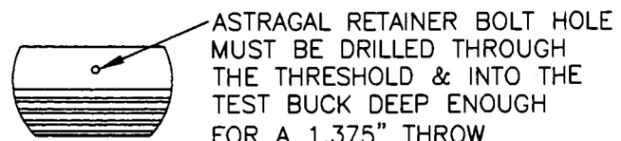

**DETAIL "F" ENDURA ASTRAGAL AT SILL**

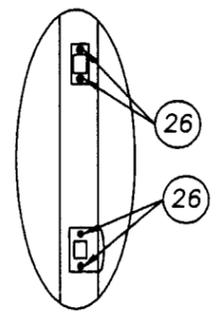




**DETAIL "D"**

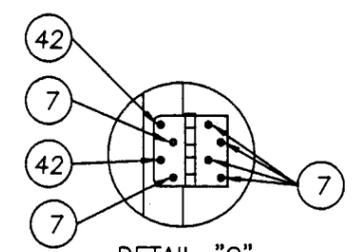

**DETAIL "C"**

Approved as complying with the  
 Florida Building Code  
 Date Aug. 22, 2002  
 NOA# 02-0109.09  
 Miami Dade Product Control  
 Division  
 By Manuel J...

DATE: 12/14/01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2181  
 SHEET 6 OF 8

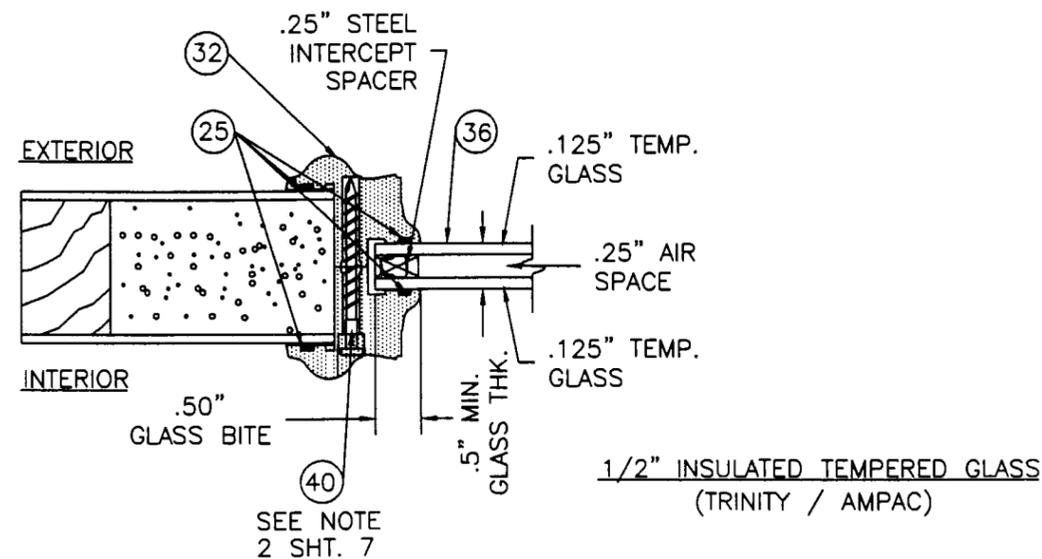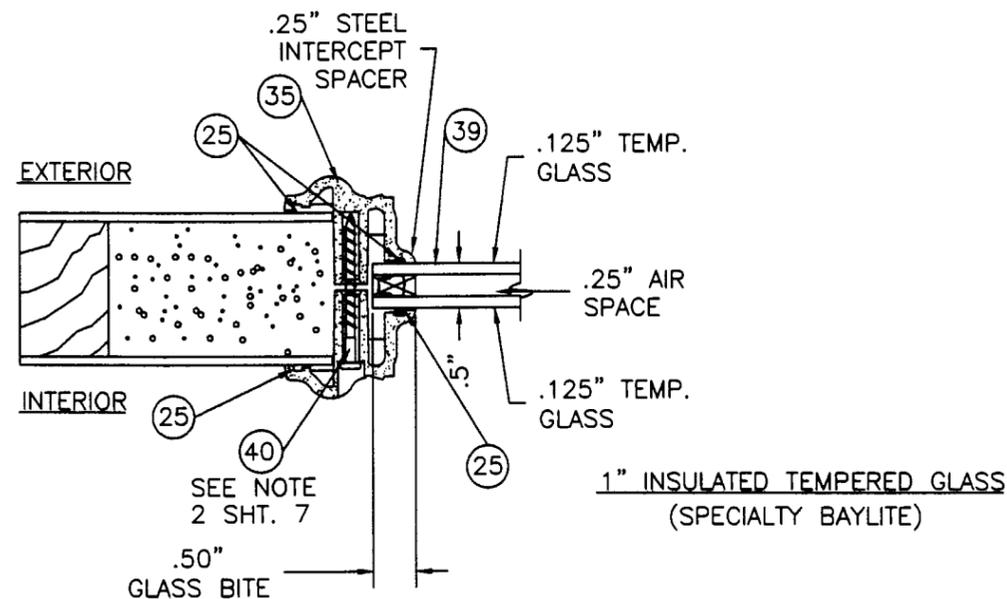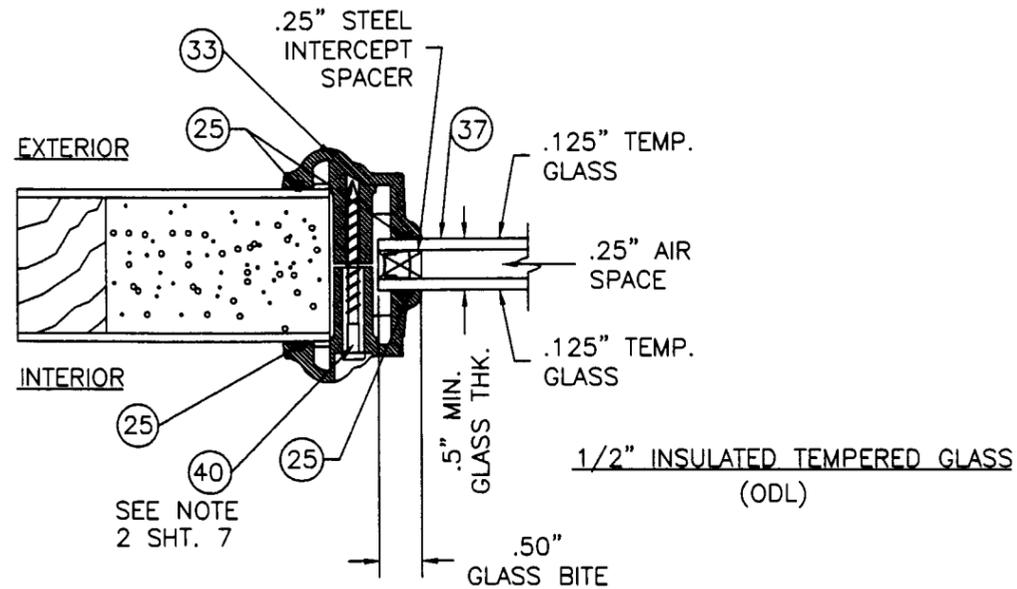

NOTES:

- SPACING FOR ITEM #44 THE PIN NAIL ATTACHING THE SIDELITE TRIM IS AS FOLLOWS; TOP & BOTTOM (1) AT 2.0" FROM OUTSIDE CORNER WITH (3) MORE 3.75" O.C. SIDES FROM TOP DOWN; (1) AT 2.75" FROM VERTICAL CORNERS WITH (6) MORE AT 14.0" O.C. MAX.
- SPACING FOR ITEM #40 WITH ITEM #32; TOP & BOTTOM (1) SCREW IN THE CENTER. SIDES; FROM TOP DOWN, 3.375", 18.0", 31.75" 47.625" AND 62.375".  
 SPACING FOR ITEM #40 WITH ITEM #33; TOP & BOTTOM (1) 2.5" FROM EACH HORIZONTAL CORNER. SIDES FROM TOP DOWN 3.375", 15.125", 27.0", 38.75", 50.5" & 62.375".  
 SPACING FOR ITEM #40 WITH #34; TOP & BOTTOM; (1) 2.5" FROM HORIZONTAL CORNERS. SIDES FROM TOP DOWN; 7.375", 20.125", 32.875", 45.625" & 58.375"  
 SPACING FOR ITEM #40 WITH ITEM #35; TOP & BOTTOM (1) .75" DOWN & .75" OVER FROM HORIZONTAL CORNERS. SIDES FROM TOP DOWN; 13.75", 26.5", 39.25" & 52.125".
- THE SIDELITE IS HELD INTO THE FRAME IN THE 2 PIECE MULLION APPLICATION WITH ITEM #14 (#10 X 2") SPACING AS FOLLOWS; HEADER AND OUTSWING THRESHOLD; (1) SCREW 3.0" FROM EACH HORIZONTAL CORNER. IN THE INSWING APPLICATION USE ITEM #53 (#10 X 3") IN THE INSWING THRESHOLD. SIDES; (1) AT 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE EQUALLY SPACED.
- SPACING FOR ITEM #41 ATTACHING THE WINDJAMBER ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS; FROM THE BOTTOM UP; 1.0", 3.0", 5.0", 20.0", 38.75" & 57.75". FROM THE TOP DOWN; 1.0", 3.0" & 5.0".
- SPACING FOR ITEM #41 ATTACHING THE ENDURA ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS FROM TOP DOWN: (2) SCREWS AT 3.0" DOWN AND .68" APART, 4.0", 11.0", 19.0", 27.0", 34.0", 44.0", 51.0", 58.875", 66.875", 73.875", & (2) AT 74.875" .68" APART. THERE IS (1) ADDITIONAL #8 x 1.75" DECK SCREW AT 51.75" DOWN FROM THE TOP. ALL THE SCREWS COMING DOWN THE ASTRAGAL ARE STAGGERED EXCEPT FOR THE 1.75" SCREW, IT IS CENTERED ON THE ASTRAGAL.
- THE SIDELITE IS HELD INTO THE FRAME IN THE 1PIECE MULLION APPLICATION WITH ITEM #14 SPACING AS FOLLOWS; HEADER AND THRESHOLD; (1) SCREW 3.0" FROM EACH HORIZONTAL CORNER. JAMB SIDE; (1) AT 6.0" FROM EACH VERTICAL CORNER WITH (4) MORE EQUALLY EQUALLY SPACED. AT THE HINGE MULLION THE SIDELITE IS HELD IN WITH (2) ITEM #42 AT EACH HINGE LOCATION. AT EACH STRIKE MULLION THE SIDELITE IS HELD IN WITH ITEM #42 SPACED 6.0" FROM TOP AND BOTTOM CORNERS WITH (4) MORE EQUALLY SPACED.

PREMDOR EXTERIOR DOOR PRODUCTS  
 1955 POWIS ROAD  
 WEST CHICAGO, IL. 60185  
 PH. (630) 584-6330


PRODUCT: "EXTERIOR DOOR PRODUCT" SINGLE & DOUBLE OUTSWING 6/8 FIBERGLASS DOOR  
 PART OR ASSEMBLY: GLAZING DETAILS & NOTES

NO	DATE	REVISIONS	BY
2	6/30/02	CORRECT B.O.M.	RW
1	03/05/02	GENERAL REVISION	WLN
NO			


RW BUILDING CONSULTANTS, INC.  
 813.684.3831

DATE: 12/14/01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2181  
 SHEET 7 OF 8


Approved as complying with the Florida Building Code  
 Date AUG. 22, 2002  
 NOA# 02-0109.09  
 Miami Dade Product Control  
 Division  
 By [Signature]

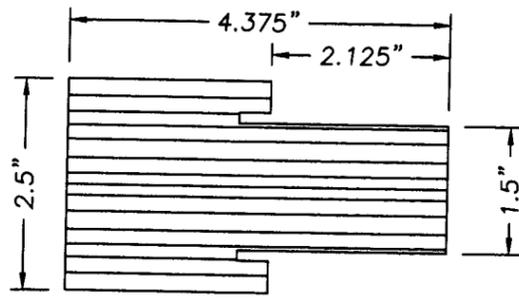


28 LAMINATED LUMBER MULLION

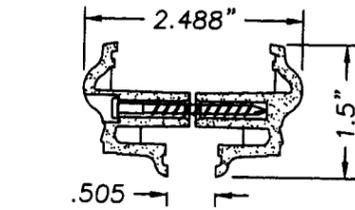


35 SPECIALTY/BAYLITE  
5\"/>




33 LITE FRAME ODL  
HP POLYPROPYLENE  
(THERMOFIL-P6-30FM0391)



32 TRINITY/AMPAC  
5\"/>




43 SIDELITE WOOD TRIM

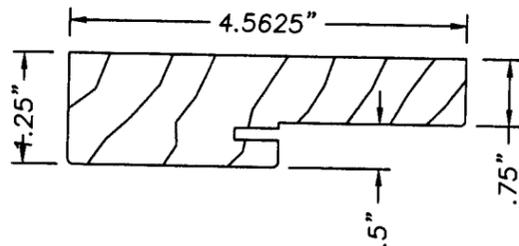


FINGER JOINTED PINE FRAME


48 49 51 18

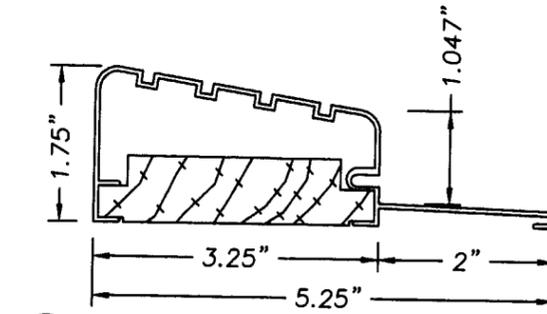


23 IMPERIAL OUTSWING BUMP FACE  
ALUMINUM THRESHOLD  
.051\"/>

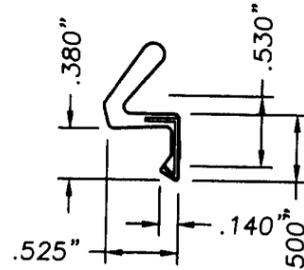


13 WEATHERSR TIP  
SCHLEGEL Q-LON QDS650

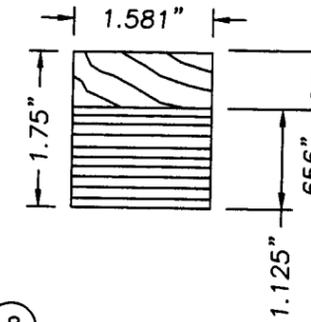

8 LATCH & HINGE STILE  
LAMINATED LUMBER W/PINE CAP




12 DOOR BOTTOM RAIL  
WOOD COMPOSITE

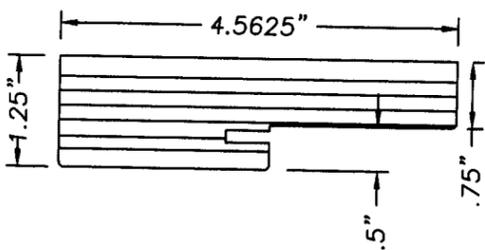


LAM. LUMBER FRAME

3 4 5 10

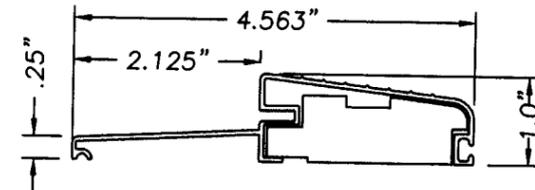


24 OUTSWING BUMP THRESHOLD  
.050\"/>

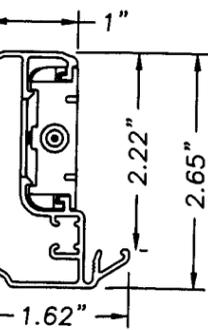


30 ENDURA EXTRUDED ALUM.  
ASTRAGAL .055\"/>


ASTRAGAL HAS  
(1) 19.75\"/>



15 LOCK BLOCK



11 DOOR TOP RAIL  
45 SIDELITE TOP RAIL  
46 SIDELITE SIDE STILE  
47 SIDELITE BOTTOM RAIL

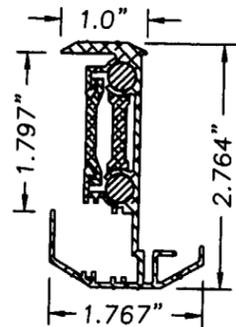

29 ASTRAGAL WINDJAMBER II  
(WR68P T-6060 EXTRUDED ALUMINUM)

ASTRAGAL HAS  
(2) 8.0\"/>

PREMDOR EXTERIOR DOOR PRODUCTS  
1955 POWIS ROAD  
WEST CHICAGO, IL. 60185  
PH. (630) 584-6330

PRODUCT: "EXTERIOR DOOR PRODUCT"  
SINGLE & DOUBLE OUTSWING  
6.8 FIBERGLASS DOOR  
PART OR ASSEMBLY:  
UNIT COMPONENTS

NO.	DATE	REVISIONS	BY
2	6/30/02	CORRECT B.O.M.	RW
1	03/05/02	GENERAL REVISION	WLN

RW BUILDING  
CONSULTANTS, INC.  
813.684.3831

DATE: 12/14/01  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2181  
SHEET 8 OF 8

Approved as complying with the  
Florida Building Code  
Date: Aug. 22, 2002  
NOA# 02-0109-09  
Miami Dade Product Control  
Division  
By: *[Signature]*