



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Jeld-Wen, Inc.
3250 Lakeport Drive
Klamath Falls, OR 97601**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Series "DoorCraft®" 8'0" S/E Outswing Opaque Insulated Steel Door w/wo Sidelites

APPROVAL DOCUMENT: Drawing No. S-2106, titled "Outswing Opaque Steel Edge Steel Door up to 107" x 8'-0 Unit", sheets 1 through 7, dated 01/03/02, with revision 1 dated 03/06/02, prepared by RW Building Consultants, Inc., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 02-0110.02
Expiration Date: July 3, 2007
Approval Date: July 3, 2002
Page 1**

DoorCraft® STEEL EDGE

STEEL EDGE OPAQUE INSULATED STEEL DOOR
OUTSWING 8-0 UNITS W/ & W/OUT SIDELITES

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS SYSTEM MEET THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES" WITH THE USE OF THE HIGH DAM THRESHOLD.
6. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE, AT SIDELITES ONLY.
7. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

Door Leaf Construction:

Face sheets: 24 ga. (0.021") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength $F_y(\text{ave.})=27,433$ psi.

Core design: Expanded polystyrene with 1.0 to 1.25 lbs. density, by Jeld-Wen, Inc.


Panel Construction: The active and inactive door panels are constructed from (2) 24 ga. (0.021") thick galvanized steel skins with roll formed edges to receive the 1.73" wide x 1.219" thick one piece continuous roll formed galvanized steel side stiles/top rail. The tops of the steel panels are bent at a ninety-degree angle to overlap 0.25" the steel top rail and side stiles. The bottom rail is 0.021" roll formed steel 1.67" wide x 1.21" high formed to receive door bottom sweeps when required. The steel bottom is butted to the side stiles. The side stiles have a tab, which is bent 90° over the bottom rail and secured with a 0.25" x 0.5" 16ga rivet at each corner. The bottoms of the steel panels are bent at a ninety-degree angle to overlap the bottom rail 0.25". Each hinge location on the hinge stile is internally reinforced with a 1.131" wide x 1.213" deep x 12.404" long piece of pressed fiberboard, (MDF board). The interior cavity of each door is filled with polystyrene. The face sheet is glued to the polystyrene.

Sash Construction: The sash is constructed from 24GA. (0.021" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and and glued to it. The sashes are routed to receive the ODL (HP Polypropylene Thermofil-P6-30FM0391) lite frame. The units are glazed with .125" tempered glass. The lite frames are sealed with QSD glazing compound on the exterior.




Frame Construction: The frames are constructed from Ponderosa Pine jambs measuring 4.563" x 1.25". The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units used an outswing bump face threshold, either the high dam or low profile. The threshold is attached to the frame with (3) 16GA. 2" x 7/16" crown wire staples.

TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS & NOTES
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & GLAZING DETAIL
7	UNIT COMPONENTS

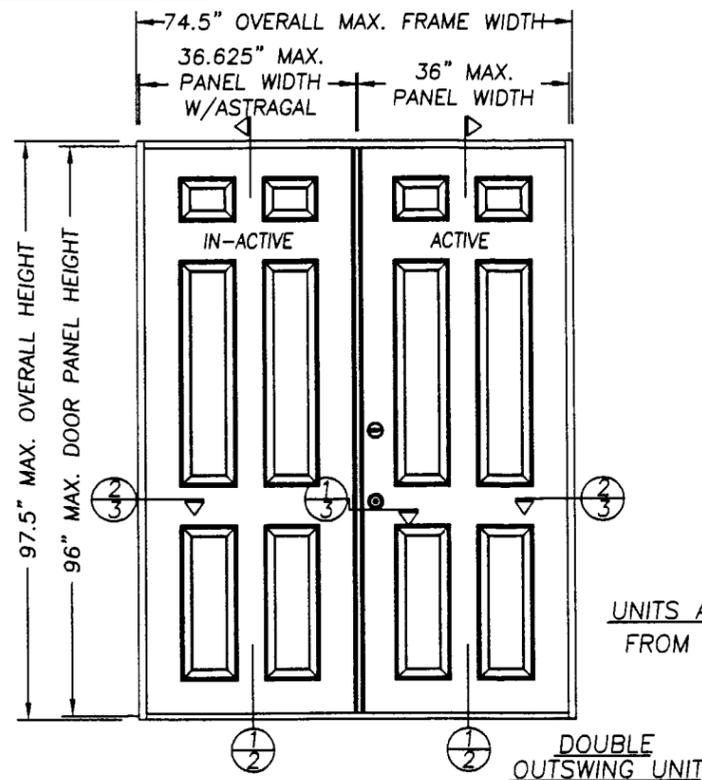

UNITS ARE VIEWED FROM INTERIOR

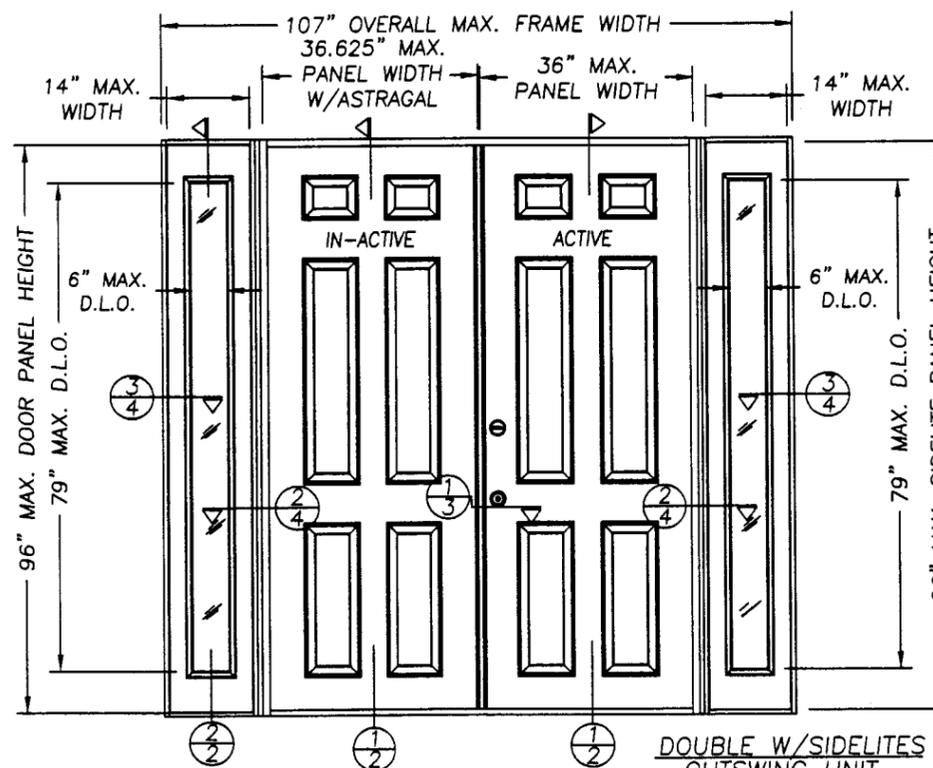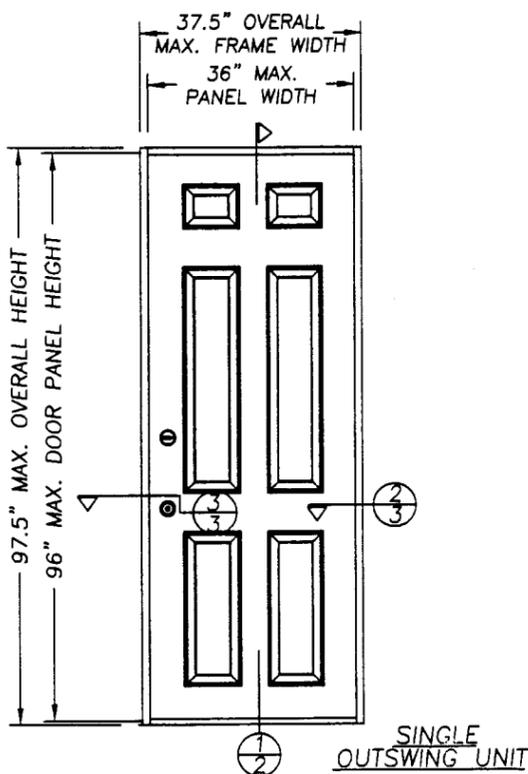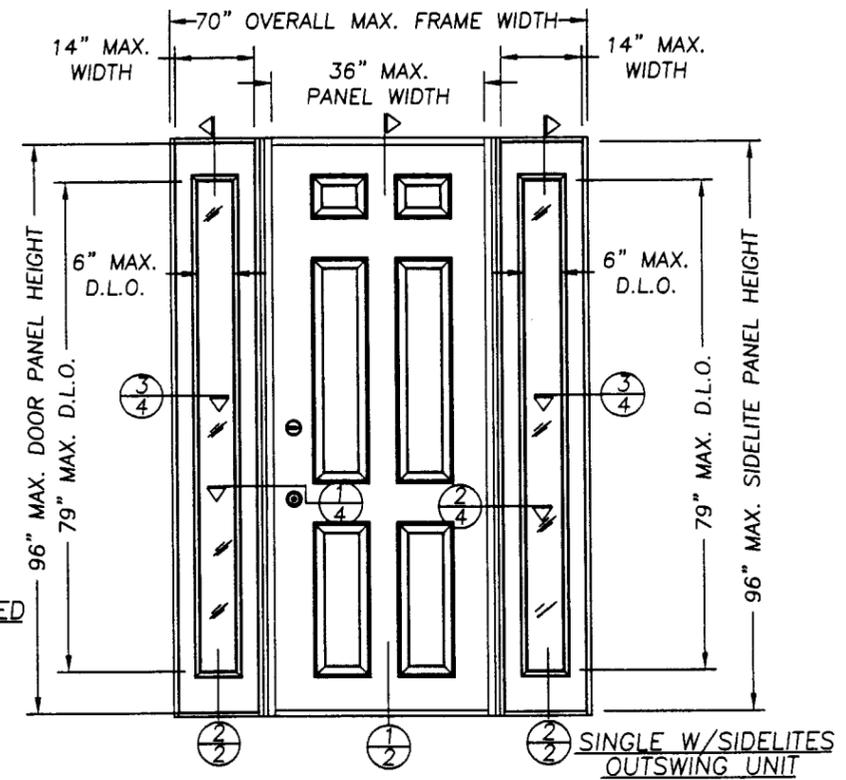

DESIGN PRESSURE RATING (WHERE WATER INFILTRATION REQUIREMENT IS NEEDED)	
UNIT TYPE	W/HIGH DAM BUMP THRESHOLD
SINGLE W/WO SIDELITES	+55.0 psf -55.0 psf
DOUBLE W/WO SIDELITES (WINDJAMBER II BY GENESIS ASTRAGAL)	+55.0 psf -55.0 psf
DOUBLE W/WO SIDELITES (IMPERIAL HURRICANE ASTRAGAL)	+47.0 psf -47.0 psf

Approved as complying with the Florida Building Code
Date July 3, 2002
NOA# 02-1010.02
Miami Dade Product Control Division
By Manuel Perez

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
OUTSWING OPAQUE STEEL
EDGE STEEL DOOR UP TO
107" x 8-0 UNIT

PART OR ASSEMBLY:
GENERAL NOTES &
TYPICAL ELEVATIONS

NO.	DATE	GENERAL REVISION	TJH	BY
1	03/06/02			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

DATE: 1/03/02

SCALE: N.T.S.


DWG. BY: WLN

CHK. BY: RW


DRAWING NO.:

S-2106

SHEET 1 OF 7

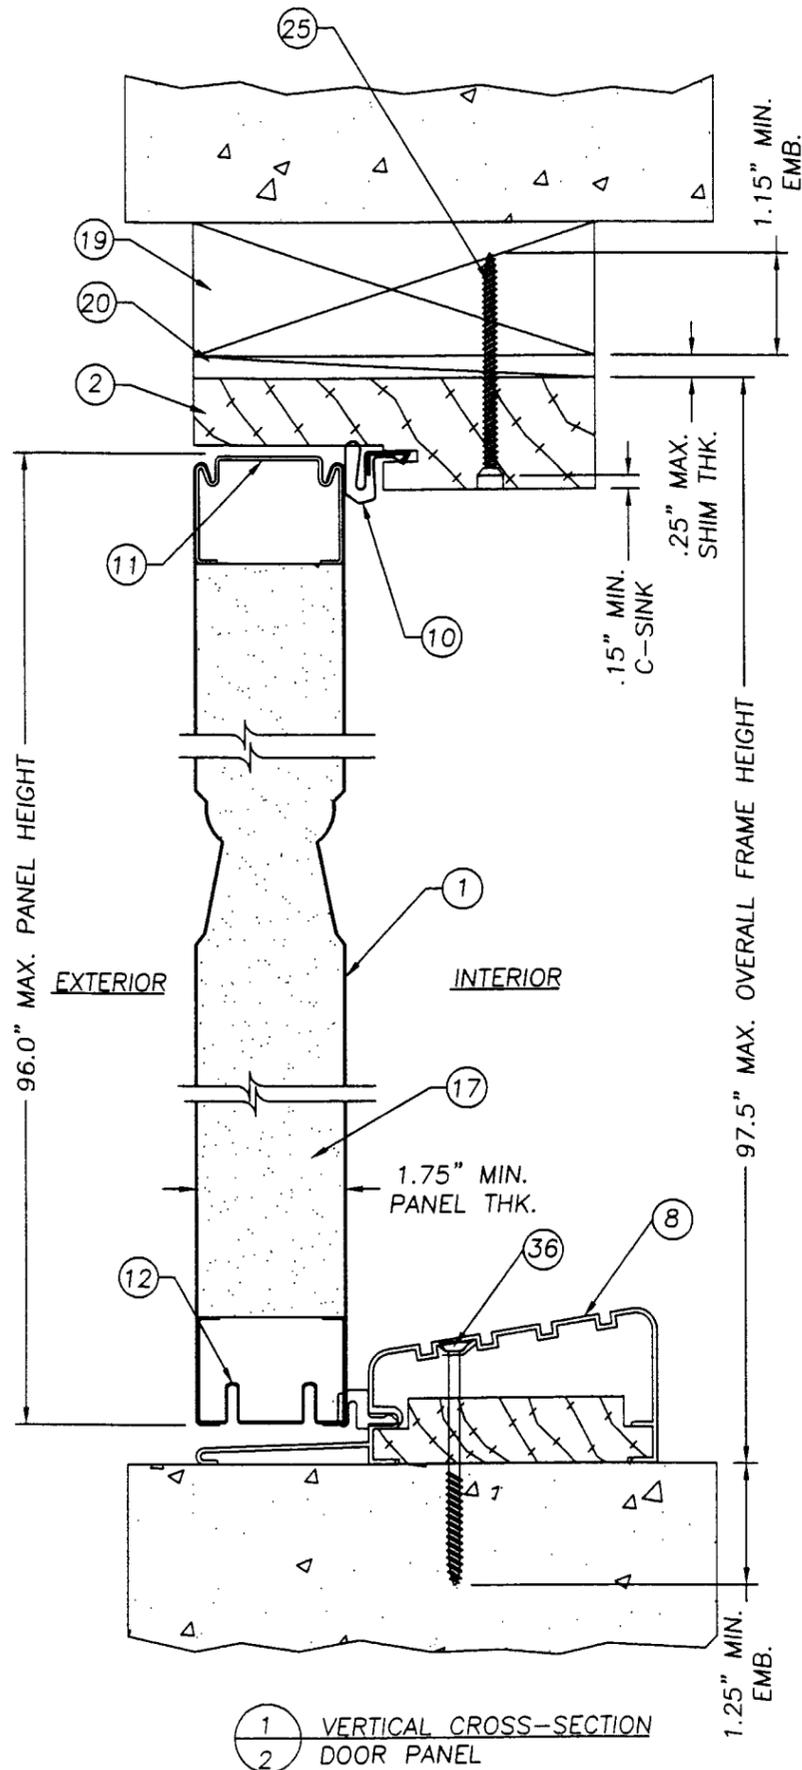

1 VERTICAL CROSS-SECTION
2 DOOR PANEL

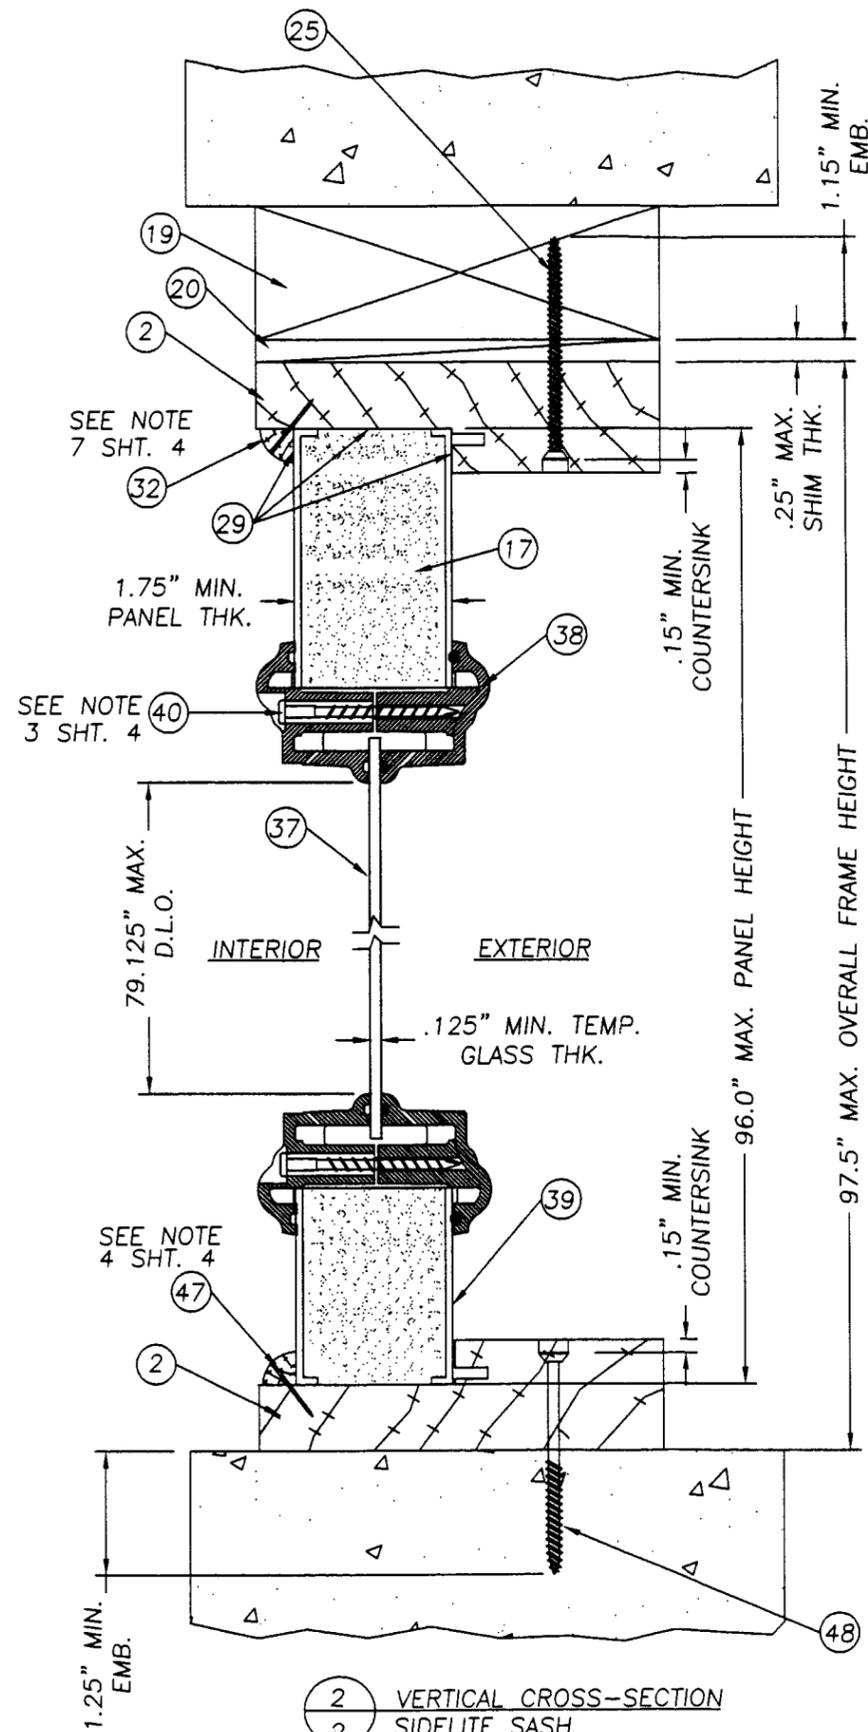

2 VERTICAL CROSS-SECTION
2 SIDELITE SASH

ITEM	DESCRIPTION	MATERIAL
1	DOOR, STEEL EDGE 1.75" THK. 24GA. (.021" MIN.)	STEEL
2	HEAD JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 6/16" FINGER JOINTED PINE)	PINE
4	SIDELITE BLANK JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	PINE
5	4" x 4" BUTT HINGE 12ga. (.097" HAGER)	STEEL
6	#9 x 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	LATCH STILE REINFORCEMENT LVL	LVL
8	HIGH DAM BUMP THRESHOLD (IMPERIAL .051" ALUM.)	ALUM.
9	OUTSWING BUMPER THRESHOLD (PEMCO .050" EXTRUDED ALUM.)	ALUM.
10	COMPRESSION WEATHERSTRIP (SCHLEGEL Q-LON QDS 650)	FOAM
11	TOP RAIL (1.67" x 1.21" x 0.021" THK. MIN. 22GA.)	STEEL
12	BOTTOM RAIL (1.67" x 1.21" x 0.021" THK. MIN. 24GA.)	STEEL
13	SIDE STILE (1.67" x 1.21" x 0.021" THK. MIN. 22GA.)	STEEL
14	#10 x 2" PFH WOOD SCREW	STEEL
15	WOOD LOCK BLOCK (1.71" x 4.0" x 18.0" FINGER JOINTED PINE)	WOOD
16	1.131" x 1.131" x 12.4" MDF BOARD	-
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb. DENSITY) BY JELD-WEN	FOAM
18	1/4" x 1 3/8" WOOD MULLION CAP	WOOD
19	2x WOOD SUB BUCK	WOOD
20	SHIM MATERIAL (.25" MAX. THK.)	-
21	KWIKSET 400 SERIES KNOB	-
22	KWIKSET TITAN 700 SERIES DEADBOLT	-
23	16GA. BRAD TRIM NAIL 1" L.	STEEL
24	# 8 x 2 3/4" PHILL. FLATHEAD WOOD SCREW	STEEL
25	# 8 x 2 1/2" PHILL. FLATHEAD WOOD SCREW	STEEL
26	ASTRAGAL EXTRUDED ALUM. (WR80J WINDJAMBER II)	ALUM.
27	GLAZING COMPOUND DOW 1199 SILICONE	SILICONE
28	EXTRUDED ALUMINUM ASTRAGAL BY IMPERIAL	ALUM.
29	SILICONE CAULK (CR LAWRENCE 33C)	SILICONE
30	GLAZING COMPOUND (QSD-16 BY ODL)	-
31	#8 x 1" PPH WOOD SCREW (ASTRAGAL WR80J TO DOOR)	STEEL
32	3/8" x 3/8" 1/4" ROUND SIDELITE STOP	WOOD
33	WOOD LOCK BLOCK 1.71" THK. X 4.0" WIDE X 18" LVL	LVL
34	SCHLAGE KNOB SET #F51	-
35	SCHLAGE DEADBOLT #B360	-
36	3/16" x 2 3/4" TAPCON ANCHOR (ELCO)	STEEL
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	LITE FRAME (ODL HP POLYPROP. THERMOFIL-P6-30FM0391)	POLYPROP.
39	STEEL SIDELITE PANEL 24GA. (.021" MIN. STEEL)	STEEL
40	#8 x 1 1/2" PLASCREW (LITE FRAME)	STEEL
41	#8 x 3" PHILLIPS FLAT HEAD WOOD SCREW	STEEL
42	YALE KNOB HERITAGE SERIES	-
43	YALE DEADBOLT HERITAGE SERIES	-
44	3/4" THK. x 4 9/16" DEEP PRESSURE TREATED REINFORCEMENT	WOOD
45	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
46	#10 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
47	16GA. BRAD TRIM NAIL 3/4" L.	STEEL
48	3/16" x 2 1/2" TAPCON ANCHOR (ELCO)	STEEL
49	NOTE USED	-
50	LATCH JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	WOOD

Approved as complying with the
Florida Building Code
Date July 3, 2002
NOA# 02-0110.02
Miami Dade Product Control
Division
By Maurice


DATE: 1/03/02
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2106
SHEET 2 OF 7

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT:
OUTSWING OPAQUE STEEL
EDGE STEEL DOOR UP TO
107" x 8-0 UNIT
PART OR ASSEMBLY:
VERTICAL CROSS SECTIONS
& BILL OF MATERIALS

NO.	DATE	GENERAL REVISION	TJH	BY	REVISIONS
1	03/06/02				


RW BUILDING
CONSULTANTS, INC.
813.684.3831

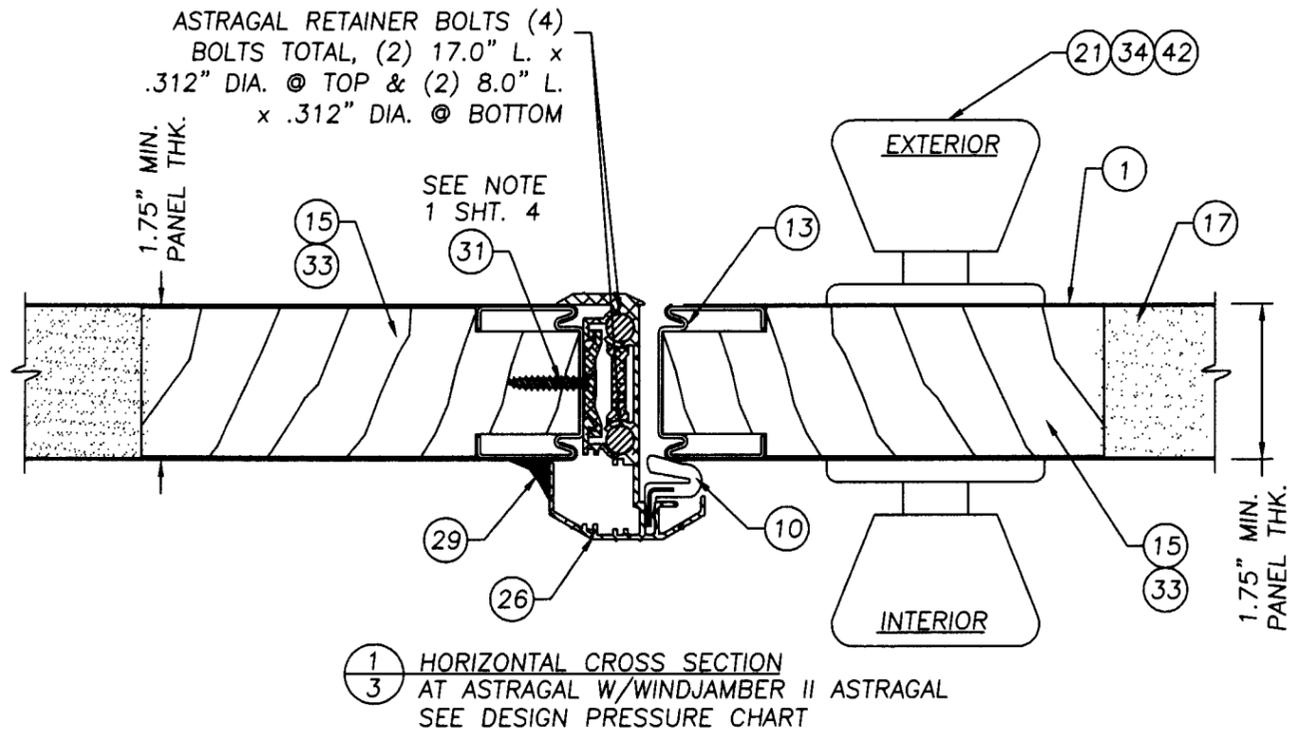


1 HORIZONTAL CROSS SECTION
3 AT ASTRAGAL W/WINDJAMBER II ASTRAGAL
SEE DESIGN PRESSURE CHART

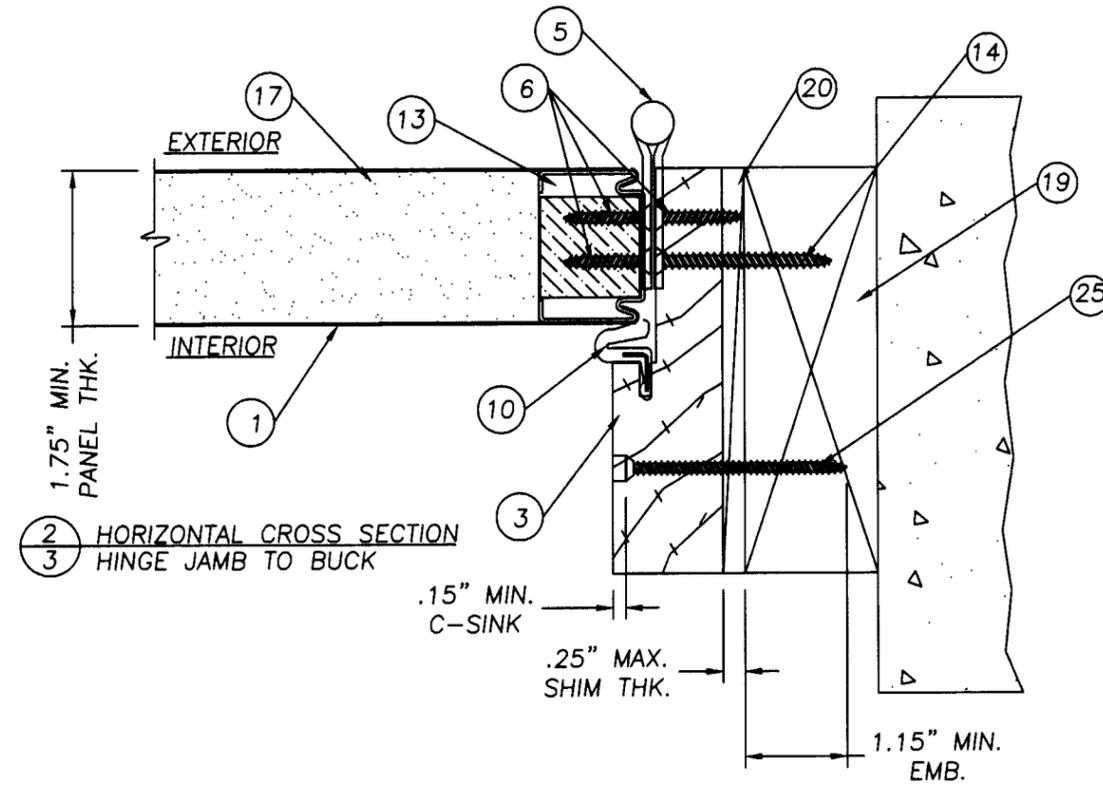

2 HORIZONTAL CROSS SECTION
3 HINGE JAMB TO BUCK

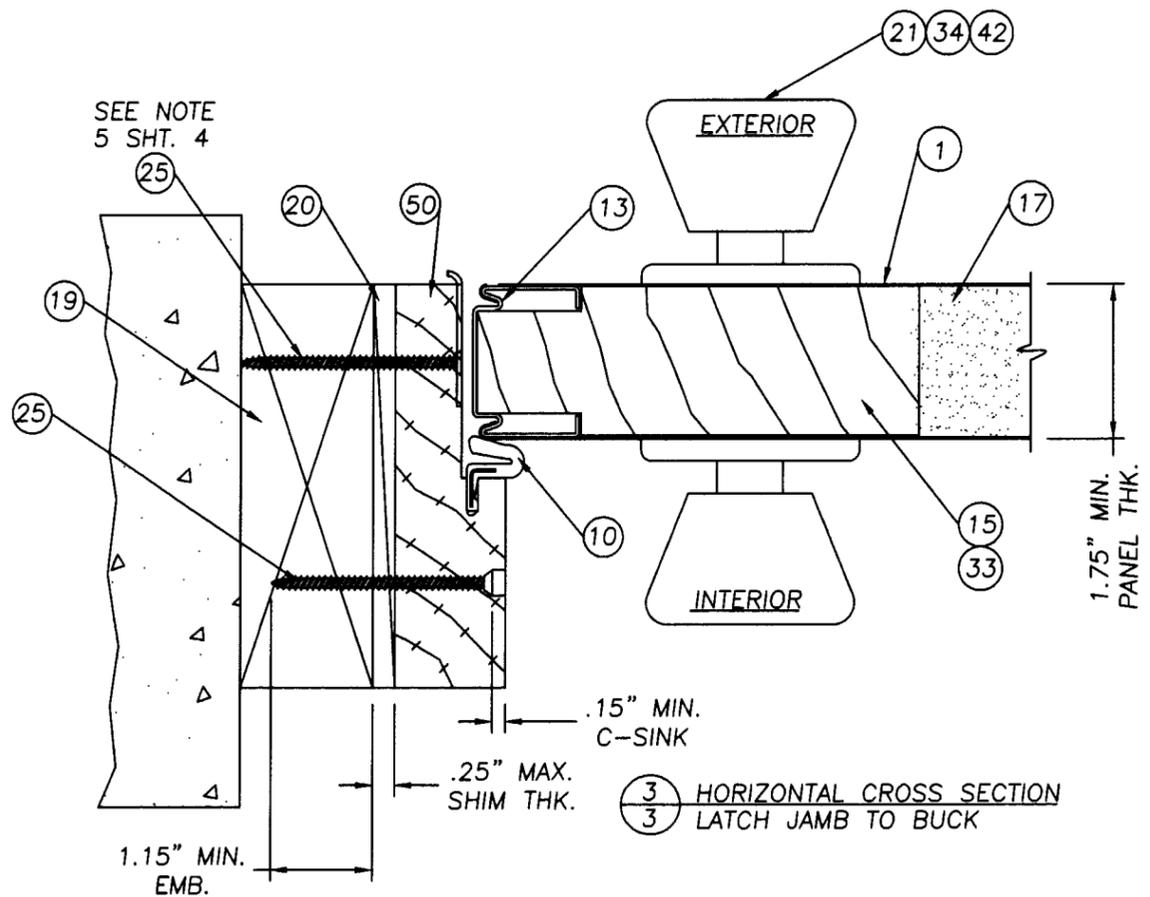

3 HORIZONTAL CROSS SECTION
3 LATCH JAMB TO BUCK

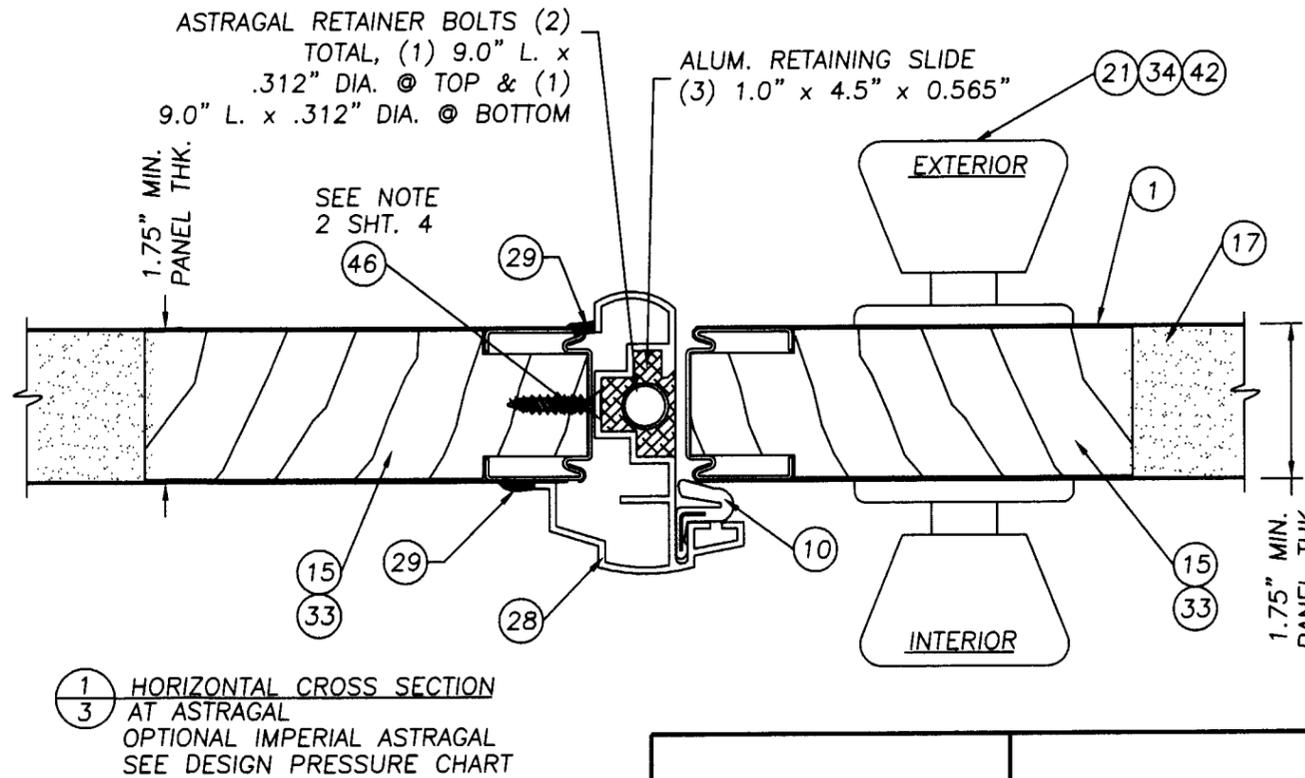

1 HORIZONTAL CROSS SECTION
3 AT ASTRAGAL
OPTIONAL IMPERIAL ASTRAGAL
SEE DESIGN PRESSURE CHART

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
OUTSWING OPAQUE STEEL
EDGE STEEL DOOR UP TO
107" x 8-0 UNIT




PART OR ASSEMBLY:
HORIZONTAL CROSS
SECTIONS

NO.	DATE	GENERAL REVISION	TJH	BY
1	03/06/02			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

DATE: 1/03/02
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2106
SHEET 3 OF 7

Approved as complying with the
Florida Building Code
Date July 3, 2002
NOA# 021-0110-02
Miami Dade Product Control
Division
By [Signature]

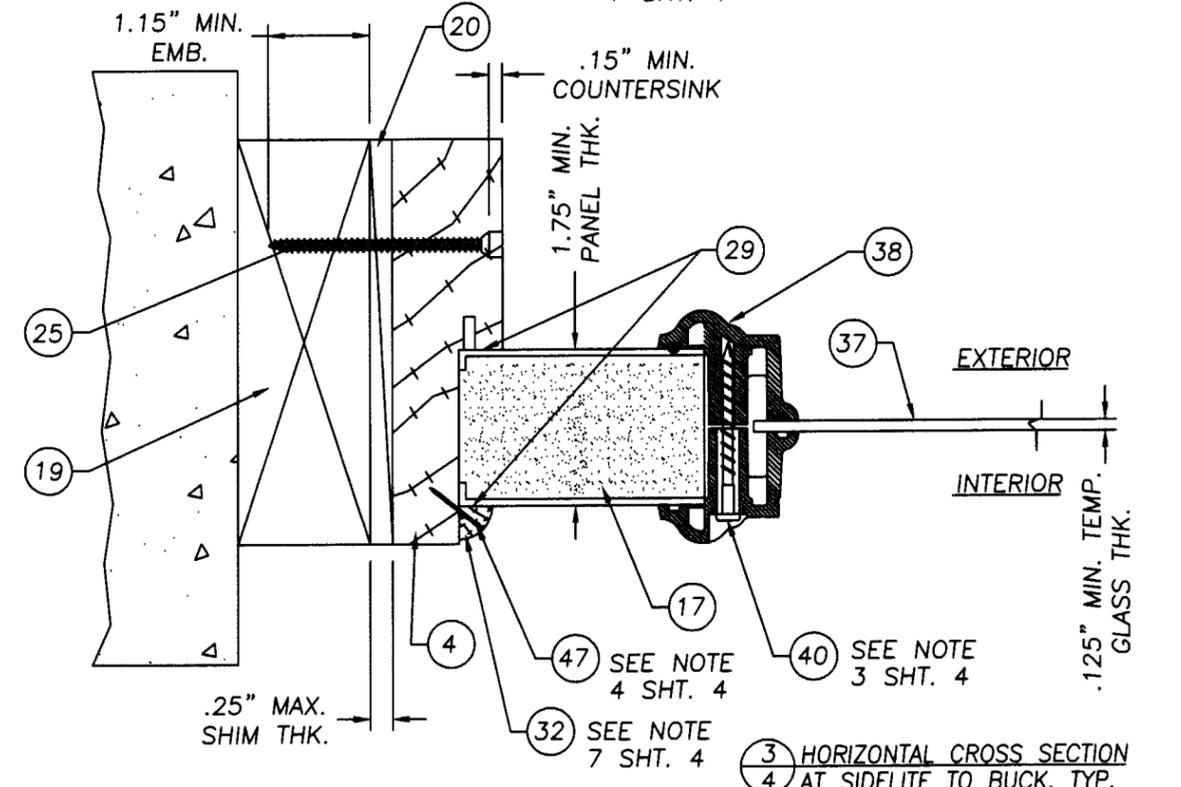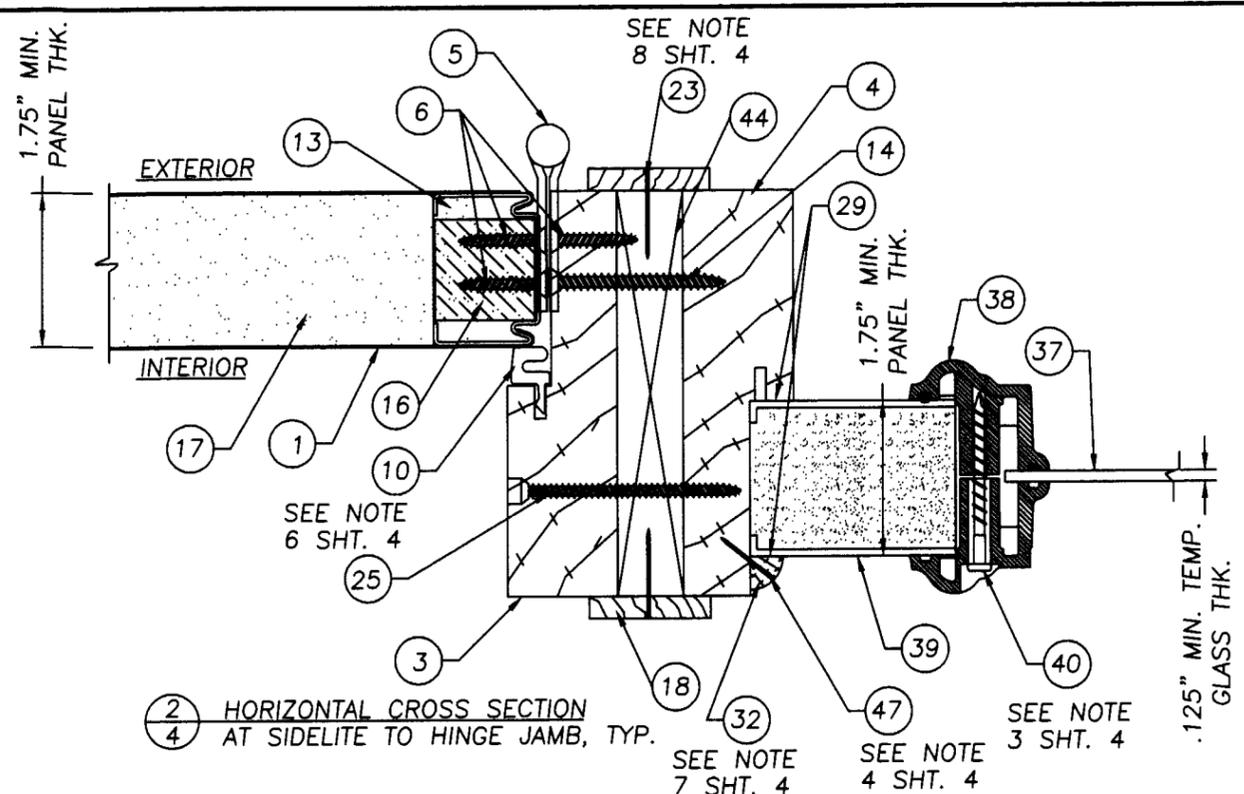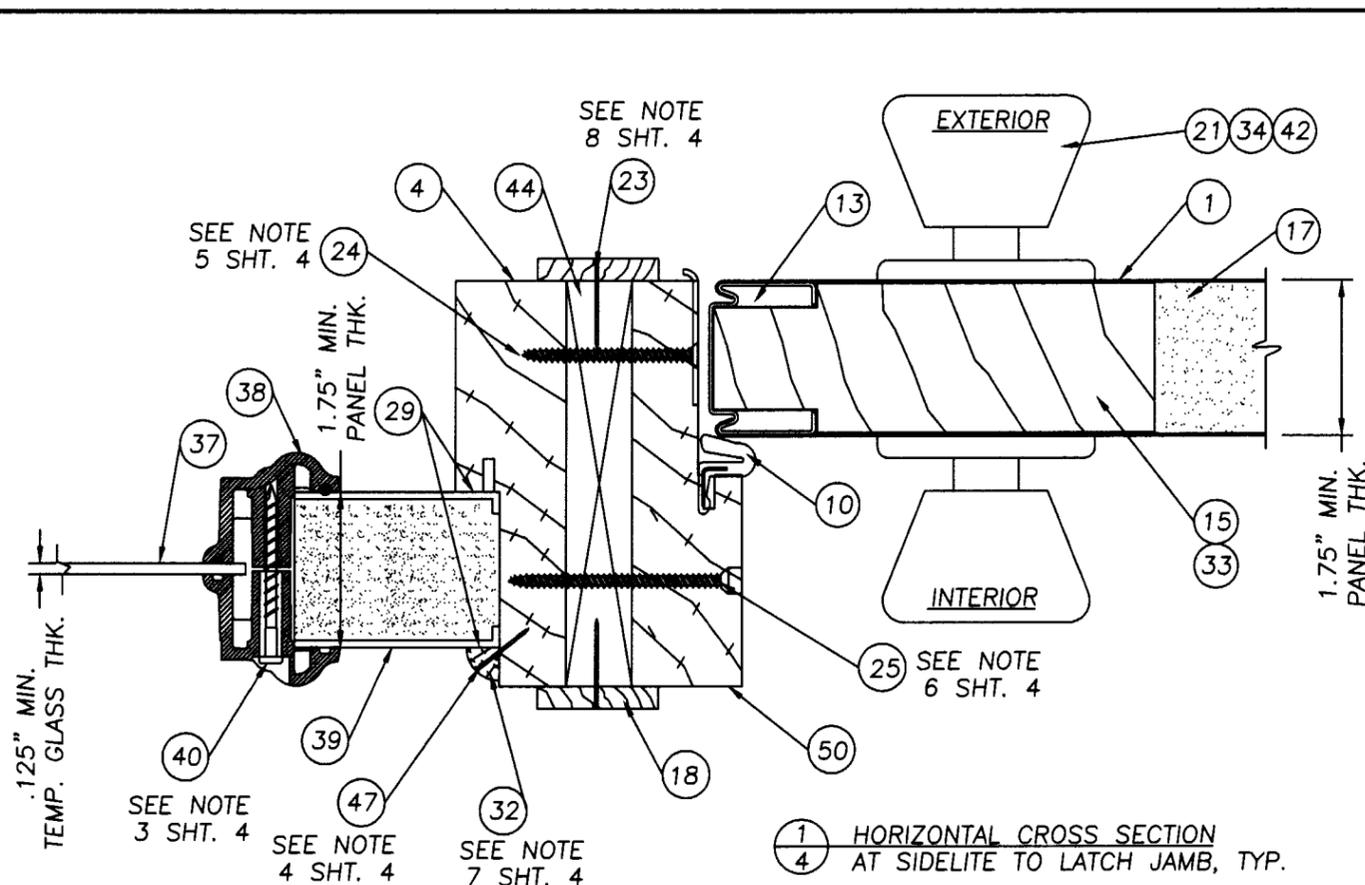

- NOTES:
1. SPACING FOR THE (9) #8 x 1" PFH SCREW ATTACHING THE WINDJAMBER ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: TOP DOWN; 1.0", 3.0" & 5.0". FROM THE BOTTOM UP; 1.0", 3.0", 5.0", 20.0", 42.0" & 61.0"
 2. SPACING FOR #10 x 1" PFH SCREW ATTACHING THE IMPERIAL ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FROM THE TOP DOWN & BOTTOM UP; 1.0", 2.5", 4.0", 5.5", 13.0", 18.0" & 26.0".
 3. SPACING FOR THE (40) #8 x 1 1/2" PLASCREW IS AS FOLLOWS; TOP & BOTTOM; (3) SCREWS (1) 3.0" IN FROM EACH HORIZONTAL CORNER WITH (1) MORE IN THE CENTER. FROM THE TOP OF THE FRAME DOWN ON THE SIDES; 3.0", 13.5", 24.5", 36.0", 46.0", 57.5", 68.5" & 79.0".
 4. SPACING FOR BRAD TRIM NAIL 3/4" L. ATTACHING THE QUARTER ROUND TO THE SIDELITE IS AS FOLLOWS; TOP & BOTTOM; 1.25" IN FROM EACH HORIZONTAL CORNER WITH (1) MORE NAIL IN THE MIDDLE. SIDES; 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
 5. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND BUCK USE #8 x 2 1/2" PFH WOOD SCREW. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE #8 x 2." PFH WOOD SCREW.
 6. SPACING FOR #8 x 2.5" PFH WOOD SCREW ATTACHING THE MULLIONS TOGETHER IS AS FOLLOWS; 6.0" FROM EACH VERTICAL CORNER WITH (5) MORE SCREWS EQUALLY SPACED, A TOTAL OF (7) SCREWS PER EACH VERTICAL MULLION.
 7. THE SIDELITE IS SECURED INTO THE SIDELITE JAMB WITH SILICONE CAULK ON THREE SIDES & 3/8" x 3/8" 1/4 ROUND & BRAD TRIM NAIL x 3/4" L.
 8. THE MULLION CAP IS ATTACHED TO THE PRESSURE TREATED REINFORCEMENT WITH ITEM #23 A 1" TRIM NAIL SPACED A MAX. OF 12" ON CENTER.

JELD-WEN, INC.
 31725 HIGHWAY 97 NORTH
 CHILOQUIN, OR. 97624
 PH. 541.783.2057

PRODUCT:
 OUTSWING OPAQUE STEEL
 EDGE STEEL DOOR UP TO
 107" x 8-0 UNIT


PART OR ASSEMBLY:
 HORIZONTAL CROSS
 SECTIONS & NOTES

NO.	DATE	GENERAL REVISION	TJH	BY
1	03/06/02			




RW BUILDING
 CONSULTANTS, INC.
 813.684.3831

Approved as complying with the
 Florida Building Code
 Date July 3, 2002
 NOA# 02-0110-02
 Miami Dade Product Control
 Division
 By [Signature]


DATE: 1/03/02
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2106
 SHEET 4 OF 7

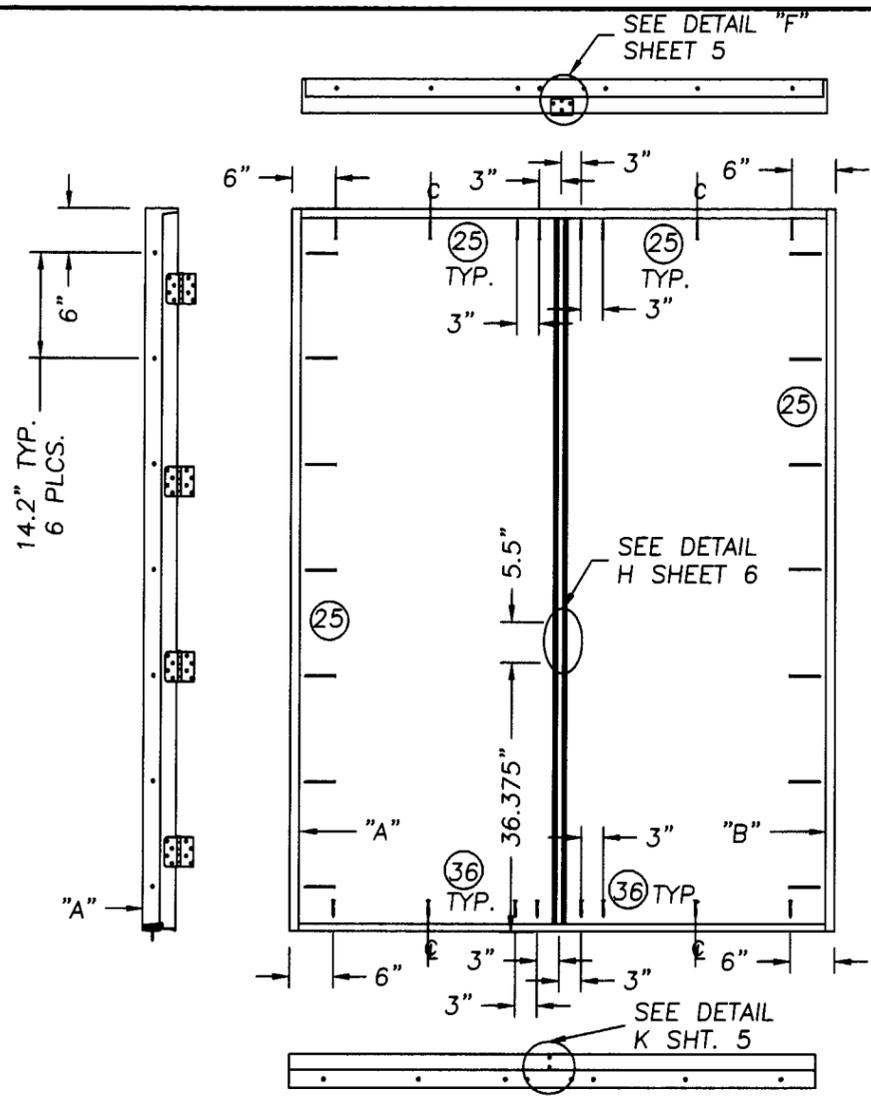


DOUBLE DOOR ANCHORING LOCATIONS

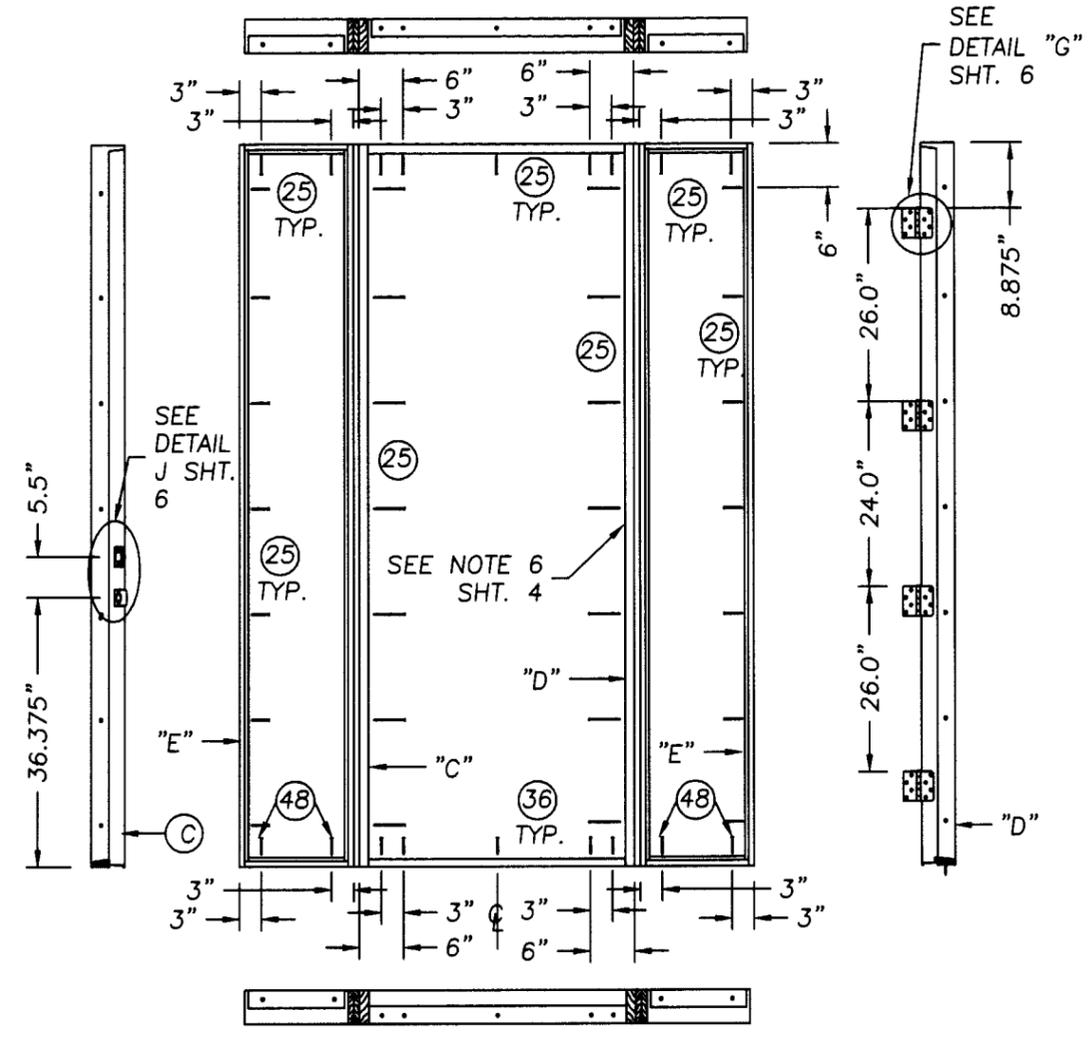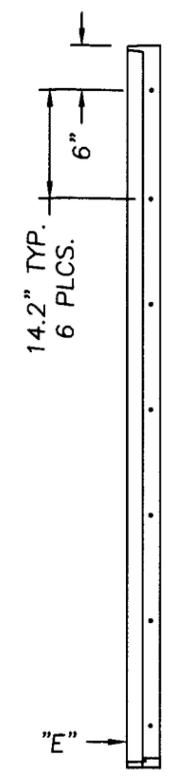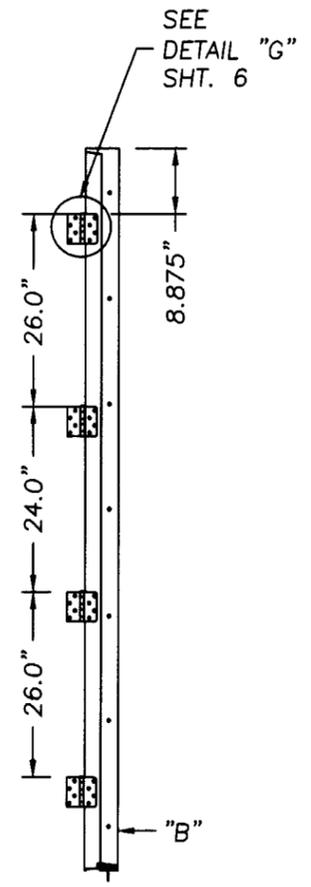


SINGLE DOOR W/SIDELITES ANCHORING LOCATIONS




DETAIL K AT HEADER
W/WINDJAMBER II ASTRAGAL BY GENESIS

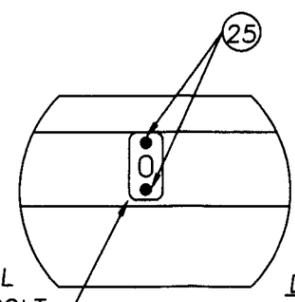

ASTRAGAL RETAINER BOLT STRIKE PLATE
DETAIL K AT HEADER
W/IMPERIAL HURRICANE ASTRAGAL

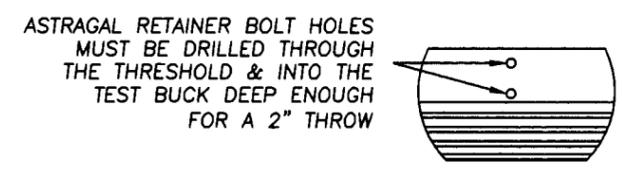

DETAIL F AT SILL
W/WINDJAMBER II ASTRAGAL BY GENESIS



DETAIL F AT SILL
W/IMPERIAL HURRICANE ASTRAGAL

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057


PRODUCT:
OUTSWING OPAQUE STEEL
EDGE STEEL DOOR UP TO
107' x 8'-0' UNIT
PART OR ASSEMBLY:
ANCHORING LOCATIONS
& DETAILS

NO.	DATE	GENERAL REVISION	TJH	BY
1	03/06/02			


RW BUILDING
CONSULTANTS, INC.
813.684.3831

Approved as complying with the
Florida Building Code
Date July 3, 2002
NOA# 02-1010.02
Miami Dade Product Control
Division
By [Signature]



DATE: 1/03/02
SCALE: N.T.S.
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2106
SHEET 5 OF 7

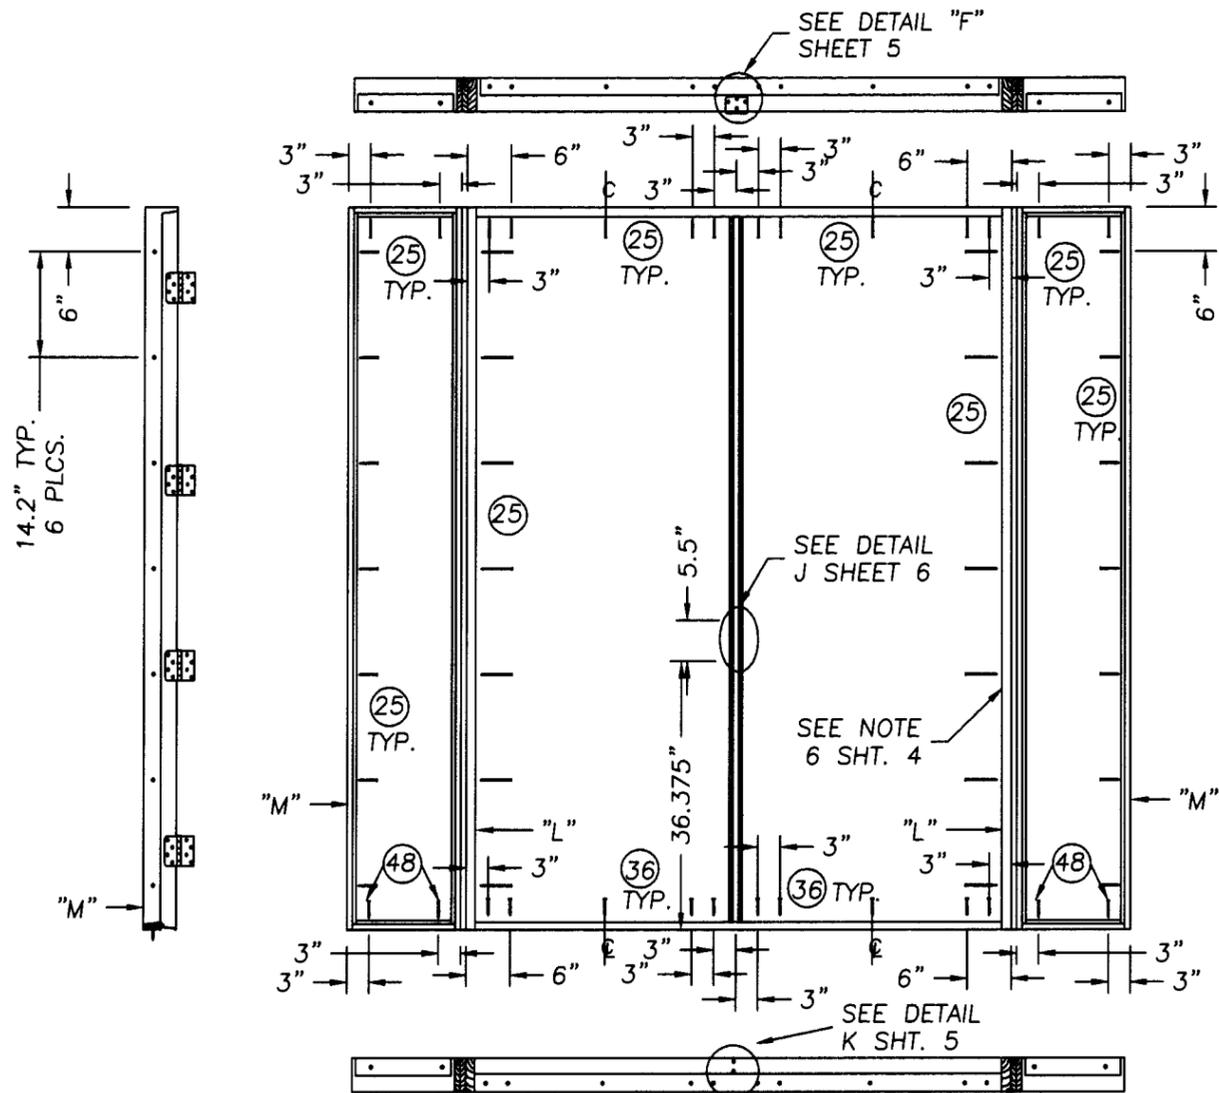


DOUBLE DOOR W/SIDELITES ANCHORING LOCATIONS

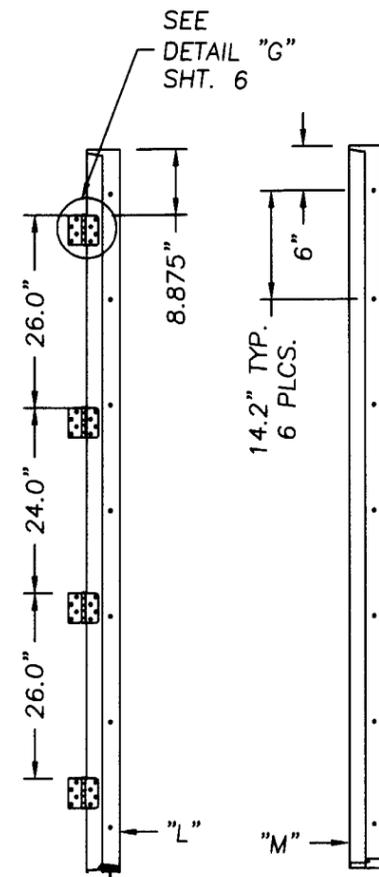


SINGLE DOOR ANCHORING LOCATIONS

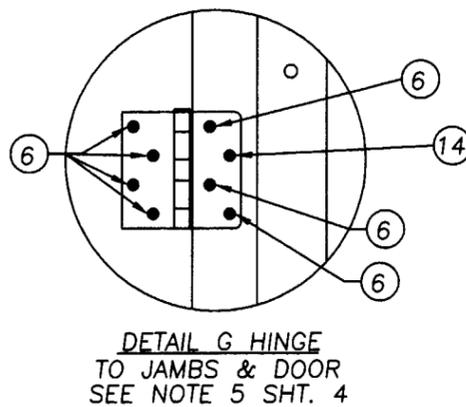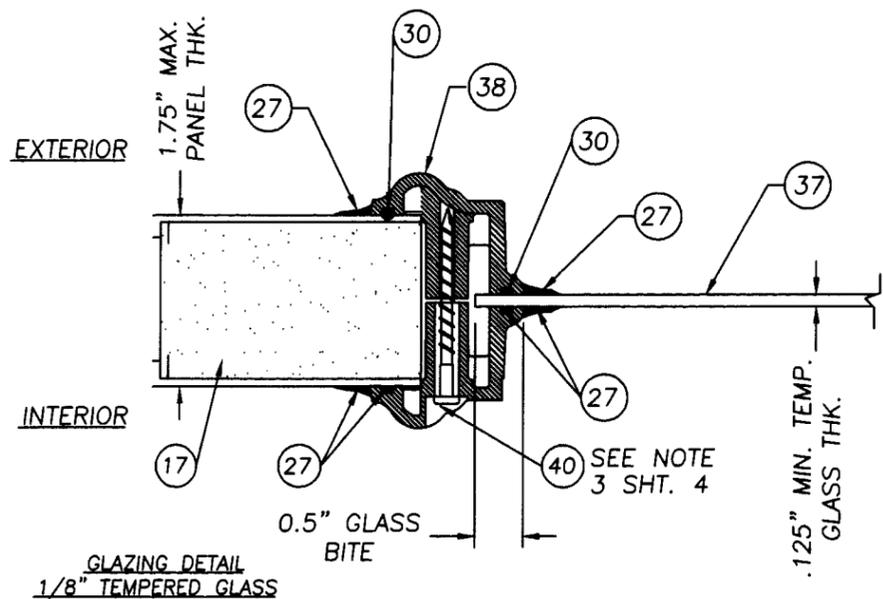

DETAIL G HINGE TO JAMBS & DOOR SEE NOTE 5 SHT. 4

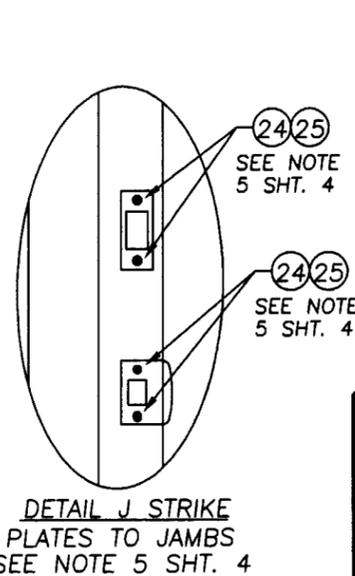

DETAIL J STRIKE PLATES TO JAMBS SEE NOTE 5 SHT. 4

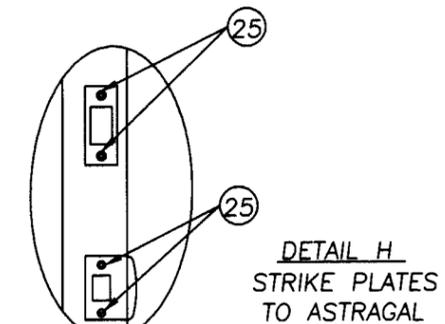

DETAIL H STRIKE PLATES TO ASTRAGAL

Approved as complying with the Florida Building Code
 Date July 3, 2002
 NOA# 02-010.02
 Miami Dade Product Control
 Division
 By [Signature]


JELD-WEN, INC.
 31725 HIGHWAY 97 NORTH
 CHILOQUIN, OR. 97624
 PH. 541.783.2057

PRODUCT:
 OUTSWING OPAQUE STEEL
 EDGE STEEL DOOR UP TO
 107" x 8'-0" UNIT
 PART OR ASSEMBLY:
 ANCHORING LOCATIONS
 & GLAZING DETAILS


NO.	DATE	GENERAL REVISION	TJH	BY
1	03/06/02			

RW BUILDING CONSULTANTS, INC.
 813.684.3831


DATE: 1/03/02
 SCALE: N.T.S.
 DWG. BY: WLN
 CHK. BY: RW
 DRAWING NO.: S-2106
 SHEET 6 OF 7

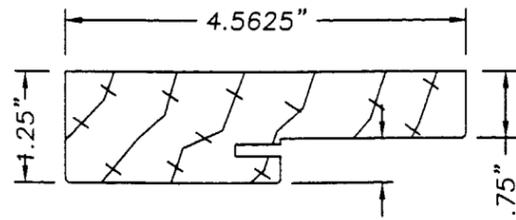


2 4
3 50
WOOD FRAME




12
DOOR STEEL EDGE CAP, BOTTOM
.021" ROLL FORMED STEEL

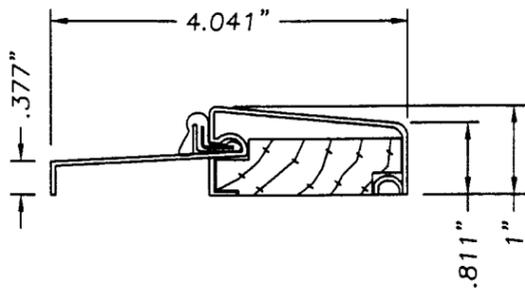


9
OPTIONAL OUTSWING BUMPFACE THRESHOLD
LOW PROFILE .050" EXTRUDED ALUMINUM
THIS THRESHOLD DOES NOT MEET THE
WATER REQUIREMENTS FOR A
"HIGH VELOCITY HURRICANE ZONE"

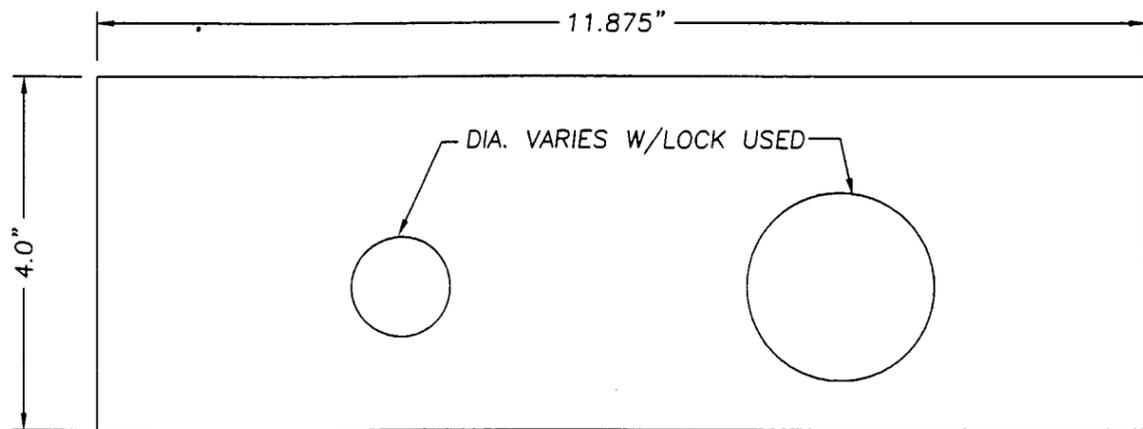


15 33
WOOD LOCK BLOCK, 1.71" THK.

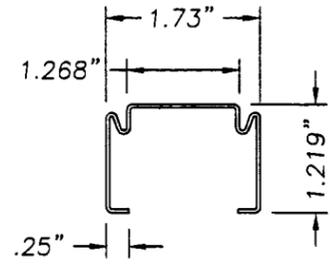

11 13
DOOR STEEL EDGE CAP,
TOP, LATCH STILE & HINGE STILE
.021" ROLL FORMED STEEL

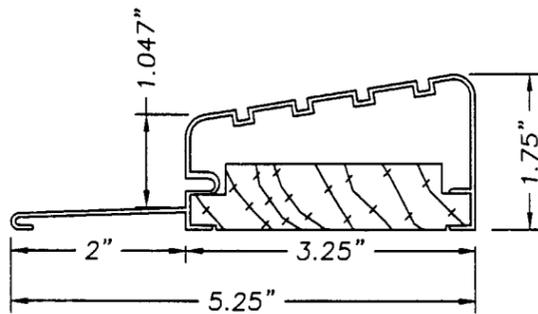


8
OUTSWING BUMP FACE
ALUMINUM THRESHOLD
.051" WALL THK.
THIS THRESHOLD MEETS
THE WATER REQUIREMENTS FOR
MIAMI-DADE COUNTY

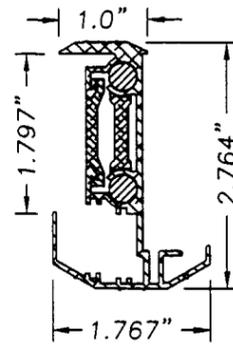

26
ASTRAGAL WINDJAMBER II
(WR80J T-6060 EXTRUDED ALUMINUM
MFG BY GENESIS


ASTRAGAL HAS
(2) 8 .0" L. x .312" DIA.
BOLTS @ BOTTOM &
(2) 17 .0" L. xz .312" DIA.
BOLTS @ TOP

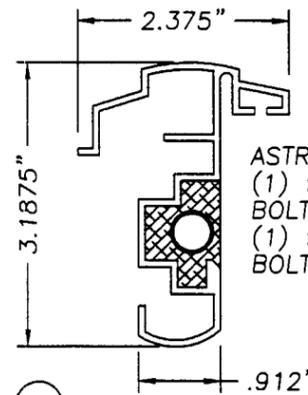

28
OPTIONAL
IMPERIAL (HURRICANE) ASTRAGAL
EXTRUDED ALUMINUM .075" WALL


ASTRAGAL HAS
(1) 9.0" L. x .312" DIA.
BOLT @ TOP &
(1) 9.0" L. x .312" DIA.
BOLT @ BOTTOM

DRILL TRU
FOR A #8
PFH WOOD
SCREW 2PLCS

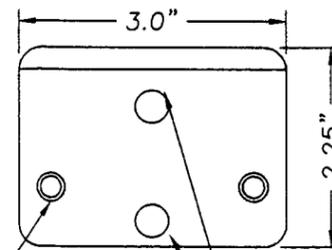


WINDJAMBER II WR68J STRIKE PLATE
STEEL PLATE


DRILL TRU FOR
.357" DIA. ASTRAGAL
RETAINER BOLTS

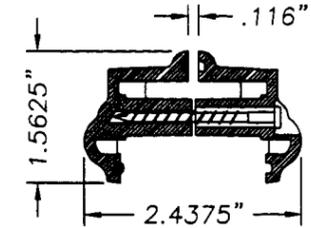

38
LITE FRAME OD
HP POLYPROPYLENE
(THERMOFIL-P6-30FM0391)

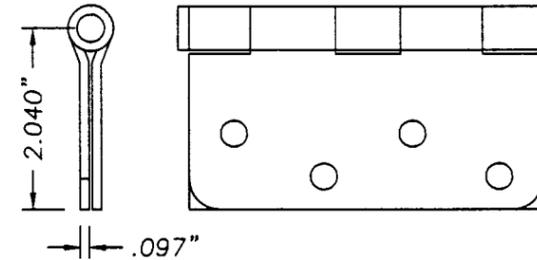

5
4 x 4 STEEL DOOR HINGE
.097" THK. STEEL BY HAGER

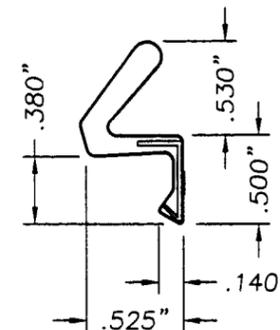

10
COMPRESSION WEATHERSR TIP
SCHLEGEL Q-LON QDS 650

JELD-WEN, INC.
31725 HIGHWAY 97 NORTH
CHILOQUIN, OR. 97624
PH. 541.783.2057

PRODUCT:
OUTSWING OPAQUE STEEL
EDGE DOOR UP TO
107" x 8'0 UNIT

PART OR ASSEMBLY:
UNIT COMPONENTS

NO.	DATE	GENERAL REVISION	TJH	BY
1	03/06/02			

RW BUILDING
CONSULTANTS, INC.
813.684.3831

DATE: 1/03/02
SCALE: NTS
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2106
SHEET 7 OF 7

Approved as complying with the
Florida Building Code
Date July 3, 2002
NOAH 02-10110-02
Miami Dade Product Control
Division
By Manuel Perez