



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Jeld-Wen, Inc.  
3250 Lakeport Drive  
Klamath Falls, OR 97601**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series "Doorcraft® Steel" 8'0 Inswing Opaque Steel Edge Door w/wo Sidelites**

**APPROVAL DOCUMENT:** Drawing No. S-2199, titled "Inswing Opaque Steel Edge Steel Door up to 107" x 8-0 Unit", sheets 1 through 7, prepared by RW Building Consultants, Inc., dated 5/28/02, bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above  
The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 02-0110.04  
Expiration Date: July 3, 2007  
Approval Date: July 3, 2002  
Page 1**

**DoorCraft® STEEL EDGE**  
8'0" OPAQUE INSULATED STEEL DOOR  
INSWING UNITS W/ & W/OUT SIDELITES

**GENERAL NOTES**

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS PRODUCT DOES NOT MEET THE WATER REQUIREMENTS FOR "HIGH VELOCITY HURRICANE ZONES". SEE DESIGN PRESSURE CHART.
6. THIS SYSTEM REQUIRES WINDBORNE DEBRIS EXTERNAL PROTECTION AS PRESCRIBED IN SECTION 1626.1 OF THE FLORIDA BUILDING CODE.
7. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

**RESIDENTIAL INSULATED STEEL DOOR**  
(Common to all frame conditions)

**Door Leaf Construction:**

**Face sheets:** 24 ga. (0.021") minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength  $F_y(\text{ave.})=27,433$  psi.

**Core design:** Expanded polystyrene with 1.0 to 1.25 lbs. density, by Jeld-Wen, Inc.





**Panel Construction:** The active and inactive door panels are constructed from (2) 24 ga. (0.021") thick galvanized steel skins with roll formed edges to receive the 1.73" wide x 1.219" thick one piece continuous roll formed galvanized steel side stiles/top rail. The tops of the steel panels are bent at a ninety-degree angle to overlap 0.25" the steel top rail and side stiles. The bottom rail is 0.021" roll formed steel 1.67" wide x 1.21" high formed to receive door bottom sweeps when required. The steel bottom is butted to the side stiles. The side stiles have a tab, which is bent 90° over the bottom rail and secured with a 0.25" x 0.5" 16ga rivet at each corner. The bottoms of the steel panels are bent at a ninety-degree angle to overlap the bottom rail 0.25". Each hinge location on the hinge stile is internally reinforced with a 1.131" wide x 1.213" deep x 12.404" long piece of pressed fiberboard, (MDF board). The interior cavity of each door is filled with polystyrene. The face sheet is glued to the polystyrene.

**Sash Construction:** The sash is constructed from 24GA. (0.021" min.) galvanized steel. The edges of the face sheet are bent 90° over the polystyrene core and are glued to it. The sashes are routed to receive the ODL (HP Polypropylene Thermofil-P6-30FM0391) lite frame. The units are glazed with .125" tempered glass. The lite frames are sealed with QSD glazing compound on the exterior.

**Frame Construction:** The frames are constructed from Ponderosa Pine jambs measuring 4.563" x 1.25". The head jambs are mortised and butt joined to the side jambs and attached with (3) 16GA. 2" x 7/16" crown wire staples. The units use a sloped adjustable threshold measuring 4.562" x 1.173". The threshold is attached to the frame with (3) 16GA. 2" x 7/16" crown wire staples.

**TABLE OF CONTENTS**

SHEET #	DESCRIPTION
1	GENERAL NOTES AND TYPICAL ELEVATIONS
2	VERTICAL CROSS SECTIONS & BILL OF MATERIALS
3	HORIZONTAL CROSS SECTIONS
4	HORIZONTAL CROSS SECTIONS & NOTES
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & GLAZING DETAIL
7	UNIT COMPONENTS

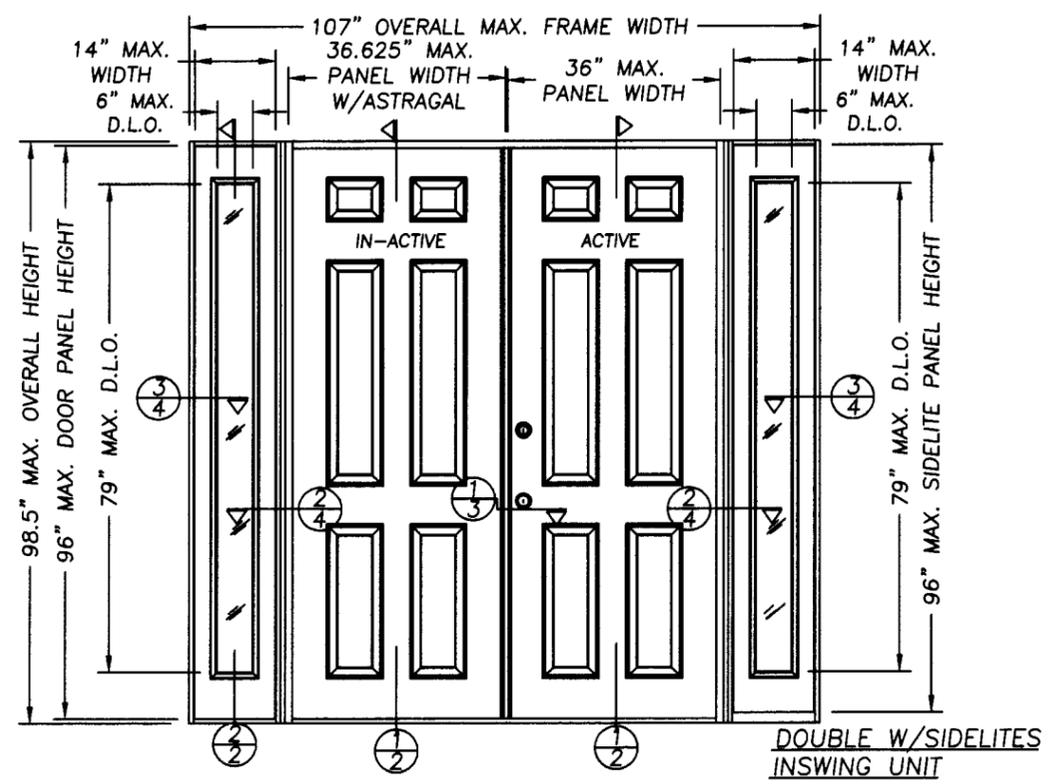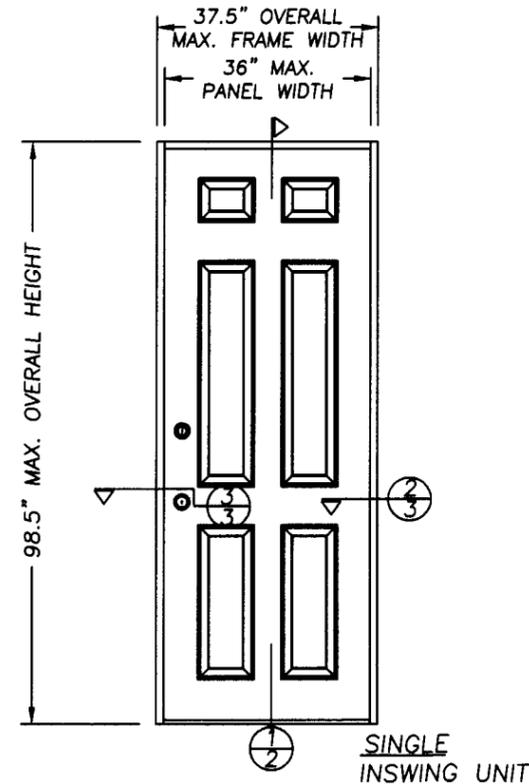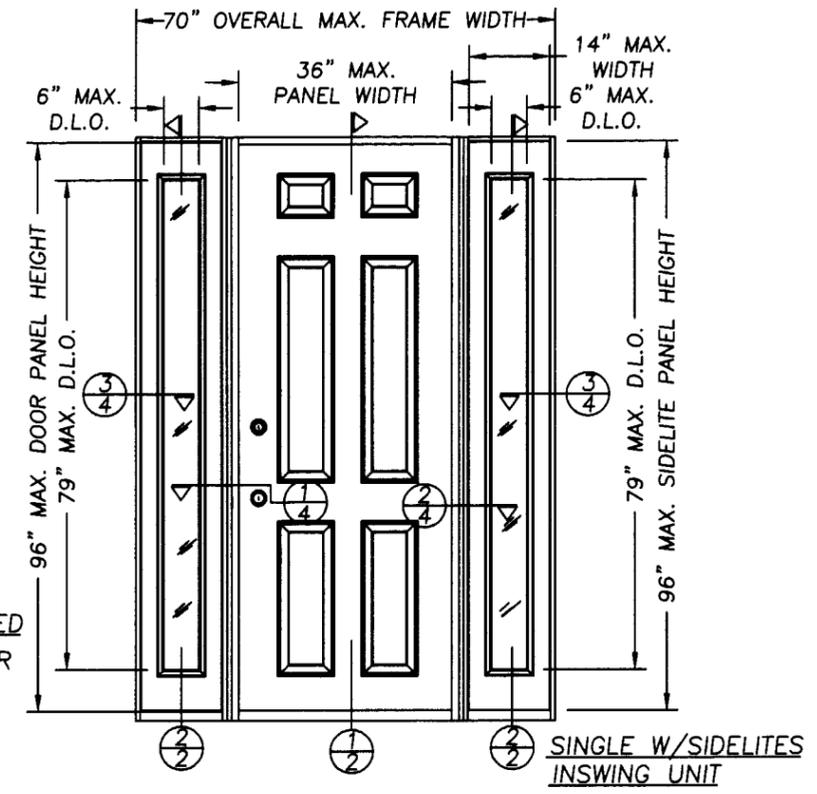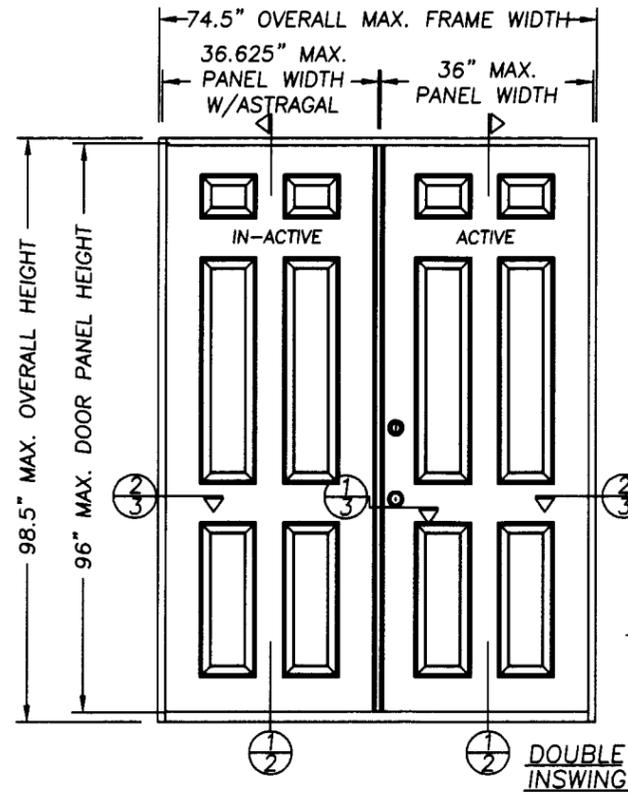

DESIGN PRESSURE RATING (WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED)	
UNIT TYPE	DESIGN PRESSURE RATING
SINGLE W/WO SIDELITES	+55.0 psf -55.0 psf
DOUBLE W/WO SIDELITES (WINDJAMBER II ASTRAGAL BY GENESIS)	+55.0 psf -55.0 psf
DOUBLE W/WO SIDELITES (IHURRICANE ASTRAGAL BY MPERIAL)	+47.0 psf -47.0 psf

Approved as complying with the Florida Building Code  
Date: July 3, 2002  
NOA# 0210110.04  
Miami Dade Product Control Division  
By: *Manuel Perez*


JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: INSWING OPAQUE STEEL EDGE STEEL DOOR UP TO 107" x 8'-0" UNIT  
PART OR ASSEMBLY: GENERAL NOTES & TYPICAL ELEVATIONS


NO.	DATE	REVISIONS
2	05/28/02	GENERAL REVISION RW
1	03/08/02	GENERAL REVISION TJH

**RW** BUILDING CONSULTANTS, INC.  
813.684.3831

DATE: 1/04/02  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2199  
SHEET 1 OF 7

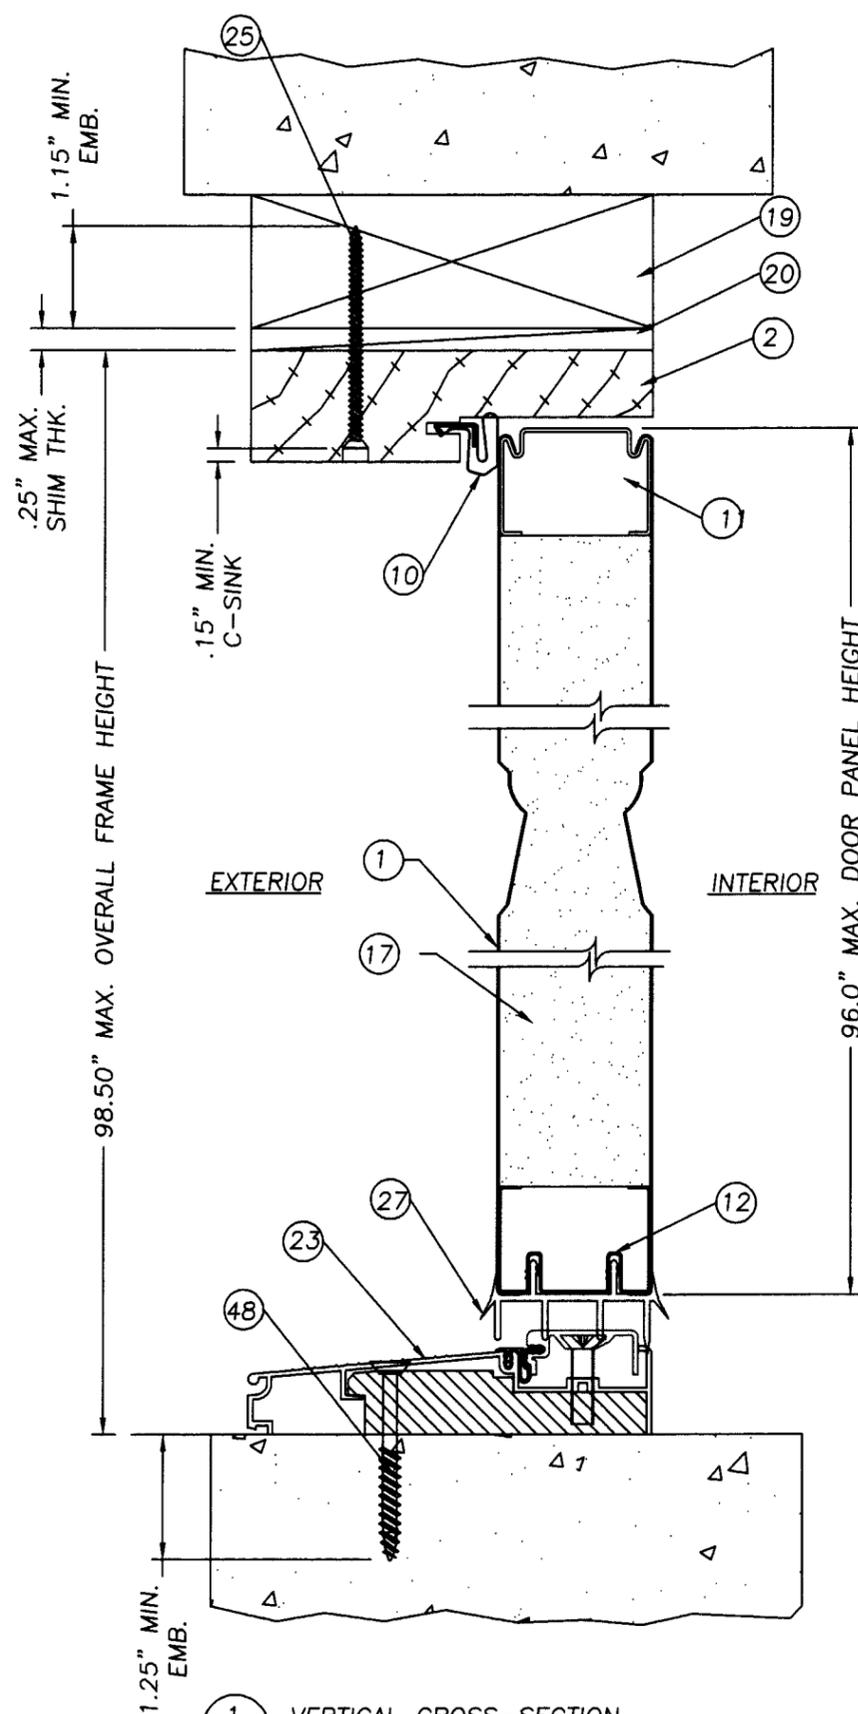

1 VERTICAL CROSS-SECTION  
2 DOOR PANEL

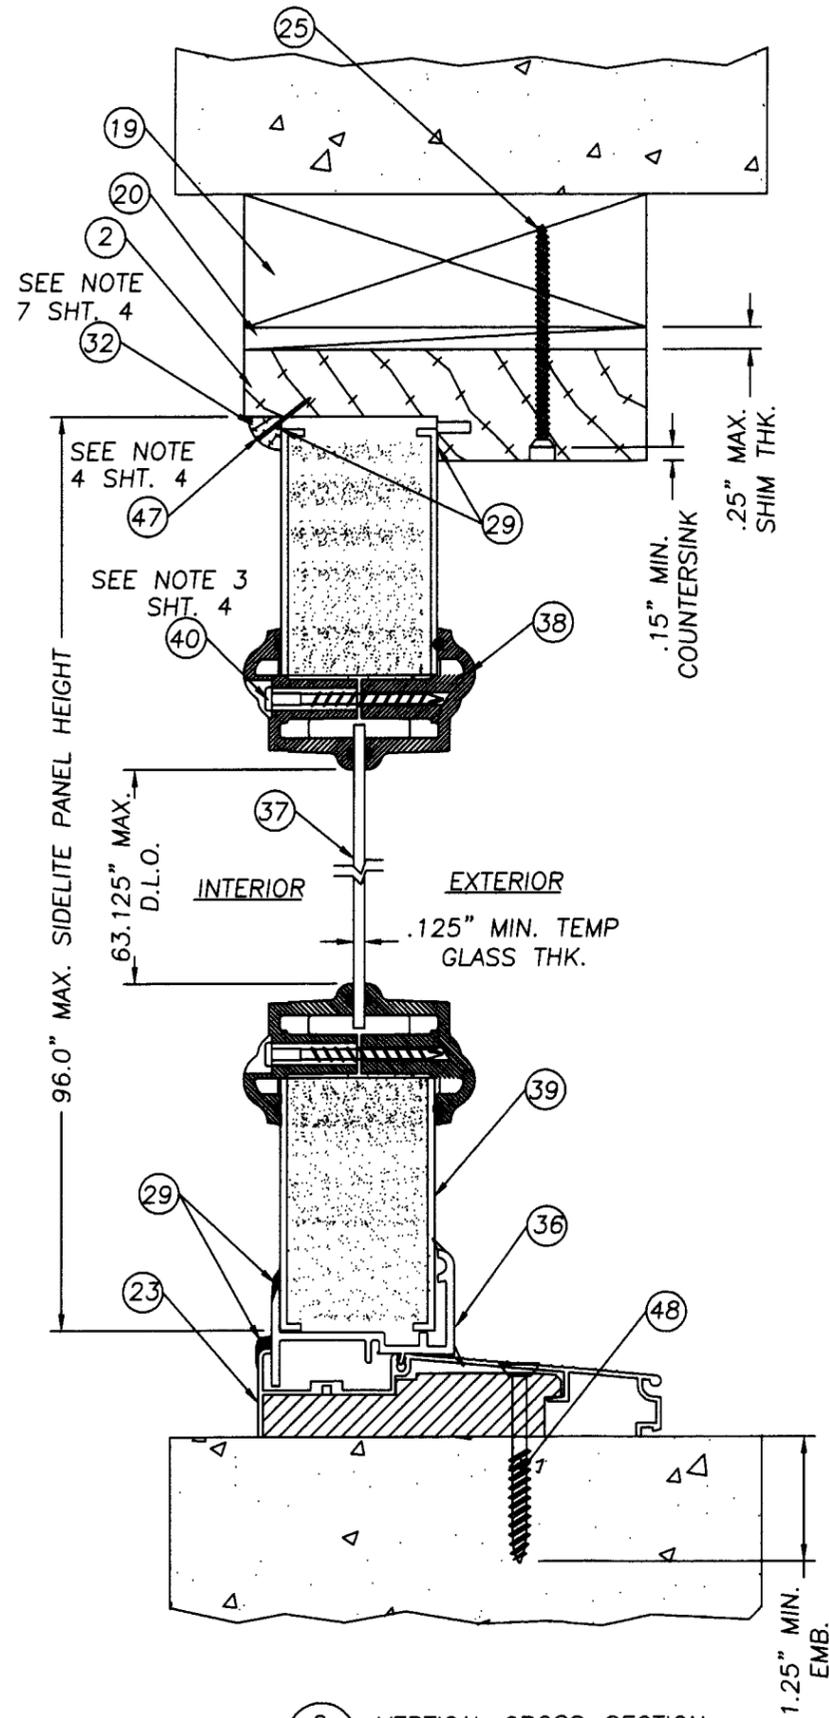

1 VERTICAL CROSS-SECTION  
2 SIDELITE SASH

ITEM	DESCRIPTION	MATERIAL
1	DOOR, STEEL EDGE 1.75" THK. 24GA. (.021" MIN.)	STEEL
2	HEAD JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	PINE
3	HINGE JAMB (1 1/4" x 4 6/16" FINGER JOINTED PINE)	PINE
4	SIDELITE BLANK JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	PINE
5	4" x 4" BUTT HINGE 12ga. (.097" HAGER)	STEEL
6	#9 x 1" PFH WOOD SCREW (HINGE TO DOOR)	STEEL
7	LATCH STILE REINFORCEMENT LVL	LVL
8	1/4" x 1 3/8" WOOD MULLION CAP	WOOD
9	16GA. BRAD TRIM NAIL 1" L.	STEEL
10	COMPRESSION WEATHERSTRIP (SCHLEGEL Q-LON QDS 650)	FOAM
11	TOP RAIL (1.67" x 1.21" x 0.021" THK. MIN. 22GA.)	STEEL
12	BOTTOM RAIL (1.67" x 1.21" x 0.021" THK. MIN. 24GA.)	STEEL
13	SIDE STILE (1.67" x 1.21" x 0.021 THK. MIN. 22GA.)	STEEL
14	#10 x 2" PFH WOOD SCREW	STEEL
15	WOOD LOCK BLOCK (1.71" x 4.0" x 18.0" PINE)	WOOD
16	1.131" x 1.131" x 12.4" MDF BOARD	-
17	EXPANDED POLYSTYRENE (1.0 to 1.25 lb. DENSITY) BY JELD-WEN	FOAM
18	NOT USED	-
19	2x WOOD SUB BUCK	WOOD
20	SHIM MATERIAL (.25" MAX. THK.)	-
21	KWIKSET 400 SERIES KNOB	-
22	KWIKSET TITAN 700 SERIES DEADBOLT	-
23	INSWING ADJUSTABLE THRESHOLD (.051" WALL BY PEMKO)	ALUMINUM
24	#8 x 2 3/4" PHILL. FLATHEAD WOOD SCREW	STEEL
25	#8 x 2 1/2" PHILL. FLATHEAD WOOD SCREW	STEEL
26	ASTRAGAL EXTRUDED ALUM. (WR80J WINDJAMBER II)	ALUM.
27	INSWING VINYL DOOR BOTTOM SWEEP	VINYL
28	EXTRUDED ALUMINUM ASTRAGAL BY IMPERIAL	ALUM.
29	SILICONE CAULK (CR LAWRENCE 33C)	SILICONE
30	GLAZING COMPOUND (QSD BY ODL)	SILICONE
31	#8 x 1" PPH WOOD SCREW (ASTRAGAL WR80J TO DOOR)	STEEL
32	3/8" x 3/8" 1/4" ROUND SIDELITE STOP	WOOD
33	WOOD LOCK BLOCK 1.71" THK. X 4.0" WIDE X 18" LVL	LVL
34	SCHLAGE KNOB SET #F51	-
35	SCHLAGE DEADBOLT #B360	-
36	INSWING SIDELITE BOTTOM SEAL	VINYL
37	1/8" TEMPERED GLASS (BY PPG)	GLASS
38	LITE FRAME (ODL HP POLYPROP. THERMOFIL-P6-30FM0391)	POLYPROP.
39	STEEL SIDELITE PANEL 24GA. (.021" MIN. STEEL)	STEEL
40	#8 x 1 1/2" PLASCREW (LITE FRAME)	STEEL
41	#8 x 3" PHILLIPS FLAT HEAD WOOD SCREW	STEEL
42	YALE KNOB HERITAGE SERIES	-
43	YALE DEADBOLT HERITAGE SERIES	-
44	3/4" THK. x 4 9/16" DEEP PRESSURE TREATED REINFORCEMENT	WOOD
45	#8 x 2" PHILLIPS FLATHEAD WOOD SCREW	STEEL
46	#10 x 1" PHILLIPS FLATHEAD WOOD SCREW	STEEL
47	16GA. BRAD TRIM NAIL 3/4" L.	STEEL
48	3/16" TAPCON ANCHOR (ELCO)	STEEL
49	GLAZING COMPOUND DOW 1199 SILICONE	SILICONE
50	LATCH JAMB (1 1/4" x 4 9/16" FINGER JOINTED PINE)	WOOD

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT: INSWING OPAQUE STEEL  
EDGE DOOR UP TO  
107" x 8'0" UNIT  
PART OR ASSEMBLY:  
VERTICAL CROSS SECTIONS  
& BILL OF MATERIALS

NO.	DATE	REVISIONS
2	05/28/02	GENERAL REVISION RW
1	03/08/02	GENERAL REVISION TJH

**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831


Approved as complying with the  
Florida Building Code  
Date July 3, 2002  
NOA# 02-010-04  
Miami Dade Product Control  
Division  
By Manuel Perez

DATE: 1/04/02  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2199  
SHEET 2 OF 7

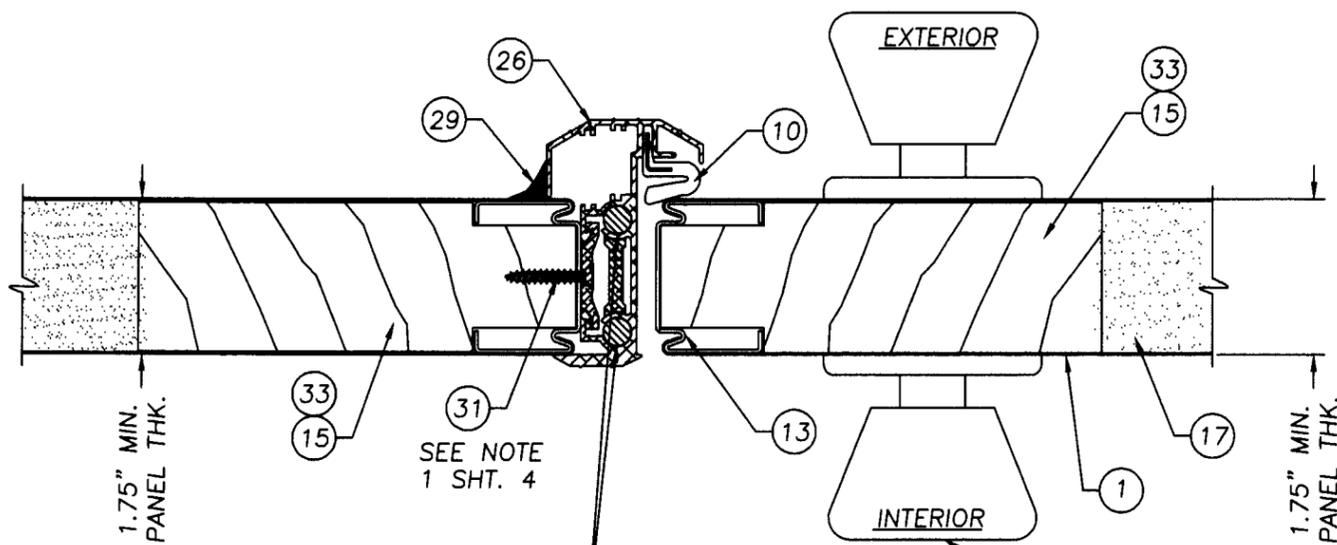


ASTRAGAL RETAINER BOLTS (4)  
 BOLTS TOTAL, (2) 17.0" L. x  
 .312" DIA. @ TOP & (2) 8.0" L.  
 x .312" DIA. @ BOTTOM


1 HORIZONTAL CROSS SECTION  
 3 AT ASTRAGAL W/WINDJAMBER II BY GENESIS  
 SEE DESIGN PRESSURE CHART

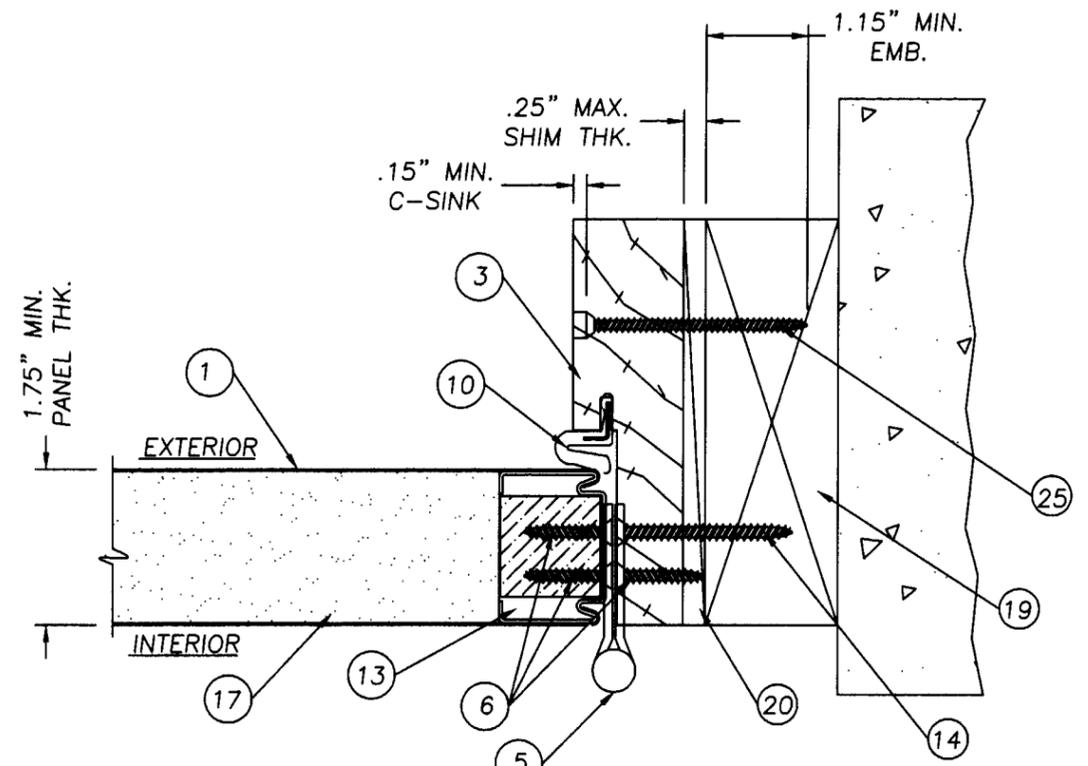

2 HORIZONTAL CROSS SECTION  
 3 HINGE JAMB TO BUCK

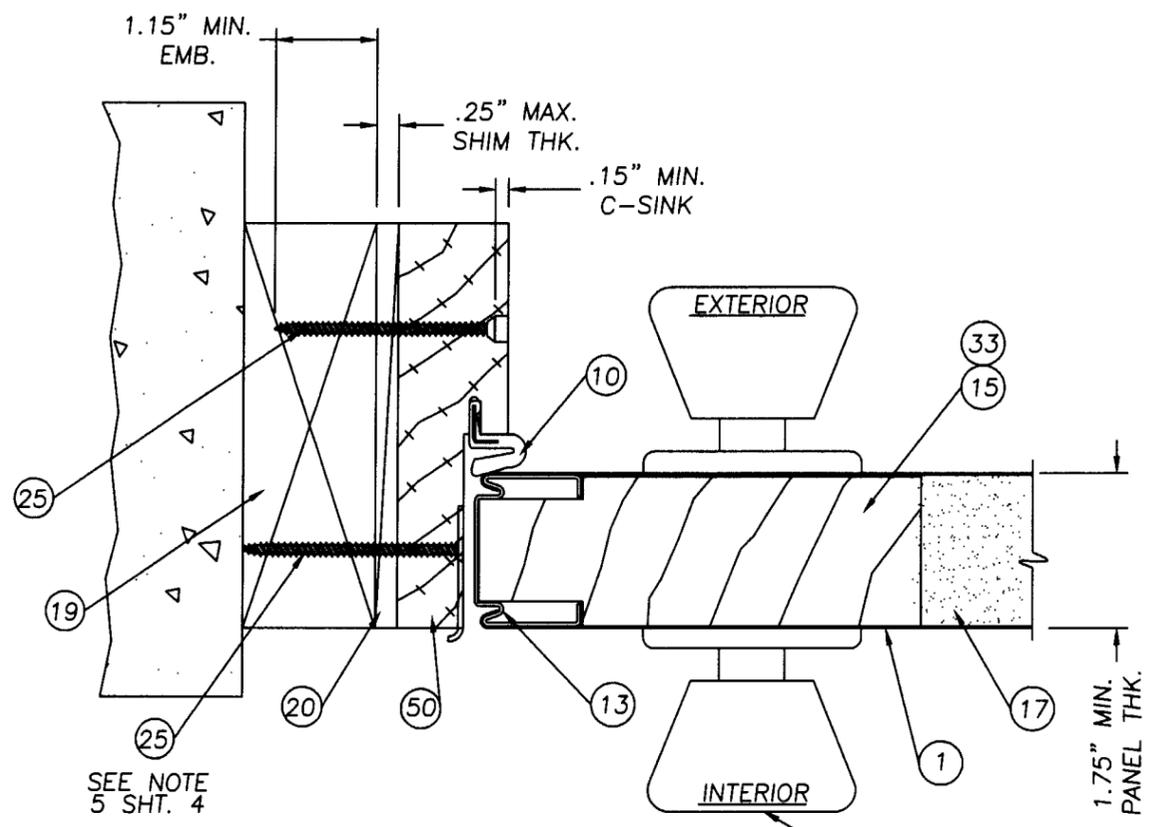

3 HORIZONTAL CROSS SECTION  
 3 LATCH JAMB TO BUCK

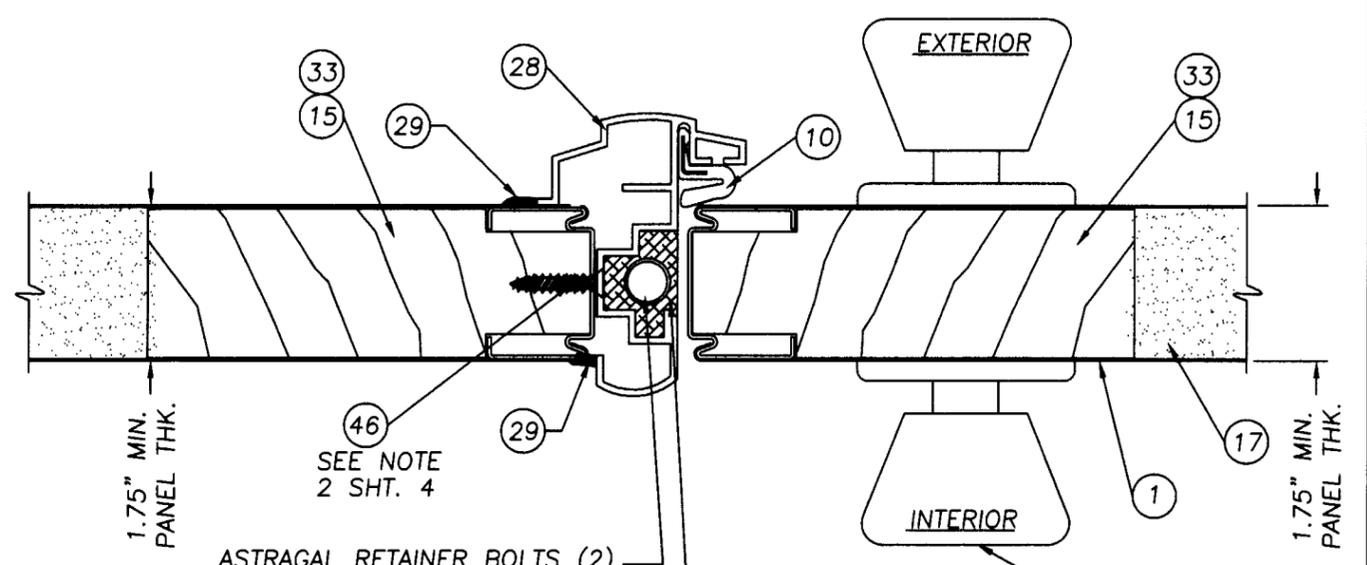

ASTRAGAL RETAINER BOLTS (2)  
 TOTAL, (1) 9.0" L. x  
 .312" DIA. @ TOP & (1)  
 9.0" L. x .312" DIA. @ BOTTOM

ALUM. RETAINING SLIDE  
 1.0" x 4.5" x 0.565"

1 HORIZONTAL CROSS SECTION  
 3 AT ASTRAGAL  
 IMPERIAL (HURRICANE) ASTRAGAL  
 SEE DESIGN PRESSURE CHART

JELD-WEN, INC.  
 31725 HIGHWAY 97 NORTH  
 CHILOQUIN, OR. 97624  
 PH. 541.783.2057




PRODUCT:  
 INSWING OPAQUE STEEL  
 EDGE STEEL DOOR UP TO  
 107" x 8-0 UNIT  
 PART OR ASSEMBLY:  
 HORIZONTAL CROSS  
 SECTIONS

REVISIONS		NO.	DATE	BY
2	GENERAL REVISION	RW	05/28/02	
1	GENERAL REVISION	TJH	03/08/02	

RW BUILDING  
 CONSULTANTS, INC.  
 813.684.3831

Approved as complying with the  
 Florida Building Code  
 Date July 3, 2002  
 NOA# 021010.04  
 Miami Dade Product Control  
 Division  
 By Mmanuel Perez

DATE: 1/04/02  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.:  
 S-2199  
 SHEET 3 of 7

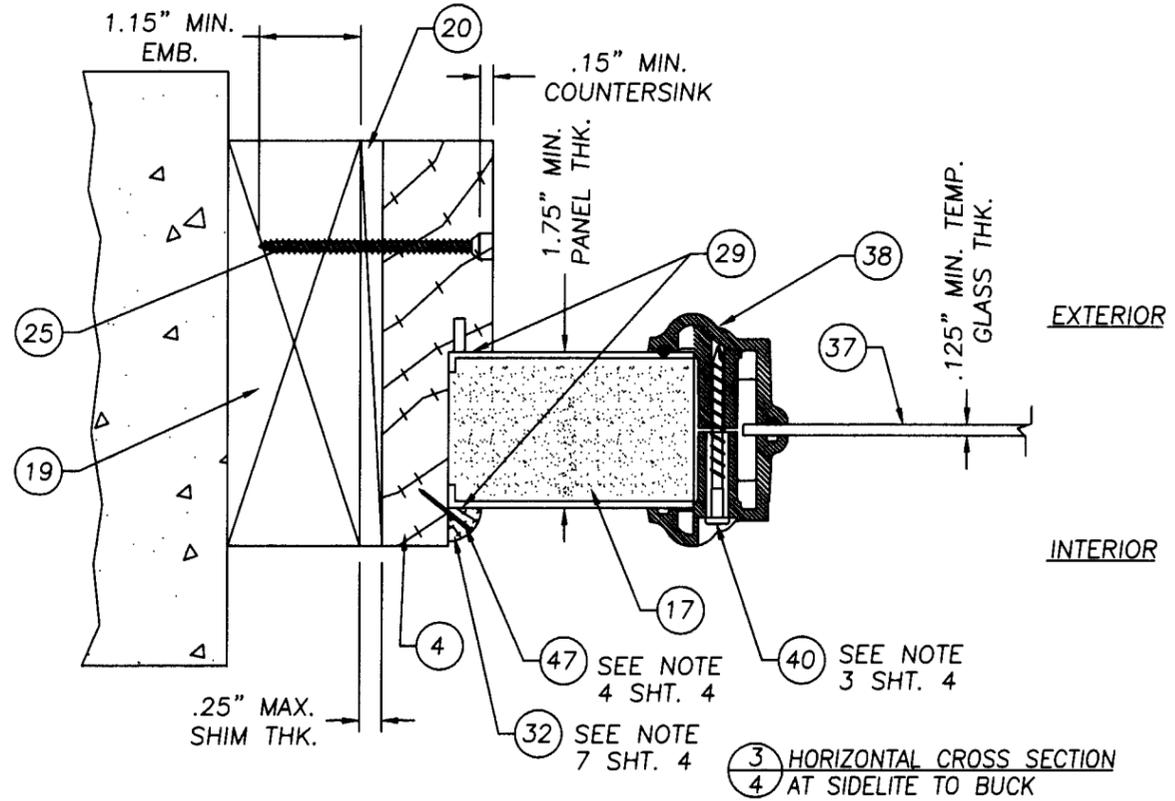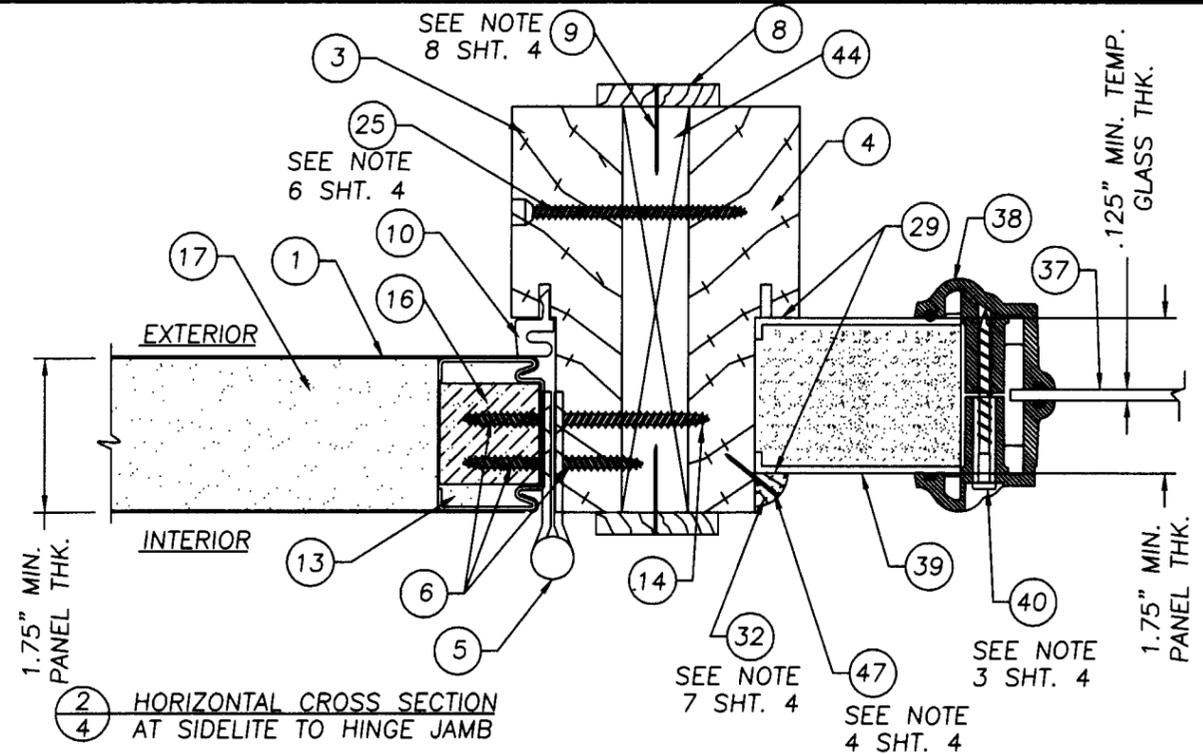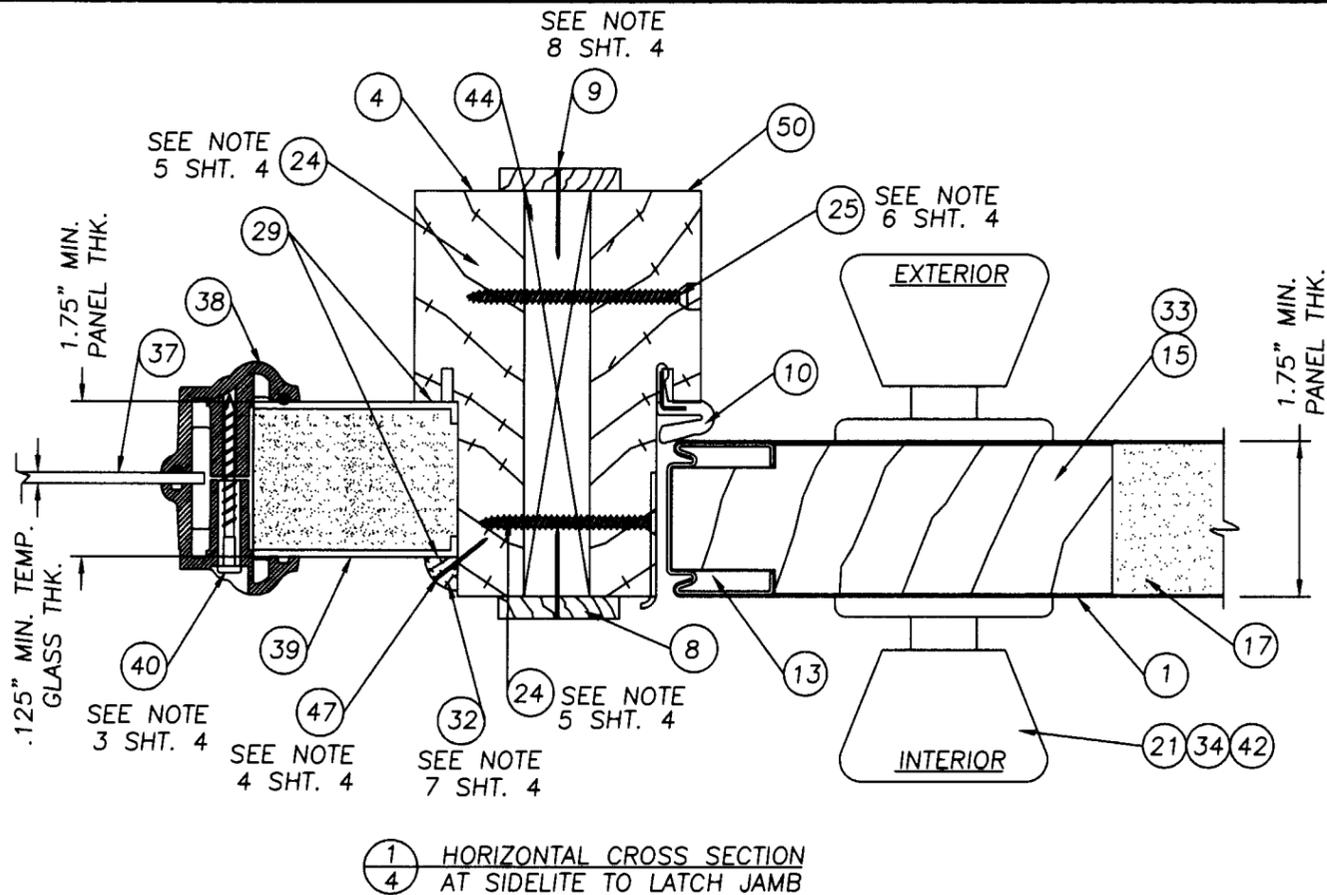

NOTES:

1. SPACING FOR THE (9) #8 x 1" PFH SCREW ATTACHING THE WINDJAMBER ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: TOP DOWN; 1.0", 3.0" & 5.0". FROM THE BOTTOM UP; 1.0", 3.0", 5.0", 20.0", 42.0" & 61.0"
2. SPACING FOR THE (14) #10 x 1" PFH SCREW ATTACHING THE IMPERIAL ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: FROM THE TOP DOWN & BOTTOM UP; 1.0", 2.5", 4.0", 5.5", 13.0", 18.0" & 26.0".
3. SPACING FOR #8 x 1 1/2" PLASCREW IS AS FOLLOWS; TOP & BOTTOM; (2) SCREWS 3.0" IN FROM EACH HORIZONTAL CORNER. FROM THE TOP OF THE FRAME DOWN ON THE SIDES; 3.0", 13.5", 24.5", 36.0", 46.0", 57.5", 68.5" & 79.0".
4. SPACING FOR BRAD TRIM NAIL 3/4" L. ATTACHING THE QUARTER ROUND TO THE SIDELITE IS AS FOLLOWS; TOP & BOTTOM; 1.25" IN FROM EACH HORIZONTAL CORNER WITH (1) MORE NAIL IN THE MIDDLE. SIDES; 1.25" FROM EACH END & SIX MORE EQUALLY SPACED ON THE FIELD.
5. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND BUCK USE #8 x 2 1/2" PFH WOOD SCREW. WHEN ATTACHING THE STRIKE PLATE TO THE JAMB AND SIDELITE JAMB AT THE MULLION USE #8 x 2." PFH WOOD SCREW.
6. SPACING FOR #8 x 2.5" PFH WOOD SCREW ATTACHING THE MULLIONS TOGETHER IS AS FOLLOWS; 6.0" FROM EACH VERTICAL CORNER WITH (5) MORE SCREWS EQUALLY SPACED, A TOTAL OF (7) SCREWS PER EACH VERTICAL MULLION.
7. THE SIDELITE IS SECURED INTO THE SIDELITE JAMB WITH SILICONE CAULK ON THREE SIDES & 3/8" x 3/8" 1/4 ROUND & BRAD TRIM NAIL x 3/4" L.
8. THE MULLION CAP IS ATTACHED TO THE PRESSURE TREATED REINFORCEMENT WITH ITEM #23 A 1" TRIM NAIL SPACED A MAX. OF 12" ON CENTER.

JELD-WEN, INC.  
 31725 HIGHWAY 97 NORTH  
 CHILOQUIN, OR. 97624  
 PH. 541.783.2057


PRODUCT: INSWING OPAQUE STEEL EDGE STEEL DOOR UP TO 107" x 8'-0" UNIT  
 PART OR ASSEMBLY: HORIZONTAL CROSS SECTIONS & NOTES

NO.	DATE	REVISIONS	BY
2	05/28/02	GENERAL REVISION	RW
1	03/08/02	GENERAL REVISION	TJH



RW BUILDING CONSULTANTS, INC.  
 813.684.3831

Approved as complying with the Florida Building Code  
 Date July 3, 2002  
 NOA# 0270110.04  
 Miami Dade Product Control Division  
 By Manuel Perez


DATE: 1/04/02  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2199  
 SHEET 4 OF 7

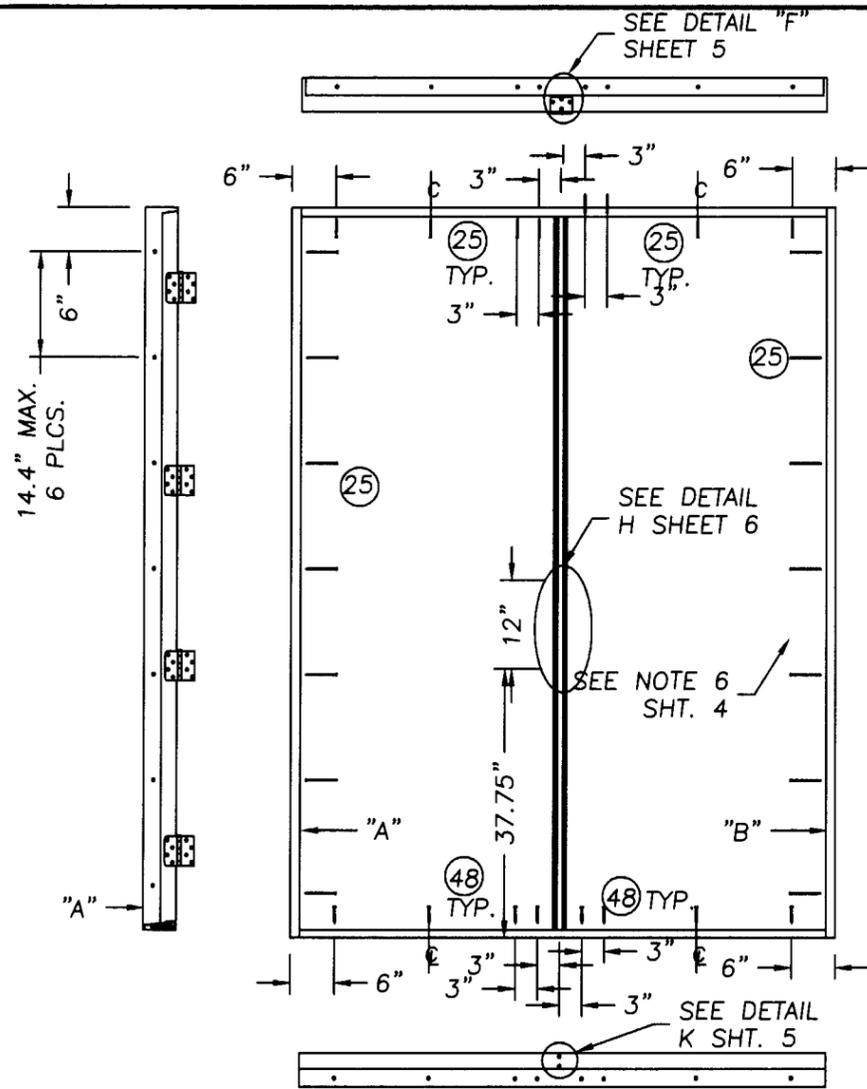


DOUBLE DOOR ANCHORING LOCATIONS

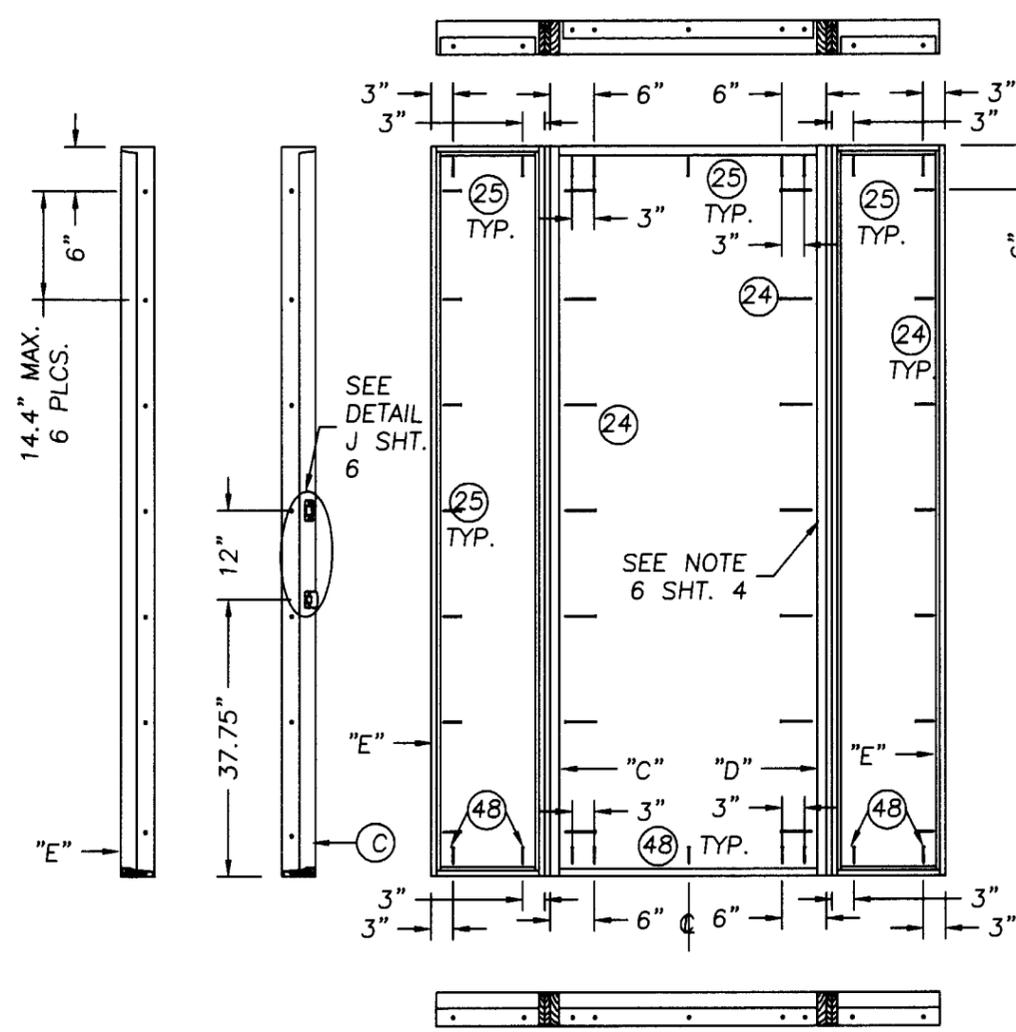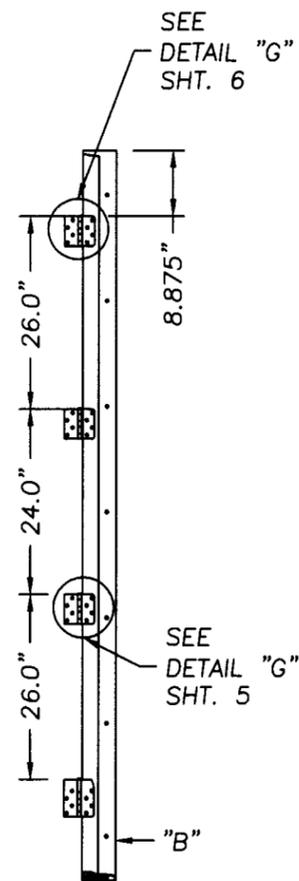

SINGLE DOOR W/SIDELITES ANCHORING LOCATIONS




DETAIL K AT HEADER  
W/WINDJAMBER II ASTRAGAL BY GENESIS




DETAIL K AT HEADER  
W/IMPERIAL HURRICANE ASTRAGAL

ASTRAGAL RETAINER BOLT HOLES  
MUST BE DRILLED THROUGH  
THE THRESHOLD & INTO THE  
TEST BUCK DEEP ENOUGH  
FOR A 2\"/>



DETAIL F AT SILL  
W/WINDJAMBER II ASTRAGAL BY GENESIS



DETAIL F AT SILL  
W/IMPERIAL HURRICANE ASTRAGAL

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057


PRODUCT:  
INSWING OPAQUE STEEL  
EDGE STEEL DOOR UP TO  
107\"/>

NO.	DATE	REVISIONS
2	05/28/02	GENERAL REVISION
1	03/08/02	GENERAL REVISION
		BY
		TJH
		RW


**RW** BUILDING  
CONSULTANTS, INC.  
813.684.3831

Approved as complying with the  
Florida Building Code  
Date July 3, 2002  
NOA# 02-10110-04  
Miami Dade Product Control  
Division  
By Maurice Puz



DATE: 1/04/02  
SCALE: N.T.S.  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.:  
S-2199  
SHEET 5 OF 7

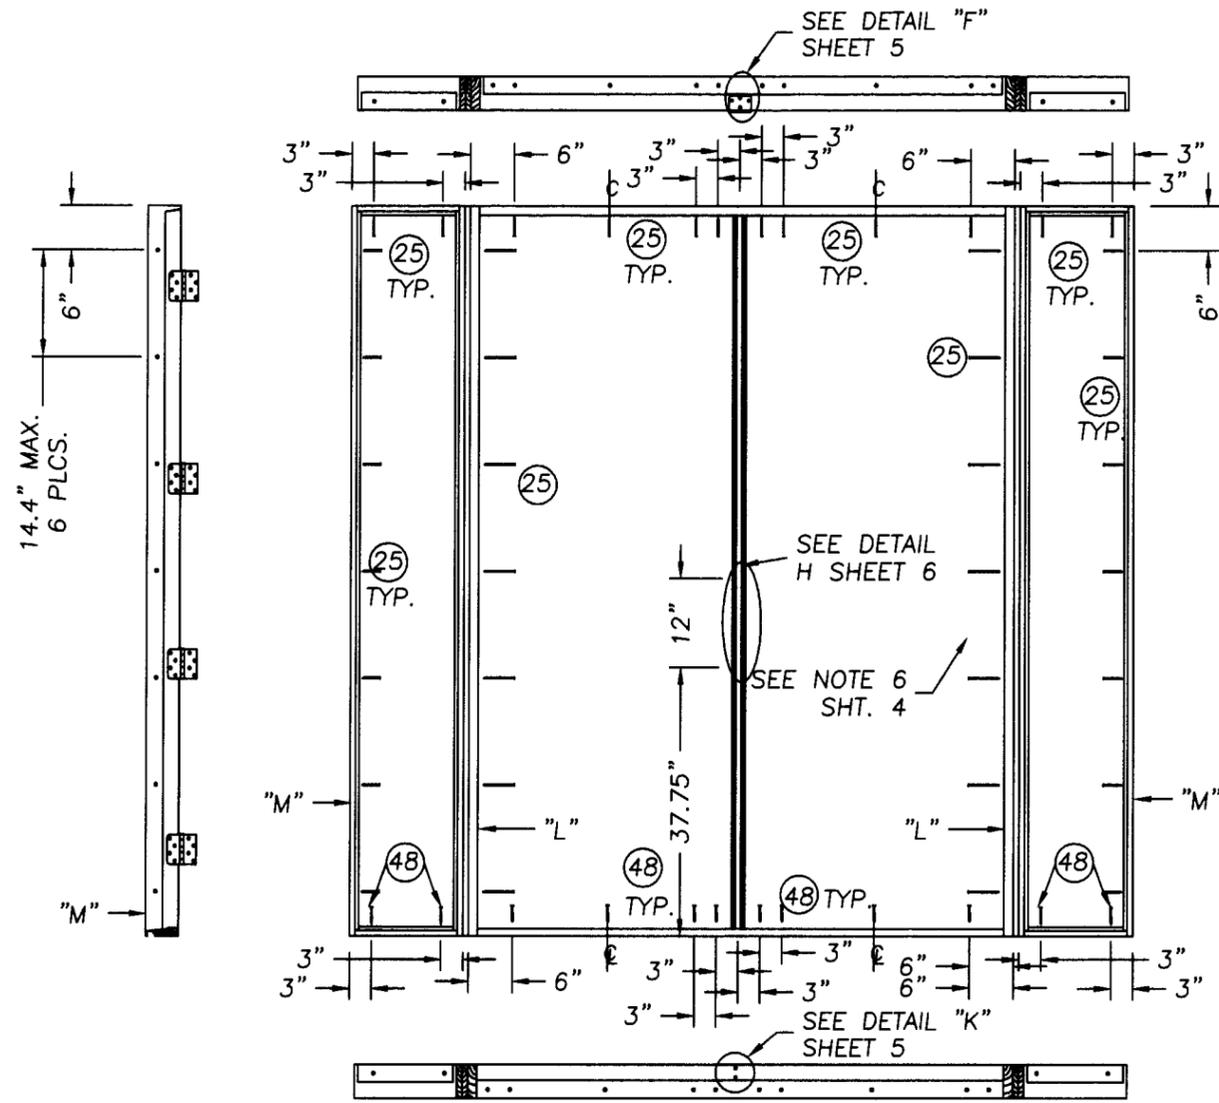


DOUBLE DOOR W/SIDELITES ANCHORING LOCATIONS

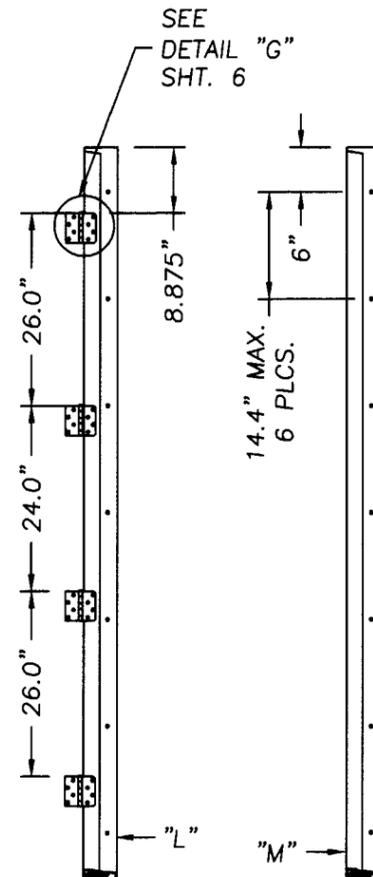


SINGLE DOOR ANCHORING LOCATIONS

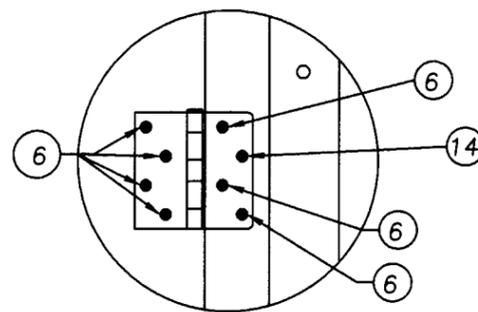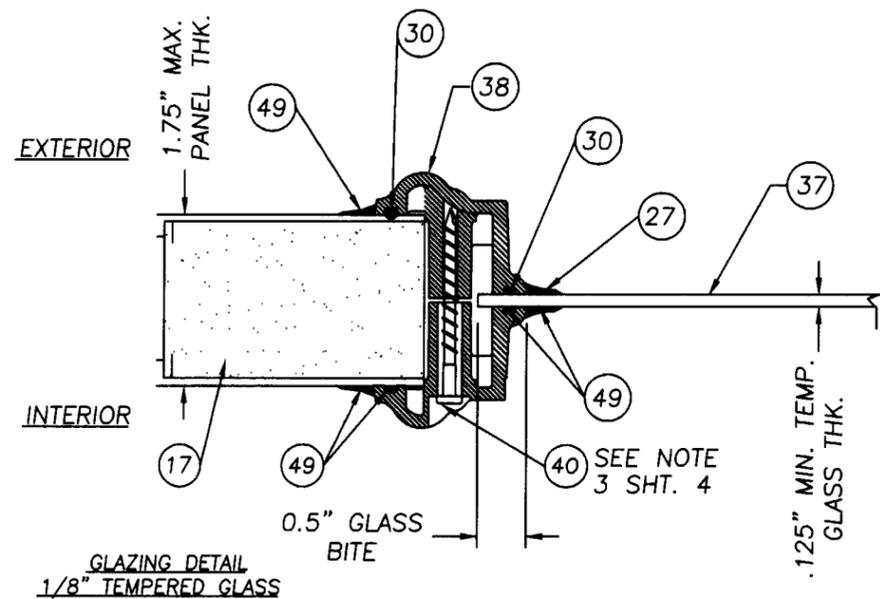

DETAIL G HINGE TO JAMBS & DOOR

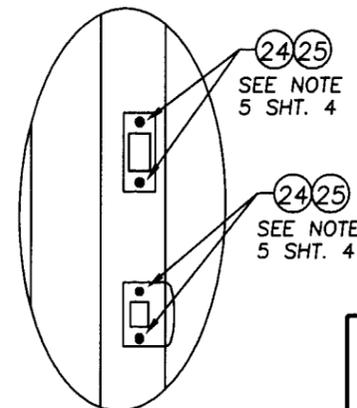

DETAIL J STRIKE PLATES TO JAMBS SEE NOTE 5 SHT. 4

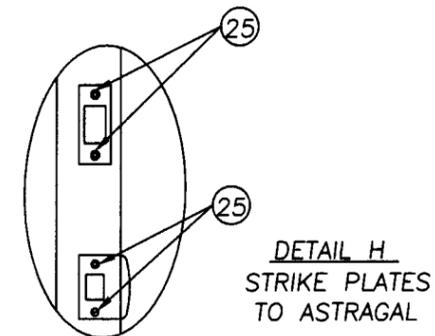

DETAIL H STRIKE PLATES TO ASTRAGAL

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057

PRODUCT: INSWING OPAQUE STEEL EDGE STEEL DOOR UP TO 107\"/>

NO.	DATE	REVISIONS
2	05/28/02	GENERAL REVISION RW
1	03/08/02	GENERAL REVISION TJH

RW BUILDING CONSULTANTS, INC.  
813.684.3831

DATE: 1/04/02

SCALE: N.T.S.


DWG. BY: WLN

CHK. BY: RW


DRAWING NO.: S-2199

SHEET 6 OF 7


Approved as complying with the Florida Building Code  
Date July 3, 2002  
NOA# 02-10110.04  
Miami Dade Product Control Division  
By: *Manuel Perez*

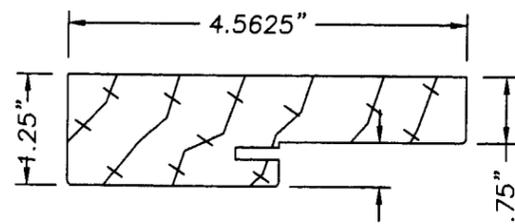

2 4  
3 50  
WOOD FRAME

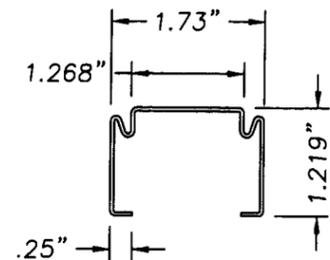


11 13  
DOOR STEEL EDGE CAP,  
TOP, LATCH STILE & HINGE STILE  
.021" ROLL FORMED STEEL

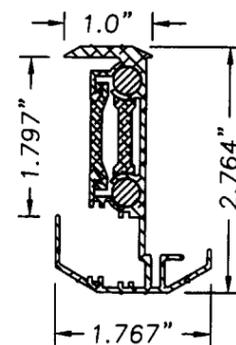


26  
ASTRAGAL WINDJAMBER II  
(WR80J T-6063 EXTRUDED ALUMINUM  
MFG BY GENESIS


ASTRAGAL HAS  
(2) 8 .0" L. x .312" DIA.  
BOLTS @ BOTTOM &  
(2) 17 .0" L. x .312" DIA.  
BOLTS @ TOP




38  
LITE FRAME OD  
HP POLYPROPYLENE  
(THERMOFIL-P6-30FM0391)

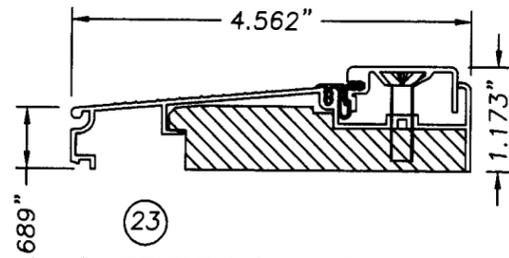

23  
ADJUSTABLE INSWING THRESHOLD  
W/ADJUSTABLE CAP  
BY IMPERIAL .051" WALL THK.

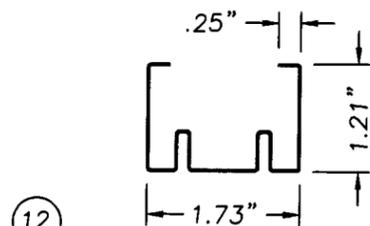


12  
DOOR STEEL EDGE CAP, BOTTOM  
.021" ROLL FORMED STEEL

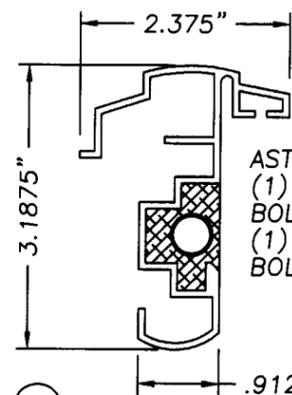


28  
OPTIONAL  
IMPERIAL (HURRICANE) ASTRAGAL  
EXTRUDED ALUMINUM .075" WALL


ASTRAGAL HAS  
(1) 9.0" L. x .312" DIA.  
BOLT @ TOP &  
(1) 9.0" L. x .312" DIA.  
BOLT @ BOTTOM

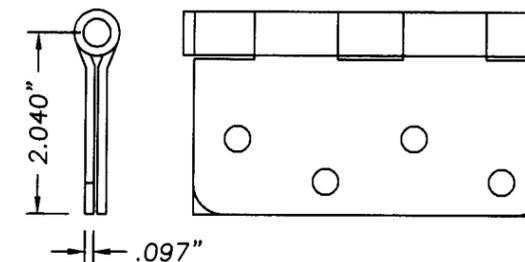


5  
4 x 4 STEEL DOOR HINGE  
.097" THK. STEEL BY HAGER

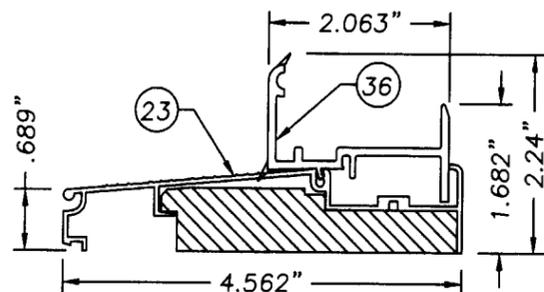


ADJUSTABLE INSWING THRESHOLD  
W/SIDELITE BOTTOM SEAL  
BY IMPERIAL .051" WALL THK.

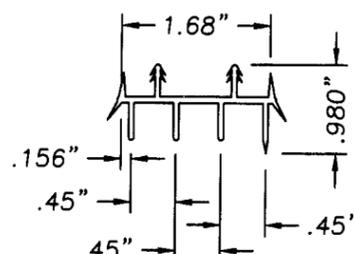

27  
INSWING DOOR BOTTOM  
SWEEP, EXTRUDED VINYL  
.060" THK WALL TYP.

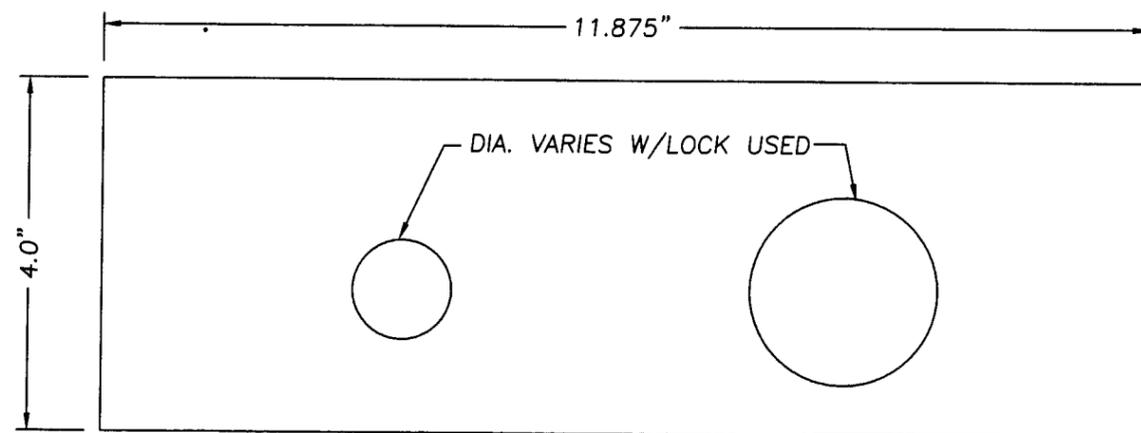


15 33  
WOOD LOCK BLOCK, 1.71" THK.

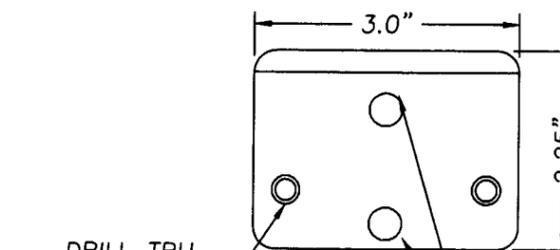

DRILL TRU  
FOR A #8  
PFH WOOD  
SCREW 2PLCS

DRILL TRU FOR  
.357" DIA. ASTRAGAL  
RETAINER BOLTS

WINDJAMBER II WR68J STRIKE PLATE  
STEEL PLATE

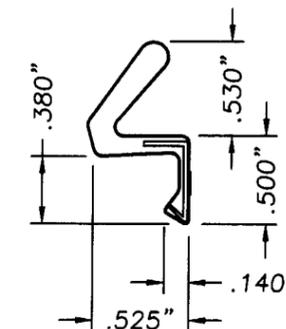

10  
COMPRESSION WEATHERSRTIP  
SCHLEGEL Q-LON QDS 650

PRODUCT:  
INSWING OPAQUE STEEL  
EDGE DOOR UP TO  
107" x 8'0 UNIT

PART OR ASSEMBLY:

UNIT COMPONENTS

NO.	DATE	REVISIONS	TJH	BY
2	05/28/02	GENERAL REVISION	RW	
1	03/08/02	GENERAL REVISION	TJH	

RW BUILDING  
CONSULTANTS, INC.  
813.684.3831

DATE: 1/04/02

SCALE: NTS

DWG. BY: WLN

CHK. BY: RW

DRAWING NO.:  
S-2199

SHEET 7 OF 7

Approved as complying with the  
Florida Building Code  
Date July 3, 2002  
NOA# 02-F-010.04  
Miami Dade Product Control  
Division  
By Maurice Perez

JELD-WEN, INC.  
31725 HIGHWAY 97 NORTH  
CHILOQUIN, OR. 97624  
PH. 541.783.2057