



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**The Overhead Door Corporation.  
1900 Crown Drive.  
Farmers Branch, TX 75234**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by the BCCO and accepted by the Building Code and Product Review Committee (BCPRC) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The BCCO (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BCPRC reserves the right to revoke this acceptance, if it is determined by BCCO that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the South Florida Building Code, 1994 Edition for Miami-Dade County or Florida Building Code.

**DESCRIPTION: Rolling Door 22' Wide.**

**APPROVAL DOCUMENT:** Drawing No. **D-307779**, Sheets 1 and 2 of 2, titled "Series 610/620, Rolling Service Door Dade County," dated 06/30/95 & 10/27/95, prepared by Overhead Door Corporation. signed and sealed by L. G. Krupke, PE., bearing the Miami-Dade County Product Control Approval stamp with the NOA number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large & Small Missile.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.



This NOA consists of this page 1 as well as approval document mentioned above.  
The submitted documentation was reviewed by **Candido F. Font PE.**



**NOA No: 02-0117.03  
Expiration Date: February 22, 2007  
Approval Date: March 14, 2002  
Page 1**

**NOTES**



1. (-W/L) = NEGATIVE WINDLOAD  
(+W/L) = POSITIVE WINDLOAD
2. WALL ANGLES MAY BE WELDED TO JAMB. PLUG WELDS IN THE WALL SLOTS OR ALTERNATE WELDS SUFFICIENT TO HOLD THE LOADS SHOWN ON THE "DOOR SIZE REFERENCE SUMMARY CHART".
3. RATED DESIGN LOAD ±53.33 PSF.
4. CURTAIN MATERIAL: ASTM A-446 GRADE C  
GUIDE MATERIAL: ASTM A-36
5. CURTAIN MATERIAL LESS THAN 20 GAUGE SHALL BE GALVANIZED ACCORDING TO ASTM A-525 TO G90 OR AN EQUIVALENT SURFACE COATING APPROVED BY THE DADE COUNTY BUILDING CODE COMPLIANCE OFFICE.

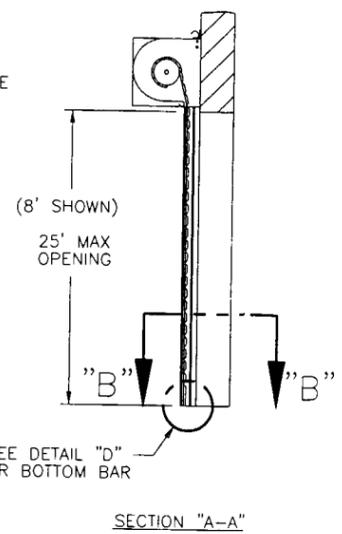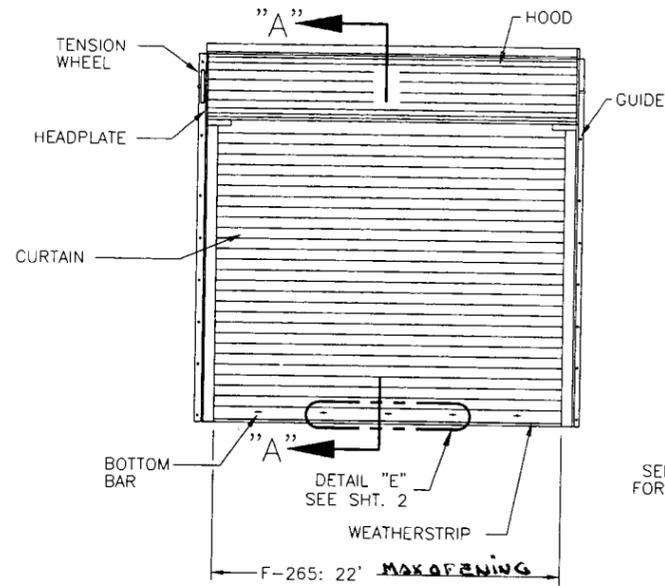






**PARALLEL FORCE:** THE CATENARY FORCE OF THE CURTAIN APPLIED TO THE WINDBAR IN POUNDS PER FOOT OF HEIGHT.

**NORMAL FORCE:** THE FORCE NORMAL TO THE DOOR OPENING IN POUNDS PER FOOT OF HEIGHT.

**MOMENT:** THE RESOLUTION OF THE PARALLEL & NORMAL FORCES TO A POINT CORRESPONDING TO THE HEEL OF THE WALL ANGLE IN INCH/POUNDS PER FOOT OF DOOR HEIGHT.

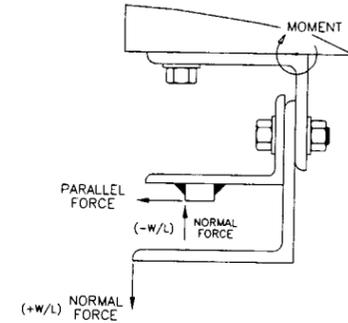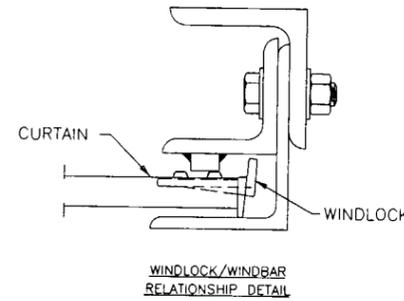

REVISIONS			
LETTER	DESCRIPTION	DATE	APPROVAL
-	RFP PER DRN 300426	10/27/95	JB
A	REV PER ECO 31209	1/25/96	JB
B	REV PER EN 10334	4/27/99	CoB

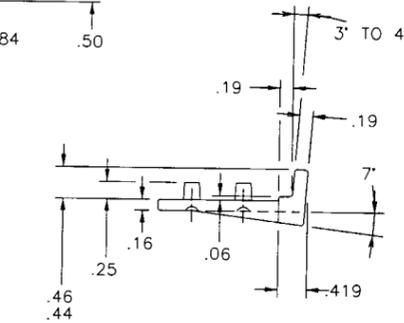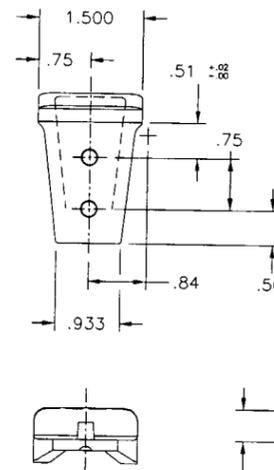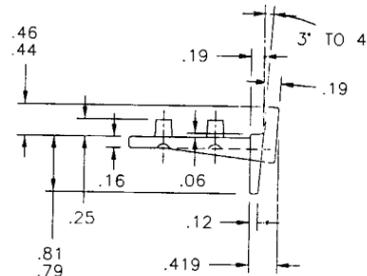
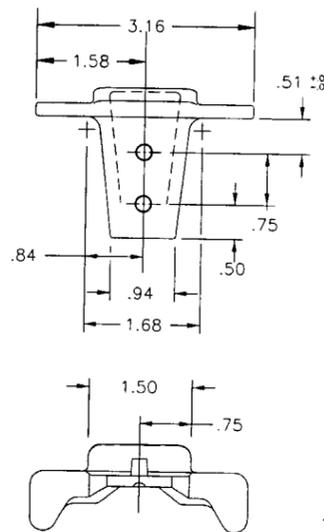
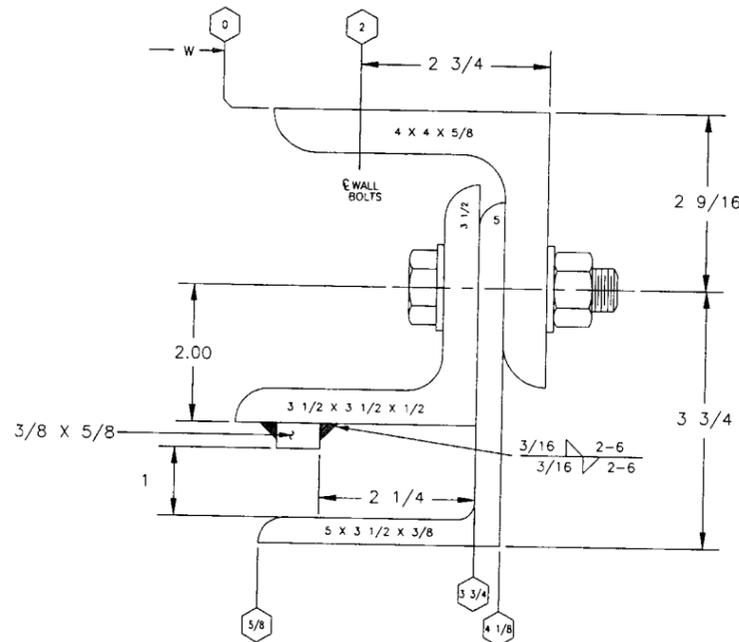


F-265 - DOOR SIZE REF. SUMMARY

	LOADS *	
	20 GA **	18 GA
MOMENT	19985	19738
NORMAL	880	880
PARALLEL	3357	3307

\* LOADS - PER FOOT OF HEIGHT

	ASSEMBLY BOLT	WALL BOLT STEEL JAMB	WALL ATTACHMENT STEEL JAMB
F-265	5/8" GRADE 5, 10" O.C.	5/8" GRADE 5, 11" O.C.	PLUG WELDS 11" O.C., 11/16" X 2" SLOT

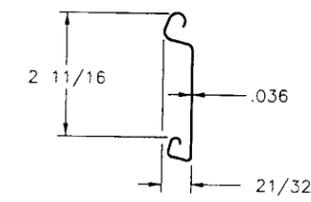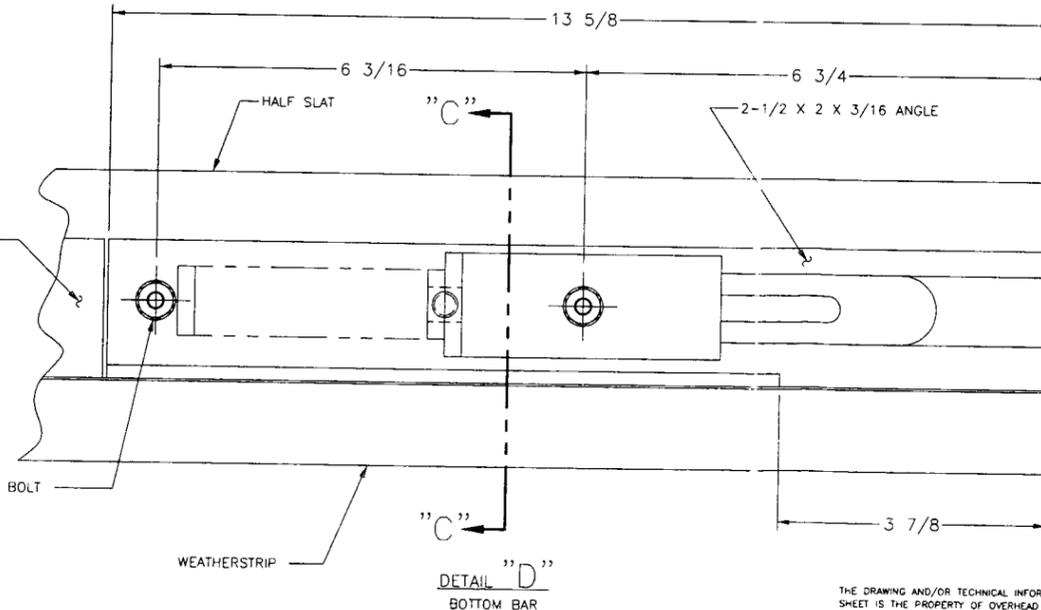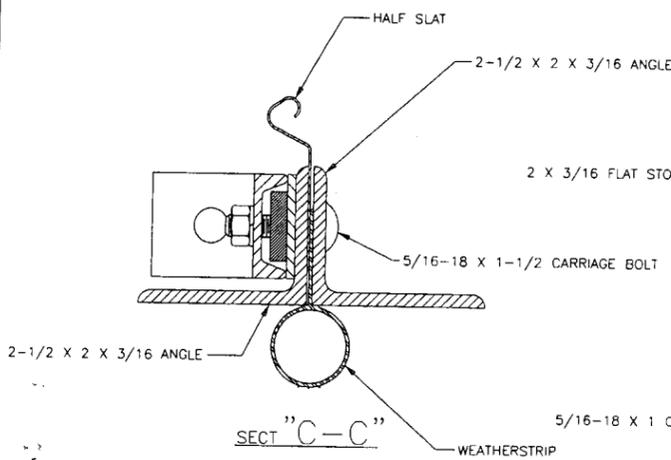

F-265 SLAT

GAUGE OPTIONS: 20 \*\*, 18  
\*\* TESTED IN ACCORDANCE WITH DADE COUNTY PROTOCOLS PA 201-94, PA 202-94, AND PA 203-94

*LeRoy Krupke*  
4-21-99

OVERHEAD DOOR CORPORATION  
1900 CROWN DRIVE  
FARMERS BRANCH, TEXAS 75234  
LeROY G. KRUPKE, P.E. #36580

ACCEPTANCE NO. 02-011703  
EXPIRATION DATE 02/22/07  
PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE  
MAY 23 99  
99-0121.04


THE DRAWING AND/OR TECHNICAL INFORMATION ON THIS SHEET IS THE PROPERTY OF OVERHEAD DOOR CORPORATION OR ITS SUBSIDIARY AND IS LOANED IN CONFIDENCE FOR ENGINEERING AND MUTUAL ASSISTANCE PURPOSES ONLY. AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING DISCLOSED HEREON WITHOUT THE EXPRESS PERMISSION OF OVERHEAD DOOR CORPORATION WHICH MAY RECALL THIS SHEET AT ANY TIME.

UNLESS OTHERWISE SPECIFIED			OVERHEAD DOOR CORPORATION		DRAWING TITLE:	
DIMENSIONS DECIMAL	HOLE DIAMETERS	ANGLES ± 0° 30'	NAME	DATE	SERIES 610/620, ROLLING SERVICE DOOR DADE COUNTY	
XXX ± .01	UNDER 251-204-.003	FRACTIONS ± 1/16"	DRAWN BY: JEFF BENNETT	6/30/95	DRAWING NUMBER D-307779	
XXX ± .005	251 TO 300-208-.003 OVER 300-208-.003		CHECKED BY: PE VESSELS	10/27/95	SCALE: NONE SHEET 1 OF 2	
			APPLIED FINISH: N/A	UNIT OF MEASURE: N/A	APPROVED BY: JEFF BENNETT	10/27/95

NOTES


1. MATERIAL: ALUMINUM 3003 H14 (0.03 THICK) WITH TRANSPARENT KELSTRIP COVERING.
2. COLOR: HANSCHY RED CS 2311.
3. SOURCE: OHD ADVERTISING AND MERCHANDISING  
2170 FRENCH SETTLEMENT RD.  
DALLAS, TX 75212
4. STAMP FACTORY ORDER NUMBER HERE.
5. A LETTER MUST BE STAMPED ON ROLLING FIRE DOORS TO IDENTIFY MANUFACTURING PLANT (I.E., USE "P" FOR PENNSYLVANIA).
6. FASTENER FOR TAG IS P/N 080276-1004(STEEL DRIVE SCREW). TAG WILL BE MOUNTED IN THE MIDDLE OF THE BOTTOM BAR.
7. STAMP SLAT TYPE HERE.
8. STAMP ACCEPTANCE NUMBER HERE.

REVISIONS			
LETTER	DESCRIPTION	DATE	APPROVAL
-	RFP PER DRN 300426	10/27/95	JB
A	REV PER ECO 31209	1/25/96	JB
B	REV PER EN 10334	4/22/99	CGP

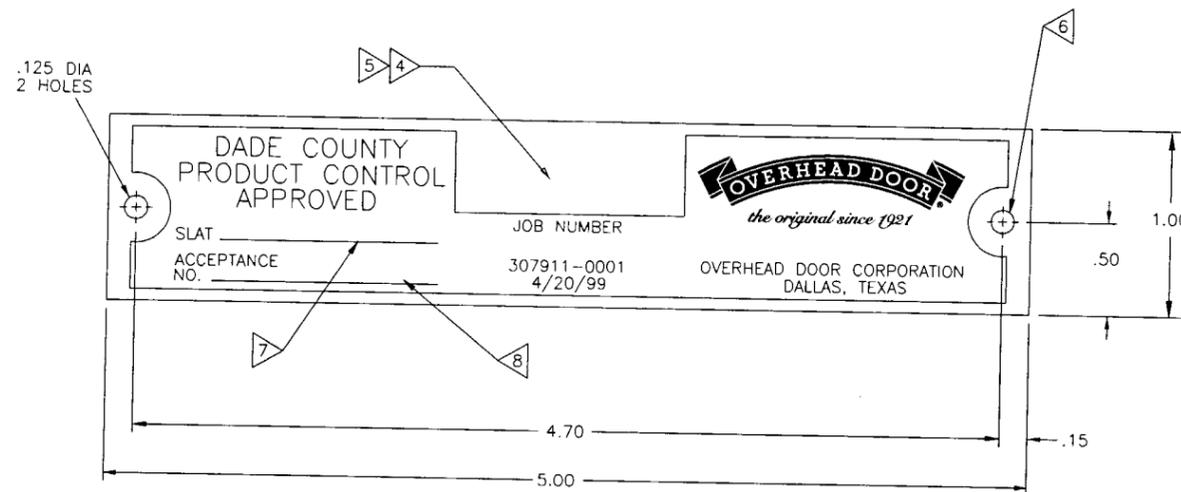

P/N 307911-0001 - DADE CO. APPROVAL TAG, ROLLING DOORS & GRILLES

SCALE: 2/1

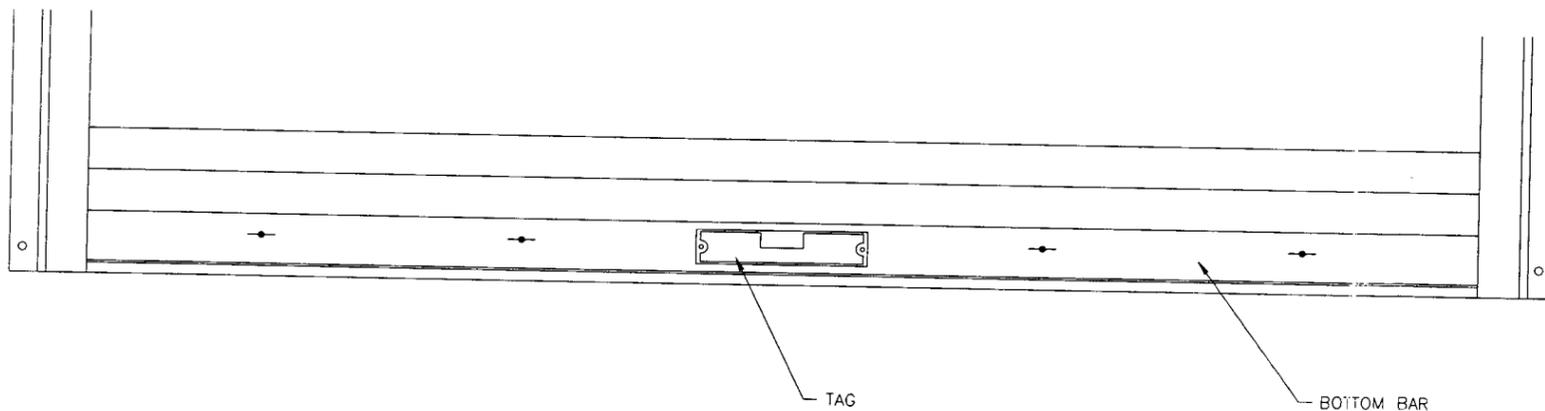

DETAIL "E" 6  
SCALE: 4/1

**PRODUCT RENEWED**

ACCEPTANCE No. 02-0117.03

EXPIRATION DATE 02/22/07

PRODUCT CONTROL DIVISION  
BUILDING CODE COMPLIANCE OFFICE

*May 27 1999*

ACCEPTANCE No. 99-0121-04

*LeRoy Krupke*  
4-21-99

OVERHEAD DOOR CORPORATION  
1900 CROWN DRIVE  
FARMERS BRANCH, TEXAS 75234  
LeROY G. KRUPKE, P.E. #36580

THE DRAWING AND/OR TECHNICAL INFORMATION ON THIS SHEET IS THE PROPERTY OF OVERHEAD DOOR CORPORATION OR ITS SUBSIDIARY AND IS LOANED IN CONFIDENCE FOR ENGINEERING AND MUTUAL ASSISTANCE PURPOSES ONLY. AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING DISCLOSED HEREON WITHOUT THE EXPRESS PERMISSION OF OVERHEAD DOOR CORPORATION WHICH MAY RECALL THIS SHEET AT ANY TIME.

DIMENSIONS UNLESS OTHERWISE SPECIFIED			OVERHEAD DOOR		DRAWING TITLE	
DECIMAL DIMENSIONS	HOLE DIAMETERS	ANGLES ± 0° 30'	DALLAS, TEXAS	NAME	DATE	SERIES 610/620, ROLLING SERVICE DOOR DADE COUNTY
.001 = ± .001	UNDER .251-.004-.003	FRACTIONS ± 1/16"	MATERIAL:	DRAWN BY: JEFF BENNETT	6/30/95	DRAWING NUMBER <b>D-307779</b>
.002 = ± .002	OVER .251-.004-.003		APPLIED FINISH:	CHECKED BY: PE VESSELS	10/27/95	
			UNIT OF MEASURE: N/A	APPROVED BY: JEFF BENNETT	10/27/95	SCALE: NOTED SHEET 2 OF 2