



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Therma-Tru Corporation  
108 Mutzfeld Road  
Butler, IN 46721**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Series "Landmark" 6'8" S/E Inswing Opaque Insulated Steel Door w & wo Sidelites**

**APPROVAL DOCUMENT:** Drawing No. S-2191, dated 12/2/01, with revision 1 dated 03/12/03, titled "Landmark Steel Edge" Single & Double Inswing 6-8 Opaque Door, sheets 1 through 7, prepared by R. W. Building Consultants, Inc., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant for Doors Only**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.  
The submitted documentation was reviewed by **Manuel Perez, P.E.**



**NOA No 02-0205.02  
Expiration Date: May 1, 2008  
Approval Date: May 1, 2003  
Page 1**

**Therma-Tru Corporation**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**A. DRAWINGS**


1. Manufacturer's die drawings and sections.
2. Drawing No. **S-2191**, dated 12/2/01, with revision 1 dated 03/12/03, titled "Landmark Steel Edge" Single & Double Inswing 6-8 Opaque Door, sheets 1 through 7, prepared by R. W. Building Consultants, Inc.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94  
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94  
3) Water Resistance Test, per SFBC, PA 202-94  
4) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94  
5) Cyclic Wind Pressure Loading per SFBC, PA 203-94  
6) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94  
along with marked-up drawings and installation diagram of a Landmark series opaque steel edge steel door x configuration, prepared by ETC Laboratories, Test Report No. **ETC 01-741-11237.0**, dated 11/21/01, signed and sealed by Mark D. Passero, P.E.
2. Test reports on 1) Air Infiltration Test, per SFBC, PA 202-94  
2) Uniform Static Air Pressure Test, Loading per SFBC PA 202-94  
3) Water Resistance Test, per SFBC, PA 202-94  
4) Large Missile Impact Test per SFBC, PA 201-94  
5) Cyclic Wind Pressure Loading per SFBC, PA 203-94  
6) Forced Entry Test, per SFBC 3603.2 (b) and PA 202-94  
along with marked-up drawings and installation diagram of a Landmark series opaque steel edge steel door, prepared by ETC Laboratories, Test Report No. **ETC 01-741-11239.0**, dated 01/07/01, signed and sealed by Mark D. Passero, P.E.

**C. CALCULATIONS**

1. Anchor Calculations and structural analysis dated 01/29/02, prepared, signed and sealed by Lyndon F. Schmidt, P.E.

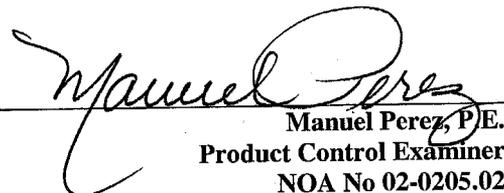  
Manuel Perez, P.E.

Product Control Examiner  
NOA No 02-0205.02  
Expiration Date: May 1, 2008  
Approval Date: May 1, 2003

**Therma-Tru Corporation**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

(For File ONLY. Not part of NOA)

**D. MATERIAL CERTIFICATIONS**


1. Tensile Test prepared by ETC Laboratories, Report No. **ETC-01-741-11245.0**, dated 12/13/01, for steel sheet samples of "Benchmark" doors, tested per ASTM E8-96, signed and sealed by Mark D. Passero, P.E.
2. Test reports No. **J20039349-231**, issued to General Products for steel skin door w/ BASF polyurethane cores for 45 minute full vertical fire test standard "Fire Test of Door Assemblies" per UBC Standard 7-2 (1994), NFPA-252 (1999), and UL 10B (1997) dated February 28, 2001, issued by Intertek Testing Services NA Inc., signed by Kent Kelsey and Andrew Hyun, Ph. D.
3. Test reports No. J97027616a-231 for "20 minute Full Scale Vertical Test Conducted on a Foam Filled Steel Door" per ASTM E-152-81a, dated January 9, 1998, issued by Intertek Testing Services.
4. NOA No.01-0718.08 issued to ODL, Inc. for their HP Polypropylene Doorlight Assembly, approved on 01/17/2002 and expiring on 01/17/06.

**E. STATEMENTS**

1. Statement letter of conformance and no financial interest, dated January 29, 2002, signed and sealed by Lyndon F. Schmidt, P.E.
2. Statement letter of no financial interest, dated September 6, 2001, signed by Steven Kepler.
3. Statement letter naming Mr. Rick Wright as their representative and contact person, signed by Steve Kepler

**F. OTHER**

1. None.

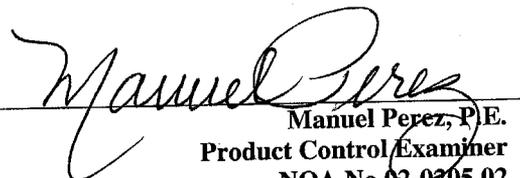  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No 02-0205.02  
Expiration Date: May 1, 2008  
Approval Date: May 1, 2003

# THERMA-TRU®

## "LANDMARK"

### STEEL EDGE INSULATED DOOR

#### 6'8 INSWING WITH & WITHOUT SIDELITES

#### GENERAL NOTES

1. THIS PRODUCT IS DESIGNED TO MEET THE FLORIDA BUILDING CODE.
2. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.
3. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS. ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
4. DESIGNED PRESSURE RATING SEE TABLE PAGE 1.
5. THIS PRODUCT DOES NOT MEET THE WATER REQUIREMENTS FOR HIGH WIND ZONE VELOCITY AREA.
6. UNIT SHALL BE INSTALLED ONLY AT LOCATIONS PROTECTED BY CANOPY OR OVERHANG SUCH THAT THE ANGLE BETWEEN THE EDGE OF CANOPY OR OVERHANG TO SILL IS LESS THAN 45 DEGREES. UNLESS UNIT IS INSTALLED IN NON-HABITABLE AREAS WHERE THE UNIT AND THE AREAS ARE DESIGNED TO ACCEPT WATER INFILTRATION.
7. WHEN THIS PRODUCT IS USED IN AREAS REQUIRING WINDBORNE DEBRIS PRODUCTS, FLORIDA BUILDING CODE APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED FOR THE SIDELITES ONLY.
8. SIDELITES ARE AN OPTION AND CAN BE USED IN A SINGLE OR DOUBLE CONFIGURATION.

#### RESIDENTIAL INSULATED STEEL DOOR (Common to all frame conditions)

##### Door & Sidelite Leaf Construction:

**Face sheets:** panel door 25 ga. (0.019") minimum thickness & sidelite panel 0.021" minimum thickness, Galvanized steel A-525 commercial quality - AKDQ per ASTM 620 with yield strength  $F_y(\text{ave.})=40,561$  psi.

**Core design:** Polyurethane foam core, with 1.9 lbs. density by BASF.



**Construction:** Flush or embossed type. The vertical edges are extensions of the skin, rolled formed to a mechanical interlock, horizontal edges are welded together at two places 6.5" from each corner.

**Frame Construction:** The frame is constructed from finger jointed pine measuring 4.563" wide x 1.25" thick. The header is joined to the side jambs with (3) 16 ga. 1/2" crown x 2" long staples at each side. The threshold is joined to the side jambs with (3) #10 x 1.5" PFH SMS at each side. The mullions are secured together in a sidelite application using #10 x 2" long PFH Wood Screws (6) screws per each mullion. The unit uses an Inswing saddle threshold measuring 5.563" x 1.125"

**Sidelite Glazing:** The sidelite panels are sandwich glazed using a two piece lip lite frame. They are dry glazed on the exterior with an 1/8" thk. cellular glazing tape, (Stik-It Tape), with the silicone caulking and secured to the steel panel with #8 X 1.5" Philips Pluscrew. The integral lite was glazed between the steel face sheets with glazing tape and sealed on the exterior with a silicone caulking cap bead.

#### TABLE OF CONTENTS

SHEET #	DESCRIPTION
1	TYPICAL ELEVATIONS & GENERAL NOTES
2	VERTICAL CROSS SECTIONS
3	HORIZONTAL CROSS SECTIONS & NOTES
4	HORIZONTAL CROSS SECTIONS & BILL OF MATERIAL
5	ANCHORING LOCATIONS & DETAILS
6	ANCHORING LOCATIONS & GLAZING DETAIL
7	UNIT COMPONENTS

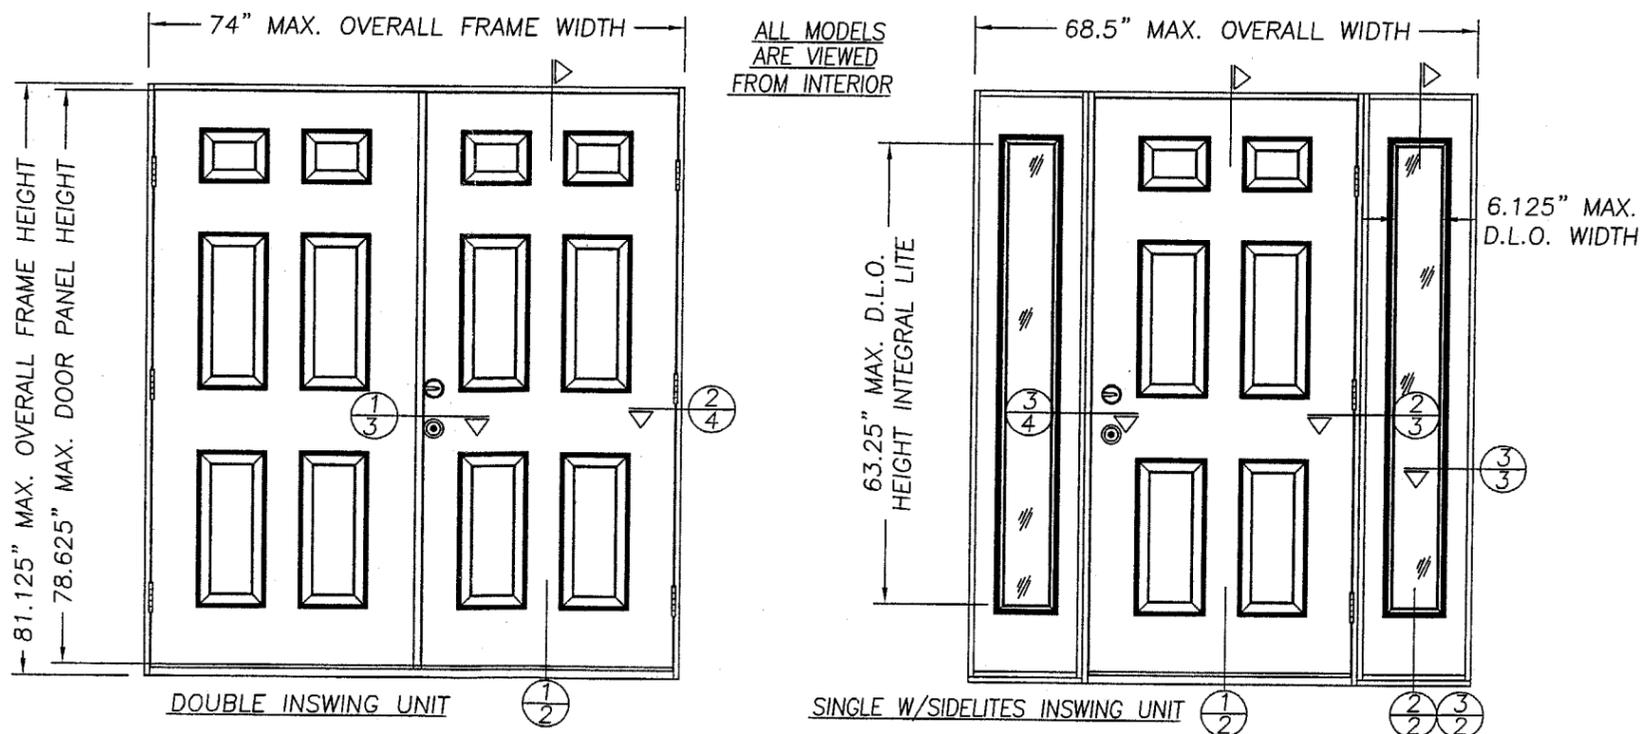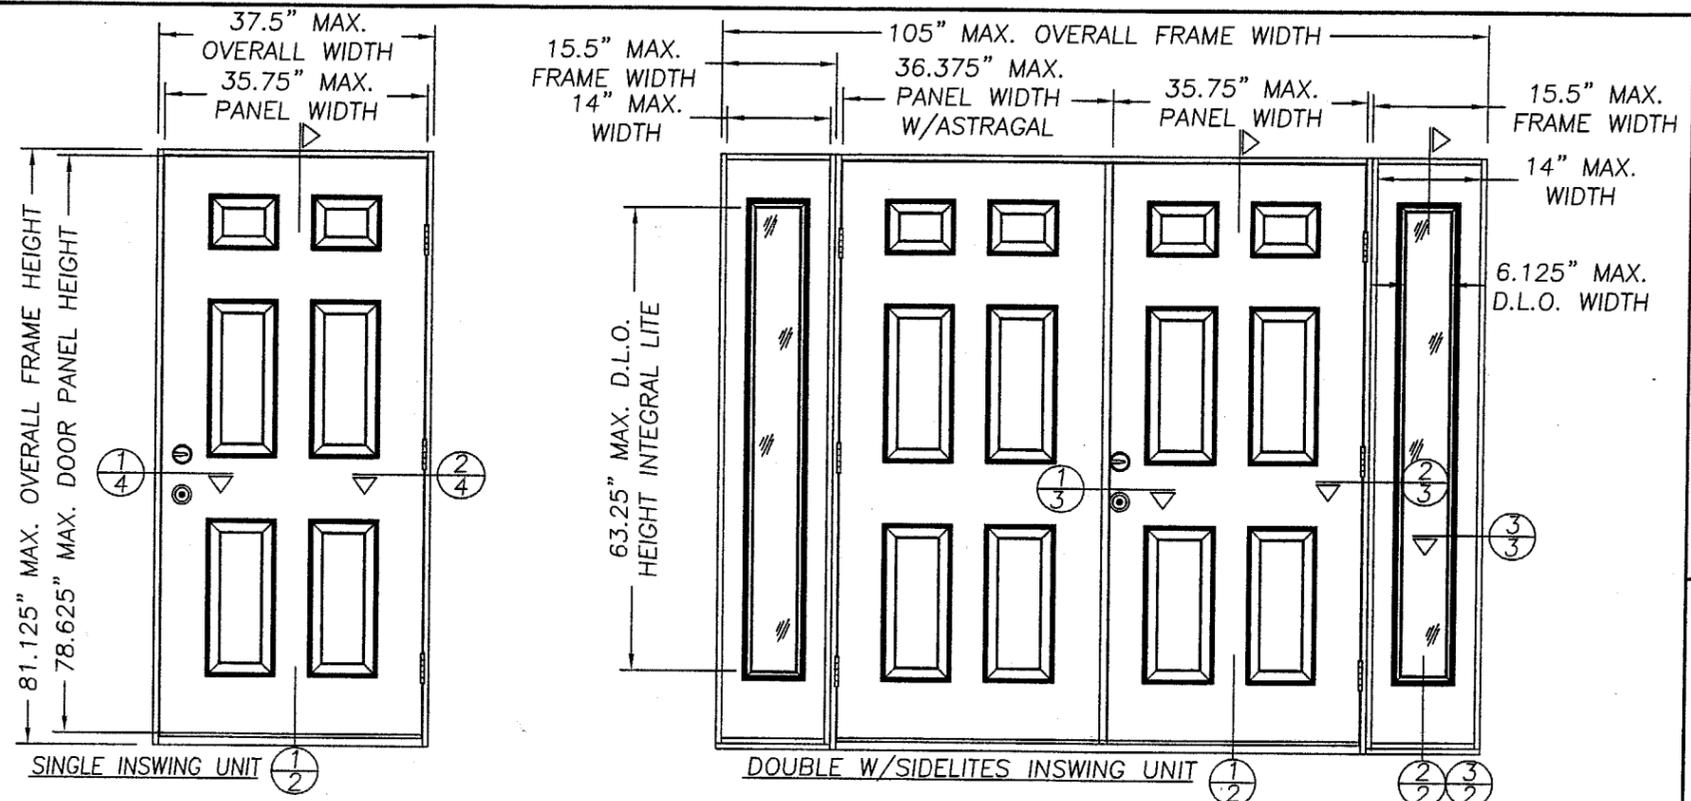

DESIGN PRESSURE RATING  
(WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED)

ALL MODELS + 65.0 PSF - 65.0 PSF

Approved as complying with the  
Florida Building Code  
Date MAY 1, 2003  
NOA# 02-0205.02  
Miami Dade Product Control  
Division  
By Manuel Perez

DATE: 12/2/01

SCALE: N.T.S.

DWG. BY: WLN

CHK. BY: RW

DRAWING NO.:

S-2191

SHEET 1 OF 7


THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO  
PH. (800) 537-8827

PRODUCT:  
"LANDMARK STEEL EDGE"  
SINGLE & DOUBLE INSWING  
6-8 OPAQUE DOOR  
PART OR ASSEMBLY:

TYPICAL ELEVATIONS  
& GENERAL NOTES

NO.	DATE	GENERAL REVISION	RW	BY
1	3/12/03			


RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

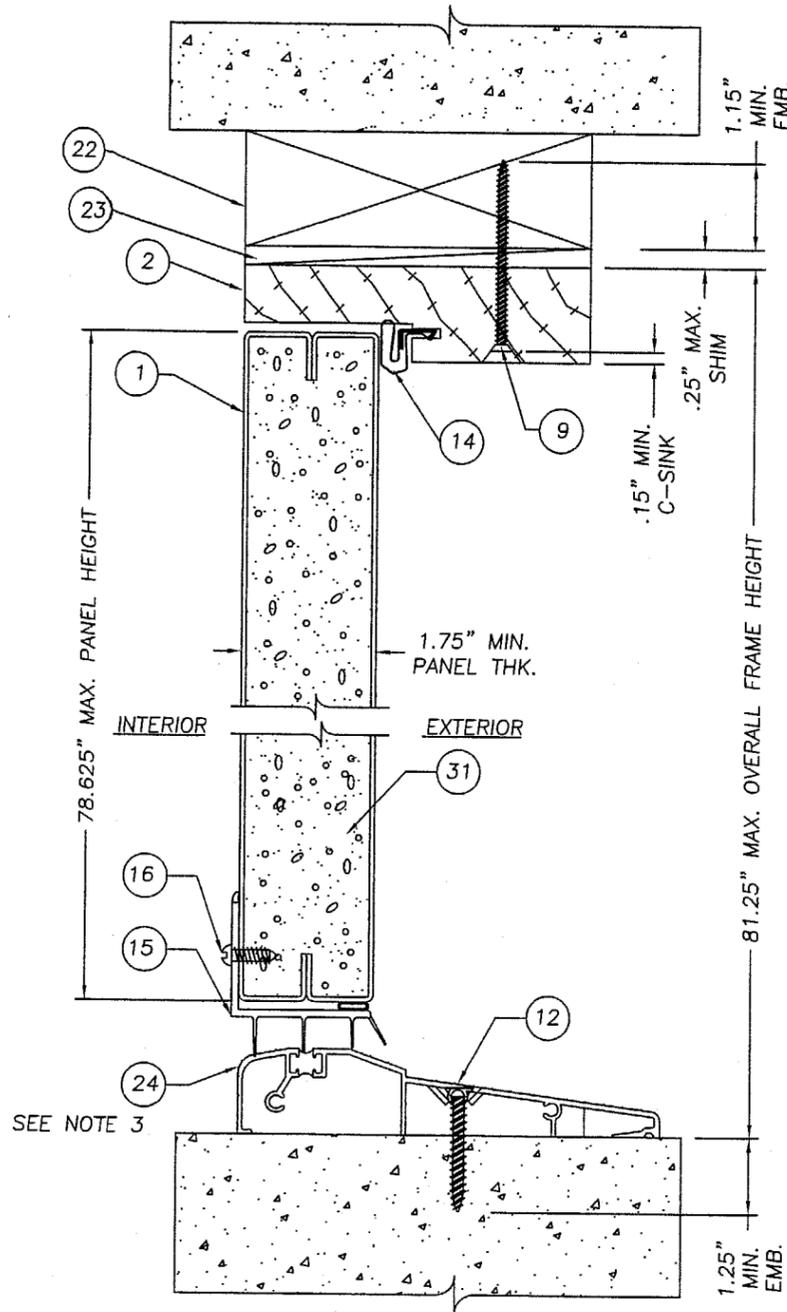

1 VERTICAL CROSS SECTION  
2 INSWING UNIT  
W/ALUMINUM THRESHOLD


NOTES:

1. THE HEAD JAMB IS ATTACHED TO THE SIDE JAMBS WITH (3) 16GA. x 1/2" CROWN x 2" STAPLES AT BOTH SIDE.
2. THE SIDELITES ARE STOPPED IN WITH 0.375" QUARTER ROUND USING 16 GA. 1.0" WIRE BRADS AT 2.0" FROM EACH CORNER AND A MAXIMUM 6.0" ON CENTER.

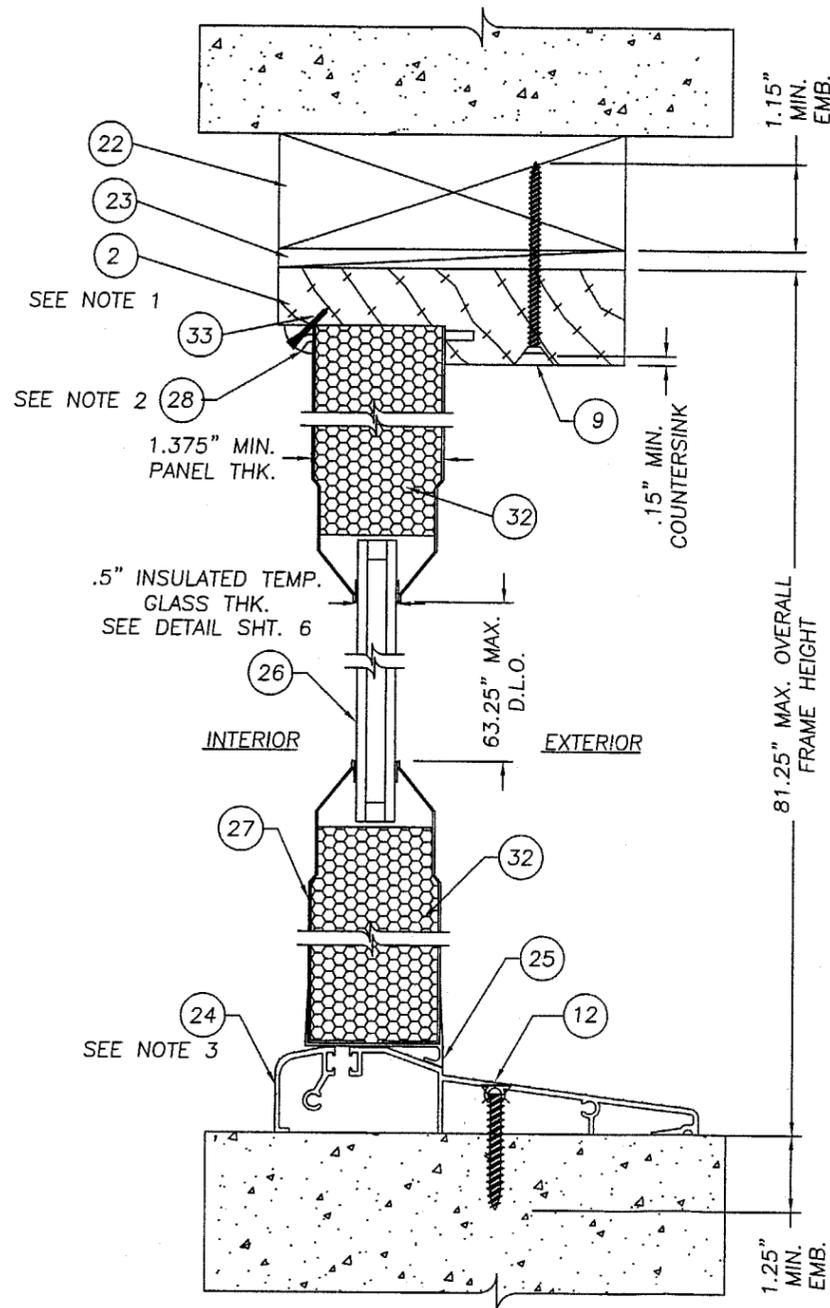

2 VERTICAL CROSS-SECTION  
2 INTEGRAL SIDELITE SASH

3. THE INSWING ALUMINUM THRESHOLD IS ATTACHED TO THE SIDE JAMBS WITH (3) # 10 X 1.5" PPH SHEET METAL SCREWS AT EACH END.

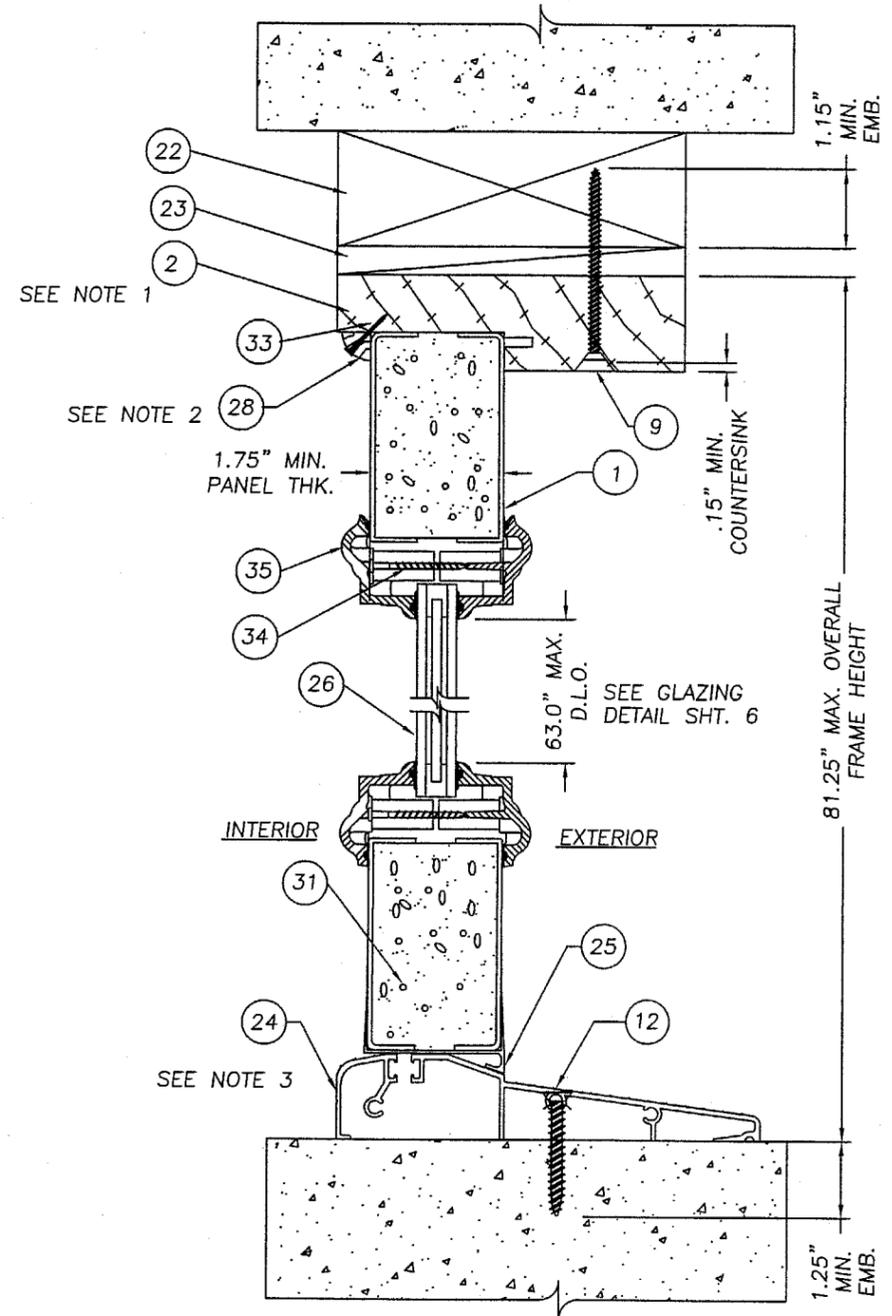

3 VERTICAL CROSS-SECTION  
2 LIP LITE SIDELITE SASH

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO  
PH. (800) 537-8827

PRODUCT:  
"LANDMARK STEEL EDGE"  
SINGLE & DOUBLE INSWING  
6.8 OPAQUE DOOR

PART OR ASSEMBLY:

VERTICAL CROSS  
SECTIONS

NO.	DATE	GENERAL REVISION	RW	BY
1	3/12/03			

REVISIONS

RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

DATE: 12/02/01

SCALE: NTS

DWG. BY: WLN


CHK. BY: RW

DRAWING NO.:

S-2191


SHEET 2 OF 7

Approved as complying with the  
Florida Building Code  
Date MAY 1, 2003  
NOA# 02-0205-02  
Miami Dade Product Control  
Division  
By *Manuel Perez*

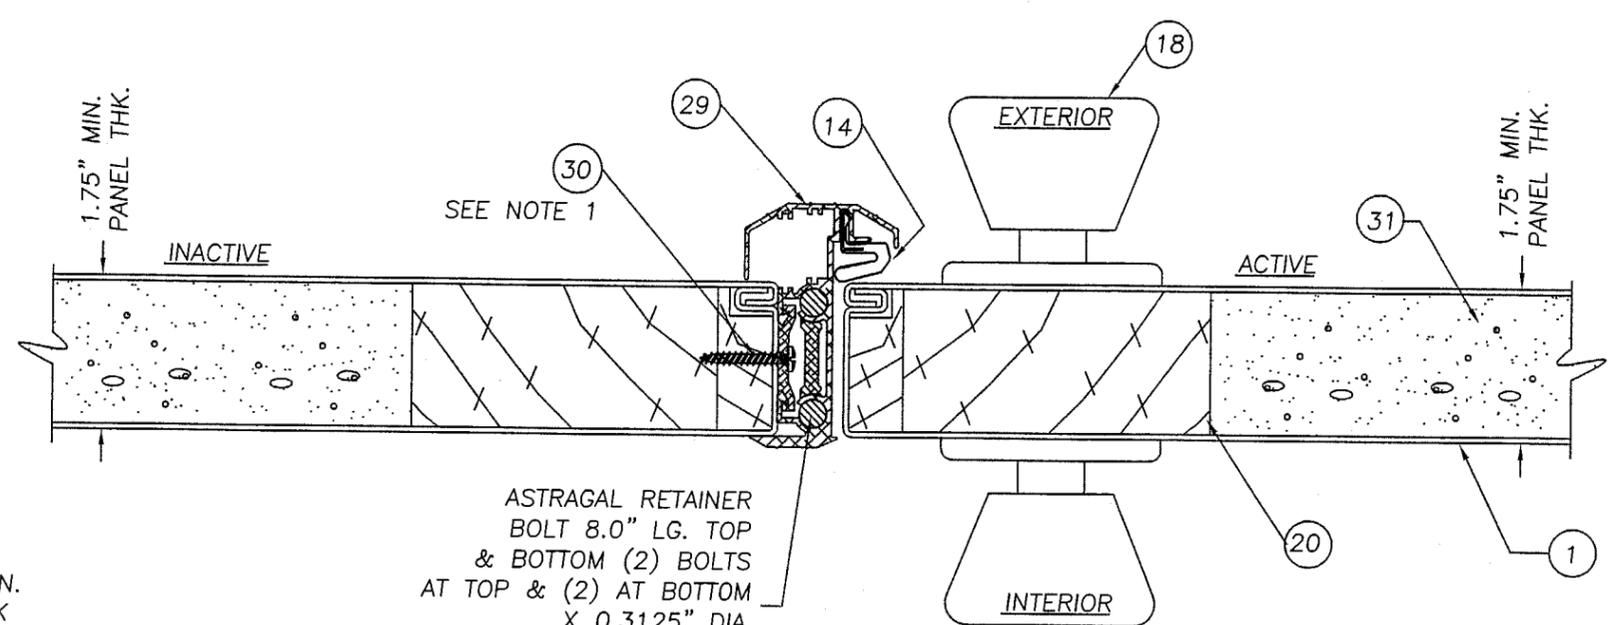


ASTRAGAL RETAINER  
BOLT 8.0" LG. TOP  
& BOTTOM (2) BOLTS  
AT TOP & (2) AT BOTTOM  
X 0.3125" DIA.

1 HORIZONTAL CROSS SECTION  
3 LATCH JAMB TO BUCK

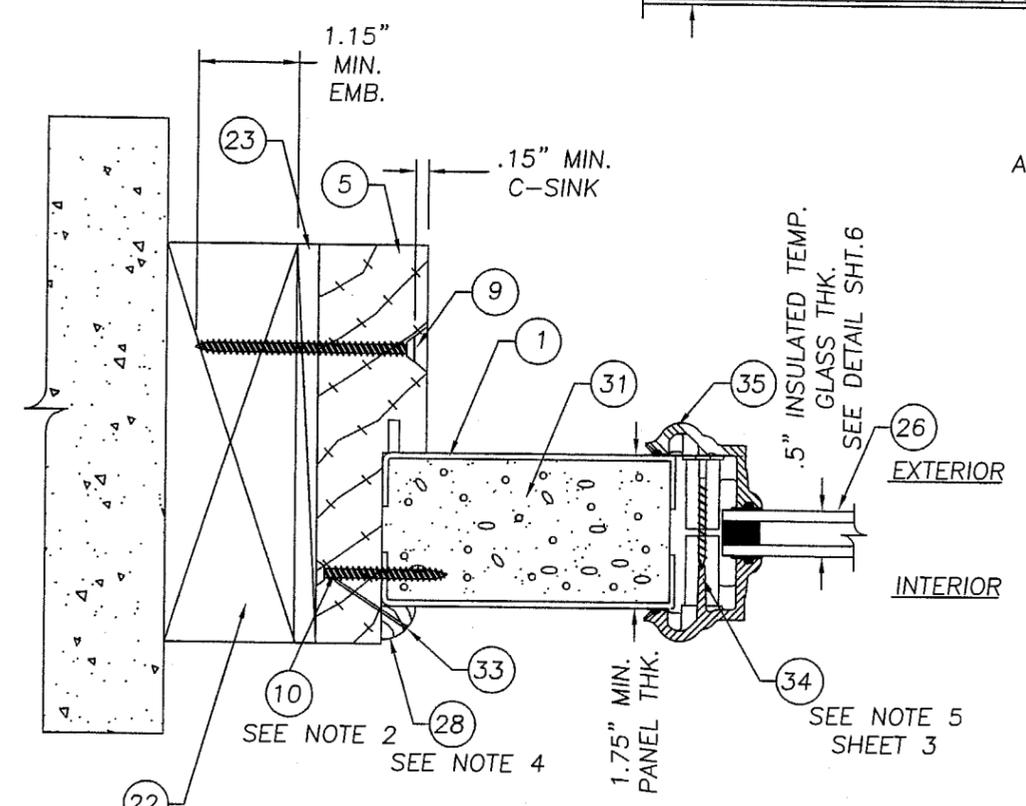

3 HORIZONTAL CROSS SECTION  
3 @ SIDELITE TO BUCK  
(SHOWN WITH LIP LITE)

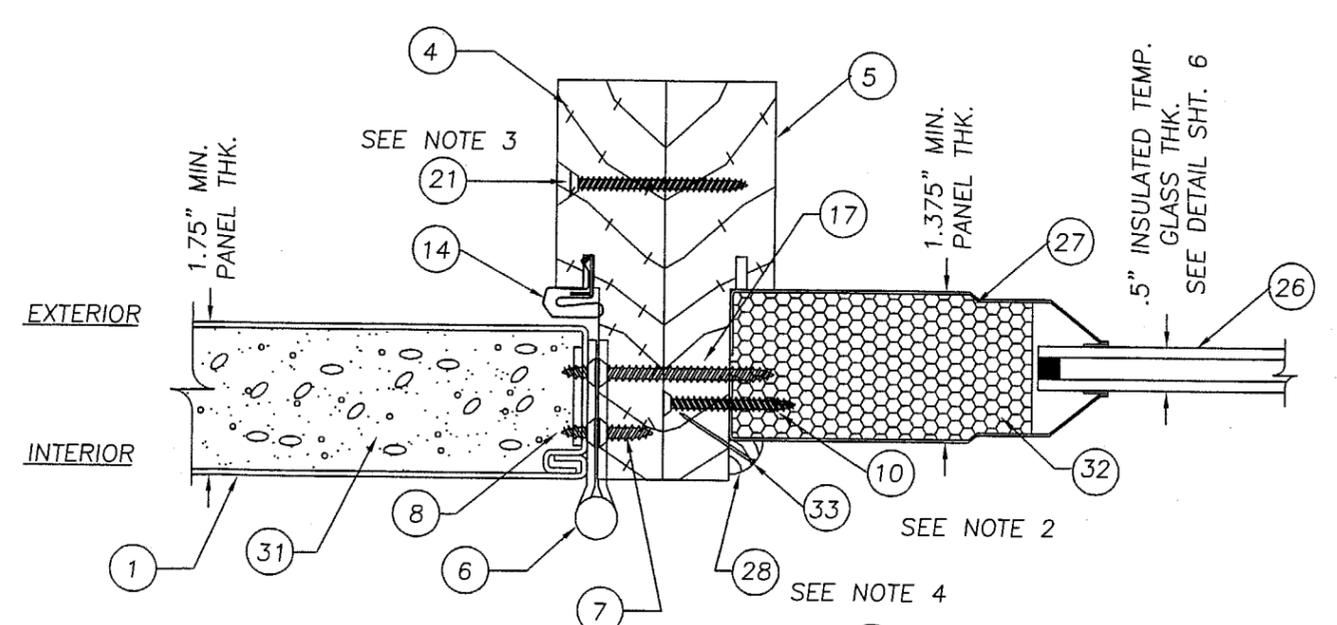

2 HORIZONTAL CROSS SECTION  
3 HINGE JAMB TO BUCK, TYP.  
(SHOWN WITH INTEGRAL LITE)

NOTES:

1. SPACING FOR THE (9) #8 x 1" PANHEAD SMS ATTACHING THE ASTRAGAL TO THE INACTIVE DOOR IS AS FOLLOWS: TOP DOWN AT 1.0", 3.0", 5.0", 17.75", 43.0", 58.875", 73.875", 75.875" AND 77.875".
2. THE SIDELITE PANELS ARE DIRECT SET INTO THE JAMBS WITH (4) #8 X 1.5" PFH WS LOCATED AT 6.0", 28.5", 51.0" AND 73.5" FROM THE TOP ON EACH VERTICAL JAMB.
3. THE SIDELITE JAMBS ARE ATTACHED TO THE DOOR JAMB WITH (6) #8 X 2.0" PFH WS LOCATED AT EACH SIDE AT 6.0", 19.625", 33.25", 46.875", 60.5" AND 74.0" FROM THE TOP OF THE HEAD JAMB THROUGH THE DOORSTOP INTO THE SIDELITE JAMB.

4. THE SIDELITES ARE STOPPED IN WITH 0.375" QUARTER ROUND USING 16 GA. 1.0" WIRE BRADS AT 2.0" FROM EACH CORNER AND A MAXIMUM 6.0" ON CENTER.
5. SPACING FOR THE (16) #8 x 1.5 PHILIPS PLASCREW: AT TOP & BOTTOM AT 2.375" FROM EACH CORNER VERTICAL: 3.25" FROM EACH END AND 4 EQUALLY SPACED.

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO  
PH. (800) 537-8827


PRODUCT:  
"LANDMARK STEEL EDGE"  
SINGLE & DOUBLE INSWING  
6'8 OPAQUE DOOR  
PART OR ASSEMBLY:  
HORIZONTAL CROSS SECTION  
& NOTES

NO.	DATE	REVISIONS	
		GENERAL REVISION	BY
1	3/12/03		RW


RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

Approved as complying with the  
Florida Building Code  
Date MAY 1, 2003  
NOA# 02-0205.02  
Miami Dade Product Control  
Division  
By Manuel Perez

DATE: 12/2/01
SCALE: NTS
DWG. BY: WLN
CHK. BY: RW
DRAWING NO.: S-2191
SHEET 3 OF 7

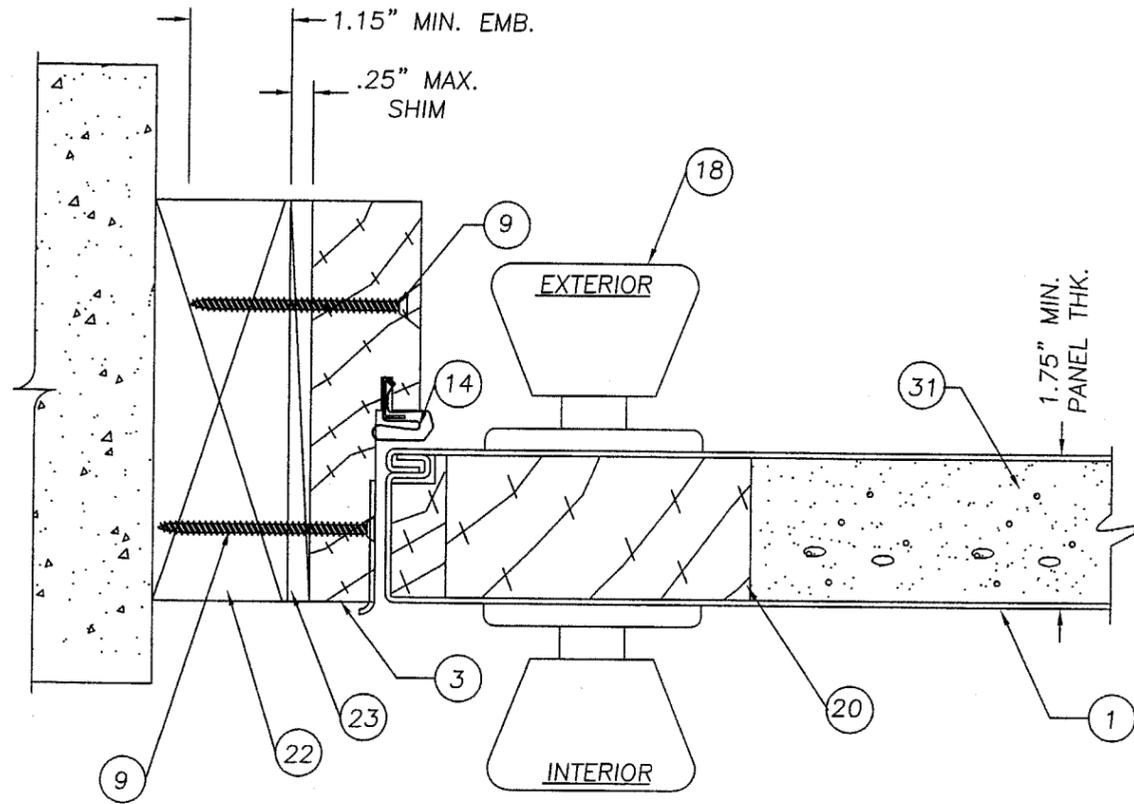

1 HORIZONTAL CROSS SECTION  
4 LATCH JAMB TO BUCK

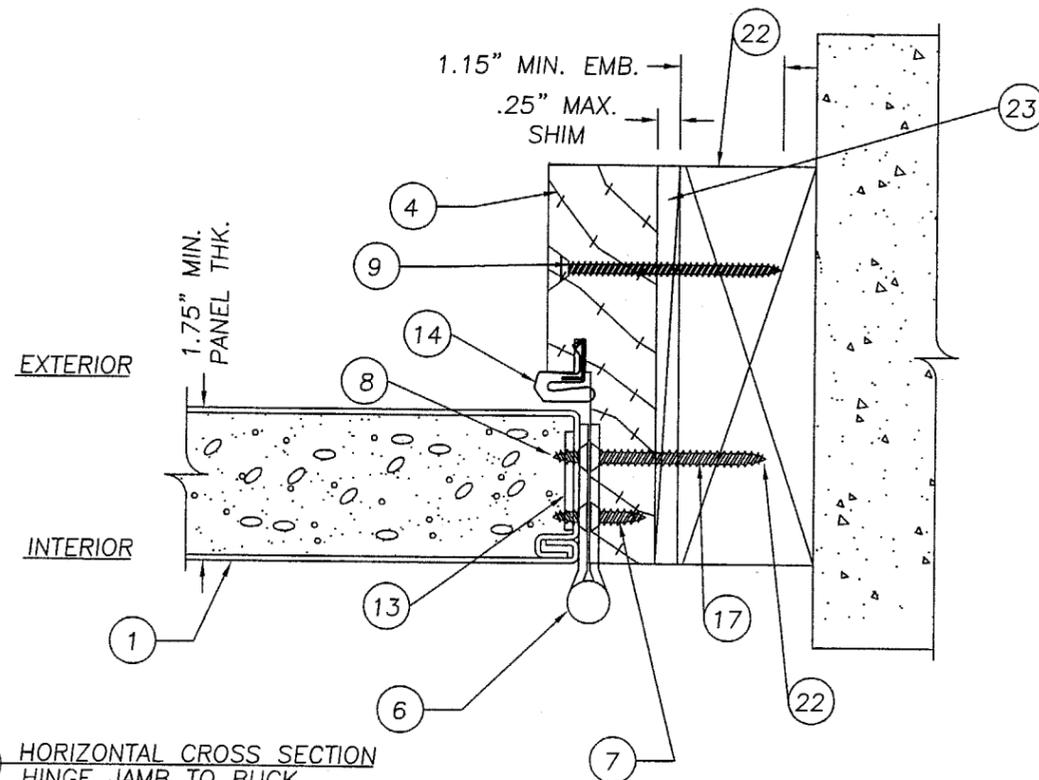

2 HORIZONTAL CROSS SECTION  
4 HINGE JAMB TO BUCK

Item	DESCRIPTION	Material
1	DOOR PANEL STEEL FACE SHEETS (.019" MIN. THK.) fy= 40,561 psi	STEEL
2	4 9/16" HEADER	WOOD
3	4 9/16" LATCH JAMB	WOOD
4	4 9/16" HINGE JAMB	WOOD
5	4 9/16" BLANK JAMB	
6	4" x 4" RADIUS HINGE PROPRIETARY .097" THK.	STEEL
7	#10 x 3/4" LG. (Hinge to Frame)	STEEL
8	#10 x 1/4" LG. (Hinge to Door)	STEEL
9	#8 x 2 1/2" LG. WOOD SCREW	STEEL
10	#8 x 1 1/2" PFH WS	STEEL
11	#8 x 2 1/2" PFH WS	STEEL
12	3/16" TAPCON ANCHOR (ELCO)	STEEL
13	HINGE REINFORCEMENT PLATE 1.125" WIDE x 5.25" LONG x 0.050" THICK	STEEL
14	COMPRESSION WEATHERSTRIP (Therma-Tru)	
15	THERMA-TRU ADJUSTABLE SWEEP	VINYL
16	#8 x 1/2" LG. TYPE "AB" PANHEAD	STEEL
17	#10 WOOD SCREW X 2" LG.	STEEL
18	KWIKSET 700 DL PASSAGE	
19	KWIKSET 700 DEADBOLT	
20	LATCH & DEADBOLT WOODBLOCK W/CROSS BORE WOOD BLOCK	WOOD
21	#8 x 2" PFH WS	STEEL
22	2x WOOD SUB BUCK	WOOD
23	MAX. 1/4" SHIM MATERIAL	WOOD
24	ONE PIECE THRESHOLD	ALUMINUM
25	SIDELITE BOTTOM SEAL	VINYL
26	GLAZING, 1/2" INSULATED TEMPERED GLASS	GLASS
27	SIDELITE PANEL STEEL FACE SHEETS (.021" MIN. THK.) fy= 40,561 psi	STEEL
28	3/8" x 3/8" QUARTER ROUND FINGER JOINTED PINE	WOOD
29	ASTRAGAL WINDJAMBER II (.052" WALL)	6060T-6 ALUM.
30	#8 x 1" LG. PANHEAD STEEL METAL SCREW	STEEL
31	BASF URETHANE CORE	FOAM
32	POLYSTYRENE CORE (CORE DENSITY 1.0 LBS.)	
33	1" LONG X .040" DIA. BRAD TRIM NAIL	STEEL
34	#8 1 1/2" PHILIPS PLASCREW (LITE FRAME)	STEEL
35	LIP LITE FRAME .5 GLASS BY O.D.L.	
36	GLAZING TAPE DEVAN #566.12	BUTYL

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO  
PH. (800) 537-8827


PRODUCT:  
"LANDMARK STEEL EDGE"  
SINGLE & DOUBLE INSWING  
6/8 OPAQUE DOOR  
PART OR ASSEMBLY:  
HORIZONTAL CROSS SECTION  
& BILL OF MATERIAL

NO.	DATE	GENERAL REVISION	BY
1	3/12/03		RW


RW BUILDING  
CONSULTANTS, INC.  
813.659.9197

Approved as complying with the  
Florida Building Code  
Date MAY 1, 2003  
NOA# 02-0203-02  
Miami Dade Product Control  
Division  
By Manuel Perez

DATE: 12/2/01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.:  
S-2191  
SHEET 4 OF 7

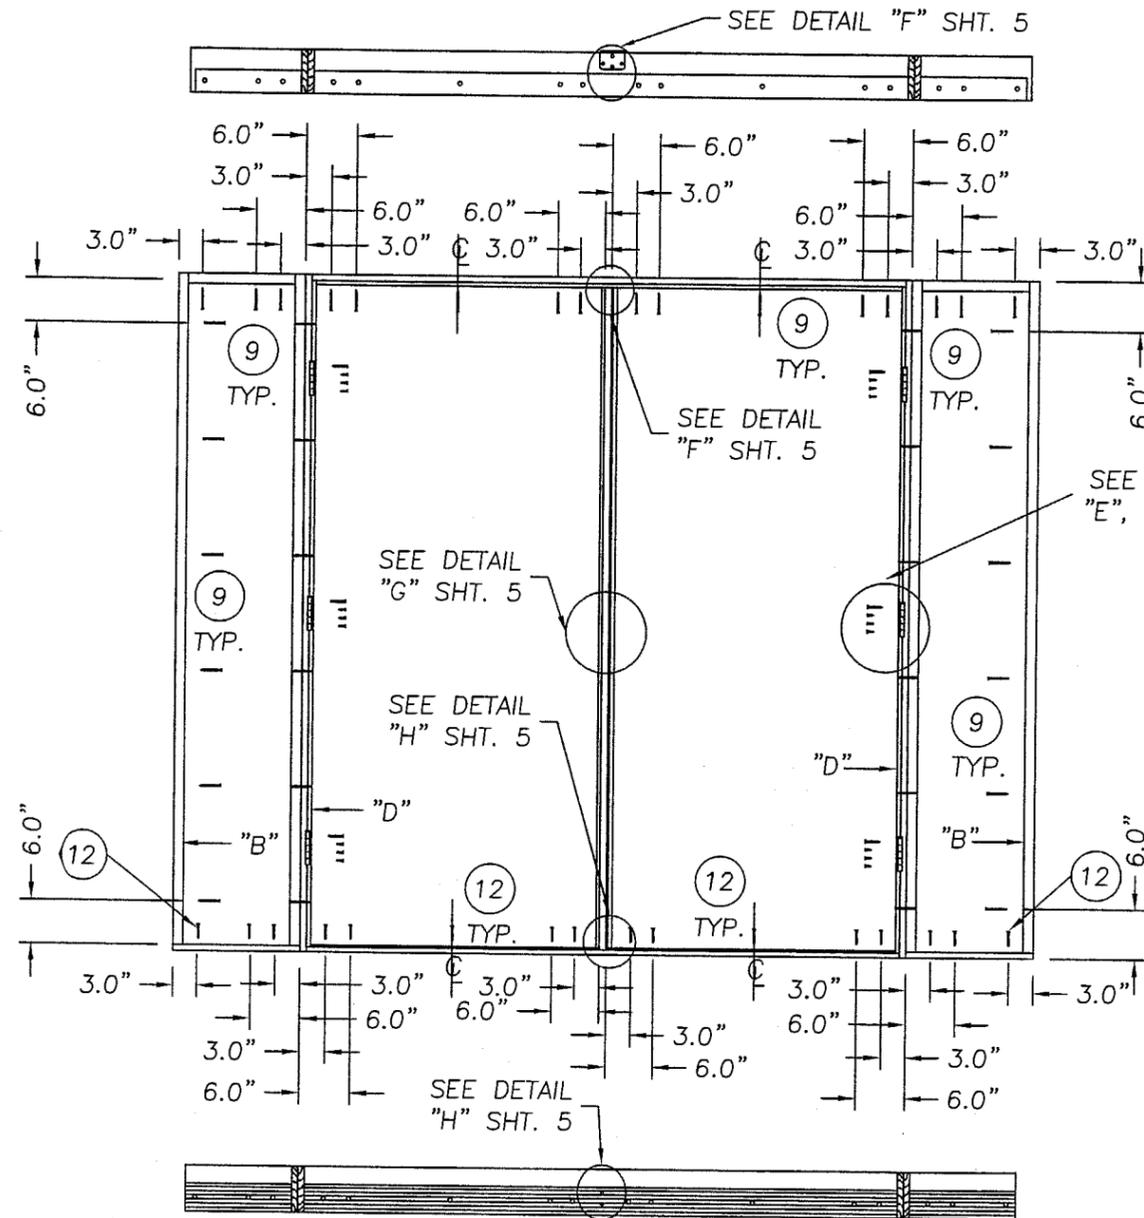


DOUBLE DOOR W/SIDELITES

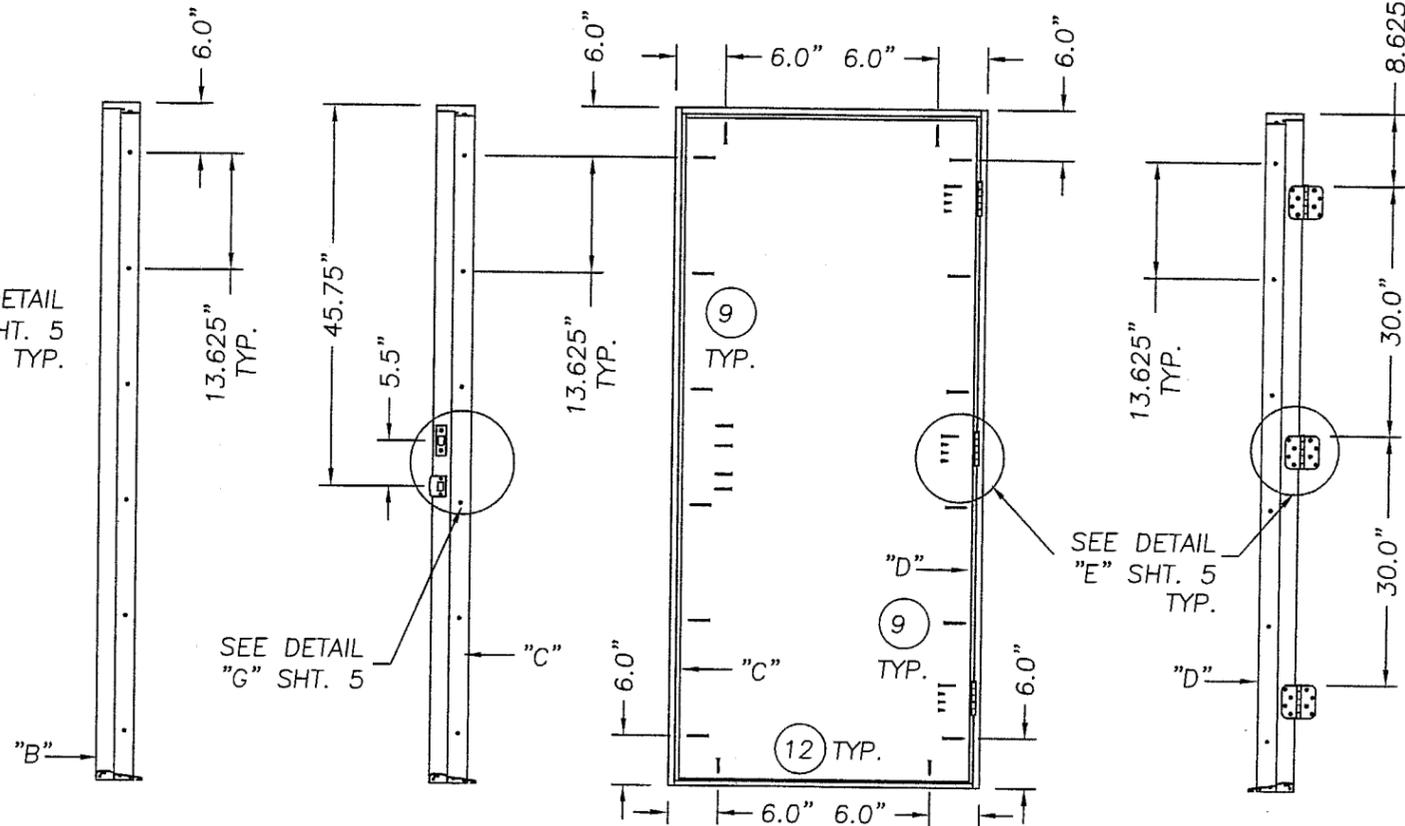


SINGLE DOOR


NOTE:  
 USE #8 x 2 1/2" PFH WOOD SCREW TO ATTACH THE STRIKE AND DEADBOLT PLATES TO THE JAMB OR ASTRAGAL EXCEPT IN THE MULLED APPLICATION WITH THE SIDELITE USE #8 x 2" PFH WOOD SCREW.

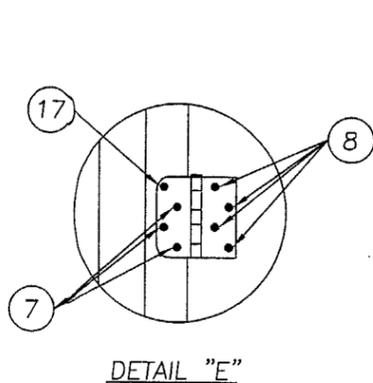


DETAIL "E"

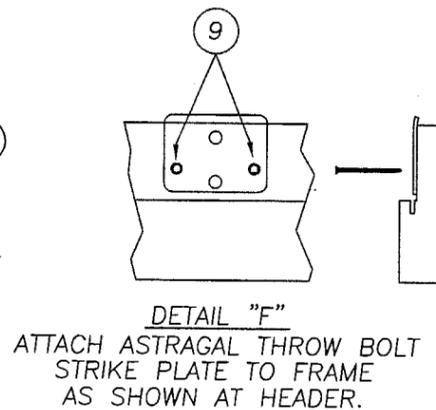

DETAIL "F"  
 ATTACH ASTRAGAL THROW BOLT STRIKE PLATE TO FRAME AS SHOWN AT HEADER.

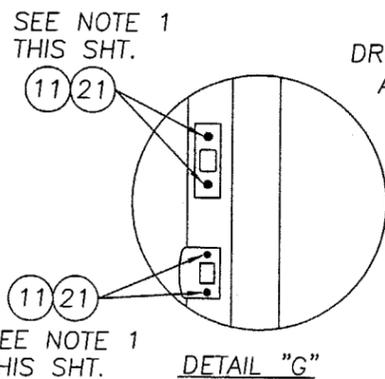

DETAIL "G"  
 SEE NOTE 1 THIS SHT.

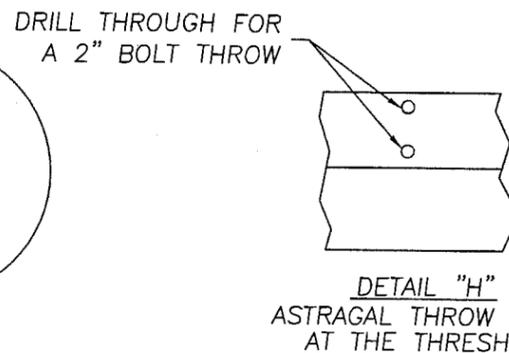

DETAIL "H"  
 ASTRAGAL THROW BOLTS AT THE THRESHOLD

THERMA-TRU CORPORATION  
 1687 WOODLANDS DRIVE  
 MAUMEE, OHIO  
 PH. (800) 537-8827


PRODUCT:  
 "LANDMARK STEEL EDGE"  
 SINGLE & DOUBLE INSWING  
 6.8 OPAQUE DOOR  
 PART OR ASSEMBLY:  
 ANCHORING LOCATIONS  
 & DETAILS

NO.	DATE	REVISIONS
1	3/12/03	GENERAL REVISION
		RW
		BY


RW BUILDING  
 CONSULTANTS, INC.  
 813.659.9197

Approved as complying with the  
 Florida Building Code  
 Date MAY 1, 2003  
 NOA# 02-0205.02  
 Miami Dade Product Control  
 Division  
 By Manuel Sney


DATE: 12/02/01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2191  
 SHEET 5 OF 7

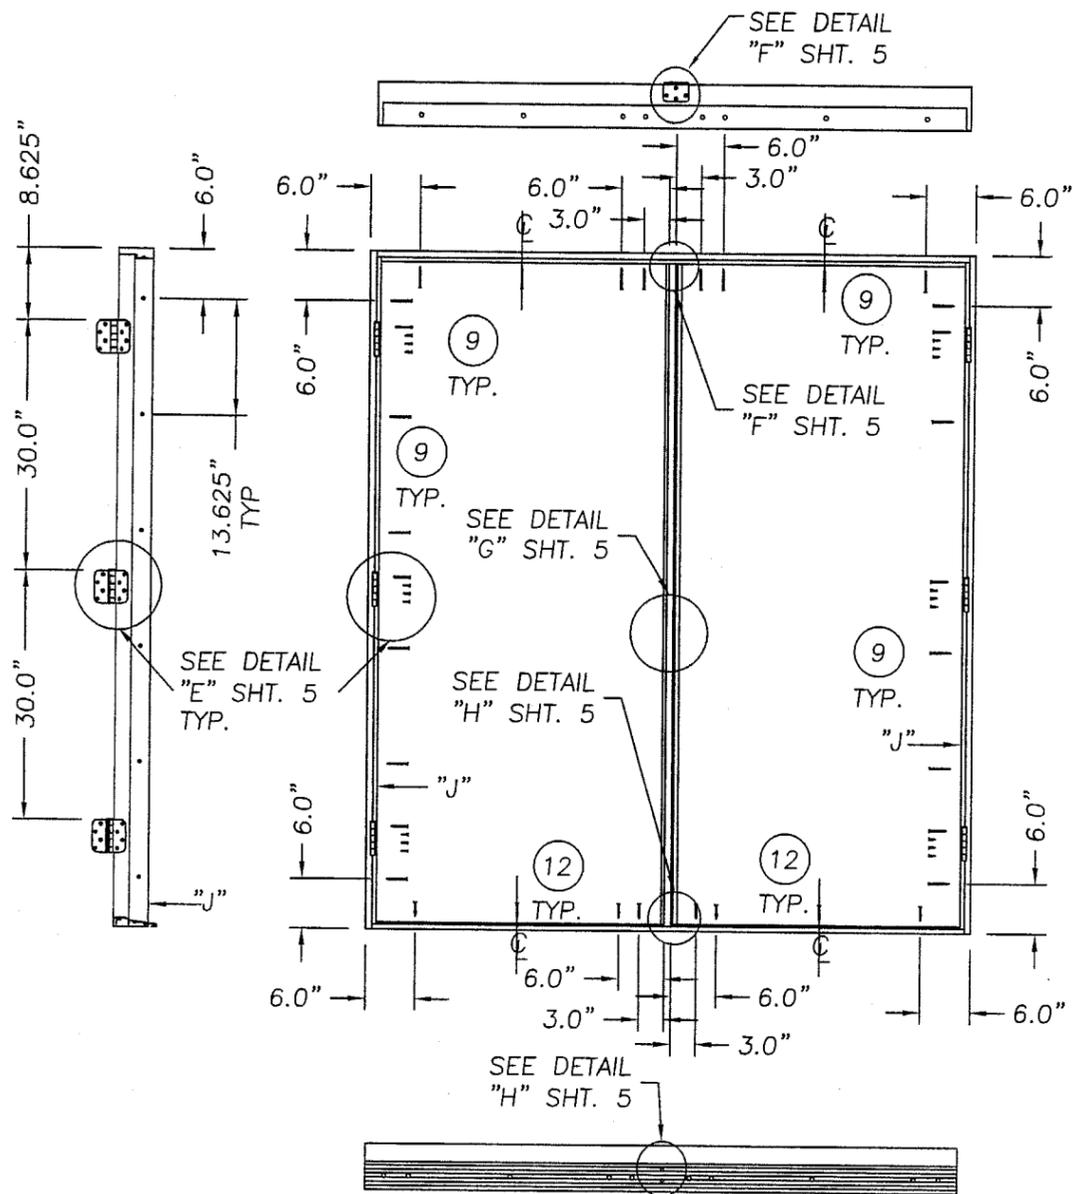


DOUBLE DOOR

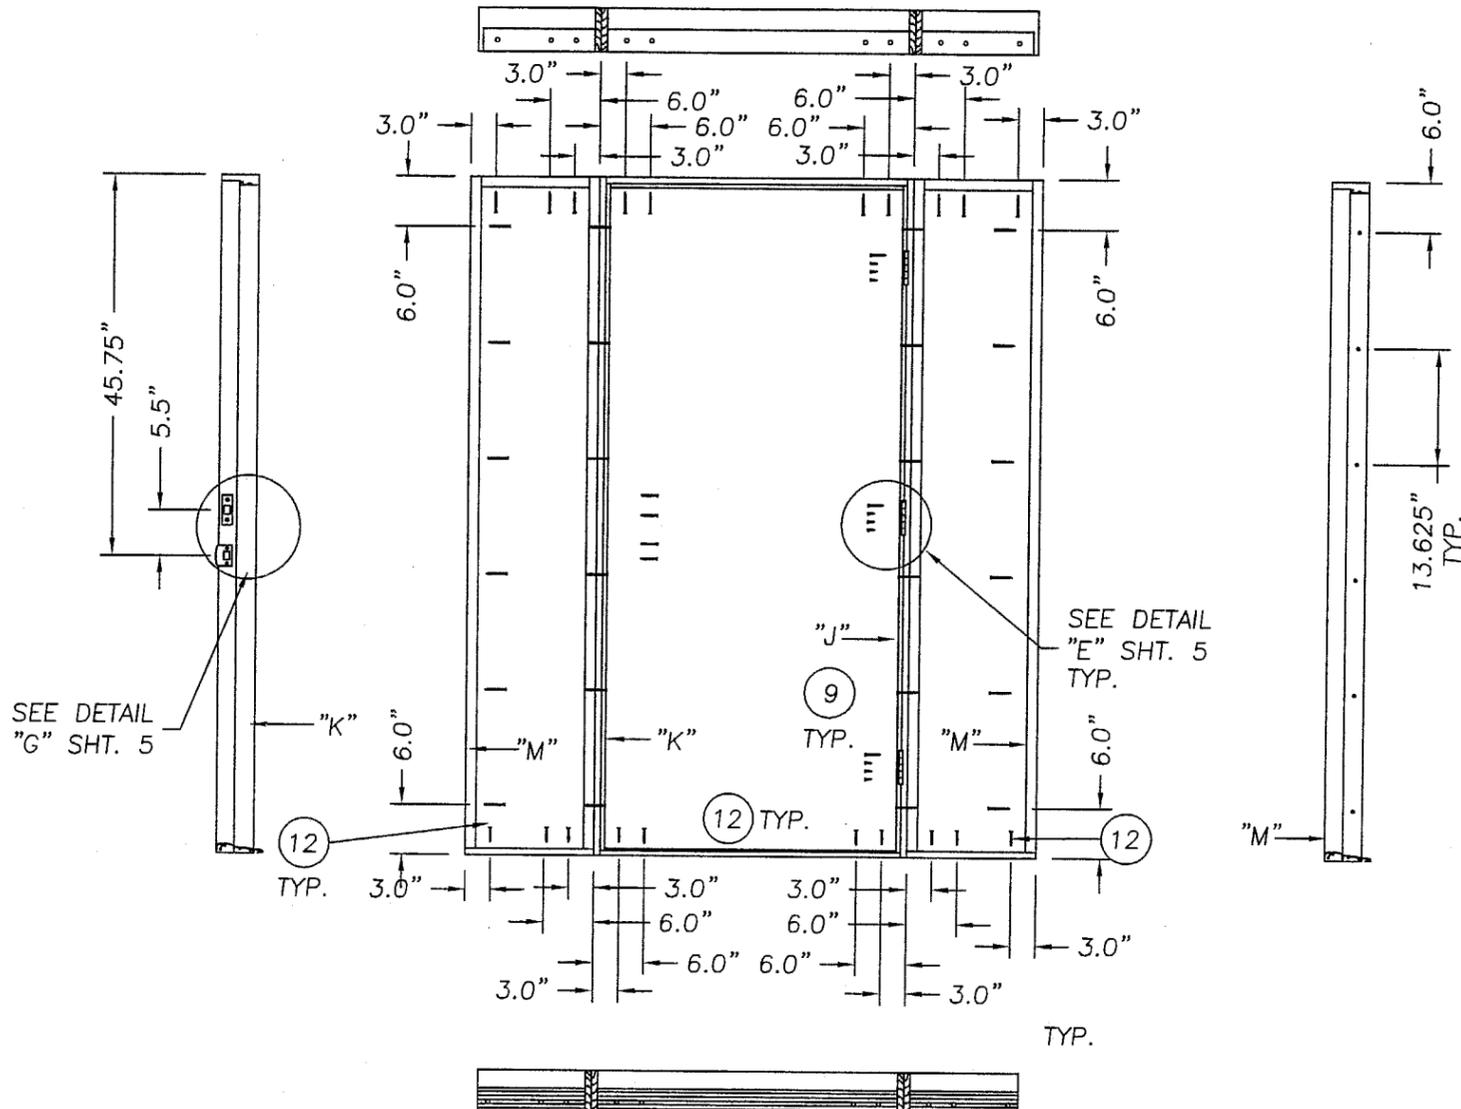

SINGLE DOOR W/SIDELITES

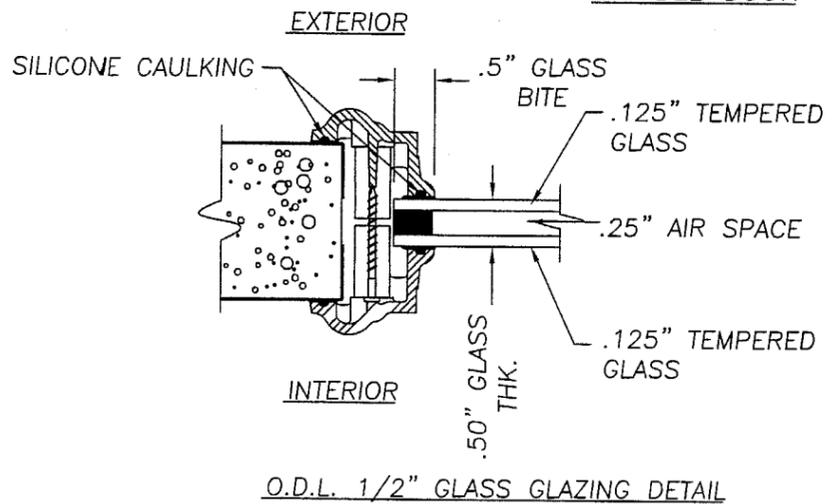

O.D.L. 1/2" GLASS GLAZING DETAIL

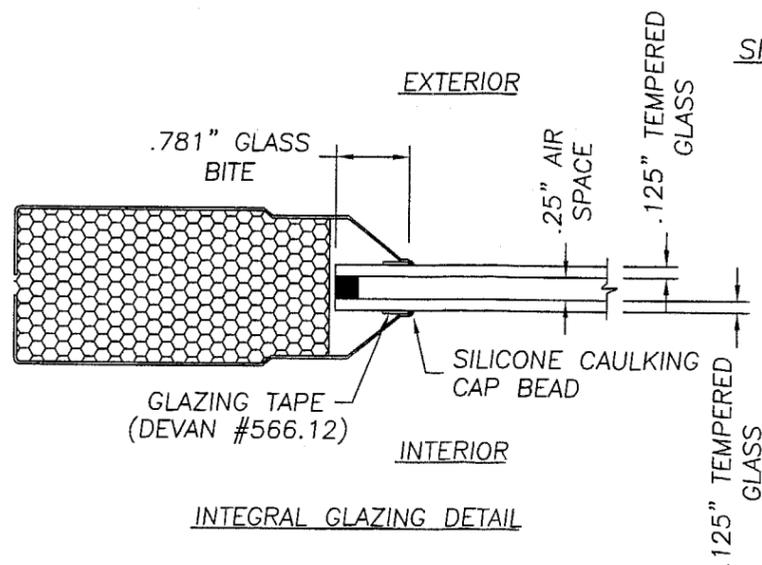

INTEGRAL GLAZING DETAIL

THERMA-TRU CORPORATION  
 1687 WOODLANDS DRIVE  
 MAUMEE, OHIO  
 PH. (800) 537-8827


PRODUCT: "LANDMARK STEEL EDGE" SINGLE & DOUBLE INSWING 6'8" OPAQUE DOOR  
 PART OR ASSEMBLY: ANCHORING LOCATIONS & GLAZING DETAIL

NO.	DATE	GENERAL REVISION	BY
1	3/12/03		RW


RW BUILDING CONSULTANTS, INC.  
 813.659.9197

Approved as complying with the Florida Building Code  
 Date: MAY 1, 2003  
 NOAH 02-0205-02  
 Miami Dade Product Control Division  
 By: *Maurice Pura*


DATE: 12/3/01  
 SCALE: N.T.S.  
 DWG. BY: WLN  
 CHK. BY: RW  
 DRAWING NO.: S-2191  
 SHEET 6 OF 7




⑬ 6" LG. WOOD HINGE REINFORCEMENT

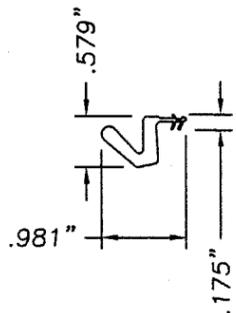


⑭ COMPRESSION WEATHERSTRIP BY THERMA-TRU FOAM CELL CORE W/VINYL JACKET




⑮ VINYLE SIDELITE BOTTOM SEAL



⑯ VINYL ADJUSTABLE SWEEP

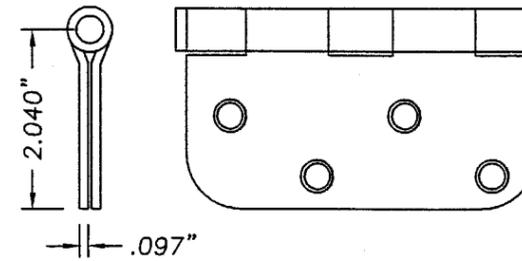


⑥ 4 x 4 RADIUS HINGE

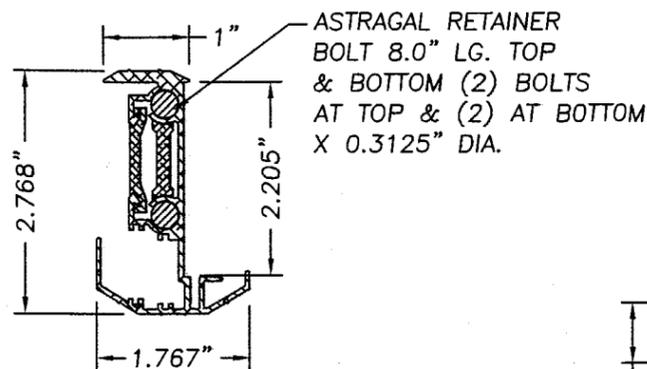


⑲ WINDJAMBER II ASTRAGAL (ALUMINUM .052" WALL TYP.) (6060 T6)


ASTRAGAL RETAINER BOLT 8.0" LG. TOP & BOTTOM (2) BOLTS AT TOP & (2) AT BOTTOM X 0.3125" DIA.

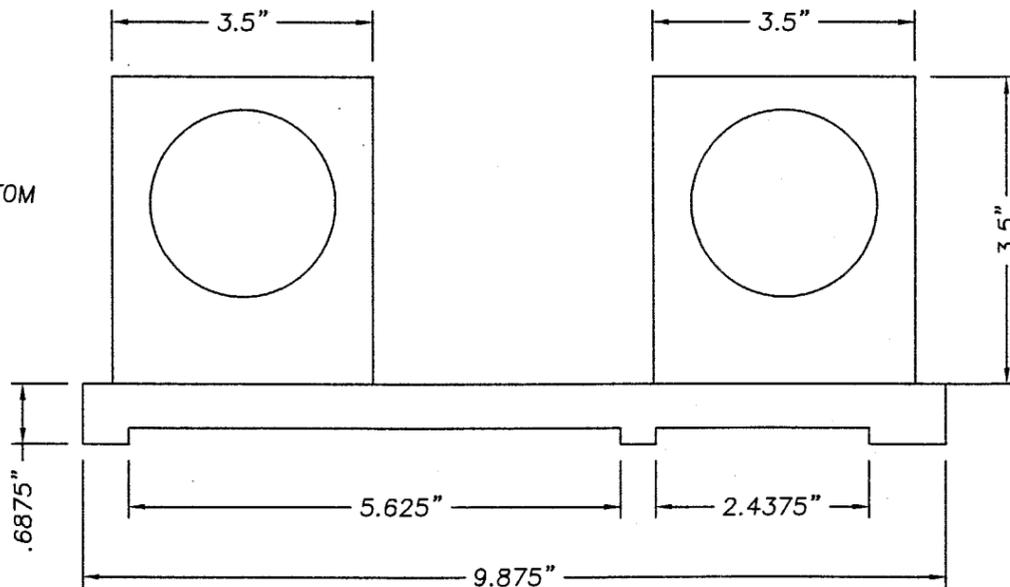


⑳ LATCH & DEADBOLT WOOD BLOCK W/ CROSS BORE WOOD BLOCK

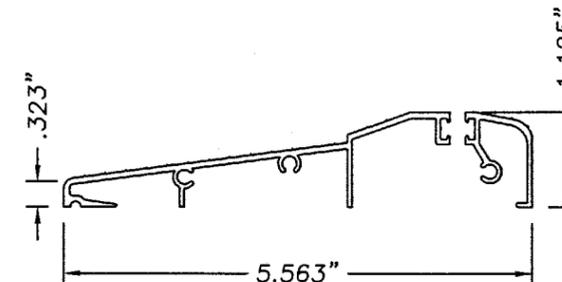


㉔ INSWING ALUMINUM THRESHOLD MATERIAL: ALUMINUM .055" WALL THK.

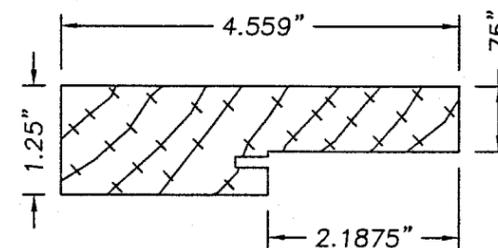

②③④⑤ 4 9/16" WOOD FRAME

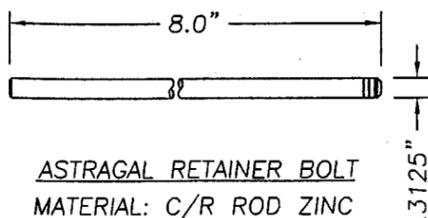

ASTRAGAL RETAINER BOLT MATERIAL: C/R ROD ZINC & YELLOW CHROMATE

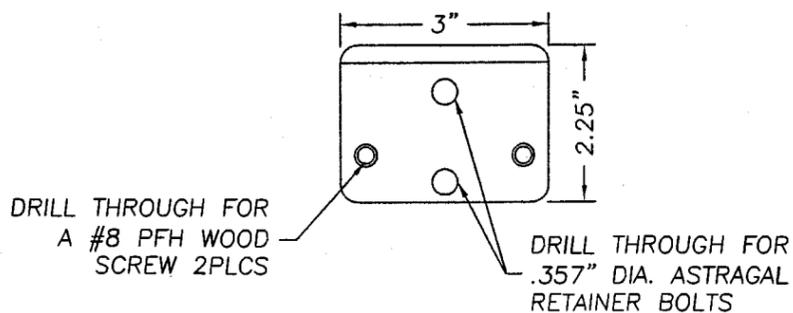

WINDJAMBER II STRIKE PLATE

THERMA-TRU CORPORATION  
1687 WOODLANDS DRIVE  
MAUMEE, OHIO  
PH. (800) 537-8827

PRODUCT: "LANDMARK STEEL EDGE" SINGLE & DOUBLE INSWING 6-8 OPAQUE DOOR  
PART OR ASSEMBLY:

NO.	DATE	GENERAL REVISION	RW	BY
1	3/12/03			

RW BUILDING CONSULTANTS, INC.  
813.659.9197

DATE: 11/28/01  
SCALE: NTS  
DWG. BY: WLN  
CHK. BY: RW  
DRAWING NO.: S-2191  
SHEET 7 OF 7

Approved as complying with the Florida Building Code  
Date: MAY 1, 2003  
NOA# 02-0205.02  
Miami Dade Product Control  
Division  
By: *Manuel Perry*