



**BUILDING CODE COMPLIANCE OFFICE (BCCO)  
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA  
METRO-DADE FLAGLER BUILDING  
140 WEST FLAGLER STREET, SUITE 1603  
MIAMI, FLORIDA 33130-1563  
(305) 375-2901 FAX (305) 375-2908**

**NOTICE OF ACCEPTANCE (NOA)**

---

**Collier a Division of System Design & Mfg. Inc.  
48 Dalkeith Drive  
Brantford, Ontario Canada N3P1N6**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: Insulated Overhead Sectional Garage Door 18' Wide.**

**APPROVAL DOCUMENT:** Drawing No. D-CFL3WLP-188-IN, titled "Collier/Fortress Level 3 Wind Load Hardware Package", sheets 1 through 2, prepared by Collier, signed and sealed by F. A. Fore, P.E., dated 5/01/02 with no revisions, bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Division.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.


**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 as well as approval document mentioned above.

The submitted documentation was reviewed by **Candido F. Font, PE.**



**NOA No 02-0207.02  
Expiration Date: September 26, 2007  
Approval Date: September 26, 2002  
Page 1**

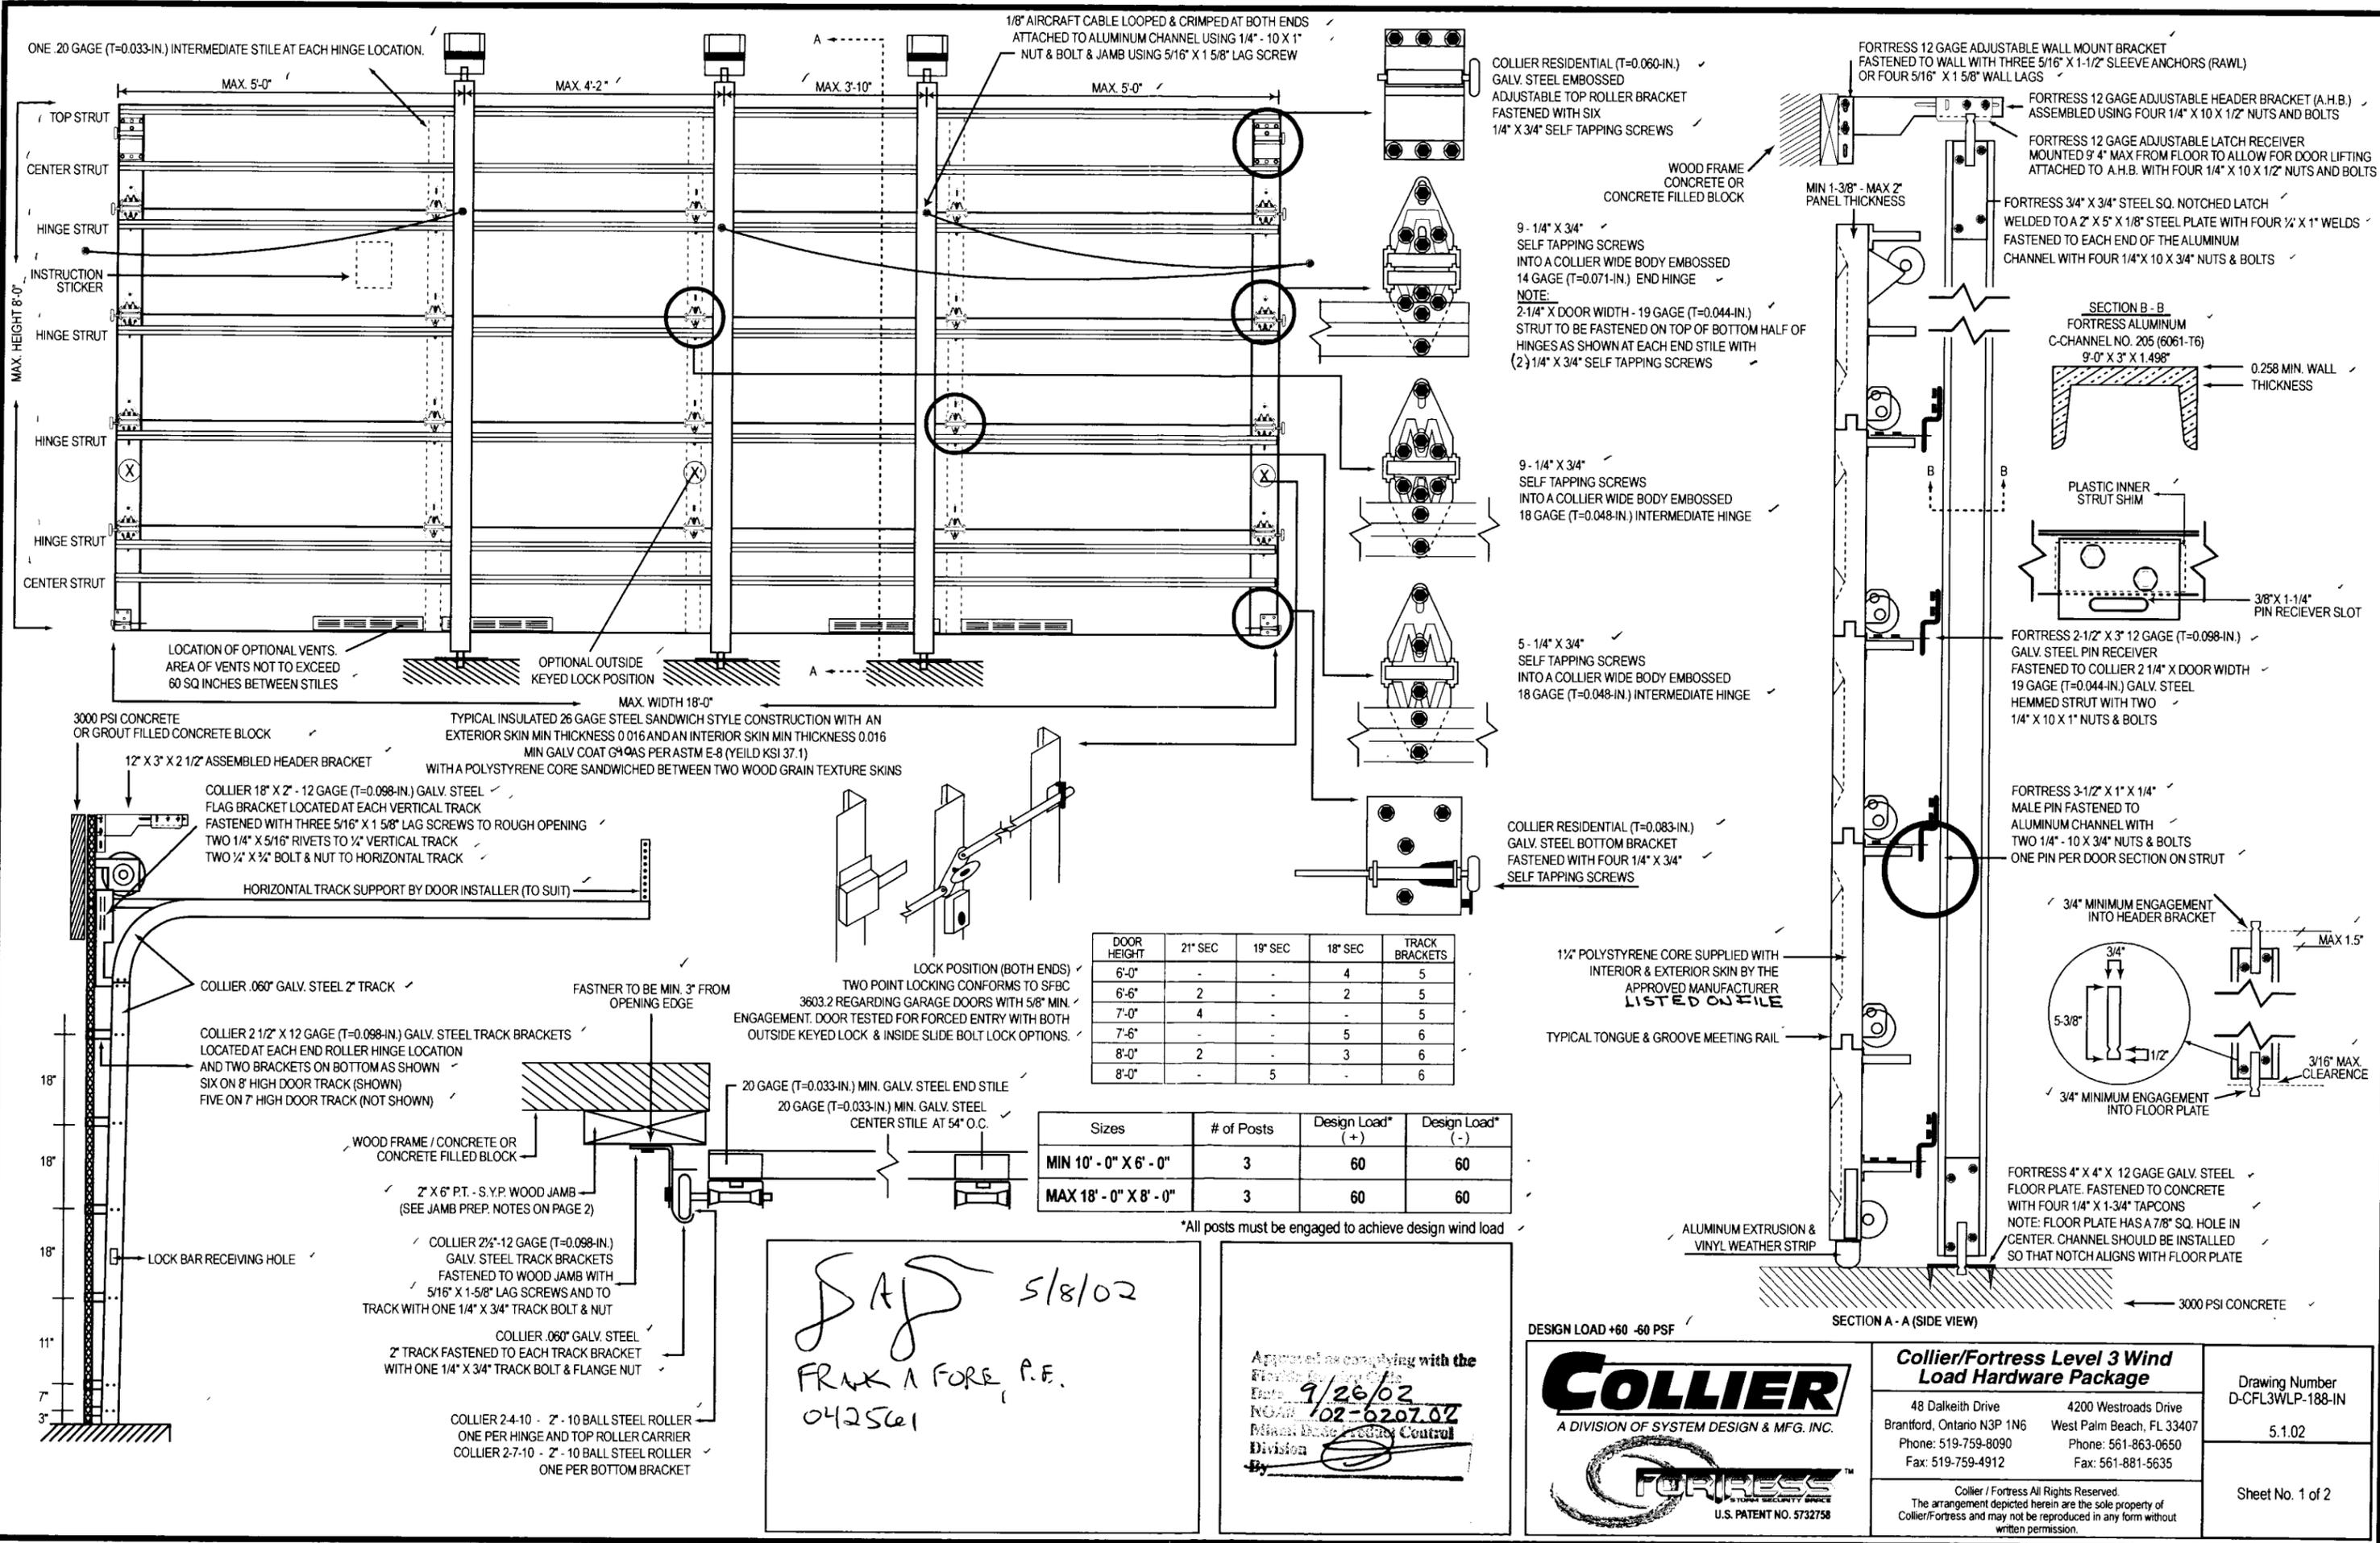

DOOR HEIGHT	21" SEC	19" SEC	18" SEC	TRACK BRACKETS
6'-0"	-	-	4	5
6'-6"	2	-	2	5
7'-0"	4	-	-	5
7'-6"	-	-	5	6
8'-0"	2	-	3	6
8'-0"	-	5	-	6

Sizes	# of Posts	Design Load* (+)	Design Load* (-)
MIN 10' - 0" X 6' - 0"	3	60	60
MAX 18' - 0" X 8' - 0"	3	60	60

\*All posts must be engaged to achieve design wind load

*JAG* 5/8/02  
 FRANK A FORE P.E.  
 042561

Approved as complying with the Florida Building Code  
 Date: 9/26/02  
 NOA# 102-6207.02  
 Division of Building Control  
 By: *[Signature]*

DESIGN LOAD +60 -60 PSF

**COLLIER**  
 A DIVISION OF SYSTEM DESIGN & MFG. INC.

**FORTRESS**  
 U.S. PATENT NO. 5732758

**Collier/Fortress Level 3 Wind Load Hardware Package**

48 Dalkeith Drive  
 Brantford, Ontario N3P 1N6  
 Phone: 519-759-8090  
 Fax: 519-759-4912

4200 Westroads Drive  
 West Palm Beach, FL 33407  
 Phone: 561-863-0650  
 Fax: 561-881-5635

Collier / Fortress All Rights Reserved.  
 The arrangement depicted herein are the sole property of Collier/Fortress and may not be reproduced in any form without written permission.

Drawing Number D-CFL3WLP-188-IN  
 5.1.02  
 Sheet No. 1 of 2

**2X6 JAMB TO SUPPORTING STRUCTURE ATTACHMENT**

- A) APPROXIMATELY EIGHTY PERCENT OF THE WIND LOAD ( 8640 LBS) FROM THE DOOR IS TRANSFERRED TO THE FORTRESS ALUMINUM C-CHANNEL(S).
- B) ONE-HALF OF THE COMBINED FORTRESS ALUMINUM C-CHANNEL(S) LOAD IS TRANSFERRED TO THE HEADER BRACKET(S) AND THEN FROM THE HEADER BRACKET(S) TO THE FASTENERS (SEE PAGE 1 OF THIS DRAWING)
- C) THE REMAINING ONE-HALF OF THE FORTRESS ALUMINUM C-CHANNEL(S) LOAD IS TRANSFERRED TO THE FLOOR THROUGH THE FLOOR PLATE(S) AND THEN INTO THE FASTENER(S).
- D) THE REMAINING TWENTY PERCENT OF THE WIND LOAD ( 1710 LBS) FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK AND FLAG BRACKETS AND THEN FROM THE TRACK TO THE 2X6 PRESSURE TREATED VERTICAL JAMBS (GRADE #2 OR BETTER YELLOW PINE).
- E) THE FORTRESS HEADER BRACKET(S) SEES A MAXIMUM DESIGN LOAD OF **1230 LB** (615 LB. PER SLEEVE ANCHOR OR 305 LB. PER WALL LAGS)
- F) EACH FLOOR PLATE(S) SEES A MAXIMUM DESIGN LOAD OF **1230 LB** (305 LB. PER TAPCON)
- G) EACH VERTICAL JAMB/TRACK SEES A MAXIMUM DESIGN LOAD OF **856 LB** (143 LB PER WALL LAG)
- H) ALL JAMB FASTENERS MAY BE (BUT NOT REQUIRED) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.

**WOOD FRAME BUILDINGS**

- A) STUD WALLS OF DOOR OPENING SHALL BE FRAMED SOLID BY NOT LESS THAN (3) 2x6 PRESSURE TREATED GRADE #2 OR BETTER WOOD STUD OF A STRESS GRADE NOT LESS THAN **1200 PSI** NOMINAL EXTREME FIBER STRESS BENDING (Fb).
- B) STUD WALLS TO BE CONTINUOUS FROM FOOTING TO TIE BEAMS AND IN ACCORDANCE WITH FBC SECTION **2308.1**.

**BLOCK WALL OR CONCRETE**

- A) 2x6 WOOD JAMB SHALL BE ANCHORED TO GROUT REINFORCED BLOCK WALL OR CONCRETE COLUMN.
- B) BLOCK WALL CELLS SHALL BE FILLED WITH CONCRETE AND REINFORCED WITH #5 BAR EXTENDING INTO FOOTING AND INTO TIE BEAMS.
- C) ALL BARS SHALL BE CONTINUOUS FROM THE TIE BEAMS TO FOOTING PER BLOCK WALL OR CONCRETE COLUMN.
- D) BLOCK WALLS AND CONCRETE COLUMNS TO BE DESIGNED BY BUILDING PROFESSIONAL OF RECORD AND IN ACCORDANCE WITH FBC SECTION **2121.2**.

BUILDING TYPE	FASTENER TYPE	MAXIMUM ON CENTER DISTANCE BETWEEN FASTENERS	STEEL WASHERS REQUIRED
WOOD FRAME (SYP)	1/2" x 3" EMBED LAG SCREW (ASTM A307, GRADE A)	16"	YES
BLOCK WALL OR CONCRETE	1/2" x 1-3/4" MIN. EMBED ITW TAPCON CONCRETE ANCHOR	10"	YES
BLOCK WALL OR CONCRETE	3/8" x 1-3/4" MIN. EMBED RAWL-STUD EXPANSION ANCHOR (7400 SERIES)	19"	NO
BLOCK WALL OR CONCRETE	3/8" x 1-3/4" MIN. EMBED RAWL LOK/BOLT ANCHOR BOLT (5000 SERIES)	16"	NO

\*MINIMUM DISTANCE BETWEEN CENTER OF ANCHOR AND EDGE OF CONCRETE BLOCK: 3", EXCLUDING STUCCO THICKNESS.

COLLIER/FORTRESS DOES NOT SUPPLY JAMB ATTACHMENT FASTENERS.

WHEN USING RAWL-STUD; THE CONCRETE BLOCK MUST BE GROUT FILLED WITH 2000 PSI GROUT

**JAMB PREPARATION NOTE**

- A) EACH TRACK AND FLAG BRACKET SHALL BE FASTENED TO PRESSURE TREATED 2x6 YELLOW PINE WOOD JAMBS WITH 5/16"x1-5/8" LAG SCREWS (9) LAG SCREWS PER SIDE UP TO 70" HIGH AND (10) LAG SCREWS PER SIDE UP TO 80" HIGH.
- B) THE METHOD OF ATTACHMENT TO THE SUPPORTING STRUCTURE OF THE PRESSURE TREATED 2x6 WOOD JAMBS SHALL BE APPROVED BY THE PROFESSIONAL OF RECORD FOR THE STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.
- C) PREPARATION OF JAMBS BY OTHERS.
- D) ALL MOUNTING OF TRACK, ANGLES, HORIZONTAL TRACK SUPPORTS, AND ALL OTHER DOOR HARDWARE TO BE INSTALLED PER COLLIER/FORTRESS INSTALLATION INSTRUCTIONS SUPPLIED WITH DOOR SYSTEM UNLESS OTHERWISE NOTED.

**FORTRESS ALUMINUM C-CHANNEL(S) STORAGE**

- A) ALUMINUM FORTRESS ALUMINUM C-CHANNEL(S) SHALL BE STORED IN A CONSPICUOUS PLACE WITH EASY AND IMMEDIATE ACCESS SO THEY CAN BE REACHED AND INSTALLED ANY TIME HURRICANE WINDS ARE PRESENT.
- B) THE DOOR WITHOUT THE FORTRESS ALUMINUM C-CHANNEL(S) DOES NOT PROVIDE PROTECTION AGAINST HURRICANE WINDS.
- C) THE FORTRESS ALUMINUM C-CHANNEL(S) SHALL BE INSTALLED TO ACHIEVE DESIGN WIND LOADS.

**GENERAL NOTES**

- A) MINIMUM EMBEDMENT OF CONCRETE ANCHORS - 1 1/2"
- B) MINIMUM EMBEDMENT OF LAG SCREWS INTO WOOD - 1 1/2"

THIS APPROVAL REQUIRES THE MANUFACTURER TO DO TESTING OF ALL COILS USED TO FABRICATE DOOR PANELS UNDER THIS NOTICE OF ACCEPTANCE. A MINIMUM OF 2 SPECIMENS SHALL BE CUT FROM EACH COIL AND TENSILE TESTED ACCORDING TO ASTM E-8 BY A DADE COUNTY APPROVED LABORATORY SELECTED AND PAID BY THE MANUFACTURER. EVERY 3 MONTHS 4 TIMES A YEAR THE MANUFACTURER SHALL MAIL TO THIS OFFICE A COPY OF THE TEST REPORTS WITH CONFIRMATION THAT THE SPECIMENS WERE SELECTED FROM COILS AT THE MANUFACTURER'S PRODUCTION FACILITIES. AND A NOTARIZED STATEMENT FROM THE MANUFACTURER THAT ONLY COIL WITH YIELD STRENGTH OF 37,100 PSI OR MORE SHALL BE USED TO MAKE DOOR PANELS FOR DADE COUNTY UNDER THIS NOTICE OF ACCEPTANCE.

5/8/02

*Frank A. Fore, P.E.*  
042561

Approved as complying with the Florida Building Code  
Date 9/26/02  
N/A 02-0207.02  
Miami Dade Product Control  
Division  
By *[Signature]*

DESIGN LOAD +60 -60 PSF

 A DIVISION OF SYSTEM DESIGN & MFG. INC.  U.S. PATENT NO. 5732758	<b>Collier/Fortress Level 3 Wind Load Hardware Package</b>		Drawing Number D-CFL3WLP-188-IN
	48 Dalkeith Drive Brantford, Ontario N3P 1N6 Phone: 519-759-8090 Fax: 519-759-4912	4200 Westroads Drive West Palm Beach, FL 33407 Phone: 561-863-0650 Fax: 561-881-5635	5.1.02
Collier / Fortress All Rights Reserved. The arrangement depicted herein are the sole property of Collier/Fortress and may not be reproduced in any form without written permission.			Sheet No. 2 of 2

